


491/20167.SDW - PHASE 500:

CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN

SALINE, MICHIGAN

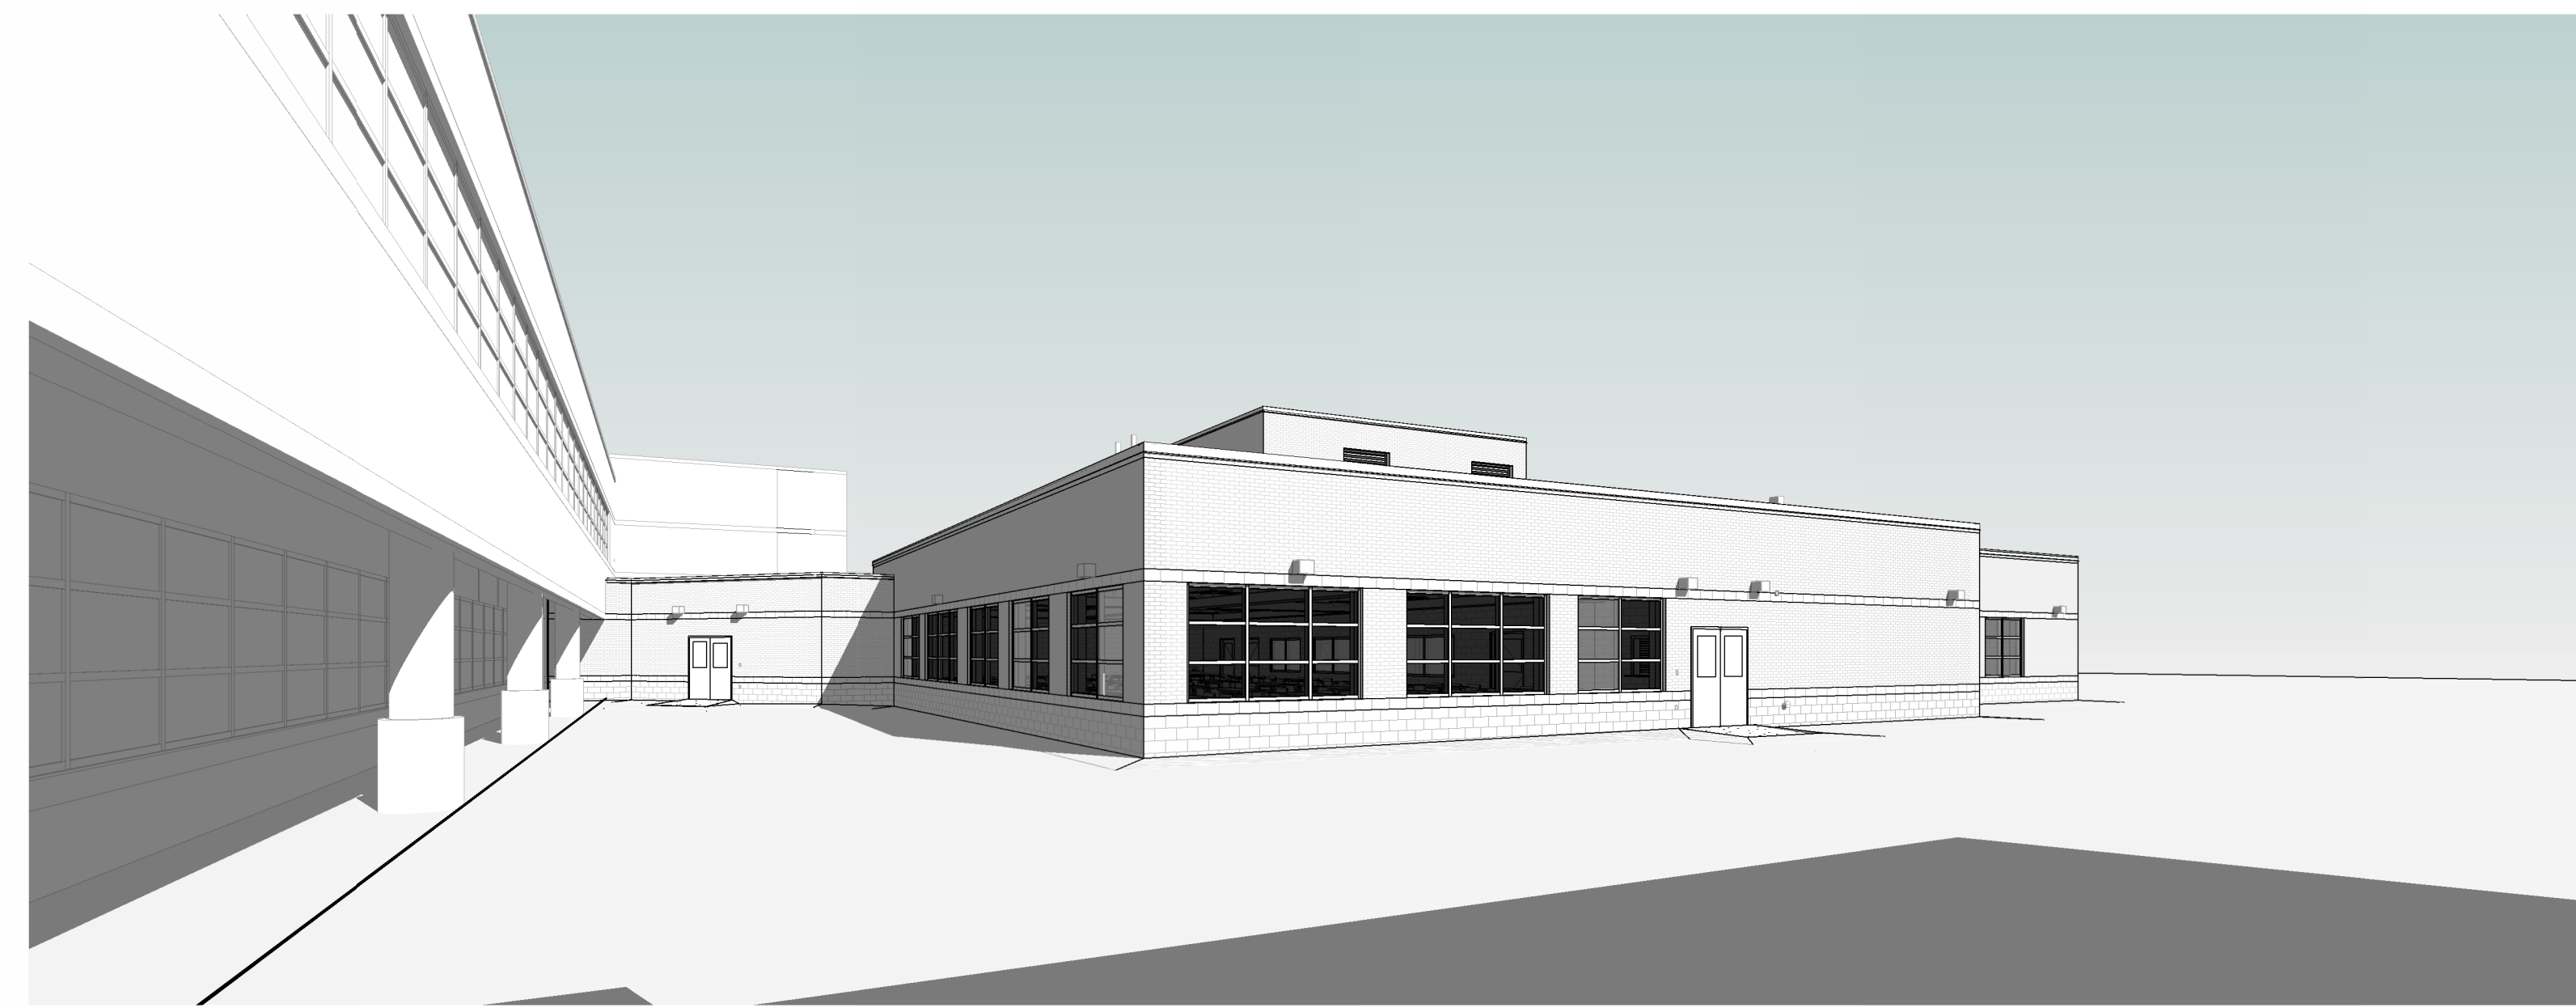

CONTACTS:

ARCHITECT:

WTA ARCHITECTS
100 S. JEFFERSON AVENUE, SUITE 601
SAGINAW, MICHIGAN 48607
PHONE: (989) 752-8107
EMAIL: DESIGN@WTAARCH.COM

STRUCTURAL ENGINEER:

MACMILLAN ASSOCIATES, INC.
714 E. MIDLAND STREET
BAY CITY, MICHIGAN 48706
PHONE: (989) 894-4300
FAX: (989) 864-9930

MECHANICAL & ELECTRICAL ENGINEER:

PETER BASSO ASSOCIATES, INC.
CONSULTING ENGINEERS
5145 LIVERNOIS ROAD, SUITE 100
TROY, MICHIGAN 48098
PHONE: (248) 879-5666
FAX: (248) 879-0007

CIVIL ENGINEER:

ROWE PROFESSIONAL SERVICES COMPANY
127 S. MAIN STREET
MT. PLEASANT, MICHIGAN 48858
PHONE: (989) 772-2138
FAX: (989) 773-7757

FOOD SERVICE:

STAFFORD SMITH, INC.
3414 SOUTH BURDICK STREET
KALAMAZOO, MICHIGAN 49001
PHONE: (800) 962-2442
PHONE: (269) 343-1240

COMMUNICATIONS & IT:

COMMTECH DESIGN
6581 BELDING RD NE SUITE #101
ROCKFORD, MICHIGAN 49341
PHONE: (616) 446-4545
PHONE: (616) 863-8132

INDEX OF DRAWINGS:

TS TITLE SHEET

CIVIL DRAWINGS

- C1.01 CIVIL LEGEND
- C1.02 CIVIL NOTES
- C1.03 CIVIL DETAILS
- C1.04 FENCE DETAILS

- C2.01 SITE DEMOLITION PLAN
- C2.02 SITE PLAN
- C2.03 UTILITY PLAN
- C2.04 GRADING PLAN

ARCHITECTURAL DRAWINGS

- A0.01 PROJECT INFORMATION
- A2.01 FIRST FLOOR MASTER CODE PLAN
- A2.02 FIRST FLOOR PARTIAL CODE PLAN
- A2.11 FIRST FLOOR DEMOLITION PLAN

- A2.21 FIRST FLOOR CONSTRUCTION PLAN
- A2.22 SECOND FLOOR CONST. PLN., ENLARGED PLN., & INTERIOR ELEVATION
- A2.23 FIRST & SECOND FLOOR FLOORING PLANS

- A2.31 PLAN DETAILS

- A3.01 ROOM FINISH & DOOR SCHEDS, DOOR & WDW TYPES, AND DOOR DTLS

- A4.01 VERTICAL CIRCULATION

- A5.01 EXTERIOR ELEVATIONS

- A5.11 BUILDING SECTIONS

- A6.01 ROOF PLAN

- A7.01 WALL SECTIONS & DETAILS
- A7.02 WALL SECTIONS & DETAILS

- A9.01 FIRST & SECOND FLOOR REFLECTED CEILING PLAN

FOOD SERVICE DRAWINGS

- FS2.01 KITCHEN EQUIPMENT PLAN
- FS2.02 KITCHEN ELECTRICAL PLAN
- FS2.03 KITCHEN PLUMBING PLAN
- FS2.04 KITCHEN VENTILATION PLAN
- FS2.05 SPECIAL CONDITIONS PLAN

STRUCTURAL DRAWINGS

- S2.01 FOUNDATION PLAN
- S2.02 ROOF FRAMING PLAN

- S3.01 NOTES AND SCHEDULES

- S5.01 FOUNDATION DETAILS

- S7.01 ROOF FRAMING DETAILS

MECHANICAL DRAWINGS

- M0.01 MECHANICAL STANDARDS AND DRAWING INDEX

- M1.01 FIRE PROTECTION ZONING PLAN

- M2.00 UNDERGROUND PLUMBING PLAN
- M2.01 FIRST FLOOR PLUMBING AND FIRE PROTECTION PLAN - UNIT H

- M2.02 FIRST FLOOR PLUMBING AND FIRE PROTECTION PLAN - UNIT J

- M2.03 PENTHOUSE PLUMBING PLAN

- M3.01 FIRST FLOOR HVAC PIPING PLAN - UNIT H

- M3.03 PENTHOUSE HVAC PIPING PLAN

- M4.01 FIRST FLOOR SHEET METAL PLAN - UNIT H

- M4.03 PENTHOUSE SHEET METAL PLAN

- M4.04 MECHANICAL ROOF PLAN

- M5.01 PLUMBING ENLARGED PLAN

- M6.01 MECHANICAL DETAILS
- M6.02 MECHANICAL DETAILS
- M6.03 MECHANICAL DETAILS
- M6.04 MECHANICAL DETAILS

- M7.01 MECHANICAL SCHEDULES
- M7.02 MECHANICAL SCHEDULES
- M7.03 MECHANICAL SCHEDULES
- M7.04 MECHANICAL SCHEDULES

- M8.01 TEMPERATURE CONTROL STANDARDS AND GENERAL NOTES
- M8.02 TEMPERATURE CONTROLS
- M8.03 TEMPERATURE CONTROLS
- M8.04 TEMPERATURE CONTROLS

ELECTRICAL DRAWINGS

- E0.01 ELECTRICAL STANDARDS AND DRAWING INDEX

- E0.02 ELECTRICAL STANDARD SCHEDULES
- E0.03 ELECTRICAL DEMOLITION SITE PLAN
- E0.04 ELECTRICAL NEW WORK SITE PLAN

- ED1.01 FIRST FLOOR ELECTRICAL DEMOLITION PLAN

- E2.01 FIRST FLOOR LIGHTING PLAN - UNIT H

- E3.00 BASEMENT FLOOR POWER PLAN - UNIT H
- E3.01 FIRST FLOOR POWER PLAN - UNIT H

- E4.01 FIRST FLOOR AUXILIARY SYSTEMS PLAN - UNIT H

- E4.04 ELECTRICAL ROOF PLAN

- E5.01 ONE LINE DIAGRAM - NEW WORK
- E5.02 PANEL SCHEDULES

- E6.01 ELECTRICAL ENLARGED PLAN
- E6.02 ELECTRICAL ENLARGED PLAN

- E7.00 ELECTRICAL DETAILS AND DIAGRAMS
- E7.01 ELECTRICAL DETAILS AND DIAGRAMS

COMMUNICATIONS & IT DRAWINGS

- TC1.01 CABLING LEGENDS, SCHEDULES & DETAILS
- TC1.02 CABLING CONNECTIVITY CODES
- TC1.03 CABLING RACK LAYOUTS & DETAILS
- TC1.04 FENCE DETECTION DETAILS
- TC1.05 ACCESS CONTROL DEVICES
- TC1.06 SECURITY ACCESS CONTROL DETAILS
- TC1.07 VIDEO SECURITY SYSTEM DETAILS

- TC2.00 TECHNOLOGY SITE PLAN
- TC2.01 FIRST FLOOR TECHNOLOGY PLAN
- TC2.01A BASEMENT TECHNOLOGY PLAN AREA 100

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACHE, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE

491/20167.SDW - PHASE 500:

CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN

SALINE, MICHIGAN

SHEET TITLE

TITLE SHEET

PROJECT NUMBER

2021094

PROJECT DATE

SEPTEMBER 6, 2023

CHECKED BY

C.D.S.

SHEET NUMBER

TS

STRUCTURE SYMBOLS

- ◻ EXISTING CATCH BASIN IN CURB LINE
- PROPOSED CATCH BASIN IN CURB LINE
- ⊙ EXISTING CATCH BASIN IN GREEN SPACE
- PROPOSED CATCH BASIN IN GREEN SPACE
- EXISTING STORM MANHOLE
- PROPOSED STORM MANHOLE
- PROPOSED CULVERT END SECTION
-) EXISTING HEADWALL
-) PROPOSED HEADWALL
- * EXISTING GATE VALVE AND BOX
- * EXISTING WATER SHUT OFF (CURB BOX)
- PROPOSED GATE VALVE AND BOX
- EXISTING GATE VALVE AND WELL
- PROPOSED GATE VALVE AND WELL
- × EXISTING SPRINKLER HEAD
- EXISTING WATER WELL
- ⊕ EXISTING FIRE HYDRANT
- ⊕ PROPOSED FIRE HYDRANT
- ┌─┐ PROPOSED WATER MAIN FITTINGS
- EXISTING CLEAN OUT
- EXISTING SANITARY SEWER MANHOLE
- PROPOSED SANITARY SEWER MANHOLE
- ⊠ EXISTING MONITORING WELL

EXISTING TOPOGRAPHICAL SYMBOLS

- ≡ SIGN
- ↑ STREET SIGN
- ≡ END OF PIPE
- ≡ SWAMP OR WETLAND
- ⊙ DECIDUOUS TREE
- ☀ CONIFEROUS TREE
- ⊕ TREE STUMP
- * MAIL BOX
- ⊠ SOIL BORING
- ROCK
- METAL POST
- BUMPER BLOCK

UTILITY SYMBOLS

- UTILITY POLE
- > GUY ANCHOR CABLE
- * LIGHT POLE / ORNAMENTAL LIGHT
- ⊕ POWER LIGHT POLE
- TELEPHONE MANHOLE
- + UNDERGROUND GAS LINE MARKER
- GAS RISER
- GAS VENT
- * GAS VALVE
- ⊕ RAILROAD SIGNAL
- * METAL LIGHT POLE
- OUTLET
- CIRCUIT BREAKER PANEL
- ⊠ ELECTRICAL TRANSFORMER PAD
- ⊠ ELECTRICAL TRANSFORMER RISER
- ⊖ ELECTRIC METER
- TELEPHONE PEDESTAL / RISER
- ⊠ TRAFFIC SIGNAL ON POLE
- PHONE BOOTH / PAY PHONE

SURVEY SYMBOLS

- MONUMENT
- ▲ BENCHMARK
- △ TRAVERSE POINT
- ⊕ SECTION CORNER
- FOUND SURVEY MONUMENTATION

MISCELLANEOUS SYMBOLS

- EX 1812 EXISTING STORM SEWER STRUCTURE NUMBER
- EX 5236 EXISTING SANITARY SEWER STRUCTURE NUMBER
- 1 PROPOSED STORM SEWER STRUCTURE NUMBER
- A PROPOSED SANITARY SEWER STRUCTURE NUMBER
- ~ FLOW DIRECTION
- ⊗ EXISTING RIP-RAP
- ⊗ PROPOSED RIP-RAP

CAUTION SYMBOLS

- CAUTION●● HAZARDOUS FLAMMABLE MATERIAL UNDERGROUND USED WITH UNDERGROUND GAS & ELECTRICAL LINES
- CAUTION●● FIBER OPTIC USED WITH FIBER OPTICS LINES

PLAN VIEW LINE TYPES

- 12" STM ----- EXISTING STORM SEWER
- 12" COMC ----- EXISTING CULVERT
- PROPOSED STORM SEWER LESS THAN 24"
- PROPOSED STORM SEWER 24" AND GREATER
- 12" SAN ----- EXISTING SANITARY SEWER
- PROPOSED SANITARY SEWER
- 12" WM ----- EXISTING WATER MAIN
- PROPOSED WATER MAIN
- SECTION LINE
- 60' ROW ----- EXISTING RIGHT OF WAY
- 60' ROW ----- PROPOSED RIGHT OF WAY
- PROPOSED EASEMENT
- EXISTING CENTER LINE DITCH
- PROPOSED DITCH CENTERLINE
- EXISTING CENTER LINE ROADWAY
- PARCEL LINE / LOT LINE
- 0/H ----- EXISTING OVERHEAD UTILITIES
- U/G ELEC ----- UNDERGROUND ELECTRICAL LINE
- 6" S-MP GAS ----- GAS LINE OR PETROLEUM PIPELINE
- U/G TEL ----- UNDERGROUND TELEPHONE LINE
- U/G CATV ----- UNDERGROUND CABLE TV LINE
- U/G FIBER OPTIC ----- UNDERGROUND FIBER OPTIC
- 11+00 ----- PROJECT CONTROL LINE
- ~~~~~ TREE LINE
- ~~~~~ BRUSH LINE
- X----- EXISTING FENCE
- X----- PROPOSED FENCE
- EXISTING GUARD RAIL
- PROPOSED SLOPE STAKE LINE
- PROPOSED SILT FENCE

TOPOGRAPHY

- 960 EXISTING CONTOURS MAJOR
- 958 EXISTING CONTOURS MINOR
- 960 PROPOSED CONTOUR MAJOR
- 958 PROPOSED CONTOURS MINOR

PARCEL INFORMATION

- 401-069 PARCEL/TAX IDENTIFICATION NUMBER
- #5324 ADDRESS/BUSINESS NAME

PAVEMENT IDENTIFICATION

- ===== EXISTING CURB AND GUTTER

HATCHING LEGEND

- REMOVE PAVEMENT
- REMOVE SIDEWALK
- PROPOSED CONCRETE SIDEWALK
- PROPOSED CONCRETE PAVEMENT
- PROPOSED HMA PAVEMENT
- SAND BACKFILL (PROFILE)

PROPOSED CALLOUTS

- | TOPO CALLOUTS | PLAN VIEW | |
|---------------|-----------|-------------------------------|
| ADJ | ADJ | ADJUST STRUCTURE |
| ADJ-X | ADJ-X | ADJUST STRUCTURE W/ NEW COVER |
| ADJ-B/O | ADJ-B/O | ADJUST STRUCTURE BY OTHERS |
| REC | REC | RECONSTRUCT STRUCTURE |
| REL | REL | RELOCATE |
| REL-B/O | REL-B/O | RELOCATE BY OTHERS |
| REM | R | REMOVE |
| R&R | R&R | REMOVE AND REPLACE |
| SALV | SALV | SALVAGE |
| SAVE | S | SAVE |
| ABN | A | ABANDON |
| CLR | C | CLEARING |
| | B | BULKHEAD |
| | SR-F | SIDEWALK RAMP TYPE |
| | 6 | SOIL EROSION CONTROL MEASURE |




NO.	REVISION	DATE



FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

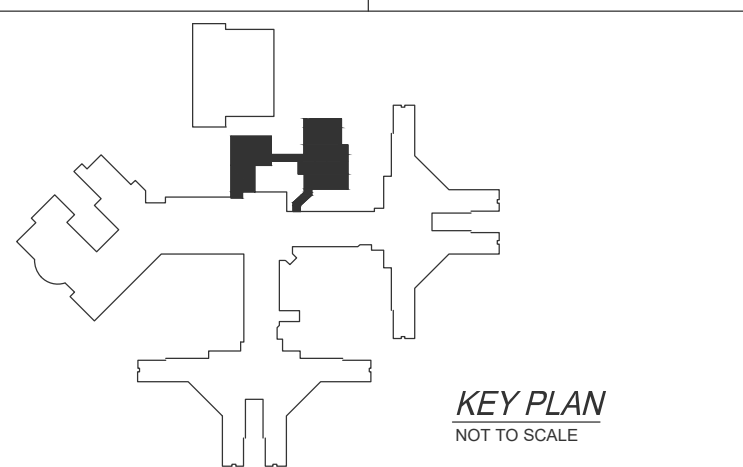

WTAARCH.COM

WTA ARCHITECTS
100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

ROWE PROFESSIONAL SERVICES COMPANY

PROJECT TITLE
491/20167.SDW CFP - PHASE 500
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
CIVIL LEGEND

PROJECT NUMBER	SHEET NUMBER
2021094	C1.01
PROJECT DATE SEPTEMBER 6, 2023	
CHECKED BY A.J.T.	

GENERAL CONSTRUCTION NOTES

EMERGENCY CONTACTS

BEFORE BEGINNING WORK ON THE PROJECT, THE CONTRACTOR SHALL PROVIDE THE OWNER AND ENGINEER WITH THE NAMES AND TELEPHONE NUMBERS OF EMERGENCY CONTACTS. AT LEAST ONE PERSON REPRESENTING THE CONTRACTOR SHALL BE AVAILABLE TO RESPOND TO EMERGENCIES THROUGHOUT THE LIFE OF THE PROJECT, 24 HOURS A DAY, 7 DAYS A WEEK.

UNDERGROUND UTILITY IDENTIFICATION AND LOCATION

CONTRACTOR TO COMPLETE GROUND PENETRATING RADAR WITHIN CONSTRUCTION LIMITS TO DETERMINE THE EXACT LOCATION OF UNDERGROUND UTILITIES PRIOR TO BEGINNING EXCAVATION.

PUBLIC UTILITIES

EXISTING UTILITIES ARE SHOWN BASED UPON RECORDS AND LOCATIONS PROVIDED BY UTILITY AGENCIES. THE INFORMATION SHOWN IS CONSIDERED APPROXIMATE AND SHALL BE VERIFIED BY THE CONTRACTOR. UNLESS THE PLANS SPECIFICALLY SHOW THAT EXISTING UTILITIES ARE TO BE MOVED, THE CONTRACTOR IS RESPONSIBLE TO PROTECT AND MAINTAIN EXISTING UTILITIES.

VERIFICATION OF UNDERGROUND UTILITIES

THE CONTRACTOR SHALL EXCAVATE AND LOCATE ALL EXISTING UTILITIES IN THE PROJECT AREA IN ADVANCE OF CONSTRUCTION TO VERIFY THEIR ACTUAL LOCATION. POTENTIAL CONFLICTS SHALL BE REPORTED TO THE ENGINEER. THE CONTRACTOR SHALL MAKE SUCH CHANGES TO GRADE AND ALIGNMENT OF PROPOSED WORK AS DIRECTED BY THE ENGINEER TO AVOID CONFLICTS, AT NO INCREASE IN COST TO THE OWNER.

UTILITY SERVICE

UNLESS SPECIFICALLY PROVIDED OTHERWISE IN THE CONTRACT DOCUMENTS, ALL EXISTING UTILITIES ARE TO REMAIN IN SERVICE DURING THE PROJECT.

PRIVATE IRRIGATION SYSTEMS

THE CONTRACTOR SHALL COORDINATE WITH THE FACILITY TO DETERMINE THE LOCATION OF THE IRRIGATION SYSTEM PRIOR TO THE START OF CONSTRUCTION. THE SYSTEM IS TO BE REVISED TO ACCOMMODATE PROPOSED SITE WORK.

SOIL BORINGS / PAVEMENT CORES

IF PROVIDED ON THE PLANS OR IN THE CONTRACT DOCUMENTS, LOGS OF SOIL BORINGS OR PAVEMENT CORES REPRESENT THE SUBSURFACE CONDITIONS ENCOUNTERED AT SPECIFIC POINTS. THE INFORMATION IS PROVIDED FOR THE CONTRACTOR'S INFORMATION ONLY.

MAINTAINING TRAFFIC

LOCAL AND EMERGENCY TRAFFIC SHALL BE MAINTAINED AT ALL TIMES WITHIN THE PROJECT AREA.

WHEN EXCAVATION, FRESH CONCRETE, OR OTHER CONSTRUCTION WORK WILL RESULT IN THE CLOSURE OF A STREET OR DRIVEWAY FOR A PERIOD OF TIME, THE CONTRACTOR IS RESPONSIBLE TO NOTIFY ALL AFFECTED RESIDENTS AND BUSINESSES IN ADVANCE.

THE CONTRACTOR SHALL NOTIFY EMERGENCY RESPONSE AGENCIES IN ADVANCE OF ROAD CLOSURES OR THE ESTABLISHMENT OF DETOURS.

SCHEDULE

THE CONTRACTOR SHALL COMPLETE ALL WORK IN AN EXPEDITIOUS MANNER AND SHALL NOT STOP WORK ON THE PROJECT ONCE BEGUN.

ALIGNMENT

ALIGNMENT AND GRADES FOR CURB AND GUTTER (INCLUDING THROUGH RAMPS AND DRIVEWAY OPENINGS) SHOWN ON THE PLANS ARE FOR THE TOP, BACK OF CURB, UNLESS SPECIFICALLY SHOWN OTHERWISE ON THE PLANS.

THE HORIZONTAL ALIGNMENT SHOWN ON THE DRAWINGS FOR DRAINAGE STRUCTURES LOCATED IN THE CURB LINE IS TO THE CENTER OF THE CASTING.

THE HORIZONTAL ALIGNMENT SHOWN ON THE DRAWINGS FOR DRAINAGE STRUCTURES WHICH ARE NOT IN THE CURB LINE AND FOR MANHOLES IS TO THE CENTER OF THE STRUCTURE.

WHERE RIM ELEVATIONS ARE PROVIDED ON THE PLANS FOR MANHOLE CASTINGS, THE ELEVATION PROVIDED IS FOR THE TOP OF THE CASTING.

WHERE RIM ELEVATIONS ARE PROVIDED FOR INLET TYPE CASTINGS, THE ELEVATIONS ARE PROVIDED AS FOLLOWS:

- CURB INLETS – THE ELEVATION OF THE TOP OF CURB
- ALL OTHER INLETS – THE ELEVATION OF THE FLOW LINE

WHERE RIM ELEVATIONS ARE PROVIDED ON THE PLANS FOR INLETS OR MANHOLE CASTINGS, THE ELEVATIONS PROVIDED ARE CONSIDERED PRELIMINARY. THE CONTRACTOR SHALL MAKE THE FINAL ADJUSTMENT FOLLOWING THE ESTABLISHMENT OF ACTUAL GRADING AND PAVEMENT ELEVATIONS.

CONSTRUCTION STAKING

WHEN CONSTRUCTION STAKING IS TO BE PROVIDED BY THE ENGINEER OR OWNER, THE CONTRACTOR SHALL REQUEST STAKING AT LEAST THREE WORKING DAYS IN ADVANCE.

WHEN CONSTRUCTION STAKING IS TO BE PROVIDED BY THE ENGINEER OR OWNER, STAKING WILL BE PROVIDED ONE TIME. THE CONTRACTOR SHALL PROTECT AND PRESERVE SURVEY CONTROL AND STAKING. RE-STAKING WILL BE AT THE CONTRACTOR'S EXPENSE.

SURVEY CORNERS, BENCHMARKS, AND CONTROL POINTS

THE CONTRACTOR SHALL PRESERVE ALL GOVERNMENT CORNERS, PROPERTY CORNERS, BENCHMARKS, SURVEY CONTROL POINTS AND OTHER SURVEY POINTS WITHIN THE PROJECT AREA. WHERE CORNERS, BENCHMARKS, OR SURVEY POINTS ARE ENCOUNTERED WHICH WILL BE DISTURBED BY THE CONTRACTOR'S ACTIVITIES, A LICENSED SURVEYOR SHALL WITNESS THE POINT BEFORE DISTURBANCE AND SHALL RE-SET THE POINT FOLLOWING THE COMPLETION OF CONSTRUCTION ACTIVITIES. THE CONTRACTOR SHALL PAY THE SURVEYOR TO WITNESS AND TO RE-SET THE POINTS.

PROTECTION OF TREES, SHRUBS, AND LANDSCAPING

ALL TREES, SHRUBS, AND LANDSCAPING WITHIN THE CONSTRUCTION AREA WHICH ARE NOT SPECIFICALLY DESIGNATED FOR REMOVAL SHALL BE PROTECTED FROM DAMAGE BY THE CONTRACTOR. DAMAGED TREES, SHRUBS, AND LANDSCAPING SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.

CONSTRUCTION SIGNING AND BARRICADING

THE CONTRACTOR SHALL PROTECT HAZARDOUS AREAS WITH BARRICADES. BARRICADES LEFT IN PLACE AFTER SUNSET SHALL BE LIGHTED.

THE CONTRACTOR SHALL PROVIDE SUITABLE SANDBAGS OR OTHER SUITABLE MEASURES FOR ANCHORING OF TEMPORARY SIGNS AND BARRICADES, TO PREVENT THEIR TIPPING OR DISPLACEMENT BY WIND OR AIR FLOW FROM VEHICLES.

THE CONTRACTOR SHALL PROVIDE SIGNING, BARRICADES, TRAFFIC REGULATORS, CONES, AND OTHER TRAFFIC CONTROL DEVICES IN ACCORDANCE WITH THE REQUIREMENTS OF THE AGENCY HAVING JURISDICTION OVER STREETS OR ROADS IN THE PROJECT AREA, THE CURRENT MICHIGAN MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES, AND THE PLANS AND SPECIFICATIONS.

THE CONTRACTOR SHALL COVER OR REMOVE TEMPORARY SIGNS DURING PERIODS WHEN THEY ARE NOT APPROPRIATE.

TURF ESTABLISHMENT

ALL DISTURBED AREAS WHICH ARE NOT TO BE SURFACED WITH PAVEMENT, AGGREGATE OR OTHER APPROVED SURFACES SHALL BE ESTABLISHED WITH TURF.

TURF AREAS SHALL BE GRADED TO PROVIDE POSITIVE DRAINAGE.

DISTURBED AREAS SHALL BE SURFACED WITH FOUR INCHES OF SCREENED TOPSOIL.

THE CONTRACTOR IS RESPONSIBLE TO ESTABLISH TURF WHICH IS SUBSTANTIALLY FREE OF BARE SPOTS AND FREE OF WEEDS. THE GROUND SURFACE IN TURF AREAS SHALL BE SMOOTH AND PROVIDE A NATURAL TRANSITION TO ADJACENT, UNDISTURBED AREAS.

THE CONTRACTOR IS RESPONSIBLE TO PROVIDE WATERING, WEEDING, RESEEDING, AND REWORKING AS NECESSARY TO ESTABLISH TURF AREAS TO THE REQUIRED STANDARD.

ADA COMPLIANCE

ALL PROPOSED CONSTRUCTION SHALL COMPLY WITH THE PROVISIONS OF THE AMERICANS WITH DISABILITIES ACT (ADA), AND APPLICABLE GUIDELINES OR STANDARDS. WHERE EXISTING CONDITIONS AND/OR THE REQUIREMENTS OF THE PLANS WILL RESULT IN FINISHED CONDITIONS THAT DO NOT MEET THE ADA REQUIREMENTS, GUIDELINES, OR STANDARDS; THE CONTRACTOR SHALL NOTIFY THE ENGINEER BEFORE PROCEEDING WITH CONSTRUCTION. THE CONTRACTOR IS RESPONSIBLE TO REMOVE AND REPLACE WORK DETERMINED TO BE NOT IN ACCORDANCE WITH APPLICABLE REQUIREMENTS, GUIDELINES, OR STANDARDS.

EARTHWORK

THE CONTRACTOR SHALL MAKE HIS OWN DETERMINATION OF THE EARTHWORK QUANTITIES, AND BASE HIS BID ON HIS DETERMINATION OF THE QUANTITIES OF WORK REQUIRED.

IF ADDITIONAL FILL MATERIAL MUST BE PROVIDED TO ATTAIN THE FINISH GRADES SHOWN ON THE PLANS, THE CONTRACTOR SHALL PROVIDE THE REQUIRED FILL MATERIAL, UNLESS A SPECIFIC BORROW AREA IS IDENTIFIED ON THE PLANS.

EXCESS SOILS RESULTING FROM EXCAVATION AND EARTHWORK SHALL BECOME THE CONTRACTOR'S PROPERTY AND DISPOSED OF PROPERLY, UNLESS AN AREA(S) HAS BEEN DESIGNATED FOR STOCKPILING OR "BLENDING IN" THE EXCESS MATERIAL WITHIN THE PROJECT LIMITS.

BACKFILL AND EMBANKMENT

BACKFILL OF AN EXCAVATION UNDER OR WITHIN THE ONE ON ONE INFLUENCE OF AN EXISTING OR PROPOSED ROAD, SIDEWALK, DRIVEWAY, PAVEMENT, OR AGGREGATE SURFACE, SHALL BE SAND, MEETING THE REQUIREMENTS OF GRANULAR MATERIAL CLASS II AS DESCRIBED IN THE CURRENT MICHIGAN DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR CONSTRUCTION. THE SAND BACKFILL SHALL BE COMPACTED TO AT LEAST 95% OF ITS MAXIMUM UNIT WEIGHT.

BACKFILL OF AN EXCAVATION WHICH IS NOT UNDER OR WITHIN THE ONE ON ONE INFLUENCE OF AN EXISTING OR PROPOSED ROAD, SIDEWALK, DRIVEWAY, PAVEMENT, OR AGGREGATE SURFACE MAY BE SUITABLE EXCAVATED MATERIAL OR OTHER SOIL, WHICH IS FREE OF ORGANIC MATTER, STONES AND ROCKS, ROOTS, BROKEN CONCRETE, FROZEN MATERIAL, OR DEBRIS. THE BACKFILL SHALL BE COMPACTED TO AT LEAST 90% OF ITS MAXIMUM UNIT WEIGHT.

THE CONTRACTOR SHALL INDICATE THE SOURCE OF SAND USED FOR BACKFILL TO THE ENGINEER, AND PROVIDE THE ENGINEER WITH THE RESULTS OF A GRADATION TEST PERFORMED ON A SAMPLE OF THE SAND. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IN ADVANCE OF USING SAND FROM OTHER SOURCES.

EMBANKMENT USED TO BUILD THE SUBGRADE TO REQUIRED ELEVATION SHALL BE SUITABLE SOIL EXCAVATED FROM THE PROJECT SITE, OR FURNISHED BY THE CONTRACTOR FROM OTHER SOURCES. SUITABLE SOIL IS FREE FROM ORGANIC MATTER, ROCKS AND STONES, FROZEN MATERIAL, BROKEN CONCRETE, AND DEBRIS.

EMBANKMENT CONSTRUCTED OF GRANULAR SOILS SHALL BE COMPACTED IN LIFTS NOT EXCEEDING 10 INCHES TO AT LEAST 95% OF ITS MAXIMUM UNIT WEIGHT.

EMBANKMENT CONSTRUCTED OF COHESIVE SOILS SHALL BE COMPACTED IN LIFTS NOT EXCEEDING 10 INCHES TO AT LEAST 95% OF ITS MAXIMUM UNIT WEIGHT.

DENSITY TESTING

THE MAXIMUM UNIT WEIGHT OF SAND AND OTHER GRANULAR SOILS WILL BE DETERMINED BY THE ONE POINT CONE TEST, AS DESCRIBED IN THE MICHIGAN DEPARTMENT OF TRANSPORTATION'S DENSITY TESTING AND INSPECTION MANUAL, EXCEPT WHEN ANOTHER TEST METHOD IS SPECIFIED.

THE MAXIMUM UNIT WEIGHT OF COHESIVE SOILS WILL BE DETERMINED BY THE ONE POINT PROCTOR TEST, AS DESCRIBED IN THE MICHIGAN DEPARTMENT OF TRANSPORTATION'S DENSITY TESTING AND INSPECTION MANUAL, EXCEPT WHEN ANOTHER TEST METHOD IS SPECIFIED.

DRAINAGE

THE CONTRACTOR SHALL MAINTAIN DRAINAGE OF THE PROJECT AREA AND ADJACENT AREAS. WHERE EXISTING DRAINAGE FACILITIES ARE DISTURBED OR BLOCKED BY CONSTRUCTION, THE CONTRACTOR SHALL PROVIDE AND MAINTAIN TEMPORARY PROVISIONS FOR DRAINAGE.

WHERE CONSTRUCTION HAS DISTURBED EXISTING DITCHES, SWALES, OR OTHER DRAINAGE FACILITIES; THE CONTRACTOR SHALL RESTORE THEM TO THEIR GRADES AND DIMENSIONS WHICH EXISTED PRIOR TO THE BEGINNING OF CONSTRUCTION, UNLESS DIRECTED OTHERWISE.

DRAINAGE SHALL NOT BE REROUTED ONTO ADJACENT PROPERTIES NOR ALLOWED TO DRAIN ONTO ADJACENT PROPERTIES AT AN INCREASED RATE, AS A RESULT OF THE CONTRACTOR'S WORK.

SIDEWALK CONSTRUCTION

SIDEWALKS SHALL BE CONSTRUCTED TO PROVIDE POSITIVE DRAINAGE OF THE SIDEWALK AND ADJACENT SURFACES.

EXCEPT WHERE NECESSARY TO PROVIDE POSITIVE DRAINAGE OR MEET EXISTING SURFACES, SIDEWALK SHALL BE CONSTRUCTED WITH A CROSS SLOPE SLOPED TOWARD THE STREET.

SIDEWALK CROSS SLOPES SHALL NOT EXCEED 2%.

IN TURF AREAS, THE SURFACE OF THE SIDEWALK SHALL BE ABOUT 1/4 INCH HIGHER THAN THE ADJACENT GROUND SURFACES, EXCEPT WHERE NECESSARY TO PROVIDE POSITIVE DRAINAGE OR MEET EXISTING SIDEWALKS, CURBS, OR PAVEMENTS.

SIDEWALK SHALL BE CONSTRUCTED ON A SAND BASE, COMPACTED TO AT LEAST 95% OF ITS MAXIMUM UNIT WEIGHT.

THE CONTRACTOR SHALL NOTIFY THE ENGINEER WHEN SIDEWALK FORMS HAVE BEEN SET AND THE SAND BASE PREPARED. CONCRETE SHALL NOT BE PLACED UNTIL THE ENGINEER HAS OBSERVED THE FORMS. CONCRETE DELIVERY SHALL BE SCHEDULED TO ALLOW SUFFICIENT TIME FOR ADJUSTMENT OF THE FORMS, IN THE EVENT THAT ADJUSTMENT IS NECESSARY.

THE CONTRACTOR SHALL PROTECT FRESH CONCRETE FROM DAMAGE BY THE WEATHER, TRAFFIC, OR VANDALISM. DAMAGED CONCRETE SHALL BE REPLACED BY THE CONTRACTOR'S EXPENSE.

STORM SEWER CONSTRUCTION NOTES

DRAINAGE STRUCTURES SHALL BE CONSTRUCTED FROM PRECAST CONCRETE MANHOLE SECTIONS, MEETING ASTM C478.

SUMPS IN DRAINAGE STRUCTURES AND PIPELINES SHALL BE FREE OF SEDIMENT AND DEBRIS AT THE TIME OF ACCEPTANCE BY THE OWNER.

ROAD PROJECTS

ADJUSTING STRUCTURES

WHERE CASTINGS FOR MANHOLES, CATCH BASINS, INLETS, VALVE BOXES, AND MONUMENT BOXES ARE TO BE ADJUSTED TO MEET A NEW PAVEMENT SURFACE ELEVATION, THE FINAL ADJUSTMENT SHALL NOT BE COMPLETED UNTIL ALL PAVEMENT COURSES HAVE BEEN PLACED EXCEPT THE FINAL COURSE. THE FINAL ADJUSTMENT SHALL BE COMPLETED JUST PRIOR TO PLACEMENT OF THE FINAL COURSE OF PAVEMENT.

THE MATERIALS AND PROCEDURES FOR ADJUSTING STRUCTURES SHALL MEET THE REQUIREMENTS OF THE AGENCIES HAVING JURISDICTION OVER THE ROAD AND UTILITIES.

SUBGRADE PREPARATION

TOPSOIL, PEAT, AND ORGANIC MATERIAL SHALL BE EXCAVATED AND REMOVED.

SOFT AND YIELDING SOILS SHALL BE REMOVED OR DRIED IF THE RESULT OF EXCESSIVE MOISTURE CONTENT.

PRIOR TO CONSTRUCTING FILLS, SUBBASE, OR PAVEMENT ON A SUBGRADE, THE SUBGRADE SHALL BE PROOF-ROLLED TO DETERMINE THE SUITABILITY OF THE SUBGRADE. THE CONTRACTOR SHALL DRIVE A HEAVY PIECE OF WHEELED CONSTRUCTION EQUIPMENT OVER THE SUBGRADE WHILE THE ENGINEER IS OBSERVING. THE CONSTRUCTION OF FILLS, SUBBASE, OR PAVEMENTS SHALL NOT PROCEED UNTIL THE SUBGRADE HAS BEEN DEMONSTRATED TO BE FREE OF SOFT AREAS.

THE CONTRACTOR IS RESPONSIBLE TO MAINTAIN THE MOISTURE CONTENT OF SUBGRADE SOILS WITHIN A SUITABLE RANGE TO ALLOW FOR COMPACTION TO THE REQUIRED DENSITY. WHEN THE SOIL IS TOO DRY, THE CONTRACTOR SHALL ADD WATER. WHEN THE SOIL IS TOO WET, THE CONTRACTOR SHALL PROVIDE DRAINAGE OR AERATE THE SOIL.

THE SURFACE OF THE SUBGRADE SHALL BE COMPACTED TO AT LEAST 95% OF ITS MAXIMUM UNIT WEIGHT, PRIOR TO CONSTRUCTING FILLS, SUBBASE, OR PAVEMENTS.

HOT MIX ASPHALT (HMA) PAVING

PAVEMENTS WHICH ARE TO BE OVERLAID WITH A NEW PAVEMENT COURSE SHALL BE SWEEPED TO REMOVE ALL DIRT AND DEBRIS.

A BITUMINOUS BOND COAT SHALL BE APPLIED TO PAVEMENTS WHICH ARE TO BE OVERLAID WITH A NEW PAVEMENT COURSE AND ALLOWED TO CURE PRIOR TO CONSTRUCTING THE NEW PAVEMENT COURSE.

HMA PAVEMENT SHALL NOT BE PLACED WHEN THE SURFACE BEING OVERLAID IS WET, OR WHEN RAIN IS FORECAST OR THREATENING.

DRIVEWAY CONSTRUCTION

DRIVEWAY SLOPES SHALL NOT EXCEED 10%, EXCEPT WHERE SPECIFICALLY INDICATED OTHERWISE ON THE PLANS OR DIRECTED BY THE ENGINEER.

THE CONTRACTOR SHALL PROVIDE PROPERTY OWNERS WITH SUITABLE NOTICE BEFORE REMOVING AND REPLACING AN EXISTING DRIVEWAY.

WATER MAIN CONSTRUCTION NOTES

HYDRANTS, VALVES, AND OTHER MATERIALS SHALL MEET THE OWNER'S STANDARDS, WITH REGARD TO MANUFACTURER AND MODEL, AND DETAILS SUCH AS OPENING DIRECTION, HYDRANT COLOR, HYDRANT CONFIGURATION, AND HYDRANT THREAD PATTERN.

WATER MAIN MATERIALS:	
HYDRANT	5 1/4 INCH AMERICAN FLOW CONTROL PACER OR EAST JORDAN IRON WORKS, BR5; WITH 5 1/4 INCH AMERICAN FLOW CONTROL PACER OR EAST JORDAN IRON WORKS, BR5; WITH COLOR: RED
VALVES	RESILIENT WEDGE GATE VALVES (MUELLER OR EAST JORDAN), OPENS COUNTER CLOCKWISE

NEW WATER MAIN SHALL NOT BE CONNECTED TO THE EXISTING WATER MAIN WITHOUT THE APPROVAL OF THE OWNER.

AT LEAST TEN FEET OF HORIZONTAL AND EIGHTEEN INCHES OF VERTICAL SEPARATION SHALL BE MAINTAINED BETWEEN THE WATER MAIN AND SEWERS (STORM OR SANITARY).

THE DEPTH OF BURY SHOWN ON THE PLANS SHALL BE PROVIDED, AS A MINIMUM, OVER THE TOP OF THE WATER MAIN PIPE TO THE FINISHED GROUND OR PAVEMENT SURFACE. UNLESS SPECIFICALLY DIRECTED OTHERWISE ON THE DRAWINGS, THE DEPTH OF BURY SHOWN ON THE PLANS SHALL BE MAINTAINED BETWEEN THE BOTTOM OF DITCHES AND THE TOP OF THE PIPE.

ALL BENDS, TEES, PLUGS, HYDRANTS, VALVES, AND OTHER FITTINGS WHERE THRUST MAY OCCUR SHALL BE RESTRAINED APPROPRIATELY BY THRUST BLOCKS OR JOINT RESTRAINT.

EXISTING WATER VALVES SHALL BE OPERATED ONLY BY THE WATER DEPARTMENT'S PERSONNEL.

THE SHUTTING DOWN OF EXISTING WATER MAINS TO ALLOW FOR COMPLETING THE CONTRACTOR'S WORK SHALL BE SCHEDULED IN ADVANCE BY THE CONTRACTOR WITH THE OWNER. THE CONTRACTOR SHALL PROVIDE NOTIFICATION TO AFFECTED WATER CUSTOMERS IN AT LEAST A DAY IN ADVANCE OF ANY SCHEDULED SERVICE DISRUPTIONS.

THE CONTRACTOR SHALL EXPOSE EXISTING MAINS TO VERIFY THE SIZE, MATERIALS, AND ANY FITTINGS NECESSARY BEFORE SHUTTING DOWN EXISTING WATER MAINS FOR NEW CONNECTIONS. ALL FITTINGS, PARTS, AND EQUIPMENT NECESSARY TO COMPLETE THE PROPOSED CONNECTIONS TO THE EXISTING MAIN SHALL BE AVAILABLE AT THE SITE BEFORE THE EXISTING MAIN IS SHUT DOWN.

THE COMPLETED WATER MAIN SHALL BE SUBJECTED TO A HYDROSTATIC PRESSURE. THE TEST PRESSURE SHALL BE 150 PSI. THE TEST DURATION SHALL BE 2 HOURS. THE CONTRACTOR SHALL CONDUCT SUCH PRELIMINARY TESTING TO EXPEL AIR AND VERIFY THAT THERE ARE NO LEAKS IN THE PIPELINE. THE TEST SHALL BE WITNESSED BY THE ENGINEER OR OWNER. THE CONTRACTOR SHALL NOTIFY THE ENGINEER OR OWNER AT LEAST 24 HOURS IN ADVANCE OF THE TIME FOR TESTING.

IF THE CONTRACTOR ELECTS TO PRESSURE TEST AGAINST AN EXISTING VALVE, THE OWNER DOES NOT GUARANTEE THAT EXISTING VALVES CAN RESIST THE TEST PRESSURE. IF THE CONTRACTOR BELIEVES THAT AN EXISTING VALVE IS THE CAUSE OF A FAILED PRESSURE TEST, THE CONTRACTOR SHALL EITHER REPAIR THE VALVE AND RETEST OR TEST AGAINST A PLUG, AT THEIR EXPENSE.

UNLESS SPECIFICALLY PROVIDED OTHERWISE, THE CONTRACTOR IS RESPONSIBLE TO FURNISH WATER FOR TESTING AND DISINFECTION.

WATER FROM THE CONTRACTOR'S FLUSHING AND DISINFECTION ACTIVITIES SHALL BE DISPOSED OF TO PREVENT EROSION OR FLOODING.

THE CONTRACTOR SHALL FURNISH AND INSTALL CORPORATIONS, TAPS, PIPING, AND FITTINGS AS NECESSARY TO COMPLETE THE REQUIRED FLUSHING AND TESTING FOR ACCEPTANCE. AFTER ACCEPTANCE, THE CONTRACTOR SHALL REMOVE ALL CORPORATIONS, TAPS, PIPING, AND FITTINGS USED FOR FLUSHING AND TESTING. TAPS TO THE WATER MAIN SHALL BE PLUGGED WITH BRASS PLUGS.

TAPS FOR SERVICE CONNECTIONS SHALL BE COMPLETED UNDER PRESSURE. THE CORPORATION AND SERVICE LEAD SHALL BE VISUALLY CHECKED FOR LEAKAGE WHILE UNDER PRESSURE. ALL JOINTS SHALL REMAIN EXPOSED UNTIL THE ENGINEER HAS OBSERVED THEM.

CORPORATIONS SHALL BE LEFT IN THE "OPEN" POSITION. CURB STOPS FOR FUTURE CONNECTIONS SHALL BE LEFT "CLOSED." CURB STOPS FOR CURRENT WATER CUSTOMERS SHALL BE LEFT "OPEN" ONCE CONNECTED.

SANITARY SEWER CONSTRUCTION NOTES

THE NEW SANITARY SEWER SHALL NOT BE CONNECTED TO THE EXISTING SEWER UNTIL APPROVED BY THE OWNER.

AT LEAST TEN FEET OF HORIZONTAL AND EIGHTEEN INCHES OF VERTICAL SEPARATION SHALL BE MAINTAINED BETWEEN THE SEWER AND EXISTING WATER MAINS.

MANHOLES SHALL BE CONSTRUCTED FROM PRECAST CONCRETE MANHOLE SECTIONS, MEETING ASTM C443. MANHOLE JOINTS SHALL BE MADE WITH RUBBER O-RING GASKETS. THE SECTION BETWEEN THE TOP OF THE PRECAST CONE AND THE BOTTOM OF THE CASTING SHALL BE CONSTRUCTED OF PRECAST GRADE RINGS, OF TOTAL THICKNESS SO THAT THE MANHOLE CASTING IS PLACED AT THE PROPER FINAL ELEVATION, EXCEPT THAT THE TOTAL THICKNESS SHALL NOT EXCEED TEN INCHES.

MANHOLE STEPS SHALL BE EQUALLY SPACED AT 15 INCHES. THE DISTANCE FROM THE TOP STEP TO THE TOP OF THE MANHOLE CASTING SHALL NOT EXCEED 16 INCHES.

THE CONTRACTOR SHALL CONDUCT A LOW PRESSURE AIR TEST ON ALL SANITARY SEWERS LESS THAN 24 INCHES IN DIAMETER. THE AIR TEST SHALL MEET THE REQUIREMENTS OF ASTM C 924 FOR CONCRETE PIPE AND ASTM F1471 FOR PLASTIC PIPE. IN AREAS WHERE GROUNDWATER IS OVER THE PIPE, THE TEST PRESSURE SHALL BE INCREASED EQUAL TO THE HYDRAULIC PRESSURE EXERTED BY THE WATER OVER THE PIPE, AS DETERMINED BY THE ENGINEER.




NO.	REVISION	DATE



FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

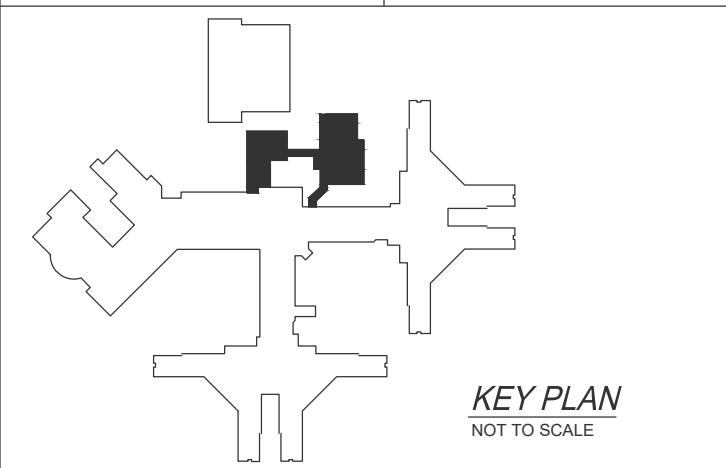

KEY PLAN
NOT TO SCALE



WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023



PROJECT TITLE
491/20167.SDW CFP – PHASE 500

CENTER FOR FORENSIC
PSYCHIATRY – CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
CIVIL NOTES


PROJECT NUMBER
2021094

PROJECT DATE
SEPTEMBER 6, 2023


CHECKED BY
A.J.T.

SHEET NUMBER


C1.02

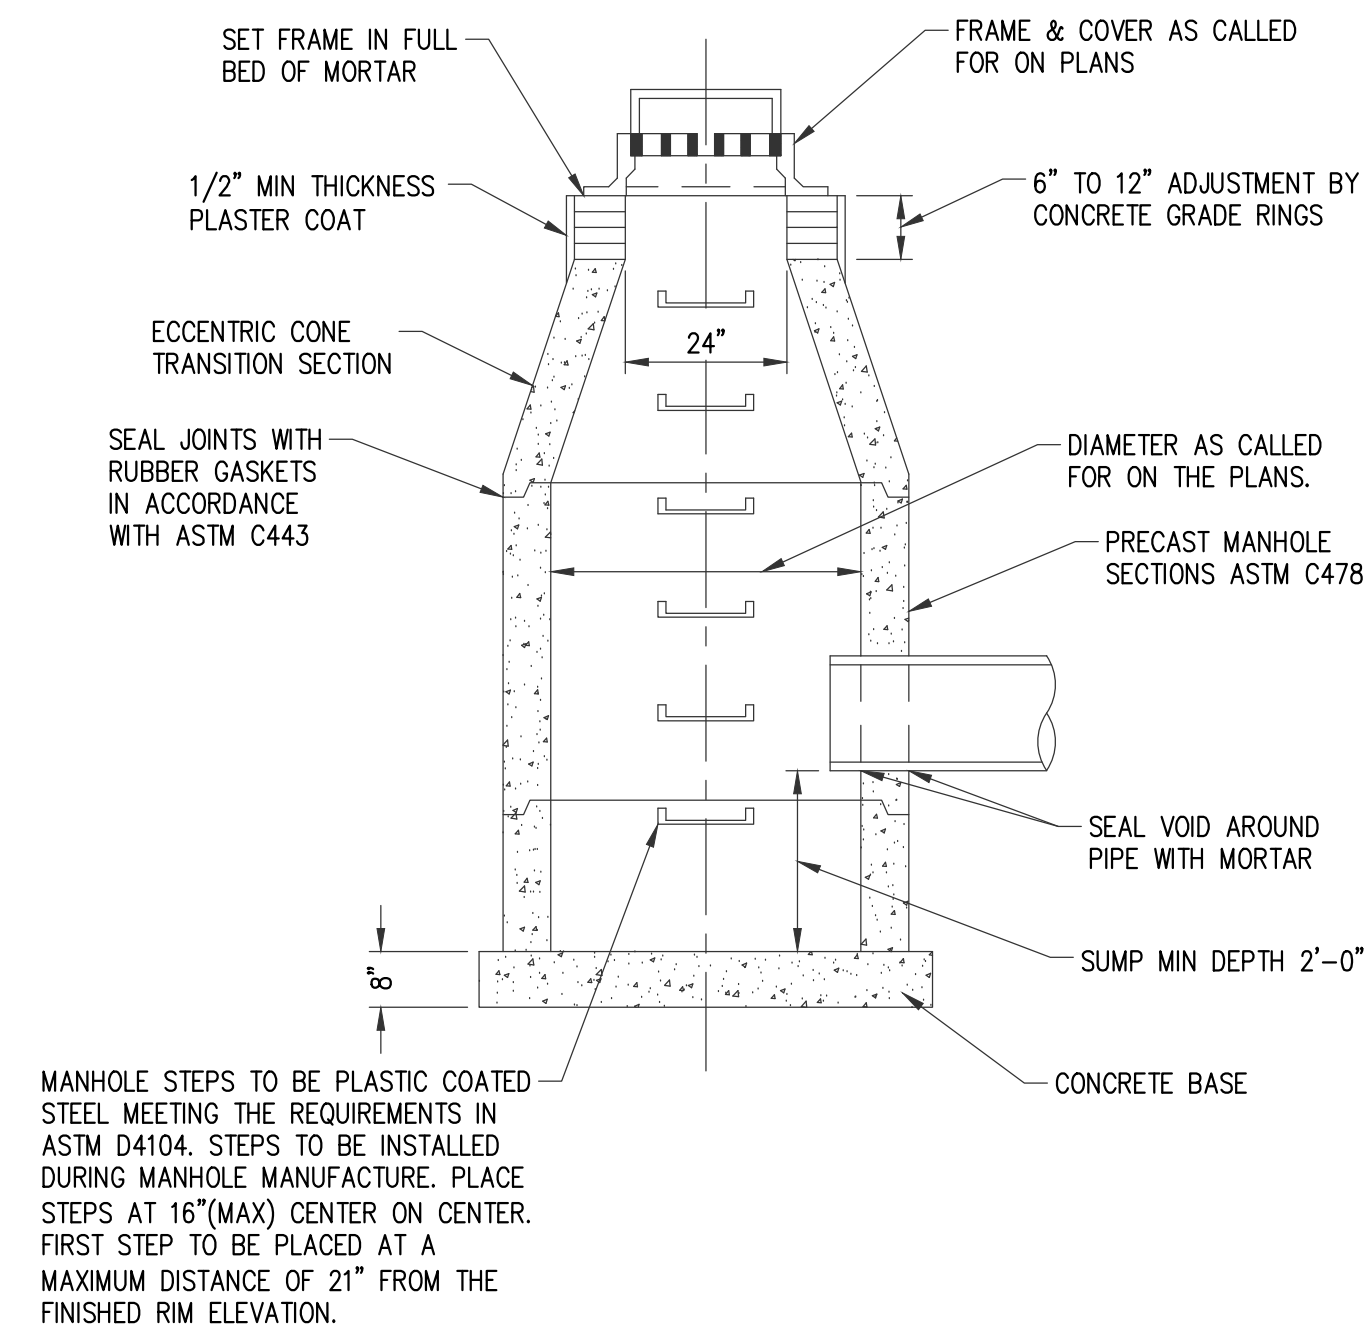


STANDARD DRAINAGE STRUCTURE WITH 2' SUMP
NOT TO SCALE

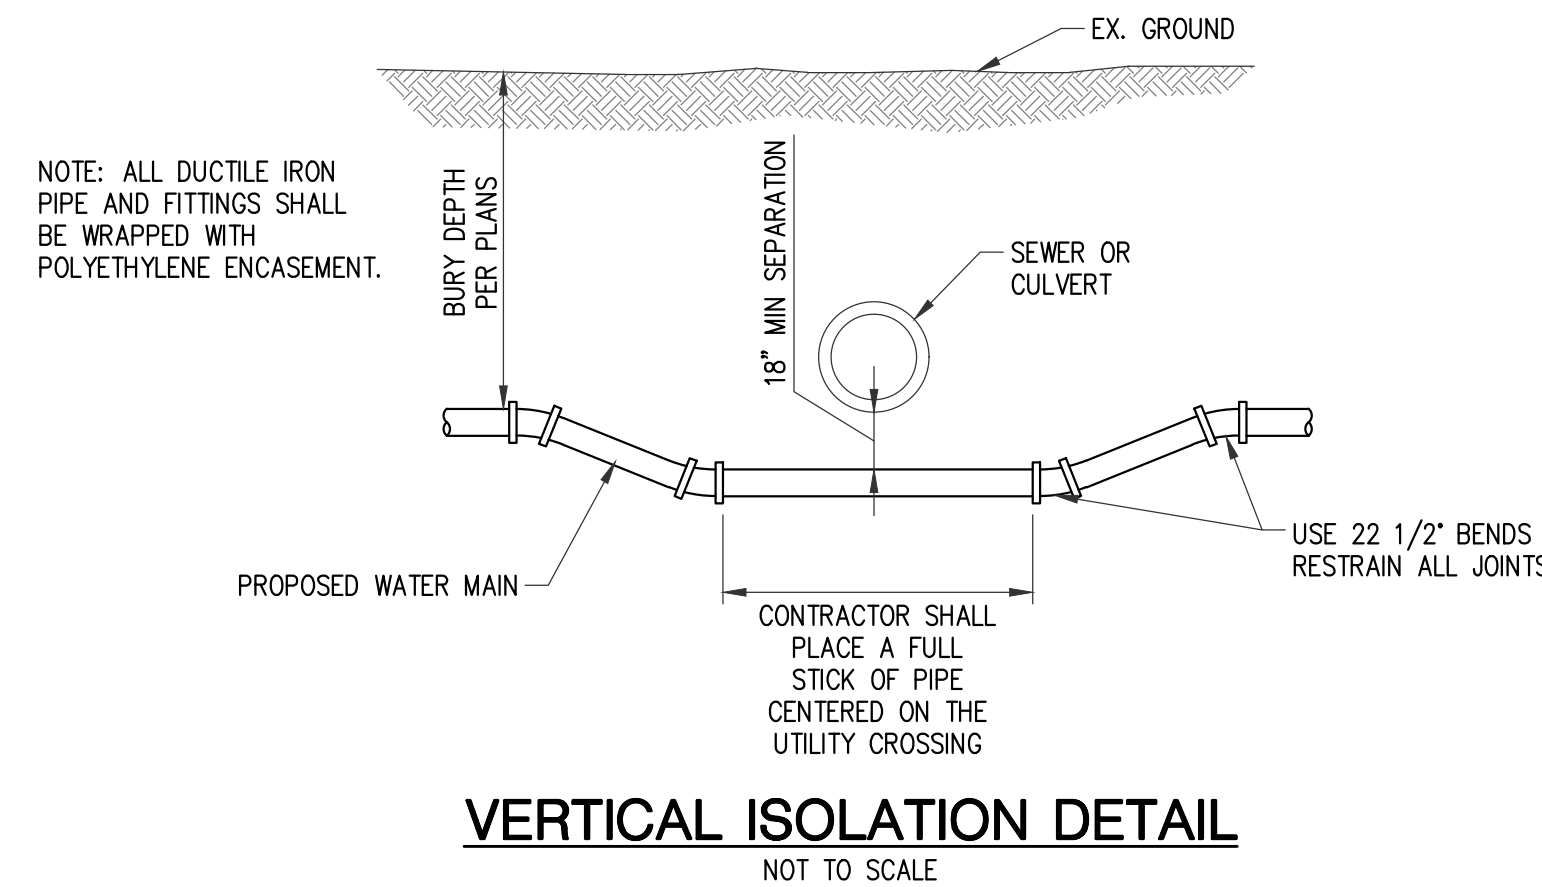

VERTICAL ISOLATION DETAIL
NOT TO SCALE

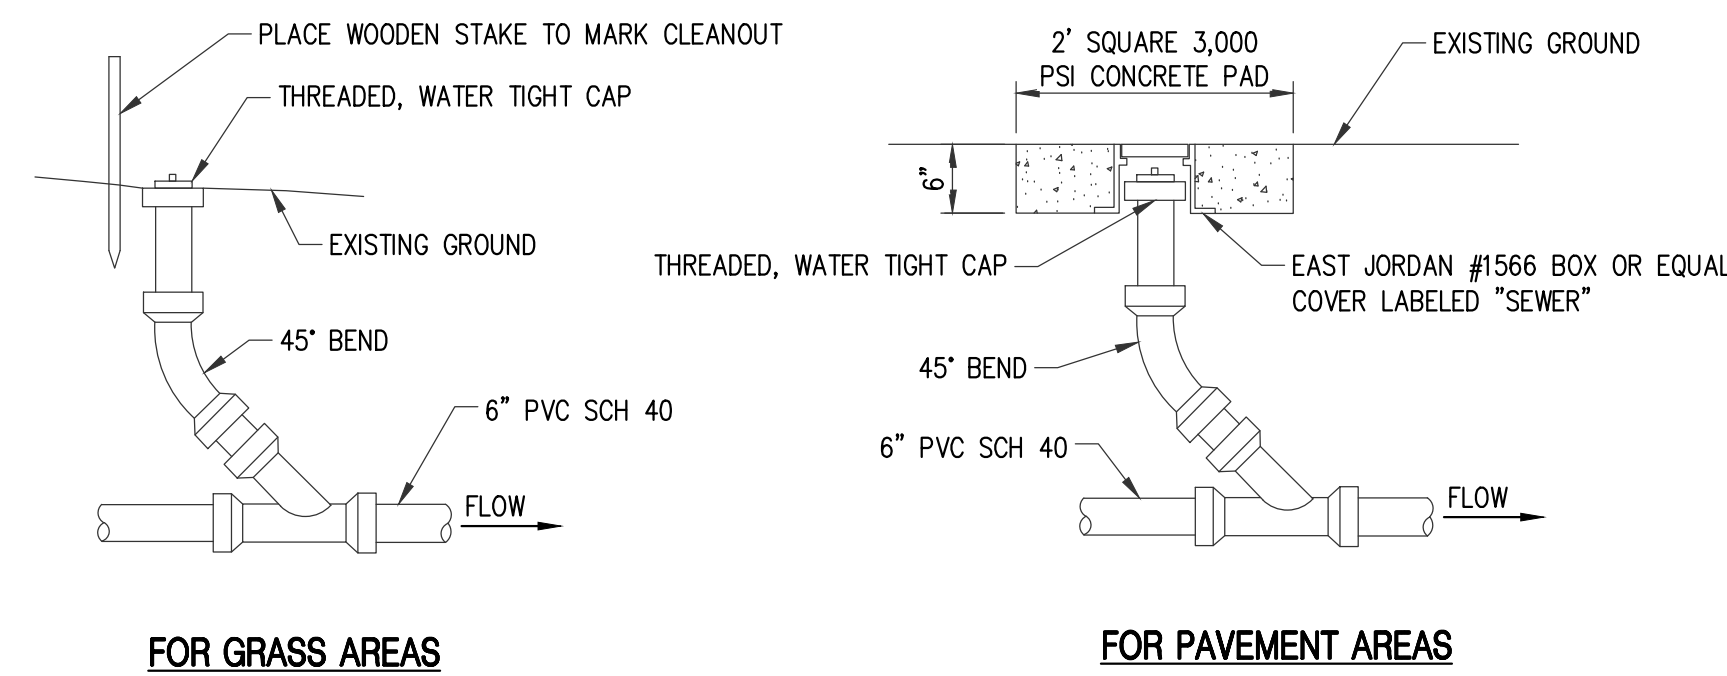

CLEANOUT RISER DETAIL
NOT TO SCALE

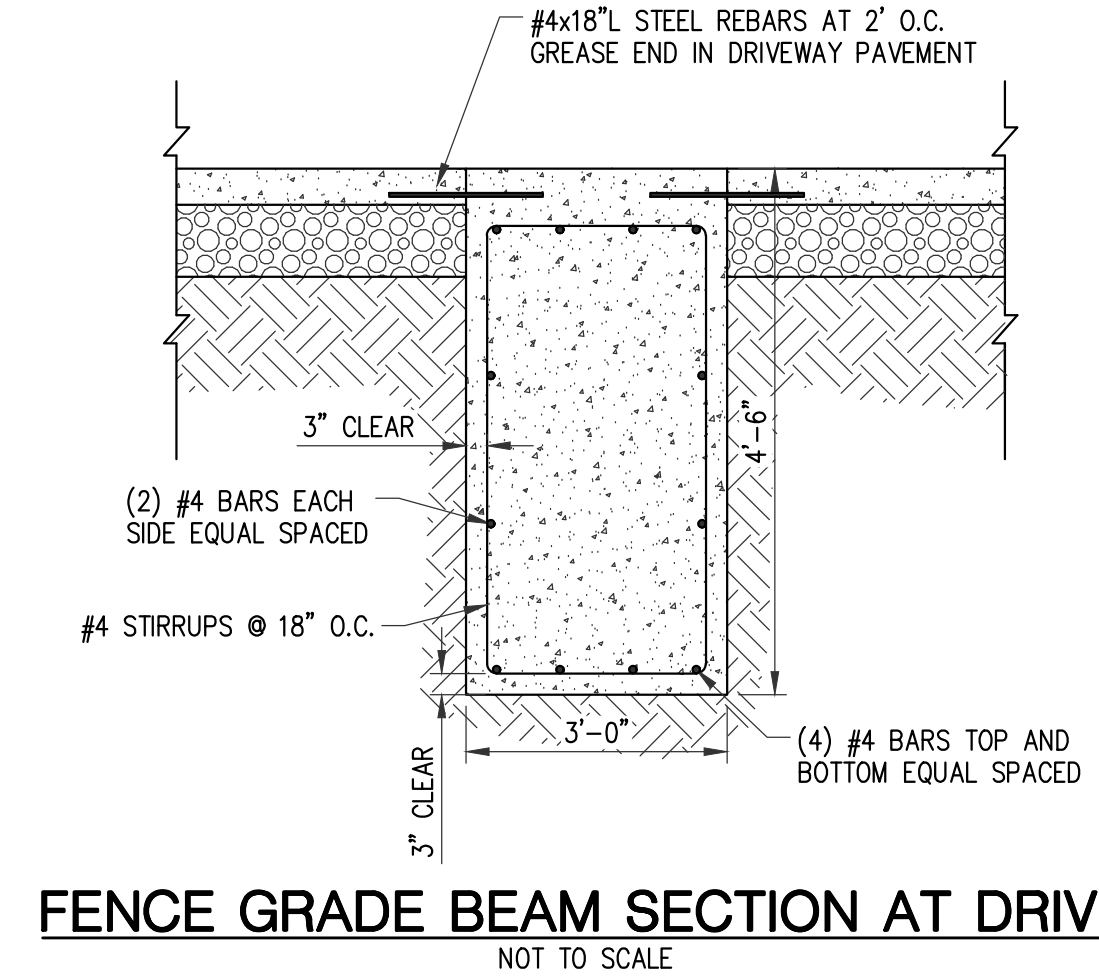

FENCE GRADE BEAM SECTION AT DRIVE
NOT TO SCALE

DIA. OF PIPE OR BRANCH OF TEE	90° BEND			45° BEND			22 1/2° BEND 11 1/4° BEND			PLUGS, HYDRANTS AND TEE		
	A	B	C	A	B	C	A	B	C	A	B	C
6"	2'-0"	2'-0"	0'-9"	2'-0"	1'-0"	0'-9"	2'-0"	1'-0"	0'-9"	2'-0"	2'-0"	1'-0"
8"	3'-0"	2'-0"	1'-0"	2'-6"	2'-0"	1'-3"	2'-0"	1'-0"	1'-0"	3'-0"	2'-0"	1'-9"
12"	4'-0"	3'-0"	1'-6"	3'-0"	3'-0"	1'-6"	2'-0"	2'-0"	1'-6"	4'-0"	3'-0"	2'-0"
16"	6'-0"	4'-0"	1'-6"	4'-0"	4'-0"	1'-6"	3'-0"	3'-0"	1'-6"	5'-0"	4'-0"	2'-0"
24"	8'-0"	6'-0"	2'-0"	5'-0"	5'-0"	2'-0"	4'-0"	4'-0"	2'-0"	8'-0"	6'-0"	2'-6"

TABLE INDICATES MINIMUM BEARING

BEND-PLAN VIEW

TEE-PLAN VIEW

SECTION A-A BEND


SECTION B-B TEE

PLUG-PLAN VIEW


SECTION C-C PLUG

NOTE:
1. USE 2,500 PSI CONCRETE FOR ALL THRUST BLOCKS.
2. POUR AGAINST UNDISTURBED SOIL.
3. KEEP BOLTS, FITTINGS AND JOINTS CLEAR OF CONCRETE.
4. BEARING AREA IS BASED ON 2,000 PSI SOIL CAPACITY.

THRUST BLOCK DETAILS
NOT TO SCALE

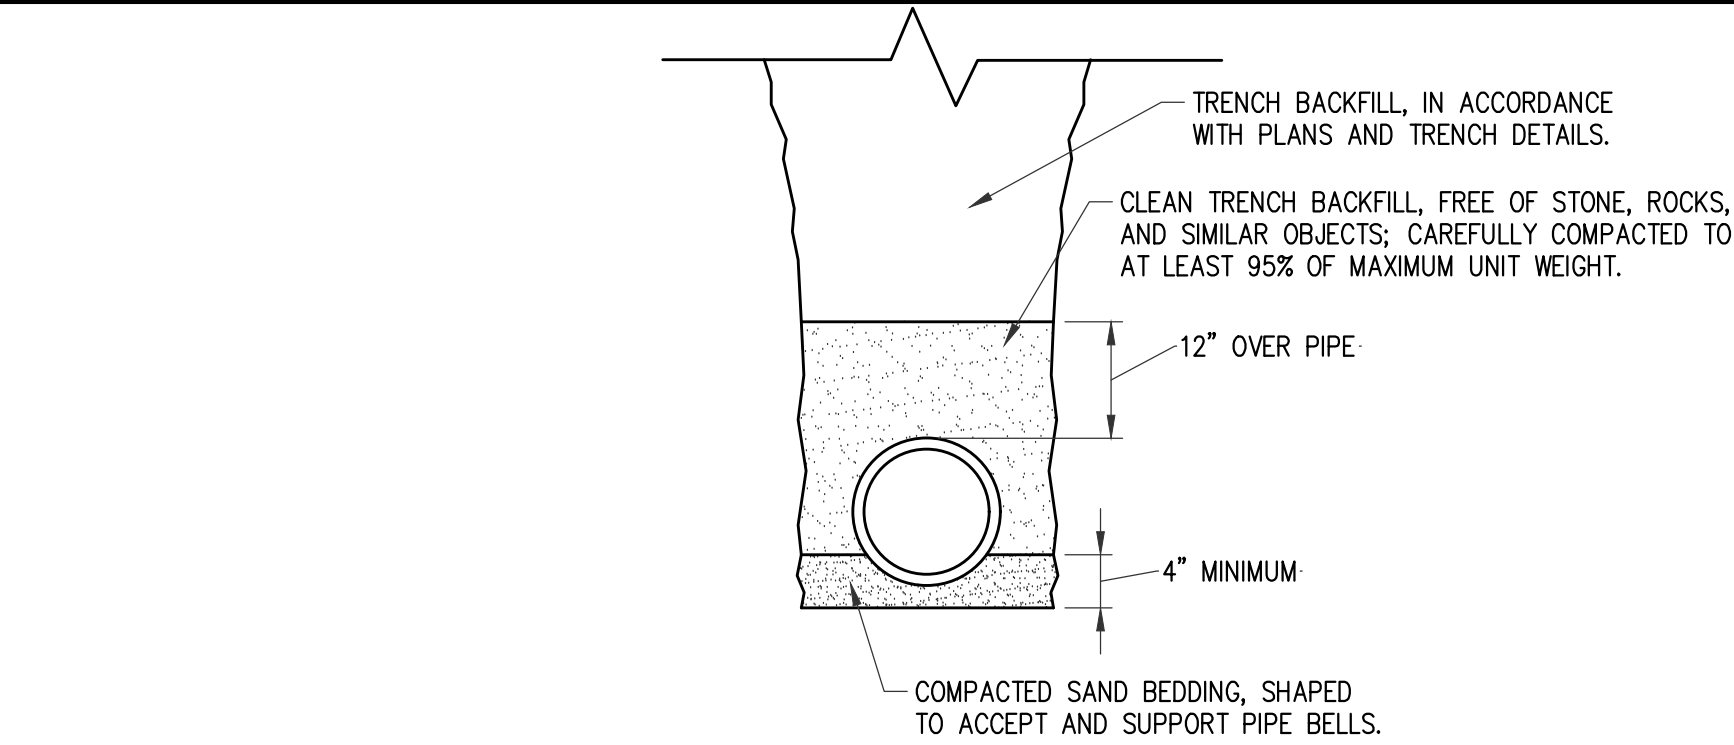


GRAVITY PIPE BEDDING DETAIL - SAND BEDDING

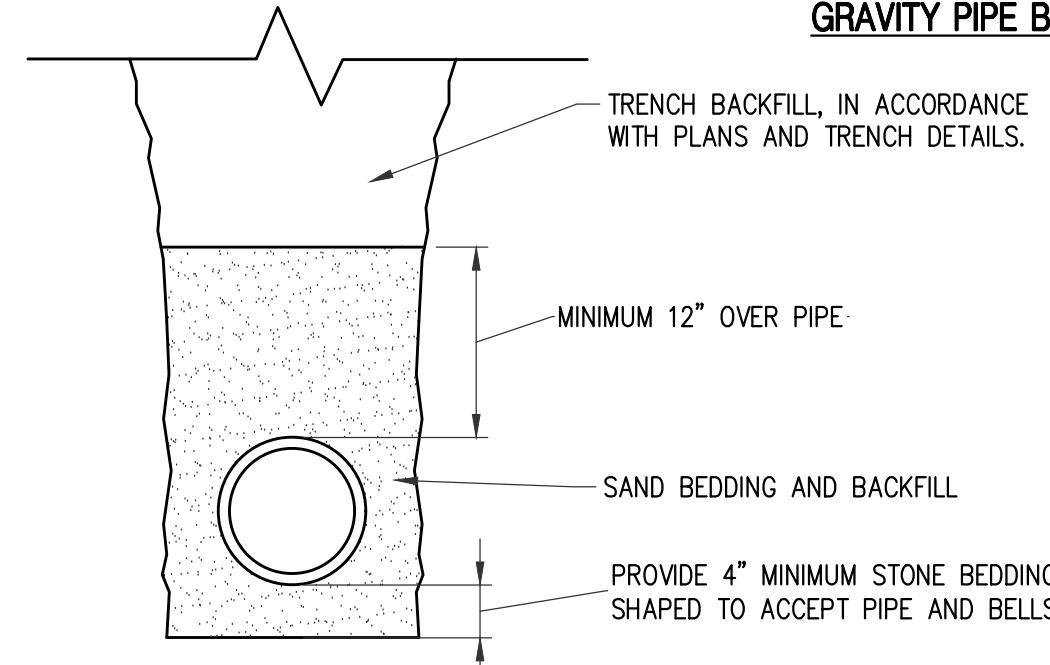

PRESSURE PIPE BEDDING DETAIL


- NOTES:
1. SAND SHALL BE MDOT GRANULAR MATERIAL CLASS II.
2. SAND SHALL BE COMPACTED TO 95% OF ITS MAXIMUM UNIT WEIGHT.

PIPE BEDDING DETAIL
NOT TO SCALE

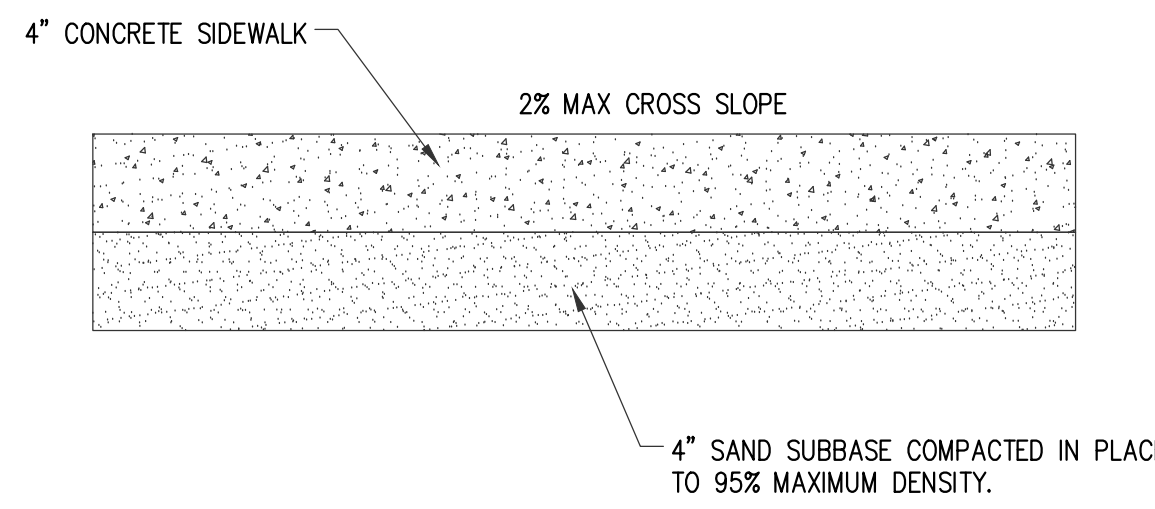

SIDEWALK DETAIL
NOT TO SCALE


- NOTES:
1. SEAL ALL EXPANSION JOINTS, BUILDING TO SIDEWALK JOINTS, SIDEWALK TO BRICK JOINTS, AND CURB TO BRICK JOINTS WITH SELF LEVELING POLYURETHANE JOINT SEALANT (GRAY) OR EQUAL.

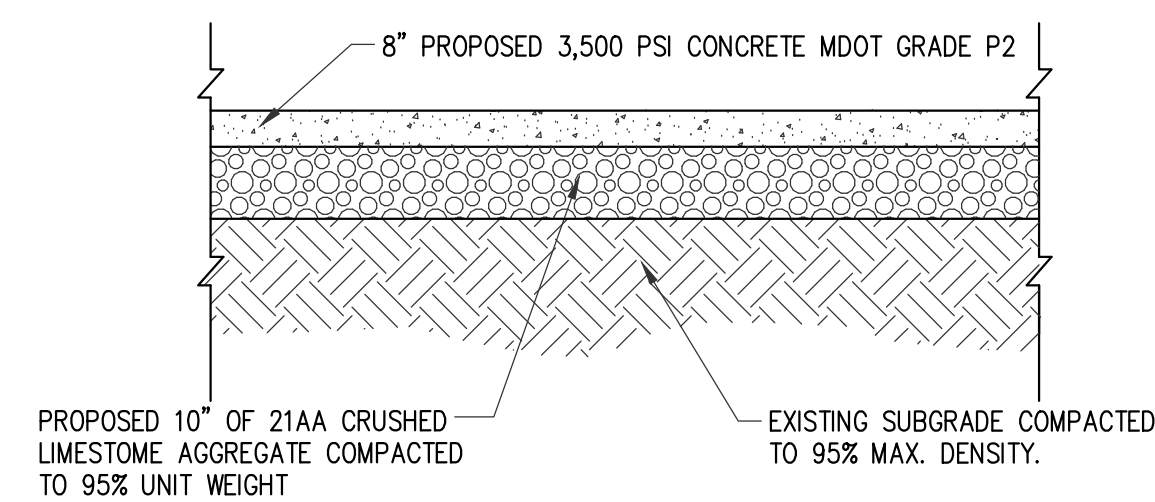


CONCRETE PAVEMENT CROSS SECTION
NOT TO SCALE

- NOTES:
1. SEAL ALL EXPANSION JOINTS WITH 1/2\"/>

- NOTES:
1. ALL PRESSURE TAPS MUST BE INSTALLED IN A CONCRETE VALVE MANHOLE.
2. CONTRACTOR SHALL LOCATE AND EXPOSE EXISTING WATER MAIN. THE CONTRACTOR WILL PROVIDE ANY FITTINGS NECESSARY TO COMPLETE TRANSITION(S) FROM EXISTING MAIN TO PROPOSED CONSTRUCTION.
3. THE VALVE SHALL HAVE ONE FLANGED END (CONNECTED TO THE SLEEVE) AND ONE MECHANICAL JOINT END (CONNECTED TO THE PIPELINE).
4. THE VALVE SHALL HAVE OVERSIZE SEAT RINGS TO PERMIT ENTRY OF THE TAPPING MACHINE CUTTERS.
5. THE VALVE SHALL MEET ALL REQUIREMENTS OF AWWA C500.
6. THE MINIMUM SIZE MANHOLE SHALL BE 6'-0\"/>

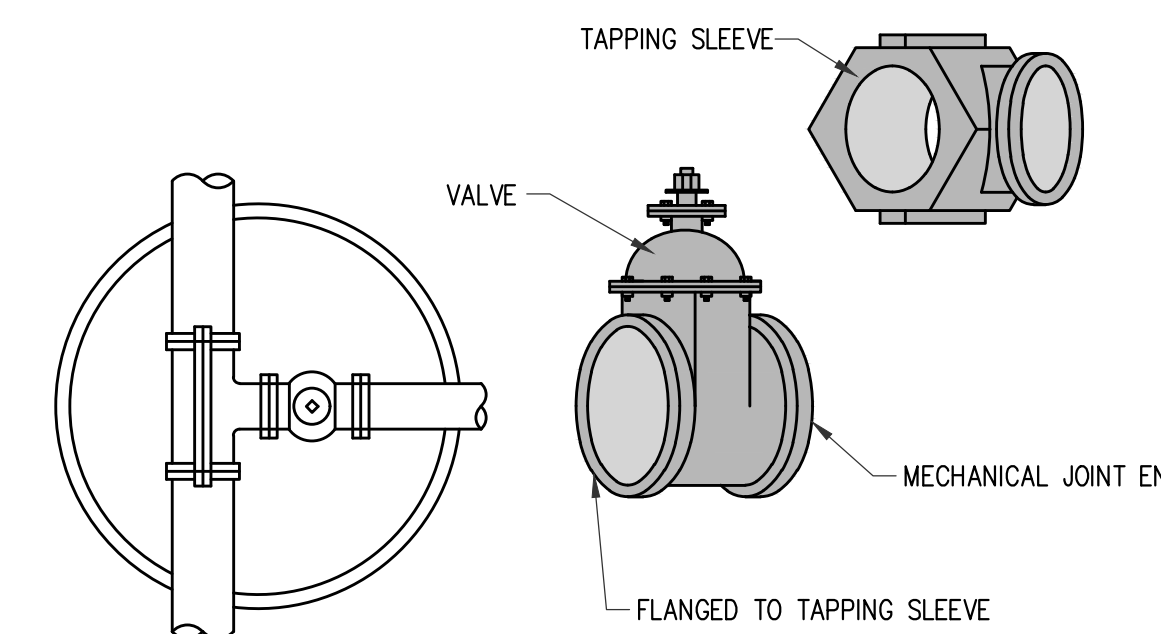


PRESSURE TAPPING SLEEVE & VALVE DETAIL
NOT TO SCALE

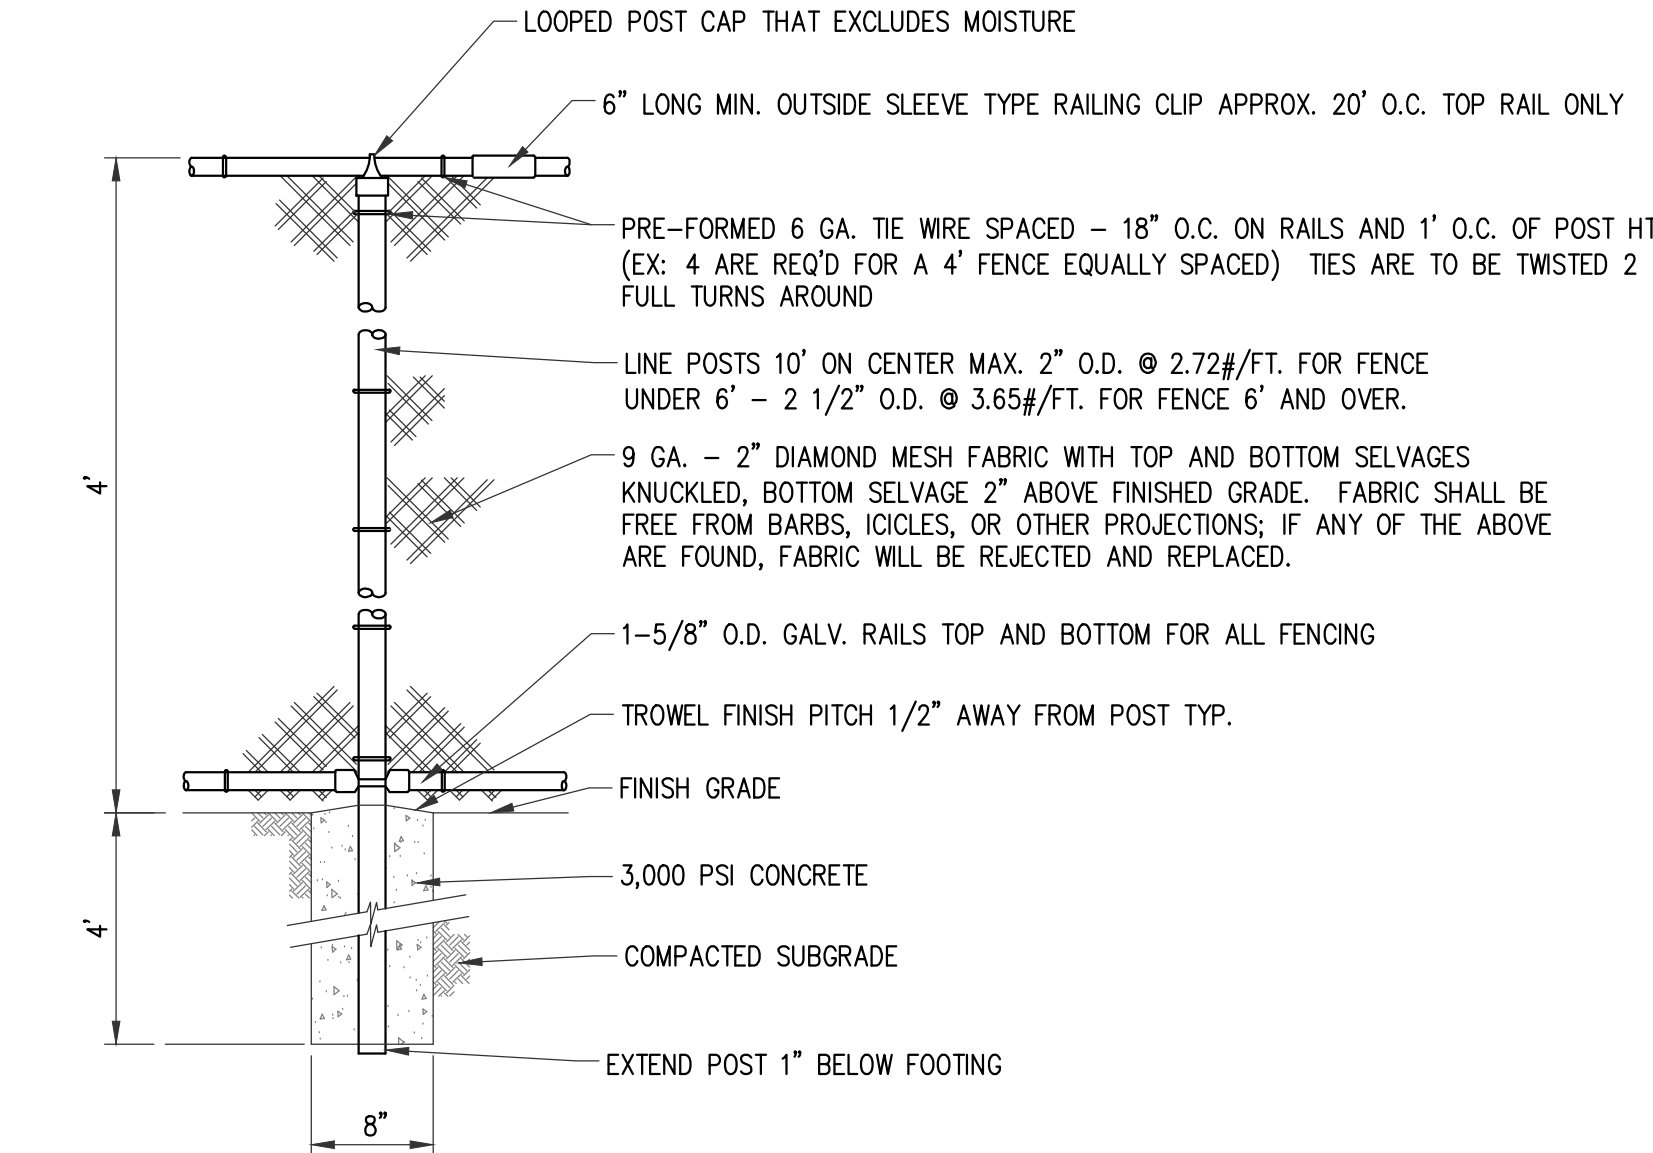


CHAIN LINK FENCE DETAIL
NOT TO SCALE

- NOTES:
1. ALL POSTS AND RAILS TO BE SCHEDULE 40 OR APPROVED EQUAL.
2. FENCE TO BE VINYL COATED.
3. COLOR TO BE AS SELECTED BY OWNER.

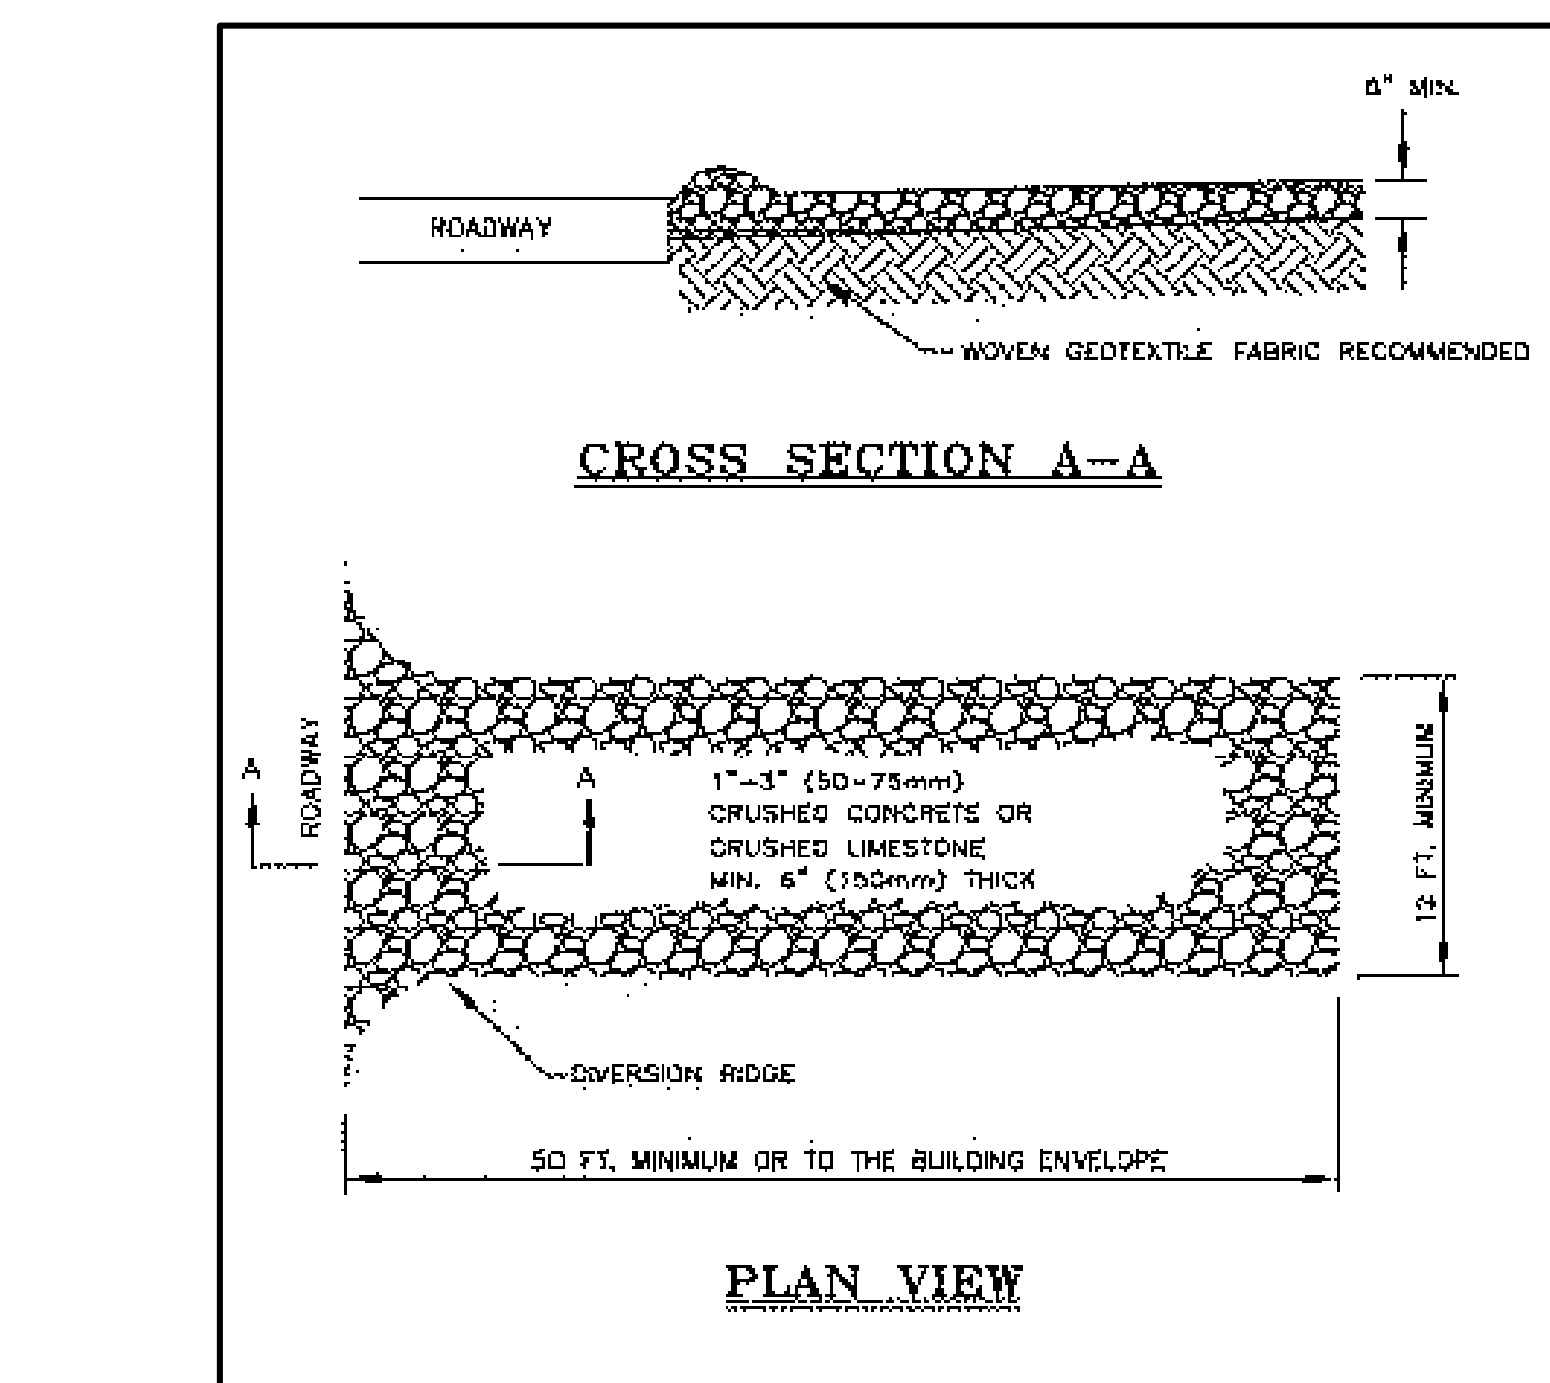

CONSTRUCTION ACCESS DRIVE DETAIL
NOT TO SCALE

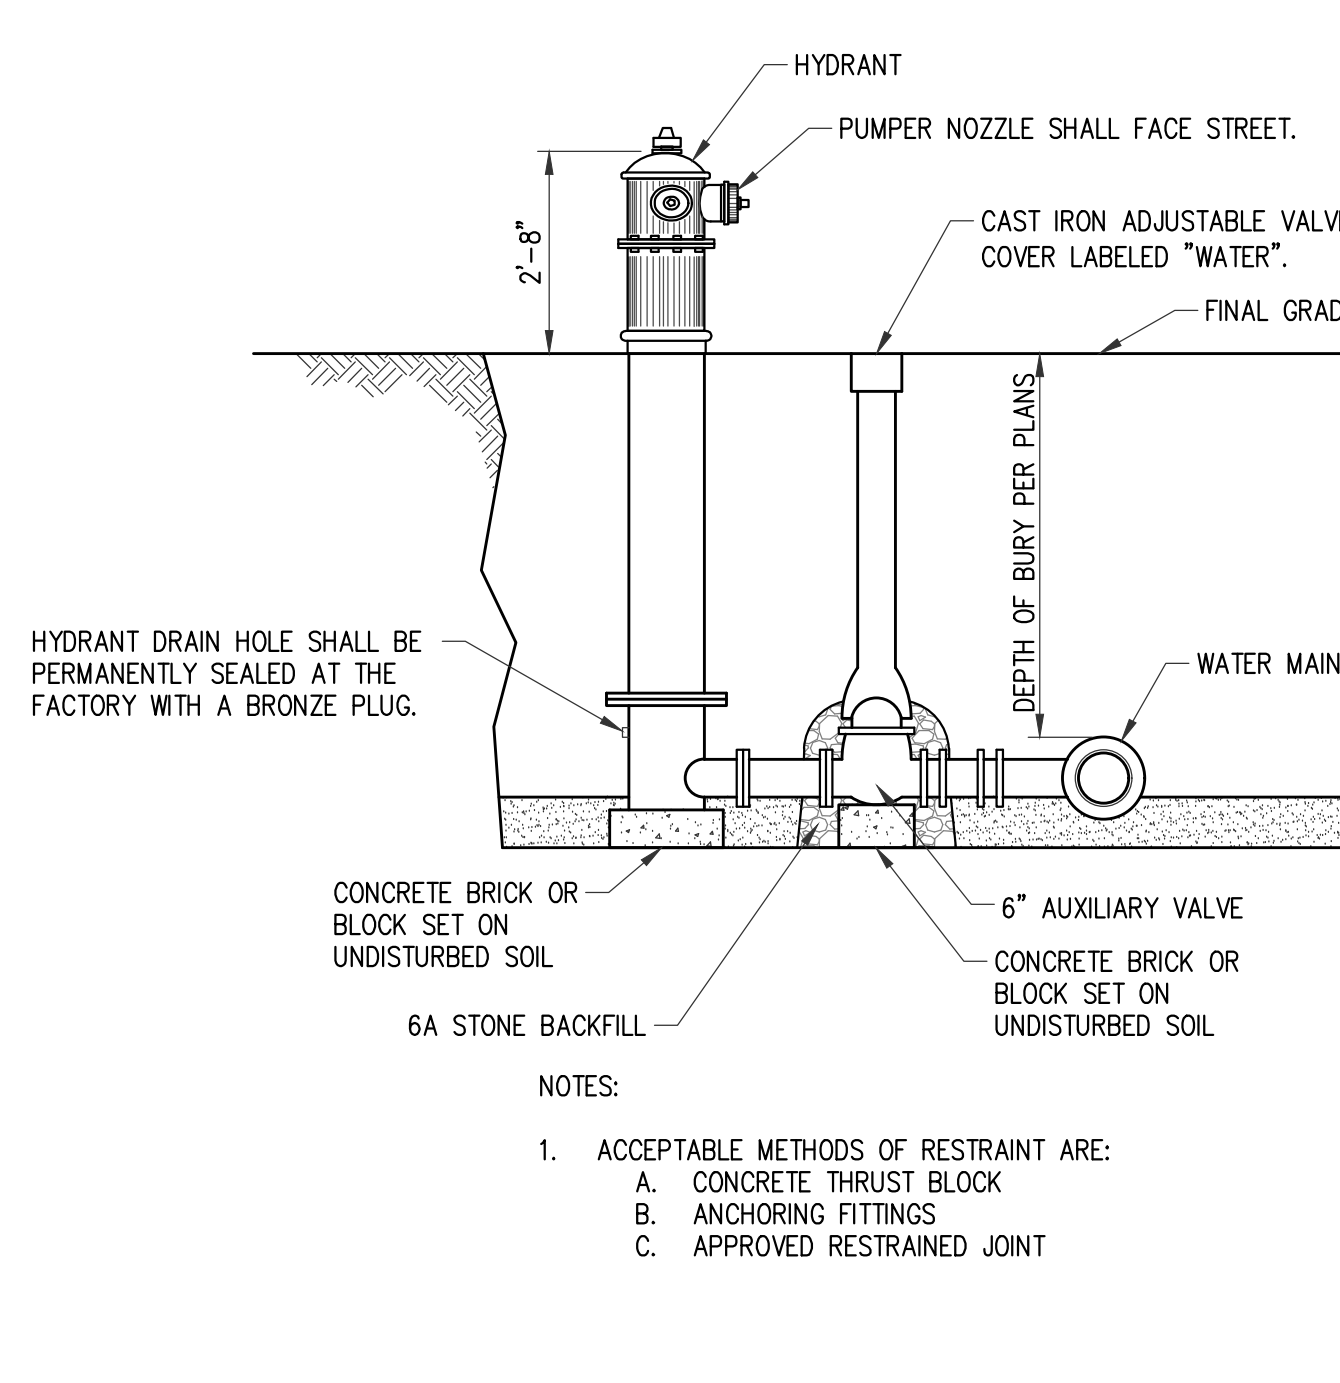

FIRE HYDRANT DETAIL
NOT TO SCALE


- NOTES:
1. ACCEPTABLE METHODS OF RESTRAINT ARE:
A. CONCRETE THRUST BLOCK
B. ANCHORING FITTINGS
C. APPROVED RESTRAINED JOINT

MINIMUM PIPE RESTRAINT SCHEDULE FOR GROUND BURIED PRESSURE PIPES (SEE NOTE 1)

PIPE DIAMETER	LENGTH (IN FEET) OF RESTRAINT REQUIRED (SEE NOTE 2)						
	DEFLECTION ANGLE 22 1/2°	33 3/4°	45°	56 1/4°	67 1/2°	78 3/4°	90° TEE OR DEAD END
6"	3	6	11	16	23	29	37
8"	4	8	15	22	31	41	50
10"	5	11	18	28	38	49	61
12"	6	13	22	33	45	59	73
14"	7	14	25	37	52	68	84
16"	8	16	28	42	59	77	95
18"	8	18	31	47	66	86	107
20"	9	20	35	53	73	95	118
24"	11	23	40	61	85	111	138
30"	13	29	50	75	105	136	170
36"	15	34	59	88	123	160	199
42"	17	39	67	101	141	184	228
48"	19	43	75	113	157	206	255


- NOTES:
1. THIS TABLE IS BASED ON A TEST PRESSURE OF 180 PSI (OPERATING PRESSURE + WATER HAMMER). FOR OTHER TEST PROCEDURES, ALL VALUES ARE TO BE INCREASED OR DECREASED PROPORTIONALLY.
2. IN EACH DIRECTION FROM POINT OF DEFLECTION OR TERMINATION EXCEPT FOR A TEE AT WHICH ONLY THE BRANCH IN THE DIRECTION OF THE TEE STEM.
3. IF THE RODS ARE USED, PLACE 2 RODS 5/8 INCH DIAMETER MINIMUM FOR WATER MAIN 6 INCH TO 10 INCH AND 4 RODS 5/8 INCH DIAMETER MINIMUM FOR 12 INCH AND LARGER.

PIPE RESTRAINT SCHEDULE
NOT TO SCALE

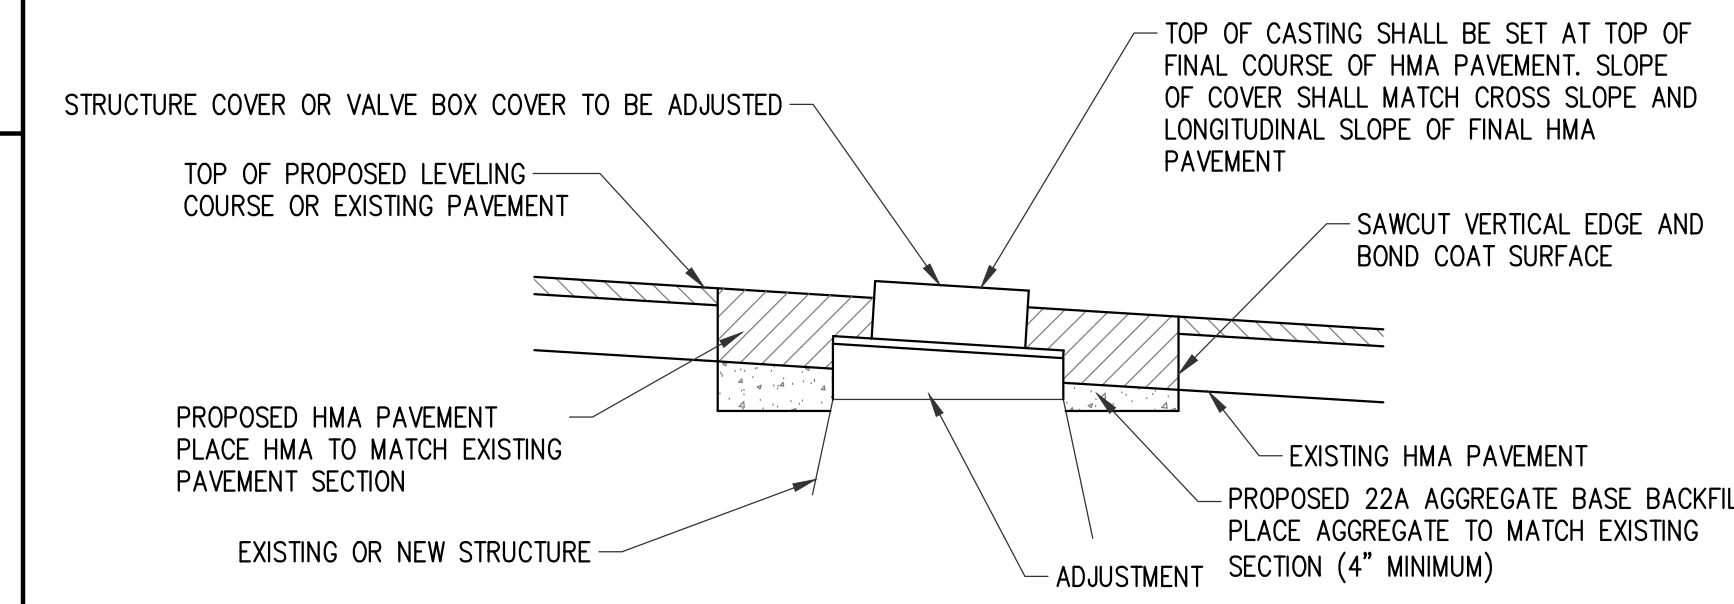

STRUCTURE COVER ADJUST DETAIL - HMA BASE
NOT TO SCALE

- NOTE:
1. STRUCTURE ADJUST SHALL BE CUT IN A DIAMOND WITH A MINIMUM 2' DISTANCE FROM THE CASTING.
2. CONCRETE BACKFILL WILL NOT BE PERMITTED. ALL COSTS OF BACKFILL (AGGREGATE AND HMA) INCLUDED IN COST OF ADJUSTMENT OR NEW STRUCTURE AND WILL NOT BE PAID FOR SEPARATELY.

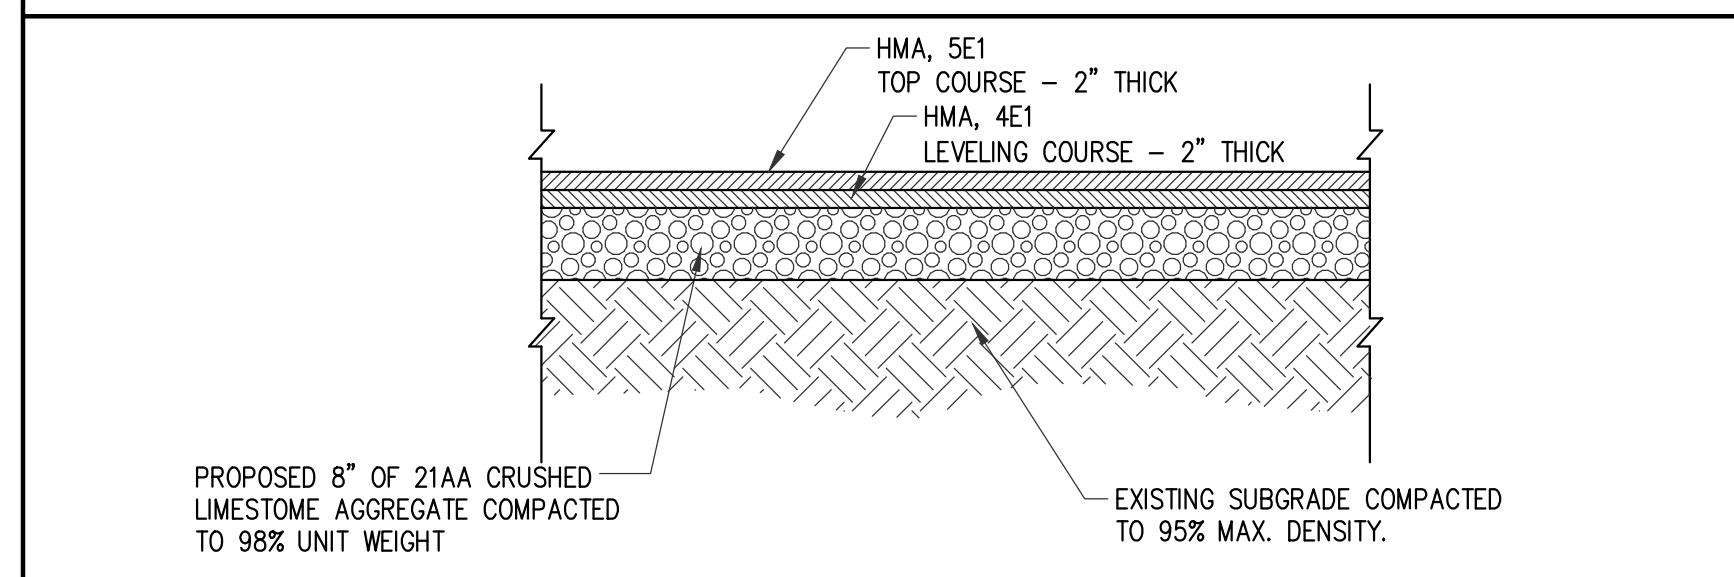

HMA APPLICATION CHART

HMA PAVEMENT	THICKNESS	PERFORMANCE GRADE	REMARKS
HMA, 5E1 (TOP)	2"	58-28	TOP COURSE (AW=220 MIN.)
HMA, 4E1 (LEVELING)	2"	58-28	LEVELING COURSE

HMA PAVEMENT CROSS SECTION
NOT TO SCALE




NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICE ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACHE DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

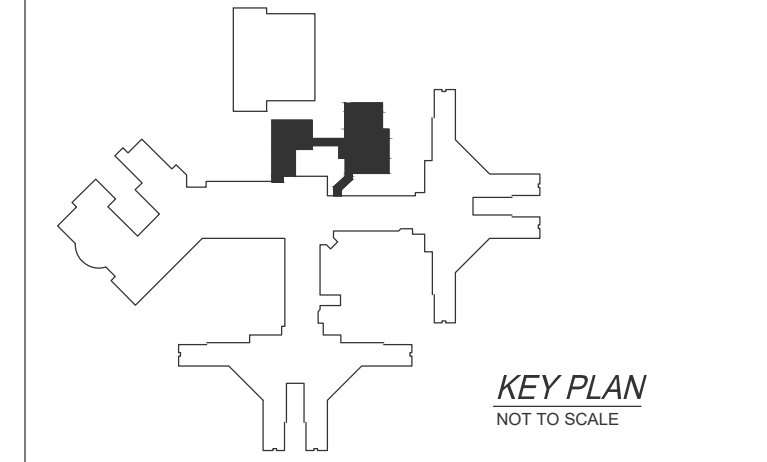

WTAARCH.COM

WTA ARCHITECTS
100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

ROWE PROFESSIONAL SERVICES COMPANY

PROJECT TITLE
491/20167.SDW CFP - PHASE 500

CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN


SHEET TITLE
CIVIL DETAILS

PROJECT NUMBER
2021094


PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
A.J.T.

SHEET NUMBER
C1.03

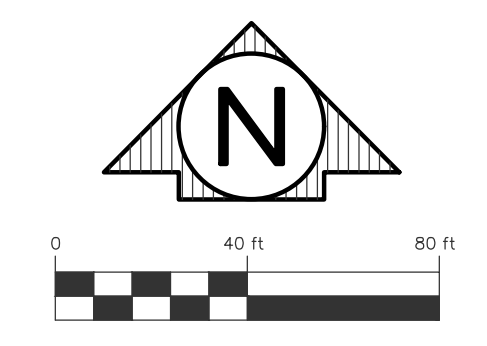

- NOTES:**
- 1) PROPOSED PERIMETER ELECTRIC AND CHAIN LINK FENCE IS TO MATCH THE EXISTING FENCE SIZE AND STYLE. ALL FENCING IS TO BE INSTALLED PER MANUFACTURERS REQUIREMENT. SEE SHEET C1.04 FOR MORE DETAILS.
 - 2) PERIMETER ELECTRIC FENCE IS TO BE INSTALLED AGAINST PROPOSED BUILDING CORNER AS SHOWN TO ALLOW FOR NO GAP OR MEANS OF PASSAGE. SEE SHEET C1.04 FOR MORE DETAILS.

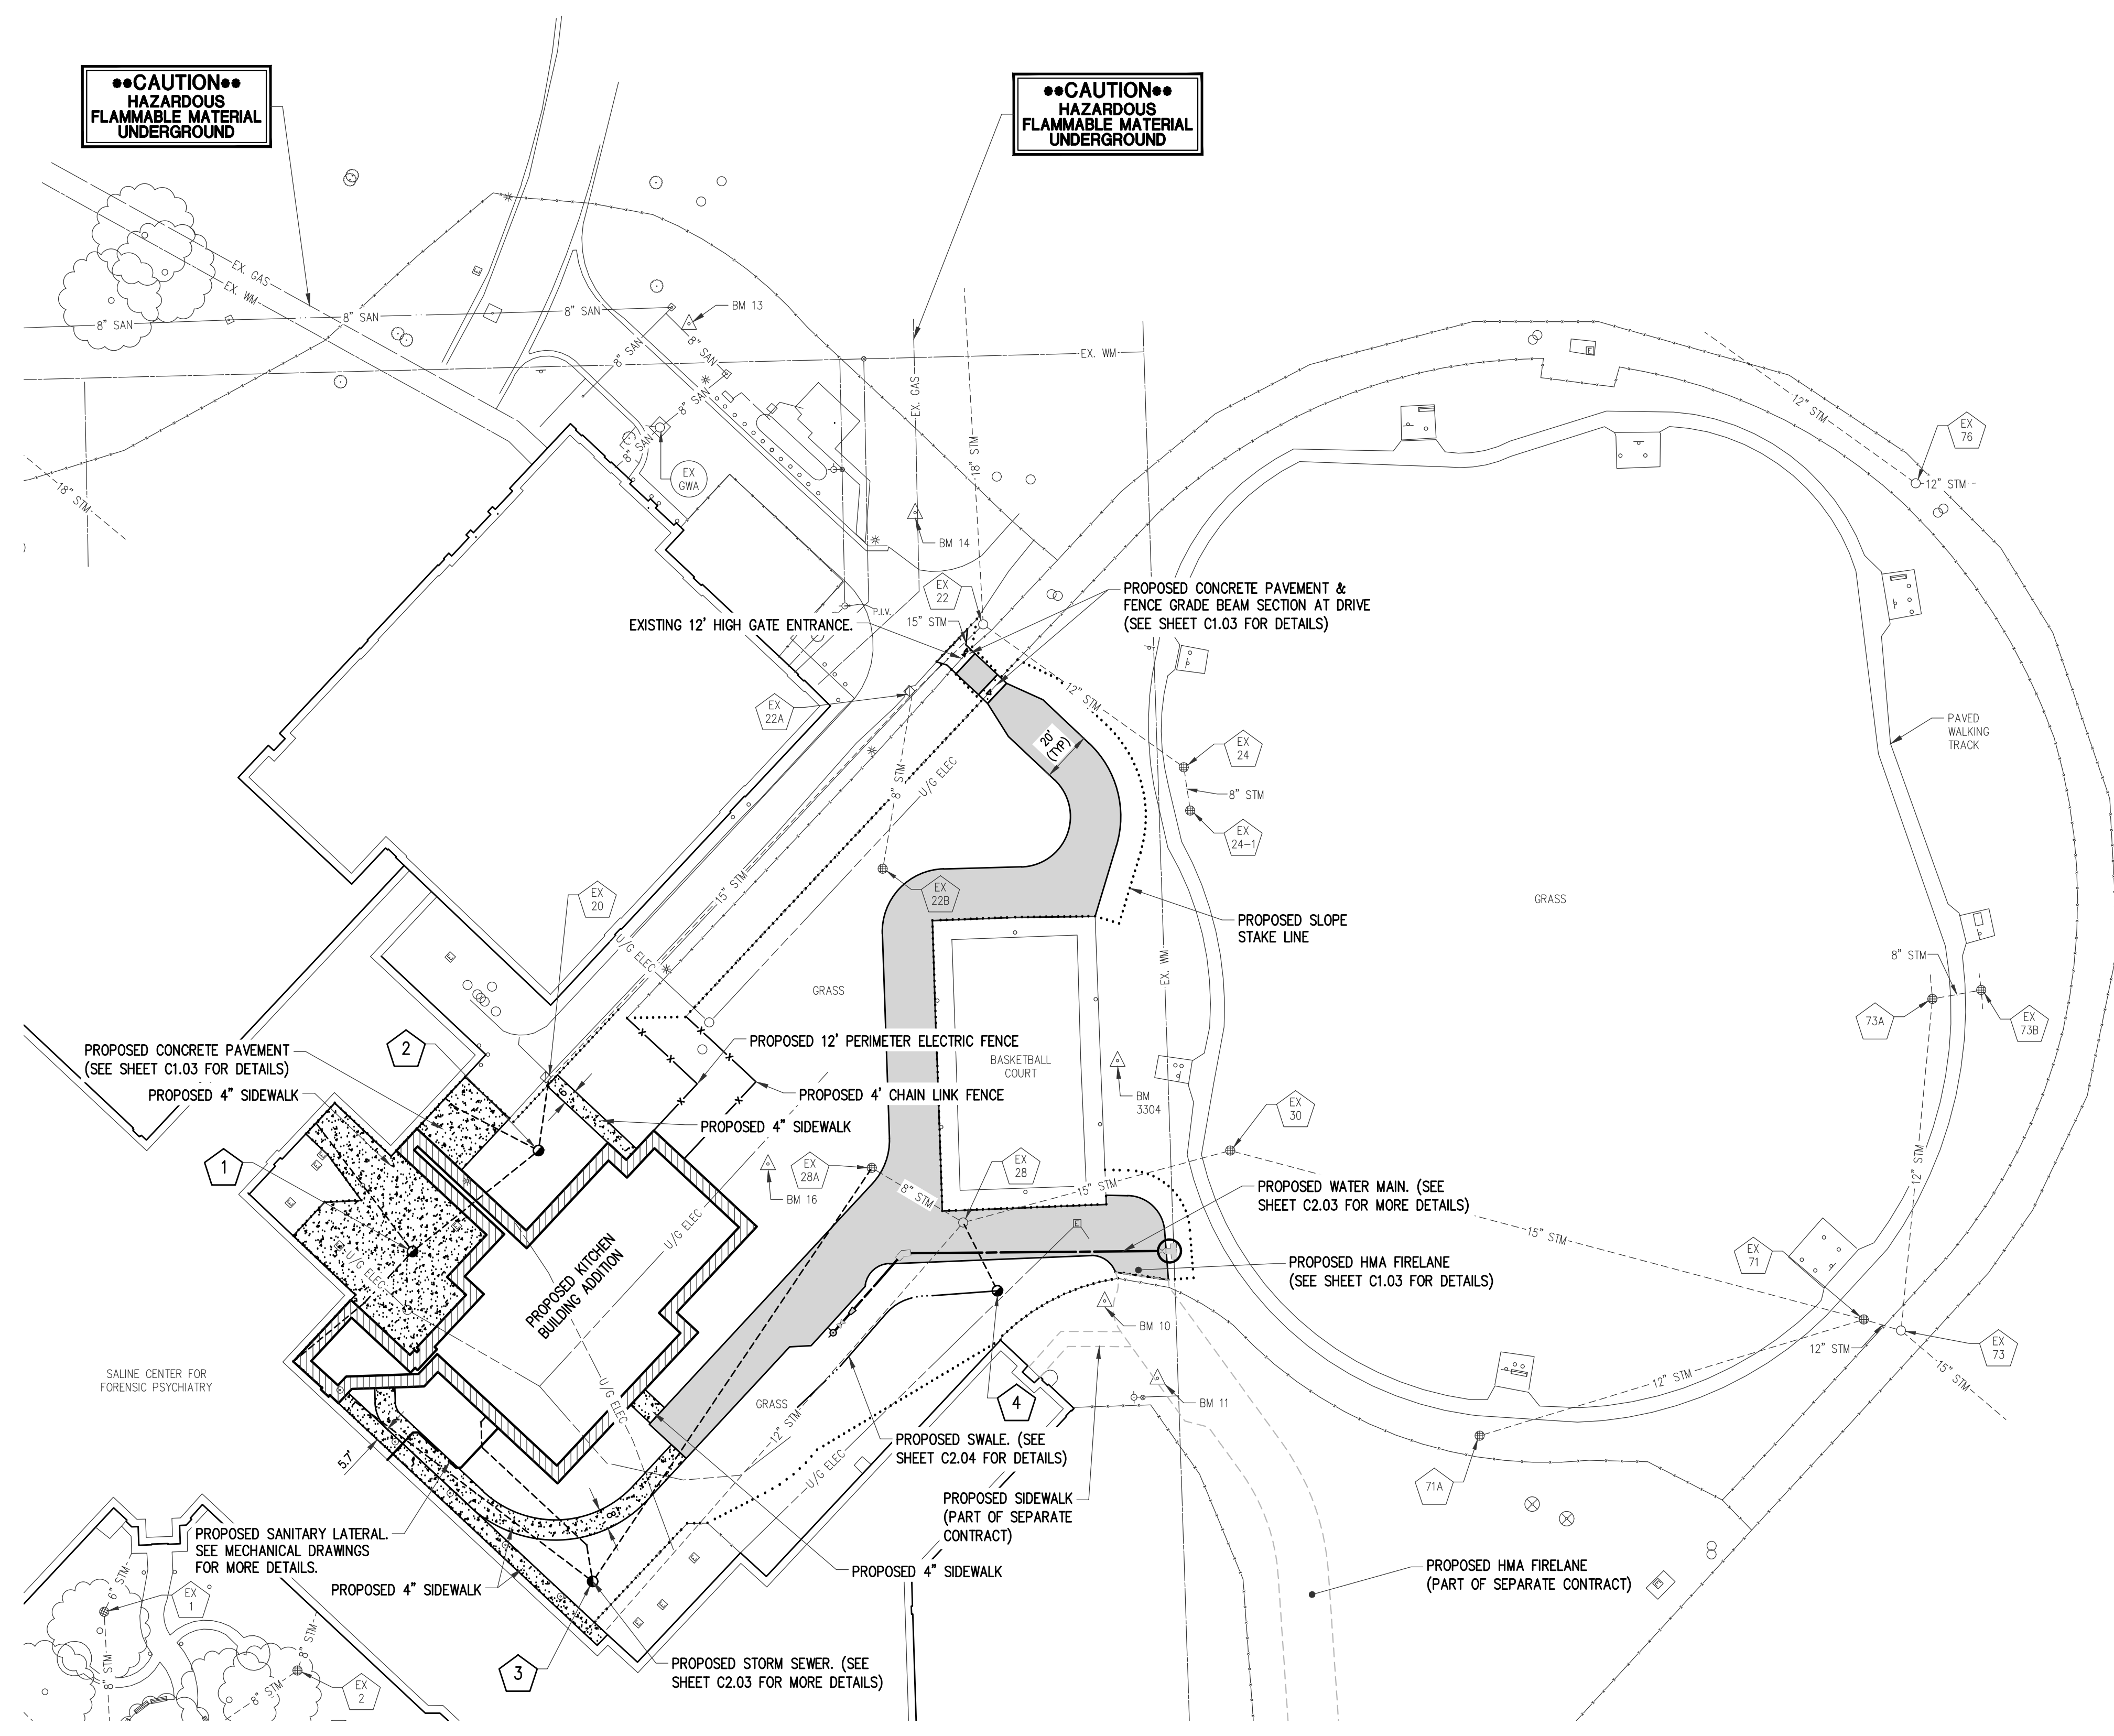

SITE INFORMATION

PROPERTY ADDRESS: 8303 PLATT ROAD
SALINE, MI 48176

PROPERTY OWNER: CENTER FOR FORENSIC PSYCHIATRY

PROPERTY TAX ID: S-19-02-200-003

ZONING AND SETBACK REQUIREMENTS: A-2; INTERM AGRICULTURE
FRONT YARD SETBACK - 50 FT
SIDE YARD SETBACK - 30 FT
REAR YARD SETBACK - 50 FT

LEGAL DESCRIPTION: OWNER REQUEST YO 2-7A-1 BEG AT NW COR SEC 2, TH N 88-35-59 E 351.45 FT, TH S 01-24-01 W 388.00 FT, TH N 88-35-59 E 245.00 FT, TH N 01-24-01 E 388.00 FT, TH N 88-35-59 E 344.48 FT, TH S 01-30-15 E 1199.51 FT, TH S 88-33-41 W 3429.32 FT, TH N 01-34-54 W 1200.00 FT TO THE POB, PT OF N 1/2 SEC 2, T4S-R6E, 92.31 AC SPLIT ON 06/29/2005 FROM S-19-02-200-001;

TOTAL SITE AREA: 92.31 ACRES

ADJACENT PROPERTIES: S-19-02-200-002
S-19-02-200-004




NO.	REVISION	DATE



FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

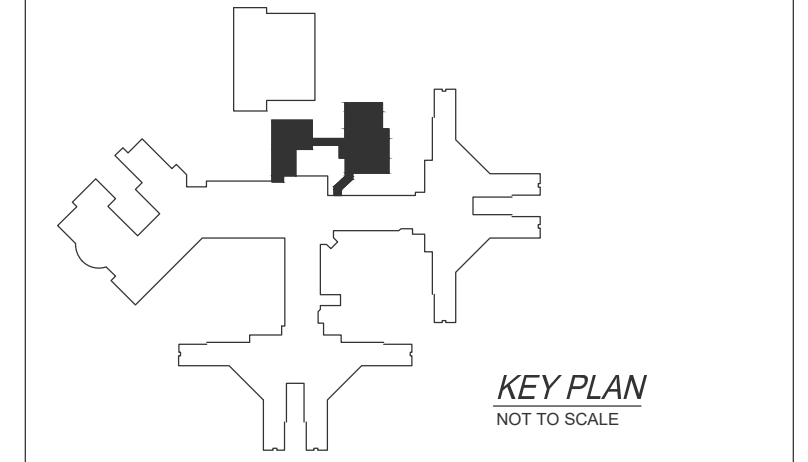

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023




PROJECT TITLE
491/20167.SDW CFP - PHASE 500


CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
SITE PLAN

PROJECT NUMBER 2021094	SHEET NUMBER C2.02
PROJECT DATE SEPTEMBER 6, 2023	
CHECKED BY A.J.T.	

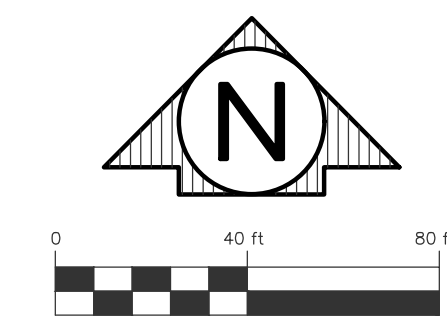

CAUTION
HAZARDOUS
FLAMMABLE MATERIAL
UNDERGROUND

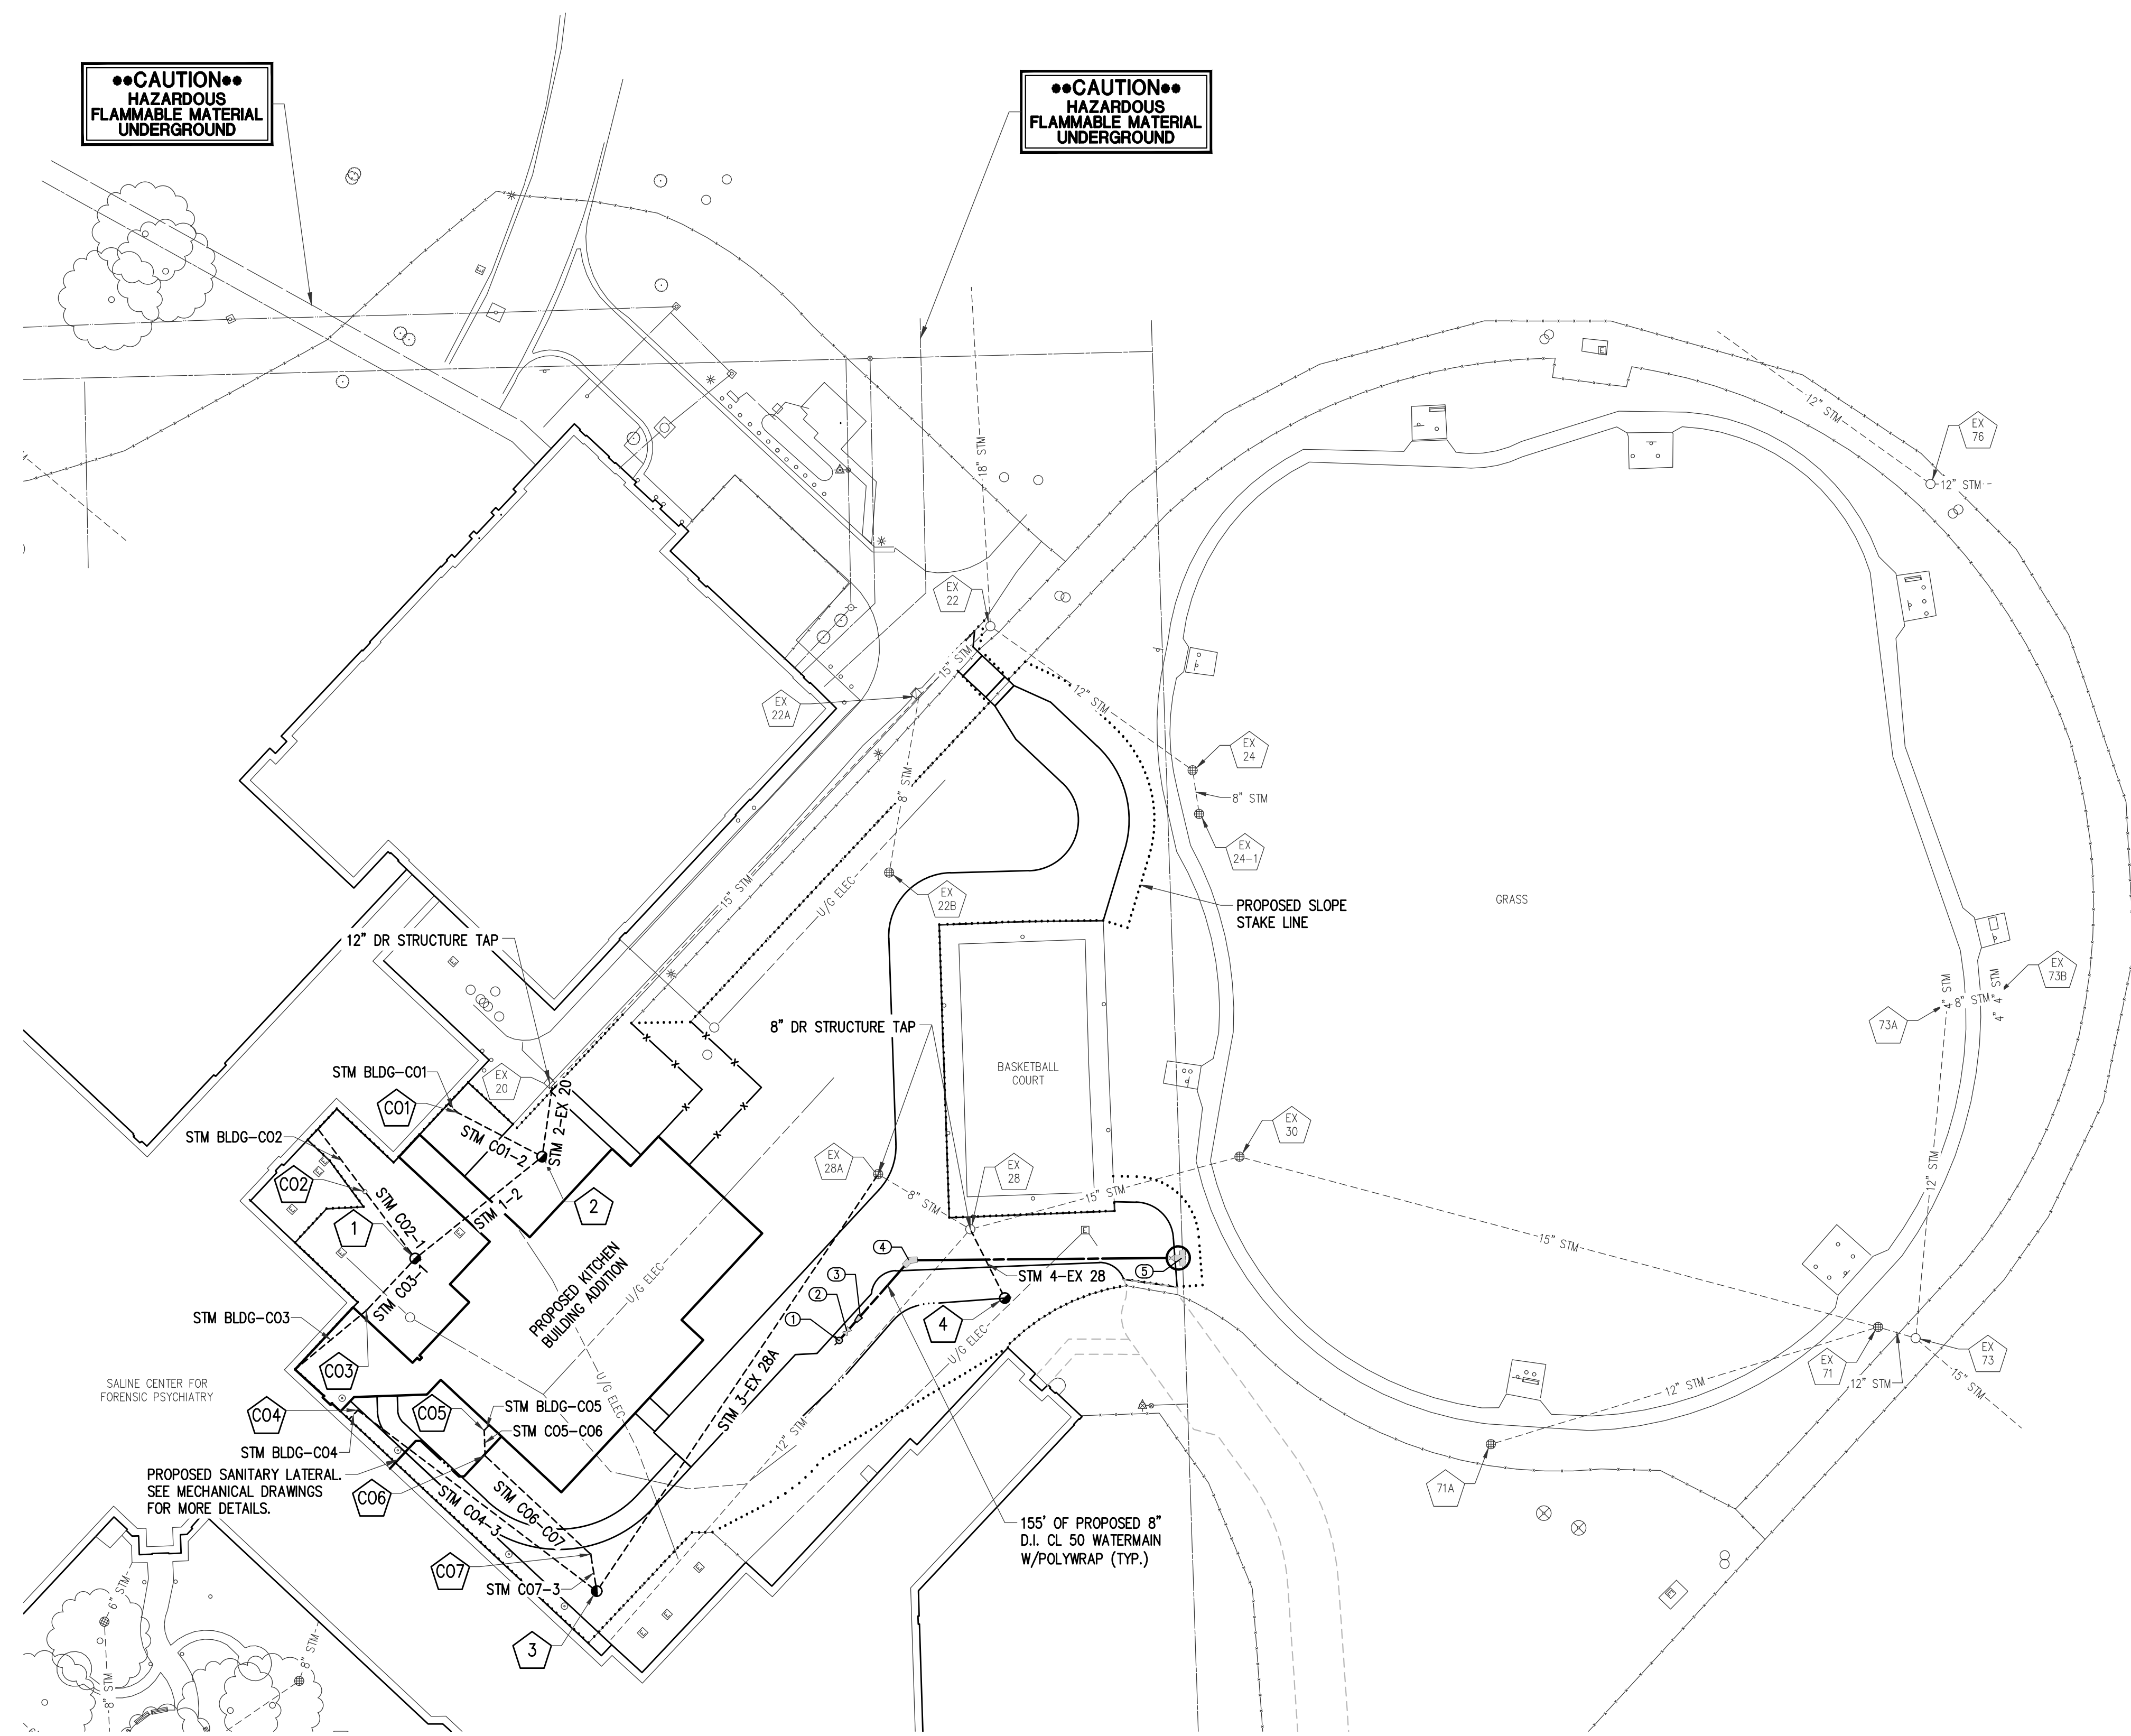


POINT	FITTING TYPE	NORTHING	EASTING
1	HYDRANT ASSEMBLY	244776.00	13306121.18
2	6" GATE VALVE	244779.62	13306124.36
3	8" x 6" REDUCER	244785.58	13306129.58
4	45° BEND	244807.65	13306148.92
5	8" x 12" TAPPING SLEEVE & VALVE IN WELL	244808.58	13306256.48

STRUCT NO.	DIA.	COVER TYPE	RIM ELEVATION	INVERT	NORTHING	EASTING
EX 28	N/A	N/A	RM=835.09	12" 827.27 SW (EX) 8" 829.27 SE (PR) 8" 825.61 NW (EX) 15" 819.10 E (EX)	244819.86	13306172.92
EX 20	N/A	N/A	T/C=834.37	12" 830.29 S (PR) 15" 830.29 NE (EX)	244876.50	13306008.16
EX 28A	N/A	N/A	RM=833.60	8" 828.18 SW (PR) 8" 828.18 SE (EX)	244841.58	13306136.61
1	48"	G	RM=835.60	12" 831.21 NE (PR) 6" 831.46 SW (PR) 6" 831.46 NW (PR)	244808.30	13305954.08
2	48"	G	RM=835.63	12" 830.57 N (PR) 12" 830.57 SW (PR) 6" 830.82 NW (PR)	244848.48	13306004.16
3	48"	G	RM=834.30	8" 830.16 NE (PR) 6" 830.84 NW (PR) 6" 830.65 N (PR)	244677.20	13306025.68
4	24"	G	RM=833.04	8" 829.57 NW (PR)	244792.70	13306186.54

PIPE NUMBER	DIAMETER	TOTAL LENGTH	SLOPE	TRENCH DETAIL A (T.D. A)	TRENCH DETAIL B (T.D. B)
STM 1-2	12"	64'	1.00%	42'	22'
STM 2-EX 20	12"	28'	1.00%	20'	8'
STM 3-EX 28A	8"	198'	1.00%	8'	190'
STM 4-EX 28	8"	30'	1.00%	5'	25'
STM BLDG-C01	6"	5'	1.00%	0'	5'
STM BLDG-C02	12"	31'	1.00%	0'	31'
STM BLDG-C03	6"	37'	1.00%	0'	37'
STM BLDG-C04	6"	5'	1.00%	0'	5'
STM BLDG-C05	6"	3'	1.00%	0'	3'
STM C01-2	6"	38'	1.00%	10'	28'
STM C02-1	6"	33'	1.00%	8'	25'
STM C03-1	6"	28'	1.00%	5'	23'
STM C04-3	6"	118'	1.00%	0'	118'
STM C05-C06	6"	10'	1.00%	7'	3'
STM C06-C07	6"	57'	1.00%	15'	42'
STM C07-3	6"	15'	1.00%	12'	3'


CLEANOUT	NORTHING	EASTING
C01	244865.88	13305970.76
C02	244834.65	13305934.31
C03	244787.91	13305934.89
C04	244748.56	13305931.40
C05	244740.57	13305981.26
C06	244730.57	13305981.61
C07	244691.72	13306023.27

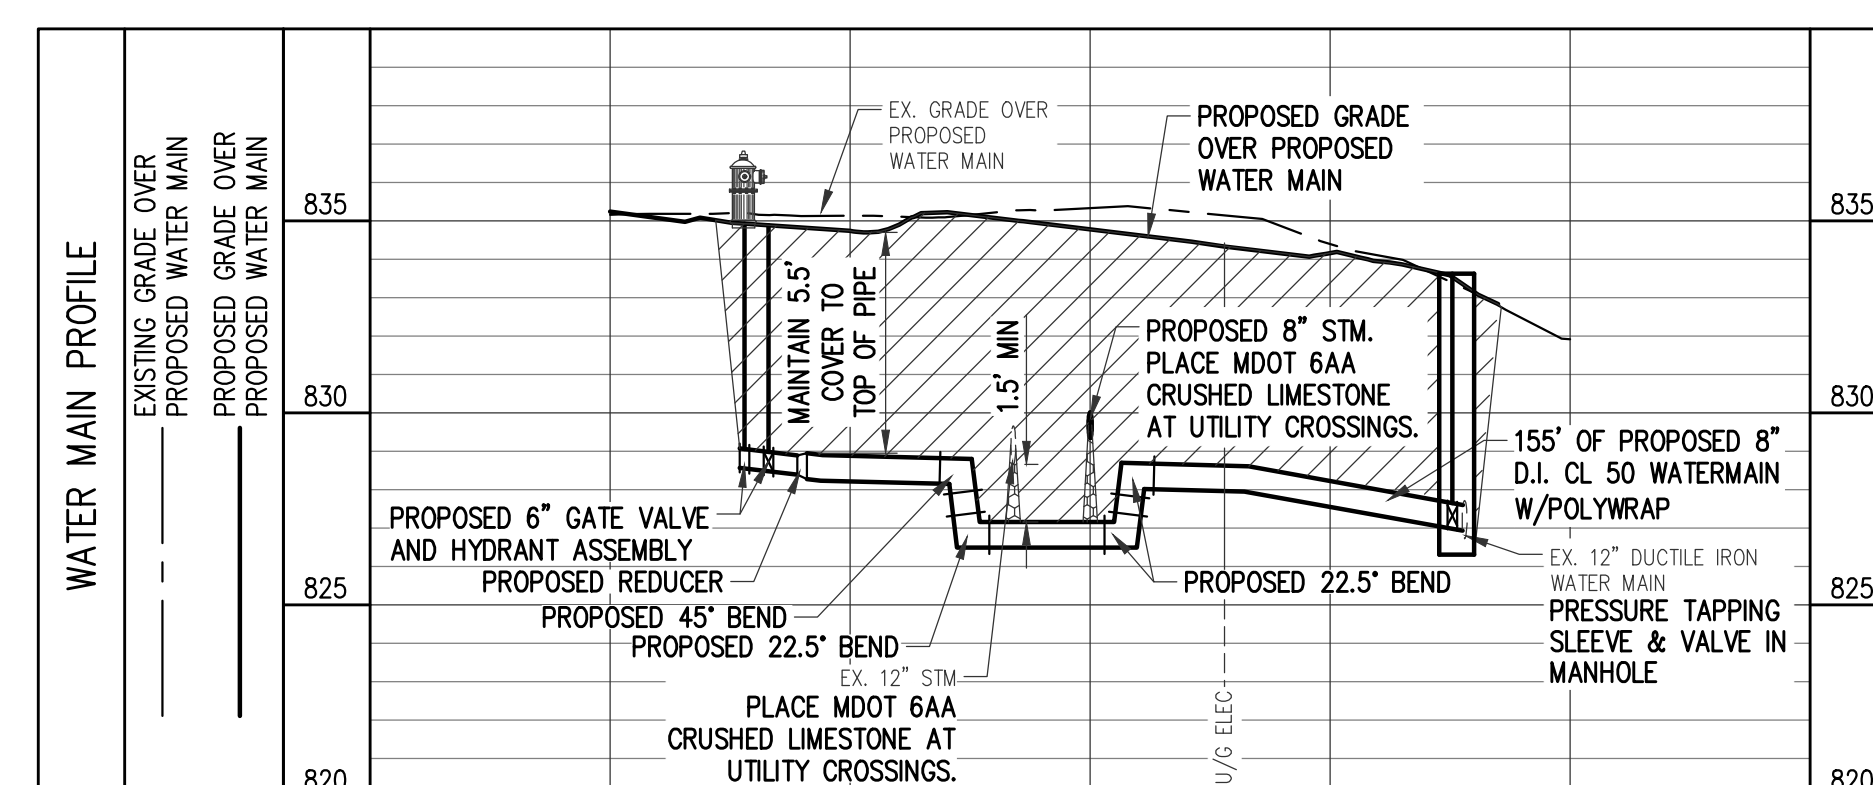

NO.	REVISION	DATE



FILE NO.
491/20167.SDW
FUNDING CODE
171CODHHS7255
CONTRACT NO.
Y22003

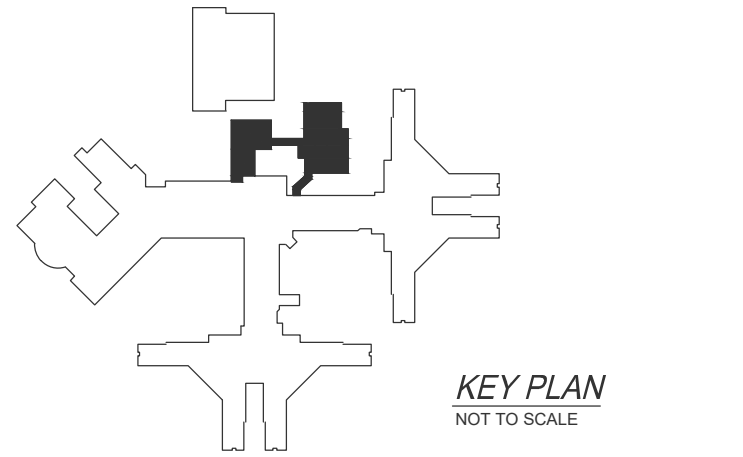

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

ROWE PROFESSIONAL SERVICES COMPANY

PROJECT TITLE
491/20167.SDW CFP - PHASE 500
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
UTILITY PLAN

PROJECT NUMBER 2021094	SHEET NUMBER C2.03
PROJECT DATE SEPTEMBER 6, 2023	CHECKED BY A.J.T.


GRADING TABLE				
POINT	ELEVATION	DESCRIPTION	NORTHING	EASTING
100	TW=836.88	PC	244707.13	13305978.81
101	TW=836.39	PC	244743.58	13305948.46
102	TW=836.94	PC	244712.98	13305982.28
103	TW=836.32	PC	244737.73	13305944.00
104	TW=836.44	PC	244748.17	13305939.24
105	TW=836.44	PC	244748.45	13305947.24
106	TW=836.50	ME	244846.22	13305945.58
107	TW=836.50	ME	244855.07	13305911.86
108	TW=836.50	ME	244848.42	13305947.63
109	TW=836.51	ME	244846.88	13305920.38
110	TW=836.33	ME	244823.43	13305957.90
111	TW=836.50	ME	244867.31	13305923.18
112	TW=836.50	ME	244831.69	13305965.57
113	TW=836.26	ME	244828.69	13305933.78
114	TW=836.27	ME	244829.58	13305951.26
115	TW=836.50	ME	244857.19	13305955.82
116	TW=836.00	ME	244877.73	13305974.97
117	TW=836.50	ME	244840.72	13305973.48
118	TW=835.73	ME	244861.26	13305992.63
119	TW=834.44	ME	244694.09	13306017.22
120	RM=834.30	ME	244677.20	13306025.68
121	TW=836.07	ME	244874.11	13306007.56
122	TW=836.05	ME	244878.49	13306011.66
123	TW=836.50	ME	244844.77	13306039.02

GRADING TABLE				
POINT	ELEVATION	DESCRIPTION	NORTHING	EASTING
124	TW=836.40	ME	244849.15	13306043.12
125	ME=836.05	ME	244901.07	13306039.28
126	ME=835.59	ME	244901.07	13306062.75
127	TW=836.50	ME	244814.66	13306096.74
128	TW=836.50	ME	244754.02	13306039.04
129	TW=836.50	ME	244754.30	13305947.03
130	TW=836.06	TP	244726.12	13306062.81
131	TW=836.17	TP	244731.57	13306056.95
132	TW=836.29	TP	244739.70	13306048.15
133	TW=836.50	ME	244747.42	13306040.76
134	TW=836.50	ME	244753.52	13306046.44
135	TW=836.29	TP	244746.15	13306054.18
136	TW=835.86	PC	244715.13	13306041.70
137	TW=835.78	PC	244709.69	13306047.56
138	RM=835.60	PC	244808.30	13305954.08
139	RM=835.52	PC	244848.48	13306004.16
140	TP=834.74	PC	244835.45	13306136.96
141	RM=833.60	PC	244841.58	13306136.61
142	TP=834.74	PC	244853.31	13306143.61
143	TP=834.98	PC	244934.55	13306165.14
144	TP=834.67	PC	244960.41	13306165.14
145	TP=834.37	PC	244961.22	13306196.03
146	TP=834.10	PC	244965.22	13306207.51
147	TP=834.46	PC	244995.77	13306209.21

GRADING TABLE				
POINT	ELEVATION	DESCRIPTION	NORTHING	EASTING
148	TP=834.72	PC	245013.07	13306190.85
149	TP=834.88	PC	245026.20	13306182.61
150	TP=834.93	PC	245029.63	13306178.98
151	TP=835.06	PC	245038.01	13306170.08
152	TP=835.11	ME	245042.73	13306162.31
153	TP=835.11	ME	245041.43	13306166.46
154	TP=834.97	ME	245055.73	13306174.81
155	TP=834.91	ME	245049.44	13306173.99
156	TP=834.86	ME	245046.02	13306177.62
157	TP=834.73	ME	245037.64	13306186.52
158	TP=834.68	ME	245034.21	13306180.16
159	TP=834.52	ME	245027.63	13306204.57
160	TP=834.26	PC	245010.33	13306222.83
161	TP=833.84	PC	244969.85	13306233.79
162	TP=833.51	ME	244941.53	13306225.30
163	TP=834.01	ME	244941.15	13306183.63
164	TP=834.54	ME	244939.83	13306180.64
165	TP=834.96	ME	244933.52	13306162.14
166	TP=835.04	ME	244884.64	13306162.54
167	TP=835.31	ME	244824.44	13306164.62
168	TP=835.23	ME	244824.56	13306169.98
169	TP=834.12	ME	244827.05	13306229.80
170	TP=834.12	ME	244830.70	13306229.65
171	TP=833.69	PC	244830.52	13306238.32


GRADING TABLE				
POINT	ELEVATION	DESCRIPTION	NORTHING	EASTING
172	TP=833.46	PC	244816.12	13306252.98
173	TP=833.76	ME	244797.03	13306254.47
174	TP=834.31	PC & ME	244800.73	13306233.36
175	TP=834.06	PC	244806.70	13306233.79
176	TP=833.23	PC	244803.49	13306143.51
177	TP=833.94	PC	244795.20	13306134.06
178	TP=834.92	PC	244794.45	13306133.93
179	TP=833.24	PC	244770.93	13306112.48
180	TP=835.35	PC	244770.45	13306103.94
181	SWALE=835.20	PC	244739.12	13306099.42
182	SWALE=834.54	PC	244761.94	13306123.34
183	SWALE=833.96	PC	244783.62	13306142.19
184	SWALE=833.65	PC	244795.20	13306155.81
185	RM=833.04	SWALE	244792.70	13306186.54
186	TW=835.57	PC	244702.01	13306016.20
187	TP=834.67	PC	244893.93	13306142.21
188	TW=836.50	ME	244656.05	13306031.57
189	TW=836.50	ME	244651.83	13306027.45
190	TW=836.50	ME	244702.93	13305972.87
191	TW=836.50	ME	244733.58	13305940.12
192	TW=836.50	ME	244748.04	13305924.64
193	TW=836.50	ME	244752.18	13305928.51
194	TW=836.50	ME	244851.59	13306031.71
195	TW=836.40	ME	244855.97	13306035.80

RADIUS POINTS				
POINT	DESCRIPTION	NORTHING	EASTING	
A	7' & 15' R	244748.70	13305954.23	
B	42' & 50' R	244743.69	13306010.91	
C	10' R	244793.49	13306143.91	
D	10' R	244796.70	13306223.97	
E	15' R	244815.52	13306238.00	
F	25' R	244935.42	13306165.79	
G	20' & 40' R	244981.21	13306195.50	
H	20' R	244770.50	13306157.28	
I	25' R	244852.45	13306118.63	

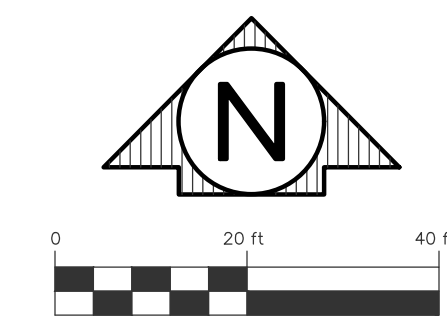

GRADING LEGEND

- TP - TOP OF PAVEMENT
- TW - TOP OF CONCRETE SIDEWALK
- ME - MATCH EXISTING ELEVATION
- PC - POINT OF CURVATURE
- RM - MANHOLE RIM

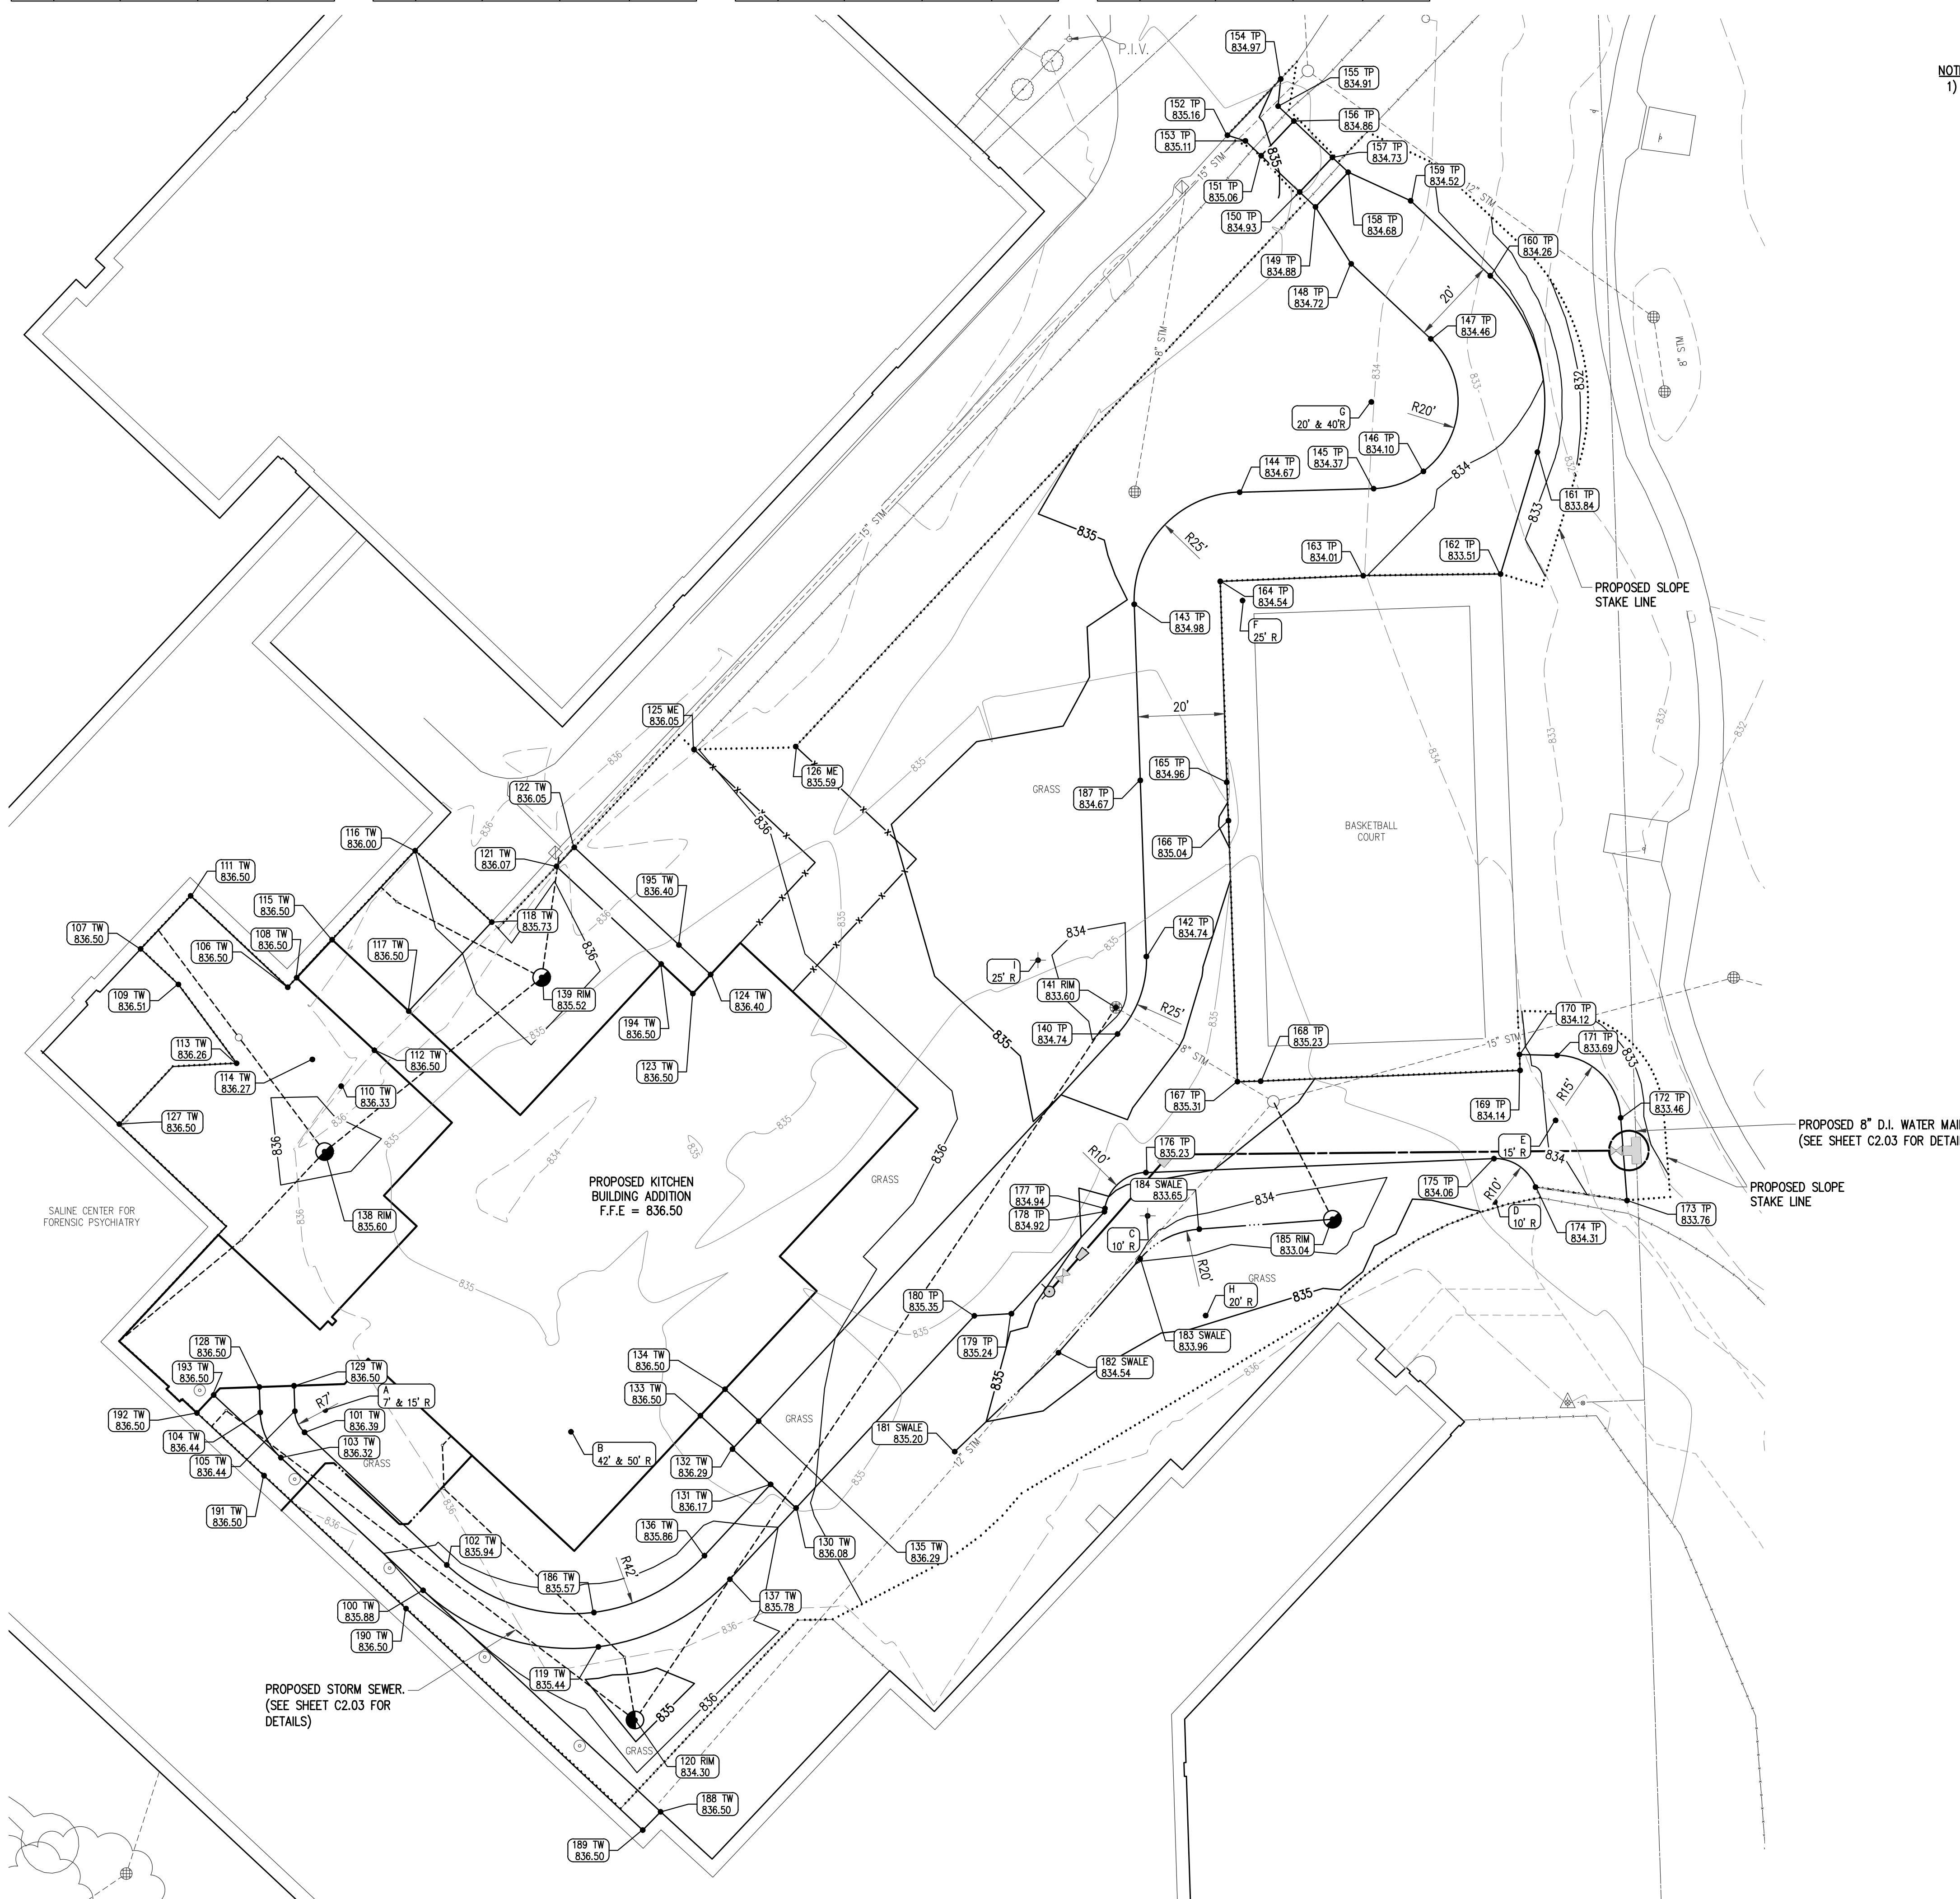

NOTES:
 1) CONTRACTOR TO COMPLETE GROUND PENETRATING RADAR WITHIN CONSTRUCTION LIMITS TO DETERMINE THE EXACT LOCATION OF UNDERGROUND UTILITIES PRIOR TO BEGINNING EXCAVATION.




NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICE ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACER, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

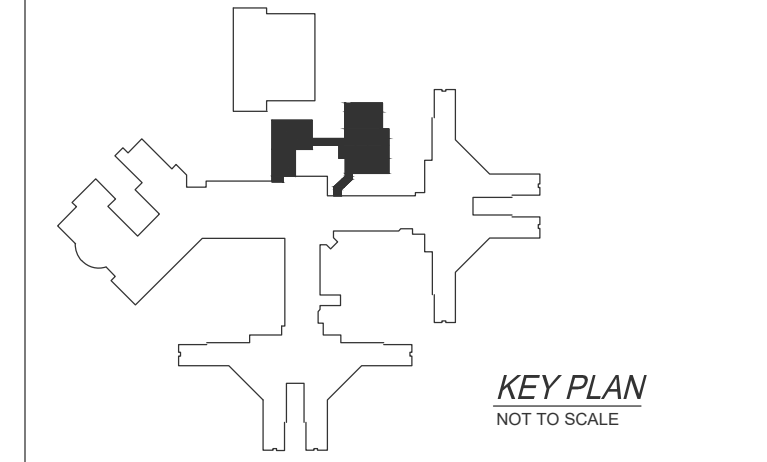

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
 Saginaw, Michigan 48607
 989 752 8107

COPYRIGHT © 2023


ROWE PROFESSIONAL SERVICES COMPANY

PROJECT TITLE
491/20167.SDW CFP - PHASE 500

CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
 SALINE, MICHIGAN

SHEET TITLE
GRADING PLAN

PROJECT NUMBER 2021094	SHEET NUMBER C2.04
PROJECT DATE SEPTEMBER 6, 2023	
CHECKED BY A.J.T.	

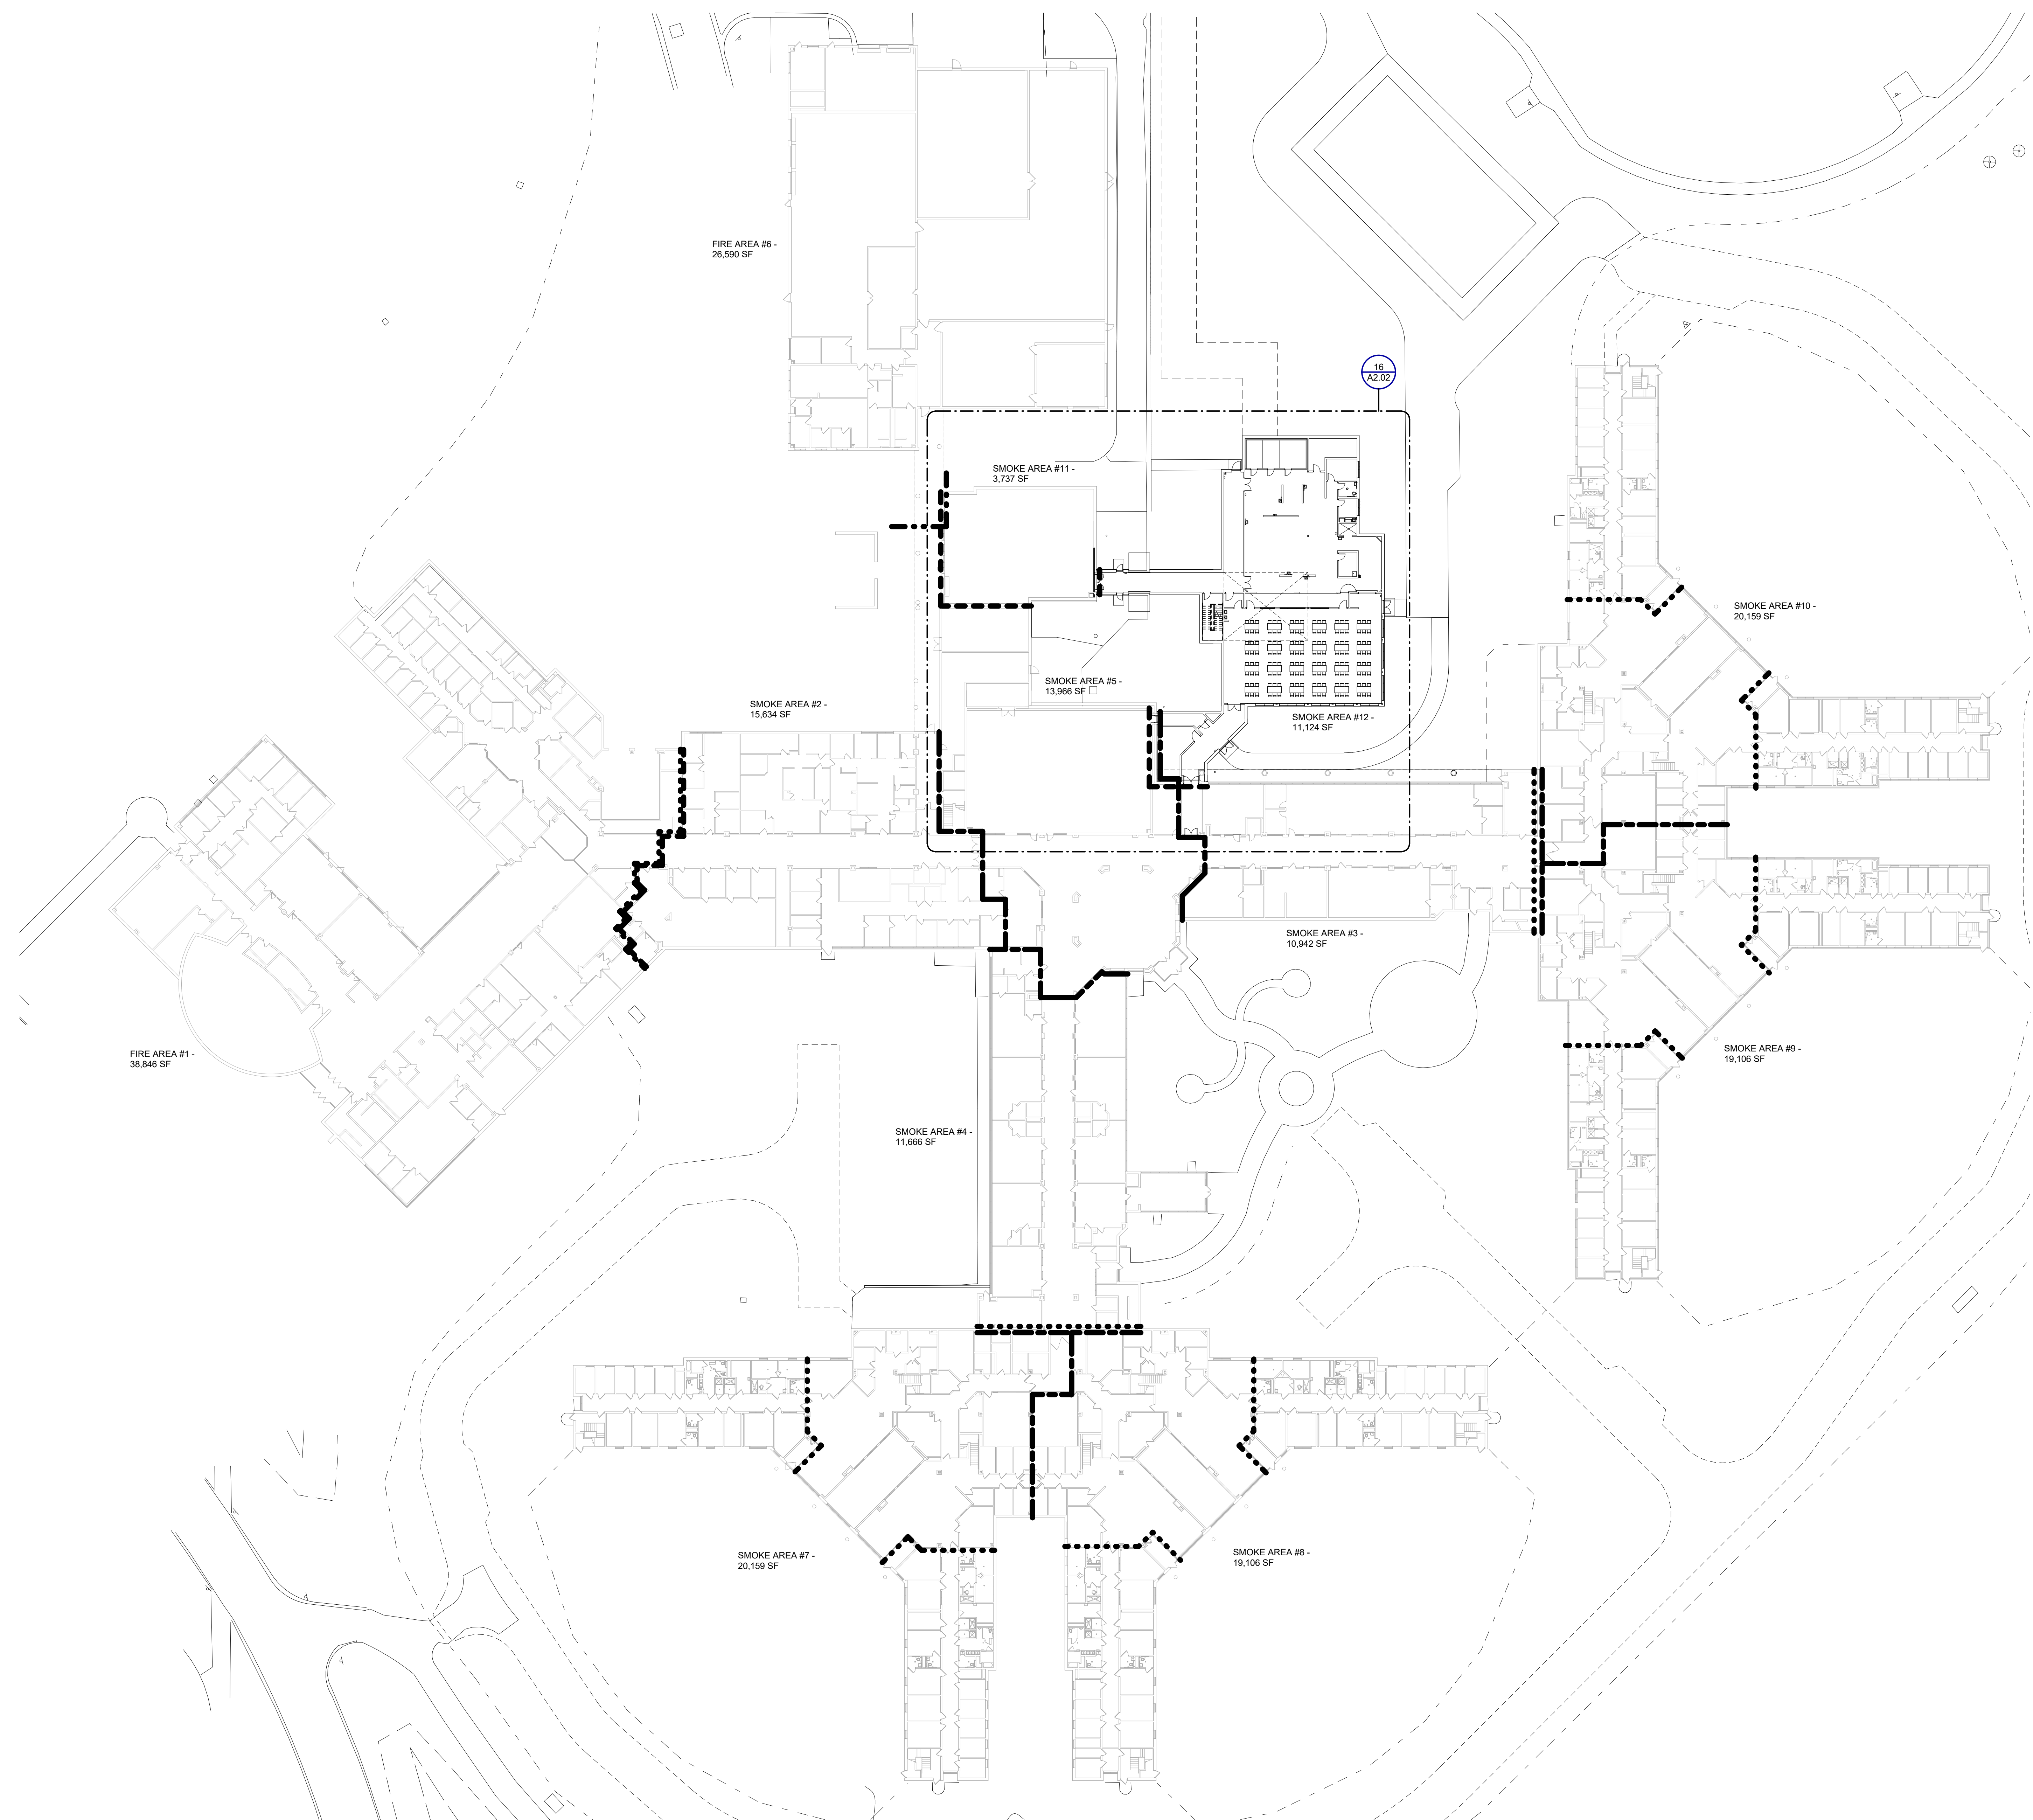

CODE LEGEND

- 3-HOUR BUILDING SEPARATION
- 2-HOUR BARRIER
- 1-HOUR ENCLOSURE
- 1-HOUR SMOKE BARRIER
- TRAVEL DISTANCE
- 100% SPRINKLED
- DF** DRINKING FOUNTAIN
- FE** FIRE EXTINGUISHER
- OCCUPANT LOAD
- EXIT CAPACITY


NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACEL, P.E., DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

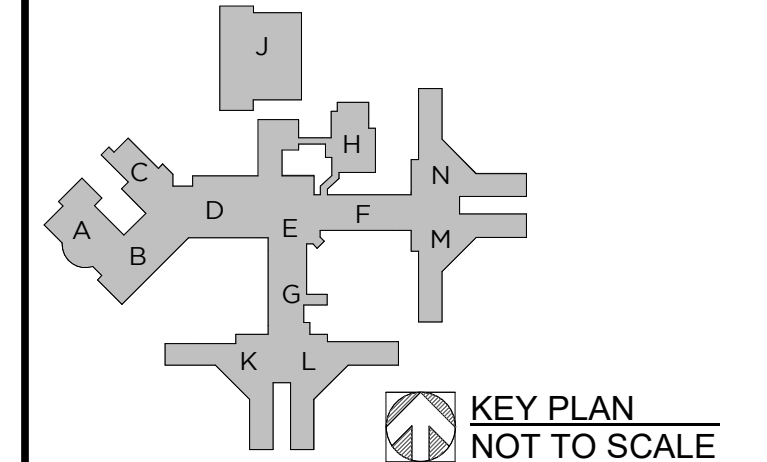

KEY PLAN
 NOT TO SCALE



WTA ARCHITECTS
 100 S Jefferson Ave, Suite 601
 Saginaw, Michigan 48607
 989 752 8107 COPYRIGHT © 2023

PROJECT TITLE
**491/20167.SDW - PHASE 500:
 CENTER FOR FORENSIC
 PSYCHIATRY - CREATE
 KITCHEN**
 SALINE, MICHIGAN

SHEET TITLE
**FIRST FLOOR MASTER
 CODE PLAN**

PROJECT NUMBER
2021094


SHEET NUMBER
A2.01

PROJECT DATE
SEPTEMBER 6, 2023


CHECKED BY
C.D.S.

FIRST FLOOR MASTER PLAN
 TRUE NORTH SCALE: 1/32" = 1'-0"

CENTER FOR FORENSIC PSYCHIATRY - BUILDING CODE NOTES				
CODE REFERENCE	2012 NFPA 2015 MICHIGAN BUILDING CODE ANSI A117.1 2015 PLUMBING CODE 2015 ELECTRICAL CODE 2015 MECHANICAL CODE			
DESCRIPTION	REFERENCE	EXISTING	NEW ADDITION	REMARKS
OCCUPANCY CLASSIFICATION	MBC 303.3 / 308.4	I-2 CONDITION 1	A-2	ASSEMBLY - DINING FACILITY & ASSOCIATED KITCHEN / INSTITUTIONAL - PSYCHIATRIC HOSPITAL
CONSTRUCTION TYPE	MBC 601	IB	IIB	TYPE IIB: RATING FOR BLDG ELEMENTS = 0-HOUR TYPE IB: RATING FOR BLDG ELEMENTS = 2-HOUR EXCEPTION: NONBEAR INT WALLS = 0-HOUR ROOF = 1-HOUR
NONBEARING EXTERIOR WALL SEPARATION	MBC 602	IB:1 > 30 FT = 0-HOUR	IIB:A = 0-HOUR	
FEATURES OF FIRE PROTECTION		FULLY SPRINKLED		
BUILDING HEIGHT	MBC 504.4	ALLOWED - 5 STORIES - 180 FT.	ALLOWED - 3 STORIES - 75 FT.	A-2: ACTUAL - 1 STORY - 18 FT.
BUILDING AREA	MBC 506.2	UNLIMITED	ALLOWED - 38,000 S.F.	A-2: ACTUAL - 11,124 S.F.
SEPARATED OCCUPANCIES	MBC 508.4	I-2	A-2	2-HOUR FIRE BARRIER SEPARATION TO COMPLY WITH A-2 REQUIREMENTS
INCIDENTAL USE AREAS	MBC 509	FURNACE ROOM WITH >400,000 BTU PER HOUR INPUT = 1 HOUR OR SPR. BOILER ROOMS >15 PSI OR 10 HORSEPOWER = 1 HOUR OR SPR. LAUNDRY ROOM > 100 S.F. = 1-HOUR LABS = 1-HOUR & SPR. PHY PLANT MAINT SHOPS = 1-HOUR	LAUNDRY ROOM > 100 S.F. = 1-HOUR OR SPR.	BUILDING FULLY SPRINKLERED
FIRE BARRIERS	MBC 707	SEPARATED OCCUPANCIES		CONTINUITY: TOP OF FND OR FLR/CLG ASSEMBLY TO UNDERSIDE OF FLR OR ROOF ABOVE - CONT THRU OUT CONCEALED SPACES
INTERIOR WALL/CEILING FINISHES	MBC TABLE 803.11	INTERIOR EXIT STAIRWAYS - B CORRIDORS - B	ROOMS AND ENCLOSED SPACES - B ADMIN - C ≤ 4 OCC. - C	ROOMS AND ENCLOSED SPACES - C
OCCUPANT LOAD	MBC 1004.1.2	STOR/MECH 1,300 S.F. (GROSS) WAREHOUSE 1/500 S.F. (GROSS)	INPAT 1,240 S.F. (GROSS) SLEEPING 1/120 S.F. (GROSS)	KITCHEN 1,200 S.F. (GROSS) DINING ROOM/SERVING 15 S.F. (NET)
FIRE EXTINGUISHERS	NFPA 10	75' MAXIMUM DISTANCE APART		
COMMON PATH EGRESS TRAVEL	MBC 1006.2.1	75'		
NUMBER OF EXITS	MBC 1006.3.1		REQUIRED: (1) KITCHEN (2) DINING	PROVIDED: (2) DINING ROOM (2) KITCHEN
EXIT ACCESS TRAVEL DISTANCE	MBC 1017.2	200 FT.	250 FT.	
CORRIDOR FIRE RESISTANCE	MBC 1020.1	w/ SPRINKLER = 0 HOUR		FULLY SPRINKLERED
MINIMUM CORRIDOR WIDTH	MBC 1020.2	MIN. 44 INCHES		
DEAD END CORRIDORS	MBC 1020.4	20 FT.		
ACCESSIBILITY	MBC 1101.2		DESIGNED AND CONSTRUCTED TO BE ACCESSIBLE	
PLUMBING FIXTURES	MPC TABLE 403.1		NO ADDITIONAL STAFF OR PATIENTS ARE BEING ADDED TO THE FACILITY	
ENERGY EFFICIENCY	MEC		ROOF - INSULATION ENTIRELY ABOVE DECK = R-30 C.I. WALLS - MASS = R-11.4 C.I. SLAB ON GRADE = R-15 FOR 24IN.	

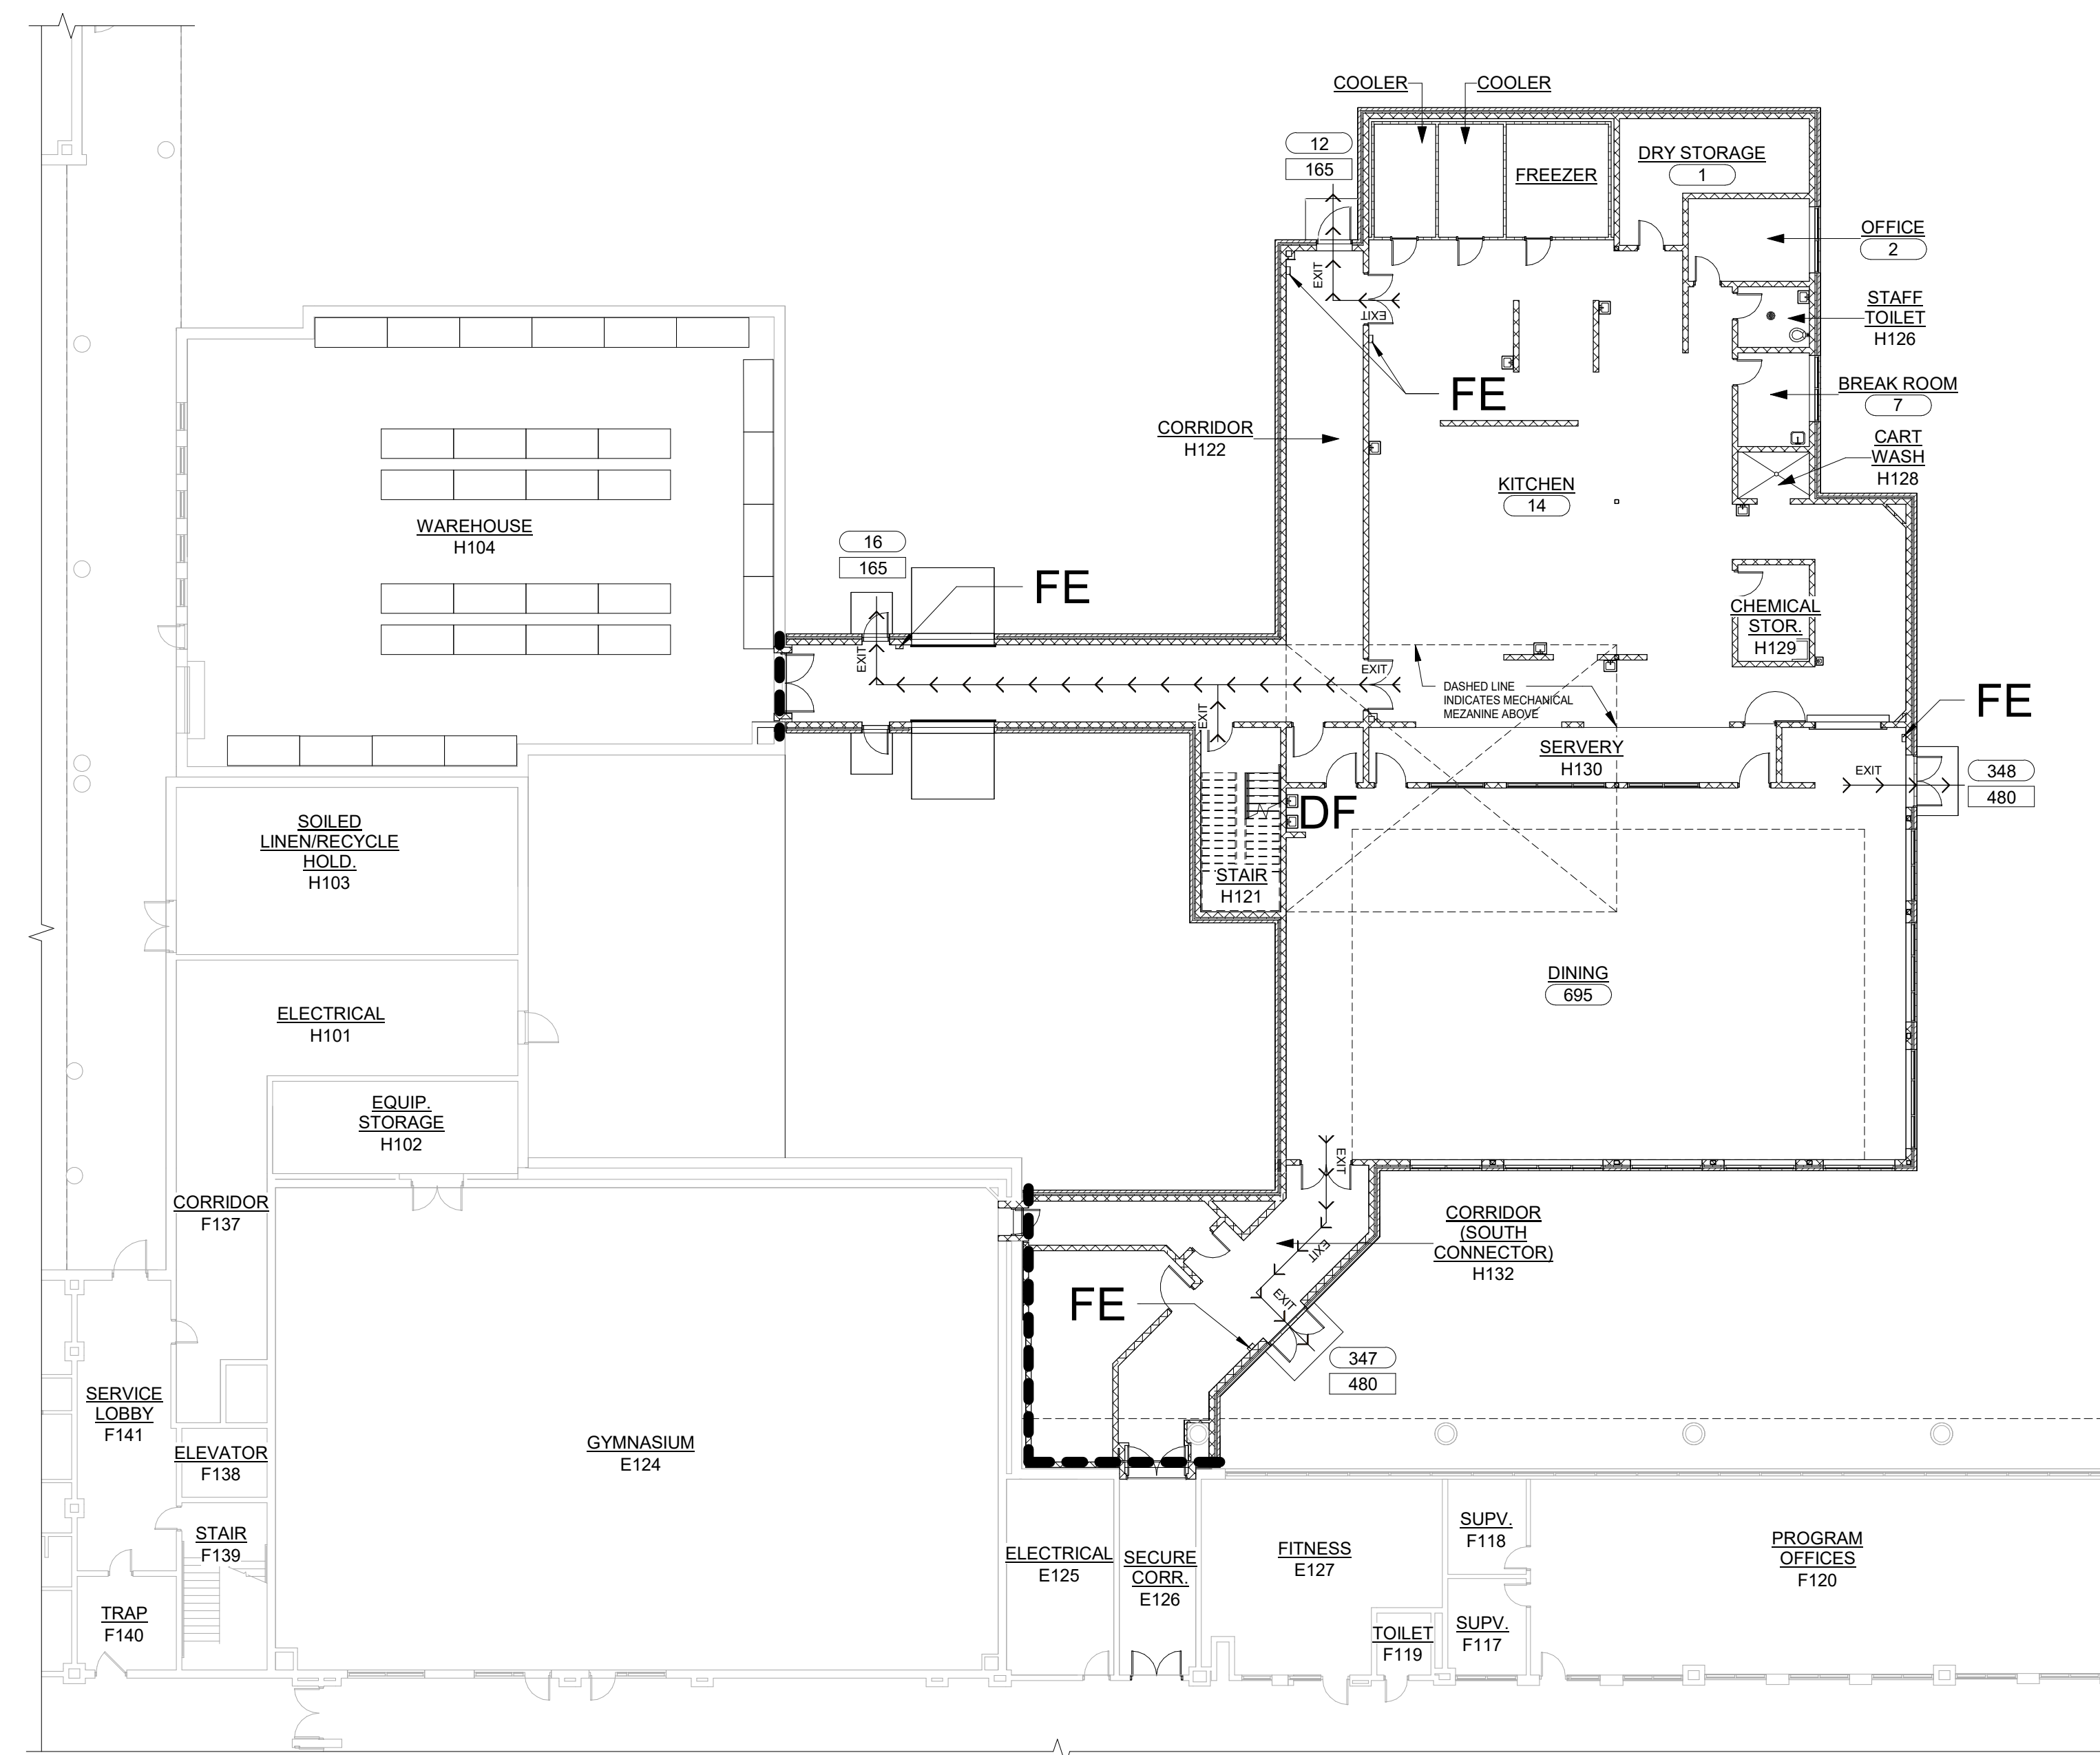

16
AZ.02
FIRST FLOOR CODE PLAN
SCALE: 1/16" = 1'-0"

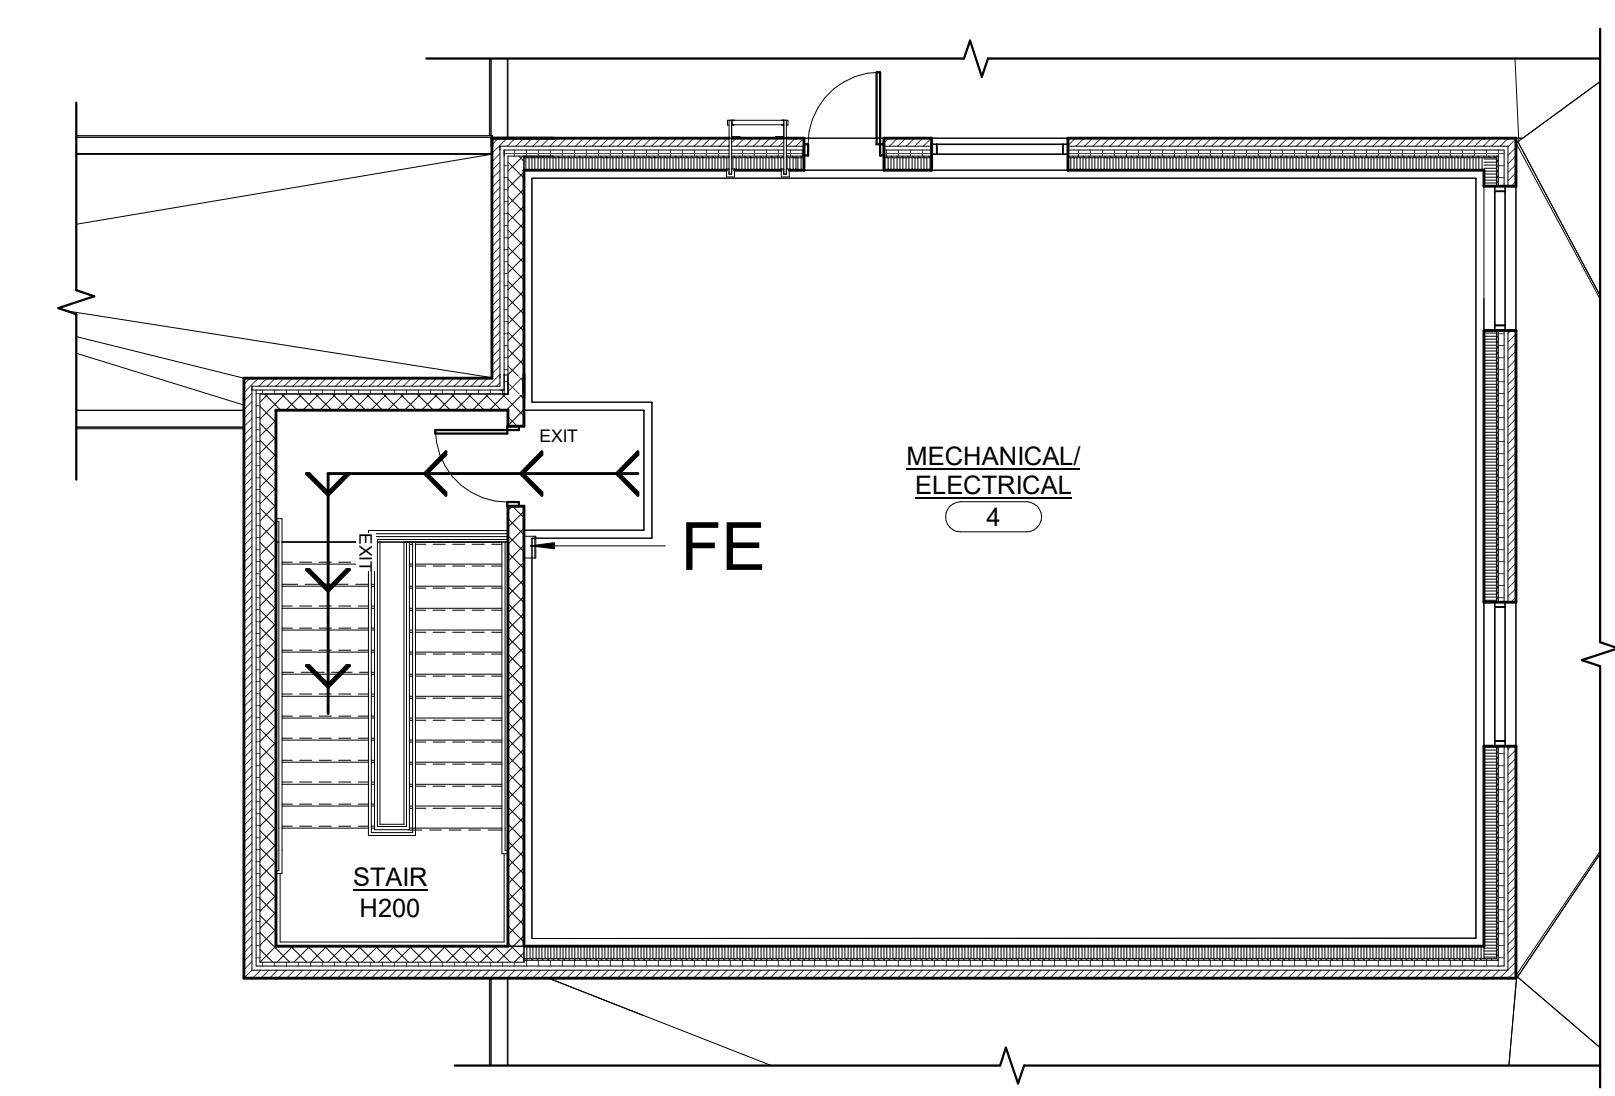

28
AZ.02
SECOND FLOOR CODE PLAN
SCALE: 1/8" = 1'-0"

CODE LEGEND	
	3-HOUR BUILDING SEPARATION
	2-HOUR BARRIER
	1-HOUR ENCLOSURE
	1-HOUR SMOKE BARRIER
	TRAVEL DISTANCE
	100% SPRINKLED
DF	DRINKING FOUNTAIN
FE	FIRE EXTINGUISHER
	OCCUPANT LOAD
	EXIT CAPACITY


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACR, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

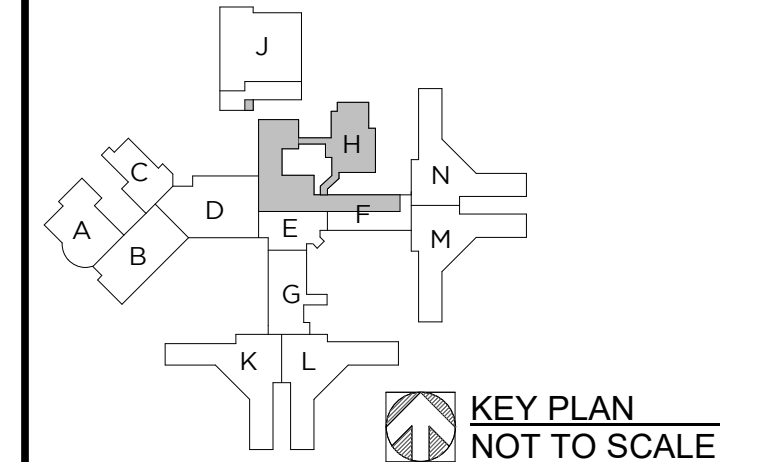

WTAARCH.COM

WTA ARCHITECTS
100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
FIRST FLOOR PARTIAL
CODE PLAN

PROJECT NUMBER 2021094	SHEET NUMBER A2.02
PROJECT DATE SEPTEMBER 6, 2023	
CHECKED BY C.D.S.	

GENERAL DEMOLITION NOTES:

1. THE CONTRACTOR SHALL PROVIDE ALL SHORING, TEMPORARY SUPPORTS, AND BRACING REQUIRED FOR THE SAFE DEMOLITION AND ERECTION OF STRUCTURAL COMPONENTS.
2. ALL BUILDING MATERIAL BEING DEMOLISHED IS TO BE DISPOSED OF BY THE CONTRACTOR, UNLESS NOTED OTHERWISE AND EXCLUDING THOSE ITEMS SALVAGED BY THE OWNER.
3. PROTECT ADJACENT MEMBERS, FINISHES, AND SURFACES FROM DAMAGE DURING DEMOLITION WORK. CONDUCT DEMOLITION TO MINIMIZE INTERFERENCE W/ ADJACENT STRUCTURAL MEMBERS, BUILDING AREAS, AND PUBLIC AND PRIVATE THOROUGHFARES. MAINTAIN PROTECTED EGRESS AND ACCESS AT ALL TIMES.
4. PRIOR TO BEGINNING ANY DEMOLITION WORK PROVIDE TEMPORARY BARRIERS AS REQUIRED TO PREVENT MIGRATION OF DUST AND NOISE INTO ADJACENT AREAS, TO PREVENT UNAUTHORIZED ACCESS INTO THE WORK AREA, AND TO PROTECT THE GENERAL PUBLIC.
5. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL DEMOLITION WORK.

DEMOLITION KEYNOTES


- 1 REMOVE EXISTING DOOR, FRAME, AND ALL ASSOCIATED HARDWARE
- 2 REMOVE A PORTION OF EXISTING WALL CONSTRUCTION FOR NEW OPENING (REFER TO CONSTRUCTION PLAN)
- 3 REMOVE EXISTING CONCRETE ENTRY SLAB AND FOUNDATION
- 4 REMOVE EXISTING FENCE, REFER TO CIVIL FOR LOCATION OF TEMPORARY FENCING AND FOR FINAL FENCING LAYOUT - TEMPORARY FENCING MUST BE IN PLACE PRIOR TO DEMOLITION OF FENCING BEGINS
- 5 REMOVE EXISTING FENCE AND GATE
- 6 REMOVE AND SALVAGE EXISTING SHELVING - RETURN TO OWNER
- 7 REMOVE EXISTING WATER RESISTANT DAMPROOFING ALONG THE EXTENT OF THE FOUNDATION WALL - REFER TO CIVIL FOR LOCATION OF TEMPORARY FENCING AND FOR FINAL FENCING LAYOUT - TEMPORARY FENCING MUST BE IN PLACE PRIOR TO DEMOLITION OF FENCING BEGINS
- 8 EXISTING CEILING TO REMAIN - MODIFY AS REQUIRED FOR NEW OPENINGS (REFER TO CONSTRUCTION PLAN)

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACEL, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

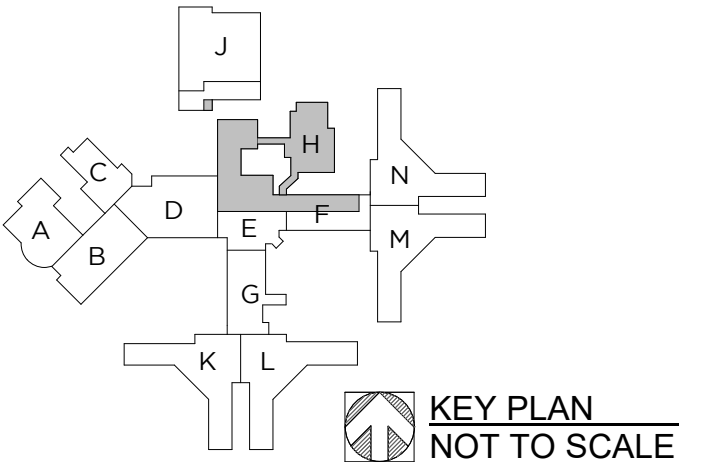

WTAARCH.COM


WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107 COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
**FIRST FLOOR
DEMOLITION PLAN**

PROJECT NUMBER 2021094	SHEET NUMBER A2.11
PROJECT DATE SEPTEMBER 6, 2023	
CHECKED BY C.D.S.	

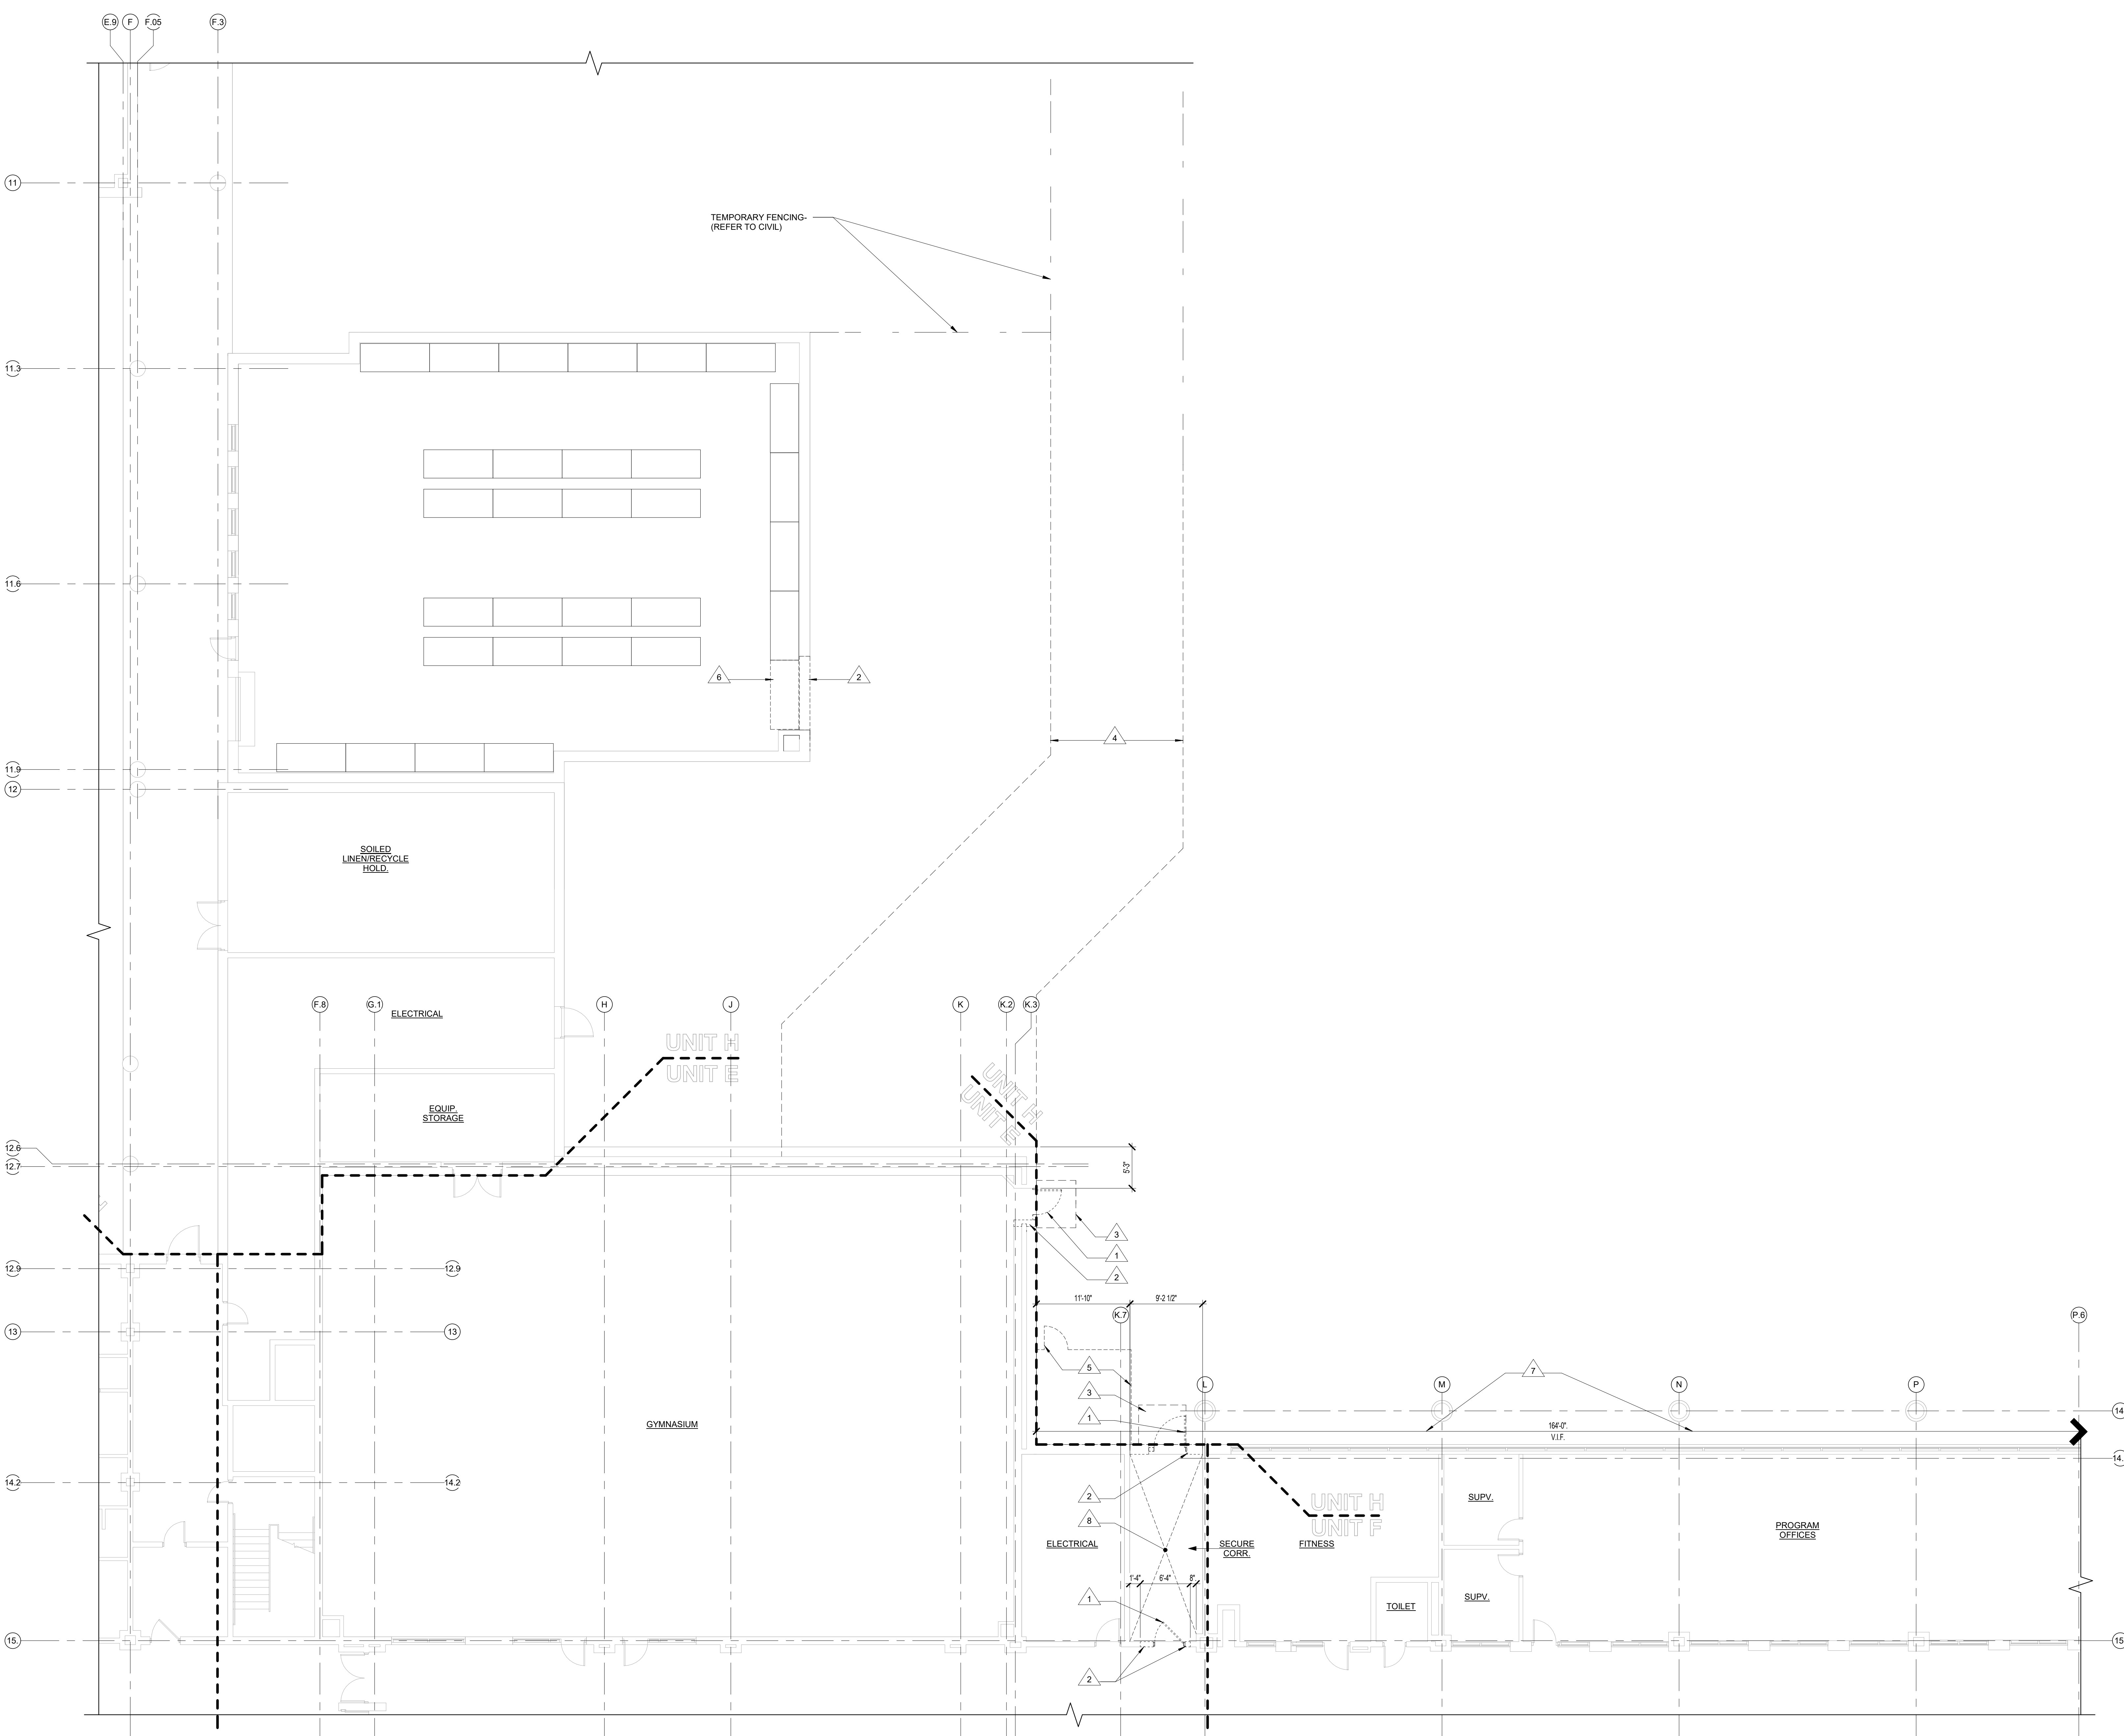

FIRST FLOOR DEMOLITION PLAN
NORTH SCALE: 1/8" = 1'-0"

CONSTRUCTION GENERAL NOTES:

1. WALL TYPES ARE INDICATED AS A DIAMOND WITH A NUMBER. REFER TO SHEET A0.01 FOR DESCRIPTION OF WALL TYPES.
2. PLAN DIMENSIONS DO NOT INCLUDE WALL THICKNESS (REFER TO WALL TYPES).
3. DOOR FRAMES ARE TO BE LOCATED 8" FROM THE PERPENDICULAR WALL ON THE HINGE SIDE OF THE DOOR AT MASONRY WALLS, UNLESS NOTED OTHERWISE.
4. PROVIDE BLOCKING AT ALL WALL MOUNTED ITEMS INCLUDING BUT NOT LIMITED TO: PLUMBING ACCESSORIES, KITCHEN EQUIPMENT, ETC.
5. ALL AREAS DAMAGED BY DEMOLITION WORK ARE TO BE PATCHED AND REPAIRED OR REPLACED TO MATCH ADJACENT SURFACES.
6. PATCH AND REPAIR REMAINING WALLS, AT ARCHITECTURAL, MECHANICAL, AND ELECTRICAL DEMOLITION POINTS WITH SIMILAR MATERIALS IN SIZE, COLOR AND TEXTURE.
7. PATCH AND REPAIR ALL EXISTING FLOORS AS REQUIRED WHERE EXISTING WALLS HAVE BEEN REMOVED.
8. FURNITURE OR EQUIPMENT TO BE BUILT AND/OR INSTALLED BY CONTRACTOR IS SPECIFICALLY NOTED, DIMENSIONED OR DETAILED. ALL OTHER FURNITURE OR EQUIPMENT WILL BE PROVIDED AND INSTALLED BY OWNER.
9. FOR CASEWORK DETAILS - REFER TO "NORTHERN AMERICA ARCHITECTURAL WOODWORK STANDARDS (A.W.S.)."
10. CASEWORK DESIGNATION REFERS TO THE WIDTH (W) AND DEPTH (D) OF THE CABINET. REFER TO DIMENSIONS FOR HEIGHT. REFER TO "A.W.S." FOR CABINET NUMBER LOCATED BELOW DIMENSION LINE.

CONSTRUCTION KEYNOTES


1. CONCRETE ENTRY SLAB (REFER TO STRUCTURAL)
2. PLUMBING FIXTURE (REFER TO MECHANICAL)
3. CASEWORK (REFER TO ELEVATIONS AND DETAILS)
4. STAINLESS STEEL GRAB BARS
5. PAPER TOWEL DISPENSER
6. TOILET PAPER DISPENSER
7. SANITARY NAPKIN RECEPTACLE
8. MIRROR 18" x 36"
9. SOAP DISPENSER
10. RECESSED FIRE EXTINGUISHER CABINET
11. FURNITURE AND EQUIPMENT (BY OWNER)
12. SEMI-RECESSED DETENTION FIRE EXTINGUISHER CABINET
13. PATCH AND REPAIR WALL CONSTRUCTION, WALL BASE, AND FLOORING TO MATCH EXISTING.
14. COORDINATE LOCATION OF FLOOR TILE MOVEMENT JOINTS WITH ARCHITECT, TYPICAL OF TCNA E-171
15. FIN TUBE RADIATOR (REFER TO MECHANICAL)
16. PROVIDE NEW WATER COLD FLUID-APPLIED WATERPROOFING ALONG THE EXISTING OF THE EXISTING FOUNDATION WALL - REFER TO CIVIL FOR COORDINATION OF NEW SIDEWALK, NEW ENTRY SLAB, AND FENCE MODIFICATIONS - USE CAUTION AS UNDERGROUND LINES ARE LOCATED IN THIS AREA.
17. MECHANICAL CHASE VERIFY SIZE WITH KITCHEN EQUIPMENT MFR. AND MECHANICAL (REFER TO MECHANICAL)
18. MECHANICAL CHASE VERIFY CLEAR WIDTH REQUIRED WITH MECHANICAL (REFER TO MECHANICAL)
19. MECHANICAL CHASE VERIFY CLEAR WIDTH REQUIRED WITH MECHANICAL (REFER TO MECHANICAL)
20. EYE WASH STATION (REFER TO FOOD SERVICE AND MECHANICAL)
21. SEMI-RECESSED WET CHEMICAL FIRE EXTINGUISHER CABINET

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACEL, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

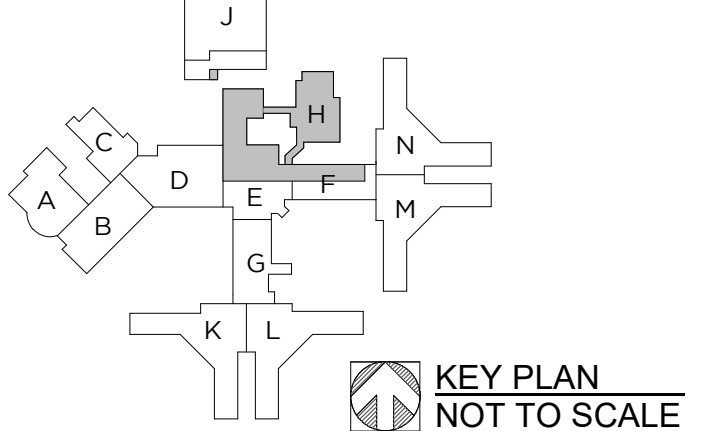

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107 COPYRIGHT © 2023

PROJECT TITLE

491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN

SALINE, MICHIGAN


SHEET TITLE

FIRST FLOOR CONSTRUCTION PLAN


PROJECT NUMBER 2021094 SHEET NUMBER


PROJECT DATE SEPTEMBER 6, 2023 **A2.21**

CHECKED BY C.D.S.

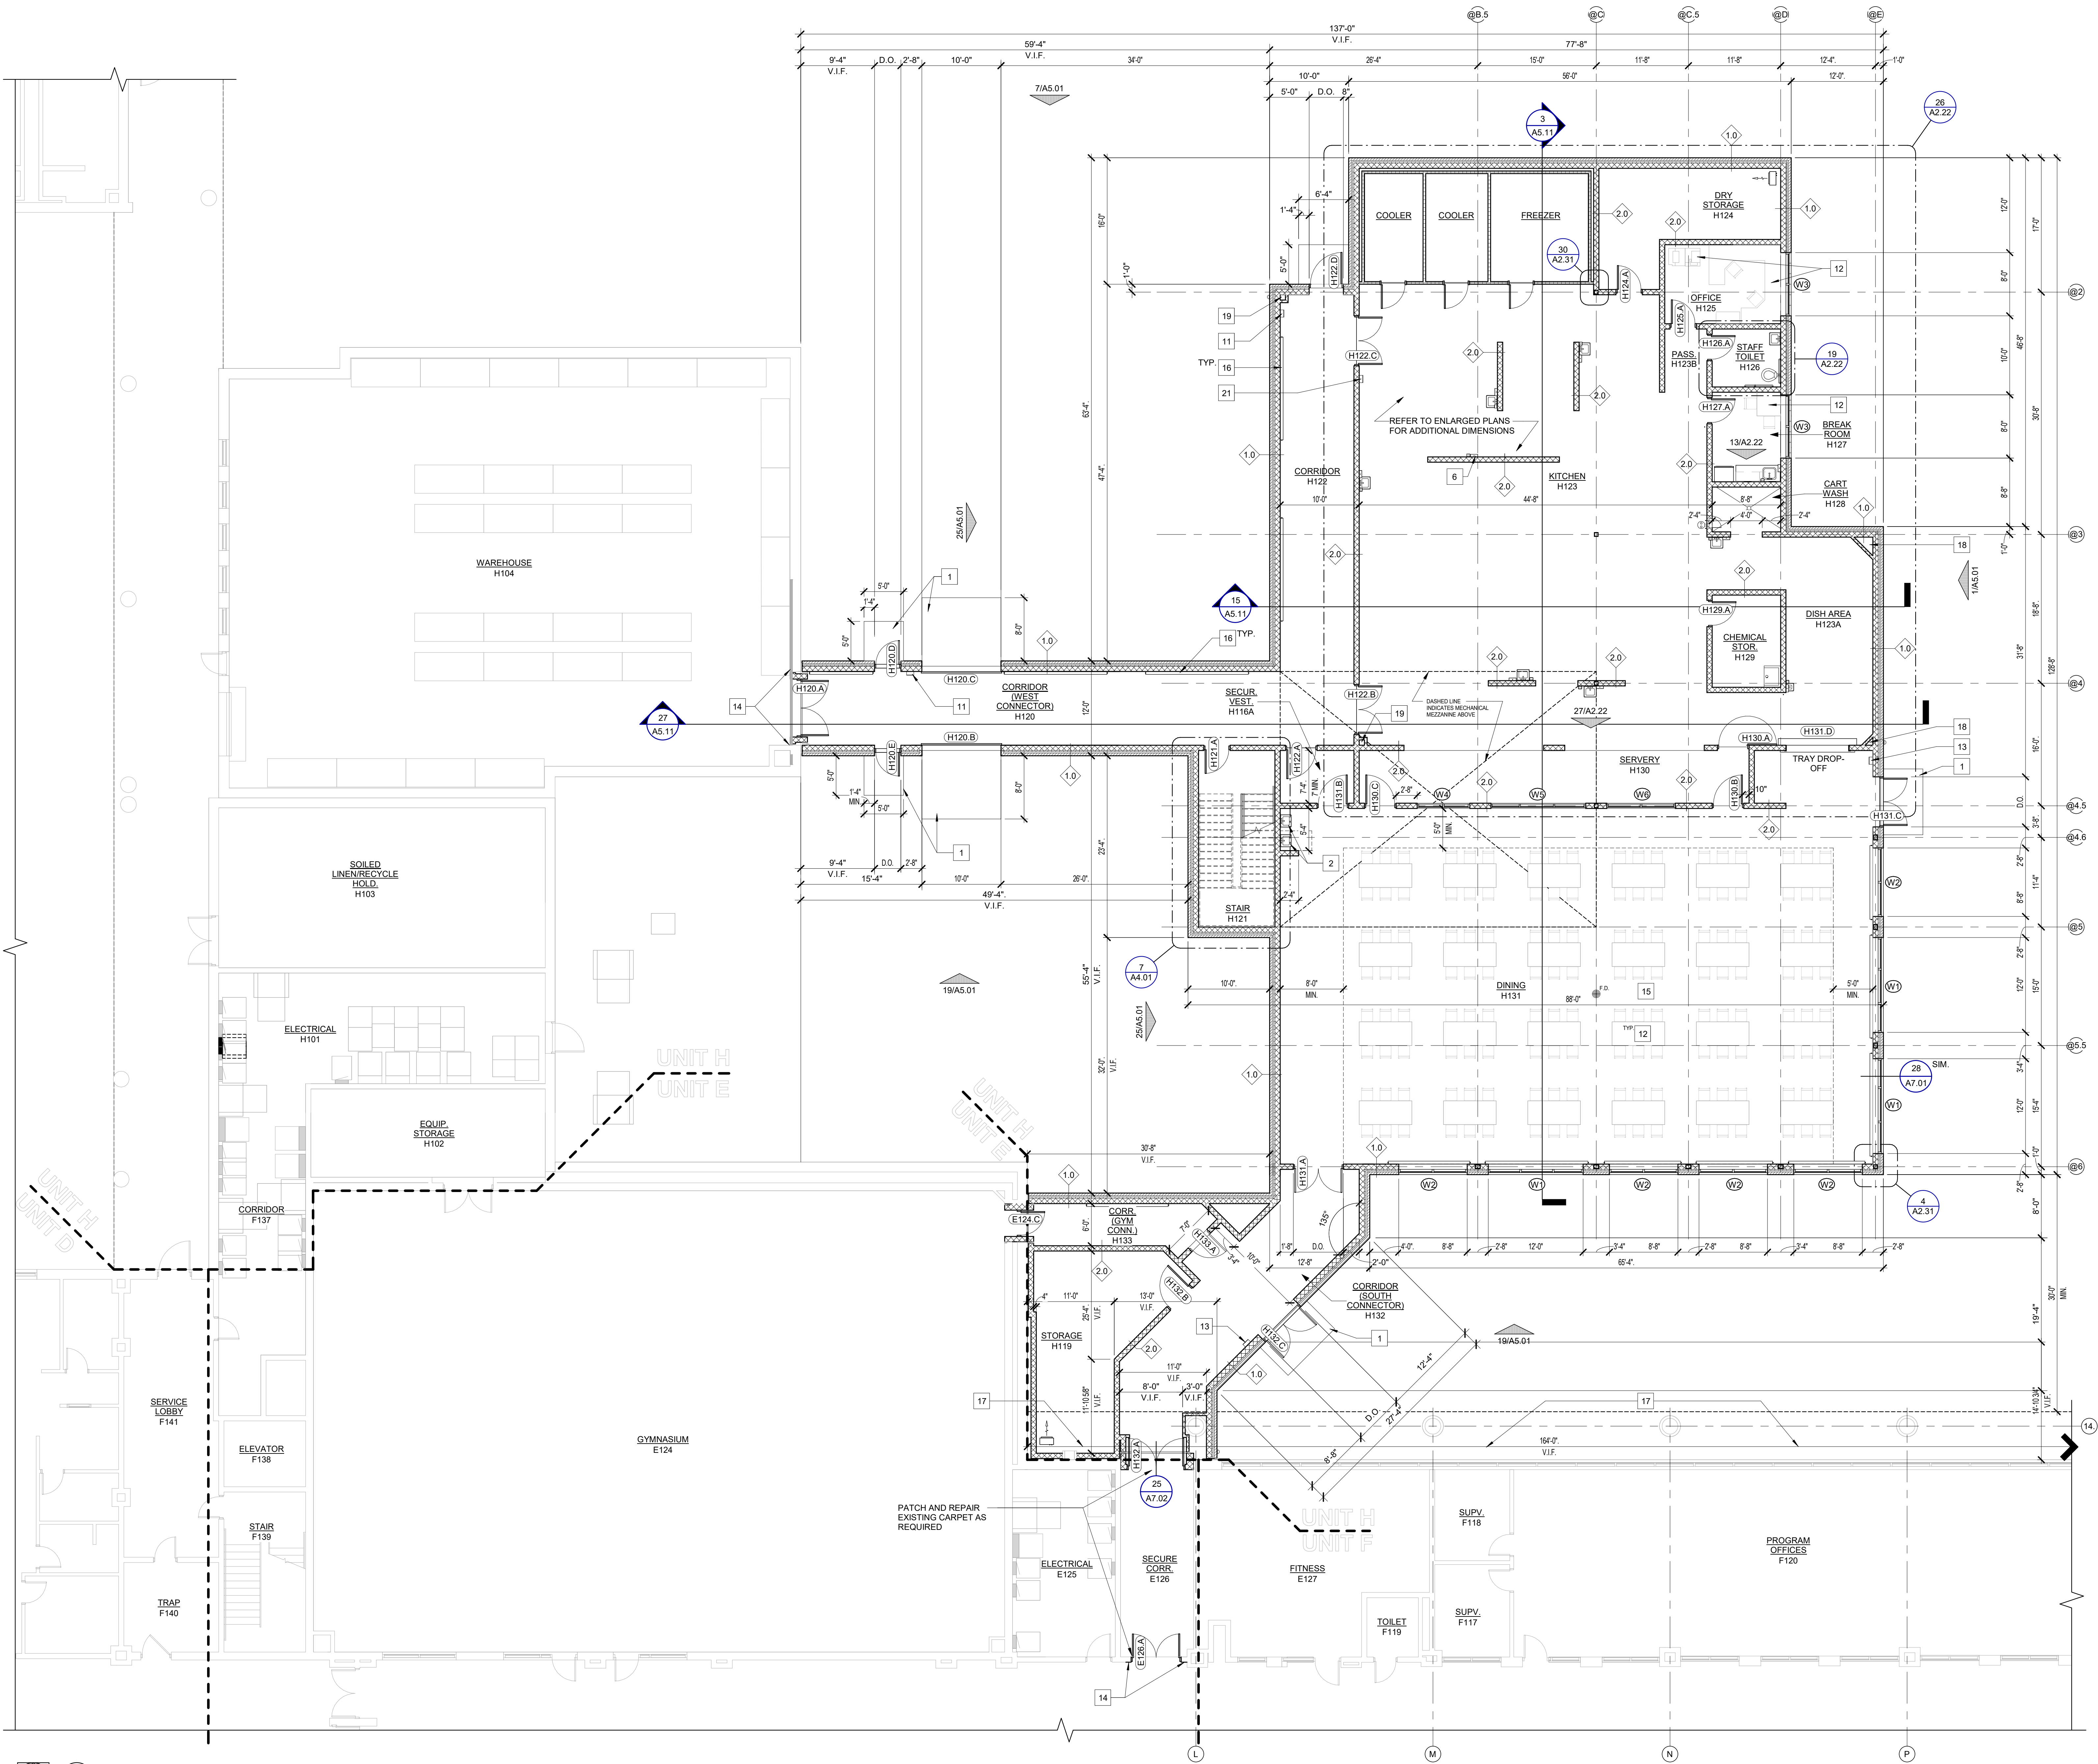


FIRST FLOOR CONSTRUCTION PLAN
SCALE: 1/8" = 1'-0"




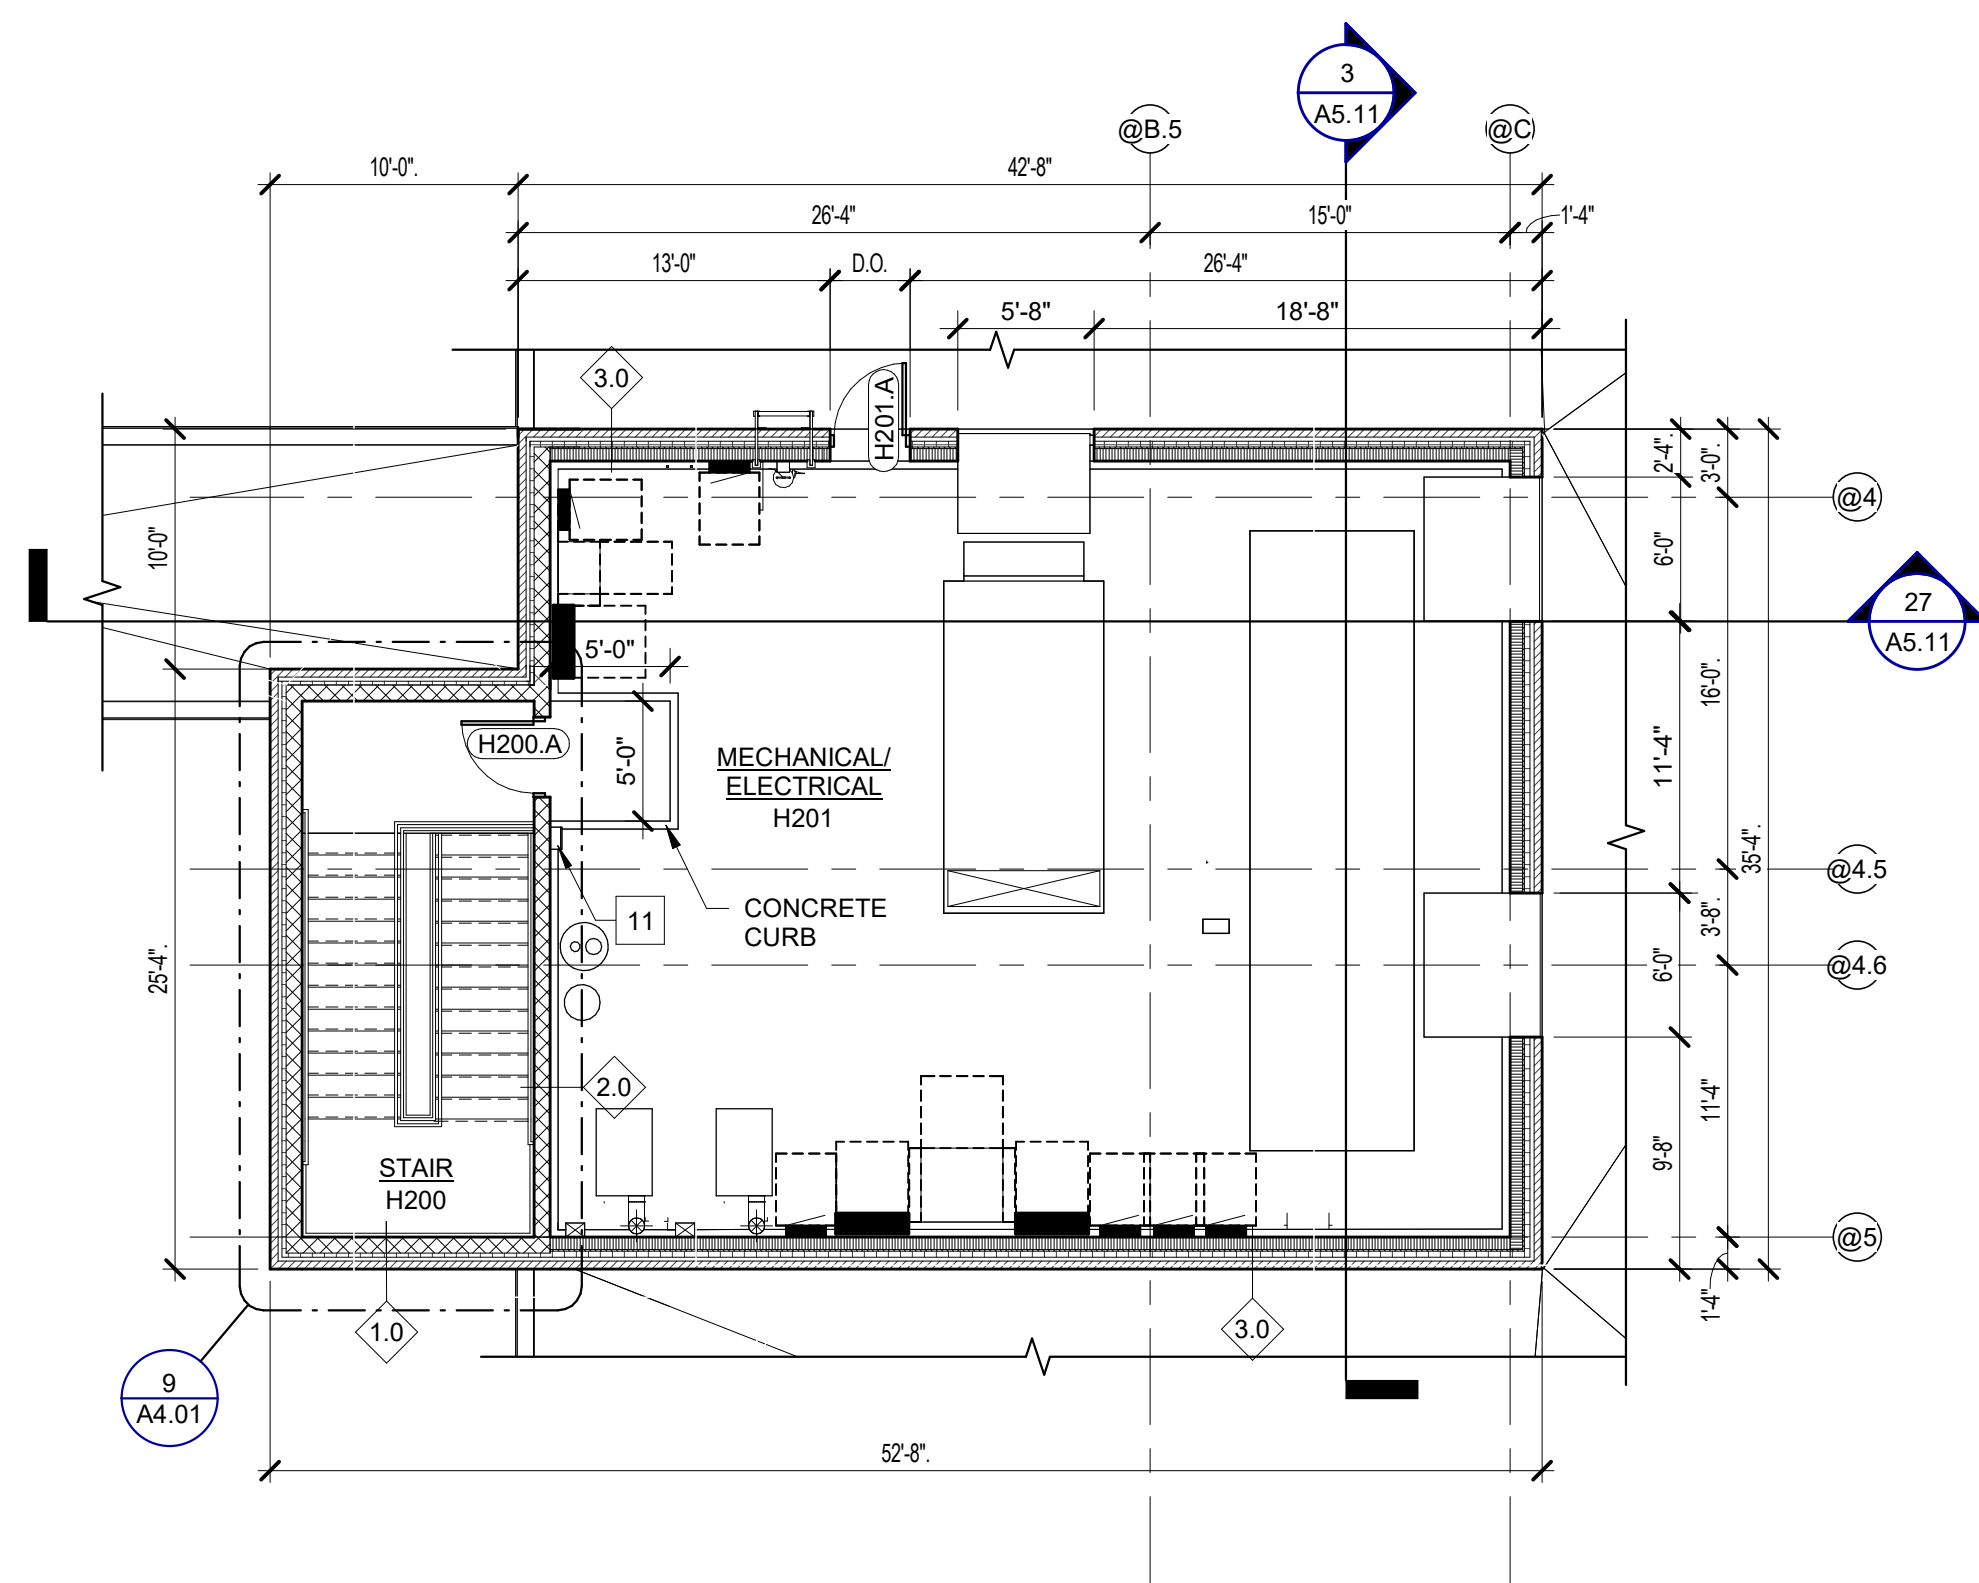


7 SECOND FLOOR CONSTRUCTION PLAN
SCALE: 1/8" = 1'-0"

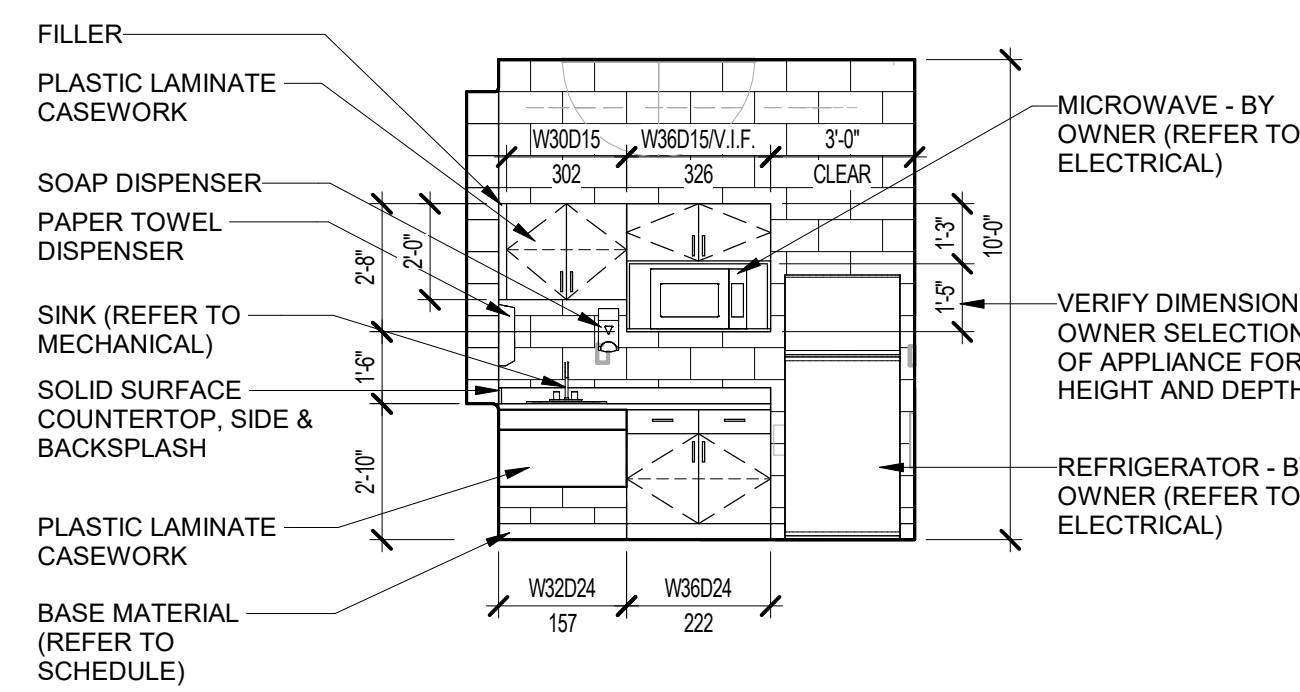


13/A2.22 BREAK ROOM ELEVATION
SCALE: 1/4" = 1'-0"

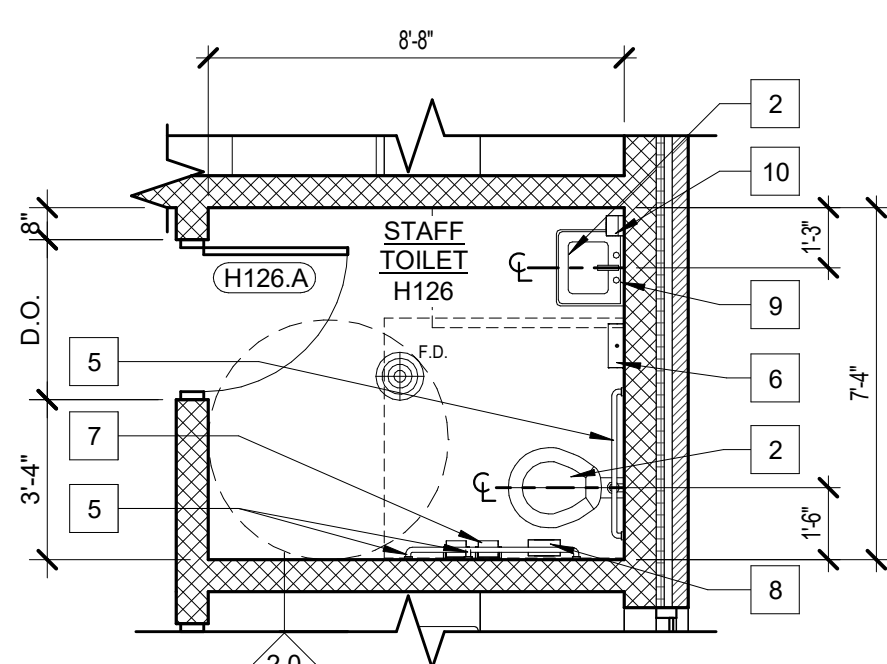

19/A2.22 ENLARGED FLOOR PLAN
SCALE: 1/4" = 1'-0"

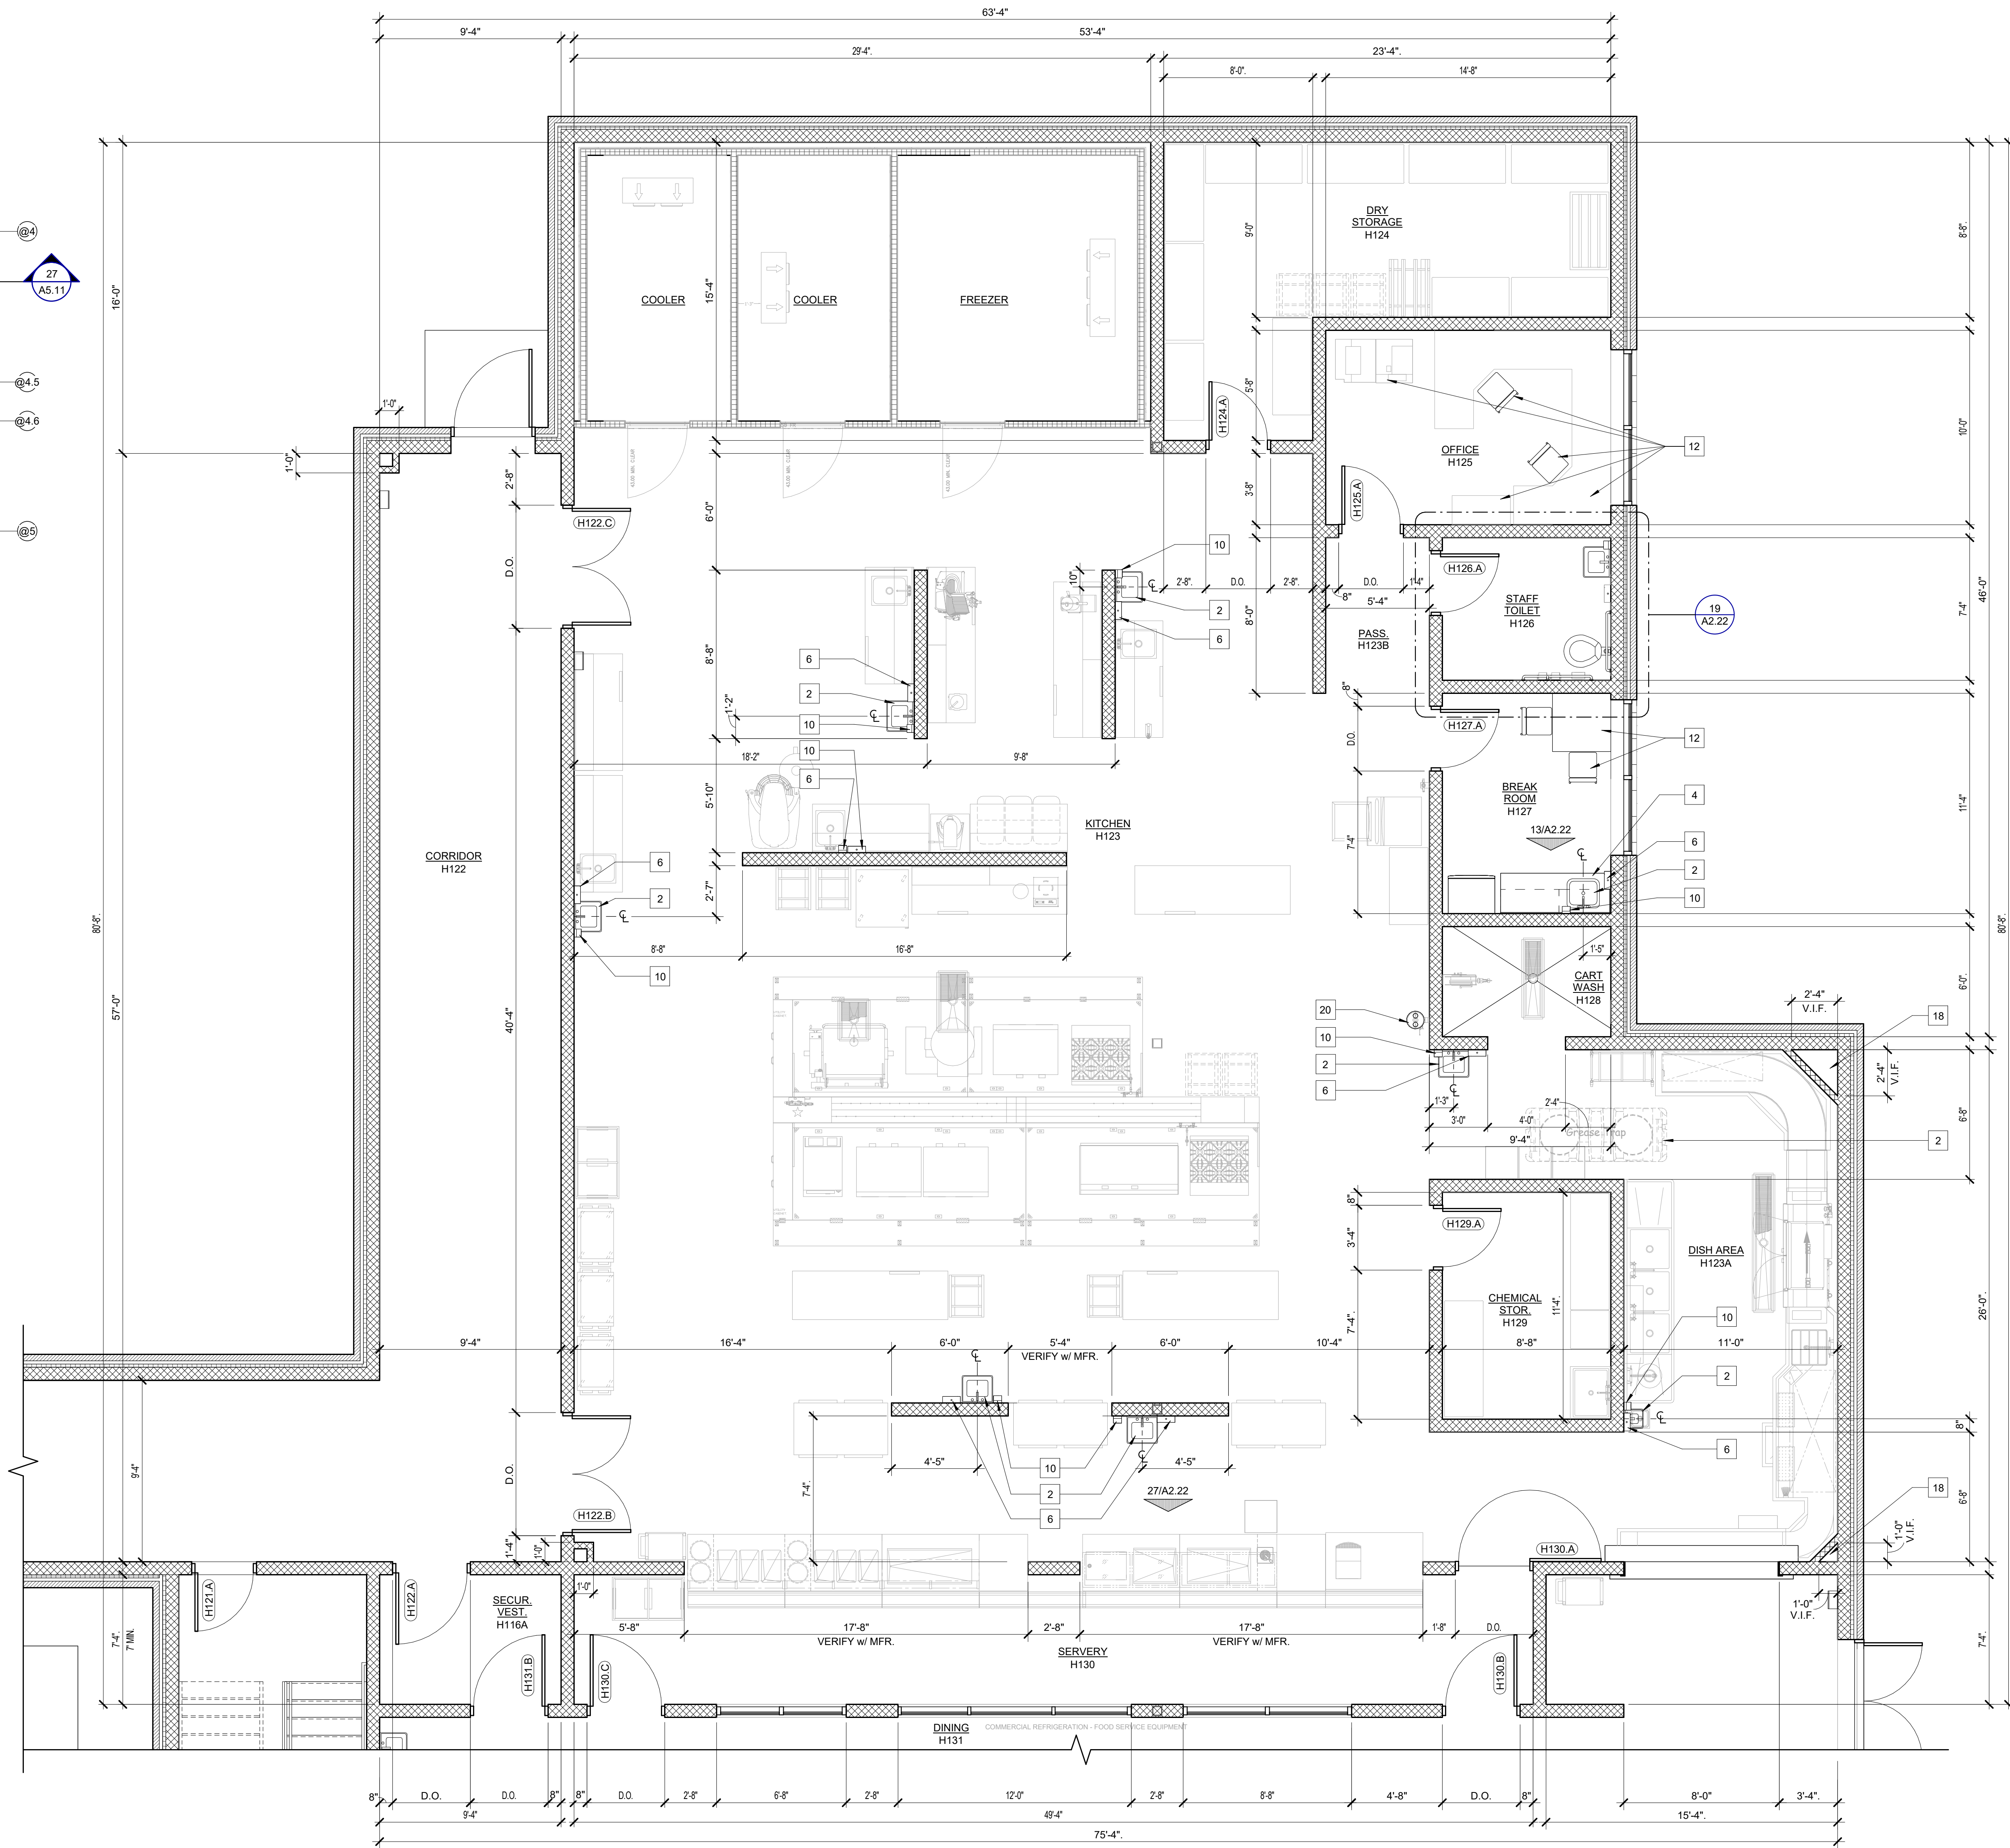

26/A2.22 ENLARGED KITCHEN FLOOR PLAN
SCALE: 1/4" = 1'-0"

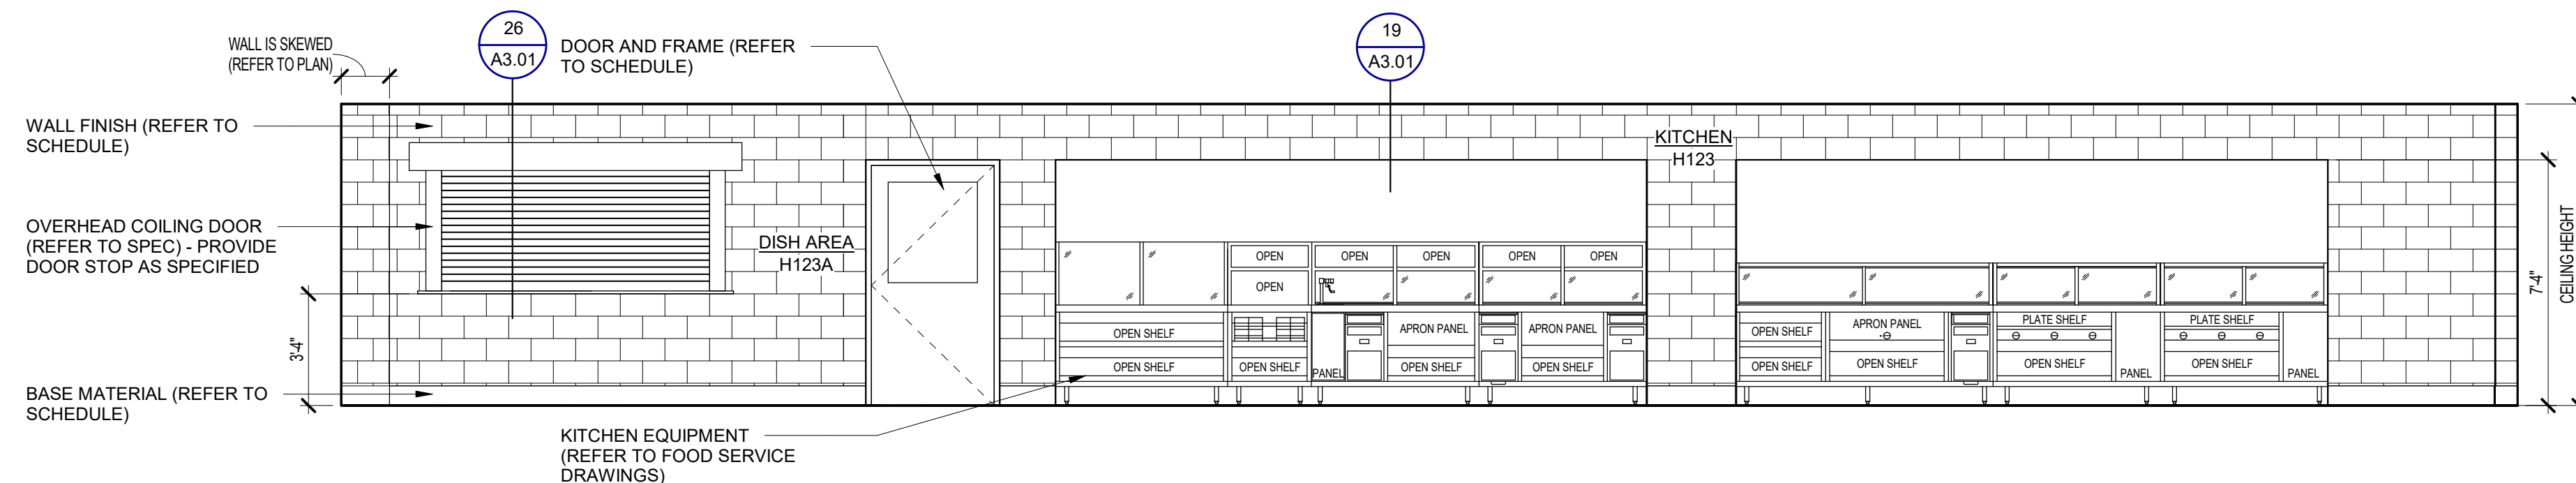

27/A2.22 SERVERY ELEVATION
SCALE: 1/4" = 1'-0"

CONSTRUCTION GENERAL NOTES:

- WALL TYPES ARE INDICATED AS A DIAMOND WITH A NUMBER. REFER TO SHEET A0.01 FOR DESCRIPTION OF WALL TYPES.
- PLAN DIMENSIONS DO NOT INCLUDE WALL THICKNESS (REFER TO WALL TYPES).
- DOOR FRAMES ARE TO BE LOCATED 8" FROM THE PERPENDICULAR WALL ON THE HINGE SIDE OF THE DOOR AT MASONRY WALLS, UNLESS NOTED OTHERWISE.
- PROVIDE BLOCKING AT ALL WALL MOUNTED ITEMS INCLUDING BUT NOT LIMITED TO: PLUMBING ACCESSORIES, KITCHEN EQUIPMENT, ETC.
- ALL AREAS DAMAGED BY DEMOLITION WORK ARE TO BE PATCHED AND REPAIRED OR REPLACED TO MATCH ADJACENT SURFACES.
- PATCH AND REPAIR REMAINING WALLS, AT ARCHITECTURAL, MECHANICAL, AND ELECTRICAL DEMOLITION POINTS WITH SIMILAR MATERIALS IN SIZE, COLOR AND TEXTURE.
- PATCH AND REPAIR ALL EXISTING FLOORS AS REQUIRED WHERE EXISTING WALLS HAVE BEEN REMOVED.
- FURNITURE OR EQUIPMENT TO BE BUILT AND/OR INSTALLED BY CONTRACTOR IS SPECIFICALLY NOTED, DIMENSIONED OR DETAILED. ALL OTHER FURNITURE OR EQUIPMENT WILL BE PROVIDED AND INSTALLED BY OWNER.
- FOR CASEWORK DETAILS - REFER TO "NORTHERN AMERICA ARCHITECTURAL WOODWORK STANDARDS (A.W.S.)."
- CASEWORK DESIGNATION REFERS TO THE WIDTH (W) AND DEPTH (D) OF THE CABINET. REFER TO DIMENSIONS FOR HEIGHT. REFER TO "A.W.S." FOR CABINET NUMBER LOCATED BELOW DIMENSION LINE.

CONSTRUCTION KEYNOTES

- CONCRETE ENTRY SLAB (REFER TO STRUCTURAL)
- PLUMBING FIXTURE (REFER TO MECHANICAL)
- CASEWORK (REFER TO ELEVATIONS AND DETAILS)
- STAINLESS STEEL GRAB BARS
- PAPER TOWEL DISPENSER
- TOILET PAPER DISPENSER
- SANITARY NAPKIN RECEPTACLE
- MIRROR 18" x 36"
- SOAP DISPENSER
- RECESSED FIRE EXTINGUISHER CABINET
- FURNITURE AND EQUIPMENT (BY OWNER)
- SEMI-RECESSED DETENTION FIRE EXTINGUISHER CABINET
- PATCH AND REPAIR WALL CONSTRUCTION, WALL BASE, AND FLOORING TO MATCH EXISTING.
- COORDINATE LOCATION OF FLOOR TILE MOVEMENT JOINTS WITH ARCHITECT, TYPICAL OF TONA EJ-171
- FIN TUBE RADIATOR (REFER TO MECHANICAL)
- PROVIDE NEW WATER COLD FLUID-APPLIED WATERPROOFING ALONG THE EXENT OF THE EXISTING FOUNDATION WALL - REFER TO CIVIL FOR COORDINATION OF NEW SIDEWALK, NEW ENTRY SLAB, AND FENCE MODIFICATIONS - USE CAUTION AS UNDERGROUND LINES ARE LOCATED IN THIS AREA.
- MECHANICAL CHASE VERIFY SIZE WITH KITCHEN EQUIPMENT MFR. AND MECHANICAL (REFER TO MECHANICAL)
- MECHANICAL CHASE VERIFY CLEAR WIDTH REQUIRED WITH MECHANICAL (REFER TO MECHANICAL)
- EYE WASH STATION (REFER TO FOOD SERVICE AND MECHANICAL)
- SEMI-RECESSED WET CHEMICAL FIRE EXTINGUISHER CABINET


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACEL, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

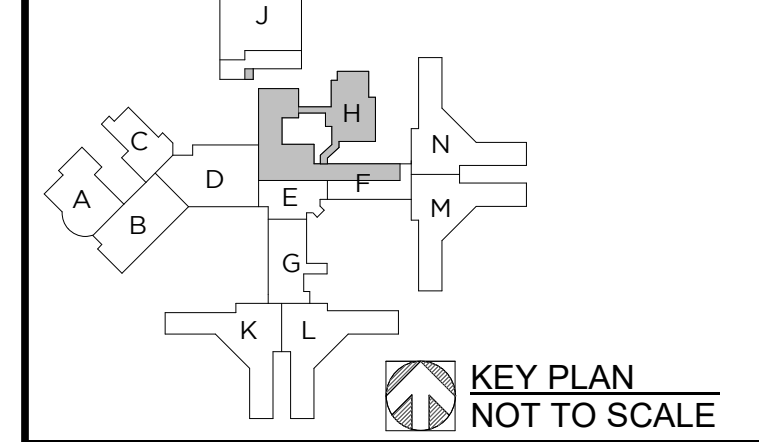

WTAARCH.COM
WTA ARCHITECTS





100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023


PROJECT TITLE
491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN**
SALINE, MICHIGAN

SHEET TITLE
**SECOND FLOOR CONST.
PLN, ENLARGED PLN, &
INTERIOR ELEVATION**


PROJECT NUMBER 2021094	SHEET NUMBER
PROJECT DATE SEPTEMBER 6, 2023	A2.22
CHECKED BY C.D.S.	

FLOORING LEGEND

-  CERAMIC TILE
-  SEALED CONCRETE
-  RESILIENT SHEET FLOORING
-  RESILIENT TILE FLOORING

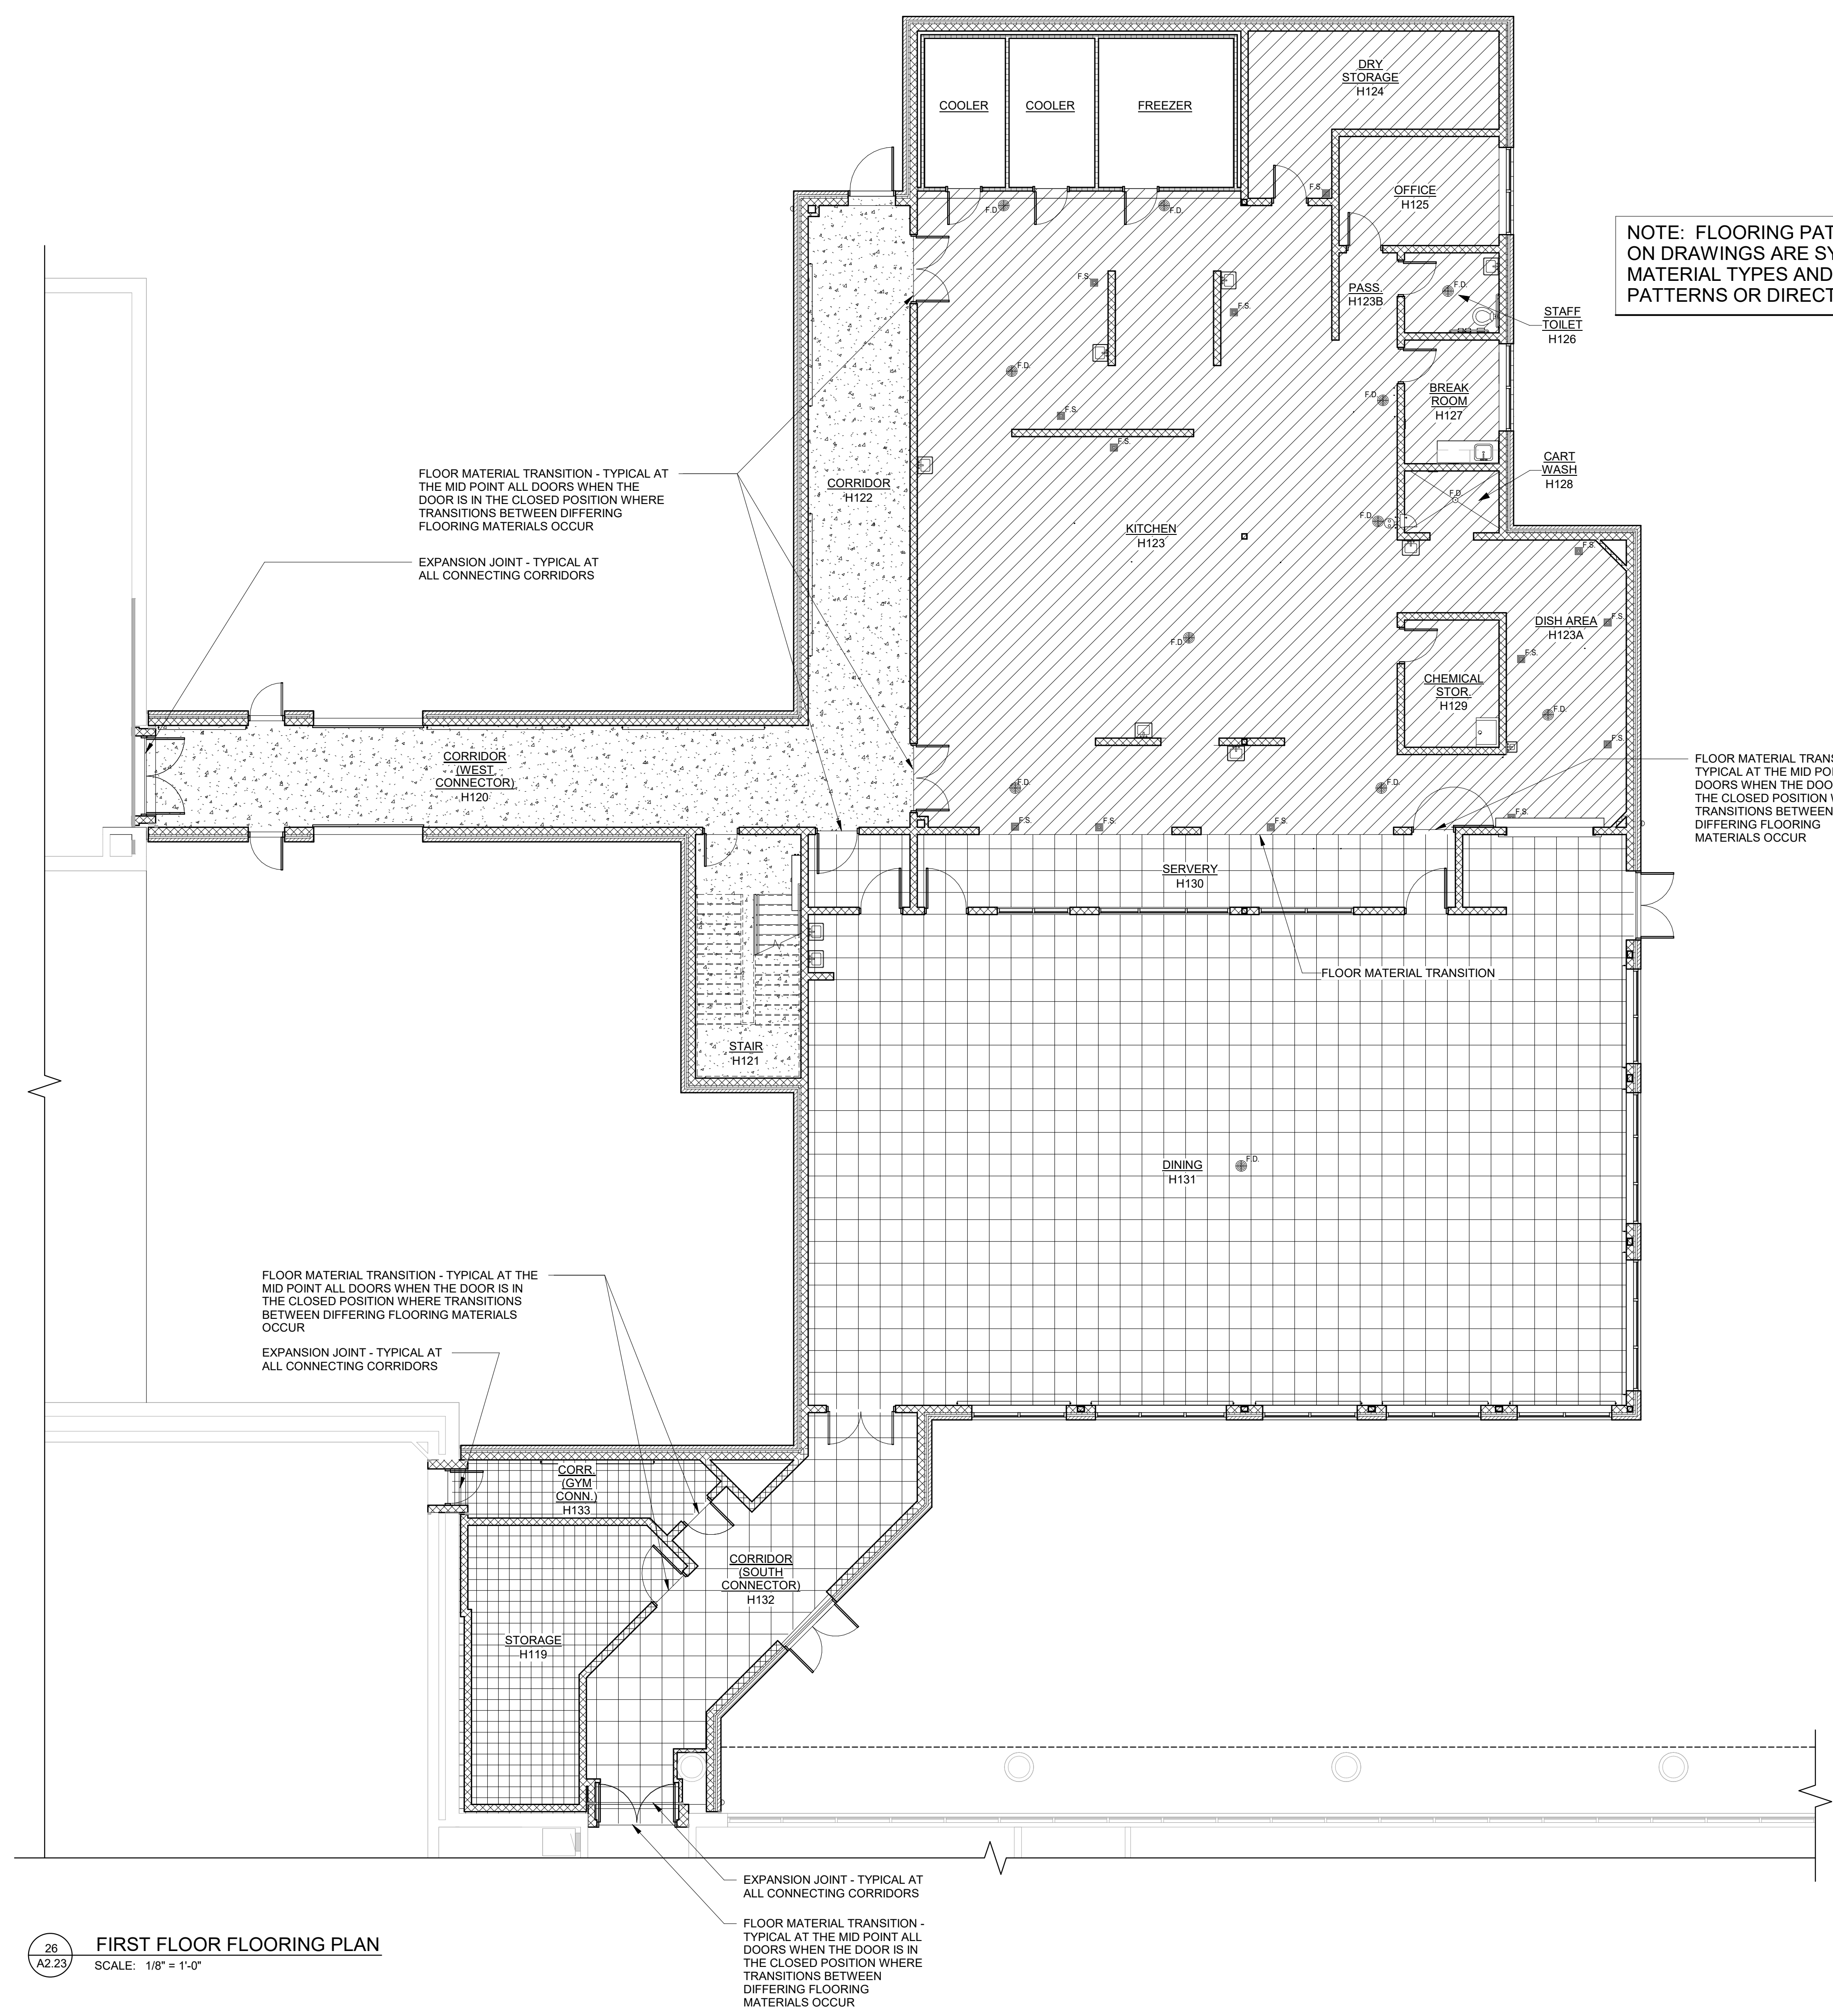

NOTE: FLOORING PATTERNS INDICATED ON DRAWINGS ARE SYMBOLIC OF MATERIAL TYPES AND NOT INSTALLATION PATTERNS OR DIRECTIONS.

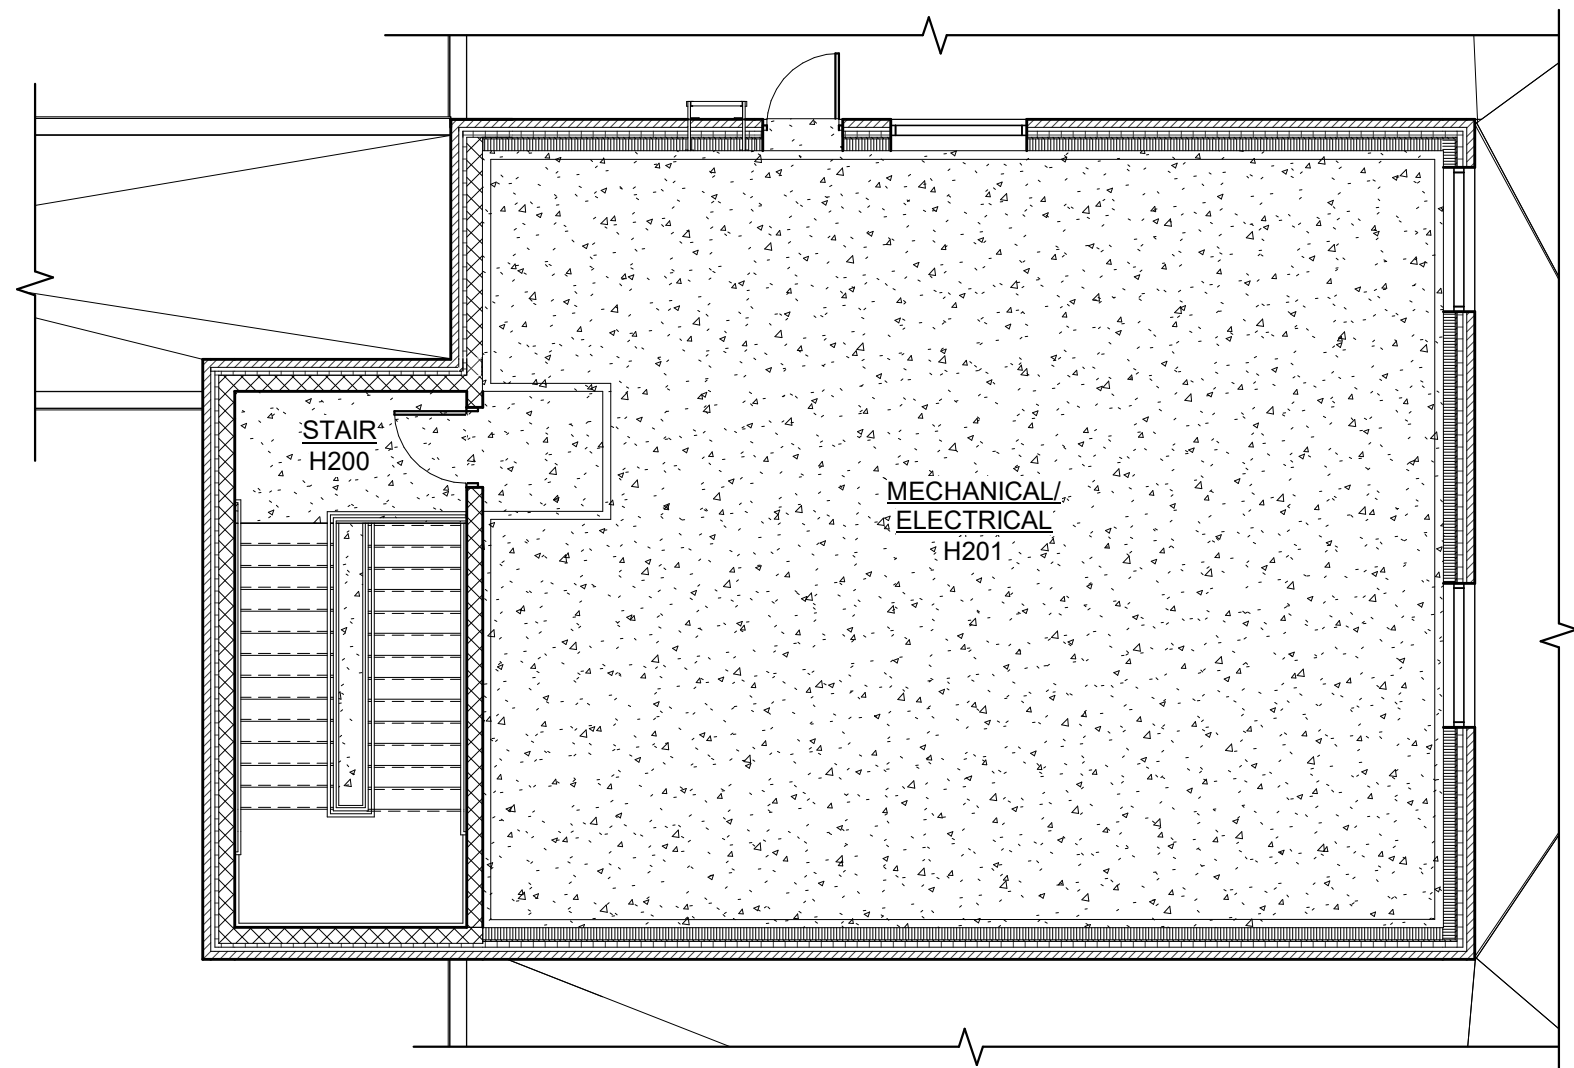

17 SECOND FLOOR FLOORING PLAN
SCALE: 1/8" = 1'-0"

26 FIRST FLOOR FLOORING PLAN
SCALE: 1/8" = 1'-0"


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, R.A., DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

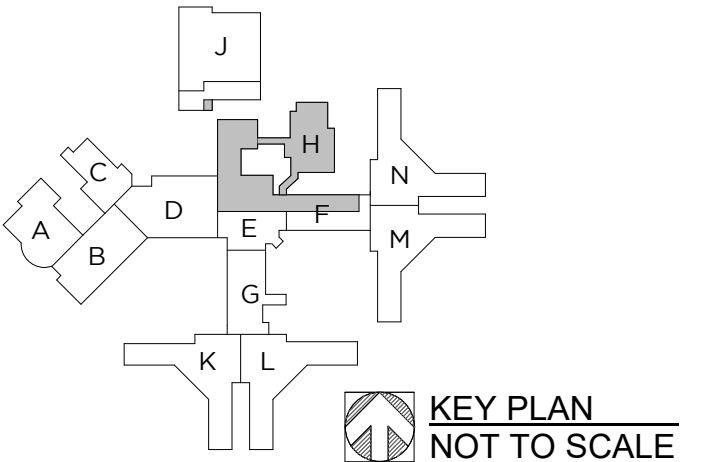


WTAARCH.COM

WTA ARCHITECTS
100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107 COPYRIGHT © 2023


PROJECT TITLE
491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN**
SALINE, MICHIGAN

SHEET TITLE
**FIRST & SECOND FLOOR
FLOORING PLANS**


PROJECT NUMBER 2021094	SHEET NUMBER A2.23
PROJECT DATE SEPTEMBER 6, 2023	
CHECKED BY C.D.S.	

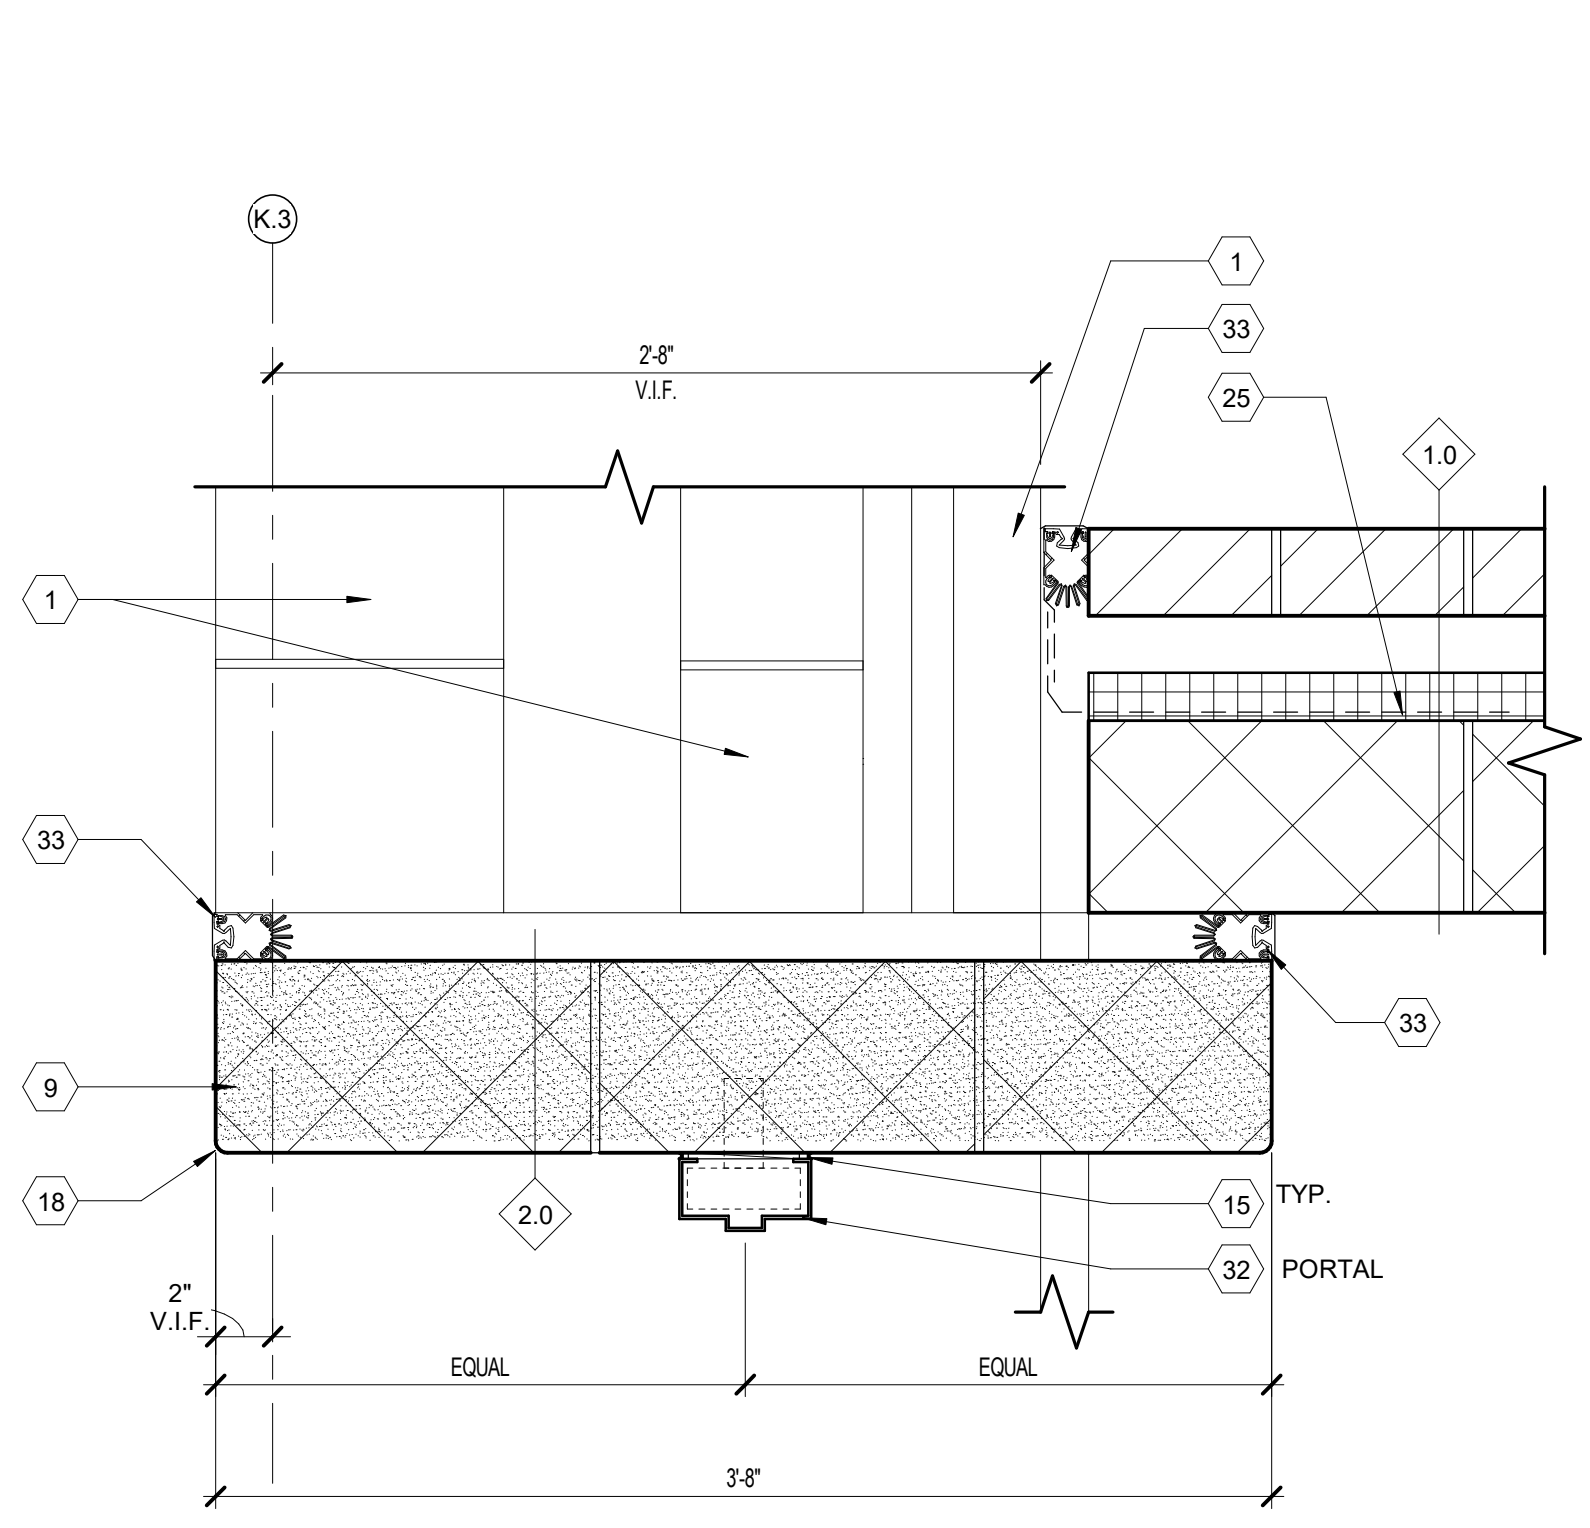


1 PORTAL FRAME @ WEST CONNECTOR
SCALE: 1 1/2" = 1'-0"

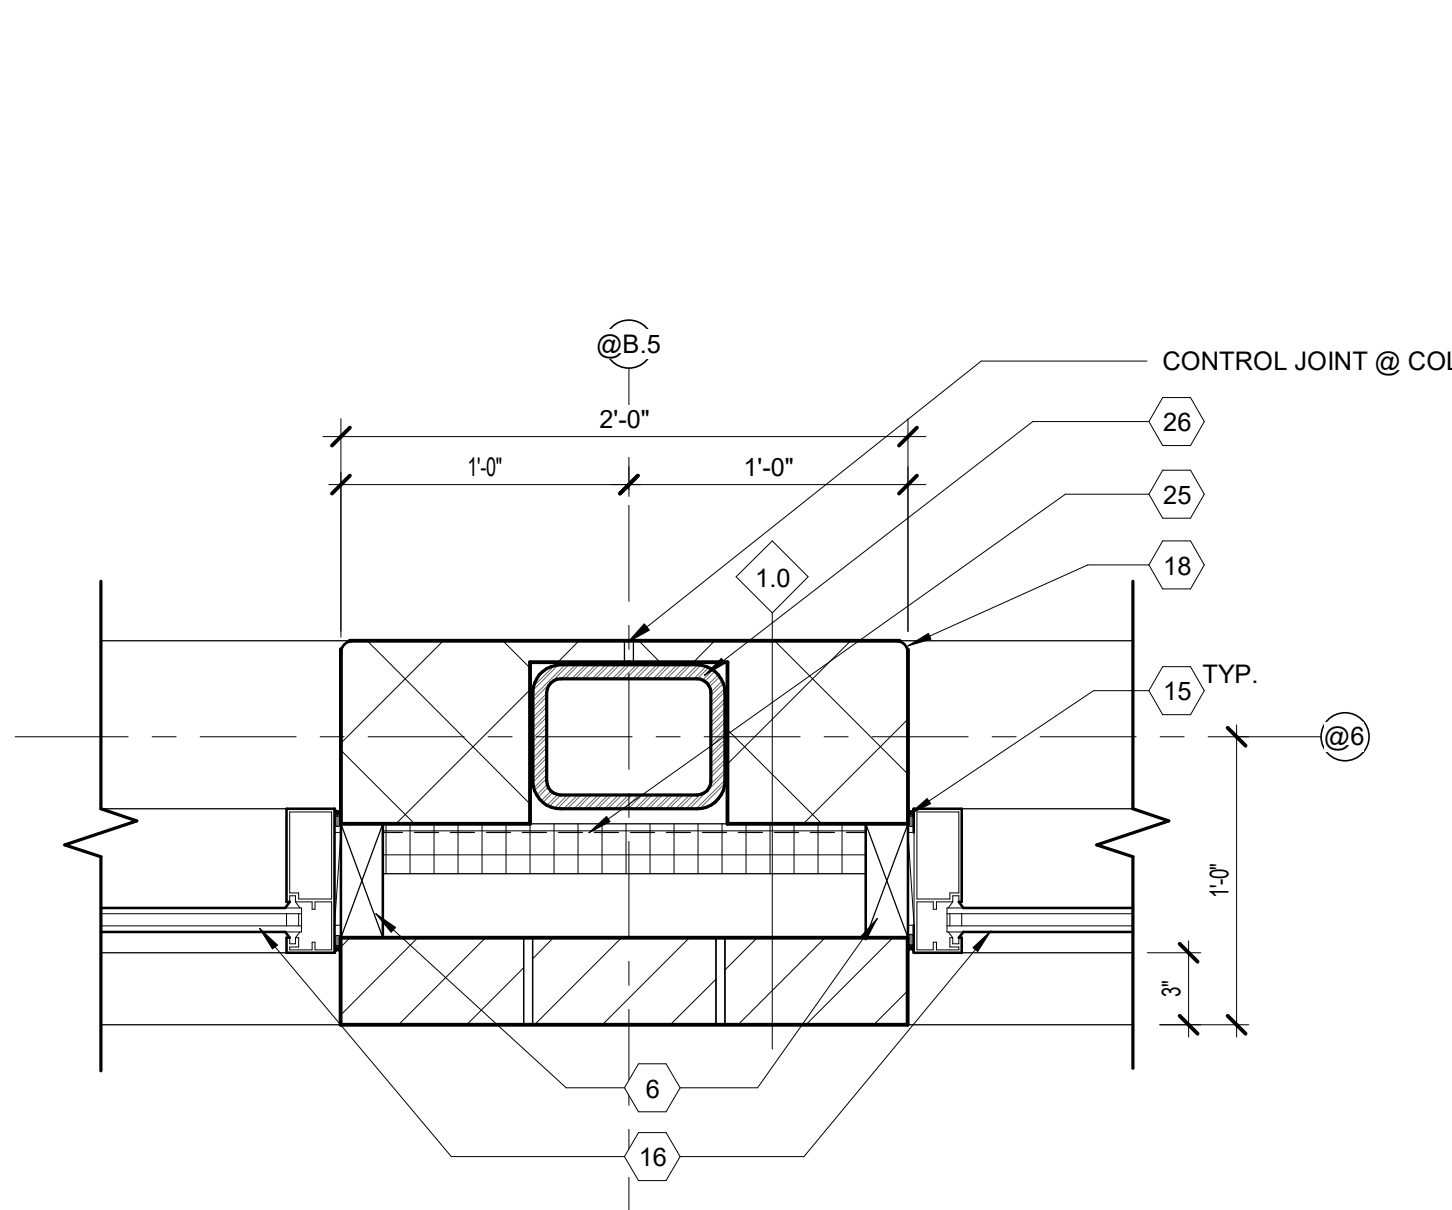


2 JAMB DETAIL @ DINING
SCALE: 1 1/2" = 1'-0"

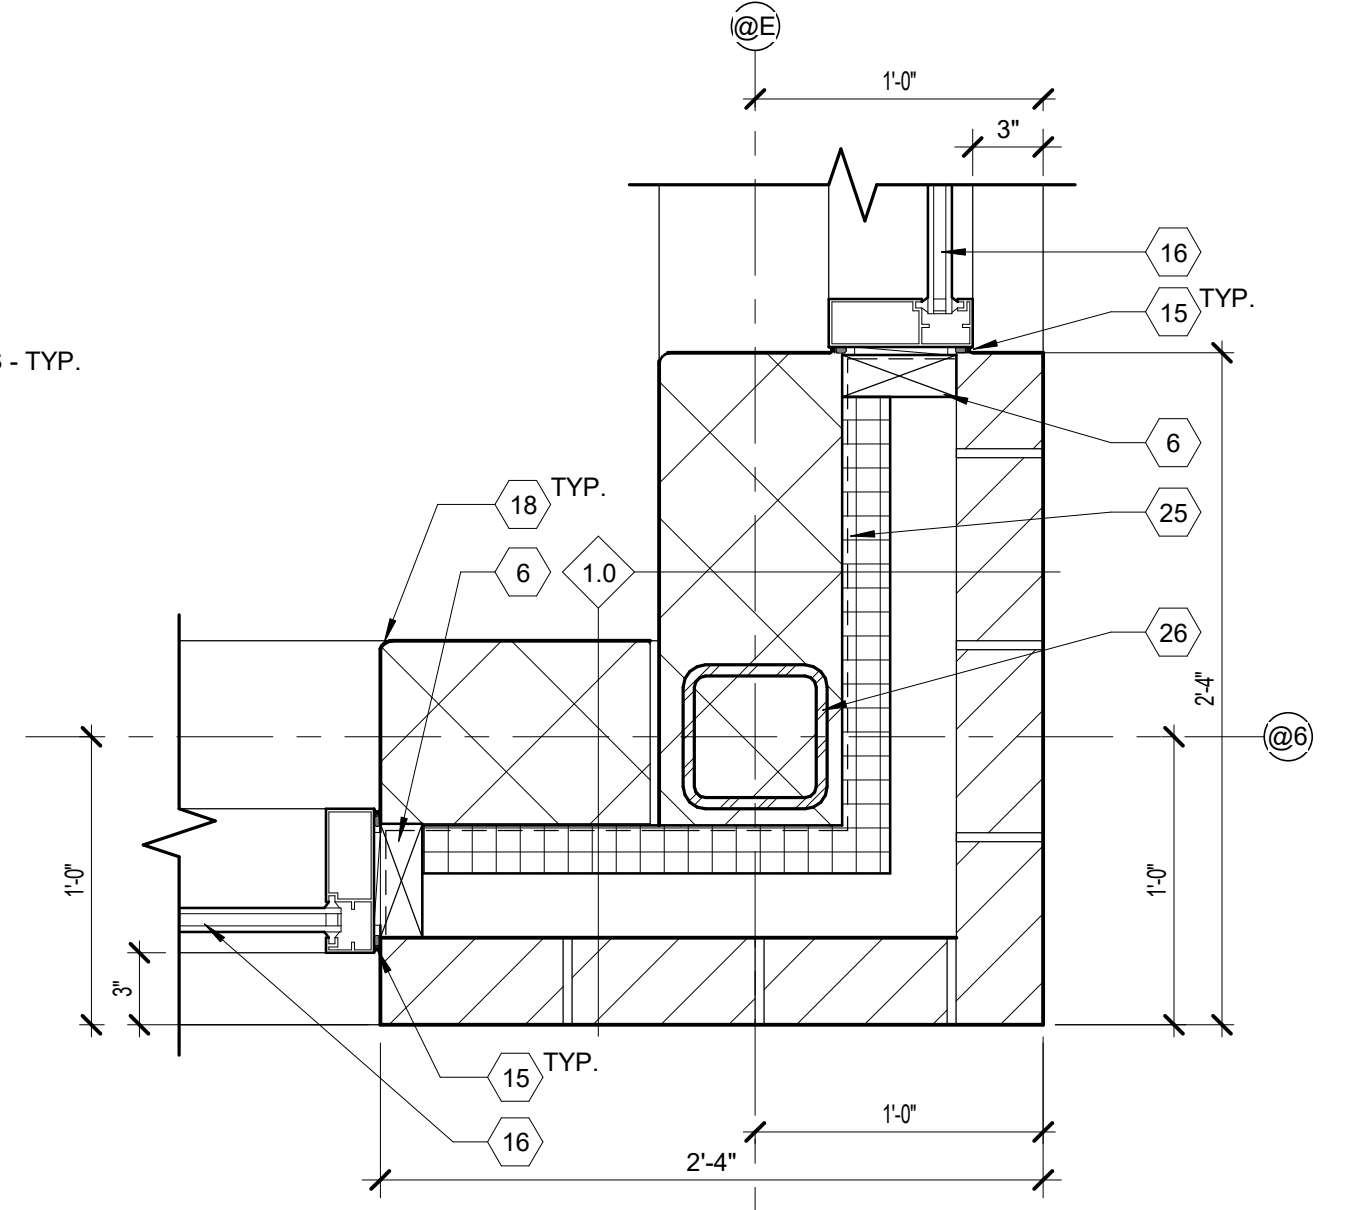


4 JAMB DETAIL @ DINING
SCALE: 1 1/2" = 1'-0"

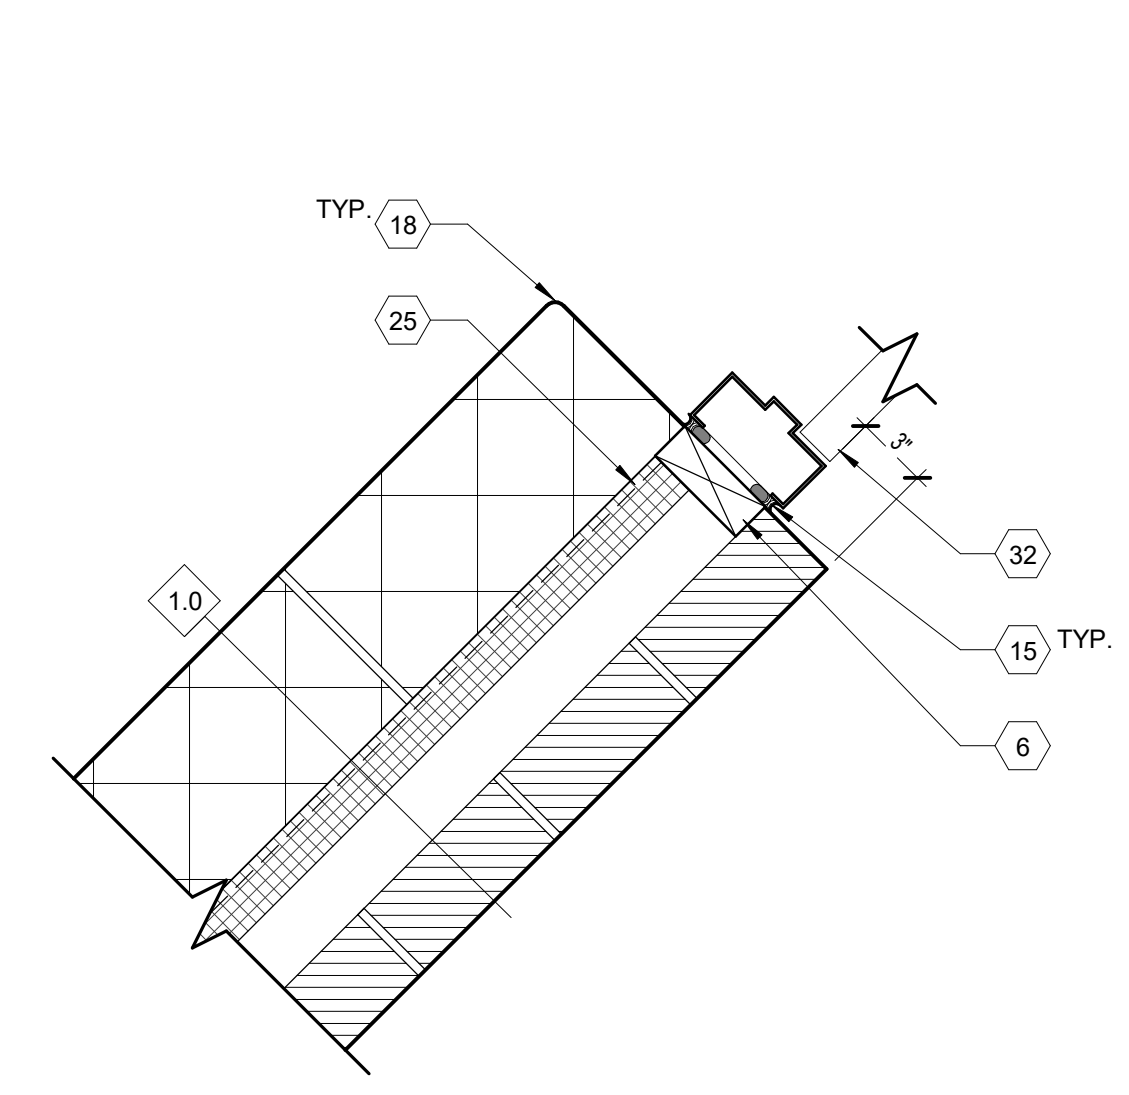


5 JAMB DETAIL @ CORRIDOR (SOUTH CONNECTOR)
SCALE: 1 1/2" = 1'-0"

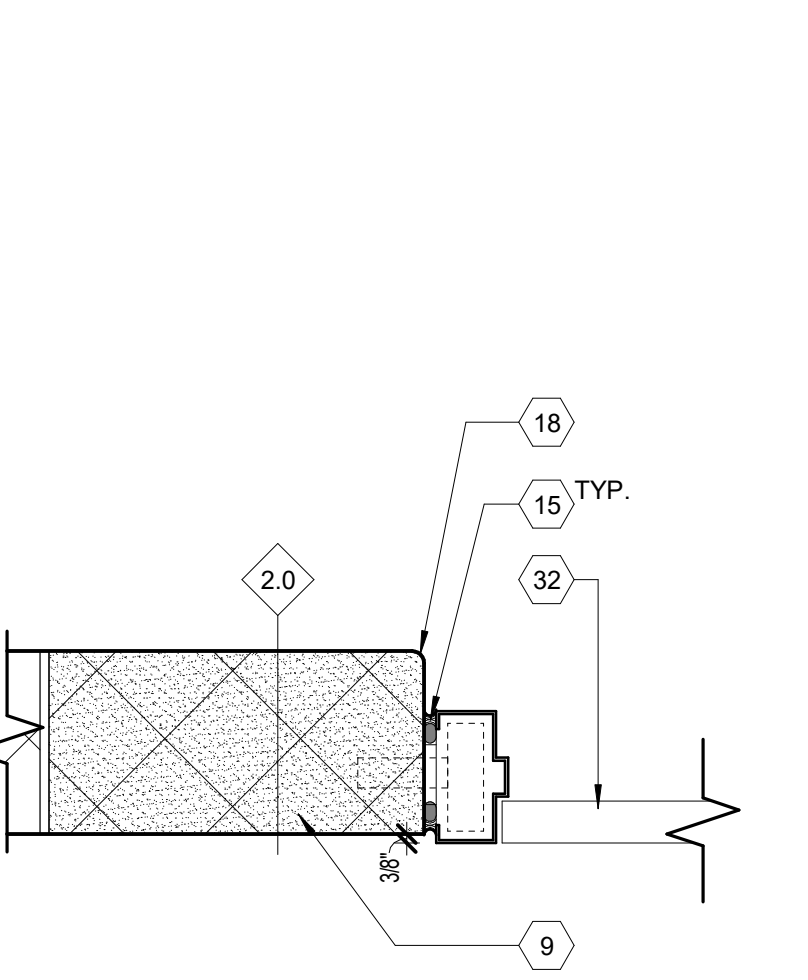


6 TYP. HM DR JAMB @ CMU
SCALE: 1 1/2" = 1'-0"

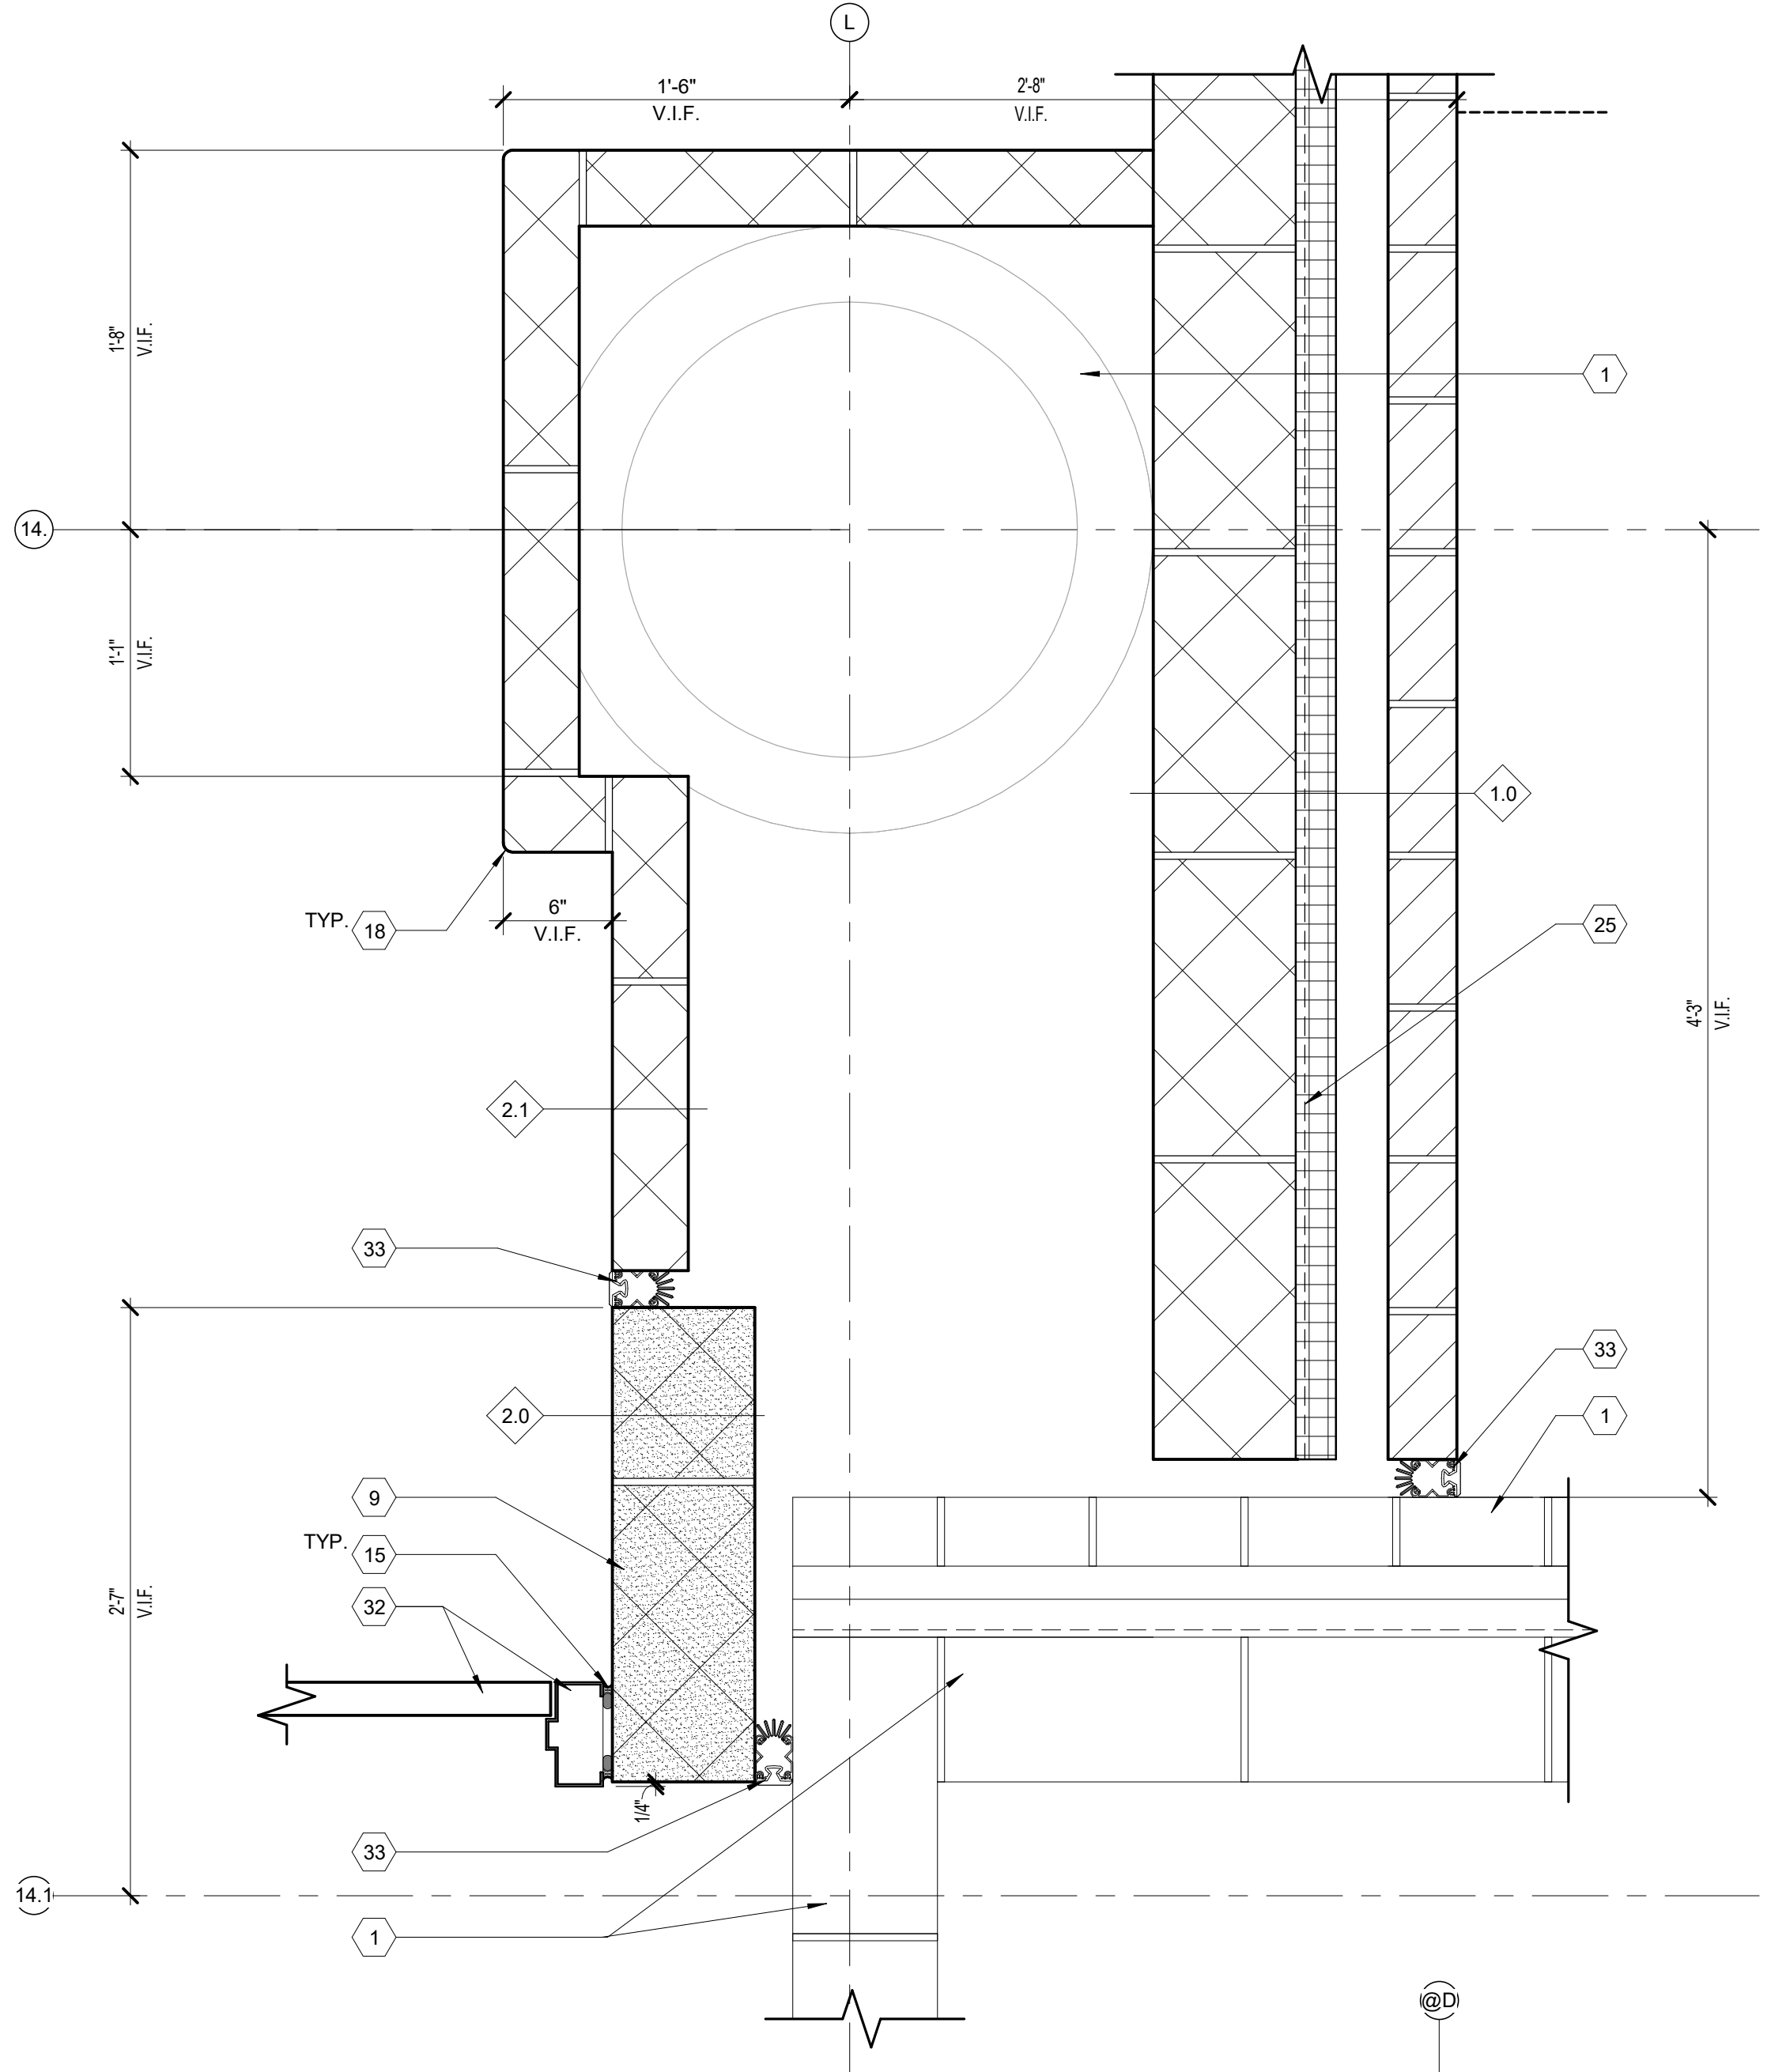


11 PORTAL FRAME @ GYM
SCALE: 1 1/2" = 1'-0"

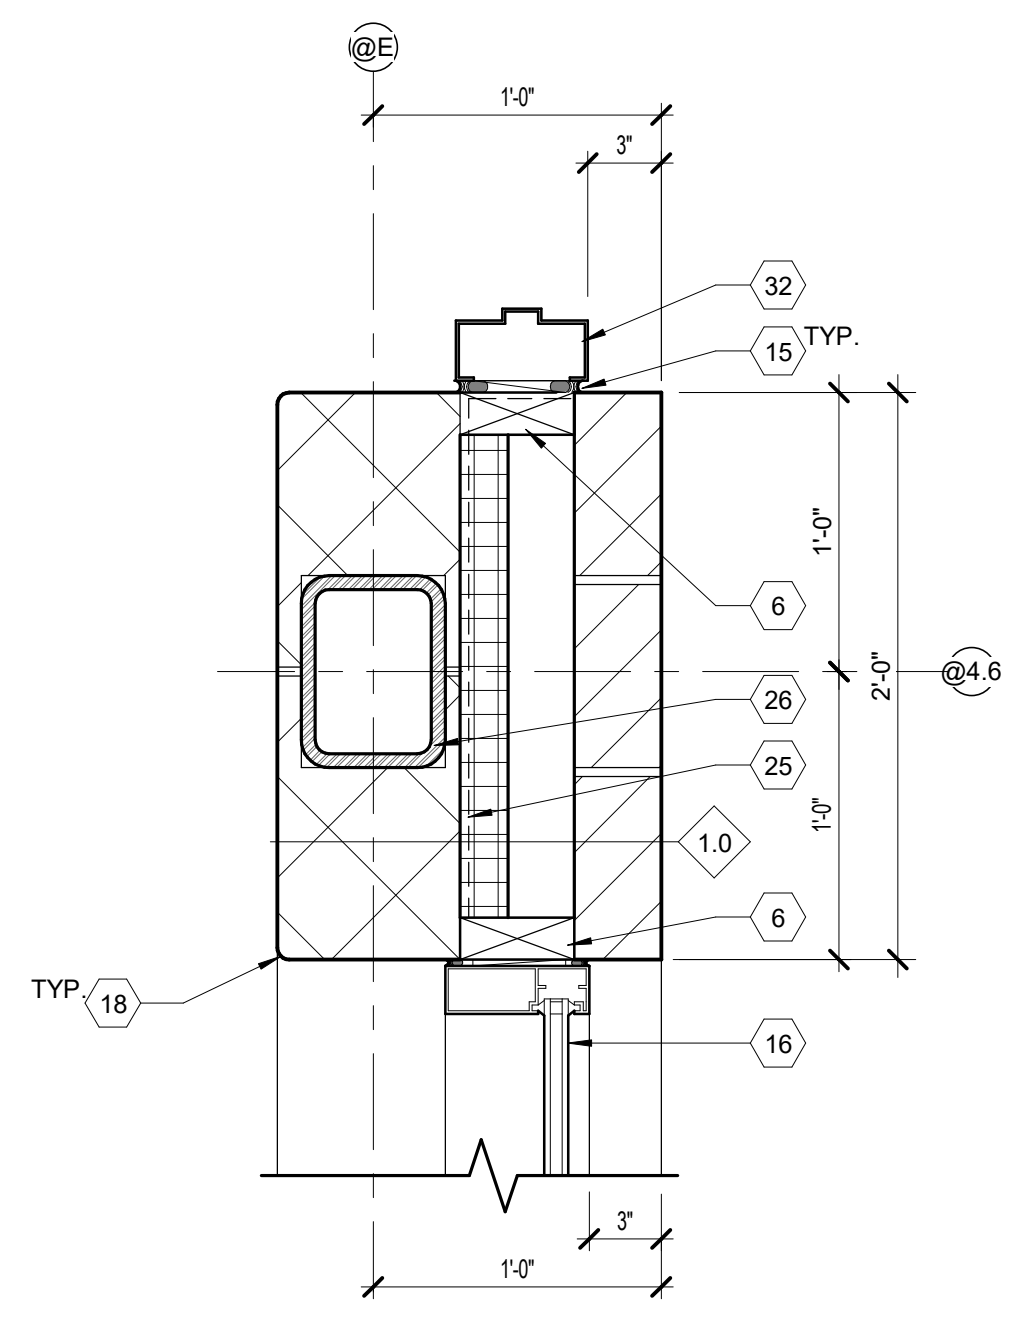


15 JAMB DETAIL @ DINING
SCALE: 1 1/2" = 1'-0"

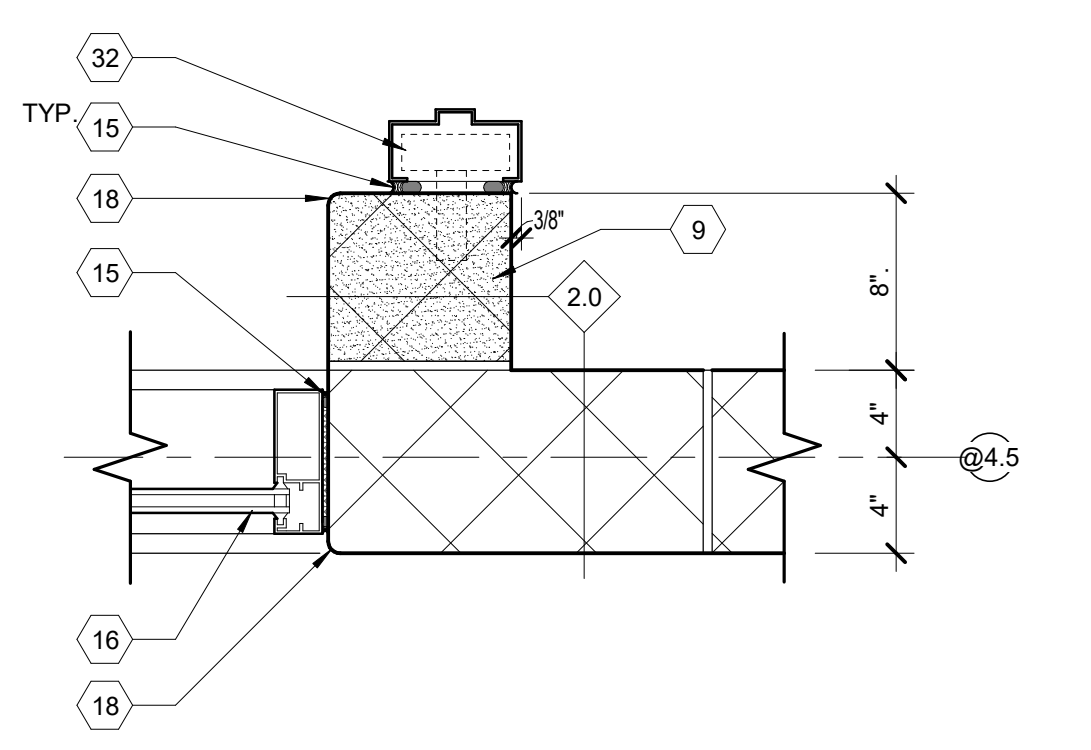

16 JAMB DETAIL @ SERVERY
SCALE: 1 1/2" = 1'-0"

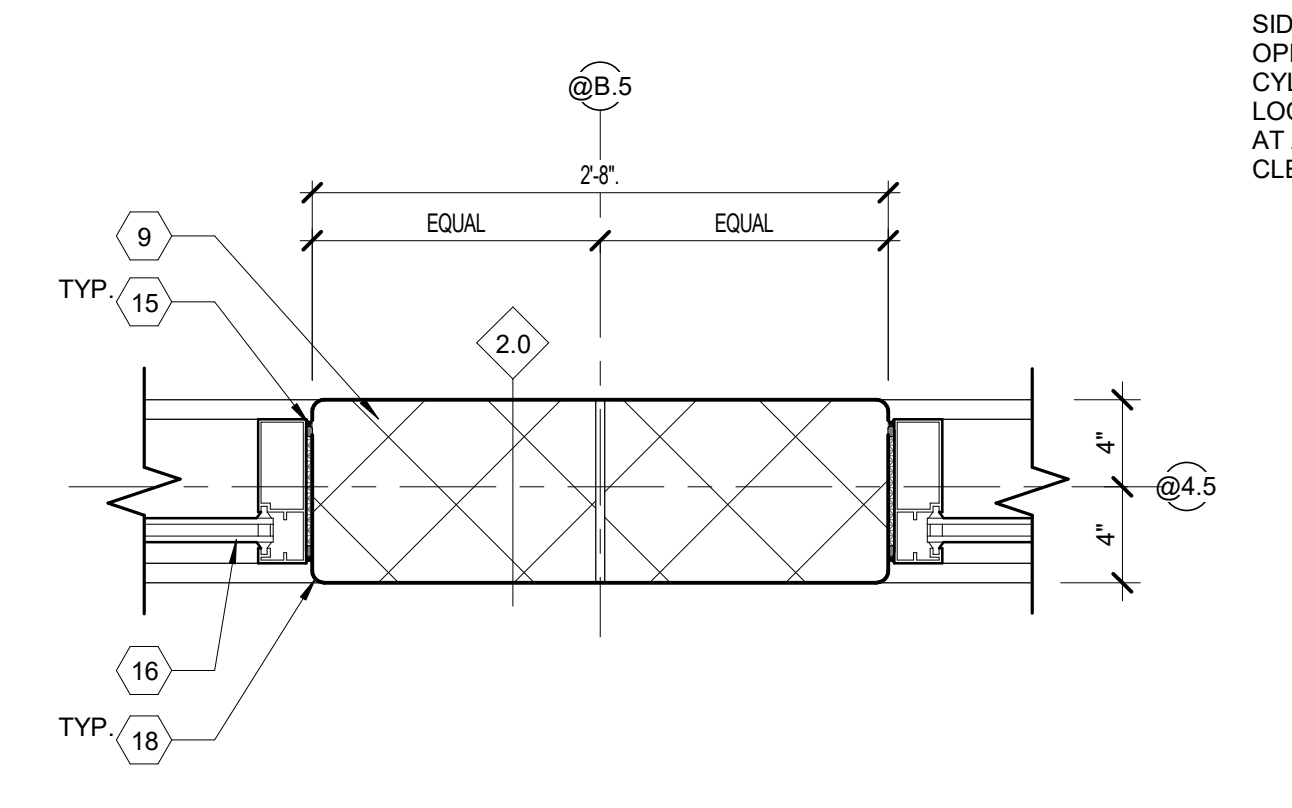


25 JAMB DETAIL @ SERVERY
SCALE: 1 1/2" = 1'-0"

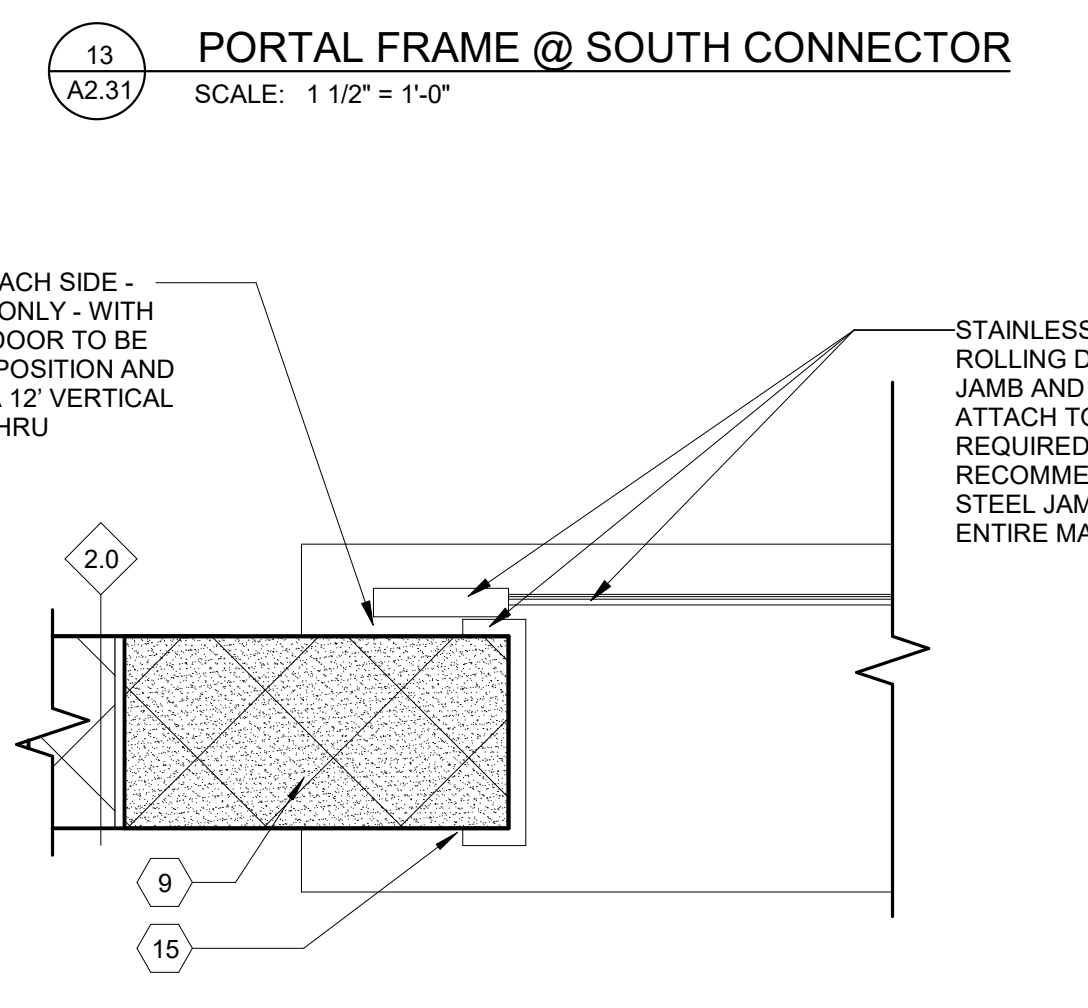


13 PORTAL FRAME @ SOUTH CONNECTOR
SCALE: 1 1/2" = 1'-0"

SIDE LOCKING BARS (1) EACH SIDE - OPERABLE FROM INSIDE ONLY - WITH CYLINDER - ALLOW FOR DOOR TO BE LOCKED IN THE CLOSED POSITION AND AT A HEIGHT TO ALLOW A 12" VERTICAL CLEARANCE FOR PASS THRU


STAINLESS STEEL OVERHEAD ROLLING DOOR w/ INTEGRAL JAMB AND COUNTER SILL - ATTACH TO MASONRY AS REQUIRED PER MANUFACTURERS RECOMMENDATION - STAINLESS STEEL JAMB AND HEAD TO WRAP ENTIRE MASONRY WALL

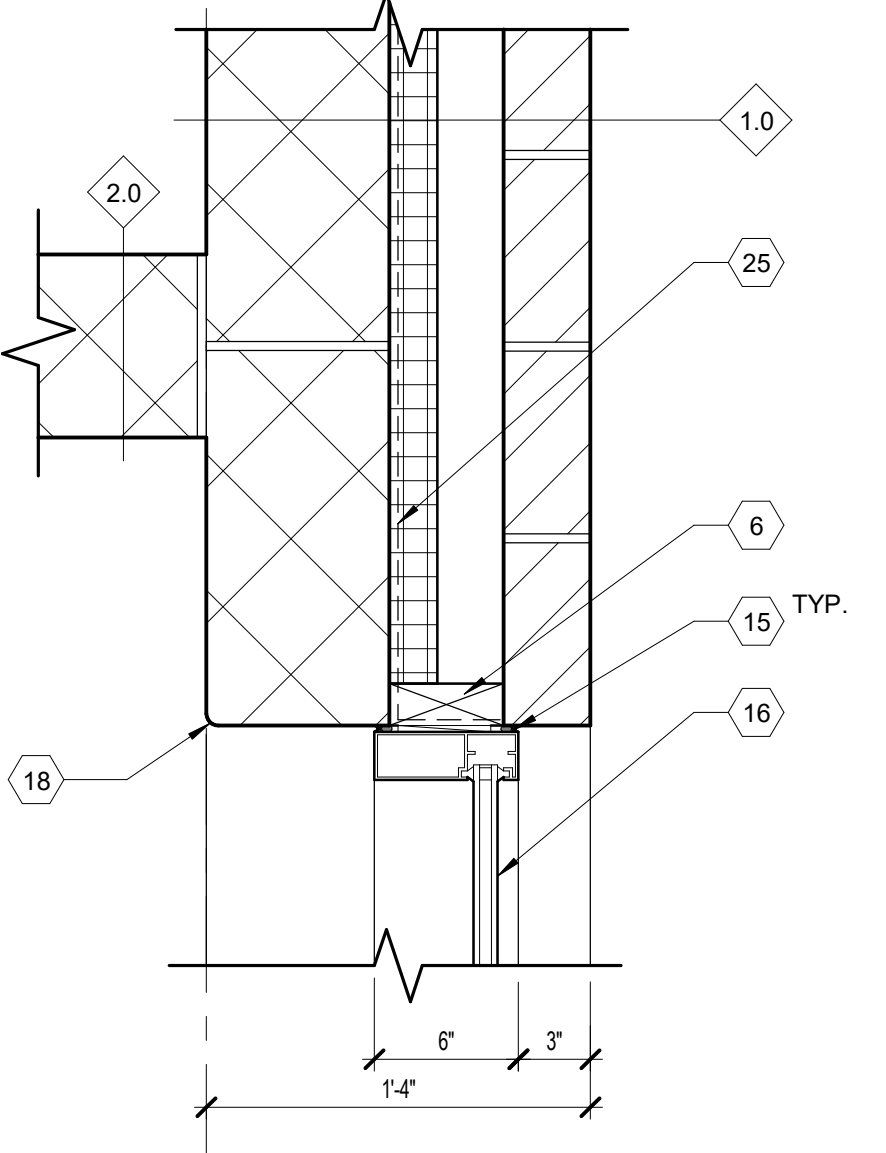

28 JAMB DETAIL @ DINING
SCALE: 1 1/2" = 1'-0"

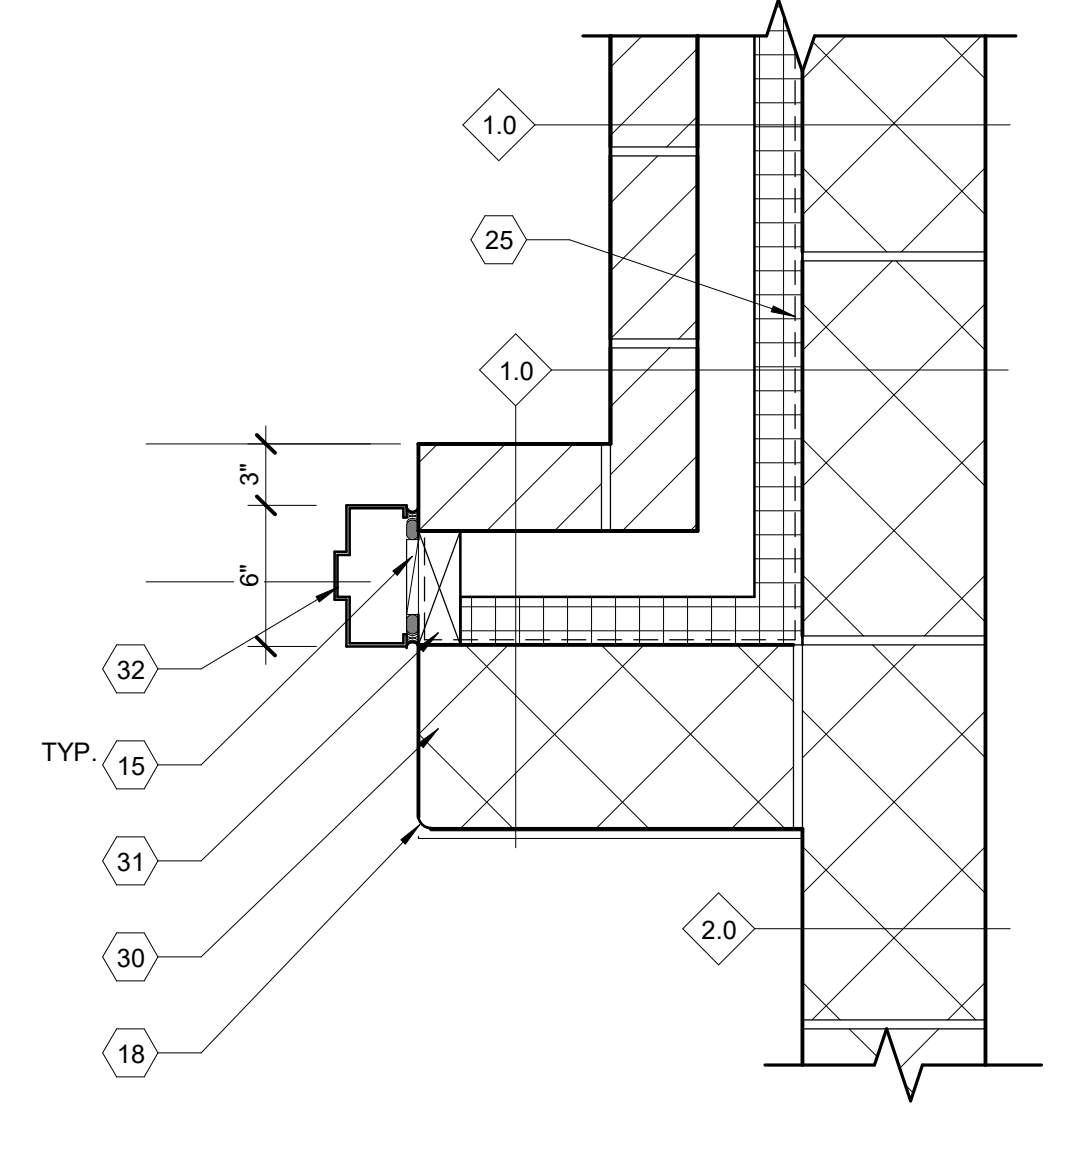

29 JAMB DETAIL @ CORRIDOR
SCALE: 1 1/2" = 1'-0"

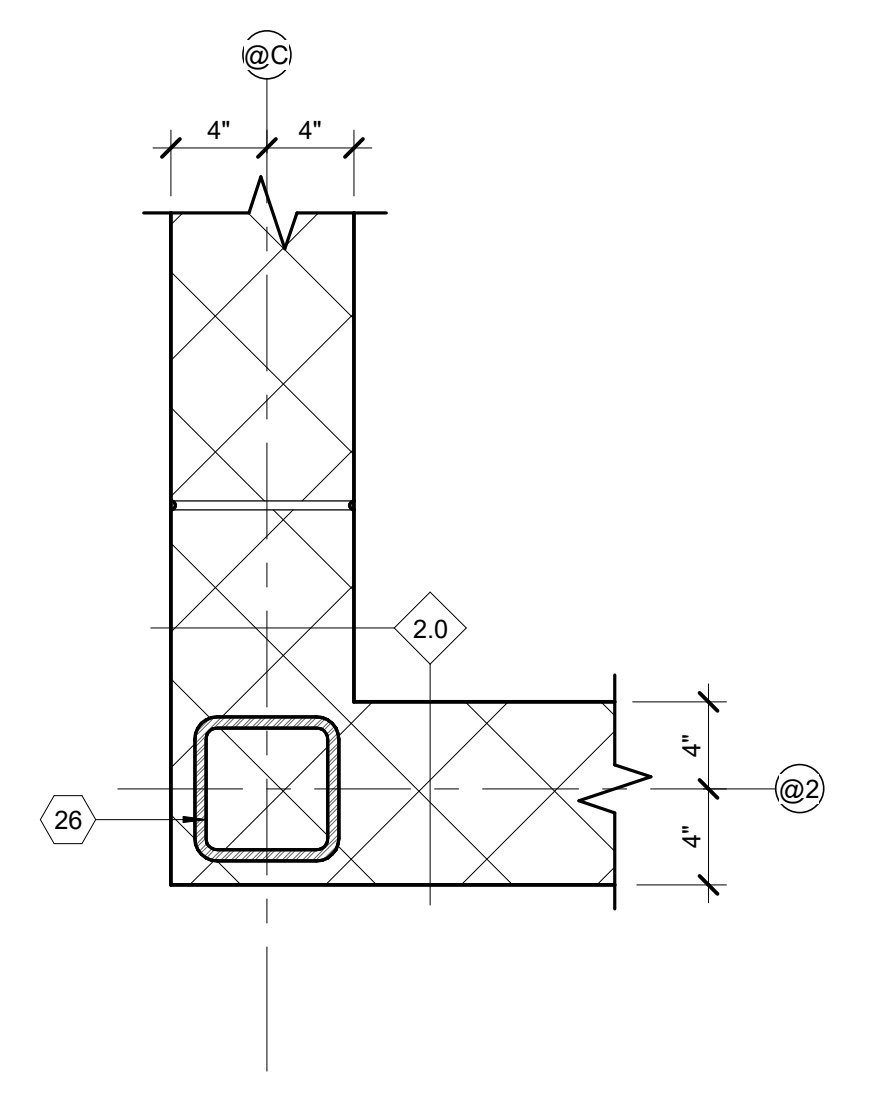

30 CORNER DETAIL @ DRY STORAGE
SCALE: 1 1/2" = 1'-0"

MATERIAL KEYNOTES

- 1 EXISTING TO REMAIN
- 2 FULLY ADHEARED SINGLE PLY MEMBRANE ROOFING
- 3 3/4" ROOFING BOARD
- 4 RIGID ROOF INSULATION R-30
- 5 METAL DECK (REFER TO STRUCTURAL)
- 6 2x PRESSURE TREATED WOOD BLOCKING
- 7 SPRAY INSULATION IN METAL DECK FLUTES TO ALLOW FOR CONTINUOUS INSULATION
- 8 STEEL LINTEL - EXTERIOR STEEL LINTELS TO BE GALVANIZED - PAINT (REFER TO STRUCTURAL)
- 9 GROUT SOLID
- 10 THRU WALL FLASHING
- 11 MORTAR NET
- 12 FACE BRICK - MATCH EXISTING
- 13 8x24 BURNISHED BLOCK ACCENT BAND - MATCH EXISTING
- 14 8x24 SPLIT FACE BLOCK WAINSCOT - MATCH EXISTING
- 15 SEALANT OVER BACKER ROD EXTERIOR / CAULK INTERIOR - TYPICAL AT ALL WINDOWS AND DOORS
- 16 ALUMINUM WINDOW SYSTEM WITH INSULATED GLAZING
- 17 BRICK VENT
- 18 BULLNOSE
- 19 BOND BREAK
- 20 4" CONCRETE SLAB ON VAPOR BARRIER (REFER TO STRUCTURAL)
- 21 PERIMETER INSULATION - EXTEND 2'-0" IN BOTH DIRECTIONS
- 22 COMPACTED GRANULAR FILL
- 23 GRADE (REFER TO CIVIL)
- 24 POURED CONCRETE FOUNDATION WALL (REFER TO STRUCTURAL)
- 25 BITUMINOUS DAMPPROOFING
- 26 STEEL COLUMN (REFER TO STRUCTURAL)
- 27 RIGID INSULATION
- 28 CONTINUOUS METAL ROOF EDGE - MATCH EXISTING PROFILE - AT CONNECTION POINTS ALSO MATCH EXISTING HEIGHT (V.I.F.)
- 29 NEW FENCE (REFER TO CIVIL AND ELECTRICAL)
- 30 CONCRETE MASONRY UNIT
- 31 COLD FORMED METAL FRAMING
- 32 DOOR AND FRAME (REFER TO SCHEDULE)
- 33 2" EXPANSION JOINT / CONTROL JOINT AS REQUIRED - FIRE RATE AS REQUIRED (REFER TO CODE PLAN)
- 34 LIGHT FIXTURE (REFER TO ELECTRICAL)
- 35 MECHANICAL ITEM (REFER TO MECHANICAL)
- 36 POURED CONCRETE FOOTING (REFER TO STRUCTURAL)
- 37 STEEL ANGLE (REFER TO STRUCTURAL)
- 38 STEEL TUBE (REFER TO STRUCTURAL)
- 39 STEEL JOIST (REFER TO STRUCTURAL)
- 40 STEEL BEAM (REFER TO STRUCTURAL)
- 41 SUSPENDED CEILING SYSTEM (REFER TO SCHEDULE)
- 42 LOUVER (REFER TO MECHANICAL)
- 43 BOND BEAM WITH (2) #6 CONT. GROUT SOLID (REFER TO STRUCTURAL)
- 44 CMU FOUNDATION WALL (REFER TO STRUCTURAL)
- 45 ROOF LADDER - ATTACH AND FLASH AS REQUIRED PER MANUFACTURERS RECOMMENDATIONS (REFER TO REFERENCE ONLY DETAIL)
- 46 WALL MOUNTED ELECTRICAL ITEM (REFER TO ELECTRICAL)
- 47 CEILING MOUNTED ELECTRICAL ITEM (REFER TO ELECTRICAL)
- 48 PLUMBING FIXTURE AND ACCESSORIES (REFER TO MECHANICAL & STANDARD MOUNTING HEIGHTS CHART)
- 49 BASE MATERIAL (REFER TO SCHEDULE)
- 50 CONTROL JOINT

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACHL, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107 COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
PLAN DETAILS

PROJECT NUMBER
2021094

PROJECT DATE
SEPTEMBER 6, 2023

A2.31

SHEET NUMBER


CHECKED BY
C.D.S.

ROOM FINISH SCHEDULE													
ROOM NO.	ROOM NAME	FLOOR	BASE	MAT.	FINISH	NORTH WALL	EAST WALL	SOUTH WALL	WEST WALL	CEILING	CL.G. HEIGHT	REMARKS	
E124	GYMNASIUM	EXISTING	EXIST.	EXIST.	EXIST.	EXIST. / C.M.U.	EXIST. / C.M.U.	EXIST.	EXIST.	EXIST.	EXIST.		O
E126	SECURE CORR.	EXIST. / C. TILE	EXIST. / C. TILE	EXIST. / C.M.U.	PAINT	EXIST.	EXIST.	EXIST.	EXIST.	EXIST.	EXIST.		O
H104	WAREHOUSE	EXISTING	EXIST.	EXIST.	EXIST.	EXIST.	EXIST.	EXIST.	EXIST.	EXIST.	EXIST.		O
H116A	SECUR. VEST.	C. TILE	C. TILE	C.M.U.	PAINT	C.M.U.	PAINT	C.M.U.	PAINT	SAT-1	--	9'-0"	
H119	STORAGE	RTF	R.W.B.	C.M.U.	PAINT	C.M.U.	PAINT	C.M.U.	PAINT	SAT-1	--	9'-0"	
H120	CORRIDOR (WEST CONNECTOR)	SEALED CONC.	R.W.B.	C.M.U.	PAINT	--	--	C.M.U.	PAINT	SAT-1	--	9'-0"	L
H121	STAIR	SEALED CONC.	R.W.B.	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	EXP.	PAINT		
H122	CORRIDOR	SEALED CONC.	R.W.B.	C.M.U.	PAINT	C.M.U.	PAINT	C.M.U.	PAINT	SAT-1	--	9'-0"	L
H123	KITCHEN	RSF	RSF COVE	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	SAT-2	--	9'-0"	N
H123A	DISH AREA	RSF	RSF COVE	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	SAT-2	--	9'-0"	N
H124	DRY STORAGE	RSF	RSF COVE	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	SAT-2	--	8'-0"	N
H125	OFFICE	RSF	R.W.B.	C.M.U.	PAINT	C.M.U.	PAINT	C.M.U.	PAINT	SAT-1	--	10'-0"	
H126	STAFF TOILET	RSF	R.W.B.	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	SAT-2	--	8'-0"	
H127	BREAK ROOM	RSF	R.W.B.	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	SAT-1	--	10'-0"	
H128	CART WASH	RSF	RSF COVE	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	SAT-2	--	9'-0"	N
H129	CHEMICAL STOR.	RSF	RSF COVE	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	SAT-2	--	9'-0"	N
H130	SERVERY	C. TILE	C. TILE	C.M.U.	PAINT	C.M.U.	PAINT	C.M.U.	PAINT	SAT-2	--	9'-0"	
H131	DINING	C. TILE	C. TILE	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	GYP. BD.	EPOXY PAINT		M
H132	CORRIDOR (SOUTH CONNECTOR)	C. TILE / CPT	C. TILE	C.M.U.	PAINT	C.M.U.	PAINT	C.M.U.	PAINT	SAT-1	--	8'-0"	L
H133	CORR. (GYM CONN.)	RTF	R.W.B.	C.M.U.	PAINT	C.M.U.	PAINT	C.M.U.	PAINT	SAT-1	--	9'-0"	
H200	STAIR	SEALED CONC.	R.W.B.	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	EXP.	EPOXY PAINT		
H201	MECHANICAL / ELECTRICAL	SEALED CONC.	--	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	C.M.U.	EPOXY PAINT	EXP.	EPOXY PAINT		


DOOR & FRAME SCHEDULE													
DOOR NUMBER	ROOM NAME	PAIR	WIDTH	HEIGHT	THK.	MAT.	TYPE	FRAME	HEAD	JAMB	SILL	FIRE RATING	REMARKS
E124.C	CORR. (GYM CONN.)		3'-0"	7'-0"	1 3/4"	H.M.	D4	H.M.	F2	27/A7.02 SIM	11/A2.31	30/A7.02 SIM	90
E126.A	SECURE CORR.	X	3'-0"	7'-2"	1 3/4"	H.M.	D2	H.M.	F1	20/A3.01	25/A3.01		20
H120.A	CORRIDOR (WEST CONNECTOR)	X	3'-6"	7'-0"	1 3/4"	H.M.	D4	H.M.	F2	27/A7.02	1/A2.31	30/A7.02	90
H120.B	CORRIDOR (WEST CONNECTOR)		10'-0"	8'-0"	1 3/8"	STEEL	D3	STEEL	-	27/A3.01	28/A3.01		H
H120.C	CORRIDOR (WEST CONNECTOR)		10'-0"	8'-0"	1 3/8"	STEEL	D3	STEEL	-	27/A3.01	28/A3.01		H
H120.D	CORRIDOR (WEST CONNECTOR)		3'-0"	7'-2"	1 3/4"	ALUM.	D2	ALUM.	F1	21/A3.01	29/A2.31		C, G, T
H120.E	CORRIDOR (WEST CONNECTOR)		3'-0"	7'-2"	1 3/4"	ALUM.	D2	ALUM.	F1	21/A3.01	29/A2.31		C, G, T
H121.A	STAIR		3'-0"	7'-2"	1 3/4"	WD.	D4	H.M.	F1	30/A3.01	6/A2.31		B 60
H122.A	SECUR. VEST.		3'-8"	7'-2"	1 3/4"	WD.	D2	H.M.	F1	20/A3.01	6/A2.31		C, F, G, S
H122.B	CORRIDOR	X	3'-0"	7'-2"	1 3/4"	WD.	D2	H.M.	F1	20/A3.01	6/A2.31		B, C, G, R
H122.C	CORRIDOR	X	3'-0"	7'-2"	1 3/4"	WD.	D2	H.M.	F1	20/A3.01	6/A2.31		B, C, G, R
H122.D	CORRIDOR		4'-0"	7'-2"	1 3/4"	ALUM.	D2	ALUM.	F1	21/A3.01	29/A2.31		C, D, E, G, T
H124.A	DRY STORAGE		3'-0"	7'-2"	1 3/4"	H.M.	D1	H.M.	F1	20/A3.01	6/A2.31		H
H125.A	OFFICE		3'-0"	7'-2"	1 3/4"	WD.	D2	H.M.	F1	20/A3.01	6/A2.31		H, R
H126.A	STAFF TOILET		3'-0"	7'-2"	1 3/4"	H.M.	D1	H.M.	F1	20/A3.01	6/A2.31		H
H127.A	BREAK ROOM		3'-0"	7'-2"	1 3/4"	WD.	D2	H.M.	F1	20/A3.01	6/A2.31		H, R
H129.A	CHEMICAL STOR.		3'-0"	7'-2"	1 3/4"	H.M.	D1	H.M.	F1	20/A3.01	6/A2.31		H
H130.A	SERVERY		3'-8"	7'-2"	1 3/4"	WD.	D1	H.M.	F1	20/A3.01	6/A2.31		C, E, G
H130.B	SERVERY		3'-8"	7'-2"	1 3/4"	WD.	D2	H.M.	F1	20/A3.01	6/A2.31		B, E, H, S
H130.C	SERVERY		3'-8"	7'-2"	1 3/4"	WD.	D2	H.M.	F1	20/A3.01	6/A2.31		B, E, H, S
H131.A	DINING	X	3'-0"	7'-2"	1 3/4"	WD.	D2	H.M.	F1	20/A3.01	6/A2.31		B, E, H, S
H131.B	SECUR. VEST.		3'-8"	7'-2"	1 3/4"	WD.	D2	H.M.	F1	20/A3.01	6/A2.31		E, G, J, P, Q, S
H131.C	DINING	X	3'-0"	7'-2"	1 3/4"	D.H.M.	D2	D.H.M.	F1	29/A3.01	5/A2.31		C, D, E, G, U
H131.D	DINING		8'-0"	3'-4"	1 1/2"	STEEL	D3	STEEL	-	26/A3.01	26/A3.01		B, H
H132.A	CORR. (S. CONN.)	X	3'-6"	7'-0"	1 3/4"	H.M.	D4	H.M.	F2	27/A7.02	13/A2.31	30/A7.02	90
H132.B	STORAGE		3'-8"	7'-2"	1 3/4"	H.M.	D1	H.M.	F1	20/A3.01	6/A2.31		E, H
H132.C	CORRIDOR (SOUTH CONNECTOR)	X	3'-0"	7'-2"	1 3/4"	D.H.M.	D2	D.H.M.	F1	21/A3.01	5/A2.31		C, D, E, G, U
H133.A	CORR. (GYM CONN.)		3'-0"	7'-2"	1 3/4"	WD.	D4	H.M.	F1	20/A3.01	6/A2.31		D, E, K, S
H200.A	STAIR		3'-0"	7'-2"	1 3/4"	WD.	D4	H.M.	F1	20/A3.01	6/A2.31		H, R
H201.A	MECHANICAL / ELECTRICAL		3'-0"	7'-2"	1 3/4"	H.M.	D1	H.M.	F1	22/A3.01	22/A3.01		H

FINISH MATERIAL SCHEDULE					
MATERIAL	MANUFACTURER	STYLE	COLOR	SIZE	REMARKS
C. TILE - CERAMIC TILING	STONEPEAK	SIMPLY MODERN	SIMPLY TAN, HONED FINISH	12"x24"	WITH MATCHING SIMPLY MODERN 6"x12" COVE BASE, LATICRETE GROUT
CPT - CARPET TILE	TARKETT	ASSERTIVE ACTION RIB	CHROMIUM 26201	24"x24"	COLOR: HEMP 27. 1/3 ASHLAR LAYING PATTERN
PAINT - CEILINGS	SHERWIN-WILLIAMS		SW1004 PURE WHITE		GLUE-DOWN, FLEX AIRE CUSHION BACK
PAINT - EXTERIOR DOORS & FRAMES	SHERWIN-WILLIAMS		SW1004 PURE WHITE		
PAINT - INTERIOR DOORS & FRAMES	SHERWIN-WILLIAMS		SW1099 KNUBBY WOOL		
PAINT - STAIRS & RAILINGS	SHERWIN-WILLIAMS		SW6215 ROCKY RIVER		
PAINT - WALLS	SHERWIN-WILLIAMS		SW1102 CHENILLE WHITE		
RSF - RESILIENT SHEET VINYL	PROTECT-ALL	CLASSIC	LIGHT GRAY	5 FT. x 8 FT.	WITH MATCHING PROTECT-ALL 6" COVE BASE SYSTEM - ONLY WHERE NOTED.
RTF - RESILIENT TILE FLOORING	TARKETT	ID LATITUDE	HEARTHSTONE	18"x18"	DIRECT GLUE DOWN
RWB - RESILIENT WALL BASE	TARKETT	TP RUBBER	CHARCOAL 20	4" COVE	
SAT-1 - SUSPENDED ACOUSTIC TILE	ARMSTRONG	FISSURED	WHITE	24"x24"	
SAT-2 - SUSPENDED ACOUSTIC TILE	ARMSTRONG	KITCHEN ZONE	WHITE	24"x24"	


- SCHEDULE GENERAL NOTES:**
- FINAL LOCATIONS OF DOOR CARD READERS, DOOR INTERCOMS AND PUSH BUTTONS TO BE FIELD VERIFIED WITH OWNER.
 - REFER TO SHEET A0.01 AND MATERIAL SCHEDULE (THIS SHEET) FOR ABBREVIATIONS.
 - WALL TYPES ARE INDICATED w/ A DIAMOND AND A NUMBER. REFER TO SHEET A0.01 FOR DESCRIPTION OF WALL TYPES.
- SCHEDULE OF REMARKS:**
- PROVIDE DOOR CLOSER.
 - PROVIDE HOLD OPEN w/ CLOSER TIED INTO FIRE ALARM.
 - PROVIDE A CARD READER INSIDE AND OUTSIDE.
 - PROVIDE A DOOR INTERCOM w/ PUSH BUTTON INSIDE AND OUTSIDE.
 - REINFORCED DOOR.
 - PROVIDE A DOOR INTERLOCKS INSIDE AND OUTSIDE.
 - PROVIDE AN ELECTRIC LOCK.
 - PROVIDE A MORTISE LOCK.
 - NOT USED.
 - PROVIDE A CARD READER OUTSIDE.
 - PROVIDE A PUSH BAR ON INSIDE.
 - PROVIDE HOLD-DOWN CLIPS FOR S.A.T. CEILING IN AREA NEAR EXTERIOR DOORS IN QUANTITY AND SPACING REQUIRED TO PREVENT MOVEMENT / UPLIFT OF CEILING TILES.
 - CEILING HEIGHT VARIES (REFER TO CEILING PLAN).
 - RSF FLOORING INCLUDES: Z-BAR COVE CAP, S.S. CORNER GUARDS @ COVE BASE CORNERS, AND S.S. TRANSITIONS STRIPS AT ALL FLOOR MATERIAL TRANSITIONS, BY FLGR MFR.
 - PATCH AND REPAIR AT DEMOLITION POINTS.
 - PROVIDE AN INTERLOCK INSIDE.
 - PROVIDE AN INTERCOM w/ PUSH BUTTON INSIDE.
 - DOOR LITE TO BE GL-1 (REFER TO SPECS).
 - DOOR LITE TO BE GL-2 (REFER TO SPECS).
 - DOOR LITE TO BE GL-3 (REFER TO SPECS).
 - DOOR LITE TO BE GL-4 (REFER TO SPECS).

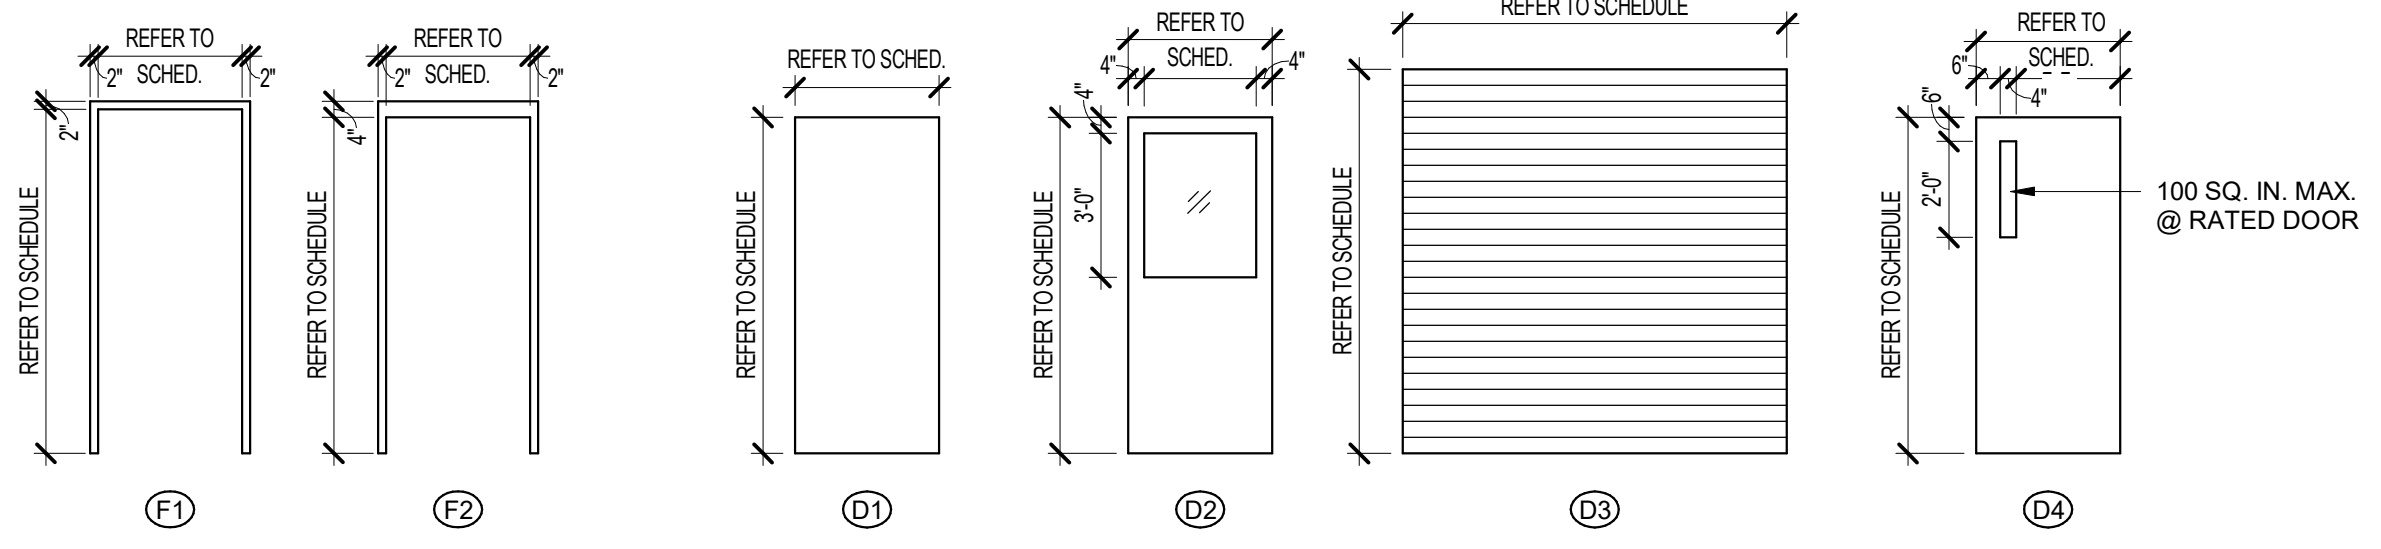

DOOR FRAMES 1/4" = 1'-0"
DOOR TYPES 1/4" = 1'-0"

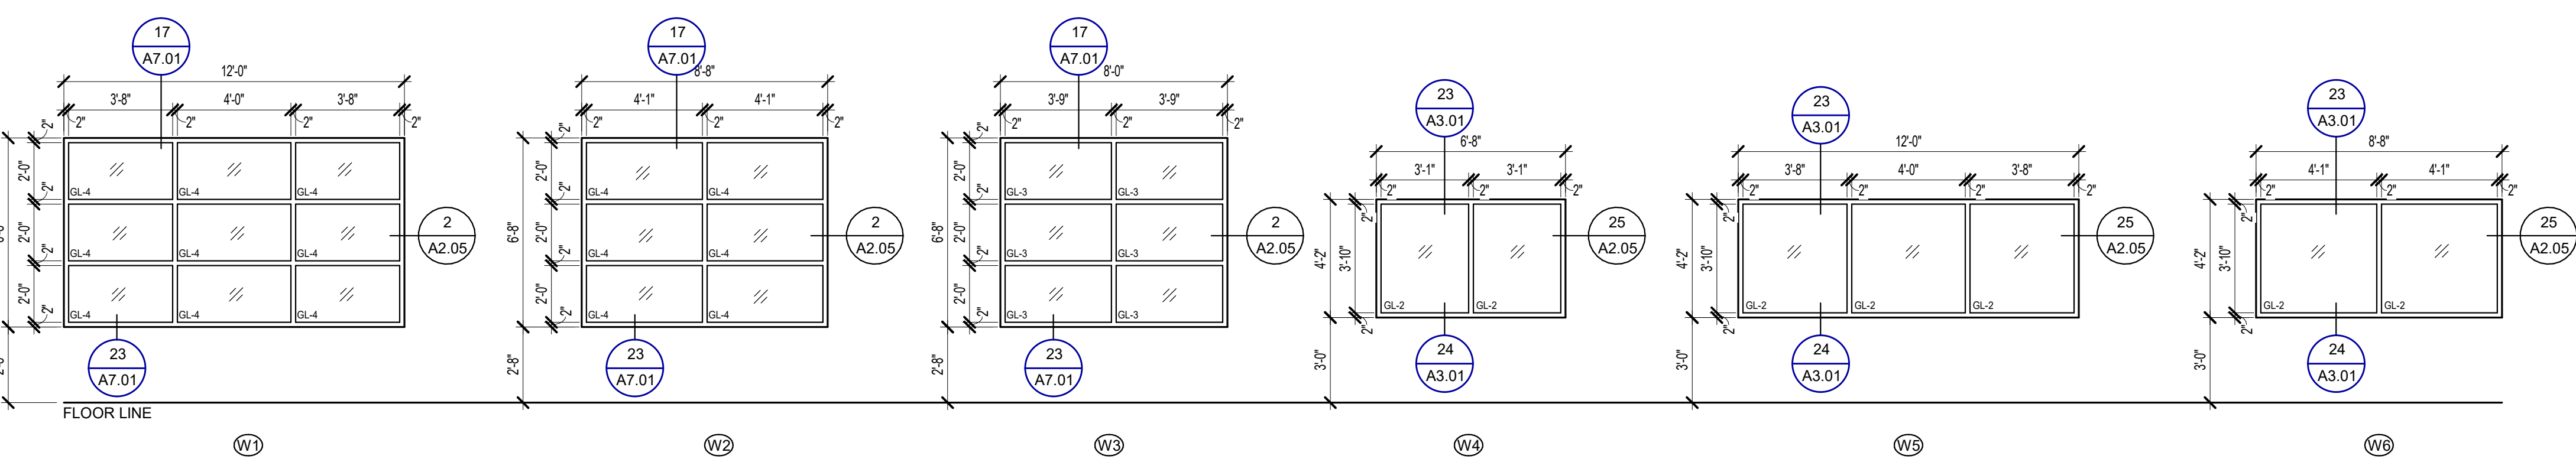

WINDOW TYPES 1/4" = 1'-0"

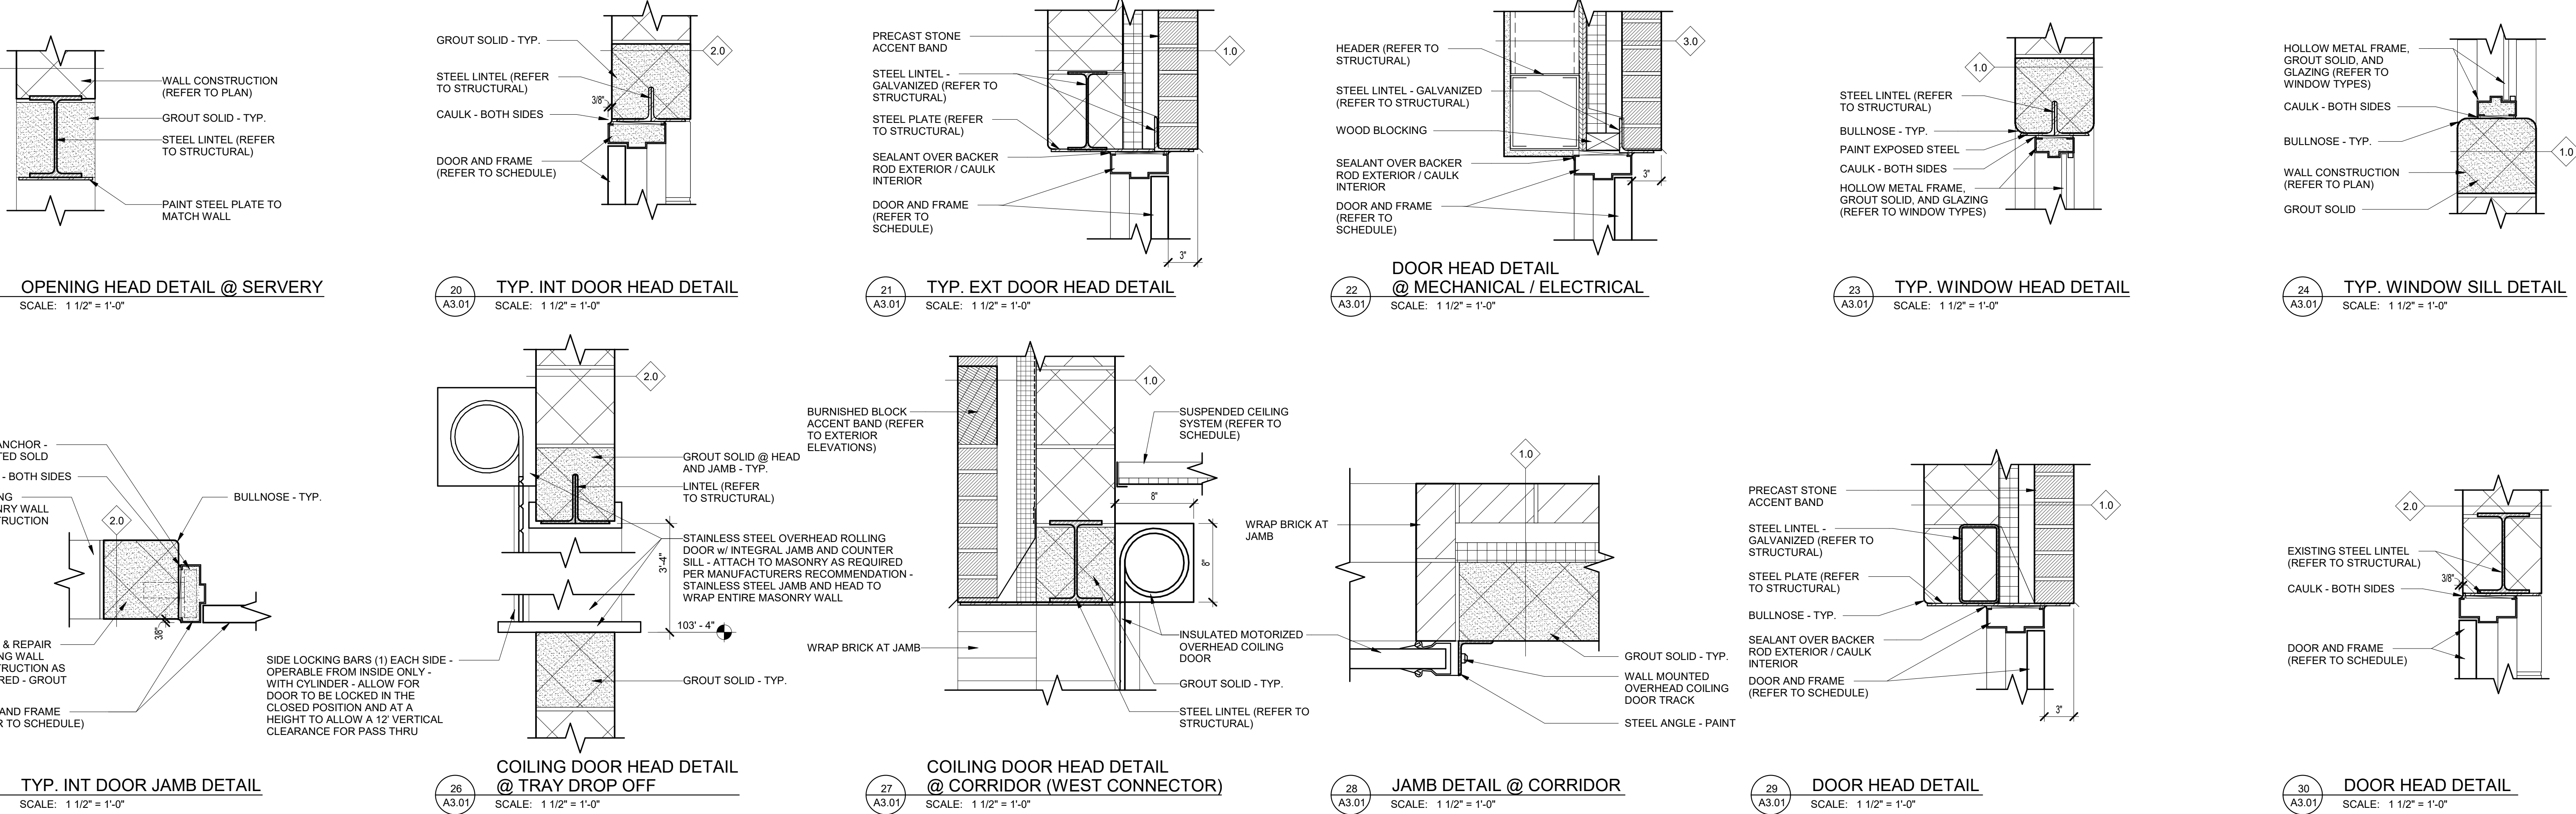

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACR, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003



WTA ARCHITECTS
100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
**491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN**

SALINE, MICHIGAN


SHEET TITLE
**ROOM FINISH & DOOR
SCHEDS, DOOR & DW
TYPES, AND DOOR DTLs**

PROJECT NUMBER
2021094


PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
C.D.S.


SHEET NUMBER
A3.01

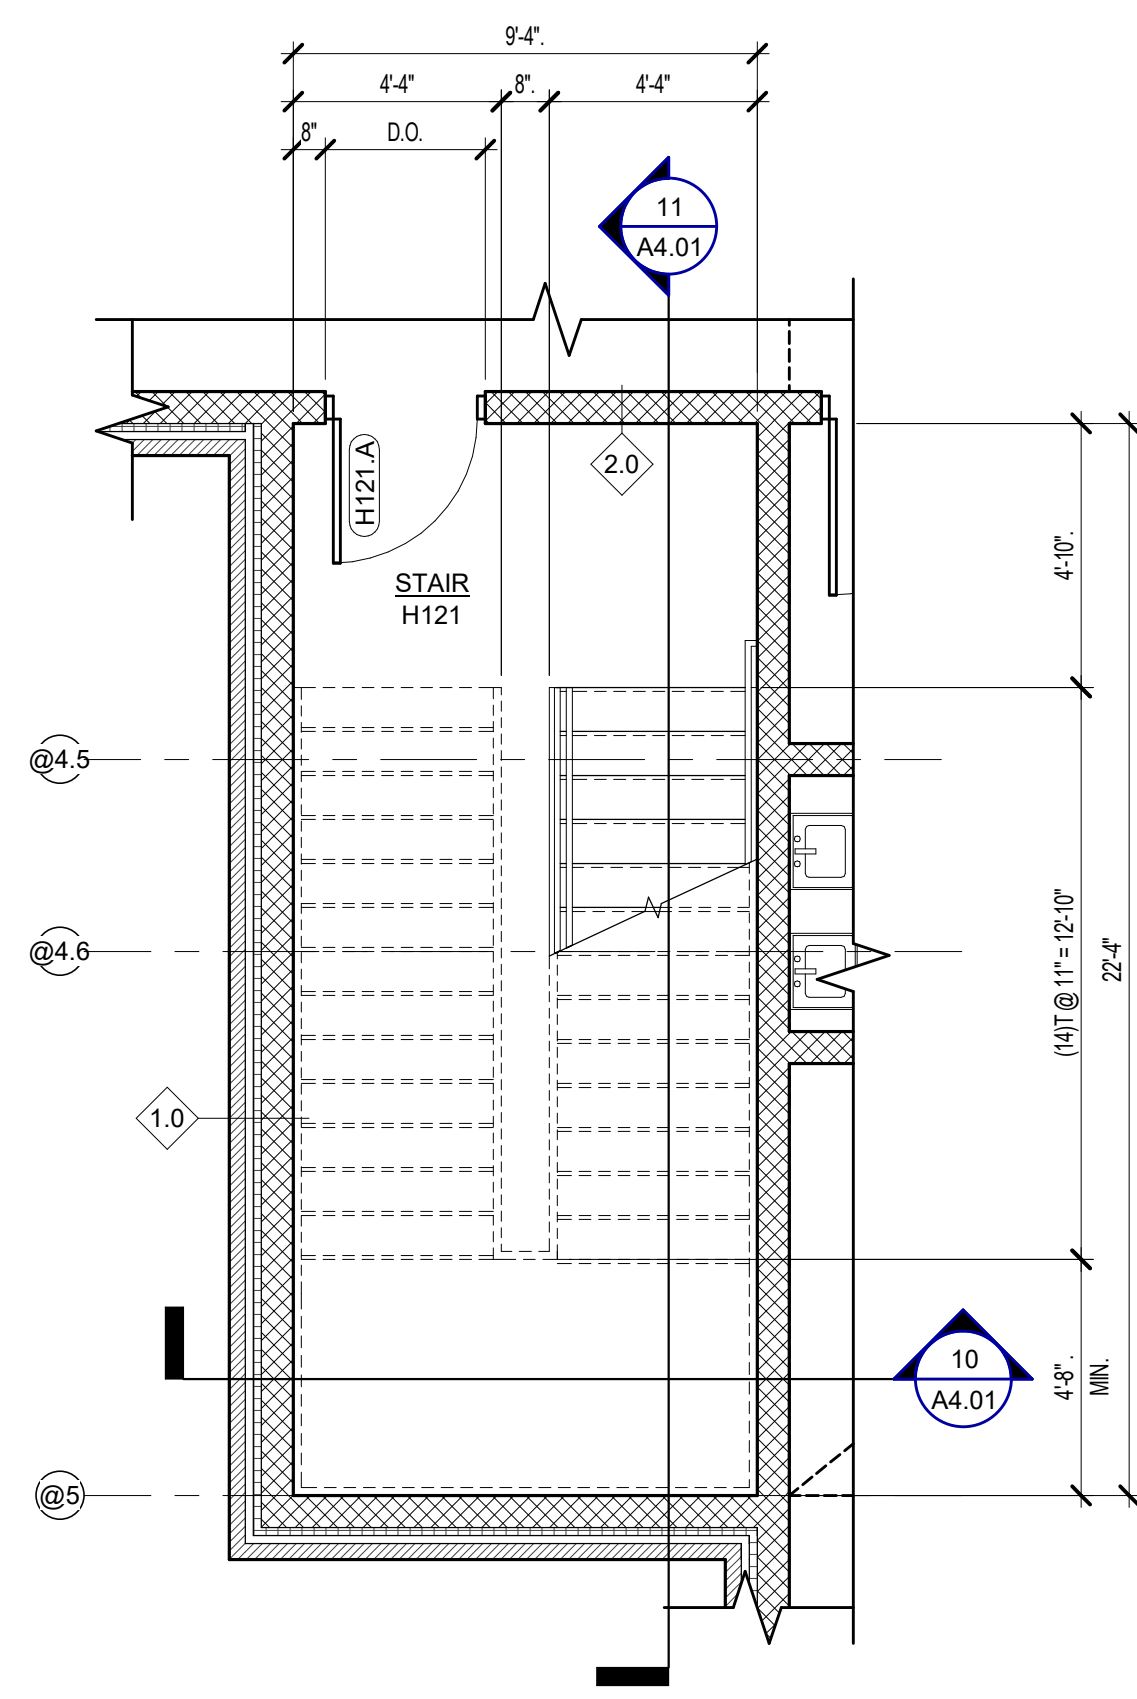


7 FIRST FLOOR STAIR PLAN
SCALE: 1/4" = 1'-0"

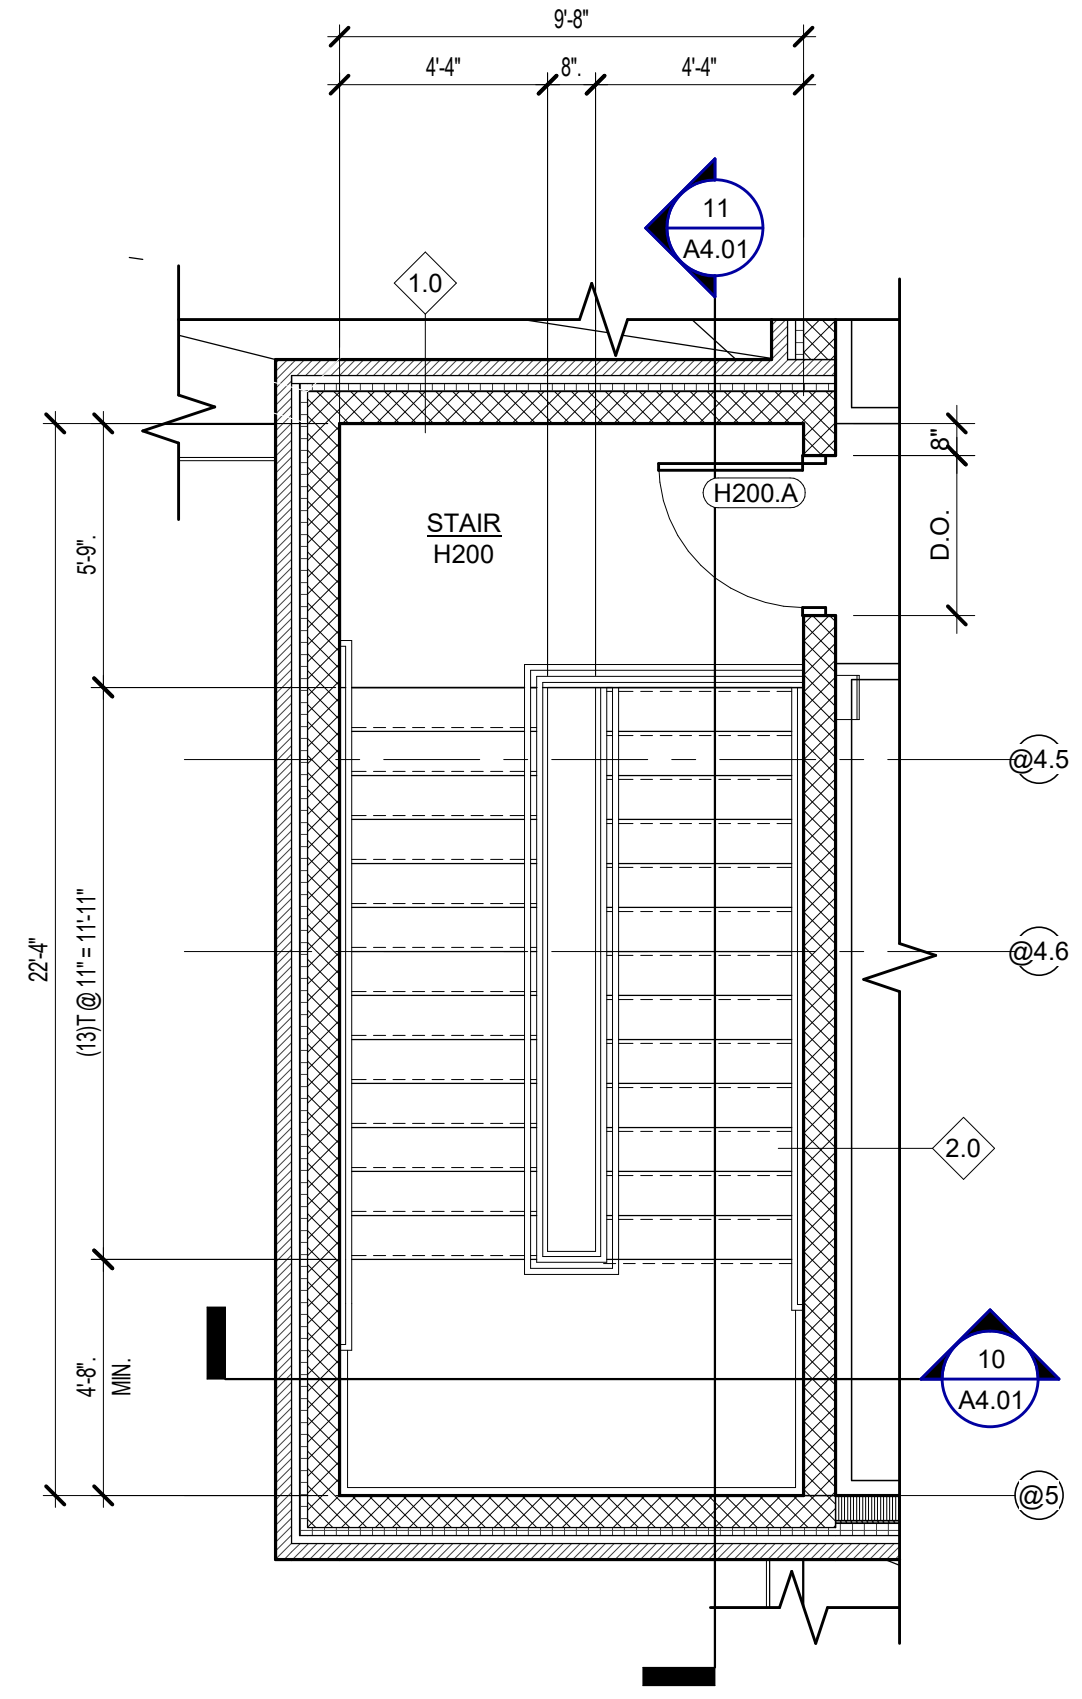


9 SECOND FLOOR STAIR PLAN
SCALE: 1/4" = 1'-0"

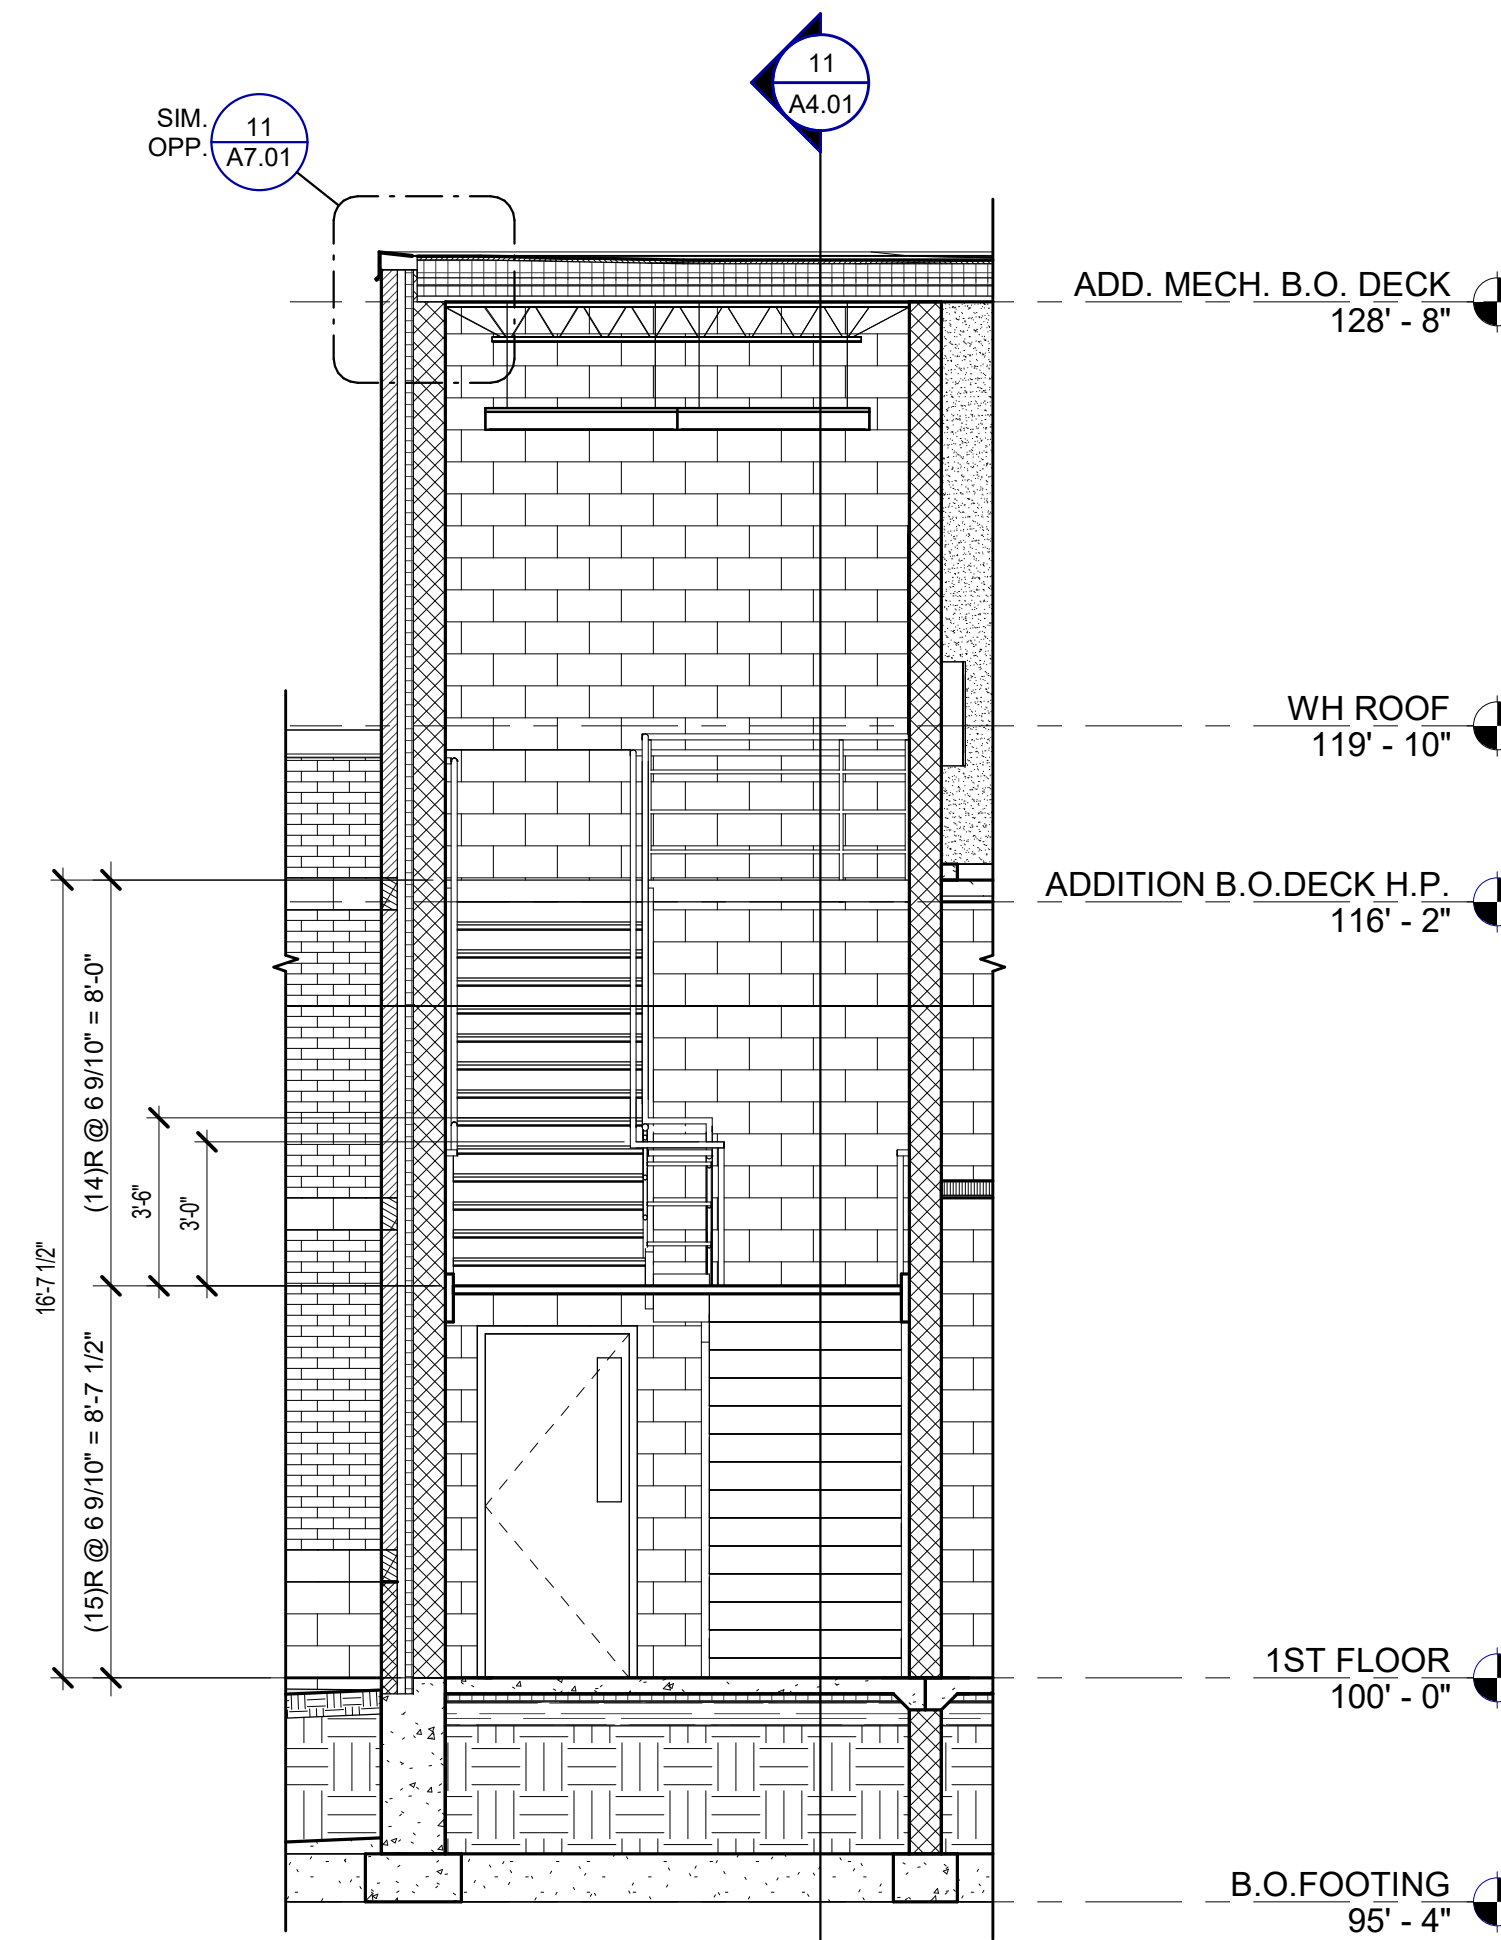


10 STAIR SECTION
SCALE: 1/4" = 1'-0"

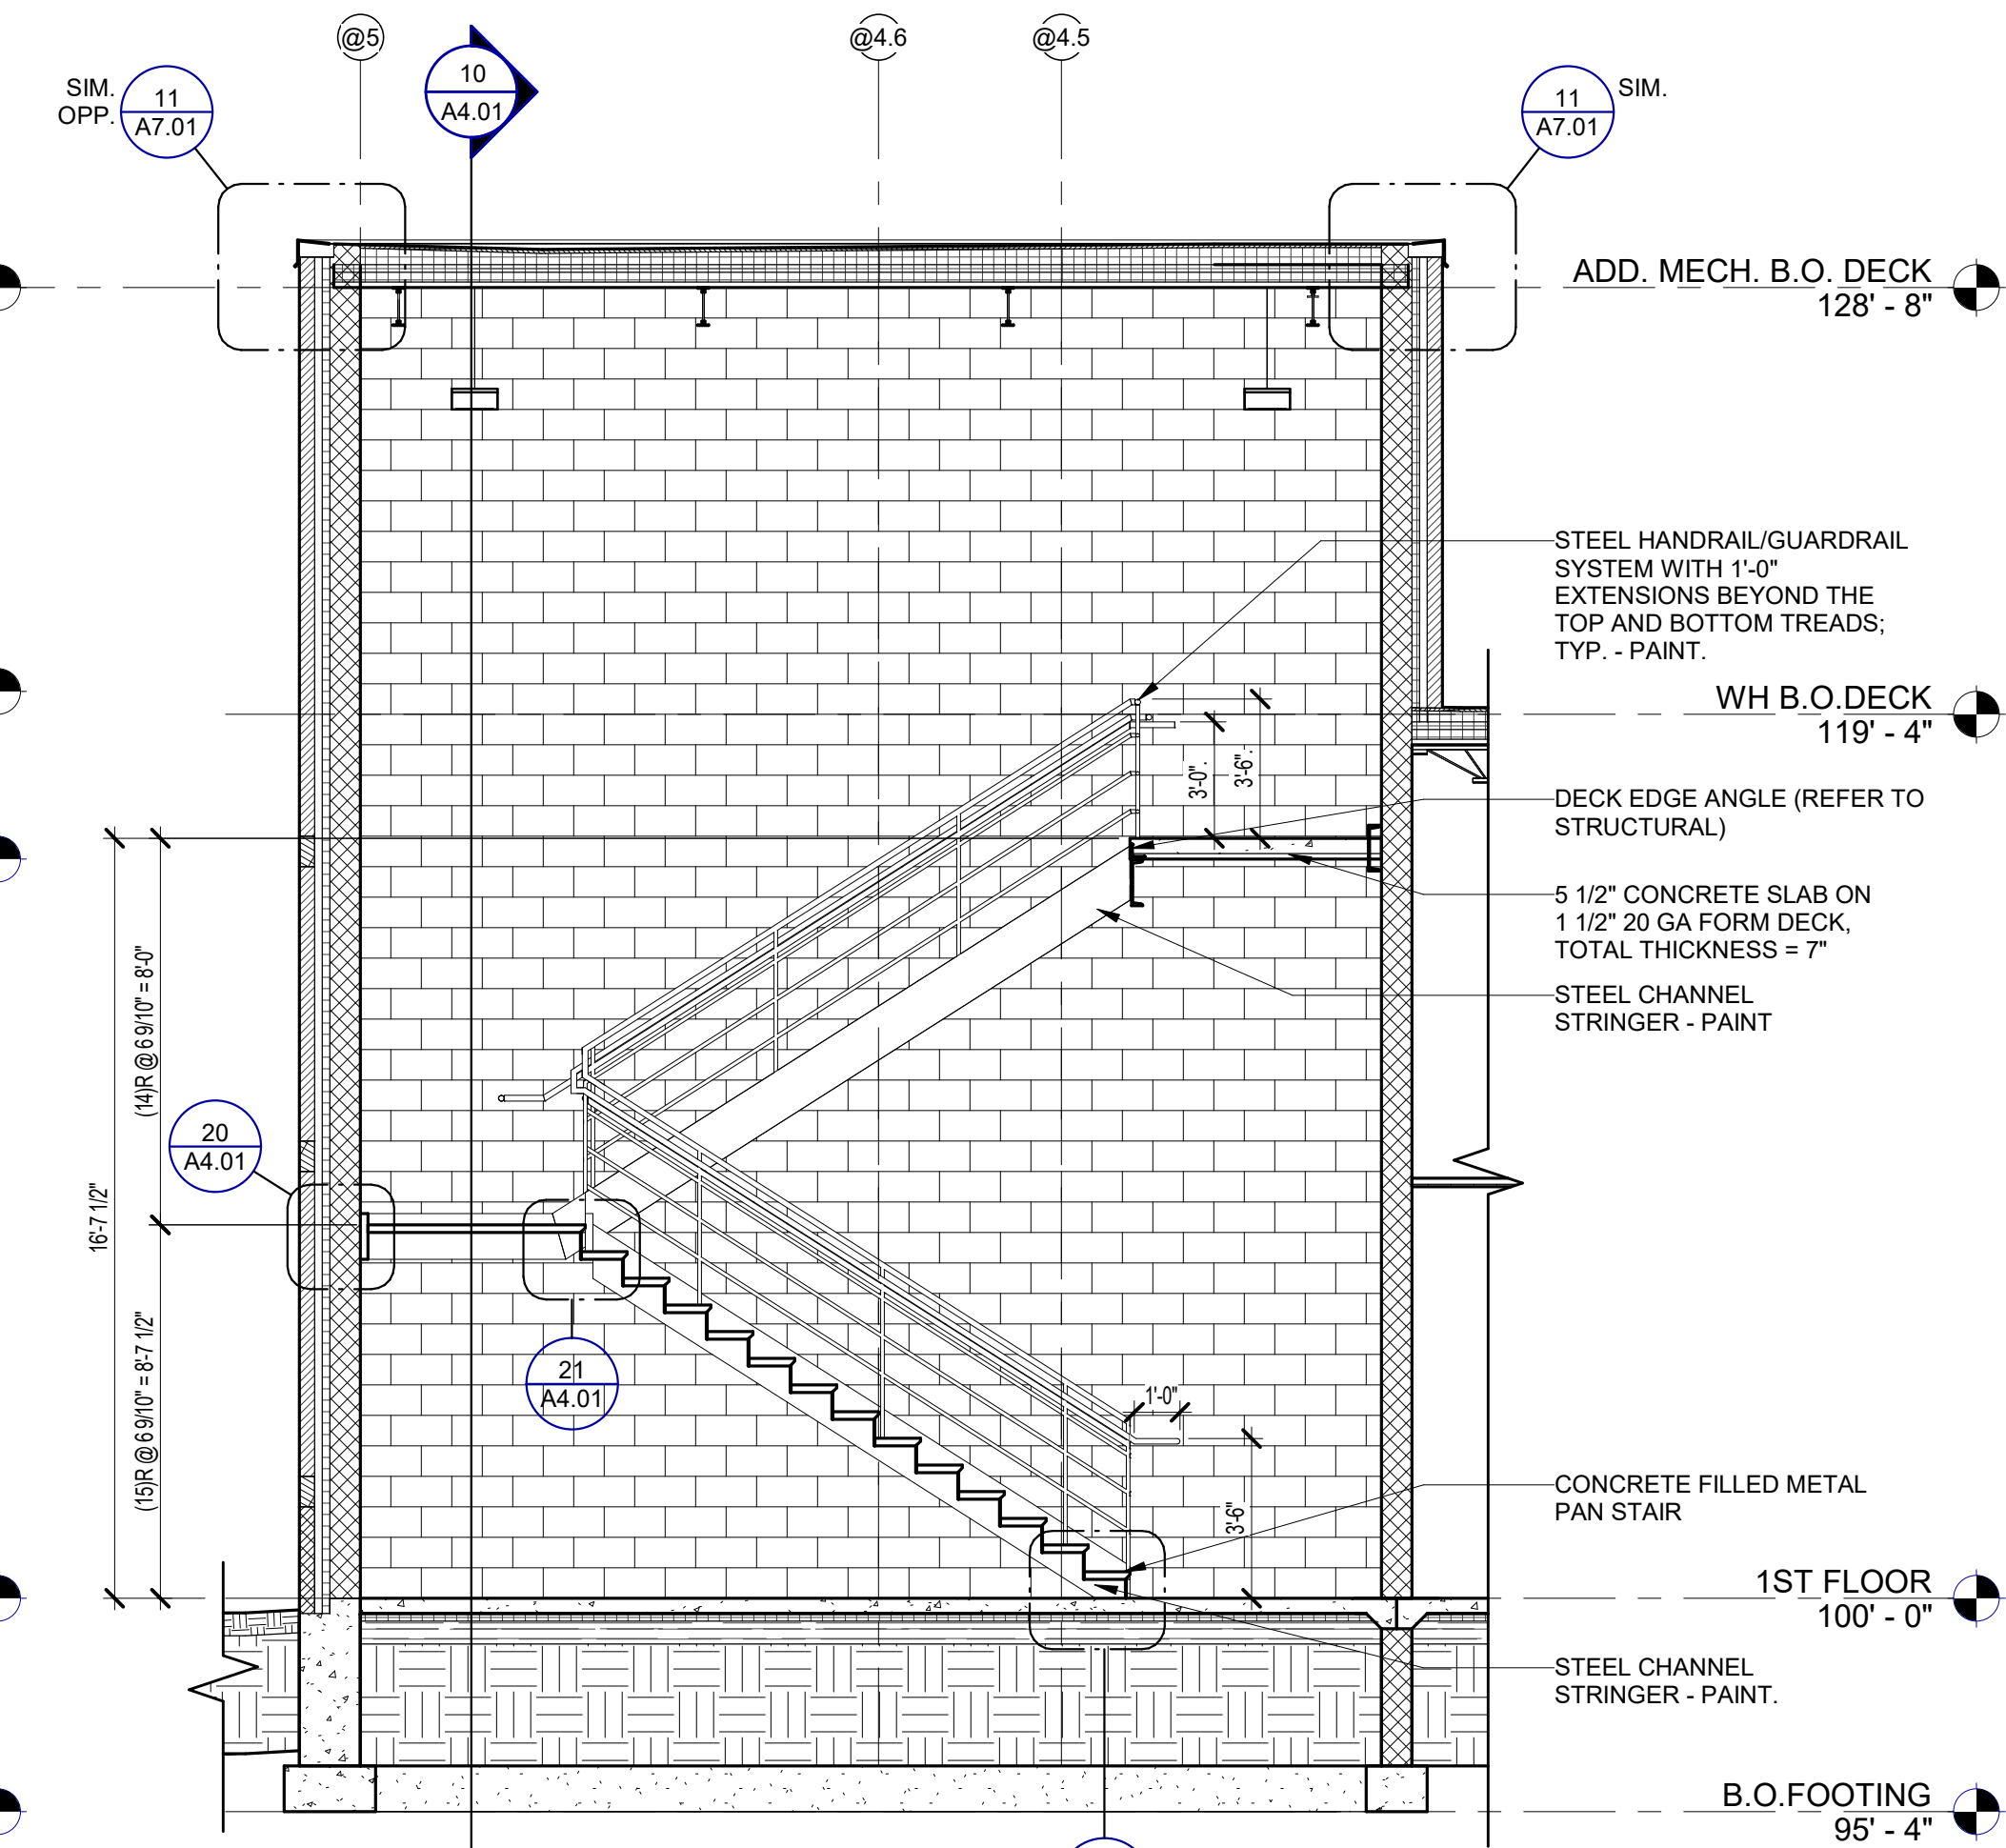


11 STAIR SECTION
SCALE: 1/4" = 1'-0"

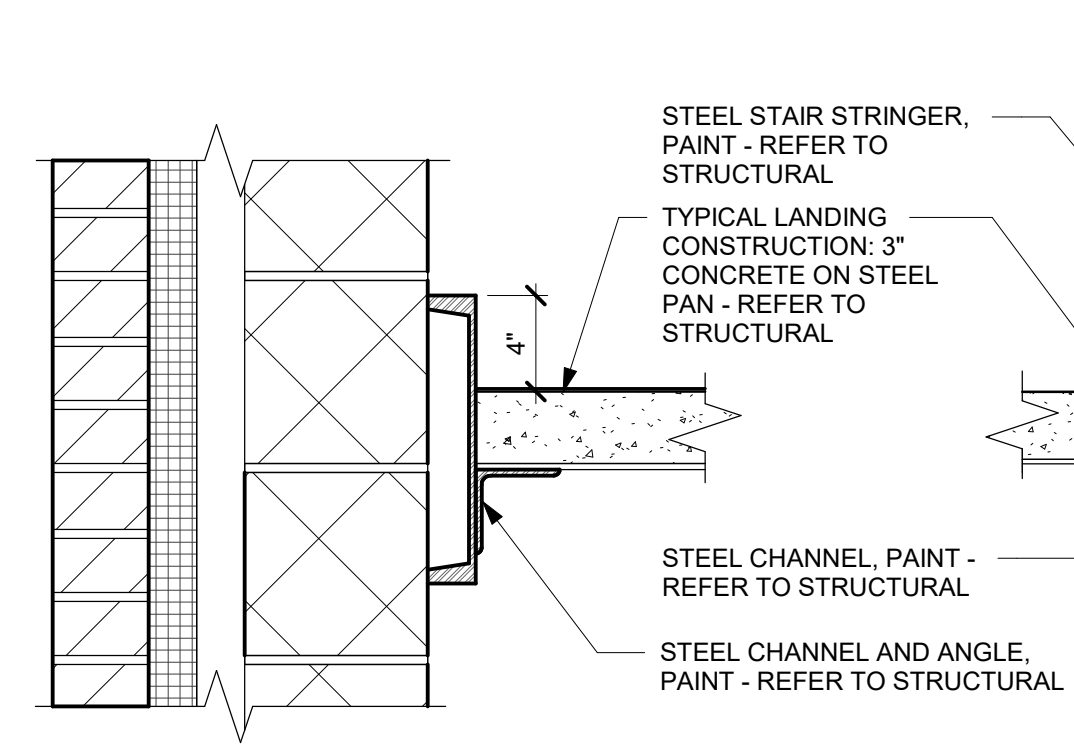

20 STAIR DETAIL
SCALE: 1 1/2" = 1'-0"

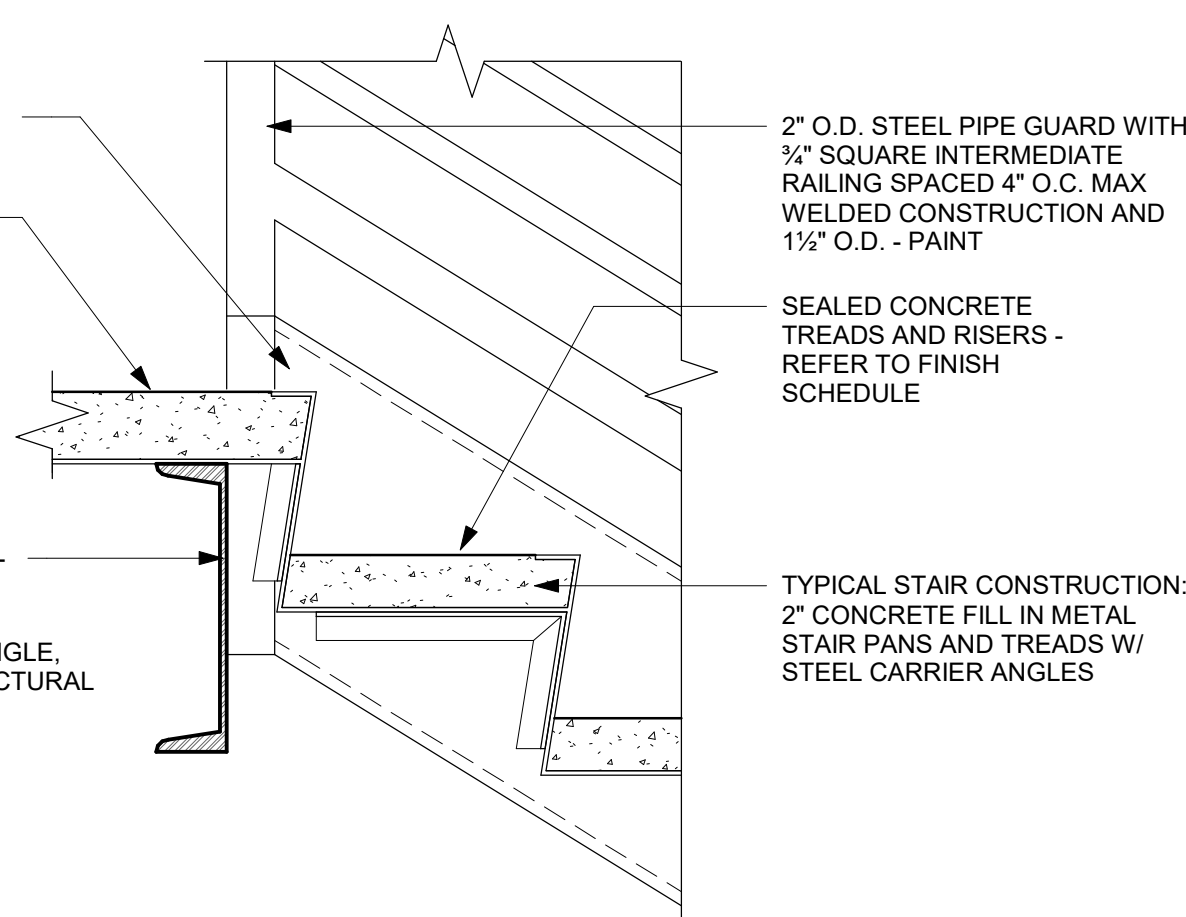

21 STAIR DETAIL
SCALE: 1 1/2" = 1'-0"

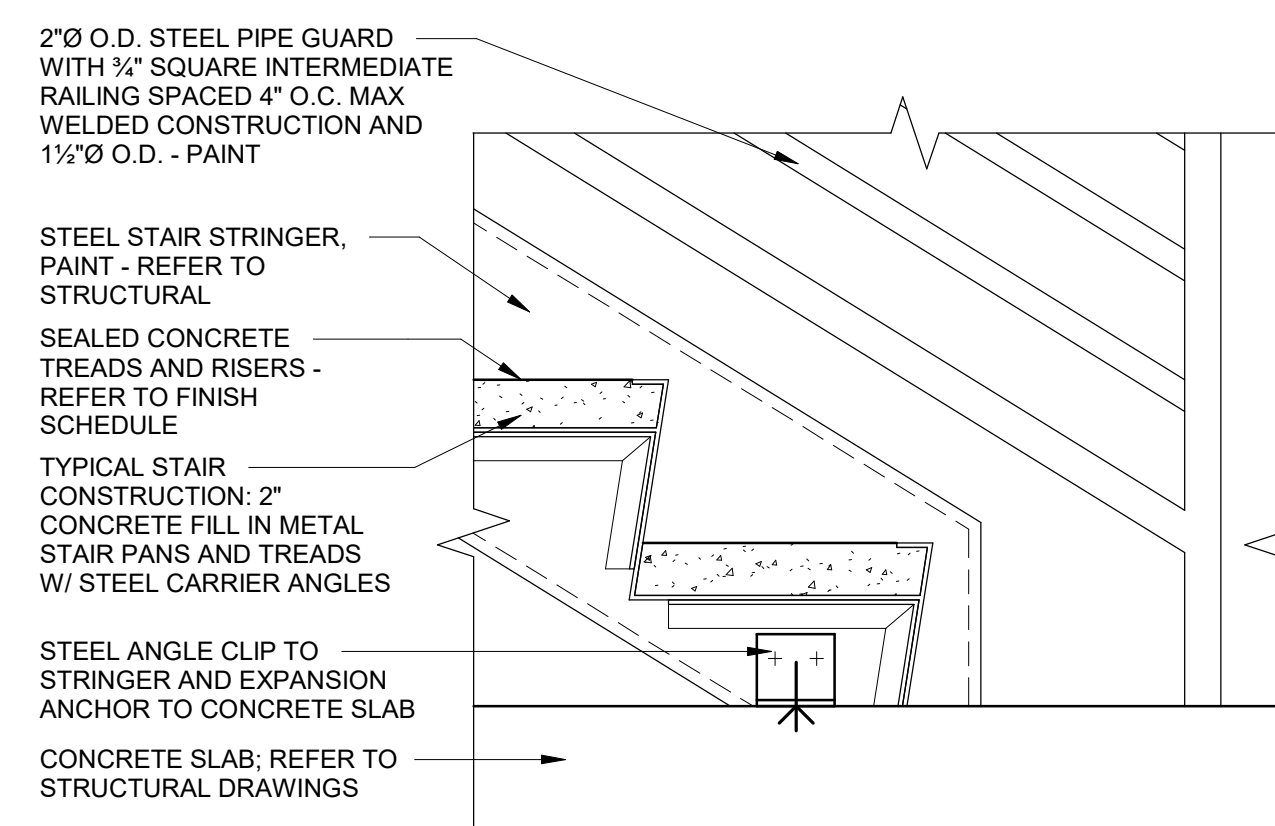

23 STAIR DETAIL
SCALE: 1 1/2" = 1'-0"

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACR, R.A., DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:

**CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN**

SALINE, MICHIGAN


SHEET TITLE
VERTICAL CIRCULATION

PROJECT NUMBER
2021094


PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
C.D.S.


SHEET NUMBER
A4.01

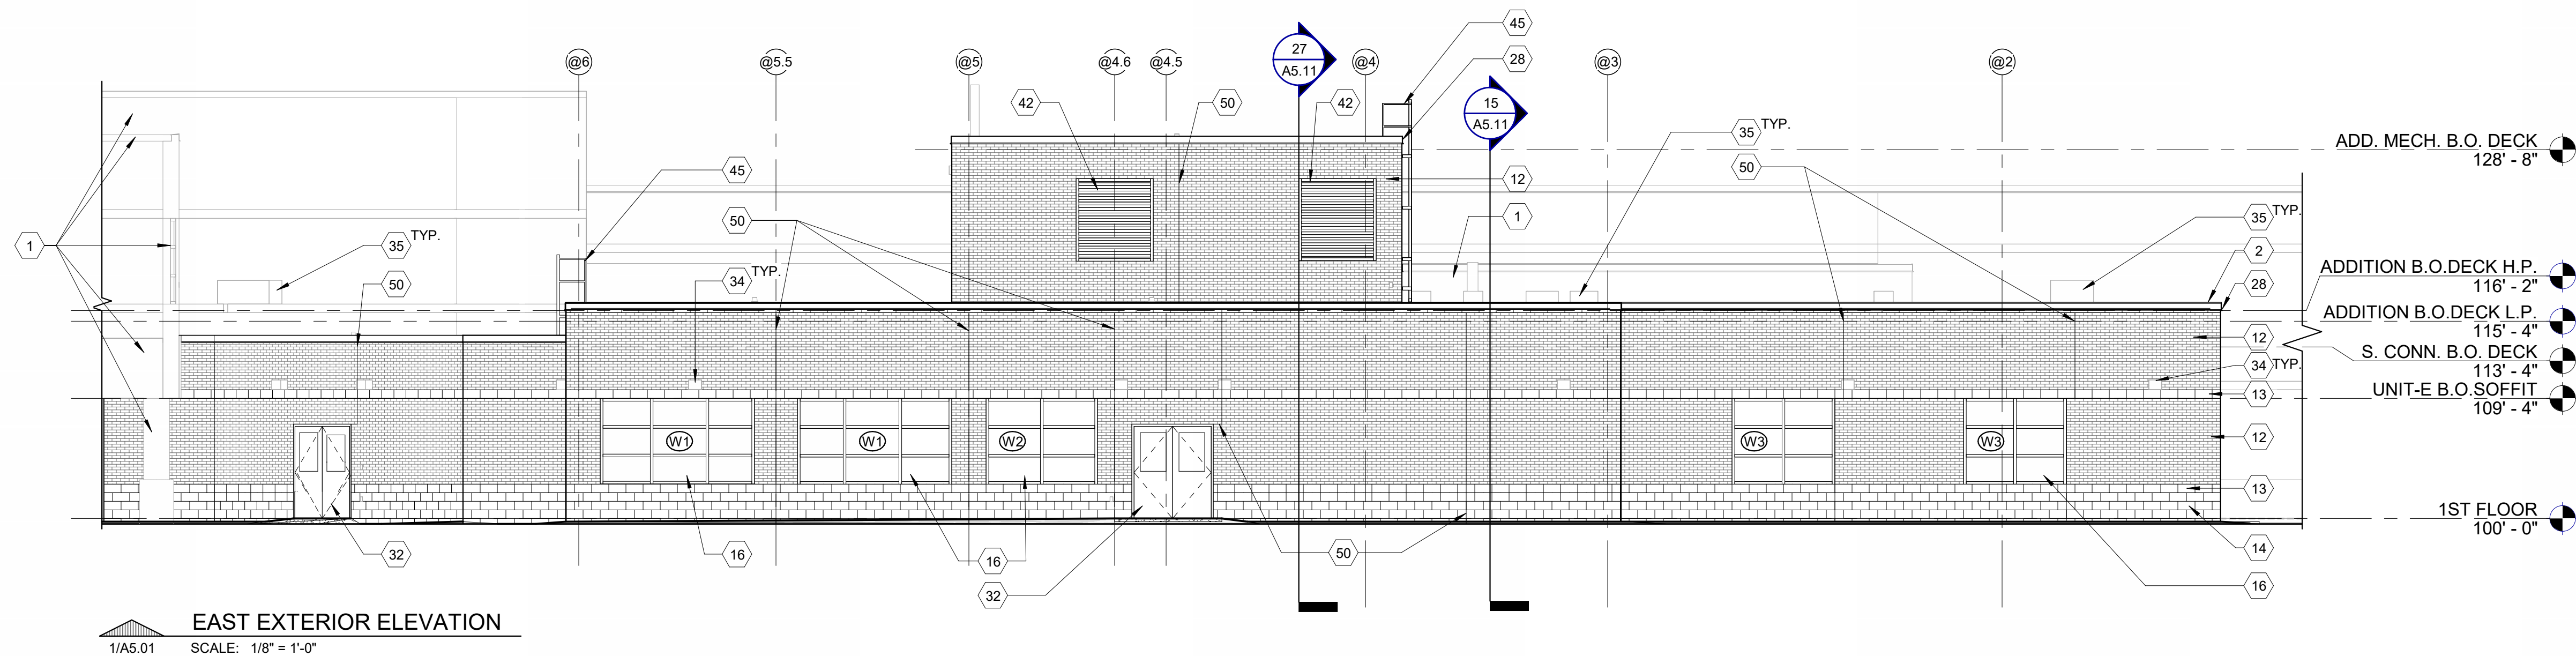


EAST EXTERIOR ELEVATION
1/A5.01 SCALE: 1/8" = 1'-0"

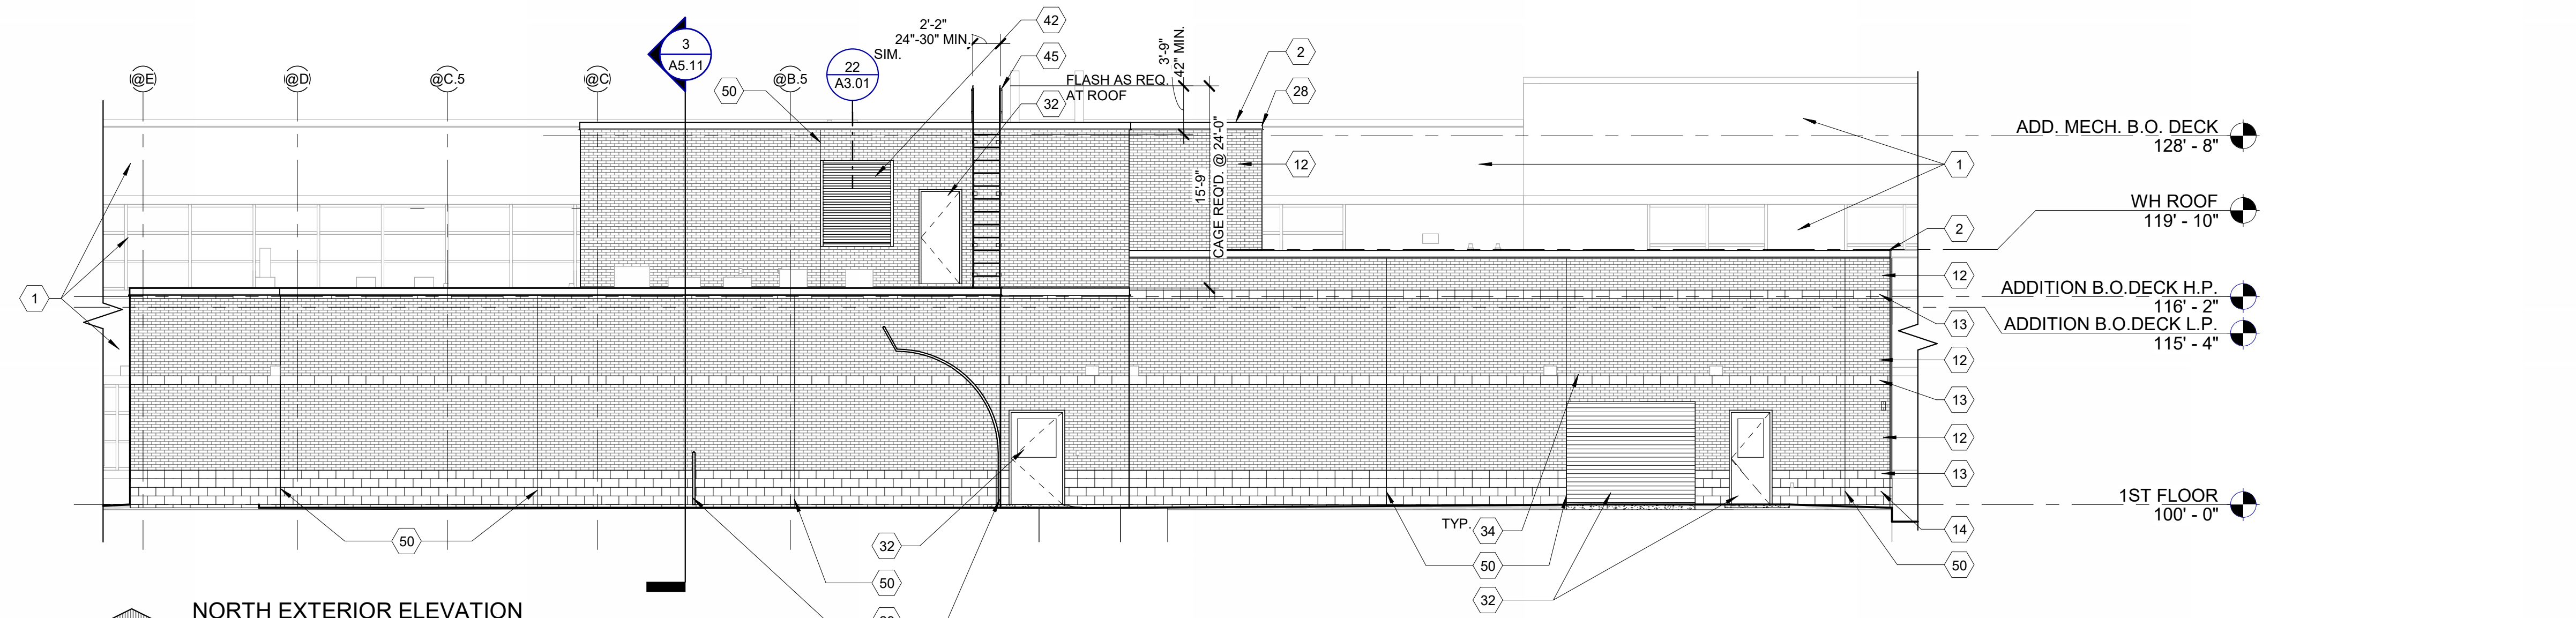


NORTH EXTERIOR ELEVATION
7/A5.01 SCALE: 1/8" = 1'-0"

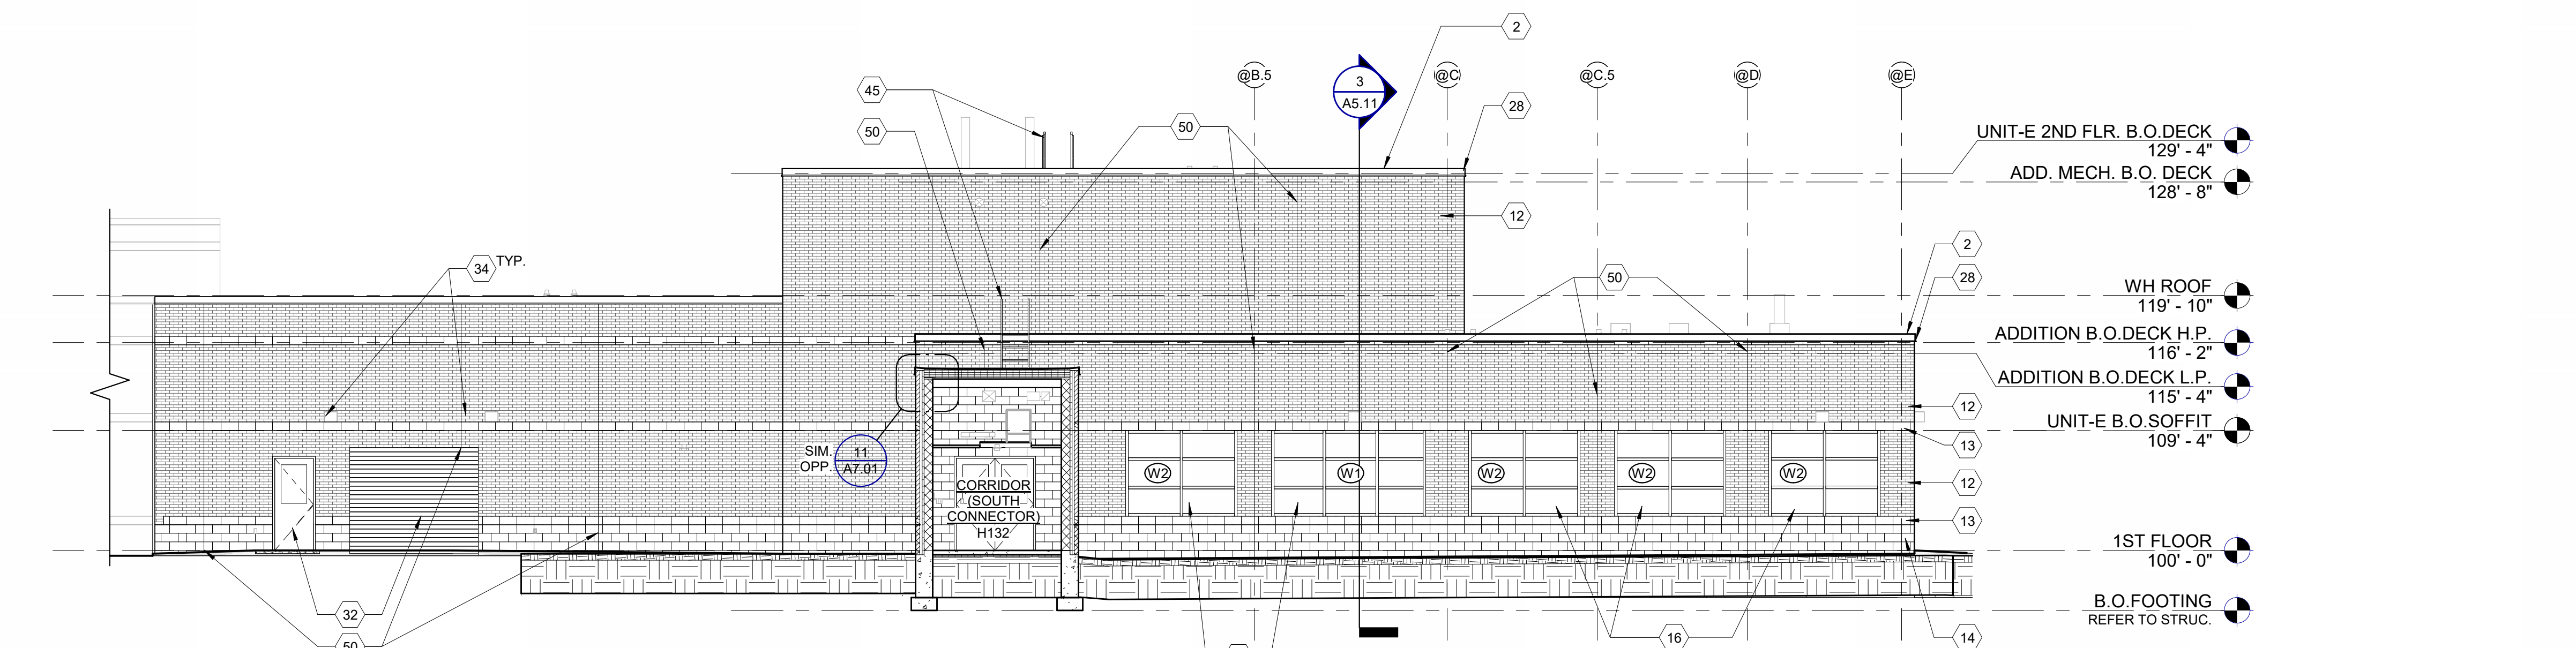


SOUTH EXTERIOR ELEVATION
19/A5.01 SCALE: 1/8" = 1'-0"

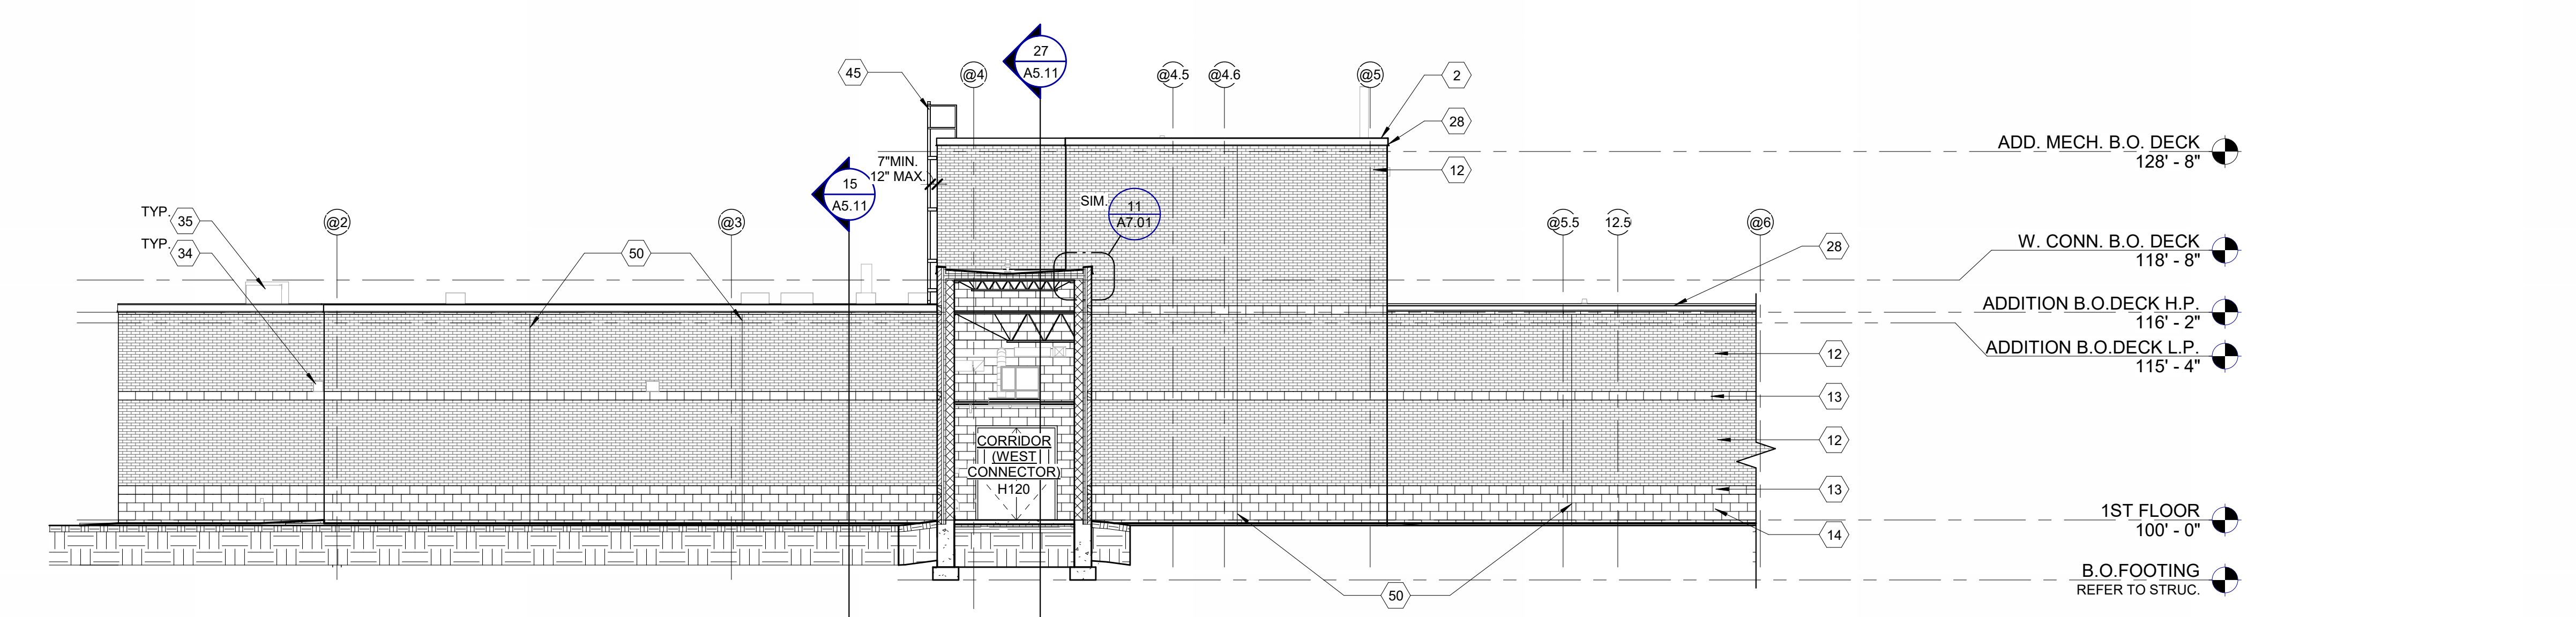

WEST EXTERIOR ELEVATION
25/A5.01 SCALE: 1/8" = 1'-0"

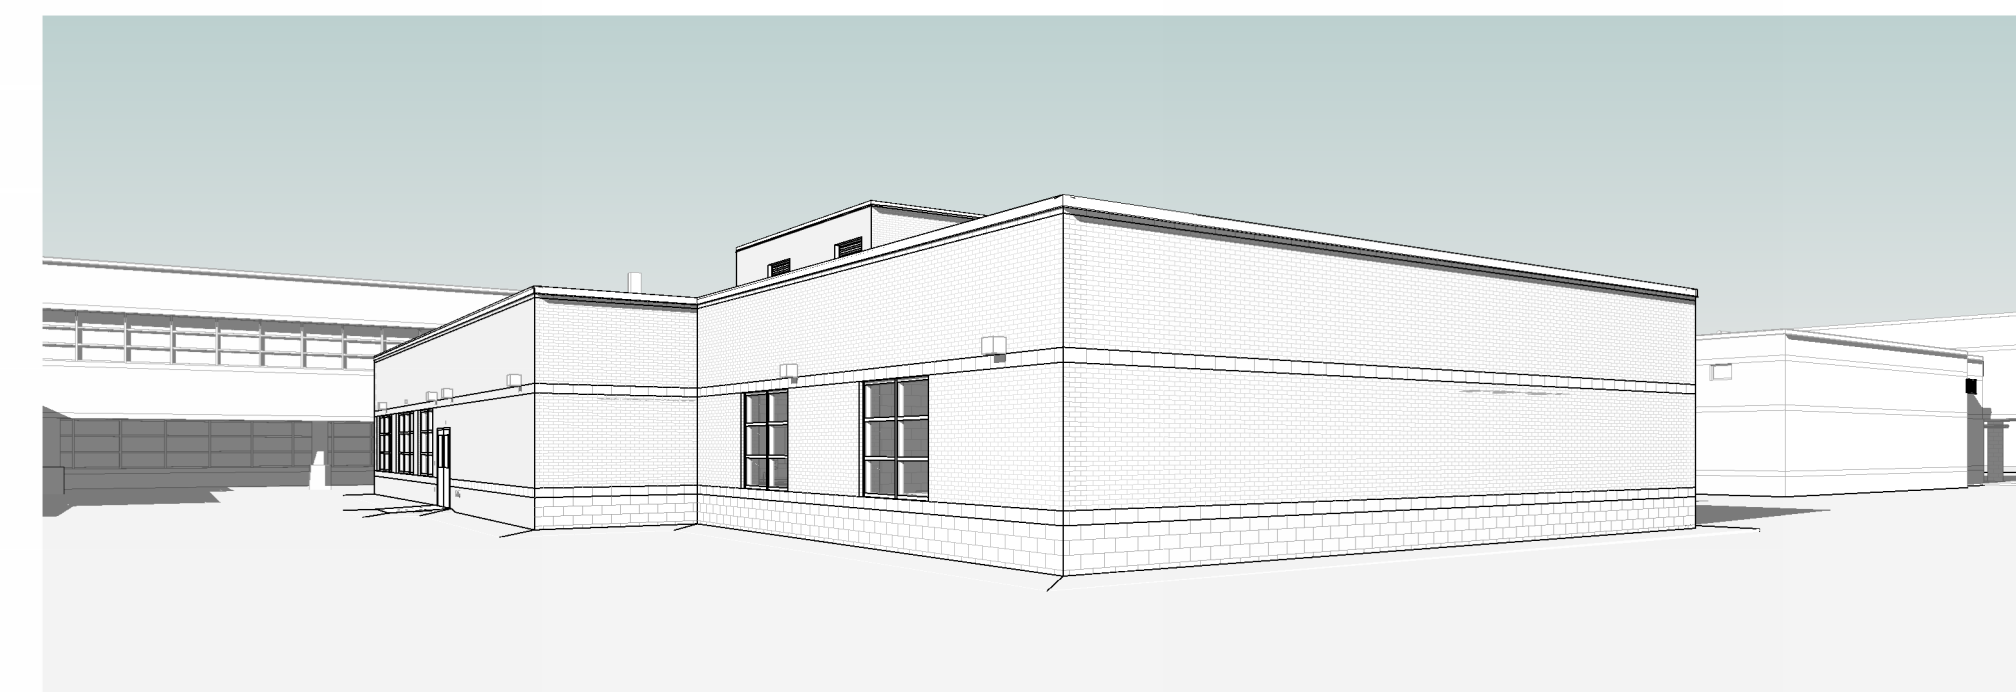

PERSPECTIVE VIEW - NORTHEAST ELEVATION

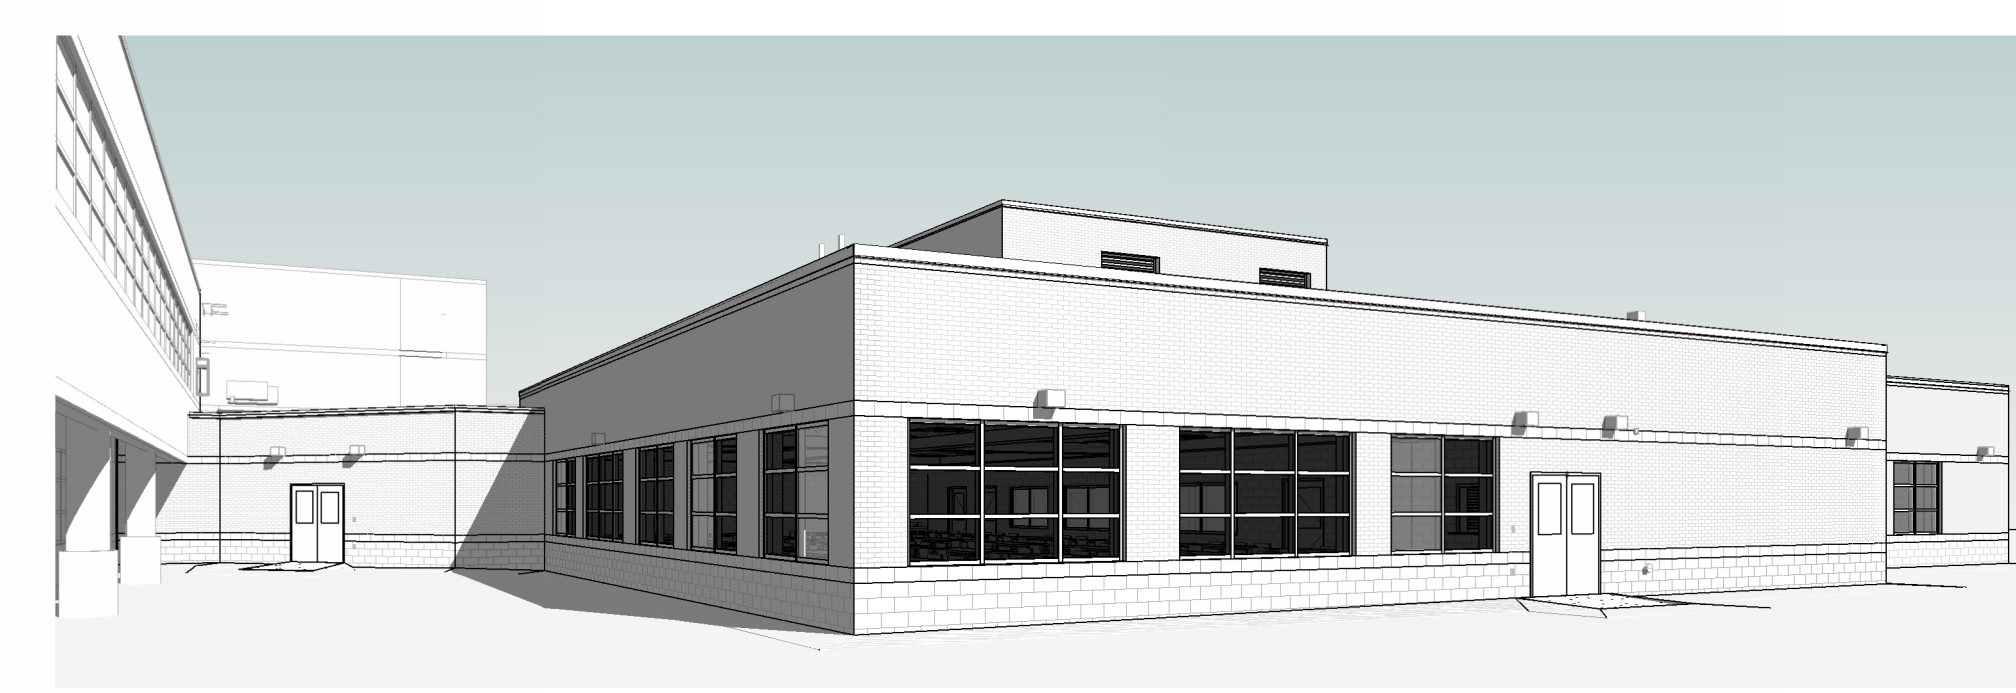

PERSPECTIVE VIEW - SOUTHEAST VIEW

MATERIAL KEYNOTES


- 1 EXISTING TO REMAIN
- 2 FULLY ADHEARED SINGLE PLY MEMBRANE ROOFING
- 3 3/4" ROOFING BOARD
- 4 RIDGID ROOF INSULATION R-30
- 5 METAL DECK (REFER TO STRUCTURAL)
- 6 2x PRESSURE TREATED WOOD BLOCKING
- 7 SPRAY INSULATION IN METAL DECK FLUTES TO ALLOW FOR CONTINUOUS INSULATION
- 8 STEEL LINTEL - EXTERIOR STEEL LINTELS TO BE GALVANIZED - PAINT (REFER TO STRUCTURAL)
- 9 GROUT SOLID
- 10 THRU WALL FLASHING
- 11 MORTAR NET
- 12 FACE BRICK - MATCH EXISTING
- 13 8x24 BURNISHED BLOCK ACCENT BAND - MATCH EXISTING
- 14 8x24 SPLIT FACE BLOCK WAINGSCOT - MATCH EXISTING
- 15 SEALANT OVER BACKER ROD EXTERIOR / CAULK INTERIOR - TYPICAL AT ALL WINDOWS AND DOORS
- 16 ALUMINIUM WINDOW SYSTEM WITH INSULATED GLAZING
- 17 BRICK VENT
- 18 BULLNOSE
- 19 BOND BREAK
- 20 4" CONCRETE SLAB ON VAPOR BARRIER (REFER TO STRUCTURAL)
- 21 PERIMETER INSULATION - EXTEND 2'-0" IN BOTH DIRECTIONS
- 22 COMPACTED GRANULAR FILL
- 23 GRADE (REFER TO CIVIL)
- 24 POURED CONCRETE FOUNDATION WALL (REFER TO STRUCTURAL)
- 25 BITUMINOUS DAMPPROOFING
- 26 STEEL COLUMN (REFER TO STRUCTURAL)
- 27 RIGID INSULATION
- 28 CONTINUOUS METAL ROOF EDGE - MATCH EXISTING PROFILE - AT CONNECTION POINTS ALSO MATCH EXISTING HEIGHT (V.I.F.)
- 29 NEW FENCE (REFER TO CIVIL AND ELECTRICAL)
- 30 CONCRETE MASONRY UNIT
- 31 COLD FORMED METAL FRAMING
- 32 DOOR AND FRAME (REFER TO SCHEDULE)
- 33 2" EXPANSION JOINT / CONTROL JOINT AS REQUIRED - FIRE RATE AS REQUIRED (REFER TO CODE PLAN)
- 34 LIGHT FIXTURE (REFER TO ELECTRICAL)
- 35 MECHANICAL ITEM (REFER TO MECHANICAL)
- 36 POURED CONCRETE FOOTING (REFER TO STRUCTURAL)
- 37 STEEL ANGLE (REFER TO STRUCTURAL)
- 38 STEEL TUBE (REFER TO STRUCTURAL)
- 39 STEEL JOIST (REFER TO STRUCTURAL)
- 40 STEEL BEAM (REFER TO STRUCTURAL)
- 41 SUSPENDED CEILING SYSTEM (REFER TO SCHEDULE)
- 42 LOUVER (REFER TO MECHANICAL)
- 43 BOND BEAM WITH (2) #5 CONT. GROUT SOLID (REFER TO STRUCTURAL)
- 44 CMU FOUNDATION WALL (REFER TO STRUCTURAL)
- 45 ROOF LADDER - ATTACH AND FLASH AS REQUIRED PER MANUFACTURER'S RECOMMENDATIONS (REFER TO REFERENCE ONLY DETAIL)
- 46 WALL MOUNTED ELECTRICAL ITEM (REFER TO ELECTRICAL)
- 47 CEILING MOUNTED ELECTRICAL ITEM (REFER TO ELECTRICAL)
- 48 PLUMBING FIXTURE AND ACCESSORIES (REFER TO MECHANICAL & STANDARD MOUNTING HEIGHTS CHART)
- 49 BASE MATERIAL (REFER TO SCHEDULE)
- 50 CONTROL JOINT

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACEL, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

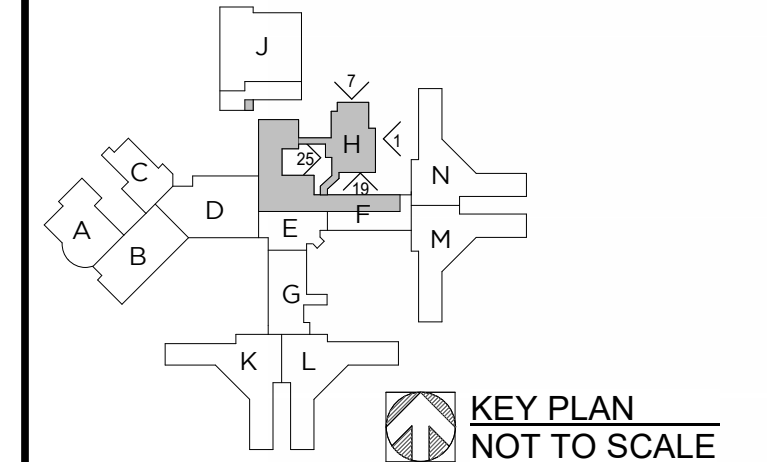

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107 COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN


SHEET TITLE
EXTERIOR ELEVATIONS

PROJECT NUMBER
2021094


PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
C.D.S.


SHEET NUMBER
A5.01

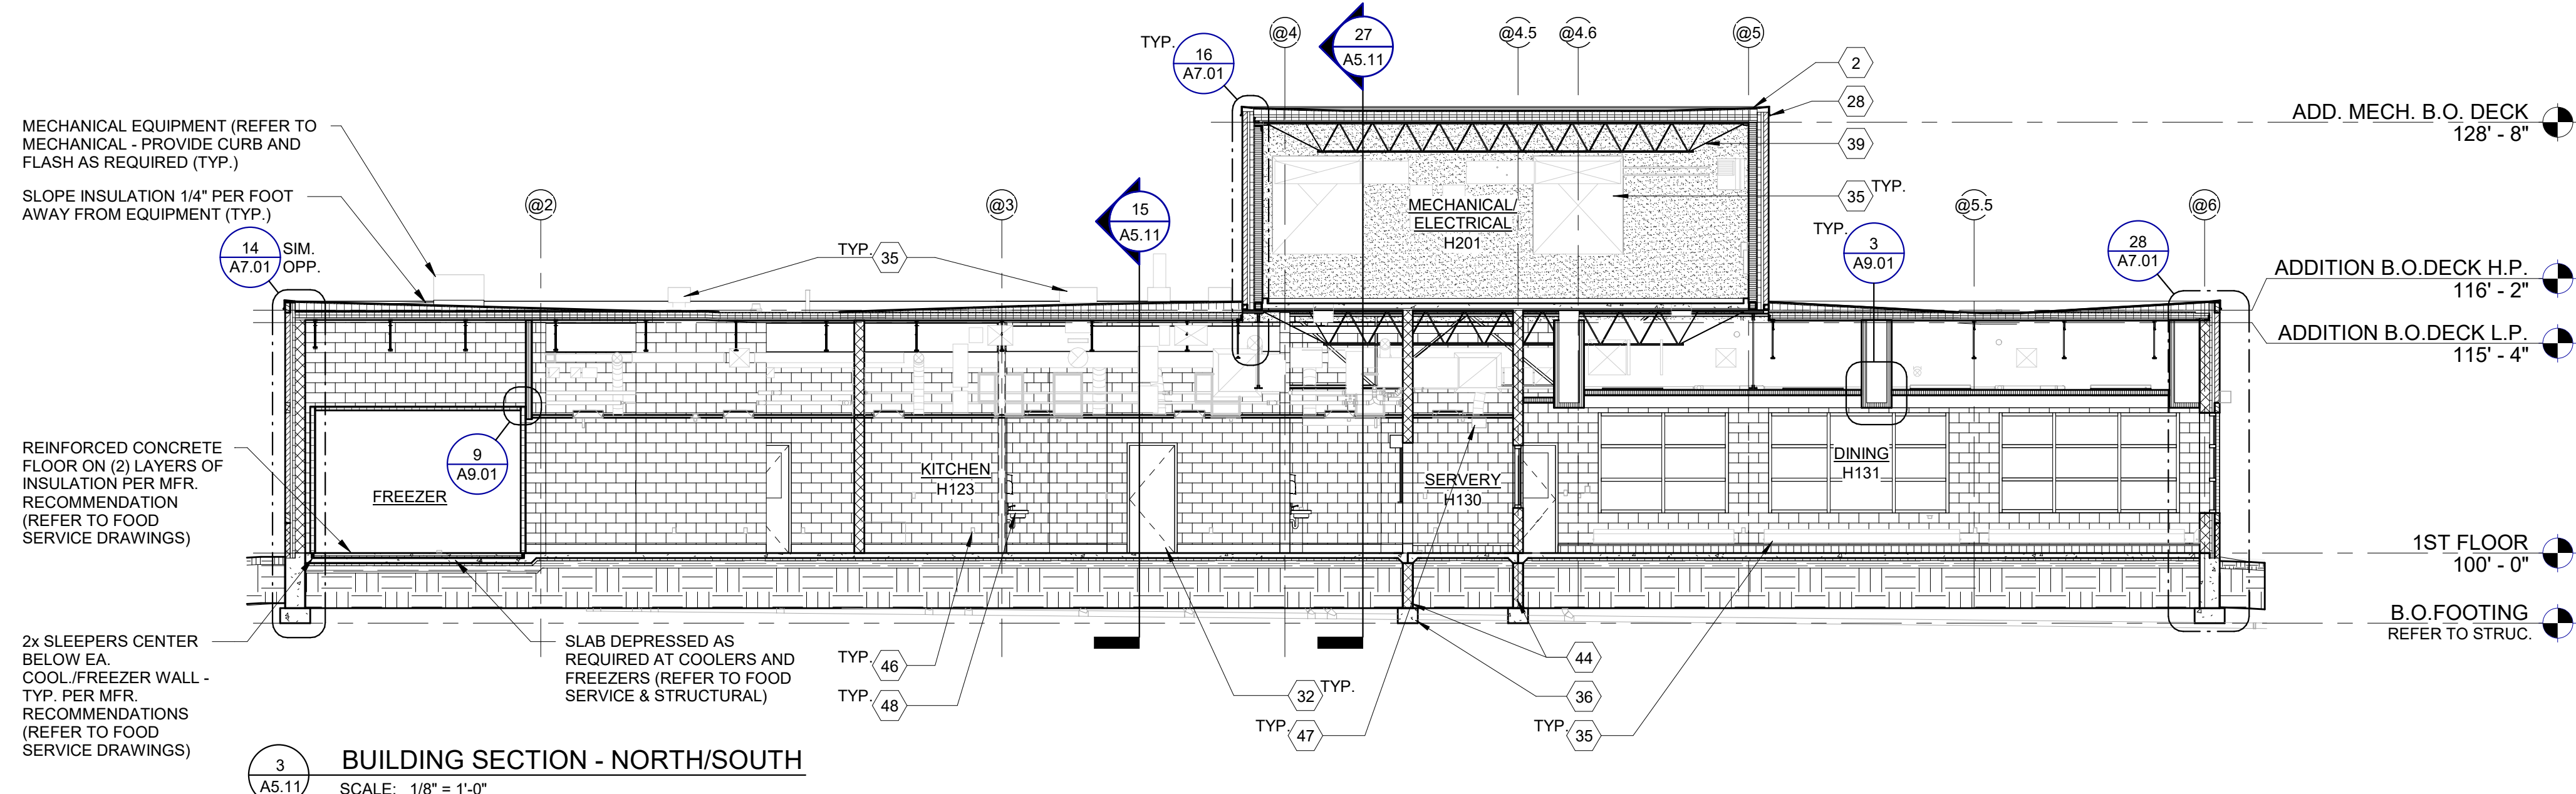

3 BUILDING SECTION - NORTH/SOUTH
SCALE: 1/8" = 1'-0"

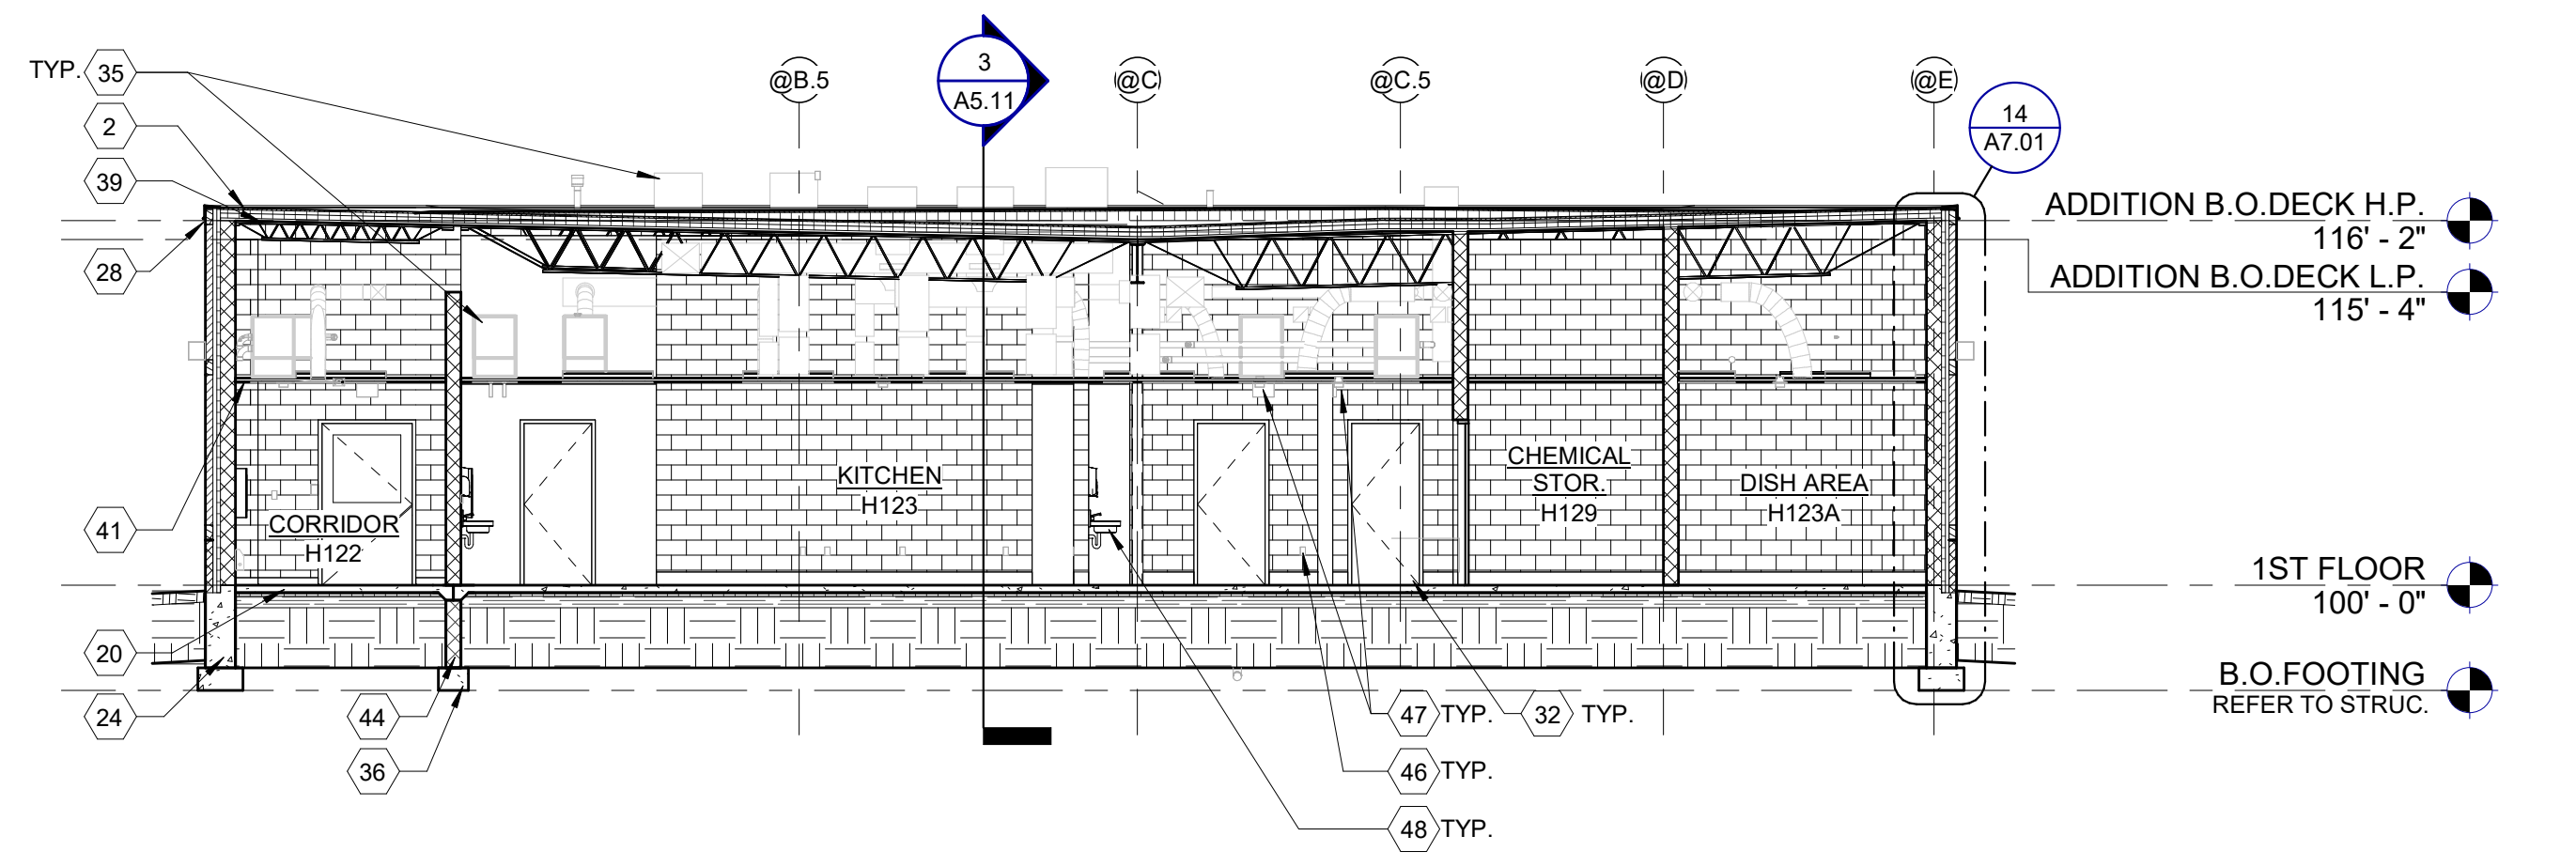

15 BUILDING SECTION - EAST/WEST
SCALE: 1/8" = 1'-0"

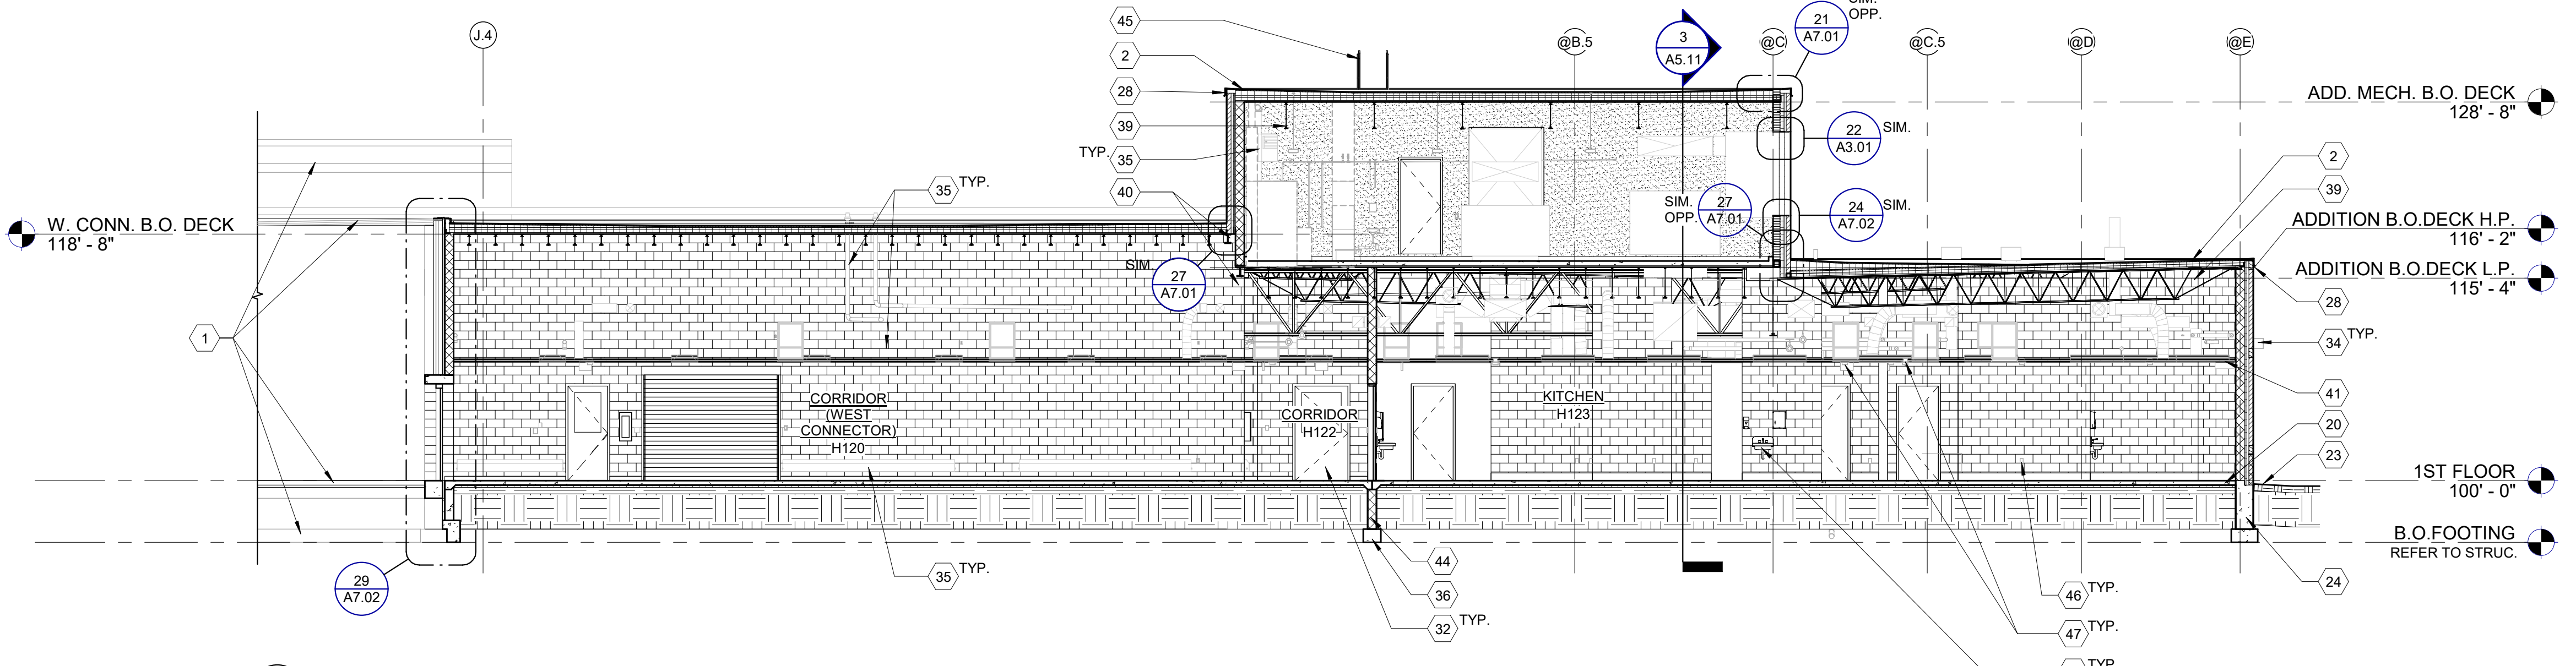

27 BUILDING SECTION - WEST CONNECTOR
SCALE: 1/8" = 1'-0"

- # MATERIAL KEYNOTES
- EXISTING TO REMAIN
 - FULLY ADHERED SINGLE PLY MEMBRANE ROOFING
 - 3/4" ROOFING BOARD
 - RIGID ROOF INSULATION R-30
 - METAL DECK (REFER TO STRUCTURAL)
 - 2x PRESSURE TREATED WOOD BLOCKING
 - SPRAY INSULATION IN METAL DECK FLUTES TO ALLOW FOR CONTINUOUS INSULATION
 - STEEL LINTEL - EXTERIOR STEEL LINTELS TO BE GALVANIZED - PAINT (REFER TO STRUCTURAL)
 - GROUT SOLID
 - MORTAR NET
 - FACE BRICK - MATCH EXISTING
 - 8x24 BURNISHED BLOCK ACCENT BAND - MATCH EXISTING
 - 8x24 SPLIT FACE BLOCK WAINSCOT - MATCH EXISTING
 - SEALANT OVER BACKER ROD EXTERIOR / CAULK INTERIOR - TYPICAL AT ALL WINDOWS AND DOORS
 - ALUMINUM WINDOW SYSTEM WITH INSULATED GLAZING
 - BRICK VENT
 - BULLNOSE
 - BOND BREAK
 - 4" CONCRETE SLAB ON VAPOR BARRIER (REFER TO STRUCTURAL)
 - PERIMETER INSULATION - EXTEND 2'-0" IN BOTH DIRECTIONS
 - COMPACTED GRANULAR FILL
 - GRADE (REFER TO CIVIL)
 - POURED CONCRETE FOUNDATION WALL (REFER TO STRUCTURAL)
 - BITUMINOUS DAMPPROOFING
 - STEEL COLUMN (REFER TO STRUCTURAL)
 - RIGID INSULATION
 - CONTINUOUS METAL ROOF EDGE - MATCH EXISTING PROFILE - AT CONNECTION POINTS ALSO MATCH EXISTING HEIGHT (V.I.F.)
 - NEW FENCE (REFER TO CIVIL AND ELECTRICAL)
 - CONCRETE MASONRY UNIT
 - COLD FORMED METAL FRAMING
 - DOOR AND FRAME (REFER TO SCHEDULE)
 - 2" EXPANSION JOINT / CONTROL JOINT AS REQUIRED - FIRE RATE AS REQUIRED (REFER TO CODE PLAN)
 - LIGHT FIXTURE (REFER TO ELECTRICAL)
 - MECHANICAL ITEM (REFER TO MECHANICAL)
 - POURED CONCRETE FOOTING (REFER TO STRUCTURAL)
 - STEEL ANGLE (REFER TO STRUCTURAL)
 - STEEL TUBE (REFER TO STRUCTURAL)
 - STEEL JOIST (REFER TO STRUCTURAL)
 - STEEL BEAM (REFER TO STRUCTURAL)
 - SUSPENDED CEILING SYSTEM (REFER TO SCHEDULE)
 - LOUVER (REFER TO MECHANICAL)
 - BOND BEAM WITH (2) #5 CONT. GROUT SOLID (REFER TO STRUCTURAL)
 - CMU FOUNDATION WALL (REFER TO STRUCTURAL)
 - ROOF LADDER - ATTACH AND FLASH AS REQUIRED PER MANUFACTURER'S RECOMMENDATIONS (REFER TO REFERENCE ONLY DETAIL)
 - WALL MOUNTED ELECTRICAL ITEM (REFER TO ELECTRICAL)
 - CEILING MOUNTED ELECTRICAL ITEM (REFER TO ELECTRICAL)
 - PLUMBING FIXTURE AND ACCESSORIES (REFER TO MECHANICAL & STANDARD MOUNTING HEIGHTS CHART)
 - BASE MATERIAL (REFER TO SCHEDULE)
 - CONTROL JOINT

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACEL, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107 COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN


SHEET TITLE
BUILDING SECTIONS

PROJECT NUMBER
2021094

PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
C.D.S.

SHEET NUMBER
A5.11

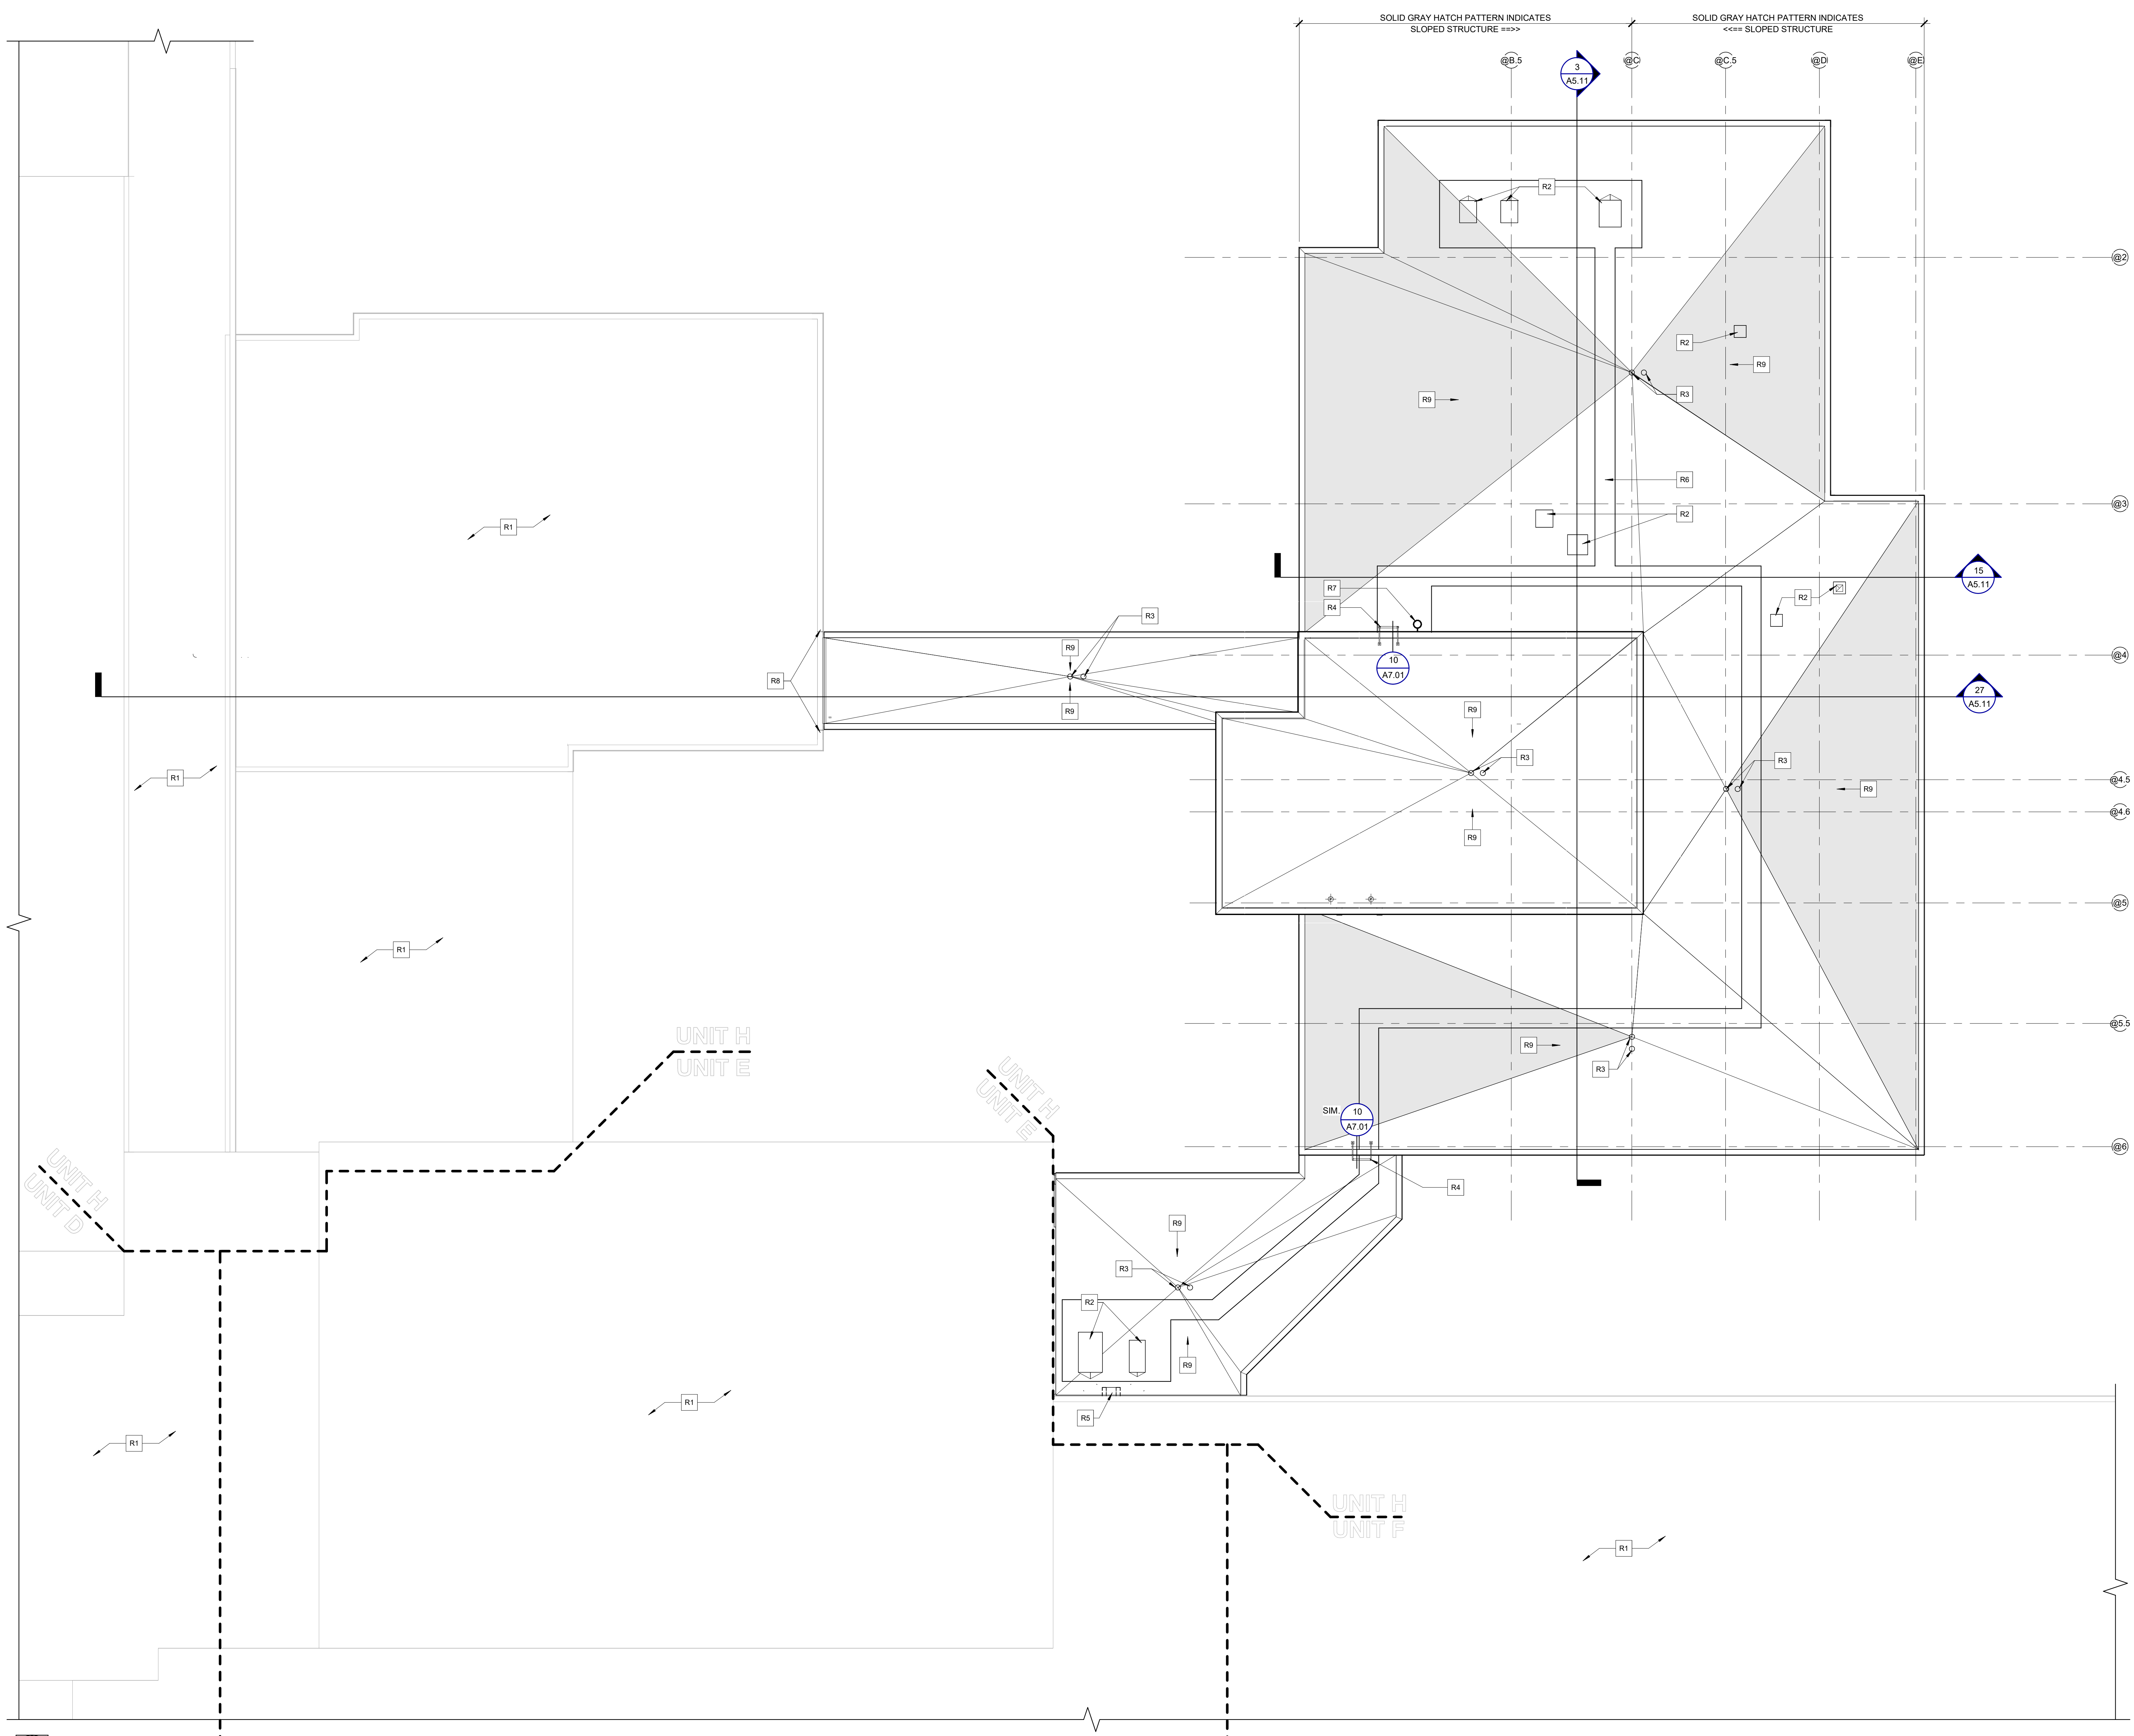

ROOF PLAN GENERAL NOTES:

1. PROVIDE FLASHING PER MANUFACTURERS RECOMMENDATIONS AT WALLS, ROOF PENETRATIONS (MECHANICAL AND ELECTRICAL), ROOF EDGES, ETC.
2. MECHANICAL AND ELECTRICAL EQUIPMENT SHOWN REFERENCE ONLY. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR EXACT QUANTITIES AND LOCATIONS OF ALL MECHANICAL AND ELECTRICAL EQUIPMENT, ROOF PENETRATIONS, VENTS THROUGH THE ROOF, ETC.
3. ALL ROOFING WORK, INCLUDING MEMBRANE ROOF FLASHING, ETC. SHALL BE PERFORMED BY ONE ROOFING CONTRACTOR TO LIMIT WARRANTY RESPONSIBILITY. REFER TO SPECIFICATIONS FOR FURTHER REQUIREMENTS.
4. ALL EXISTING ROOF WARRANTIES MUST BE MAINTAINED AT CONNECTION POINTS.

ROOF PLAN KEYNOTE


- R1 EXISTING TO REMAIN.
- R2 MECHANICAL EQUIPMENT (REFER TO MECHANICAL) - PROVIDE CURB AND FLASHING AS REQUIRED PER MANUFACTURERS RECOMMENDATIONS
- R3 ROOF DRAIN w/ OVERFLOW (REFER TO MECHANICAL)
- R4 ROOF LADDER - ATTACH AND FLASH AS REQUIRED - REFER TO DETAIL FOR REFERENCE
- R5 MECHANICAL EQUIPMENT (REFER TO MECHANICAL)
- R6 PROVIDE ROOF WALKING PADS - AS SHOWN TO ALL EQUIPMENT REQUIRING ROUTINE MAINTENANCE - VERIFY LOCATIONS WITH OWNER PRIOR TO INSTALLATION.
- R7 LIGHT FIXTURE (REFER TO MECHANICAL)
- R8 PATCH & REPAIR EXISTING ROOF AND FASCIA AT NEW ROOF CONNECTION - FLASH AS REQUIRED
- R9 SLOPE 1/4" PER FOOT TOWARD ROOF DRAIN - HATCHED AREAS UTILIZE SLOPED STRUCTURE - REMAINING AREAS UTILIZE SLOPED INSULATION (REFER TO BUILDING SECTIONS & STRUCTURAL).

NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACR, R.A. DIRECTOR

FILE NO.
 491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

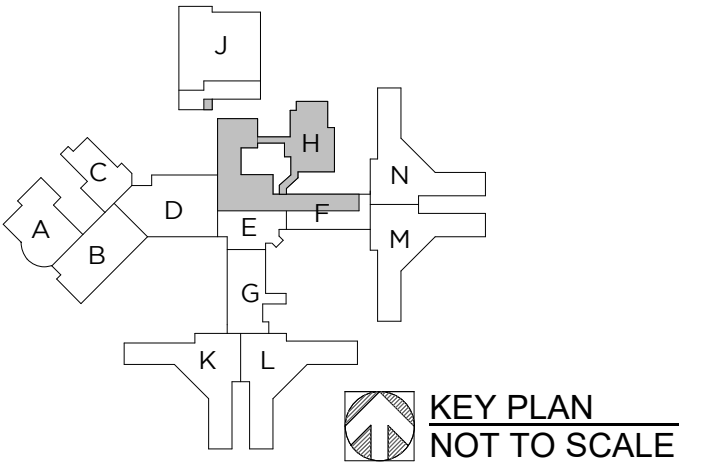

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
 Saginaw, Michigan 48607
 989 752 8107 COPYRIGHT © 2023

PROJECT TITLE
 491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
 PSYCHIATRY - CREATE
 KITCHEN**
 SALINE, MICHIGAN

SHEET TITLE
ROOF PLAN

PROJECT NUMBER
2021094

PROJECT DATE
 SEPTEMBER 6, 2023

CHECKED BY
 C.D.S.

SHEET NUMBER
A6.01


ROOF PLAN
 NORTH SCALE: 1/8" = 1'-0"

NOTE: WALL TYPES ARE INDICATED W/ A DIAMOND AND A NUMBER - REFER TO A0.01 FOR DESCRIPTION OF WALL TYPES


NOTE: ALL EXISTING ROOF WARRANTIES MUST BE MAINTAINED AT CONNECTION POINTS

MATERIAL KEYNOTES


- 1 EXISTING TO REMAIN
- 2 FULLY ADHERED SINGLE PLY MEMBRANE ROOFING
- 3 3/4" ROOFING BOARD
- 4 RIGID ROOF INSULATION R-30
- 5 METAL DECK (REFER TO STRUCTURAL)
- 6 2x PRESSURE TREATED WOOD BLOCKING
- 7 SPRAY INSULATION IN METAL DECK FLUTES TO ALLOW FOR CONTINUOUS INSULATION
- 8 STEEL LINTEL - EXTERIOR STEEL LINTELS TO BE GALVANIZED - PAINT (REFER TO STRUCTURAL)
- 9 GROUT SOLID
- 10 THRU WALL FLASHING
- 11 MORTAR NET
- 12 FACE BRICK - MATCH EXISTING
- 13 8x24 BURNISHED BLOCK ACCENT BAND - MATCH EXISTING
- 14 8x24 SPLIT FACE BLOCK WAINSCOT - MATCH EXISTING
- 15 SEALANT OVER BACKER ROD EXTERIOR / CAULK INTERIOR - TYPICAL AT ALL WINDOWS AND DOORS
- 16 ALUMINUM WINDOW SYSTEM WITH INSULATED GLAZING
- 17 BRICK VENT
- 18 BULLNOSE
- 19 BOND BREAK
- 20 4" CONCRETE SLAB ON VAPOR BARRIER (REFER TO STRUCTURAL)
- 21 PERIMETER INSULATION - EXTEND 2'-0" IN BOTH DIRECTIONS
- 22 COMPACTED GRANULAR FILL
- 23 GRADE (REFER TO CIVIL)
- 24 POURED CONCRETE FOUNDATION WALL (REFER TO STRUCTURAL)
- 25 BITUMINOUS DAMPPROOFING
- 26 STEEL COLUMN (REFER TO STRUCTURAL)
- 27 RIGID INSULATION
- 28 CONTINUOUS METAL ROOF EDGE - MATCH EXISTING PROFILE - AT CONNECTION POINTS ALSO MATCH EXISTING HEIGHT (V.I.F.)
- 29 NEW FENCE (REFER TO CIVIL AND ELECTRICAL)
- 30 CONCRETE MASONRY UNIT
- 31 COLD FORMED METAL FRAMING
- 32 DOOR AND FRAME (REFER TO SCHEDULE)
- 33 2" EXPANSION JOINT / CONTROL JOINT AS REQUIRED - FIRE RATE AS REQUIRED (REFER TO CODE PLAN)
- 34 LIGHT FIXTURE (REFER TO ELECTRICAL)
- 35 MECHANICAL ITEM (REFER TO MECHANICAL)
- 36 POURED CONCRETE FOOTING (REFER TO STRUCTURAL)
- 37 STEEL ANGLE (REFER TO STRUCTURAL)
- 38 STEEL TUBE (REFER TO STRUCTURAL)
- 39 STEEL JOIST (REFER TO STRUCTURAL)
- 40 STEEL BEAM (REFER TO STRUCTURAL)
- 41 SUSPENDED CEILING SYSTEM (REFER TO SCHEDULE)
- 42 LOUVER (REFER TO MECHANICAL)
- 43 BOND BEAM WITH (2) #5 CONT. GROUT SOLID (REFER TO STRUCTURAL)
- 44 CMU FOUNDATION WALL (REFER TO STRUCTURAL)
- 45 ROOF LADDER - ATTACH AND FLASH AS REQUIRED PER MANUFACTURER'S RECOMMENDATIONS (REFER TO REFERENCE ONLY DETAIL)
- 46 WALL MOUNTED ELECTRICAL ITEM (REFER TO ELECTRICAL)
- 47 CEILING MOUNTED ELECTRICAL ITEM (REFER TO ELECTRICAL)
- 48 PLUMBING FIXTURE AND ACCESSORIES (REFER TO MECHANICAL & STANDARD MOUNTING HEIGHTS CHART)
- 49 BASE MATERIAL (REFER TO SCHEDULE)
- 50 CONTROL JOINT

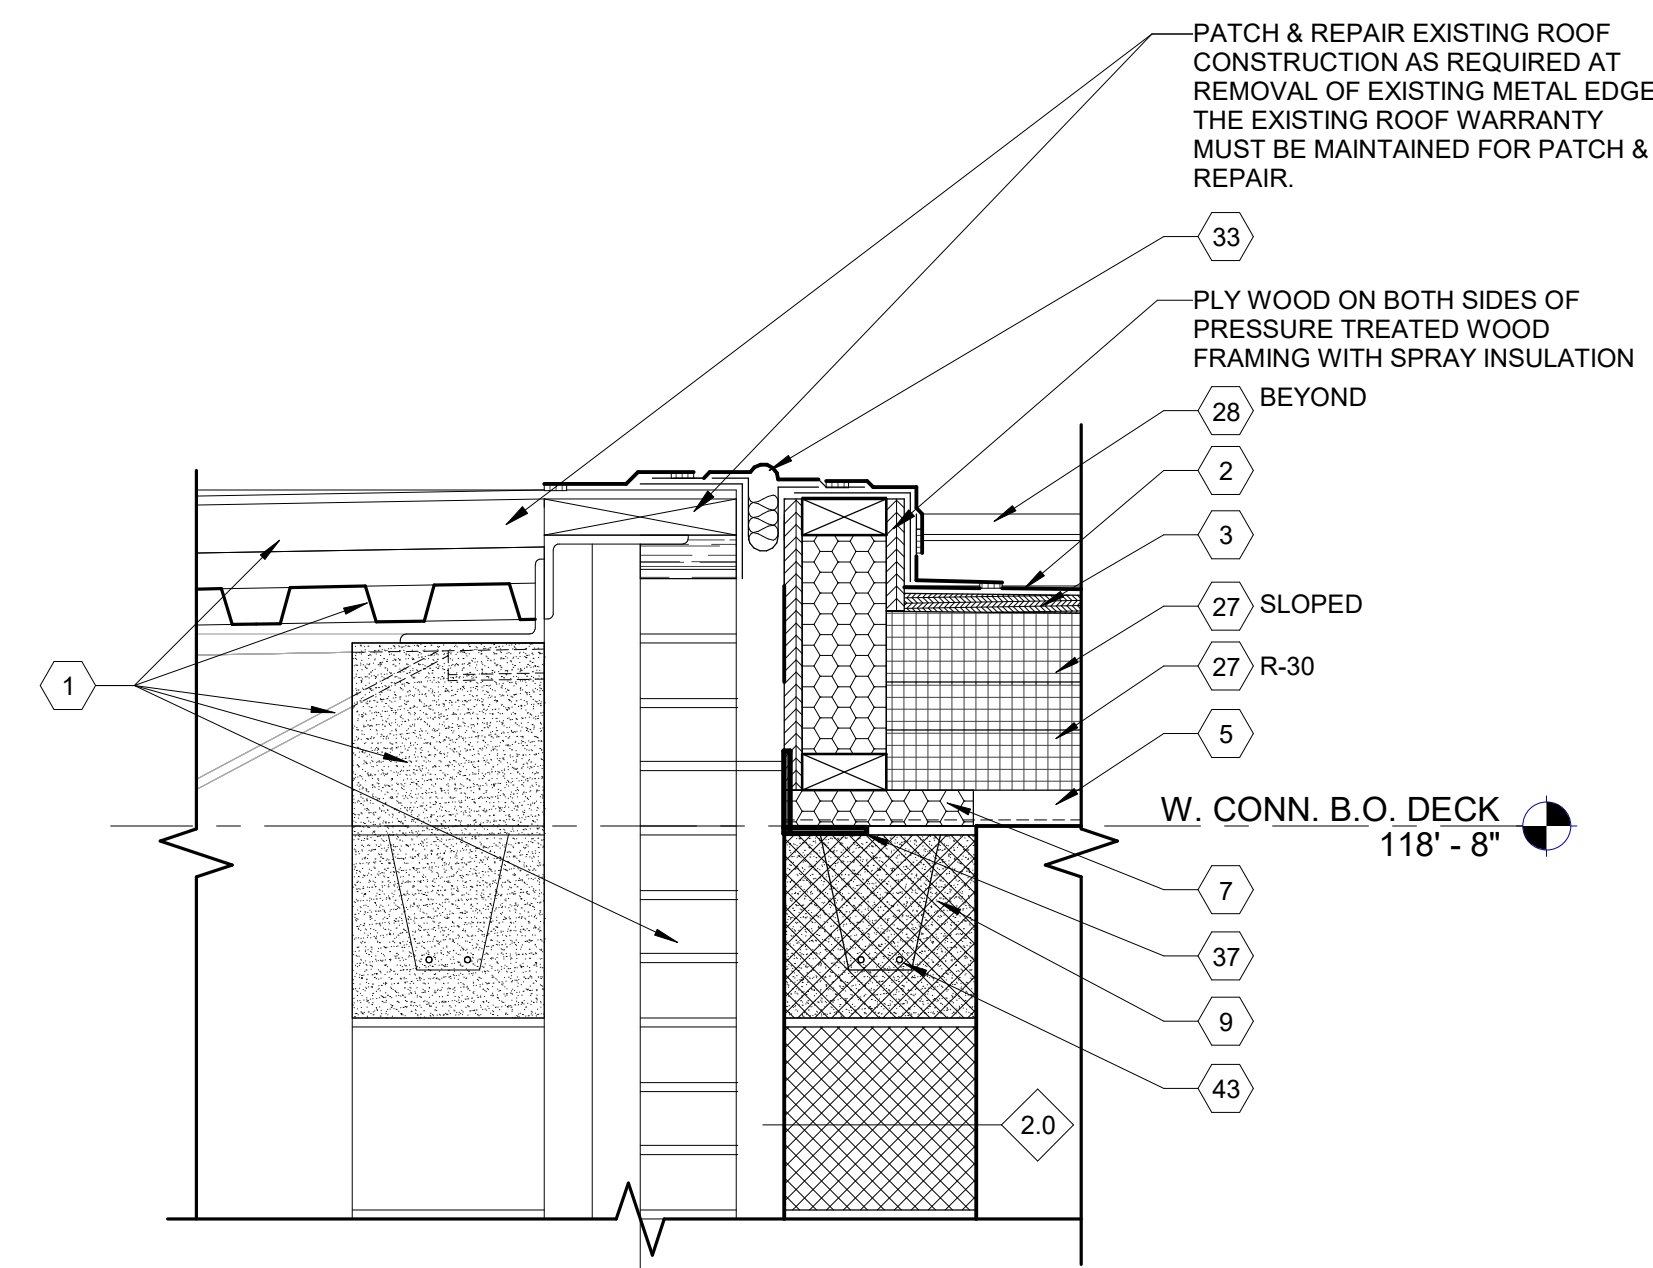


18 ROOF DETAIL
SCALE: 1 1/2" = 1'-0"

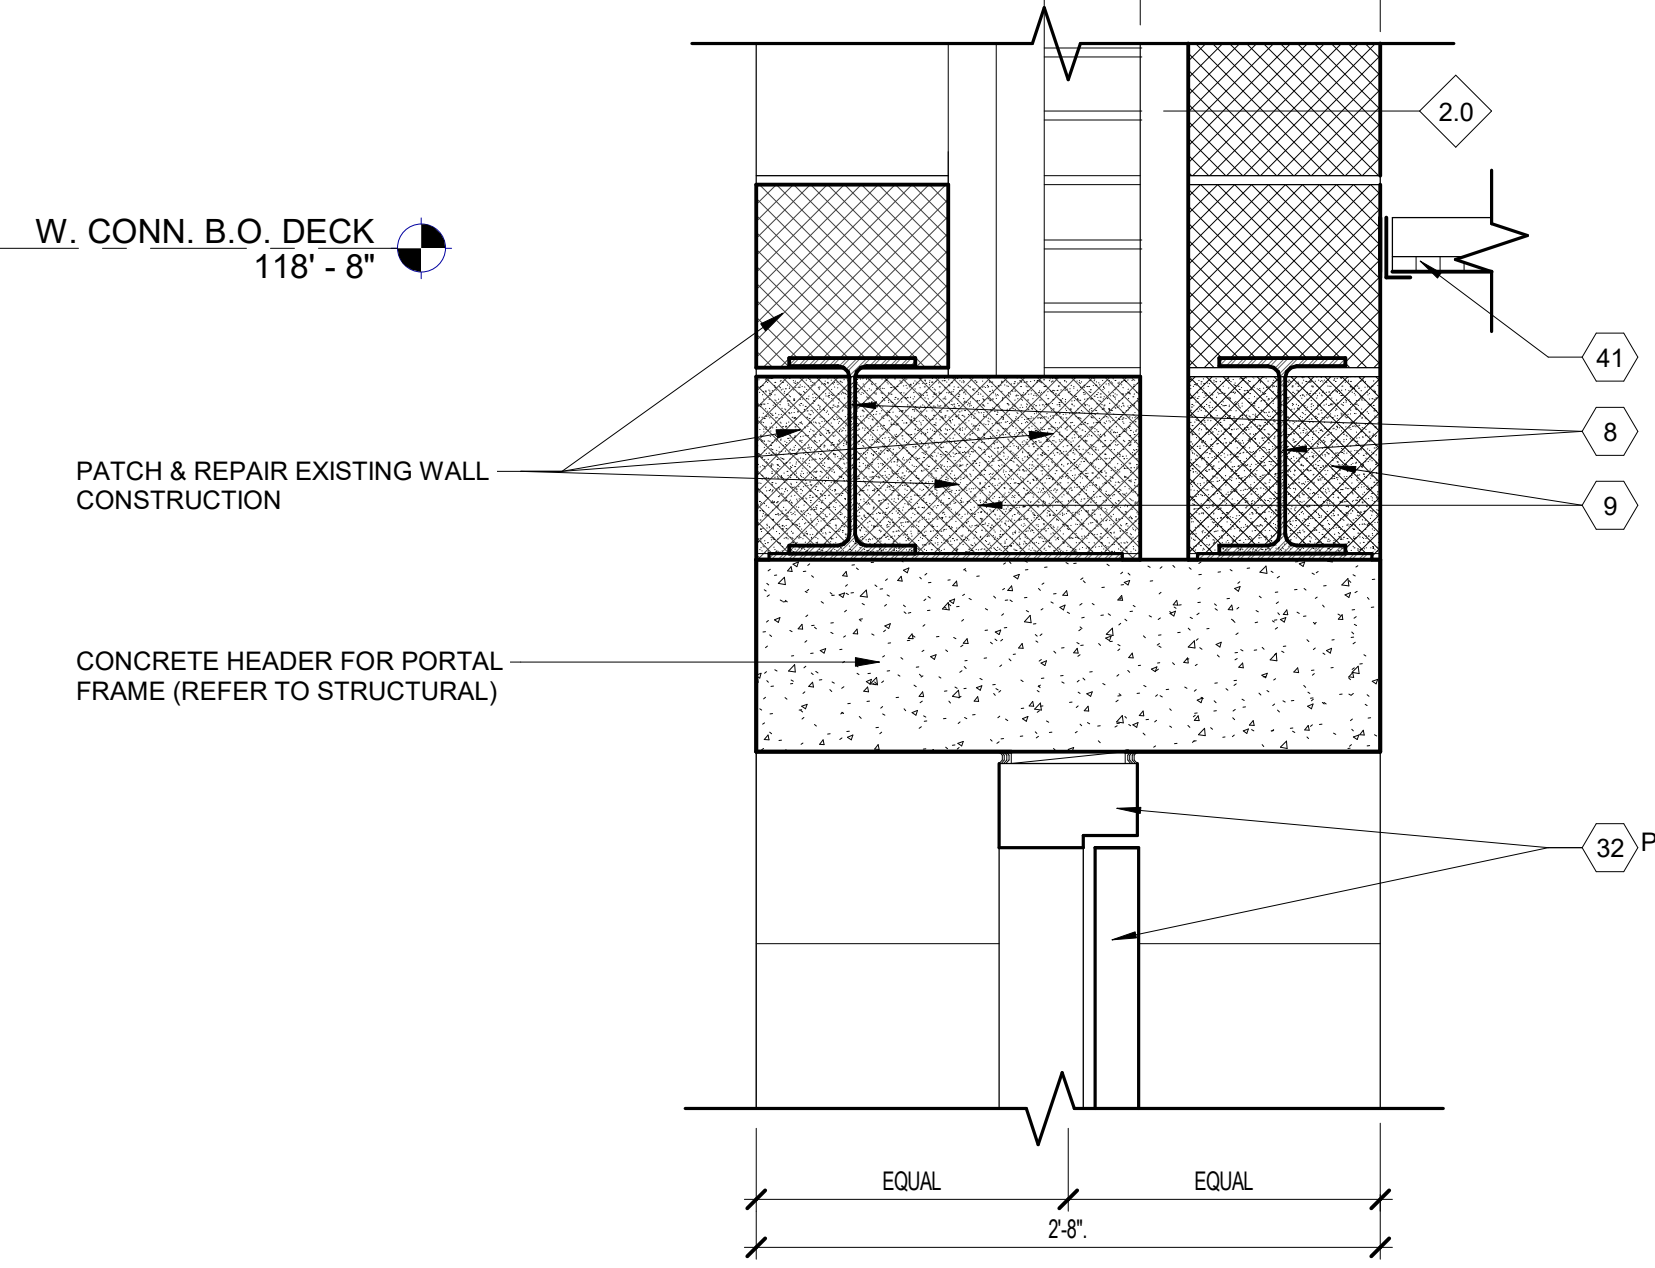


24 HEAD DETAIL
SCALE: 1 1/2" = 1'-0"

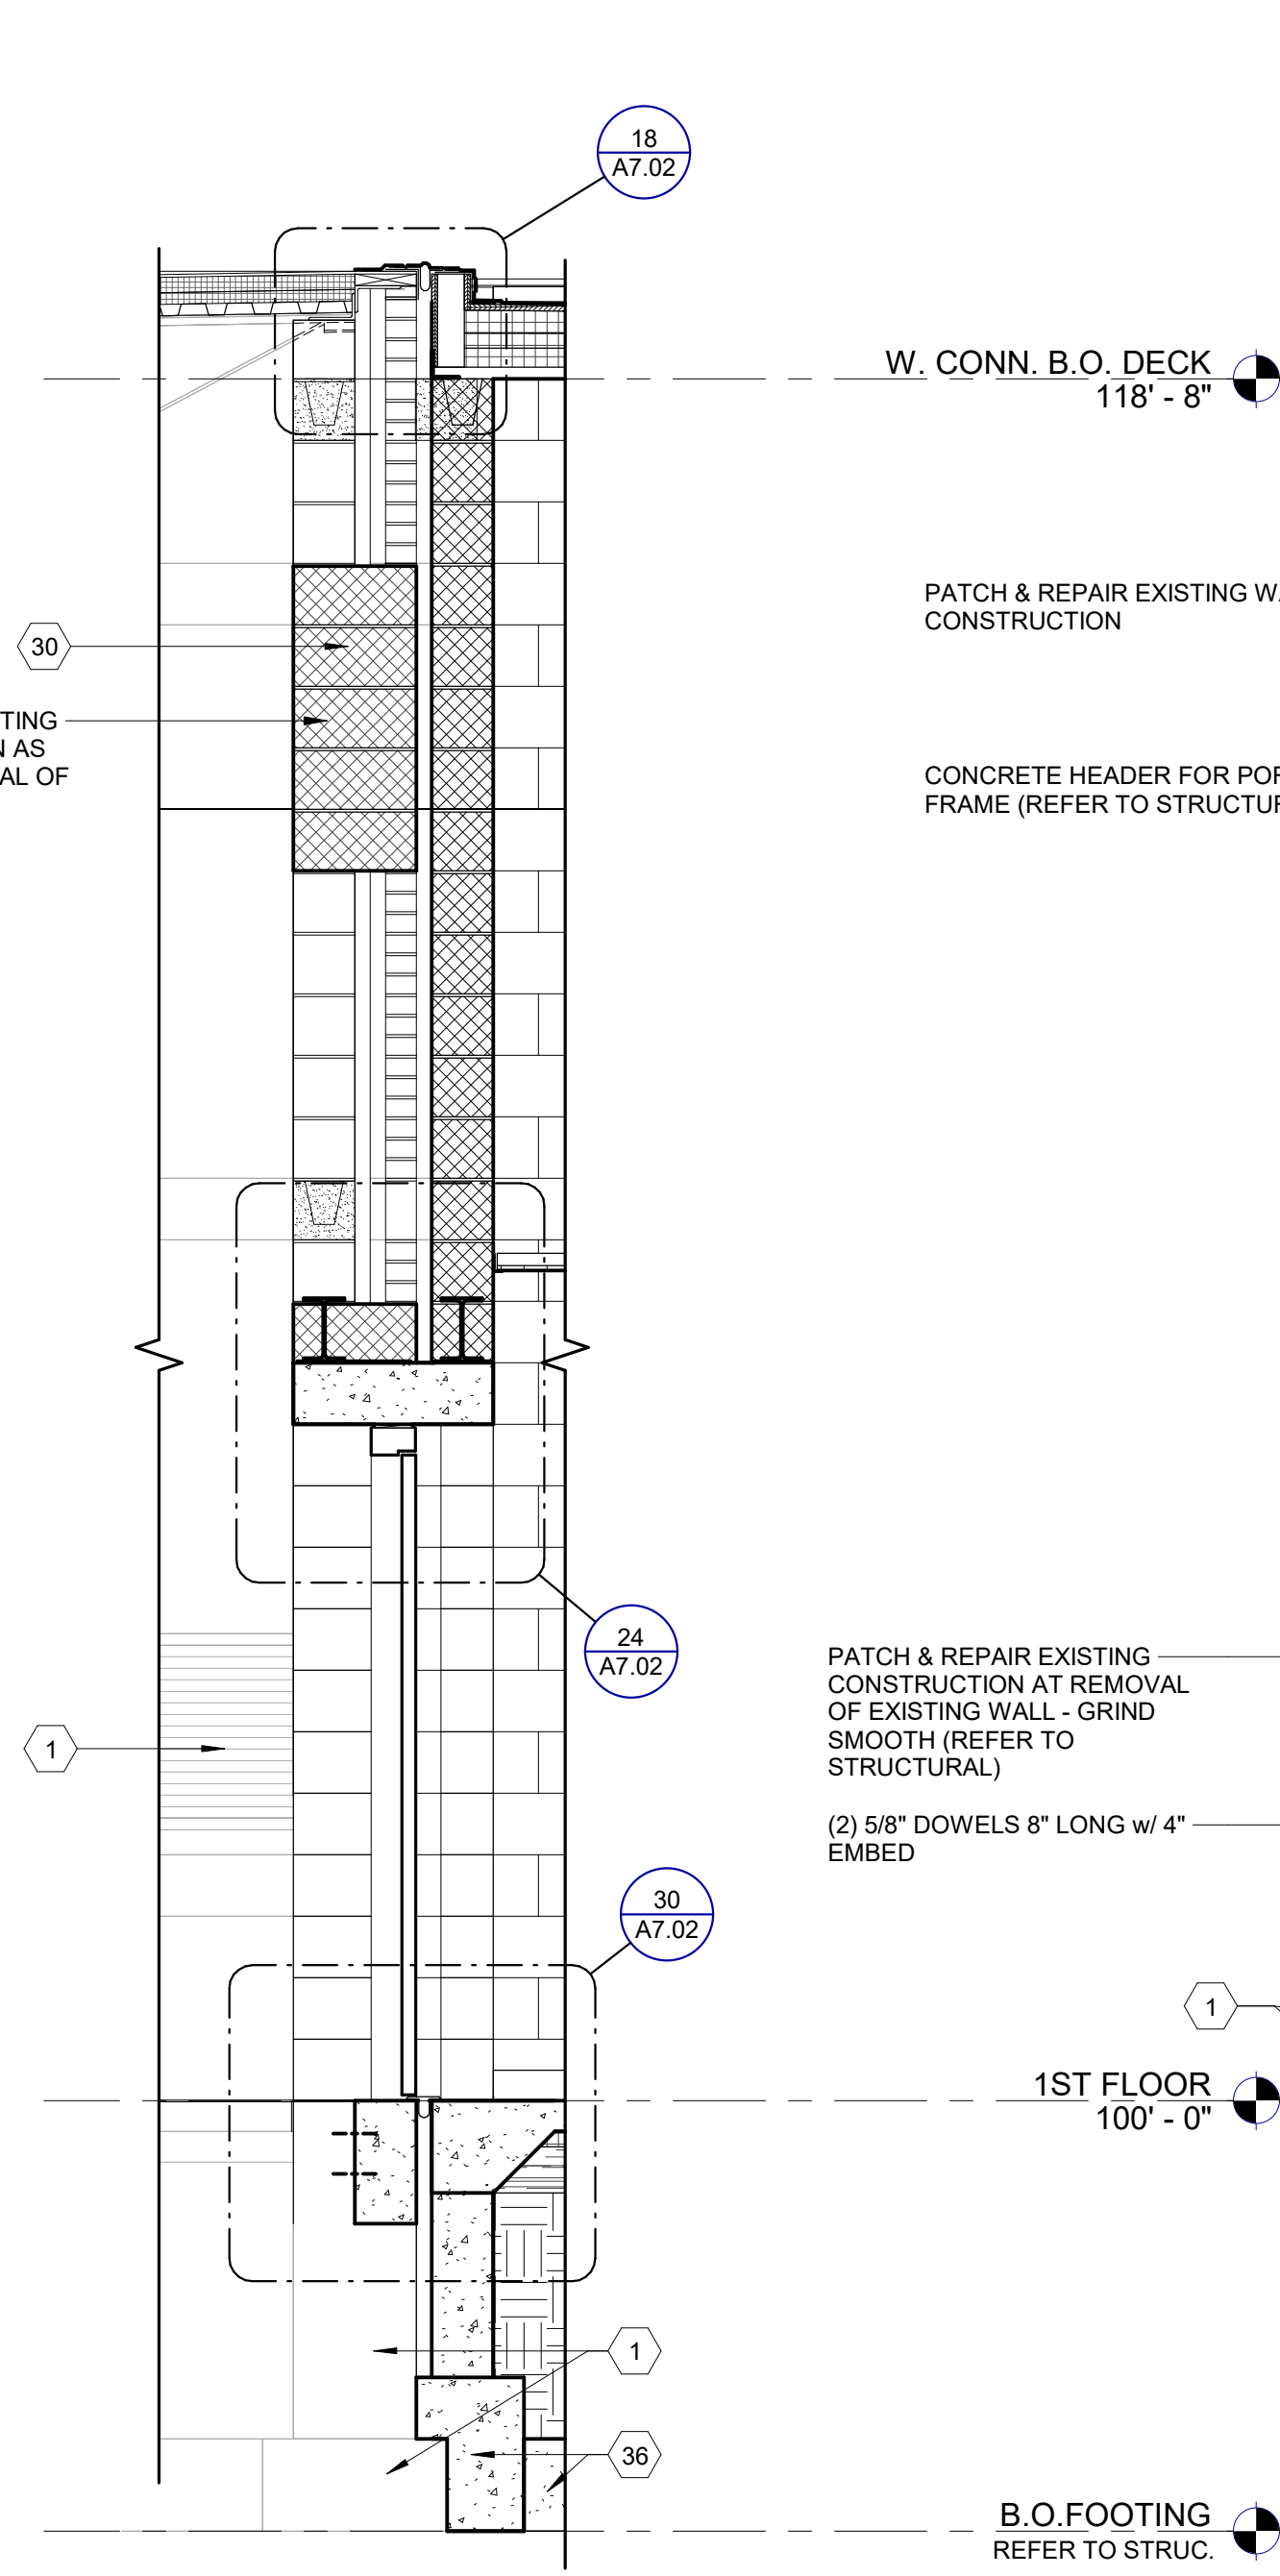


29 WALL SECTION WEST CONNECTOR
SCALE: 1/2" = 1'-0"

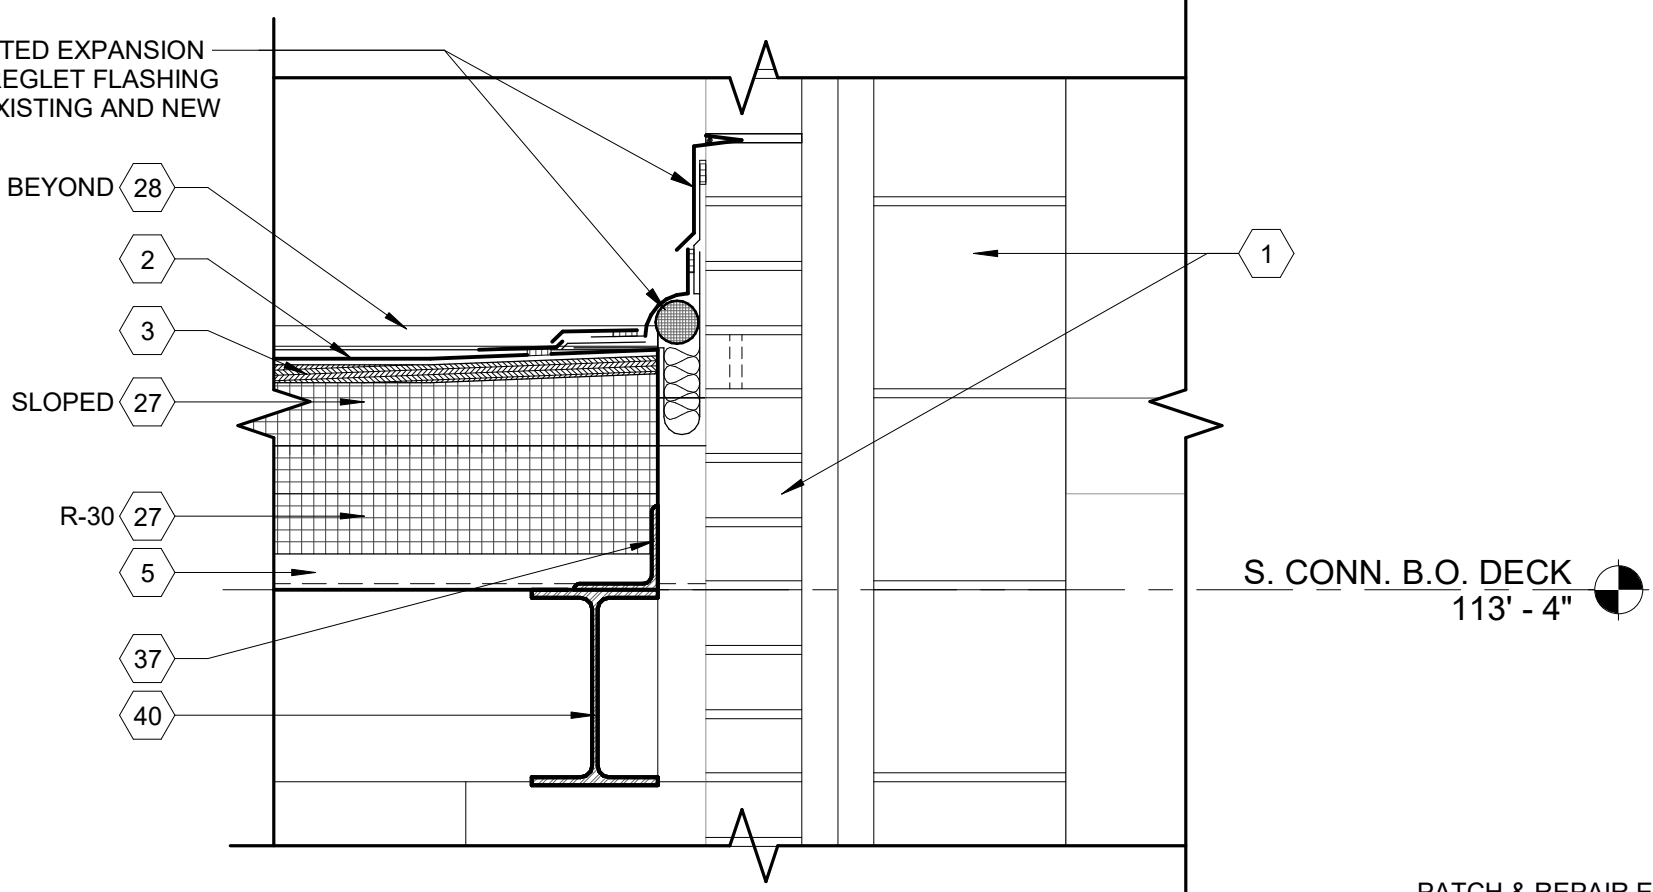

21 ROOF DETAIL
SCALE: 1 1/2" = 1'-0"

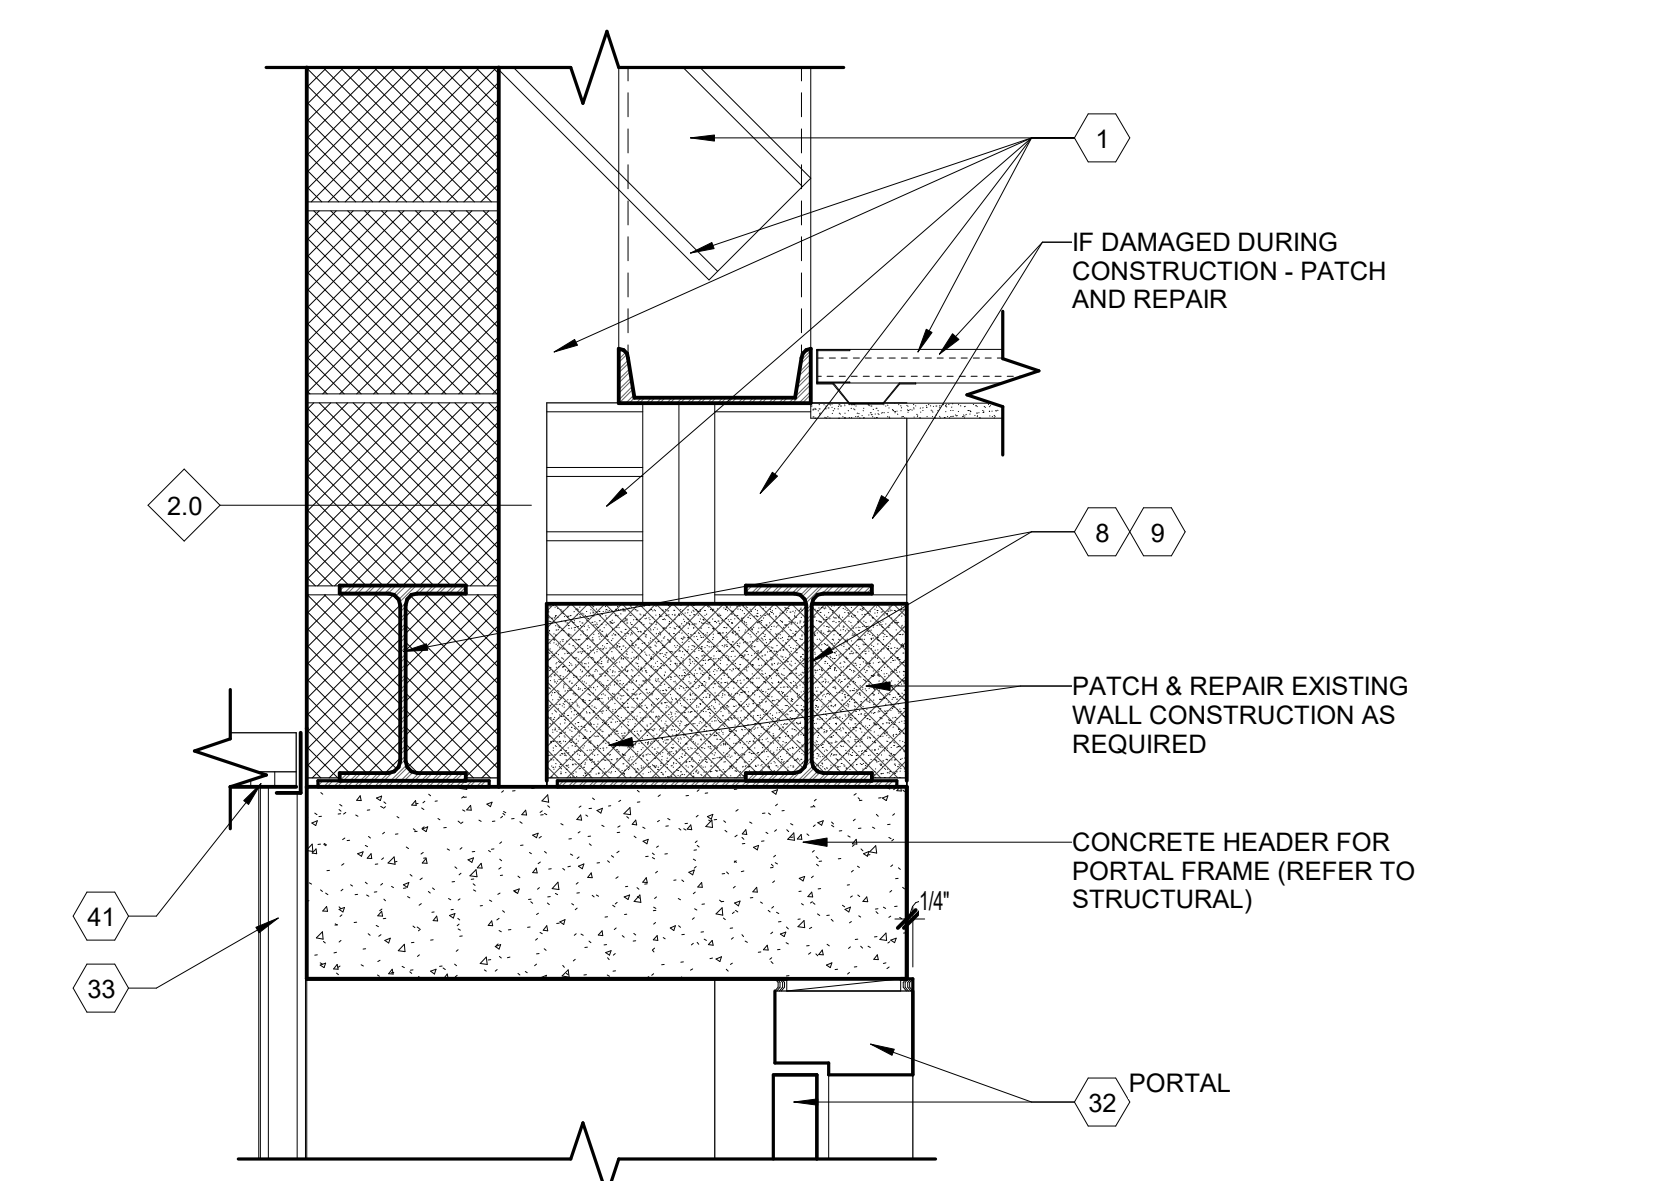

27 HEAD DETAIL
SCALE: 1 1/2" = 1'-0"

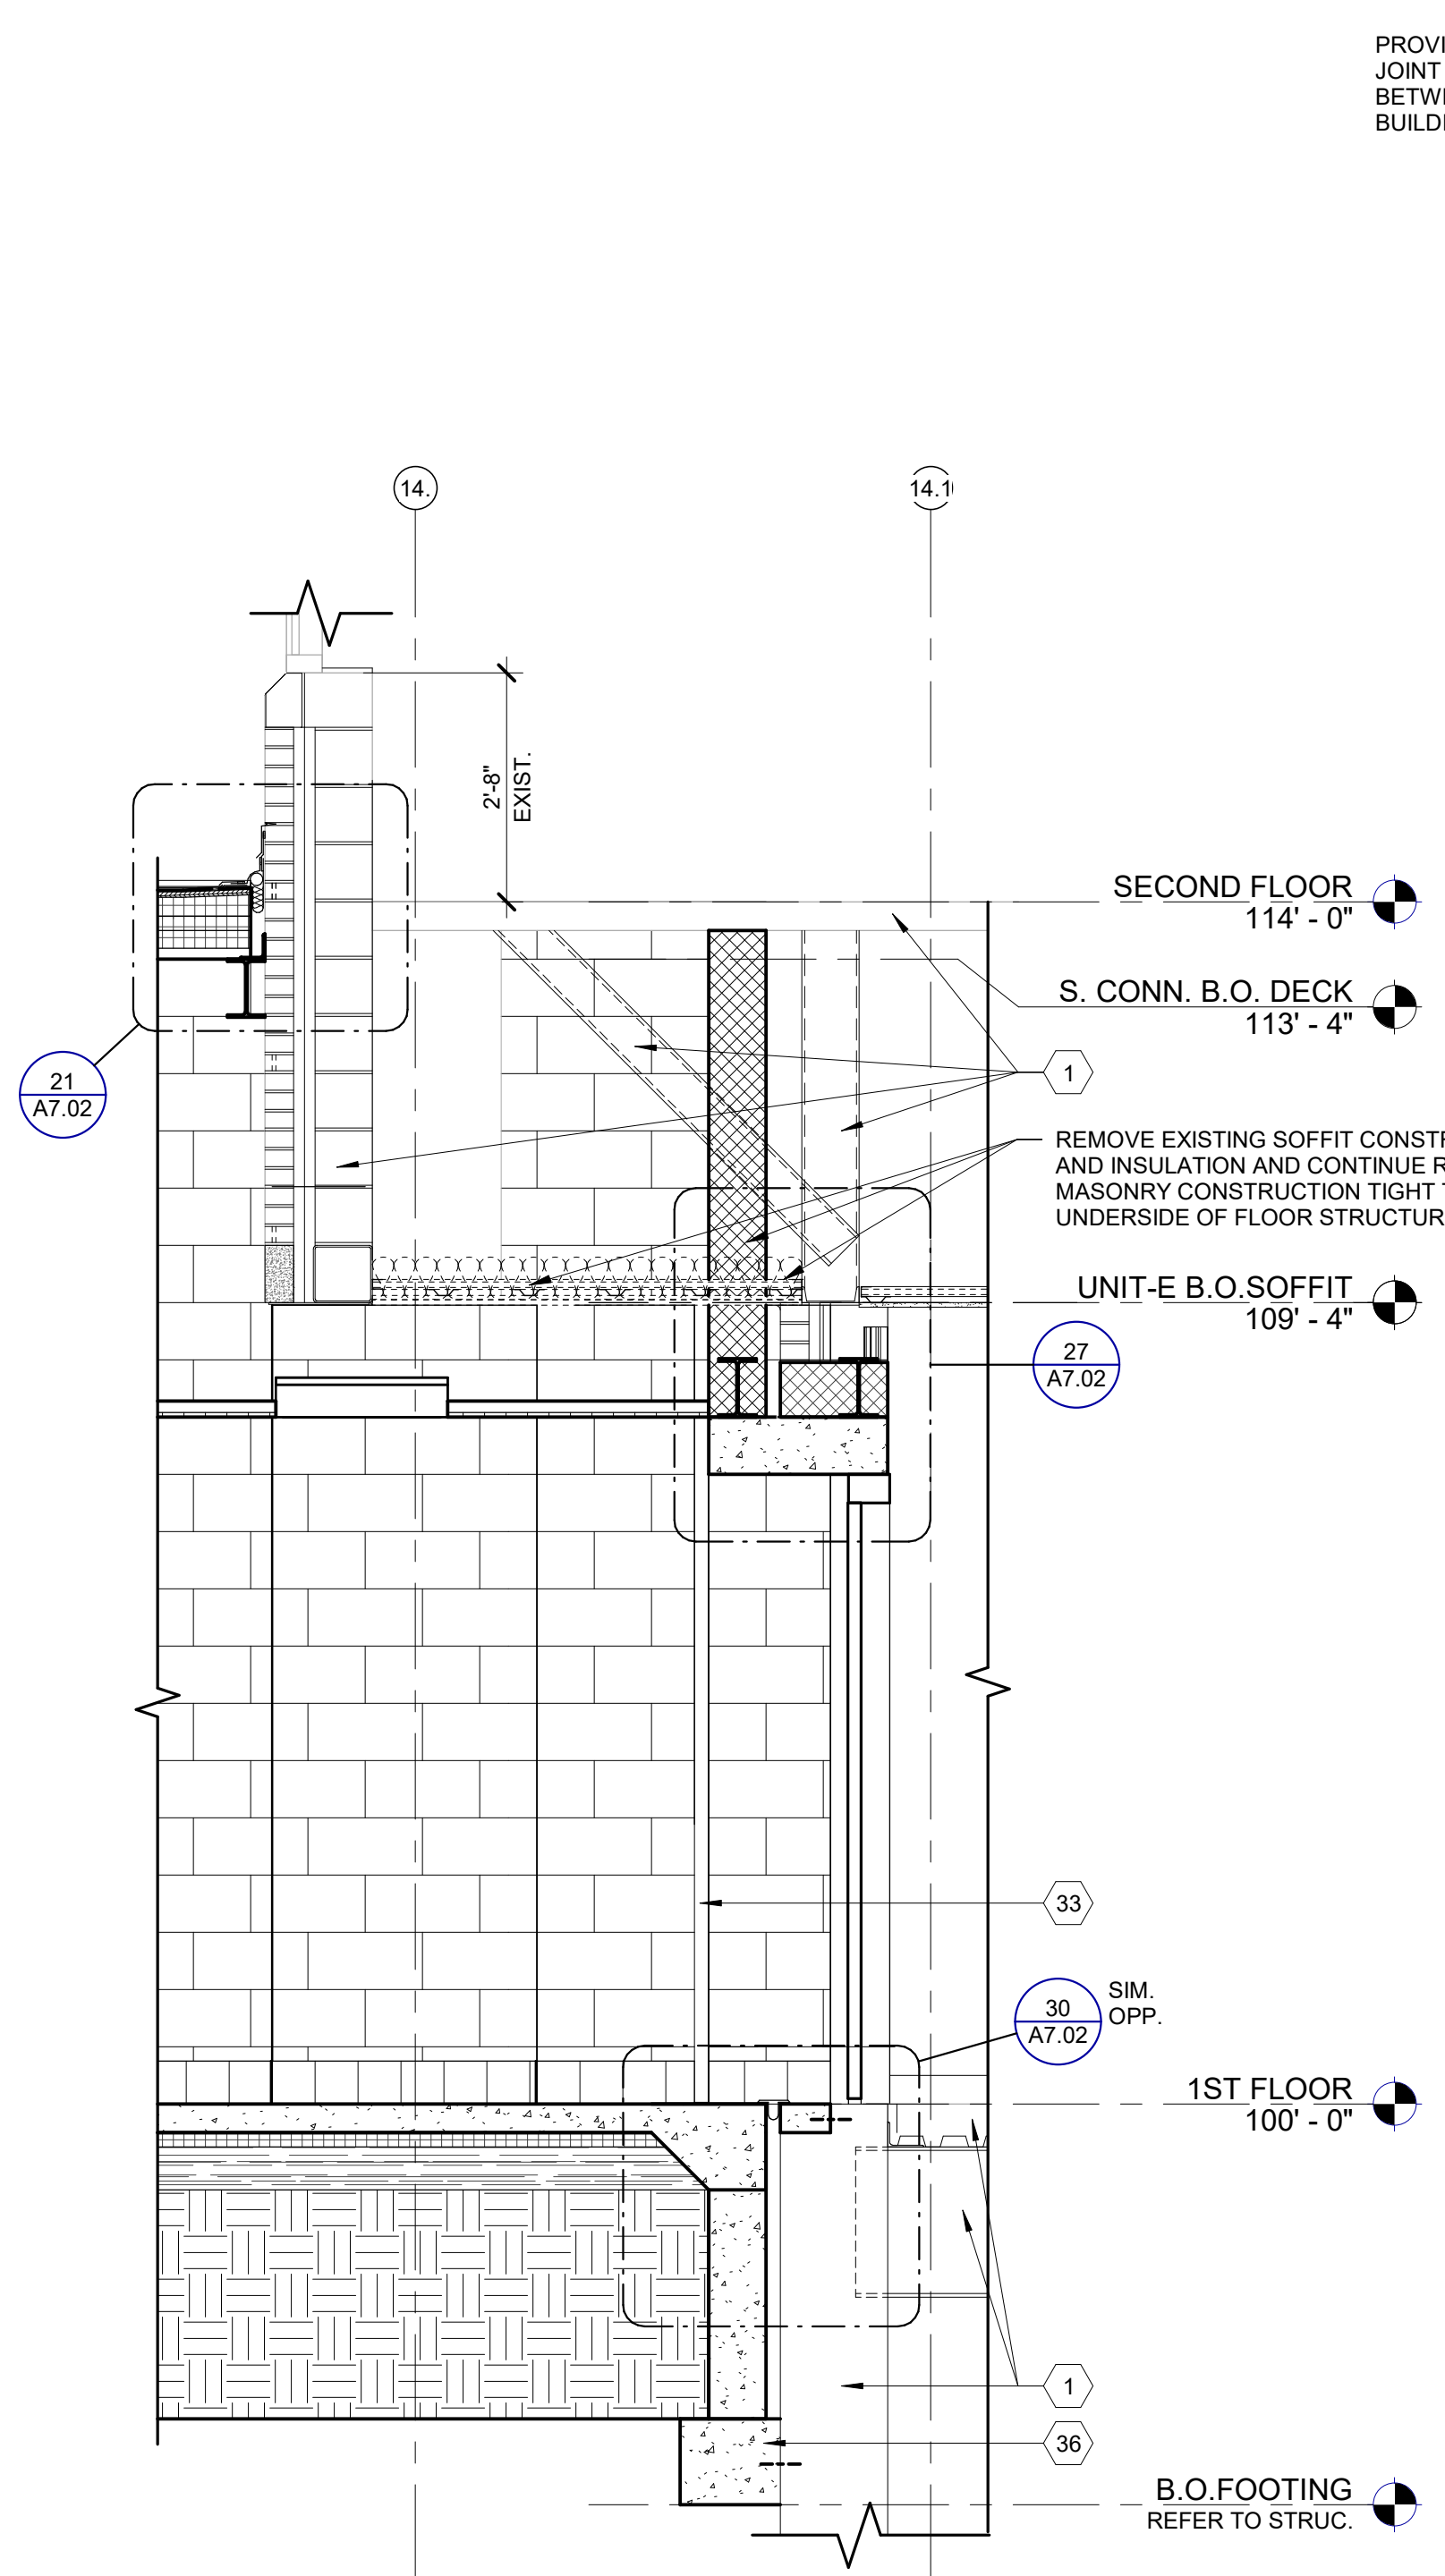

25 WALL SECTION SOUTH CONNECTOR
SCALE: 1/2" = 1'-0"

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACEL, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:

CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN

SALINE, MICHIGAN


SHEET TITLE
**WALL SECTIONS &
DETAILS**

PROJECT NUMBER
2021094

PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
C.D.S.

SHEET NUMBER
A7.02

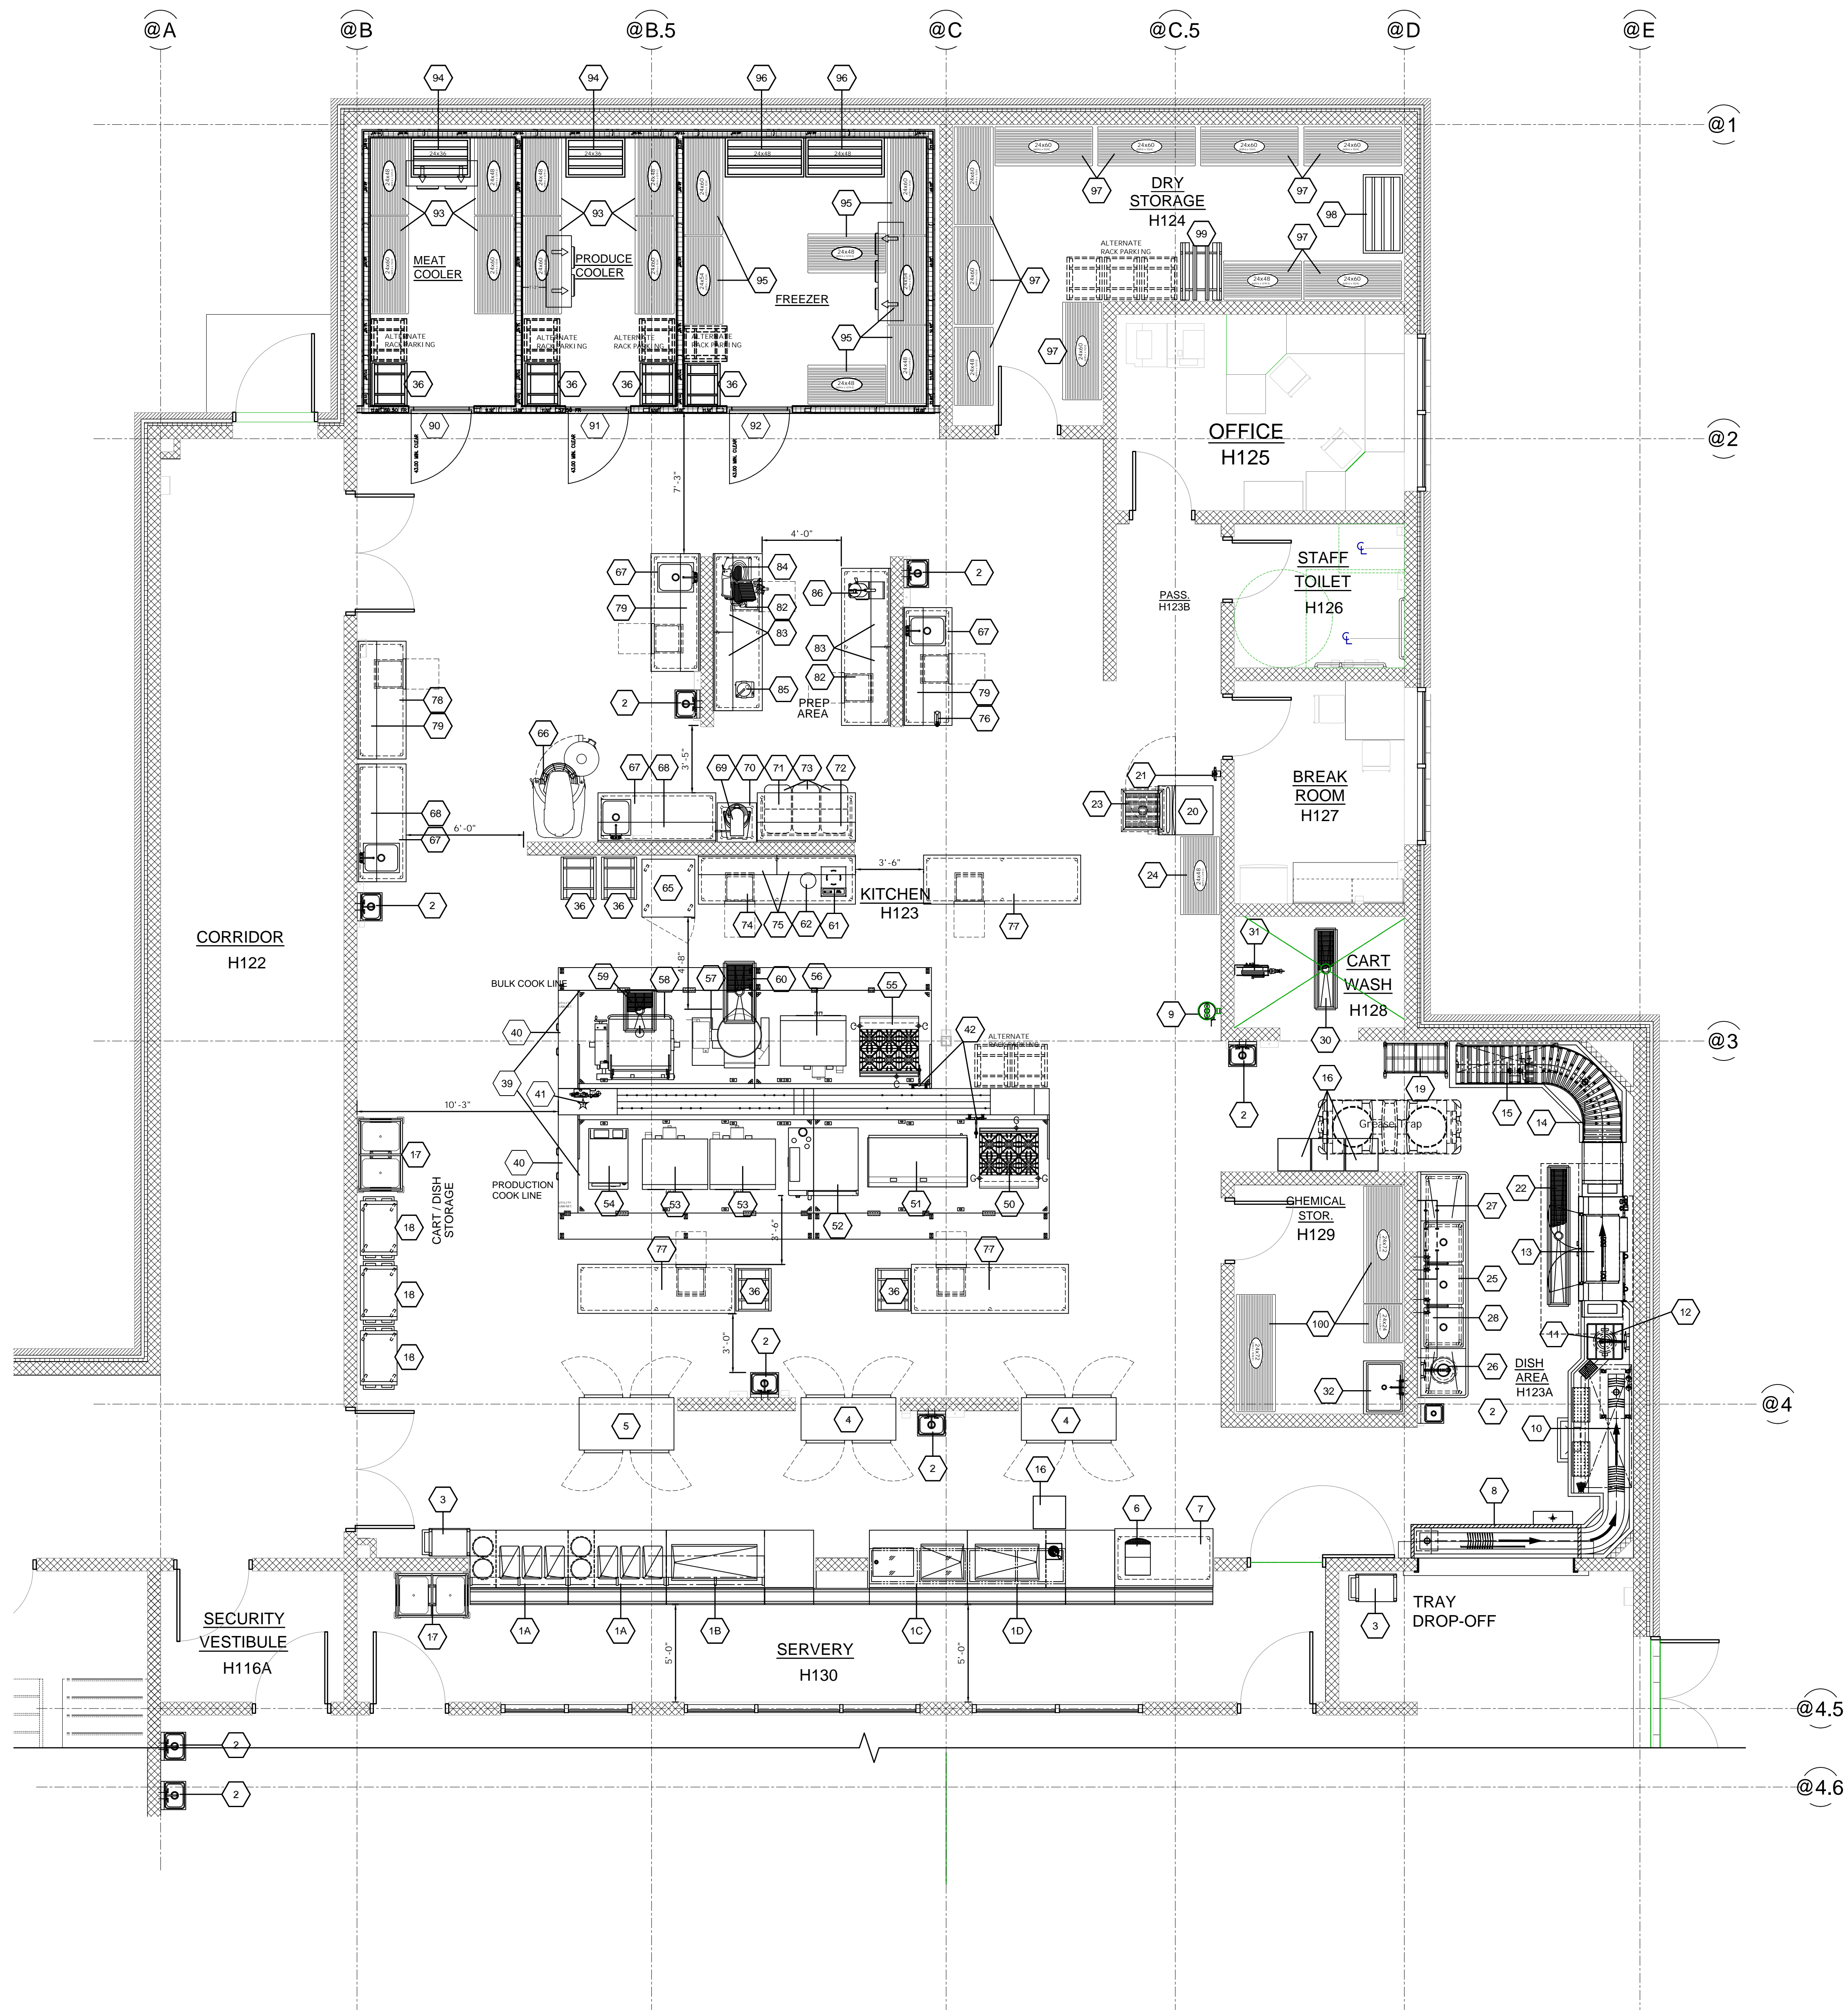

EQUIPMENT SCHEDULE			
ITEM NO	QTY	EQUIPMENT CATEGORY	EQUIPMENT REMARKS
1A	2	SERVING LINE - HOT FOOD	
1B	1	SERVING LINE - HOT/COLD FOOD COMBO	
1C	1	SERVING LINE - COLD FOOD	
1D	1	SERVING LINE - COLD FOOD	
2	9	HAND SINK, WALL MOUNT	
3	2	CART, UTILITY	
4	2	DISPLAY CASE, REFRIGERATED	
5	1	CABINET, HEATED, PASS-THRU	
6	1	COFFEE MAKER, DI SPENSER	
7	1	TABLE, WORK	
8	1	SOILED DISHTABLE TRAY CONVEYOR	
9	1	EYE WASH STATION	
10	1	DISHTABLE, ACCESSORY	
11	1	PRE-RINSE FAUCET, WALL MOUNT	
12	1	DISPOSER, GARBAGE	
13	1	WAREWASHER, RACK CONVEYOR	
14	1	CLEAN DISH ROLLER TABLE	
15	1	SHELF, WALL MOUNT	
16	3	DOLLY, DISHRACK	
17	2	DISPENSER, SELF-LEVELING TRAY	
18	3	CART, DISH & TRAY	
19	1	RACK, DOME DRYING	
20	1	ICE MAKER W/ BIN	
21	1	FILTER SYSTEM, ICEMAKER	
22	1	FLOOR TROUGH	
23	1	FLOOR TROUGH	
24	1	SHELVING UNIT	
25	1	SINK, SCULLERY, 3 COMPARTMENTS	
26	1	DISPOSER, GARBAGE	
27	1	POT RACK, WALL MOUNT	
28	1	SHELF, WALL MOUNT	
29	-	SPARE NUMBER	
30	1	FLOOR TROUGH	
31	1	HOSE REEL WITH SPRAY	
32	1	SINK, MOP W/SERVICE FAUCET	
33	-	SPARE NUMBER	
34	-	SPARE NUMBER	
35	-	SPARE NUMBER	
36	8	RACK, PAN	
37	-	SPARE NUMBER	
38	-	SPARE NUMBER	
39	2	VENTILATION SYSTEM	
40	2	FIRE SUPPRESSION SYSTEM	
41	1	UDS SYSTEM	
42	2	FAUCET, POT FILLER, WALL MOUNT	
43	-	SPARE NUMBER	
44	-	SPARE NUMBER	
45	-	SPARE NUMBER	
46	-	SPARE NUMBER	
47	-	SPARE NUMBER	
48	-	SPARE NUMBER	
49	-	SPARE NUMBER	
50	1	RANGE, HEAVY DUTY, GAS	
51	1	GRIDLE, GAS W/STAND	
52	1	OVEN-STEAMER, COMBINATION, GAS	
53	2	DOUBLE OVEN, CONVECTION, GAS	
54	1	STEAMER, PRESSURELESS	
55	1	RANGE, HEAVY DUTY, GAS	
56	1	DOUBLE OVEN, CONVECTION, GAS	
57	1	KETTLE, STEAM JACKETED, GAS, TILT	
58	1	TILT SKILLET, GAS	
59	1	FLOOR TROUGH	
60	1	FLOOR TROUGH	
61	1	INDUCTION CHARGER	
62	10	THERMAL PELLET BASE	
63	-	SPARE NUMBER	
64	-	SPARE NUMBER	
65	1	CHILLER/FREEZER, BLAST	
66	1	MIXER, FLOOR	
67	4	TABLE, WORK W/SINK	
68	2	SHELF, WALL MOUNT	
69	1	MIXER, COUNTER	
70	1	STAND, EQUIPMENT	
71	1	TABLE, WORK	
72	1	SHELF, WALL MOUNT	
73	3	INGREDIENT BIN	
74	1	TABLE, WORK W/DRAWER ASSEMBLY	
75	1	SHELF, WALL MOUNT	
76	1	CAN OPENER	
77	3	TABLE, WORK W/DRAWER ASSEMBLY	
78	1	TABLE, WORK W/DRAWER ASSEMBLY	
79	3	SHELF, WALL MOUNT	
80	-	SPARE NUMBER	
81	-	SPARE NUMBER	
82	2	TABLE, WORK W/DRAWER ASSEMBLY	
83	4	SHELF, WALL MOUNT	
84	1	SLICER	
85	1	FOOD PROCESSOR	
86	1	FOOD PROCESSOR	
87	-	SPARE NUMBER	
90	1	WALK-IN MEAT COOLER	
91	1	WALK-IN PRODUCE COOLER	
92	1	WALK-IN FREEZER	
93	8	COOLER SHELVING UNIT	
94	2	COOLER DUNNAGE RACK	
95	7	FREEZER SHELVING UNIT	
96	2	FREEZER DUNNAGE RACK	
97	9	DRY STORAGE SHELVING UNIT	
98	1	DRY STORAGE DUNNAGE RACK	
99	1	CAN RACK	
100	3	CHEMICAL STORAGE SHELVING UNIT	

**NOT FOR CONSTRUCTION
PRELIMINARY**


NO.	REVISION	DATE



FILE NO.
491/20167.SDW

FUNDING CODE
171C0DHS7255

CONTRACT NO.
Y22003

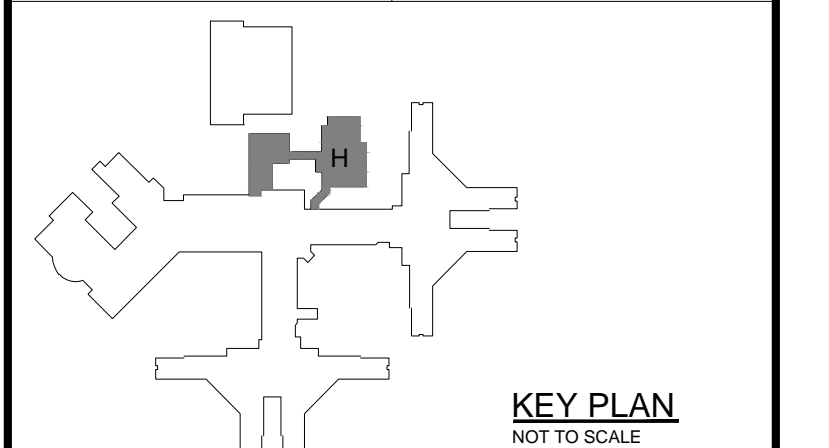

WTA ARCHITECTS
100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023



PROJECT TITLE
491/20167.SDW CFP - CREATE KITCHEN
BID AND CONSTRUCTION:
**CENTER FOR FORENSIC
PSYCHIATRY**

SALINE, MICHIGAN

SHEET TITLE
KITCHEN EQUIPMENT PLAN


PROJECT NUMBER
2021094

SHEET NUMBER


PROJECT DATE
SEPTEMBER 6, 2023

FS2.01

CHECKED BY
T.M.M.

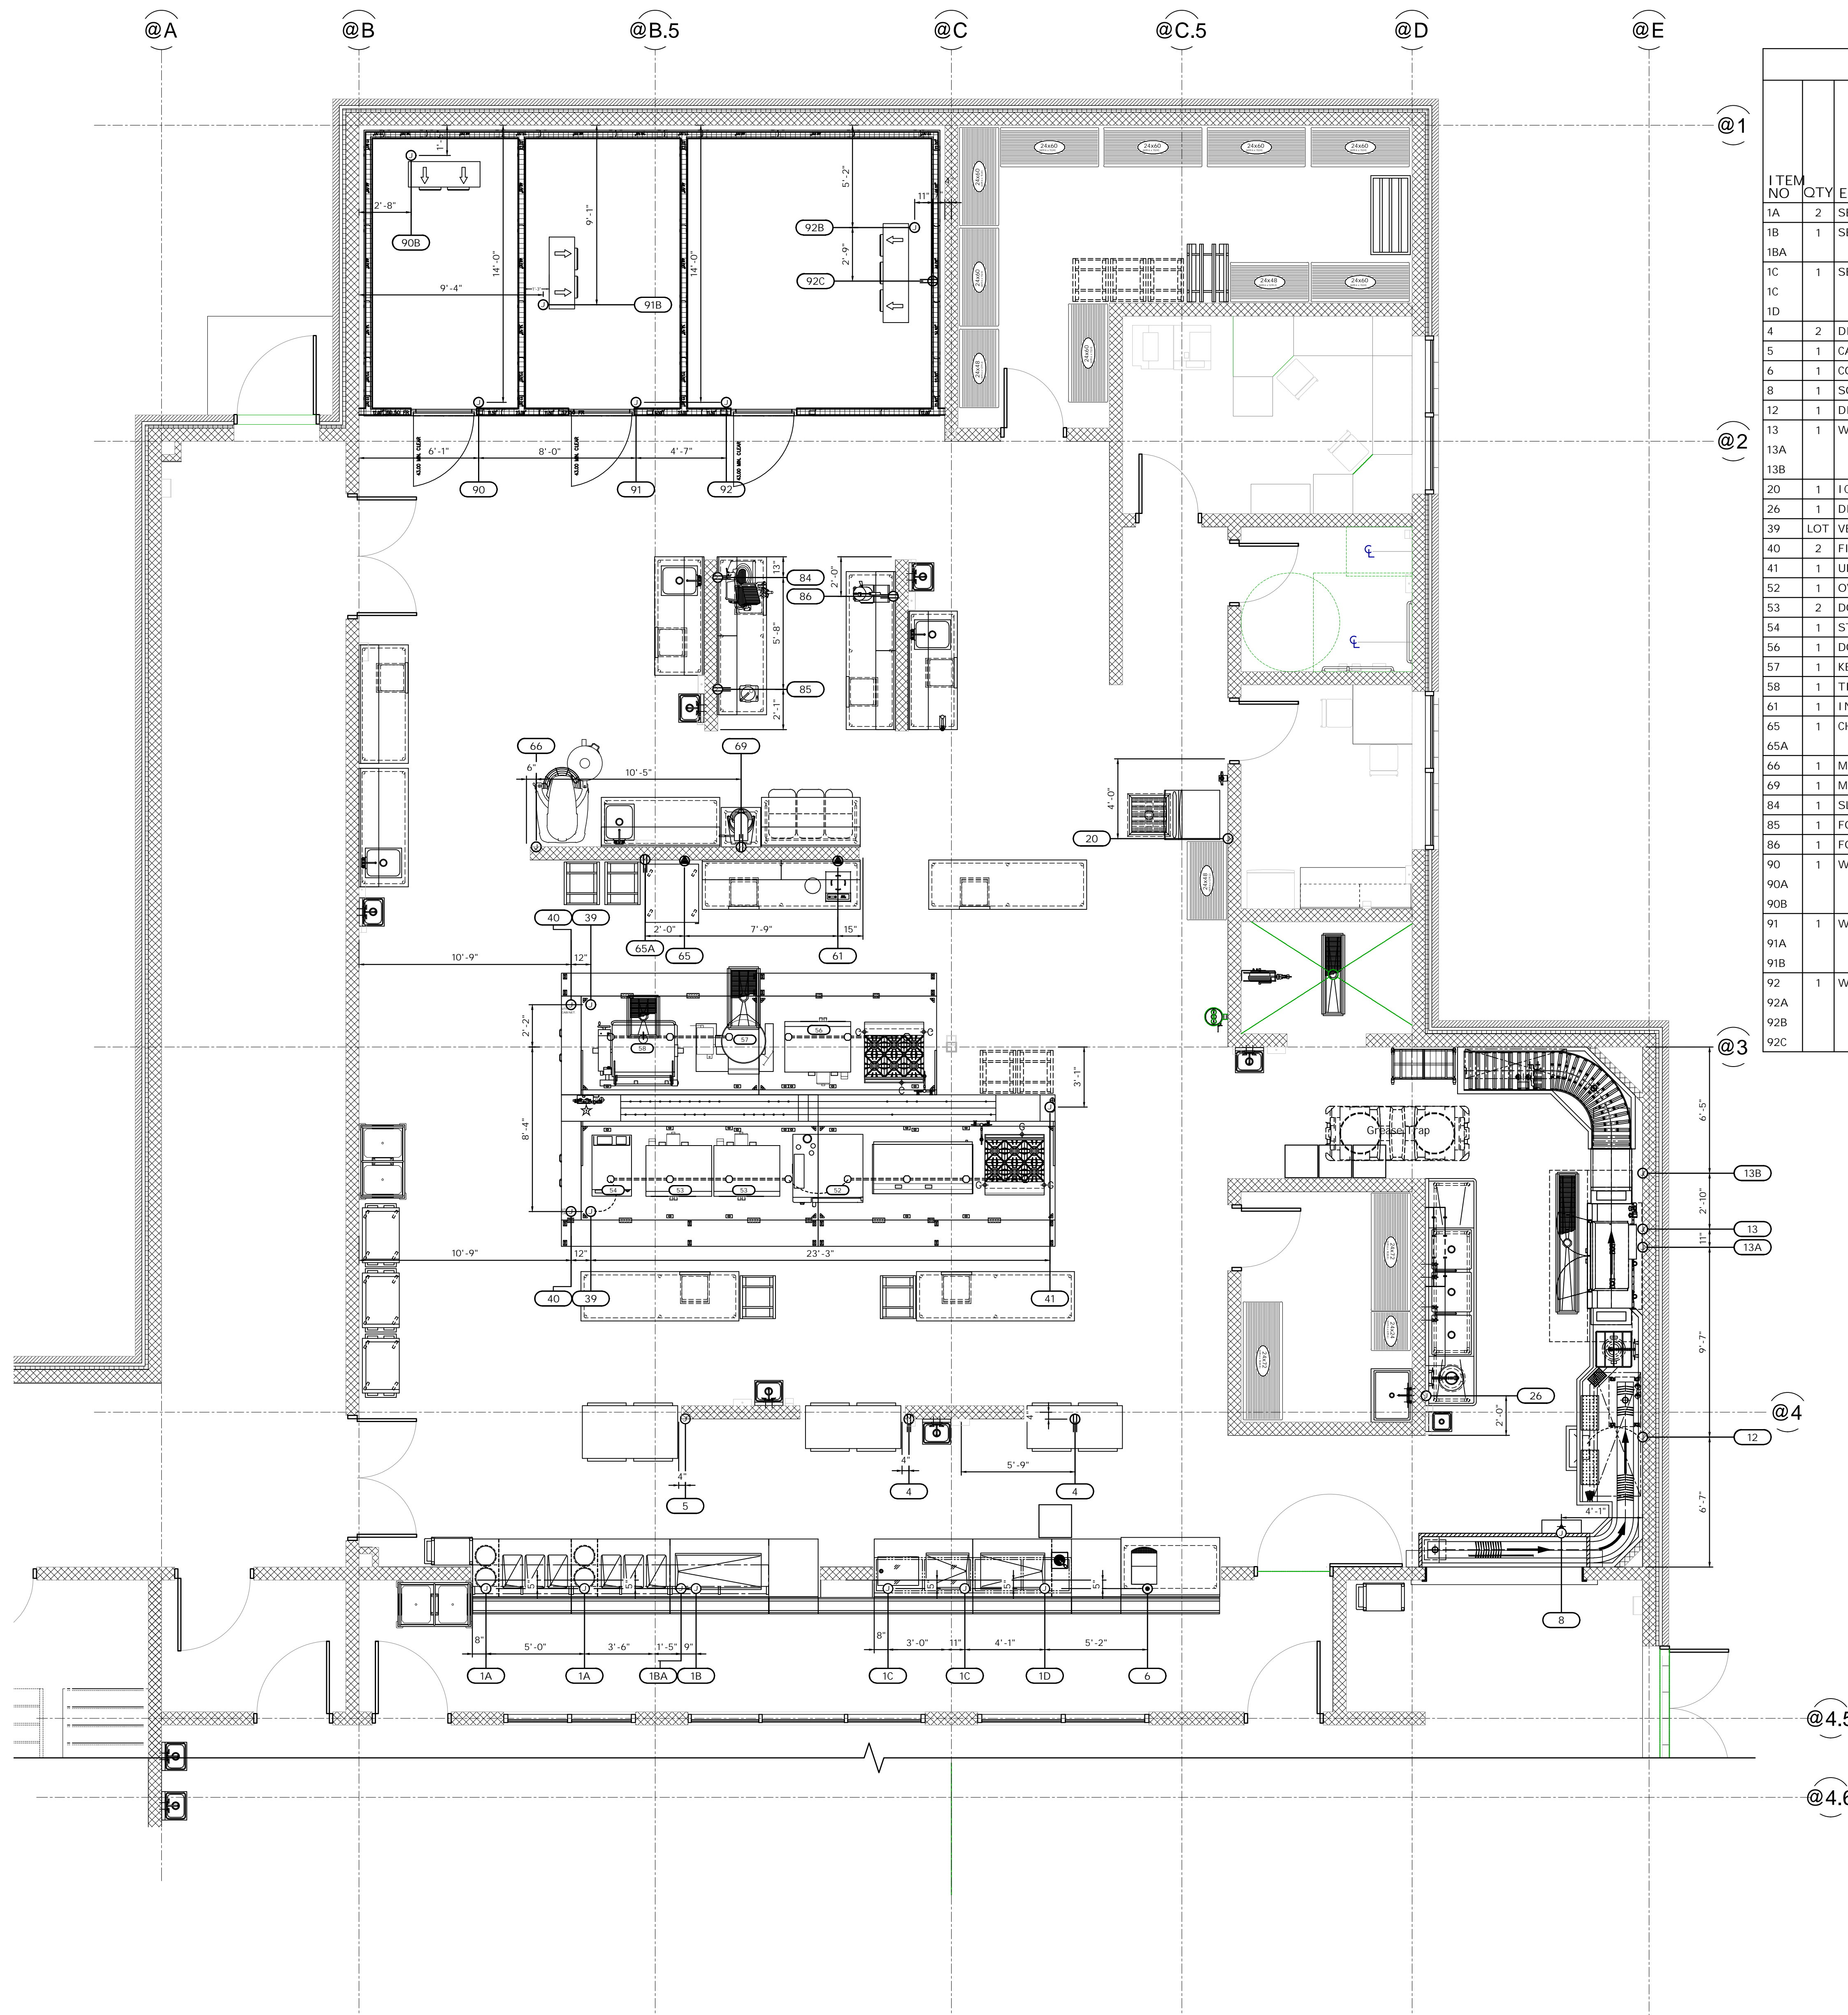

ELECTRICAL SCHEDULE													
ITEM NO	QTY	EQUIPMENT CATEGORY	AMPS	KW	HP	VOLTS	PHASE	CYCLE	DIRECT	PLUG	NEMA	ELECTRICAL AFF. (N)	ELEC REMARKS
1A	2	SERVING LINE - HOT FOOD	15.9	3.3		208	1		X			SU	'STUB UP' UTILITIES
1B	1	SERVING LINE - HOT/COLD FOOD COMBO	15.9	3.3		208	1		X			SU	'STUB UP' UTILITIES
1BA			3.5			115	1		X			SU	'STUB UP' UTILITIES
1C	1	SERVING LINE - COLD FOOD	3.5			115	1		X			SU	'STUB UP' UTILITIES
1C			3.5			115	1		X			SU	'STUB UP' UTILITIES
1D			3.5			115	1		X			SU	'STUB UP' UTILITIES
4	2	DISPLAY CASE, REFRIGERATED	10.6		0.5	115	1		X	5-20P	86	86	STUB UP OR BRING DOWN FROM ABOVE FOR UNIT AWAY FROM WALL
5	1	CABINET, HEATED, PASS-THRU	15.5	1.6		115/208	1		X			86	
6	1	COFFEE MAKER, DISPENSER	12.0	1.44		120	1		X	5-15P		SU	
8	1	SOILED DISH/TABLE TRAY CONVEYOR	15.0			208	1		X			60	
12	1	DISPOSER, GARBAGE	6.0		3.0	208	3		X			12	E.C. TO INTERWIRE TO CONTROL PANEL
13	1	WAREWASHER, RACK CONVEYOR	44.9	25.0		480	3		X			63.75	FOR MOTORS, CONTROLS & TANK HEAT
13A			40.1	30.0		480	3		X			63.75	FOR BOOSTER HEATER
13B			15.7			480	3		X			60	FOR BLOWER DRYER
20	1	ICE MAKER W/ BIN	11.9			115	1		X			72	
26	1	DISPOSER, GARBAGE	3.3		2.0	208	3		X			12	E.C. TO INTERWIRE TO CONTROL PANEL
39	LOT	VENTILATION SYSTEM	15.0			115	1		X			DFA	SERVICE TO LIGHTS & TEMP SENSORS
40	2	FIRE SUPPRESSION SYSTEM	20.0			120	1		X			DFA	20 AMP, 24-HR DEDICATED CIRCUIT
41	1	UDS SYSTEM	50.0	14.4		120/208	3		X			DFA	UDS SERVES ALL EQUIPMENT UNDER HOODS
52	1	OVEN-STEAMER, COMBINATION, GAS	9.6	2.2		208/240	1		X	6-50P	*		UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
53	2	DOUBLE OVEN, CONVECTION, GAS	(2)7.7		(2)1/2	120	1		X	5-15P	*		UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
54	1	STEAMER, PRESSURELESS	2.0	0.3		120	1		X				UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
56	1	DOUBLE OVEN, CONVECTION, GAS	(2)7.7		(2)1/2	120	1		X	5-15P	*		UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
57	1	KETTLE, STEAM JACKETED, GAS, TILT	5.0			115	1		X			*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
58	1	TILT SKILLET, GAS	5.0			115	1		X			*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
61	1	INDUCTION CHARGER	20.0	6.7		208	3		X	L15-20P	48		
65	1	CHILLER/FREEZER, BLAST	10.0		3.0	208	3		X	L15-20P	12		MAIN SERVICE TO UNIT
65A			2.0			120	1		X	5-15P	12		SERVICE FOR CONDENSATE EVAPORATOR
66	1	MIXER, FLOOR	12.0		3.0	200-240	3		X			54	CORD & PLUG NOT PROVIDED: L15-20P RECEPTACLE & PLUG CAN BE USED
69	1	MIXER, COUNTER	9.0		0.5	120	1		X	5-15P	36		
84	1	SLICER, FOOD	5.6		0.5	120	1		X	5-15P	45		
85	1	FOOD PROCESSOR	8.0		0.75	120	1		X	5-15P	45		
86	1	FOOD PROCESSOR	10.0		1.0	120	1		X	5-15P	45		
90	1	WALK-IN MEAT COOLER	15.0			120	1		X			DFA	SERVICE TO LIGHTS, ALARMS & HEATERS
90A			7.4		0.75	208-230	1		X			SU	SERVICE TO MEAT COOLER CONDENSING UNIT
90B			1.6			115	1		X			DFA	SERVICE TO MEAT COOLER EVAPORATOR COIL
91	1	WALK-IN PRODUCE COOLER	15.0			120	1		X			DFA	SERVICE TO LIGHTS, ALARMS & HEATERS
91A			7.0		0.75	208-230	1		X			SU	SERVICE TO PRODUCE COOLER CONDENSING UNIT
91B			1.6			115	1		X			DFA	SERVICE TO PRODUCE COOLER EVAPORATOR COIL
92	1	WALK-IN FREEZER	15.0			120	1		X			DFA	SERVICE TO LIGHTS, ALARMS & HEATERS
92A			21.4		3.0	208-230	1		X			SU	SERVICE TO FREEZER CONDENSING UNIT
92B			14.3			208-230	1		X			DFA	SERVICE TO FREEZER EVAPORATOR COIL
92C			15.0			120	1		X	5-15P	84	15 AMP CIRCUIT FOR DRAIN LINE HEAT TAPE	

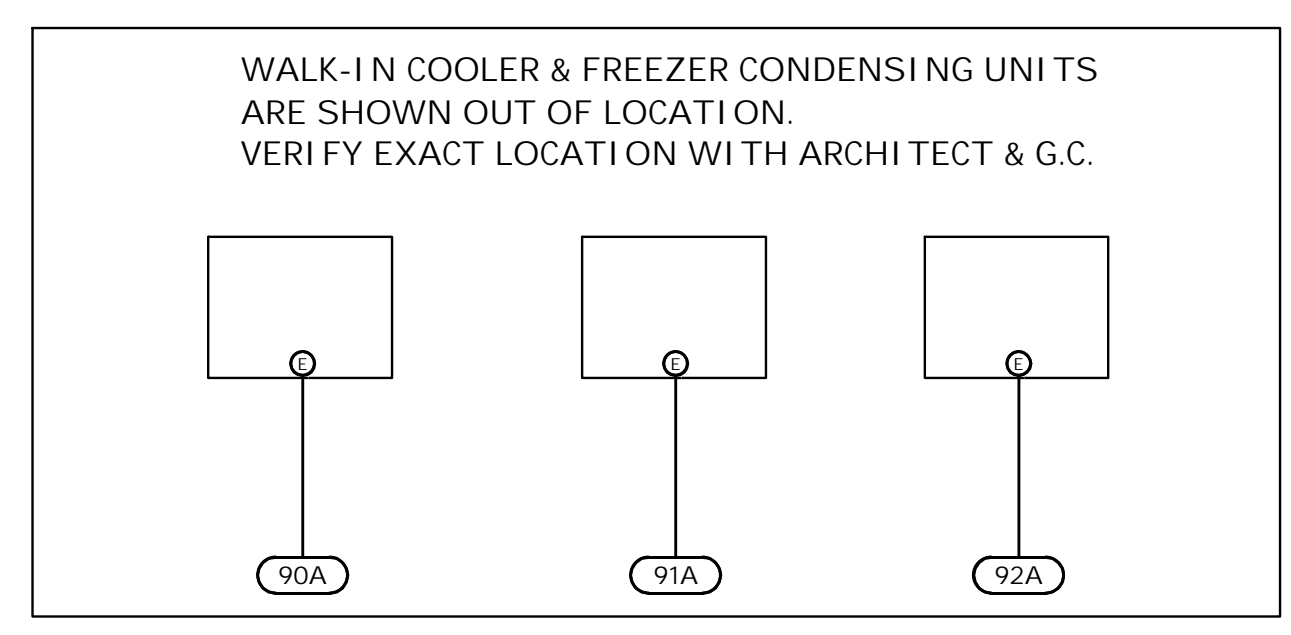

**NOT FOR CONSTRUCTION
PRELIMINARY**


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171C0DHH57255

CONTRACT NO.
Y22003

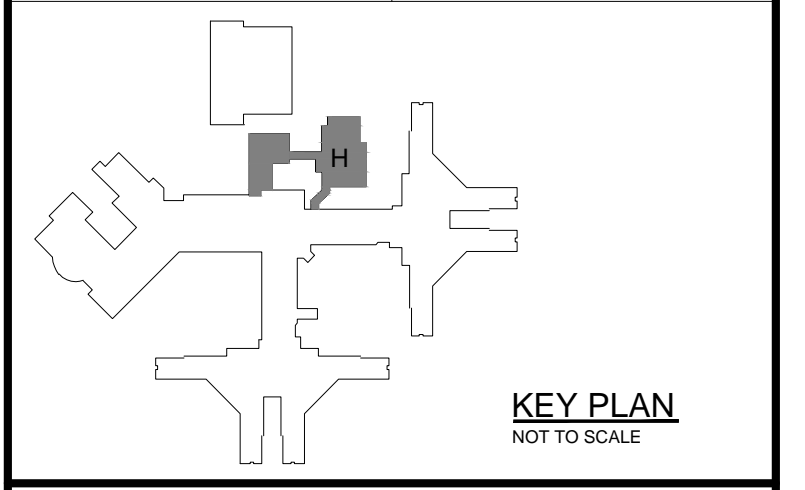

WTAARCH.COM

WTA ARCHITECTS

100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

STAFFORD-SMITH, Inc.
COMMERCIAL REFRIGERATION FOOD SERVICE EQUIPMENT
301 S. BURDESSA ALAMO, MICHIGAN 48601
PH: (989) 581-0271

PROJECT TITLE
491/20167.SDW CFP - CREATE KITCHEN
BID AND CONSTRUCTION:
**CENTER FOR FORENSIC
PSYCHIATRY**
SALINE, MICHIGAN
SHEET TITLE

KITCHEN ELECTRICAL PLAN

PROJECT NUMBER 2021094	SHEET NUMBER
PROJECT DATE SEPTEMBER 6, 2023	FS2.02
CHECKED BY T.M.M.	



ITEM NO.	QTY	EQUIPMENT CATEGORY	COLD WATER SIZE (IN)	COLD WATER AFF. (IN)	COLD WATER W/ER SIZE (IN)	HOT WATER AFF. (IN)	DIRECT DRAIN AFF. (IN)	INDIRECT DRAIN AFF. (IN)	INDIRECT DRAIN SIZE (IN)	MBTUH	GAS PIPE (IN)	PLUMBING REMARKS
1A	2	SERVING LINE - HOT FOOD							FS			M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
1B	1	SERVING LINE - HOT/COLD FOOD COMBO							FS			M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
1C	1	SERVING LINE - COLD FOOD							FS			M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
1D	1	SERVING LINE - COLD FOOD	0.5	SU					FS			STUB UP COLD WATER FOR WATER FILLER M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
2	9	HAND SINK, WALL MOUNT	0.5	18	0.5	18	1.5	20				
6	1	COFFEE MAKER, DISPENSER	0.375	SU								
8	1	SOILED DISHTABLE TRAY CONVEYOR	(2)0.5	16	(2)0.5	16			1.5,FS			M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
9	1	EYEWASH STATION	0.5	24	0.5	24	1.25	24				
11	1	PRE-RINSE FAUCET, WALL MOUNT	0.75	14	0.5	14						BRANCH CW FROM PRE-RINSE TO DISPOSER
12	1	DISPOSER, GARBAGE	0.5	*								BRANCH CW FROM PRE-RINSE TO DISPOSER
13	1	WAREWASHER, RACK CONVEYOR	0.5	8	0.5	8			2.0,FS			M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
20	1	ICE MAKER W/ BIN	0.375	*					0.75,FS			BRANCH CW FROM ITEM 21, FILTER TO ICE MAKER M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
21	1	FILTER SYSTEM, ICE MAKER	0.375	60								BRANCH CW FROM ITEM 21, FILTER TO ICE MAKER
22	1	FLOOR TROUGH							4.0	SU		
23	1	FLOOR TROUGH							4.0	SU		
25	1	SINK, SCULLERY, 3 COMPARTMENTS	(3)0.75	14	(3)0.75	14						H&C WATER TO FAUCETS & PRE-RINSE UNIT M.T. TO EXTEND WASH SINK DRAIN DIRECT TO GREASE TRAP
25A	1								2.0	FS		M.T. TO EXTEND RINSE & SANITIZE SINK DRAINS TO FLOOR SINK BRANCH CW FROM PRE-RINSE UNIT TO DISPOSER
26	1	DISPOSER, GARBAGE	0.5	*								
26A	1	FLOOR TROUGH							2.0	8		
30	1	FLOOR TROUGH							4.0	SU		
31	1	HOSE REEL WITH SPRAY	0.5	42	0.5	42						STUB OUT TO MIXING VALVE & RUN UP TO HOSE REEL UNIT
32	1	SINK, MOP	0.5	36	0.5	36	2.0	SU				
41	1	UDS SYSTEM	0.75	DFA	0.75	DFA			2.0	2350	DFA	UDS SERVES EQUIPMENT UNDER HOODS 2" GAS LOOP SYSTEM
41A	1											
42	2	FAUCET, POT FILLER, WALL MOUNT	0.5	*	0.5	*						UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
50	1	RANGE, HEAVY DUTY, GAS							1.25	260	*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
51	1	GRIDDLE, GAS W/STAND							0.75	135	*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
52	1	OVEN-STEAMER, COMBINATION, GAS							0.75	303.5	*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
53	2	OVEN, CONVECTION, GAS							0.75	100	*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
54	1	STEAMER, PRESSURELESS (1-FILTERED & 1-NON-FILTERED)	(2)0.375						0.75	144	*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
55	1	RANGE, HEAVY DUTY, GAS							1.25	260	*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
56	1	OVEN, CONVECTION, GAS							0.75	100	*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
57	1	KETTLE, STEAM JACKETED, GAS, TILT	0.5	*	0.5	*			0.5	100	*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
58	1	TILT SKILLET, GAS	0.5	*	0.5	*			0.5	144	*	UTILITY SERVICE FROM ITEM 41, UDS SYSTEM
59	1	FLOOR TROUGH							4.0	SU		
60	1	FLOOR TROUGH							4.0	SU		
65	1	CHILLER/FREEZER, BLAST							0.75	FS		M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
67	4	TABLE, WORK W/SINK	0.5	14	0.5	14			1.5	FS		M.T. TO EXTEND DRAINS TO NEAREST FLOOR SINK
90	1	WALK-IN MEAT COOLER								FFD		M.T. TO EXTEND EVAPORATOR COIL DRAIN TO FUNNEL TYPE FLOOR DRAIN
91	1	WALK-IN PRODUCE COOLER								FFD		M.T. TO EXTEND EVAPORATOR COIL DRAIN TO FUNNEL TYPE FLOOR DRAIN
92	1	WALK-IN FREEZER								FFD		M.T. TO EXTEND EVAPORATOR COIL DRAIN TO FUNNEL TYPE FLOOR DRAIN

**NOT FOR CONSTRUCTION
PRELIMINARY**


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171C0DHHS7255

CONTRACT NO.
Y22003

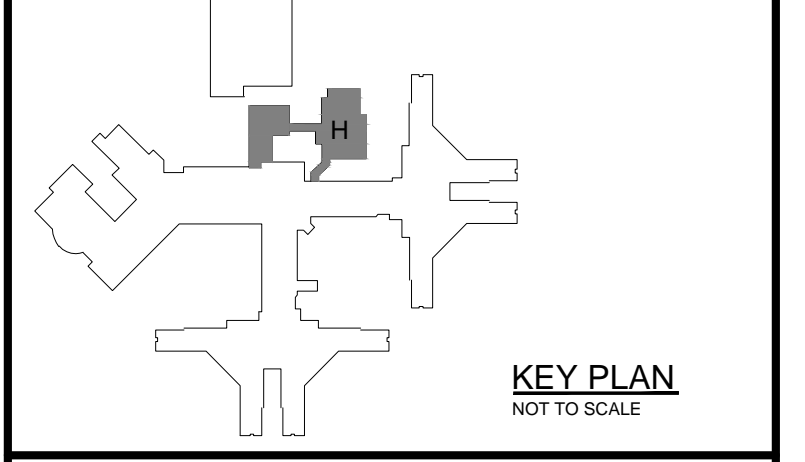


WTA ARCHITECTS
100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

STAFFORD-SMITH, Inc.
COMMERCIAL REFRIGERATION, FOOD SERVICE EQUIPMENT
3916 S BURTON AVE, ANN ARBOR, MICHIGAN 48106
PH: (734) 963-0270

PROJECT TITLE
491/20167.SDW CFP - CREATE KITCHEN
BID AND CONSTRUCTION:
**CENTER FOR FORENSIC
PSYCHIATRY**
SALINE, MICHIGAN

SHEET TITLE
KITCHEN PLUMBING PLAN

PROJECT NUMBER 2021094	SHEET NUMBER
PROJECT DATE SEPTEMBER 6, 2023	FS2.03
CHECKED BY T.M.M.	

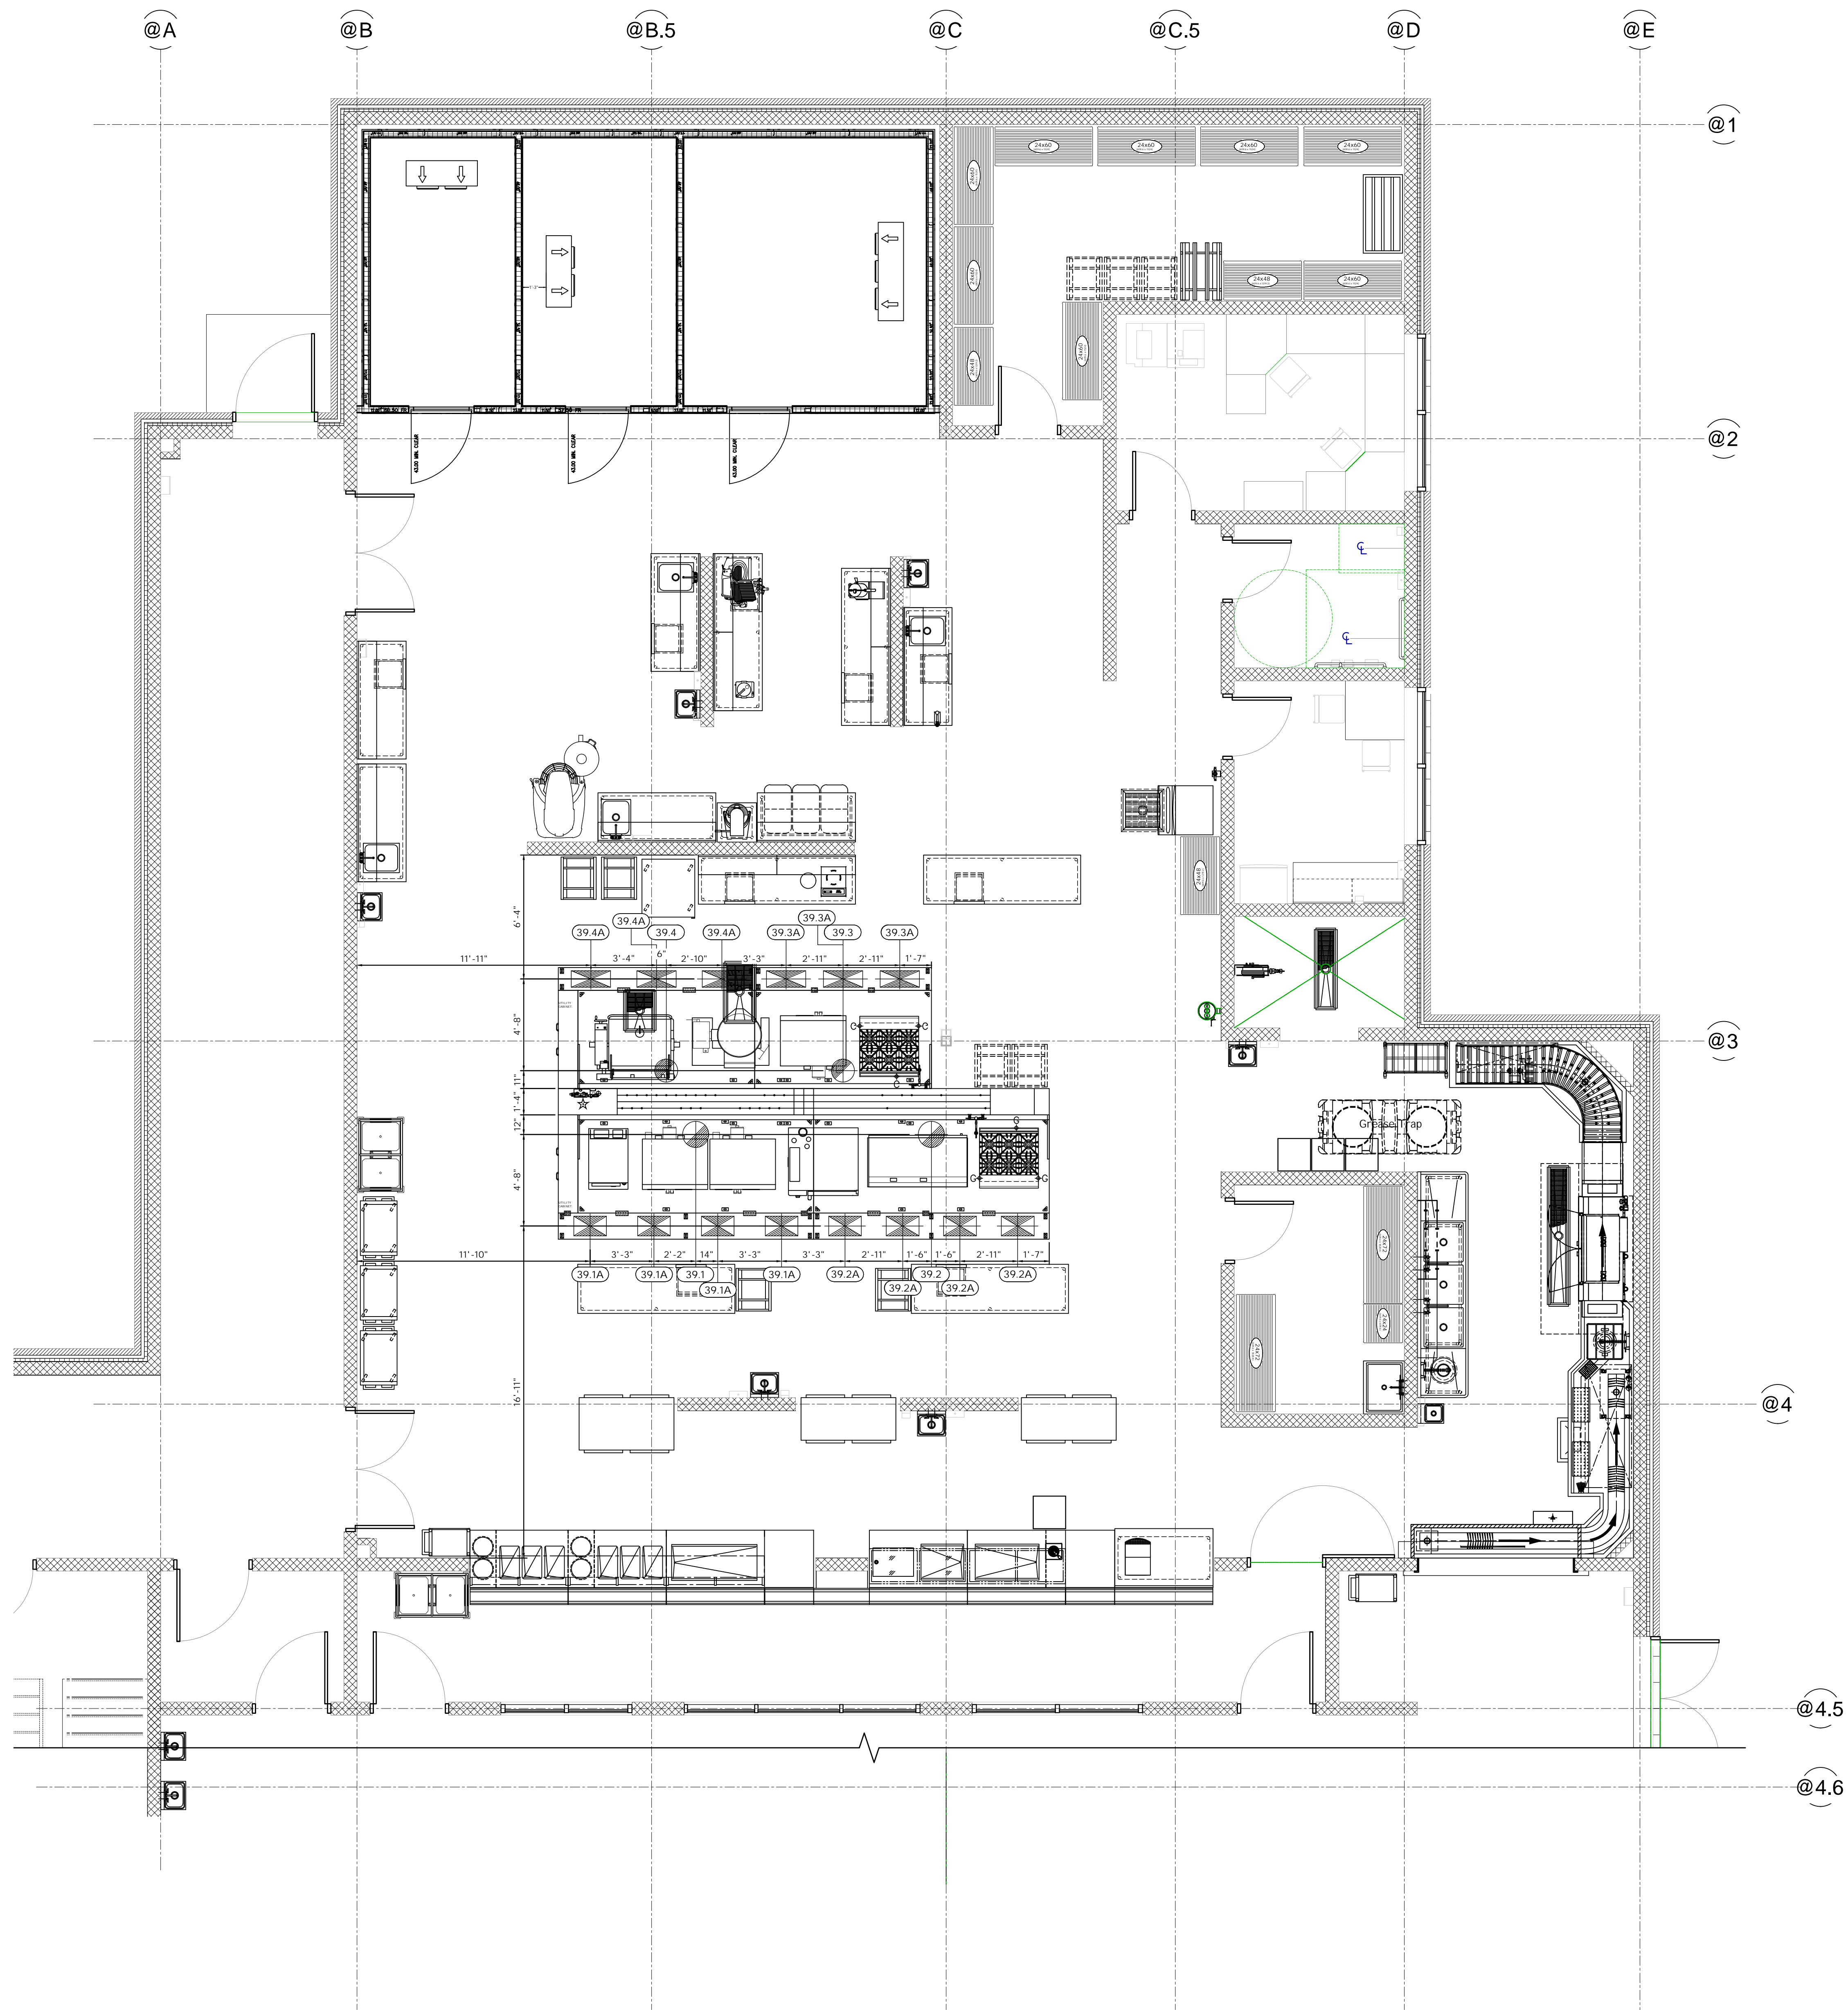

VENTILATION SCHEDULE										
ITEM NO	QTY	EQUIPMENT CATEGORY	HVAC EXHAUST DUCT SIZE (IN)	HVAC EXHAUST CFM	HVAC EXHAUST SPW/G	HVAC MAKE-UP DUCT SIZE (IN)	HVAC MAKE-UP CFM	HVAC MAKE-UP SPW/G	HVAC AFF (1/N)	HVAC REMARKS
39.1	1	VENTILATION SYSTEM	16" DIA	2350	-0.764	(4) 12" X 20"	637(EA)	0.217	DFA @ 113"-AFF	
39.1A			16" DIA	2750	-1.046	(4) 12" X 20"	637(EA)	0.217	DFA @ 113"-AFF	
39.2			14" DIA	1800	-0.666	(3) 10" X 24"	566(EA)	0.174	DFA @ 113"-AFF	
39.2A			14" DIA	1800	-0.666	(3) 10" X 24"	633(EA)	0.215	DFA @ 113"-AFF	
39.3										
39.3A										
39.4										
39.4A										

**NOT FOR CONSTRUCTION
PRELIMINARY**


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171C0DHH57255

CONTRACT NO.
Y22003

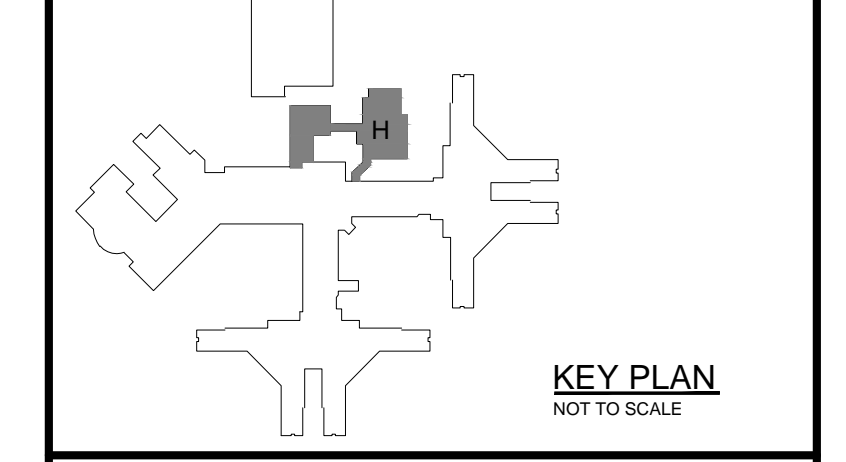

WTA ARCHITECTS
100 S Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

STAFFORD-SMITH, Inc.
COMMERCIAL REFRIGERATION FOOD SERVICE EQUIPMENT
301 S BURTON ALAMADO, MICHIGAN 48601
PH: (989) 752 2277


PROJECT TITLE
491/20167.SDW CFP - CREATE KITCHEN
BID AND CONSTRUCTION:
**CENTER FOR FORENSIC
PSYCHIATRY**

SALINE, MICHIGAN

SHEET TITLE

KITCHEN VENTILATION PLAN

PROJECT NUMBER 2021094	SHEET NUMBER
PROJECT DATE SEPTEMBER 6, 2023	FS2.04
CHECKED BY T.M.M.	

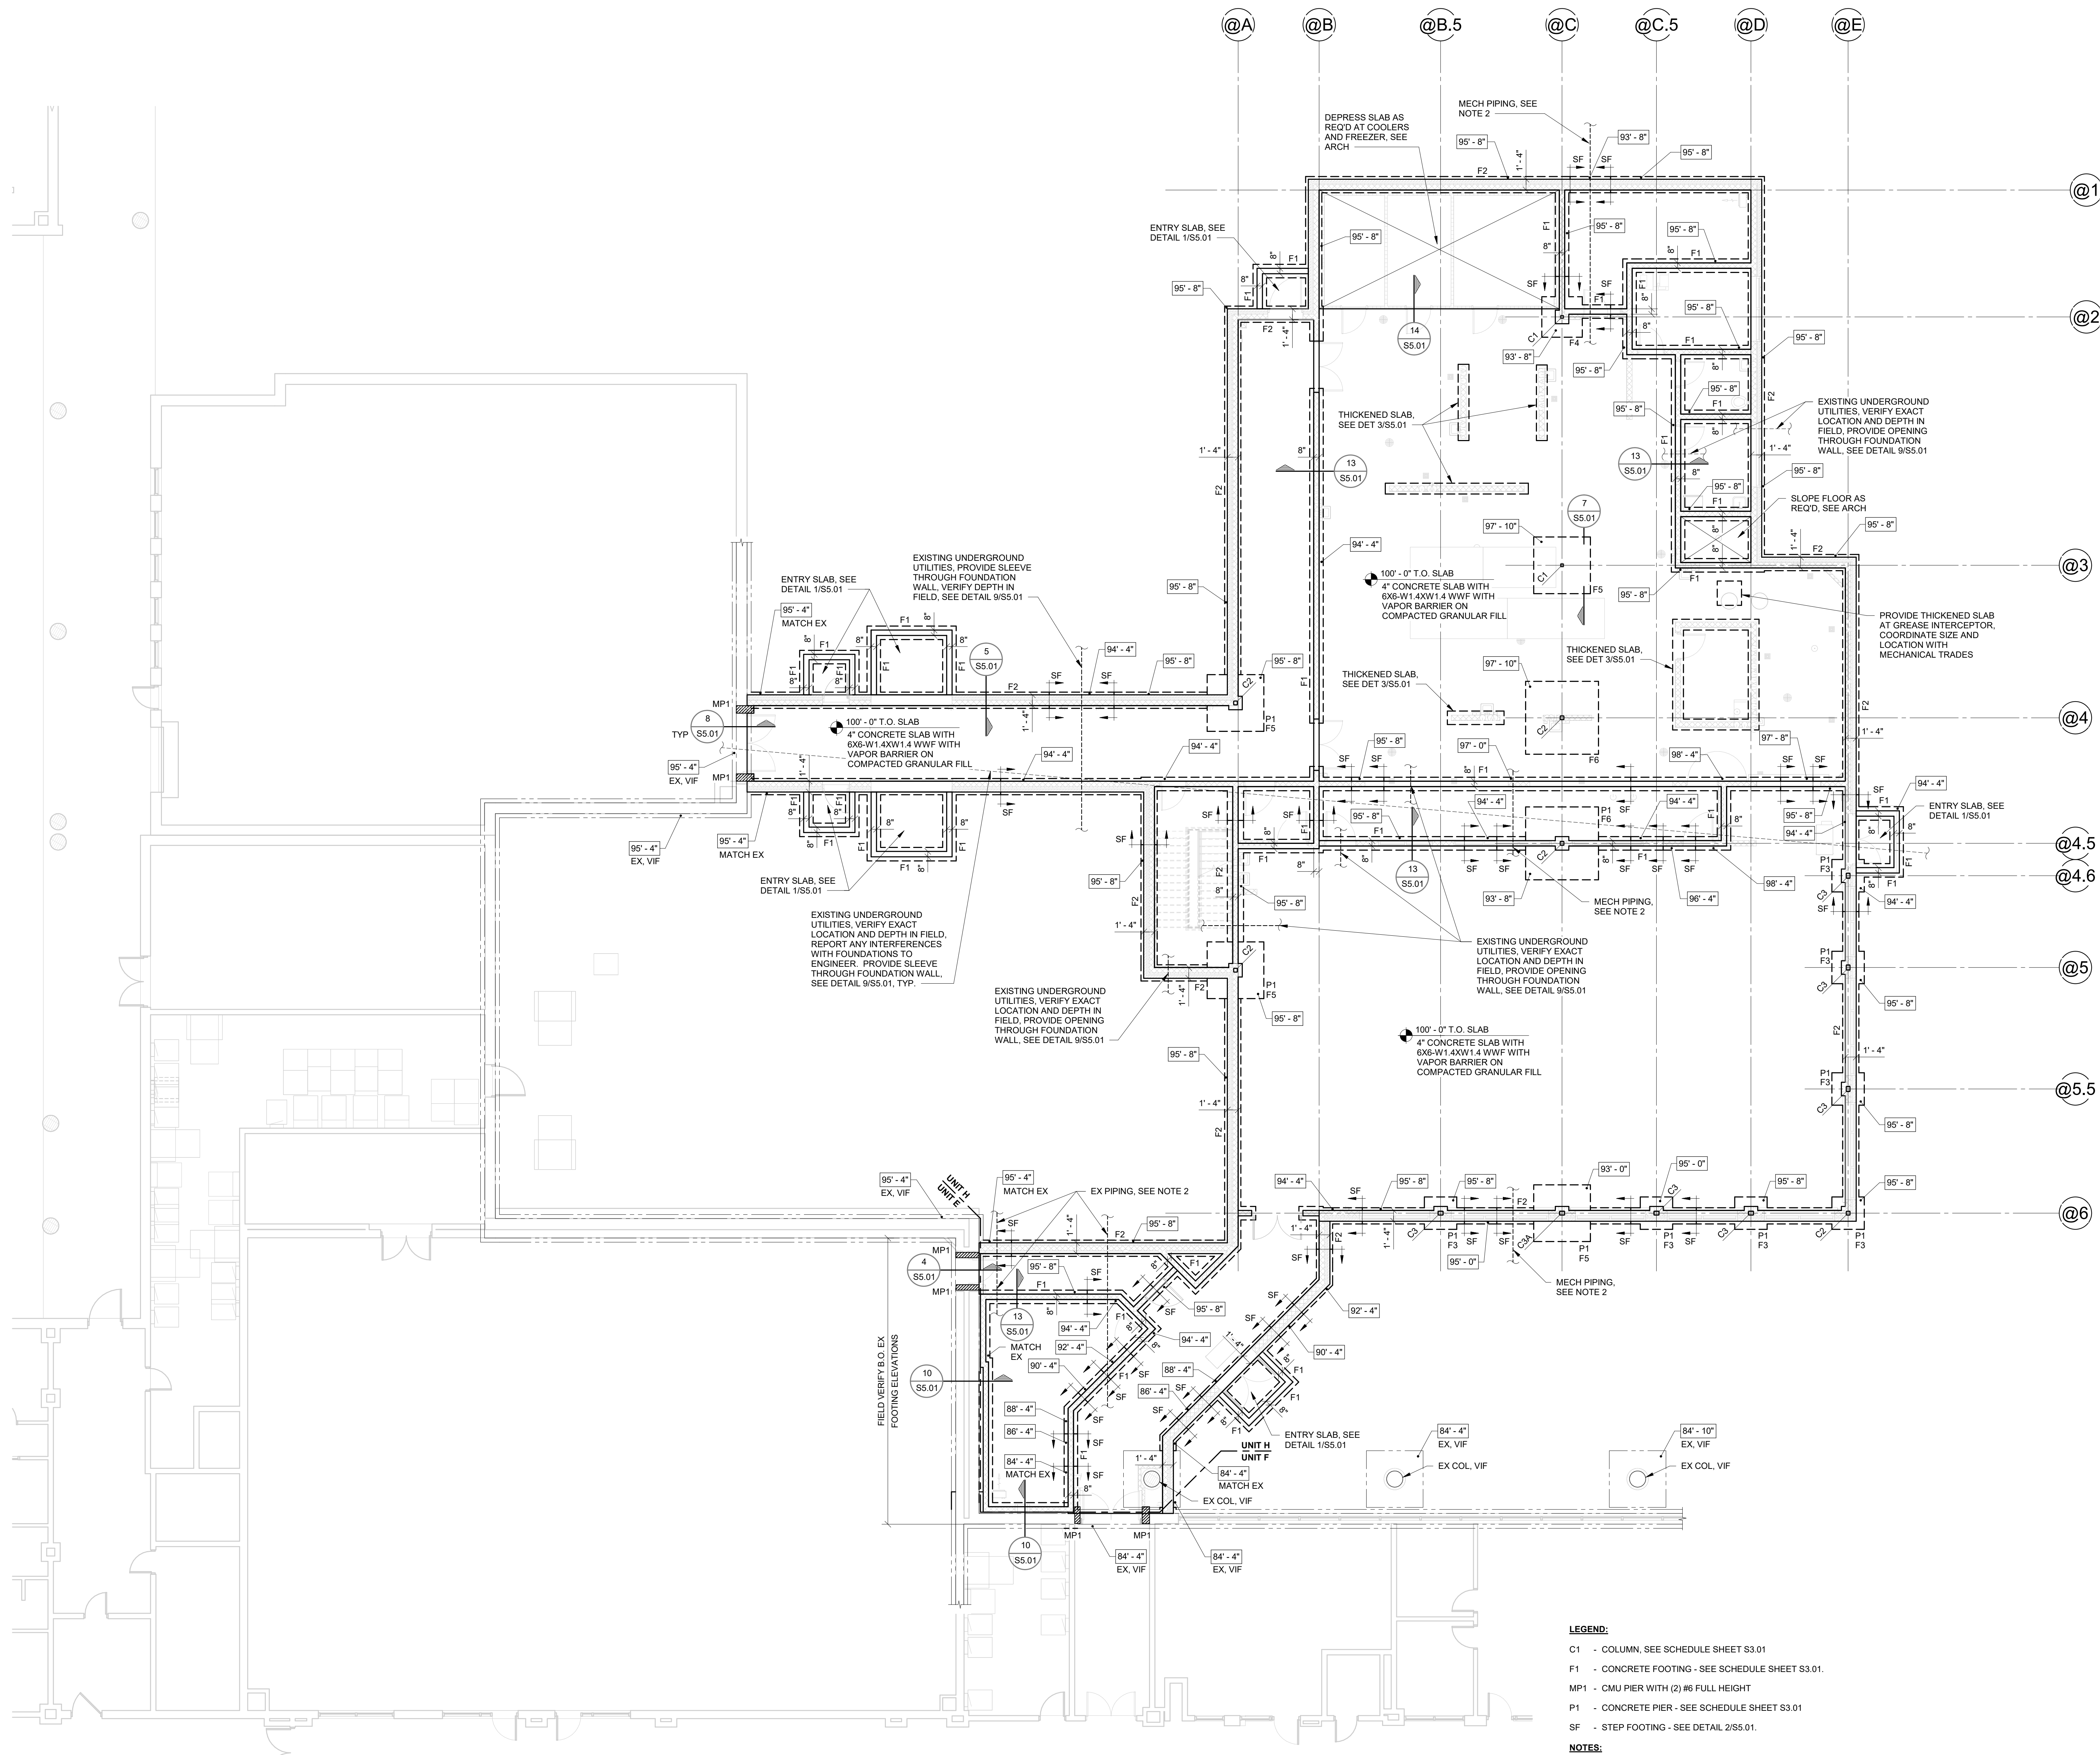

LEGEND:
 C1 - COLUMN, SEE SCHEDULE SHEET S3.01
 F1 - CONCRETE FOOTING - SEE SCHEDULE SHEET S3.01
 MP1 - CMU PIER WITH (2) #6 FULL HEIGHT
 P1 - CONCRETE PIER - SEE SCHEDULE SHEET S3.01
 SF - STEP FOOTING - SEE DETAIL 2/S5.01

NOTES:
 1. SEE SHEET S3.01 FOR GENERAL NOTES
 2. PROVIDE PIPE SLEEVE AT PIPE PENETRATIONS THROUGH FOUNDATION WALL. COORDINATE SIZE AND LOCATION WITH MECHANICAL TRADES, TYP. SEE DETAIL 1/S5.01 FOR PIPE SLEEVES THROUGH CONCRETE FOUNDATION WALLS.

FOUNDATION PLAN
 1/8" = 1'-0"
 BOTTOM OF FOOTING ELEVATION = 95'-8" (UNO)


NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, RA, DIRECTOR

FILE NO.
 491/20167.SDW

FUNDING CODE
 171CODHHS7255

CONTRACT NO.
 Y22003

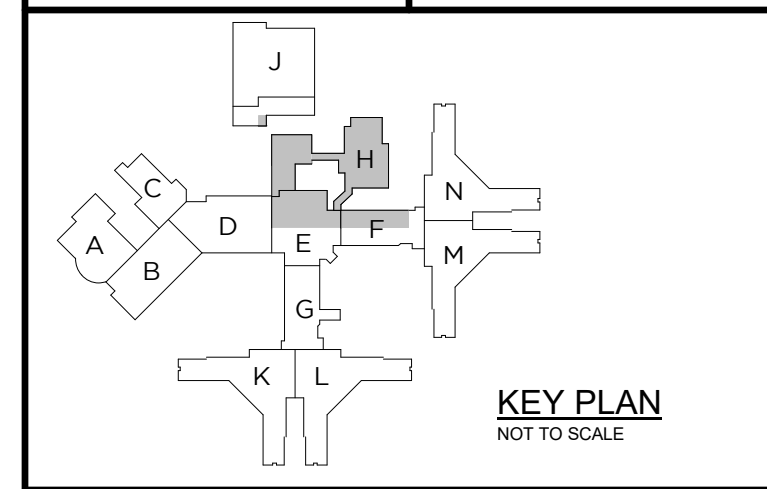

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
 Saginaw, Michigan 48607
 989.752.8107

MACMILLAN ASSOCIATES
 CONSULTING ENGINEERS
 1000 W. Grand Ave., Suite 1000
 Grand Rapids, Michigan 49503

PROJECT TITLE
 491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
 PSYCHIATRY - CREATE
 KITCHEN**
 SALINE, MICHIGAN


SHEET TITLE
FOUNDATION PLAN

PROJECT NUMBER
 2021094


SHEET NUMBER
S2.01

PROJECT DATE
 SEPTEMBER 6, 2023


CHECKED BY
 JAG

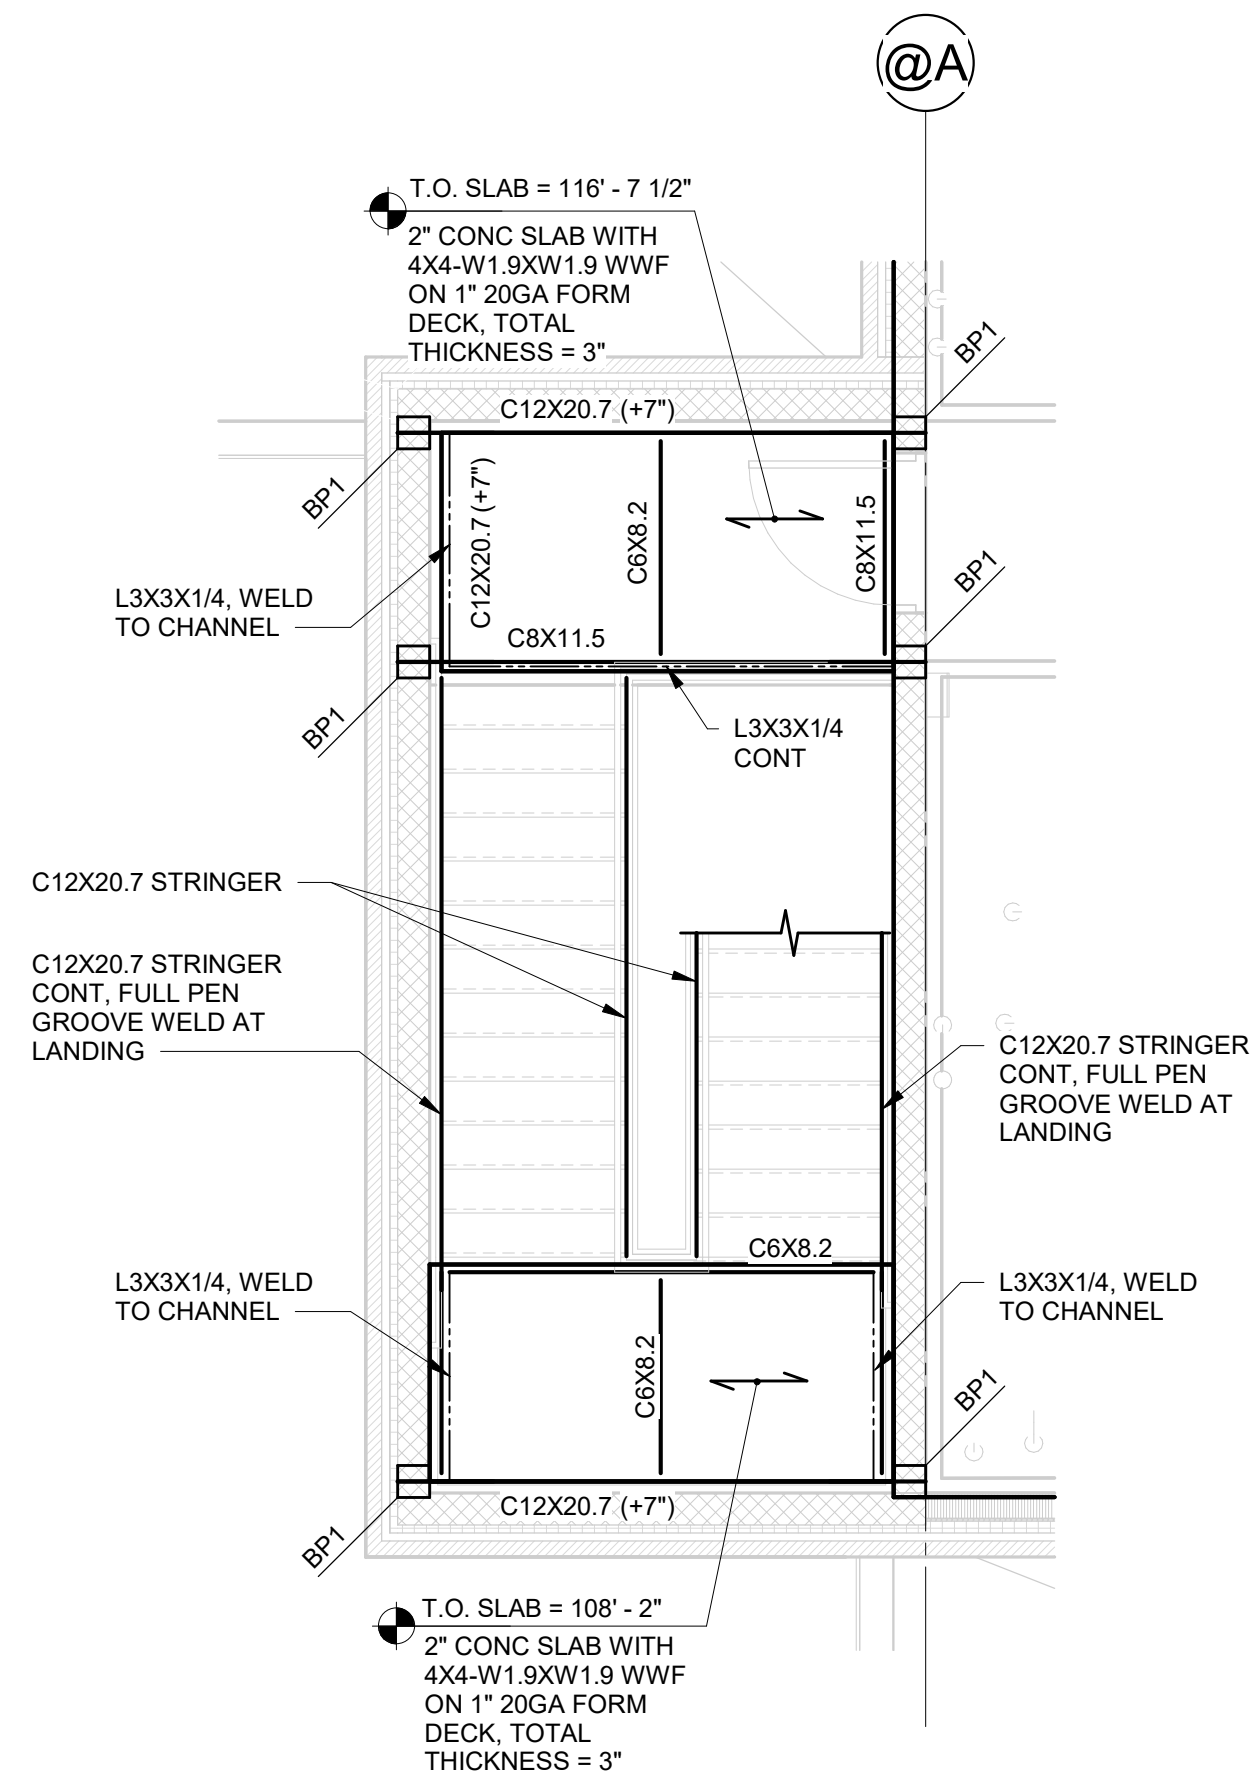

STAIR FRAMING PLAN
1/4" = 1'-0" T.O. STEEL = B.O. DECK UNO (+0'-0")

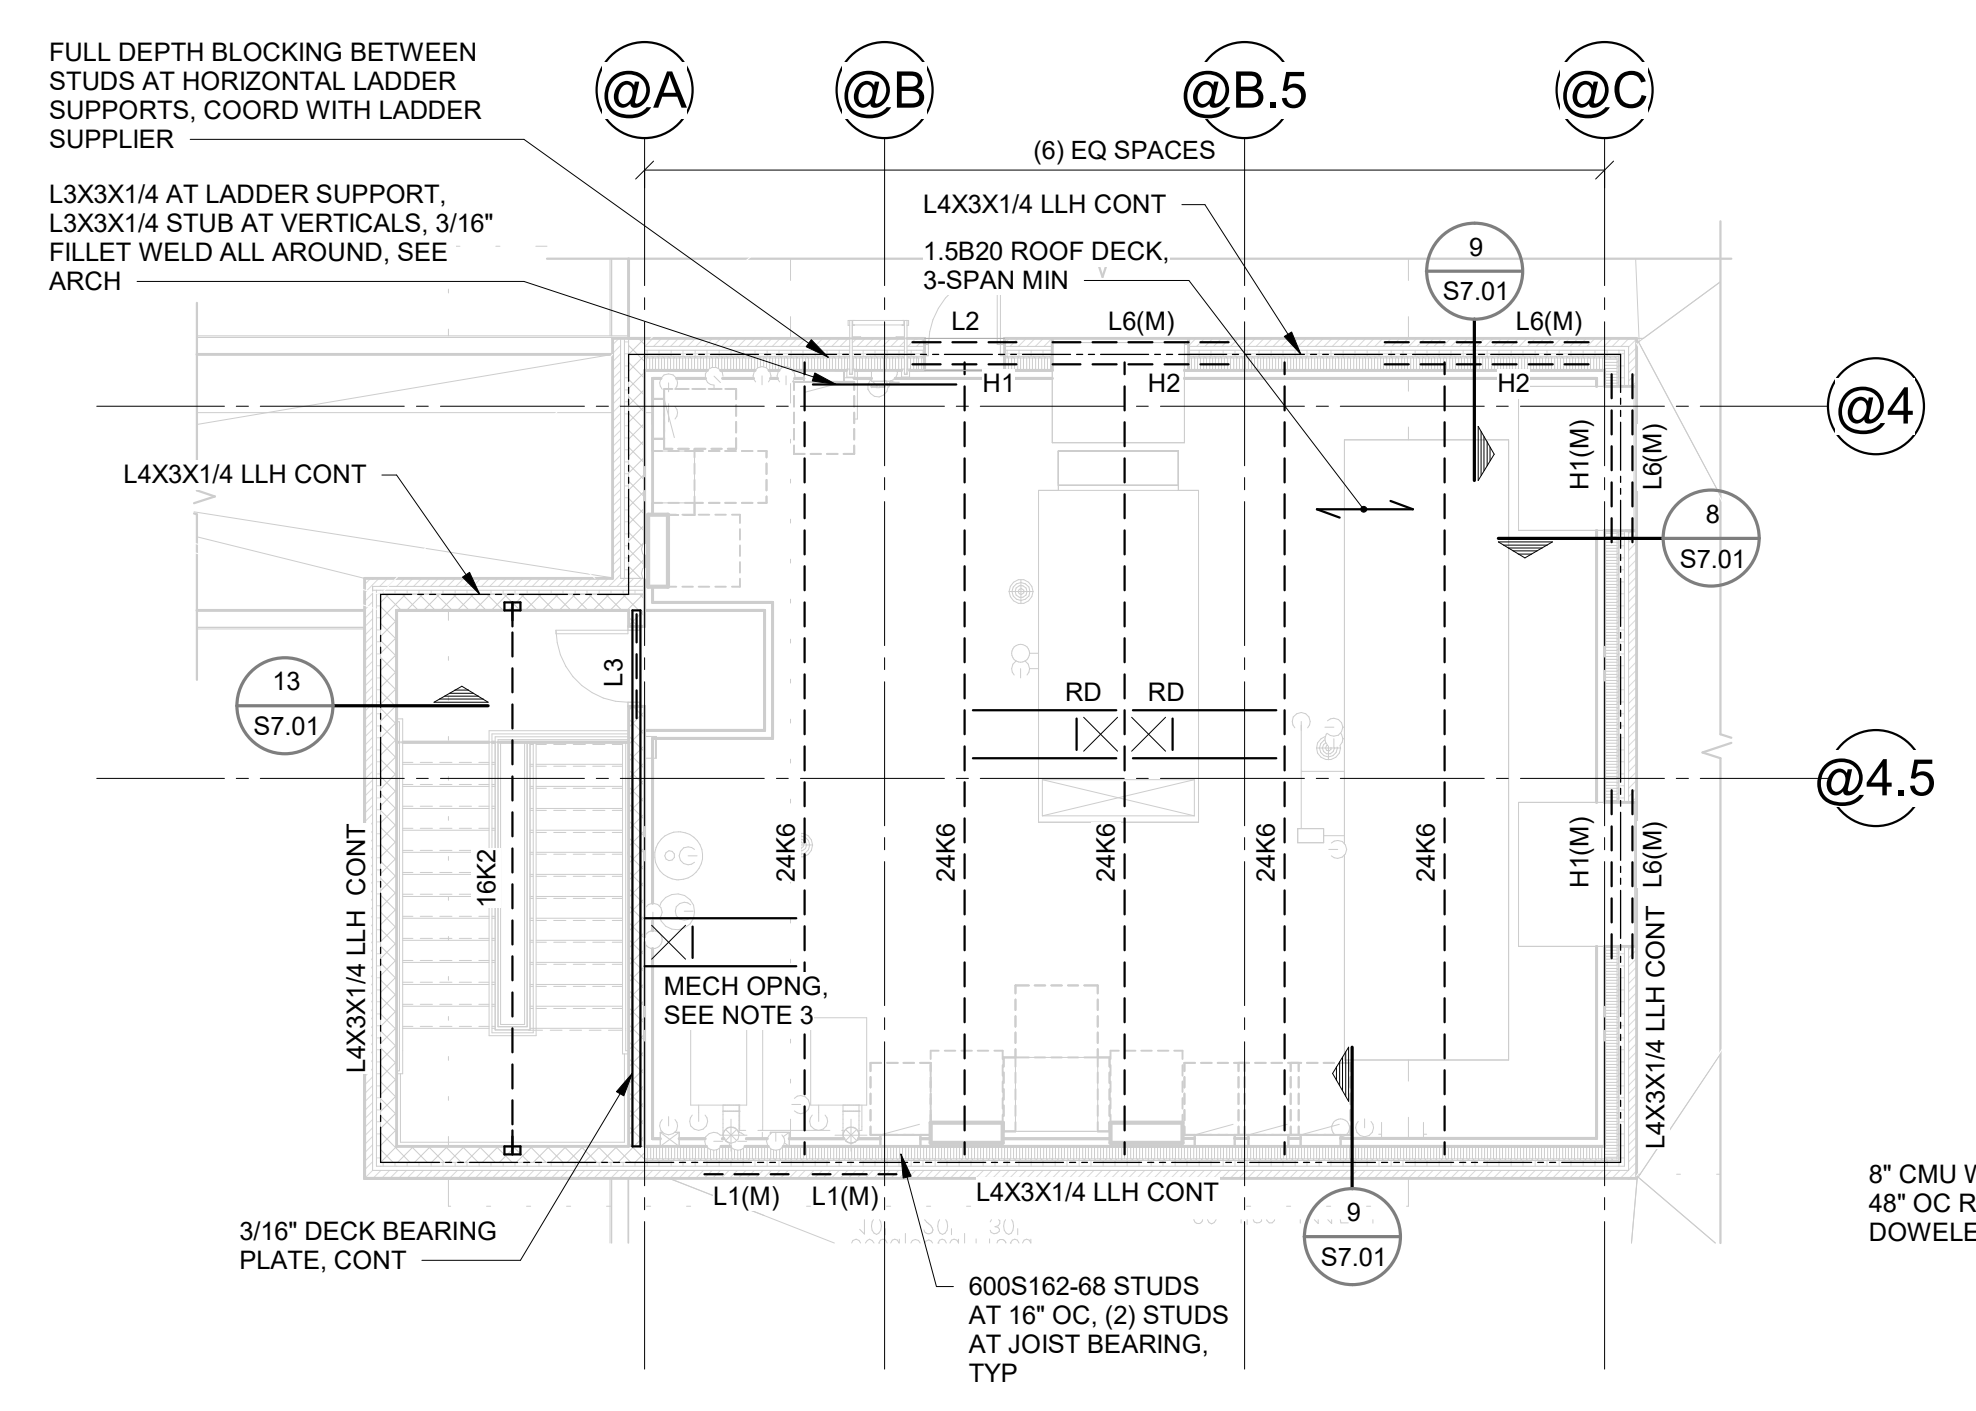

MECH PENTHOUSE ROOF FRAMING PLAN
1/8" = 1'-0" B.O. DECK = 128'-8" T.O. STEEL = B.O. DECK UNO (+0'-0")

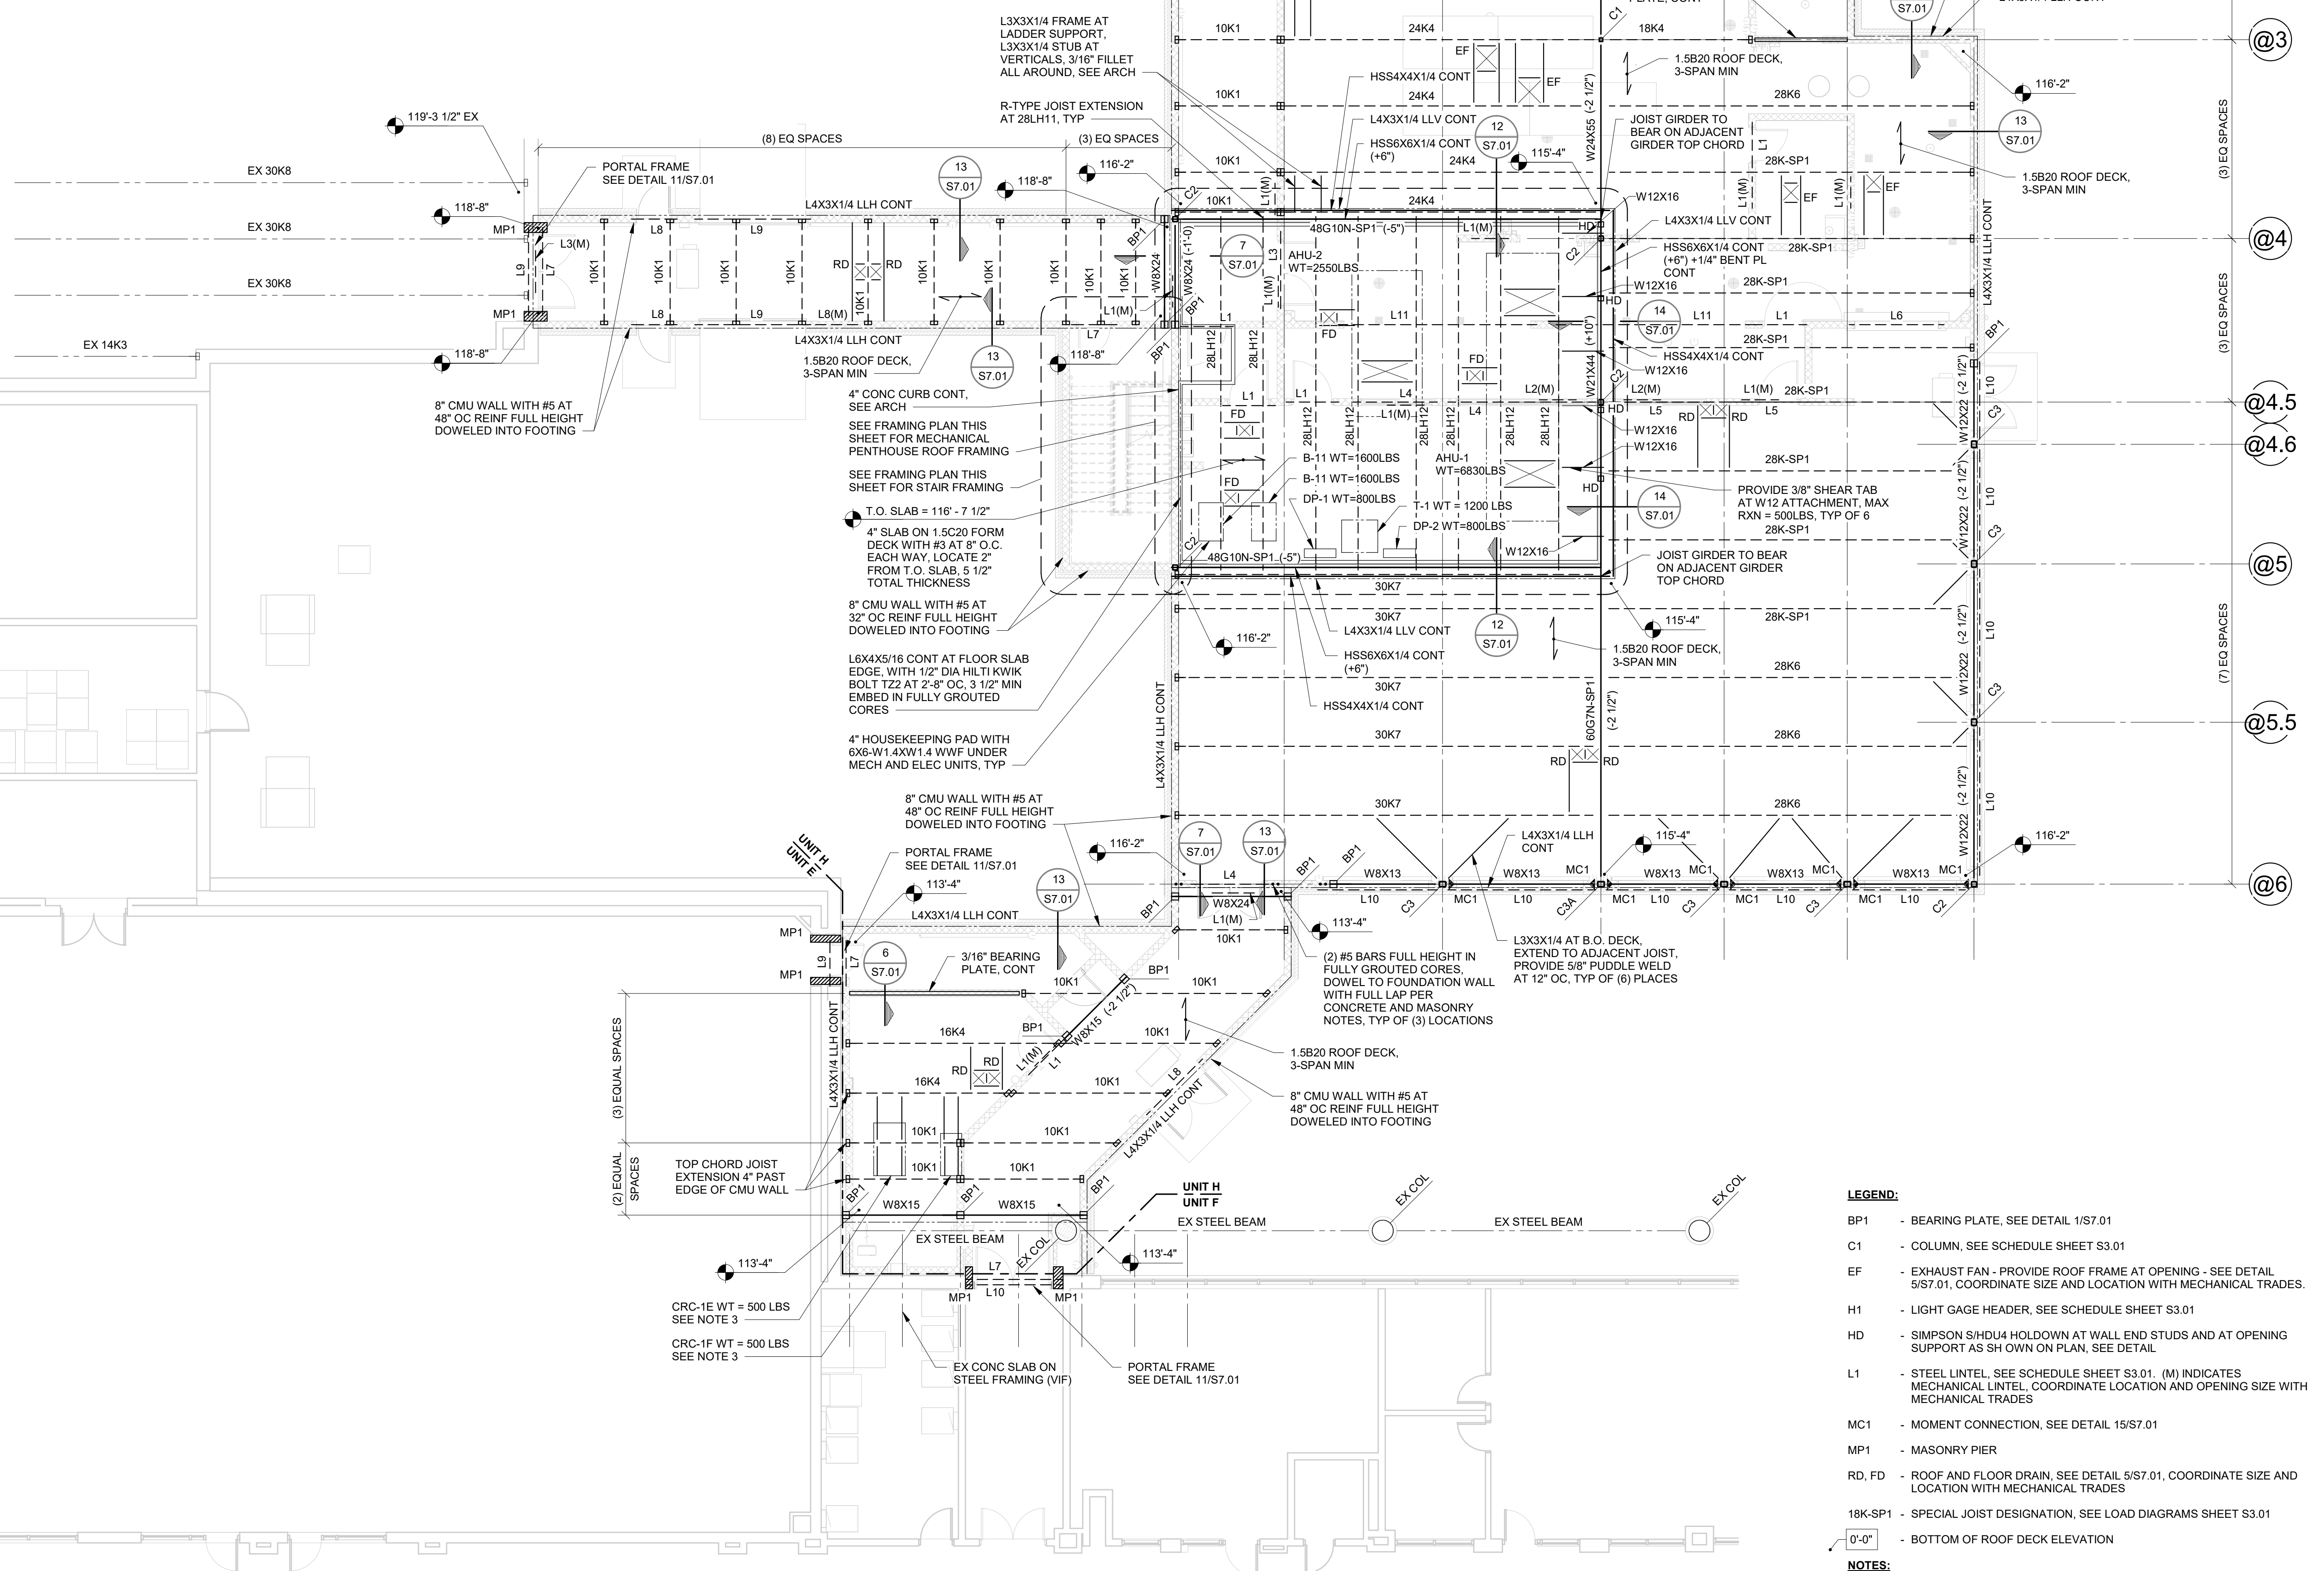

ROOF / PENTHOUSE FLOOR FRAMING PLAN
1/8" = 1'-0" T.O. STEEL = B.O. DECK UNO (+0'-0")

- LEGEND:**
- BP1 - BEARING PLATE, SEE DETAIL 1/S7.01
 - C1 - COLUMN, SEE SCHEDULE SHEET S3.01
 - EF - EXHAUST FAN - PROVIDE ROOF FRAME AT OPENING - SEE DETAIL 5/S7.01, COORDINATE SIZE AND LOCATION WITH MECHANICAL TRADES.
 - H1 - LIGHT GAGE HEADER, SEE SCHEDULE SHEET S3.01
 - HD - SIMPSON SHDU4 HOLDOWN AT WALL END STUDS AND AT OPENING SUPPORT AS SH OWN ON PLAN, SEE DETAIL
 - L1 - STEEL LINTEL, SEE SCHEDULE SHEET S3.01. (M) INDICATES MECHANICAL LINTEL, COORDINATE LOCATION AND OPENING SIZE WITH MECHANICAL TRADES.
 - MC1 - MOMENT CONNECTION, SEE DETAIL 15/S7.01
 - MP1 - MASONRY PIER
 - RD, FD - ROOF AND FLOOR DRAIN, SEE DETAIL 5/S7.01, COORDINATE SIZE AND LOCATION WITH MECHANICAL TRADES
 - 18K-SP1 - SPECIAL JOIST DESIGNATION, SEE LOAD DIAGRAMS SHEET S3.01
 - 0'-0" - BOTTOM OF ROOF DECK ELEVATION
- NOTES:**
1. SEE SHEET S3.01 FOR GENERAL NOTES
 2. ALL 8" CMU WALLS REINFORCED WITH #4 AT 48" OC, UNO.
 3. PROVIDE FRAMING UNDER MECHANICAL UNIT CURBS PER DETAIL 5/S7.01, COORDINATE SIZE AND LOCATION WITH MECHANICAL, TYP.
 4. JOIST GIRDERS TO BEAR DIRECTLY ON COLUMN UNO.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO:
491/20167.SDW

FUNDING CODE
17ICODHHS7255

CONTRACT NO.
Y22003

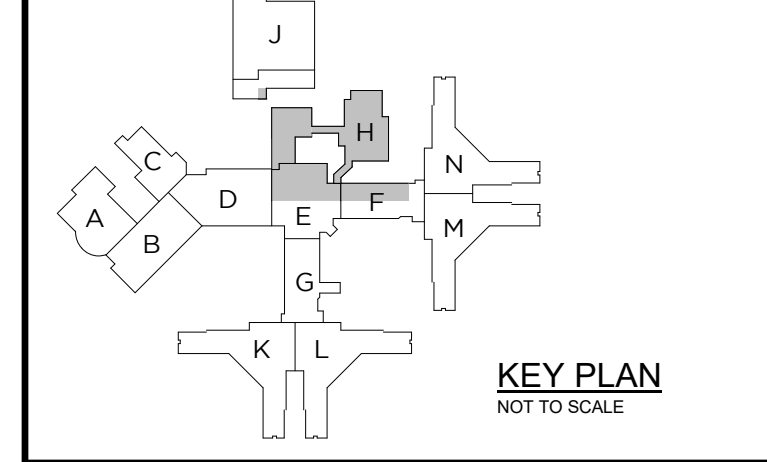

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989.752.8107 COPYRIGHT © 2023

MACMILLAN ASSOCIATES
CONSULTING ENGINEERS
7000 W. MICHIGAN STREET, SUITE 200, BENTON HARBOR, MI 48021
(800) 894-4300 T (800) 894-9799 WWW.MACMILLANASSOCIATES.COM

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN


SHEET TITLE
ROOF FRAMING PLAN

PROJECT NUMBER
2021094


PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
JAG


SHEET NUMBER
S2.02

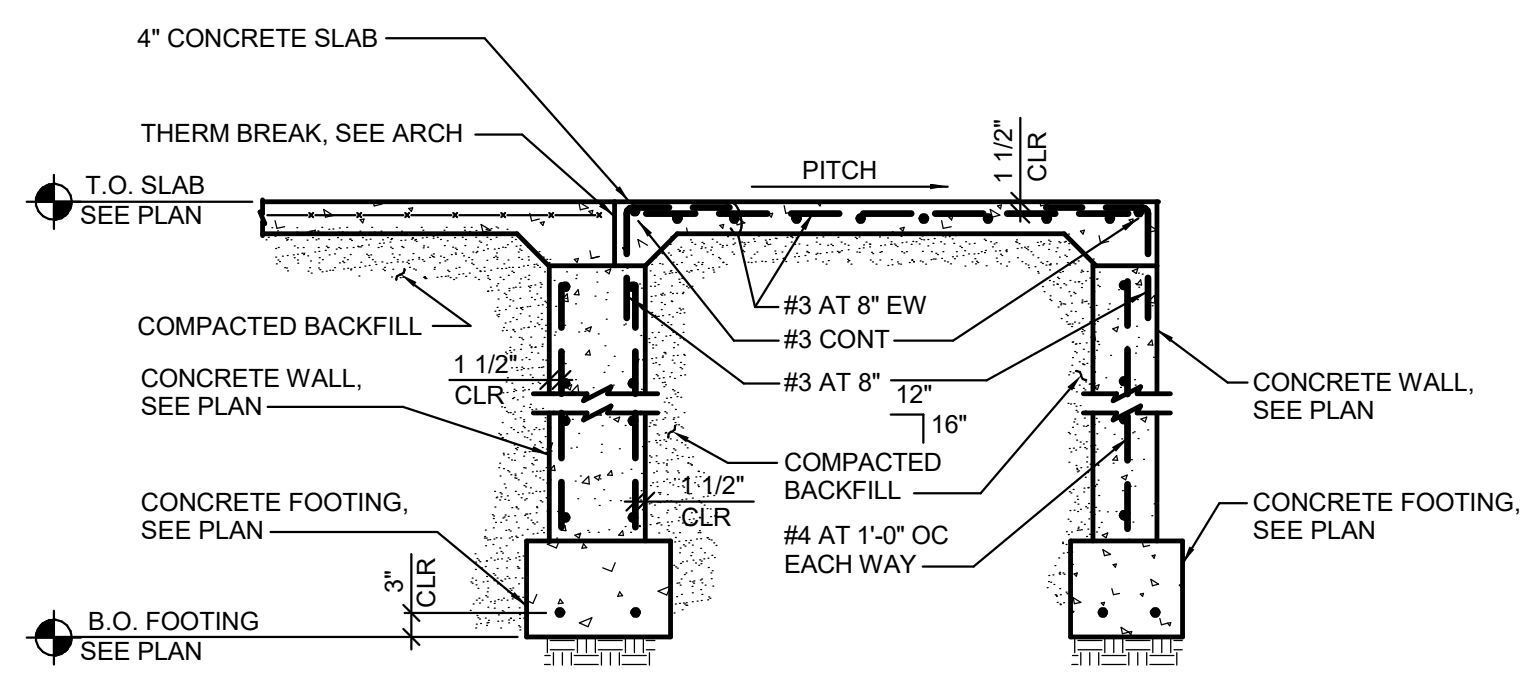


1 ENTRY SLAB
S5.01 1/2" = 1'-0"

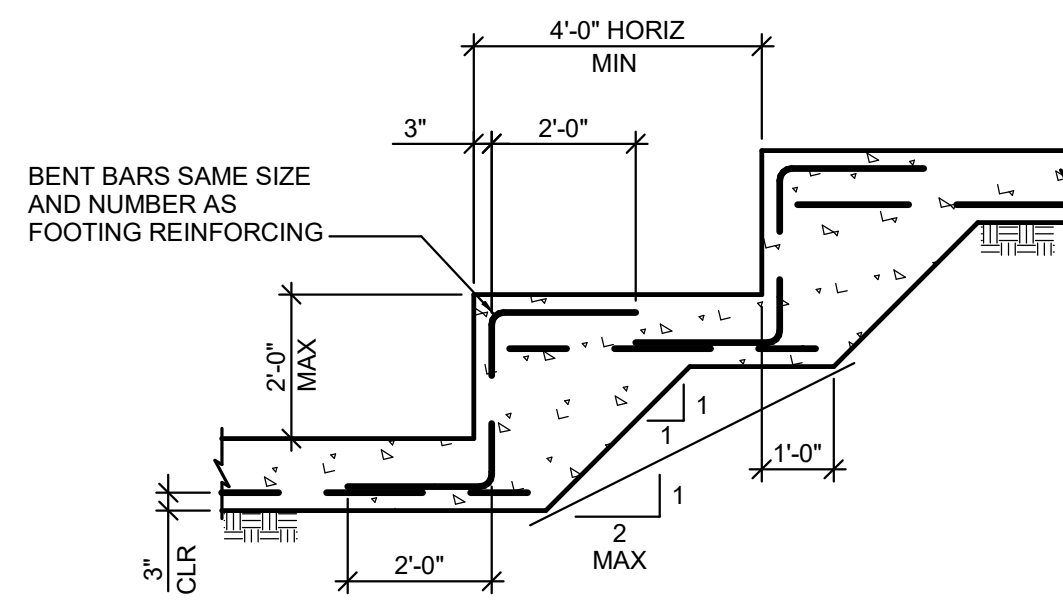


2 STEP FOOTING
S5.01 3/8" = 1'-0"

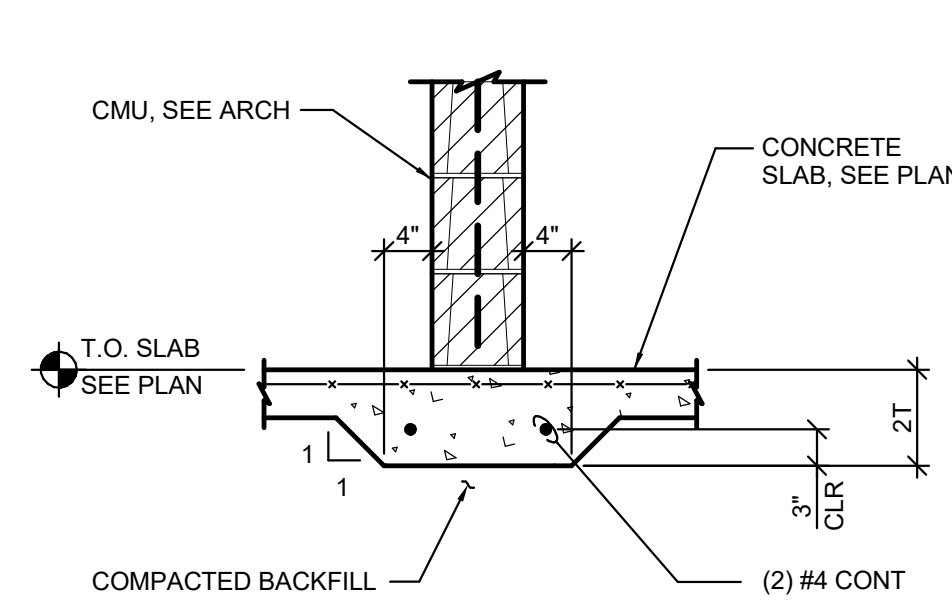


3 THICKENED SLAB
S5.01 3/4" = 1'-0"

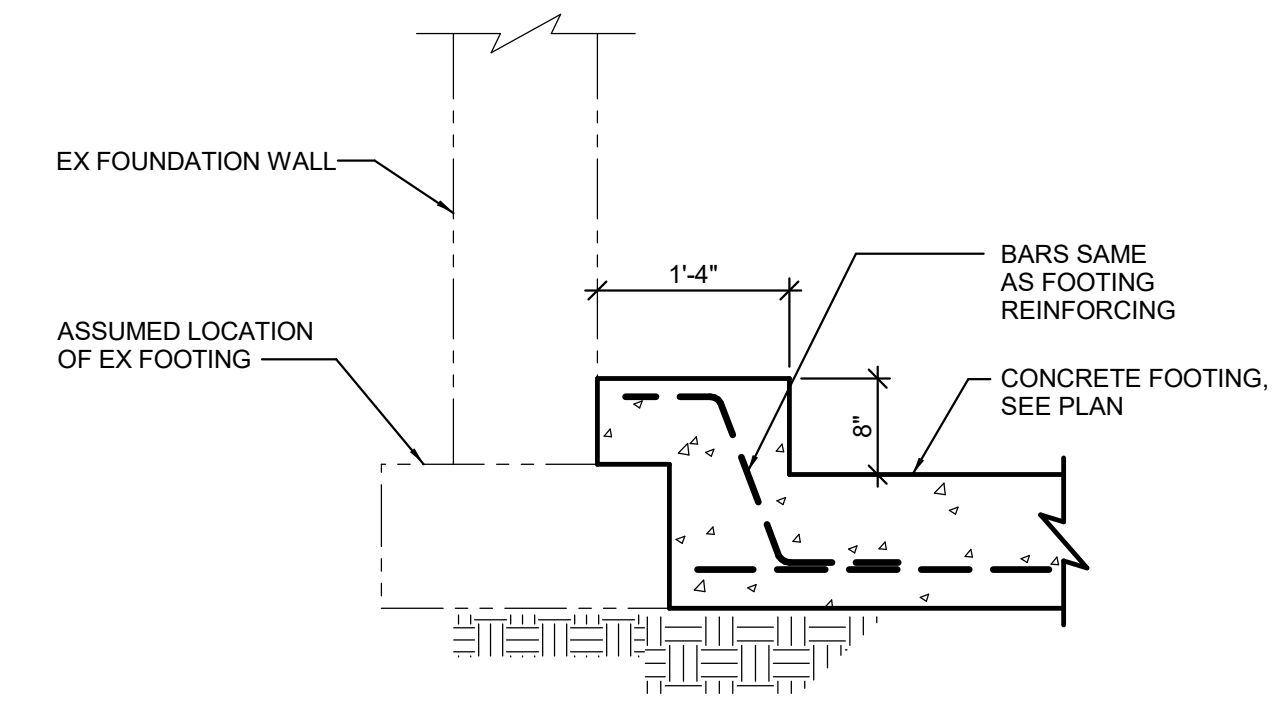


4 NEW FOOTING AT EXISTING
S5.01 3/4" = 1'-0"

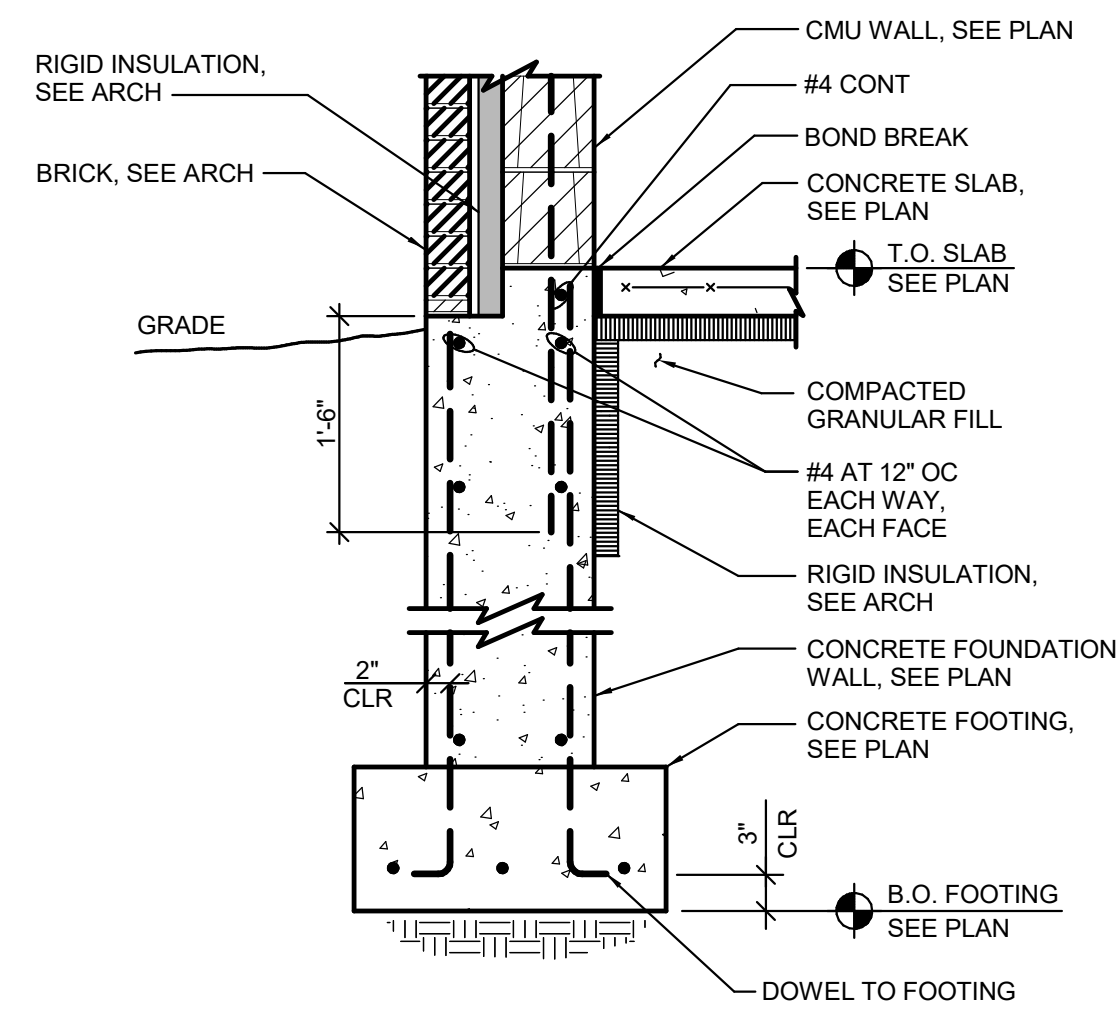


5 EXTERIOR WALL FOOTING
S5.01 3/4" = 1'-0"

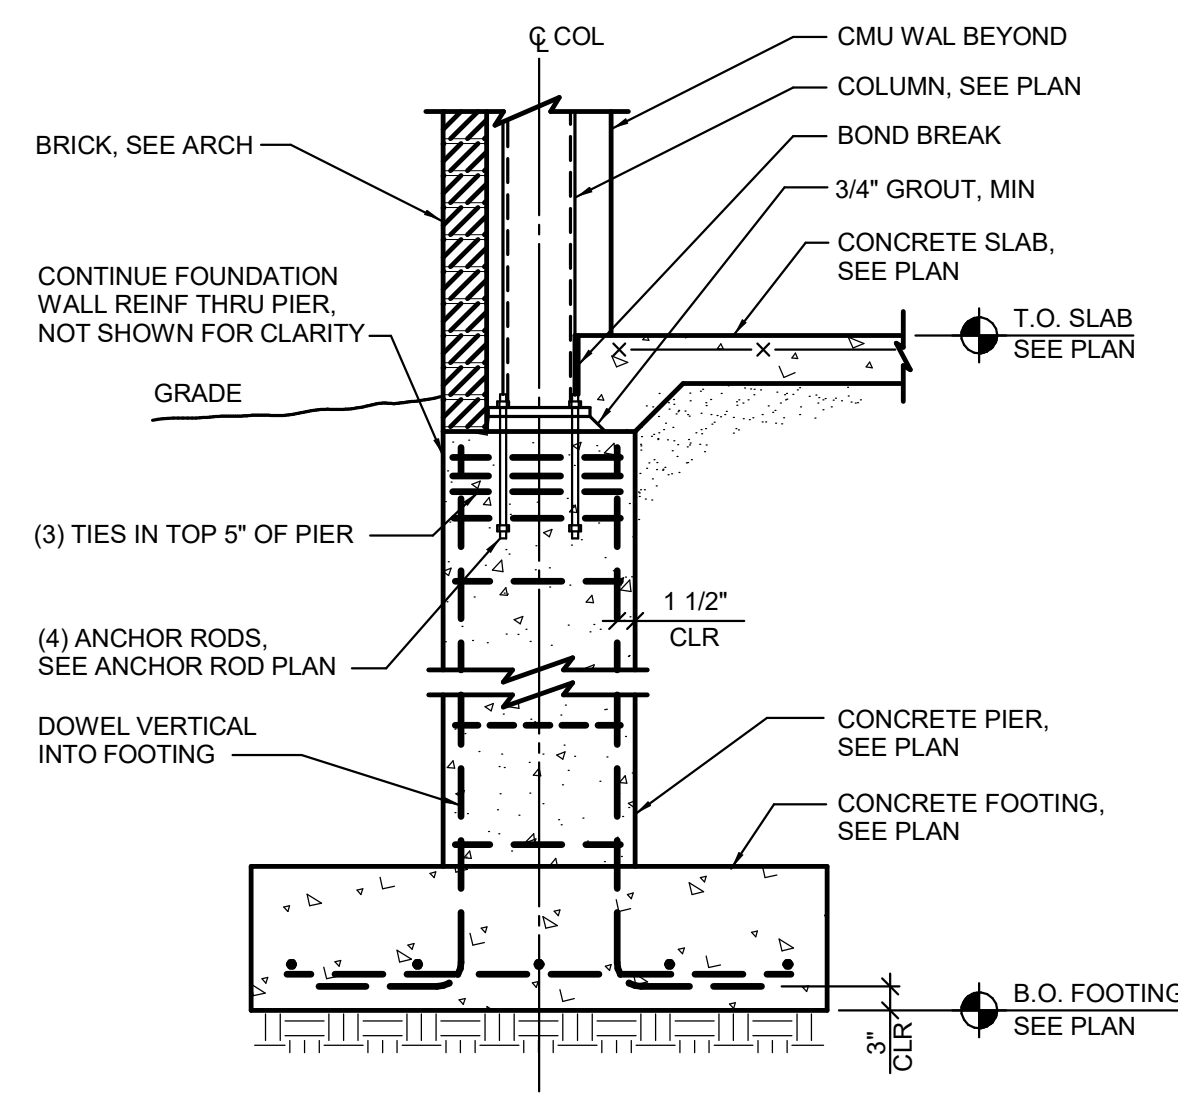


6 COLUMN FOOTING WITH PIER
S5.01 3/4" = 1'-0"

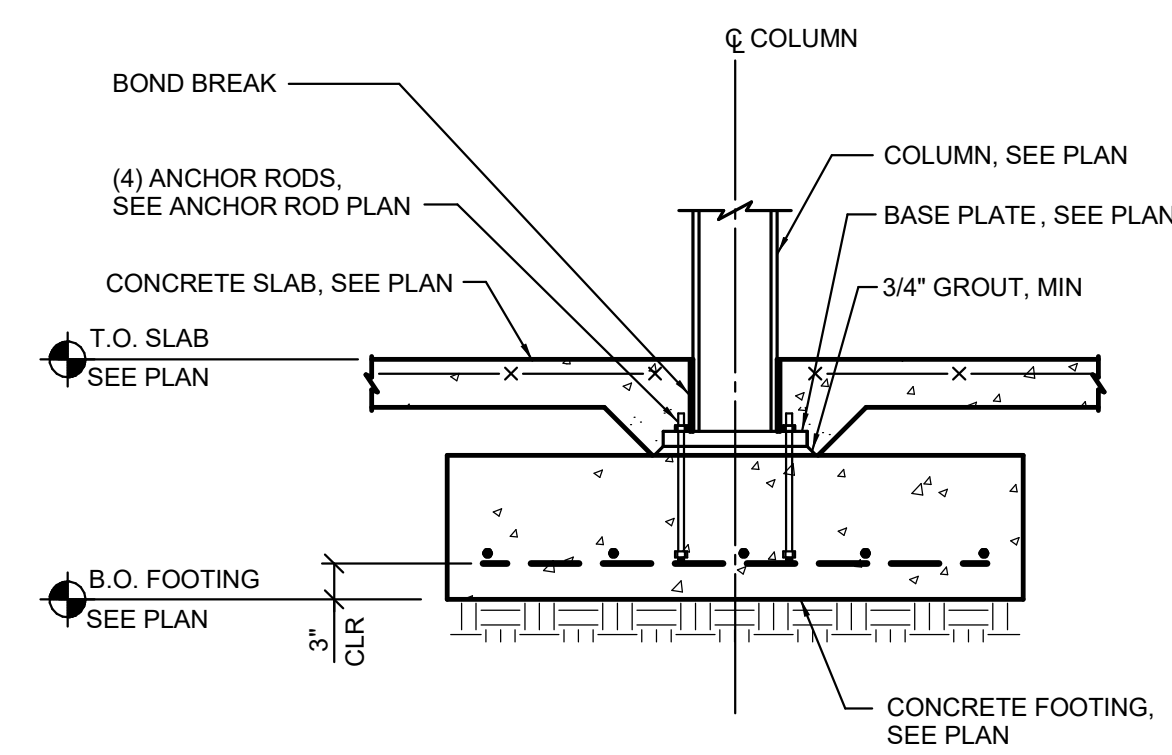


7 INTERIOR COLUMN FOOTING
S5.01 3/4" = 1'-0"

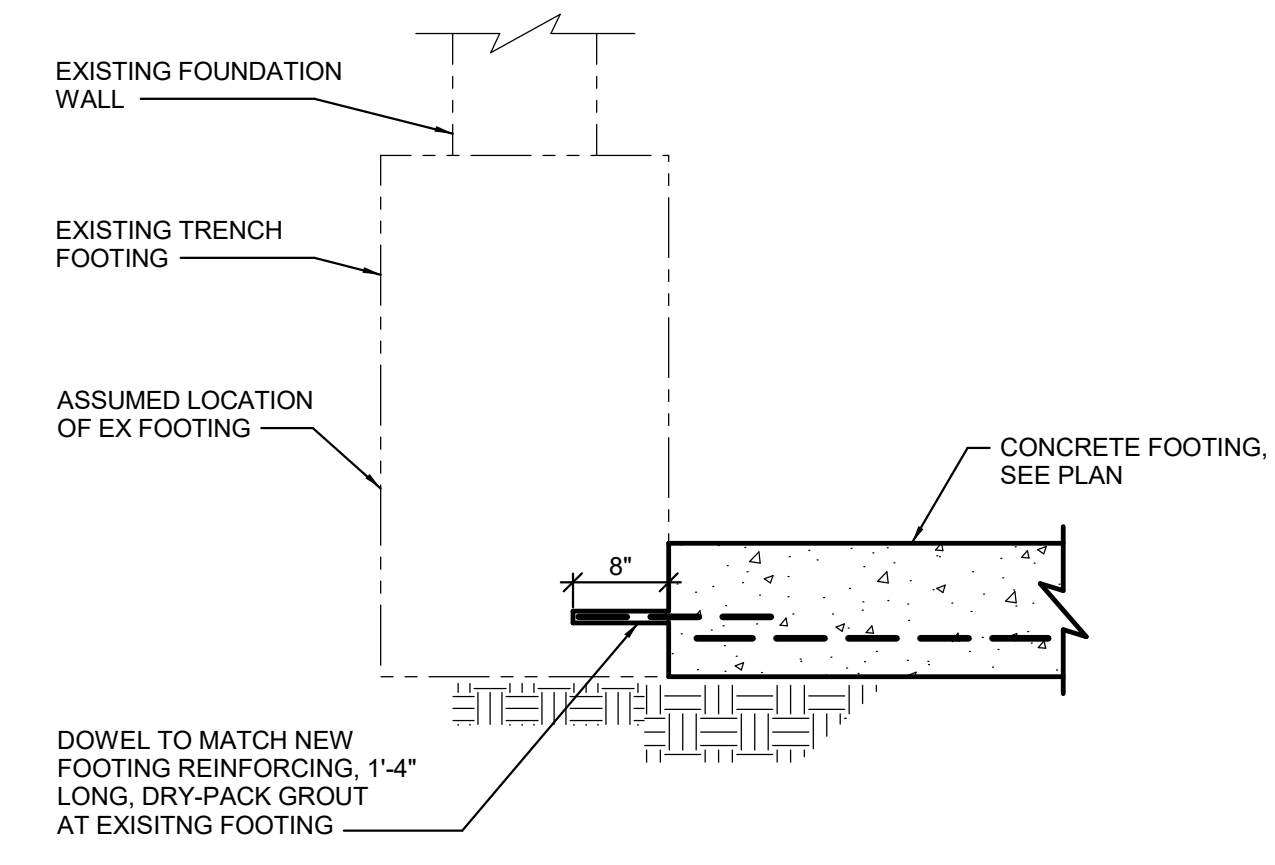


8 NEW FOOTING AT EXISTING
S5.01 3/4" = 1'-0"

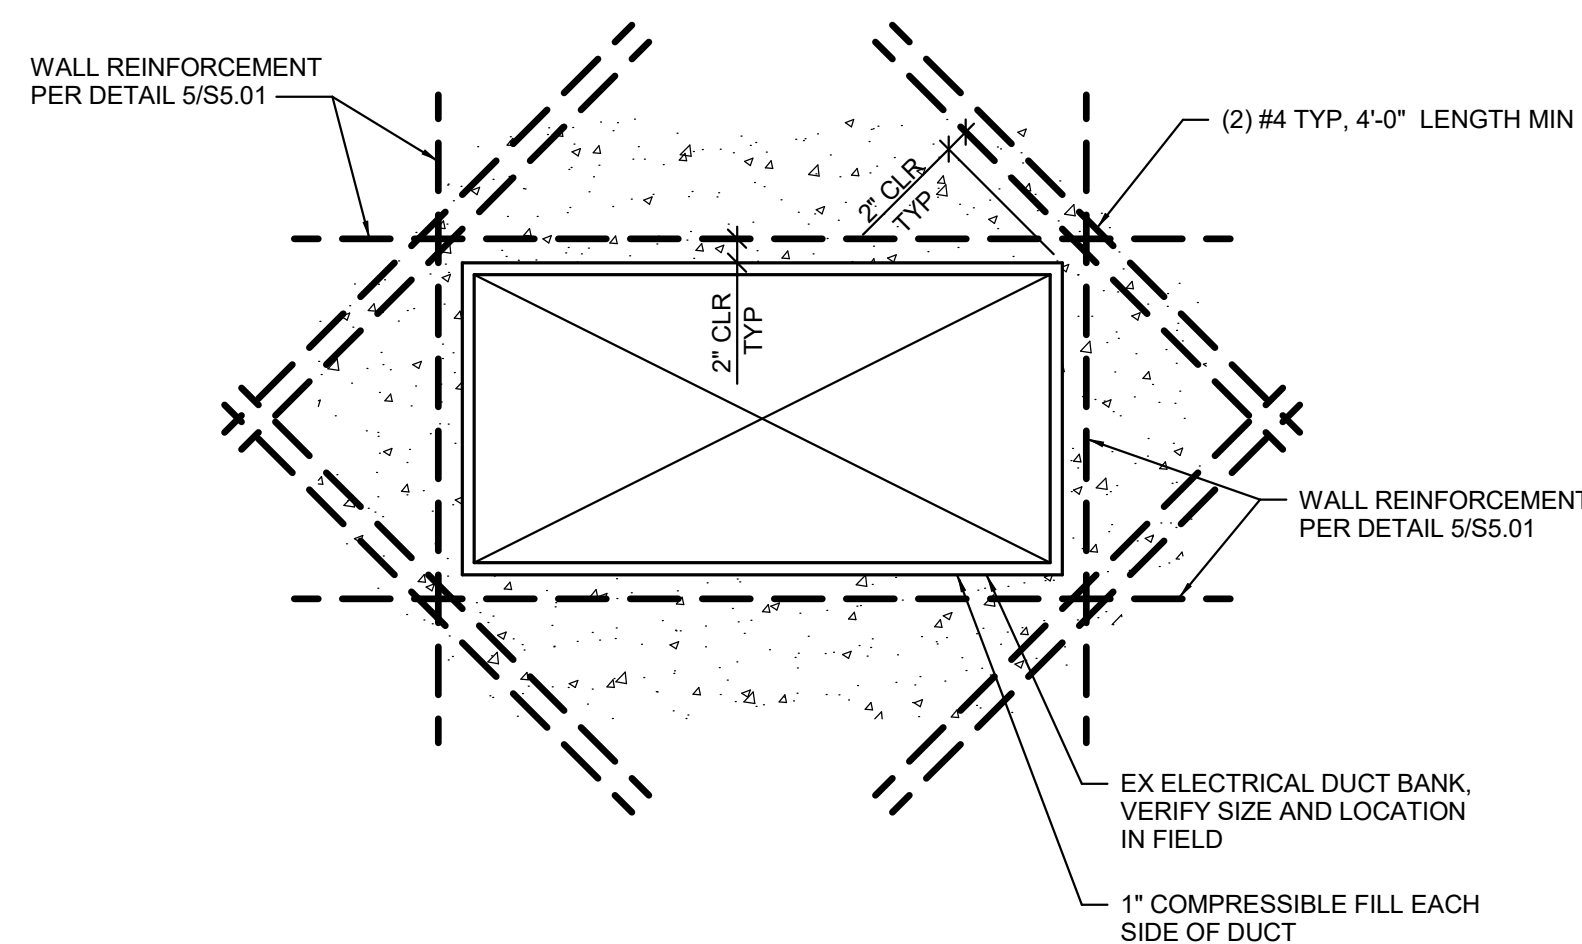


9 WALL REINFORCING AT EXISTING DUCT BANK
S5.01 3/4" = 1'-0"

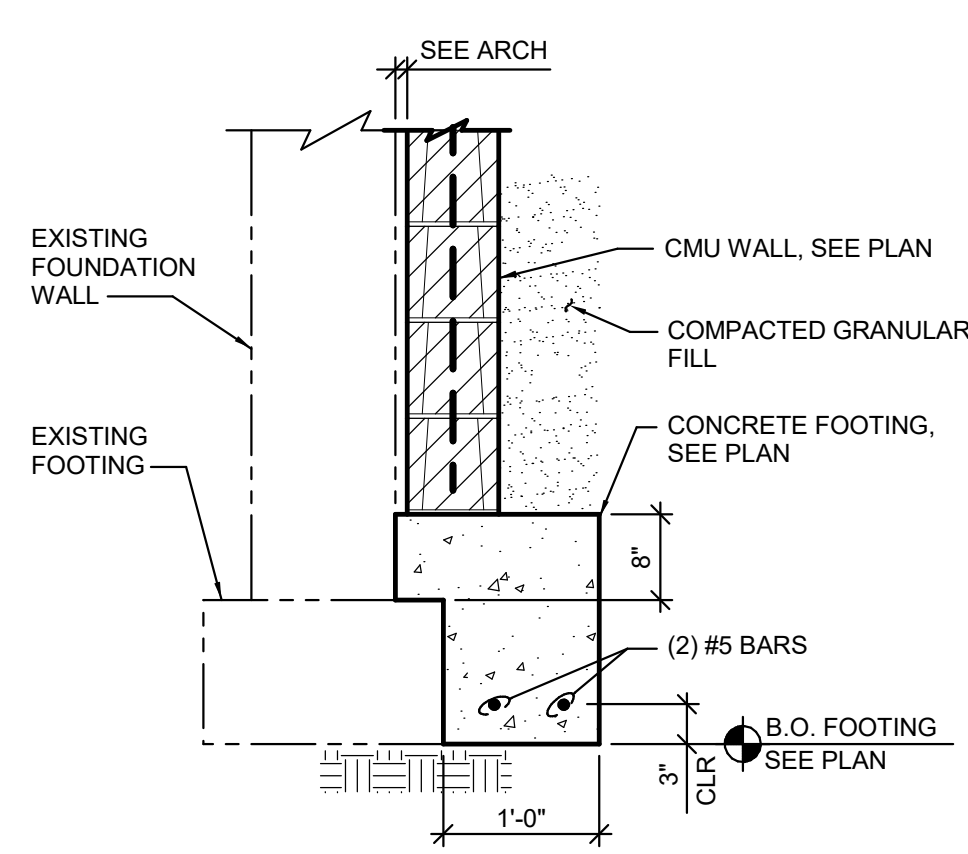


10 FOOTING AT EXISTING
S5.01 3/4" = 1'-0"

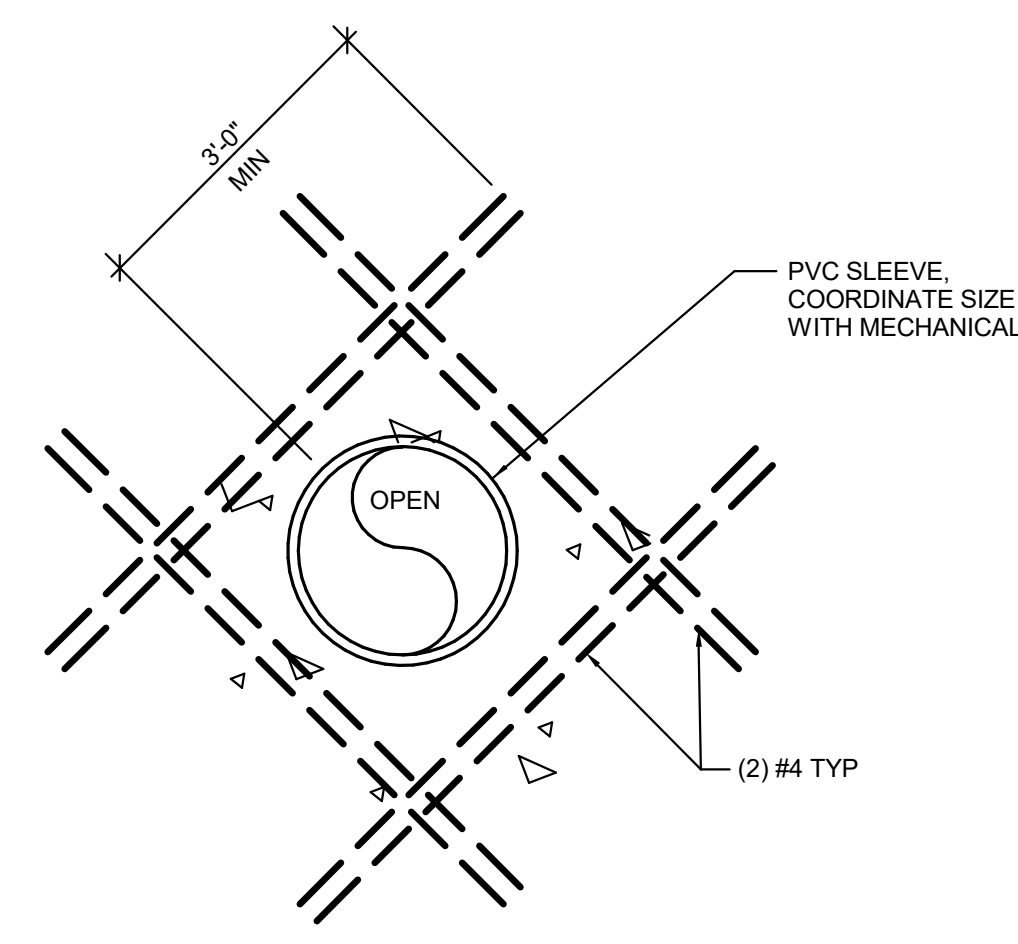


11 WALL OPENING REINFORCEMENT
S5.01 3/4" = 1'-0"

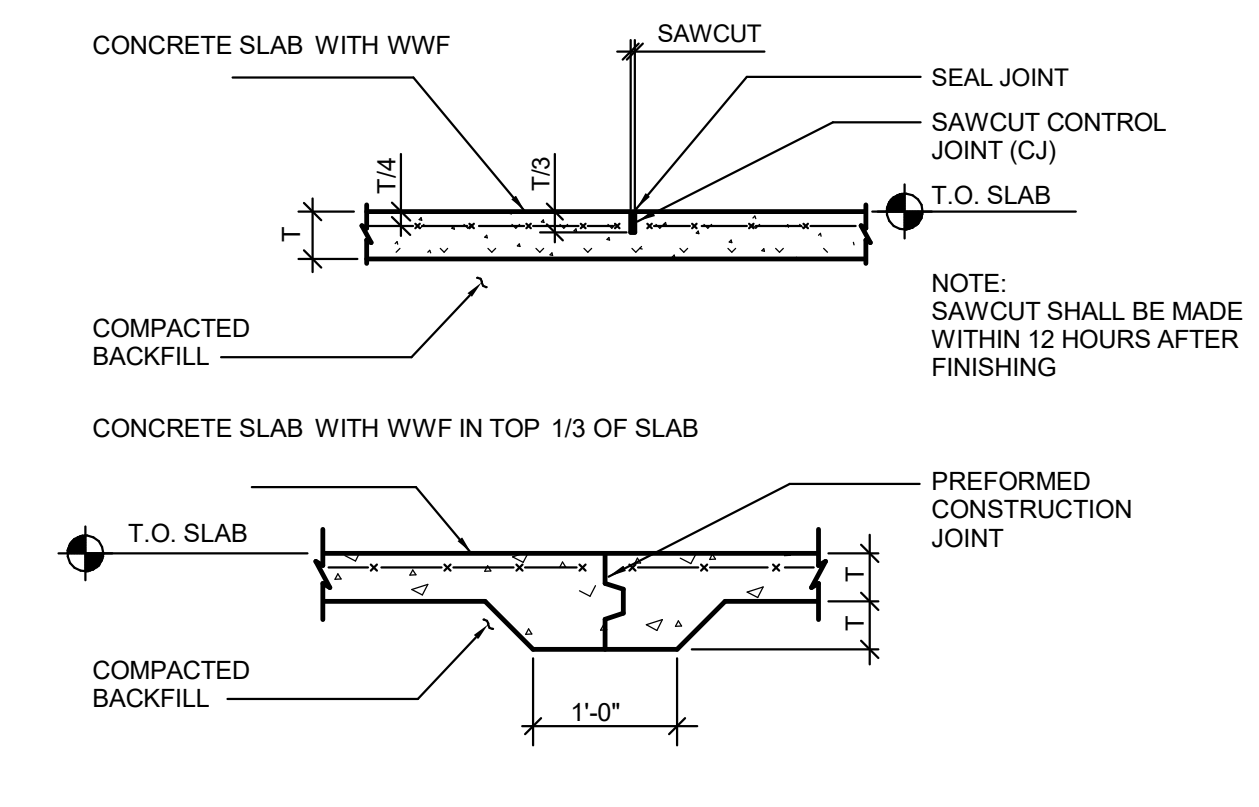

12 CONTROL/CONSTRUCTION JOINTS
S5.01 3/4" = 1'-0"

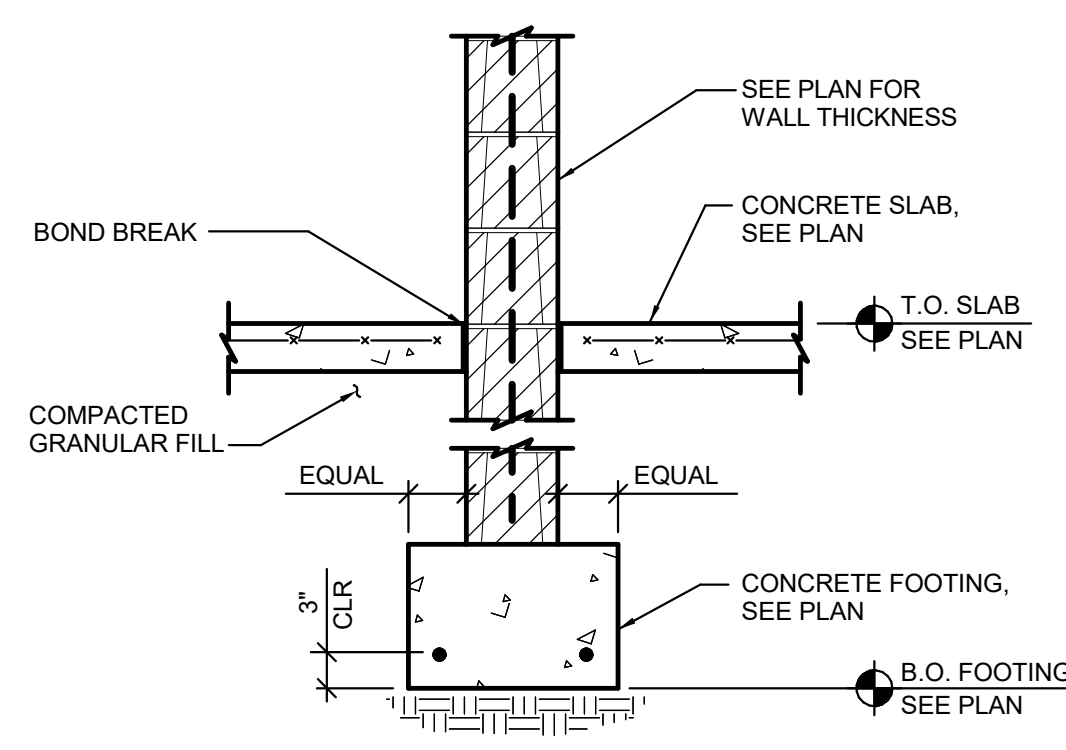

13 INTERIOR WALL FOOTING
S5.01 3/4" = 1'-0"

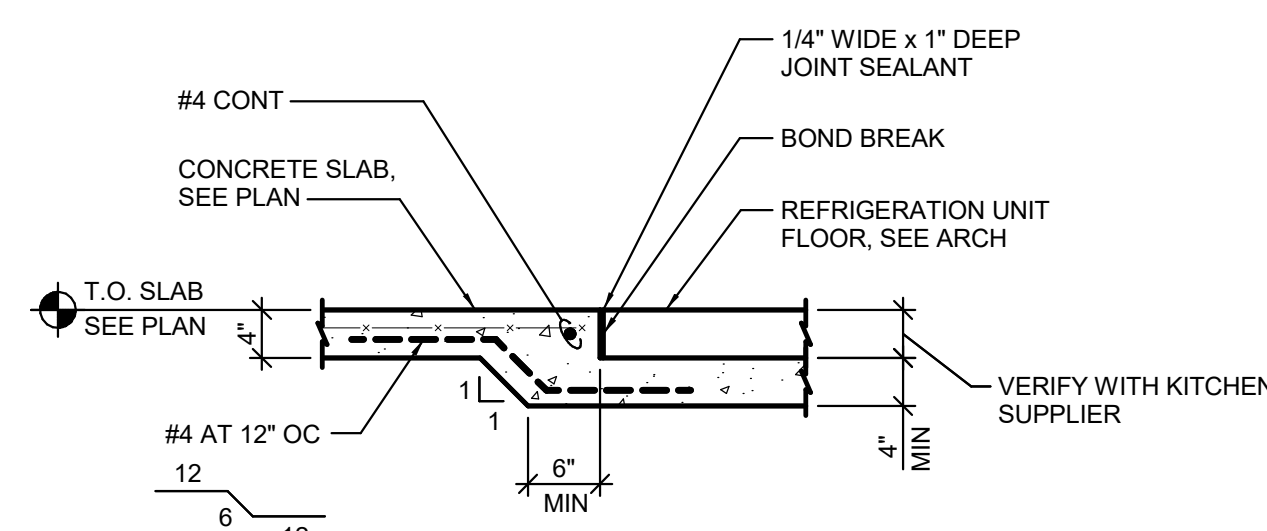


14 FLOOR SLAB EDGE DETAIL
S5.01 3/4" = 1'-0"

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO:
491/20167.SDW

FUNDING CODE: 171CODHHS7255 CONTRACT NO. Y22003

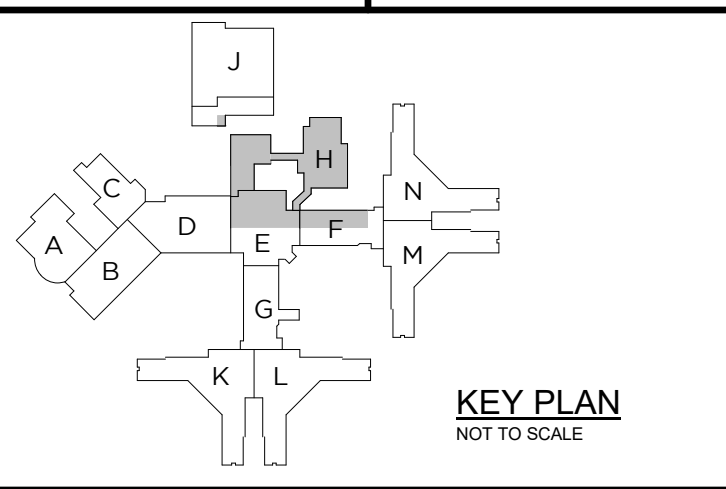

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989.752.8107 COPYRIGHT © 2023

MACMILLAN ASSOCIATES
CONSULTING ENGINEERS

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
FOUNDATION DETAILS

PROJECT NUMBER: 2021094 SHEET NUMBER

PROJECT DATE: SEPTEMBER 6, 2023 **S5.01**

CHECKED BY: JAG

MECHANICAL ABBREVIATION LIST

ABBREVIATION	DESCRIPTION	ABBREVIATION	DESCRIPTION	ABBREVIATION	DESCRIPTION
A	COMPRESSED AIR	FD	FLOOR DRAIN	O	OXYGEN
AL (#)	COMPRESSED AIR (SPECIFIC PSIG)	FFD	FUNNEL FLOOR DRAIN	OA	OUTSIDE AIR
AAV	AUTOMATIC AIR VENT	FH	FIRE HYDRANT	OAT	OUTSIDE AIR TEMPERATURE
ACC	AIR COOLED CONDENSER	FHC	FIRE HOSE CABINET	OB	OUTLET BOX
ACCU	AIR COOLED CONDENSER UNIT	FHR	FIRE HOSE RACK	OBID	OPPOSED BLADE DAMPER
AD	ACCESS DOOR	FHV	FIRE HOSE VALVE	OC	ON CENTER/CENTER TO CENTER
AD	AREA DRAIN	FLA	FULL LOAD AMPS	OD	OUTSIDE DIAMETER
AE	AIR EXTRACTOR	FLR	FLOOR	OED	OPEN ENDED DUCT
AFF	ABOVE FINISHED FLOOR	FM	FLOW METER	OFICI	OWNER FURNISHED, CONTRACTOR INSTALLED
AHU	AIR HANDLING UNIT	FMS	FLOW MEASURING STATION	OFIOI	OWNER FURNISHED, OWNER INSTALLED
ALT	ALTERNATE	FS	FEET PER MINUTE	OL	OVERLOAD
AMP	AMPERE	FP	FIRE PUMP	ORC	OVERFLOW RAIN CONDUCTOR
APD	AIR PRESSURE DROP	FTTU	FAN POWERED (AIR) TERMINAL UNIT	ORD	OVERHEAD ROOF DRAIN
AR	ARGON	FS	FLOOR SINK	OSAY	OUTSIDE SCREW AND YOKE
ASHRAE	AMERICAN SOCIETY OF HEATING, REFRIGERATION AND AIR-CONDITIONING ENGINEERS	FSEC	FOOD SERVICE EQUIPMENT CONTRACTOR	OV	OUTLET VELOCITY
ASR	AUTOMATIC SPRINKLER RISER	FT	FEET	OWS	OPERATOR WORKSTATION
ATD	AIR TRANSFER DUCT	FV	FACE VELOCITY	PACU	PACKAGED AIR CONDITIONING UNIT
AUX	AUXILIARY	FB	FACE VELOCITY	PBD	PARALLEL BLADE DAMPER
AV	ACID VENT	G	NATURAL GAS	PC	PUMPED CONDENSATE
AVTR	ACID VENT THROUGH ROOF	GA	GAL	PCW	PROCESS COOLING WATER
AW	ACID WASTE	GAL	GALLON	PCWR	PROCESS COOLING WATER RETURN
BAS	BUILDING AUTOMATION SYSTEM	GRH	GRAVITY RELIEF HOOD	PCWS	PROCESS COOLING WATER SUPPLY
BCU	BLOWER COIL UNIT	GSN	GALLONS PER HOUR	PD	PRESSURE DROP (FEET OF WATER)
BDD	BACK DRAFT DAMPER	GPM	GALLONS PER MINUTE	PH	PERIMETER HEAT
BFF	BELOW FINISHED FLOOR	GSAN	GREASE SANITARY WASTE	PHR	PERIMETER HEAT RETURN
BFP	BACKFLOW PREVENTER	H	HYDROGEN	PHS	PERIMETER HEAT SUPPLY
BHP	BRAKE HORSEPOWER	HB	HOSE BIBB	PPM	PARTS PER MILLION
BOD	BOTTOM OF DUCT	HC	HEATING COIL	PRESS	PRESSURE
BOP	BOTTOM OF PIPE	HD	HOT DECK	PRV	PRESSURE REDUCING VALVE
BTU	BRITISH THERMAL UNIT	HEPA	HIGH EFFICIENCY PARTICULATE ARRESTANCE	PSAN	PUMPED SANITARY
BTUH	BRITISH THERMAL UNIT PER HOUR	HL	HIGH LIMIT	PSI	POUNDS PER SQUARE INCH
BVC	BEVERAGE CONDUIT	HOA	HAND/OFF/AUTO	PSIA	POUNDS PER SQUARE INCH - ABSOLUTE
BVV	BACKWATER VALVE	HP	HEAT PUMP	PSIG	POUNDS PER SQUARE INCH - GAUGE
C	COMMON	HP	HORSEPOWER	PST	PUMPED STORM
CAP	CAPACITY	HPWC	HIGH PRESSURE DOMESTIC COLD WATER	PW	PURIFIED WATER
CAV	CONSTANT AIR VOLUME	HPHW	HIGH PRESSURE DOMESTIC HOT WATER	PWR	PURIFIED WATER RETURN
CB	CATCH BASIN	HPHWR	HIGH PRESSURE DOMESTIC HOT WATER RETURN	PWS	PURIFIED WATER SUPPLY
CC	COOLING COIL	HPL	HEAT PUMP LOOP	(R)	RELOCATED
CD	COLD DECK	HPLR	HEAT PUMP LOOP RETURN	R	RETURN GRILLE OR REGISTER
CD	CONDENSATE DRAIN	HPLS	HEAT PUMP LOOP SUPPLY	RA	RETURN AIR
CFCI	CONTRACTOR FURNISHED, CONTRACTOR INSTALLED	HR	HEATING	RAT	RETURN AIR TEMPERATURE
CFH	CUBIC FEET PER HOUR	HTG	HEATING VENTILATING	RC	RAIN CONDUCTOR
CFM	CUBIC FEET PER MINUTE	HVAC	HEATING, VENTILATING, AIR CONDITIONING	RCD	RAIN GUTTING PANEL
CH	CHILLER	HWH	HOT WATER HEATING	RD	ROOF DRAIN
CHW	CHILLED WATER	HWHR	HOT WATER HEATING RETURN	REQD	REQUIRED
CHWR	CHILLED WATER RETURN	HWS	HOT WATER SUPPLY	RF	RETURN FAN
CHWS	CHILLED WATER SUPPLY	HW	DOMESTIC HOT WATER	RH	RELATIVE HUMIDITY
CLG	COOLING	HWL	DOMESTIC HOT WATER (SPECIFIC TEMP °F)	RHR	REFRIGERANT LIQUID
CND	CONDENSATE	HWL	DOMESTIC HOT WATER RETURN	RLFA	REFRIGERANT LIQUID
CND (#)	CONDENSATE (SPECIFIC PSIG)	HX	HEAT EXCHANGER	RPM	REVOLUTIONS PER MINUTE
CO	CLEAN OUT	HZ	HERTZ	RPSA	REDUCED PRESSURE BACKFLOW DETECTION ASSY
CO2	CARBON DIOXIDE	IAQ	INDOOR AIR QUALITY	RSZ	REDUCED PRESSURE BACKFLOW ZONE ASSEY
CONT	CONTINUATION OR CONTINUED	ID	INSIDE DIAMETER	RS	REFRIGERANT SUCTION
CONTR	CONTRACTOR	IE	INVERT ELEVATION	RTU	ROOFTOP UNIT
CONV	CONVEYER	IH	INTAKE HOOD	S	SUPPLY AIR DIFFUSER OR GRILLE
COP	COEFFICIENT OF PERFORMANCE	IN	INCHES	SA	SOUND ATTENUATOR
CP	CIRCULATING PUMP	IR	INFRARED HEATER	SA	SANITARY AIR
CR	CONDENSATE RETURN UNIT	IS	INDIRECT WASTE	SA	SANITARY WASTE
CSS	COOLING TOWER	JP	JANITOR'S CLOSET	SAT	SUPPLY AIR TEMPERATURE
CT	CABINET UNIT HEATER	JC	JOCKEY PUMP	SCCA	SHORT CIRCUIT CURRENT RATING SECTION
CUH	DOMESTIC COLD WATER	KW	KILOWATT	SECT	SECTION
CWF	DOMESTIC COLD WATER - FILTERED	KA	THOUSAND AMP	SF	SUPPLY FAN
CWR	CONDENSER WATER RETURN	KWH	KILOWATT-HOUR	SHOWER	SHOWER
CWS	CONDENSER WATER SUPPLY	LAT	LEAVING AIR TEMPERATURE	SK	SINK
D&T	DRIP AND TRAP	LAB	LABORATORY	SMR	SNOW MELT RETURN
DA	DISCHARGE AIR	LAV	LAVATORY	LAV	SNOW MELT SUPPLY
DAT	DISCHARGE AIR TEMPERATURE	LBS	POUNDS	SP	STATIC PRESSURE
DB	DRY BULB	LDB	LEAVING DRY BULB	SPEC	SPECIFICATION
DDC	DRY DIGITAL CONTROL	LL	LOW LIMIT	SPR	SPRINKLER
DEG	DEGREE	LPC	LOW PRESSURE CONDENSATE	SQFT	SQUARE FOOT/SQUARE FEET
DFU	DRAINAGE FIXTURE UNITS	LPS	LOW PRESSURE STEAM	S/S	START/STOP
DIA	DIAMETER	LRA	LOCKED ROTOR AMPS	SS	SERVICE SINK
DMPR	DAMPER	LWB	LEAVING WET BULB	ST	STORM
DN	DAYNIGHT	LWT	LEAVING WATER TEMPERATURE	STD	STANDARD
DNZ	DOWNSPOUT NOZZLE	MA	MIXED AIR	STK	STACK
DNZ	DUCT SILENCER	MAT	MIXED AIR TEMPERATURE	STM	STEAM
DT	DRAIN TILE	MAUJ	MAKE-UP AIR UNIT	STM (#)	STEAM (SPECIFIC PSIG)
DTC	DRAIN TILE CONNECTION	MAX	MAXIMUM	SW	SWITCH
DWH	DOMESTIC WATER HEATER	MBH	THOUSAND BRITISH THERMAL UNITS PER HOUR	T	TRANSFER GRILLE
DWG	DRAWING	MCA	MINIMUM COMPRESSED AIR	TC	TEMPERATURE CONTROL
(E)	EXISTING	MCC	MOTOR CONTROL CENTER	TC	TEMPERING COIL
E	EXHAUST GRILLE OR REGISTER	MCC	MOTOR CONTROL CENTER	TC	TEMPERATURE CONTROL PANEL
EA	EACH	MECH	MECHANICAL	TD	TRENCH DRAIN
EA	EXHAUST AIR	MEZZ	MEZZANINE	TEMP	TEMPERATURE
EAT	ENTERING AIR TEMPERATURE	MFR	MANUFACTURER	TEMP	TEMPERATURE
EC	EXPANSION COMPENSATOR	MH	MANHOLE	TH	TERMINAL HEATING
ECUH	ELECTRIC CABINET UNIT HEATER	MIL	1/1000th INCH	THA	TOTAL HEAT ABSORBED
EDB	ENTERING DRY BULB	MIN	MINIMUM	THR	TERMINAL HEATING RETURN
EER	ENERGY EFFICIENCY RATIO	MIS	MISCELLANEOUS	THR	TOTAL HEAT REJECTED
EESS	EMERGENCY EYE WASH / SHOWER	MMB	MILLION BRITISH THERMAL UNITS PER HOUR	THS	TERMINAL HEATING SUPPLY
EEW	EMERGENCY EYE WASH	MOP	MAXIMUM OVERCURRENT PROTECTION	TPD	TEPID WATER
EF	EXHAUST FAN	MTD	MOUNTED	TSP	TOTAL STATIC PRESSURE
EFF	EFFICIENCY	MTR	MOTOR	TU	TERMINAL UNIT
EHC	ELECTRIC HEATING COIL	MV	MANUAL AIR VENT	TV	TURNING VANES
EJ	EXPANSION JOINT	MVAC	MEDICAL VACUUM	TW	TEMPERED WATER
EL	ELEVATION	N	NITROGEN	TYP	TYPICAL
ELEC	ELECTRICAL	N2O	NITROUS OXIDE	UH	UNIT HEATER
EMS	ENERGY MANAGEMENT SYSTEM	NC	NOISE CRITERIA	UL	UNDERWRITERS LABORATORY
ERL	ENERGY RECOVERY LOOP	NC	NORMALLY CLOSED	UN	UNLESS OTHERWISE NOTED
ERLR	ENERGY RECOVERY LOOP RETURN	NCTC	NORMALLY CLOSED TIMED CLOSED	UR	URINAL
ERLS	ENERGY RECOVERY LOOP SUPPLY	NCTO	NORMALLY CLOSED TIMED OPEN	UV	UNIT VENTILATOR
ERU	ENERGY RECOVERY UNIT	NFA	NATIONAL FIRE PROTECTION AGENCY	V	VALVE
ESH	EMERGENCY SHOWER	NTC	NORMALLY OPEN	V	VENT
ESP	EXTERNAL STATIC PRESSURE	NTC	NORMALLY OPEN TIMED CLOSED	VAC	VACUUM
EUH	ELECTRIC UNIT HEATER	NOT	NOT IN CONTRACT	VAV	VARIABLE AIR VOLUME
EWB	ENTERING WET BULB	NO	NORMALLY OPEN	VB	VACUUM BREAKER
EW	ELECTRIC WATER COOLER	NOM	NOMINAL	VD	VOLUME DAMPER (MANUALLY ADJUSTABLE)
EWT	ENTERING WATER TEMPERATURE	NPCW	NON PORTABLE COLD WATER	VL	VOLUME
EXH	EXHAUST			VFC	VARIABLE FREQUENCY CONTROLLER
F	FIRE PROTECTION			VTR	VENT THROUGH ROOF
°F	DEGREES FAHRENHEIT			VTV	VENT THROUGH ROOF
F&B	FACE AND BYPASS			VUV	VERTICAL UNIT VENTILATOR
F&T	FLOAT AND THERMOSTATIC			W	WASTE
FA	FACE AREA			W&V	WASTE AND VENT
FCU	FAN COIL UNIT			W&VD	WASTE AND VENT WITH ANESTHETIC GAS DISPOSAL

TEMPERATURE CONTROL - PARTIAL SYMBOLS LIST


SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	CARBON DIOXIDE SENSOR		OCCUPANCY SENSOR
	CARBON MONOXIDE SENSOR		PRESSURE TRANSMITTER
	DIFFERENTIAL PRESSURE TRANSMITTER		STATIC PRESSURE SENSOR OR PROBE
	FLOW METER		VALVE - 2 WAY CONTROL VALVE
	GUARD FOR STAT OR SENSOR		VALVE - 3 WAY CONTROL VALVE
	HUMIDISTAT OR HUMIDITY SENSOR (AS DEFINED ON TC DRAWINGS)		THERMOSTAT OR TEMPERATURE SENSOR (AS DEFINED ON TC DRAWINGS)

NOTE: LIST OF ADDITIONAL SYMBOLS & ABBREVIATIONS ASSOCIATED WITH TEMPERATURE CONTROLS ARE IDENTIFIED ON TC DRAWINGS.


MECHANICAL SYMBOL LIST

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	AIR VENT - AUTOMATIC		AIR TERMINAL UNIT
	AIR VENT - MANUAL		AIR TERMINAL UNIT WITH HEATING COIL
	BACKFLOW PREVENTER		VENTURI AIR TERMINAL UNIT
	CATCH BASIN		VENTURI AIR TERMINAL UNIT WITH HEATING COIL
	CIRCULATING PUMP		DAMPER - HORIZONTAL FIRE (EXISTING, NEW)
	CLEAN OUT - IN FLOOR		DAMPER - HORIZONTAL FIRE / SMOKE (EXISTING, NEW)
	CLEAN OUT - FLANGE		DAMPER - SMOKE (EXISTING, NEW)
	DIRECTION OF FLOW		DAMPER - VERTICAL FIRE (EXISTING, NEW)
	DIRECTION OF PITCH - DOWN		DAMPER - VERTICAL FIRE / SMOKE (EXISTING, NEW)
	FINNED TUBE RADIATION		DAMPER - BACK DRAFT
	FIRE PROTECTION - SIAMESE CONNECTION - FREE STANDING		DAMPER - MOTORIZED
	FIRE PROTECTION - SIAMESE CONNECTION - WALL MOUNTED		DAMPER - VOLUME (MANUALLY ADJUSTABLE)
	FIRE PROTECTION - SPRINKLER HEAD, CONCEALED		DIFFUSER - BLANK OFF
	FIRE PROTECTION - SPRINKLER HEAD, PENDANT		DIFFUSER - LINEAR SLOT
	FIRE PROTECTION - SPRINKLER HEAD, UPRIGHT		DIFFUSER - SQUARE OR RECTANGULAR
	FIRE PROTECTION - SPRINKLER HEAD, SIDEWALL		DUCT CROSS SECTION - SUPPLY
	FLOOR DRAIN		DUCT CROSS SECTION - RETURN
	FLOOR DRAIN - ELEVATION		DUCT CROSS SECTION - EXHAUST
	FLOOR DRAIN - FUNNEL		DUCT - FLEXIBLE CONNECTION
	FLOOR DRAIN - FUNNEL, ELEVATION		DUCT - FLEXIBLE DUCT
	FLOW MEASURING DEVICE (FOR TEST AND BALANCING)		DUCT TAKE-OFF - ROUND CONICAL
	FLOW SWITCH		DUCT TAKE-OFF - RECTANGULAR WITH SHOE TAP
	FLOW METER		ELBOW - RECTANGULAR WITH TURNING VANES
	HOSE BIBB		ELBOW - RECTANGULAR / ROUND SMOOTH RADIUS
	MANHOLE		ELBOW DOWN - RECTANGULAR
	OPEN SITE DRAIN		ELBOW DOWN - ROUND
	PIPE - CAP OR PLUG		ELBOW UP - RECTANGULAR
	PIPE - ELBOW DOWN		ELBOW UP - ROUND
	PIPE - ELBOW UP		FAN - AXIAL
	PIPE - EXPANSION JOINT OR COMPENSATOR		FAN - CENTRIFUGAL (ELEVATION)
	PIPE - FLANGE		HEATING COIL
	PIPE - HOSE AND BRAID FLEXIBLE CONNECTION		INCLINED DROP IN DIRECTION OF AIRFLOW
	PIPE - RUBBER FLEXIBLE CONNECTION		INCLINED RISE IN DIRECTION OF AIRFLOW
	PIPE - GUIDE		INTAKE OR RELIEF HOOD
	PIPE - TEE DOWN		REGISTER - RETURN OR EXHAUST
	PIPE - TEE UP		REGISTER - RETURN WITH BOOT
	PIPE - UNION		REGISTER - TRANSFER GRILLE
	PRESSURE AND TEMPERATURE TEST PLUG		ROOF EXHAUST FAN
	PRESSURE GAUGE AND COCK		TRANSITION - CONCENTRIC
	REDUCER - CONCENTRIC		TRANSITION - ECCENTRIC
	REDUCER - ECCENTRIC		UNIT HEATER - HORIZONTAL THROW
	SINK		UNIT HEATER - VERTICAL THROW
	SNOW MELT RETURN		DOUBLE LINE DUCTWORK SYMBOLS
	SNOW MELT SUPPLY		DUCT TAKE-OFF - RECTANGULAR WITH SHOE TAP
	STATIC PRESSURE		DUCT TAKE-OFF - ROUND CONICAL
	SPECIFICATION		ELBOW - RECTANGULAR WITH TURNING VANES
	SPRINKLER		ELBOW - RECTANGULAR SMOOTH RADIUS
	SQUARE FOOT/SQUARE FEET		ELBOW DOWN - RECTANGULAR
	START/STOP		ELBOW DOWN - ROUND
	SERVICE SINK		ELBOW UP - RECTANGULAR
	STORM		ELBOW UP - ROUND
	STANDARD		HEATING COIL
	STACK		INCLINED DROP IN DIRECTION OF AIRFLOW
	STEAM		INCLINED RISE IN DIRECTION OF AIRFLOW
	VALVE - ANGLE		TRANSITION - CONCENTRIC
	VALVE - BALL		TRANSITION - ECCENTRIC
	VALVE - BALANCE (i.e. BALANCE VALVE TO 0.5 GPM)		
	VALVE - COMBINATION RAIN ALARM & FLOW MEASURING (i.e. BALANCE VALVE TO 0.5 GPM)		
	VALVE - BUTTERFLY		
	VALVE - CHECK		
	VALVE - SPRING CHECK		
	VALVE - GAS (MANUAL)		
	VALVE - GLOBE		
	VALVE - ISOLATION		
	VALVE - NEEDLE		
	VALVE - O-S&Y		
	VALVE - PLUG		
	VALVE - PRESSURE REGULATING		
	VALVE - PRESSURE REDUCING		
	VALVE - PRESSURE RELIEF		
	VALVE - PRESSURE & TEMPERATURE RELIEF		

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

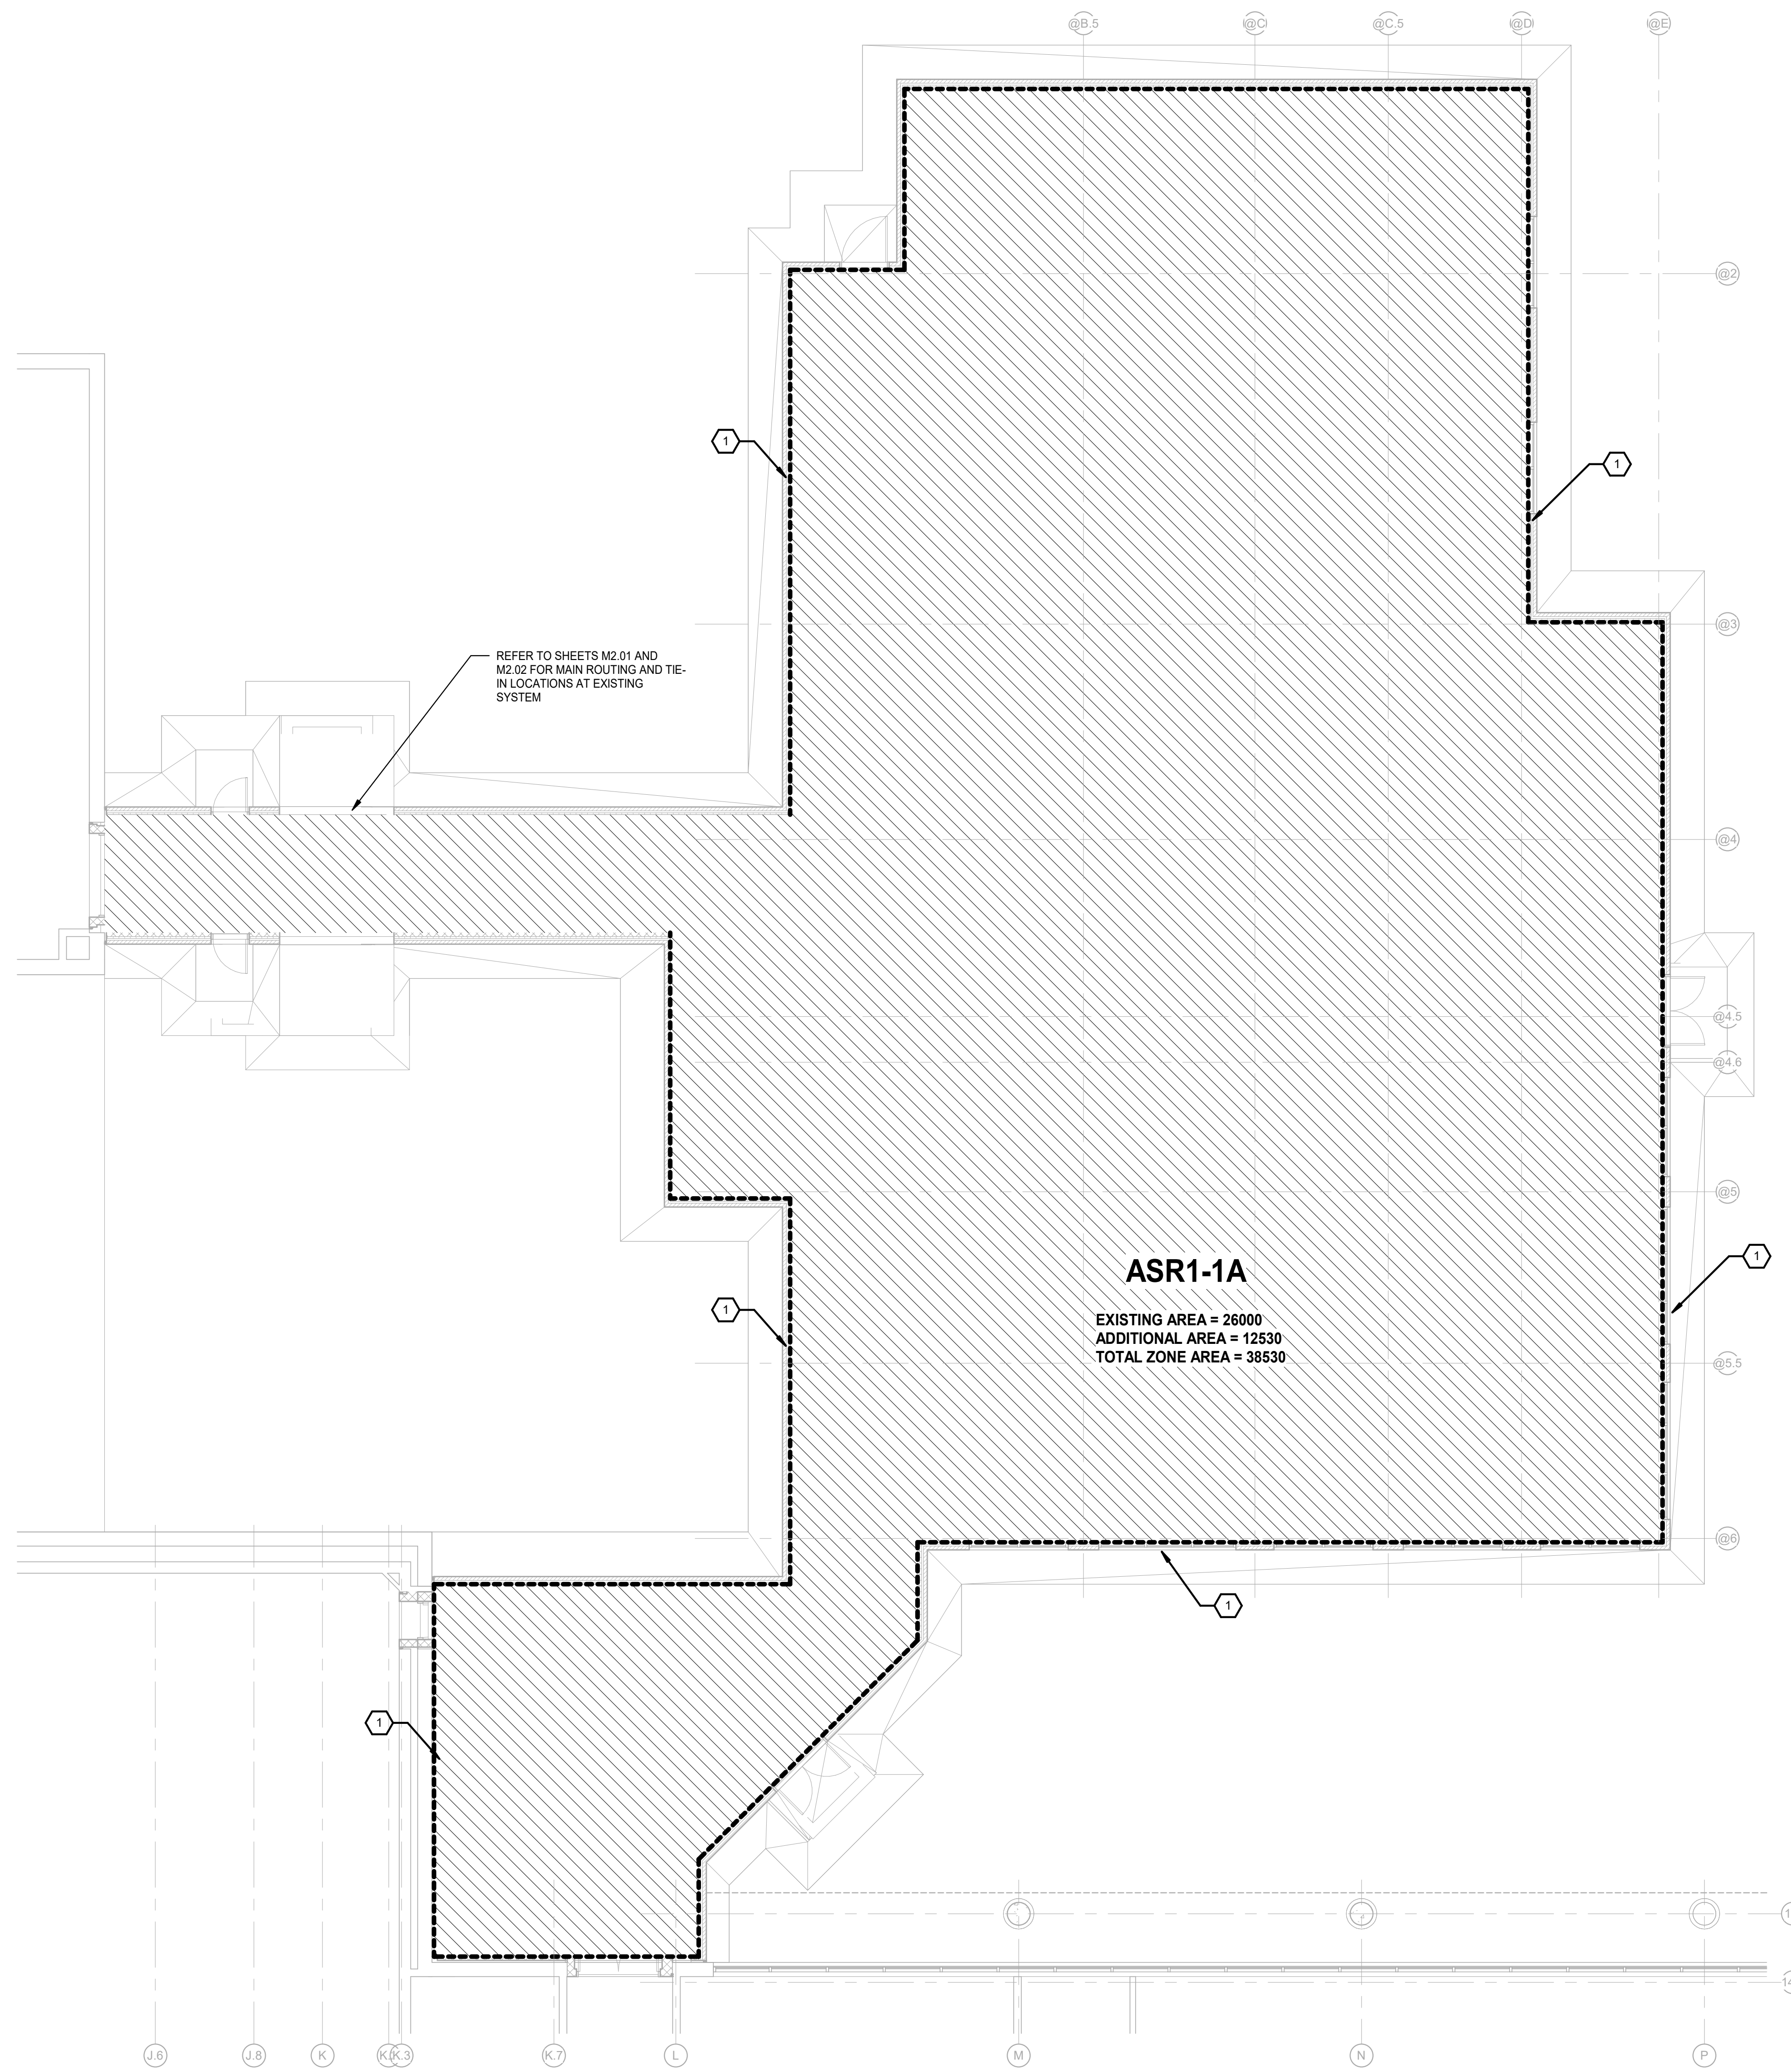

FIRST FLOOR FIRE PROTECTION ZONING PLAN
SCALE: 1/8" = 1'-0"

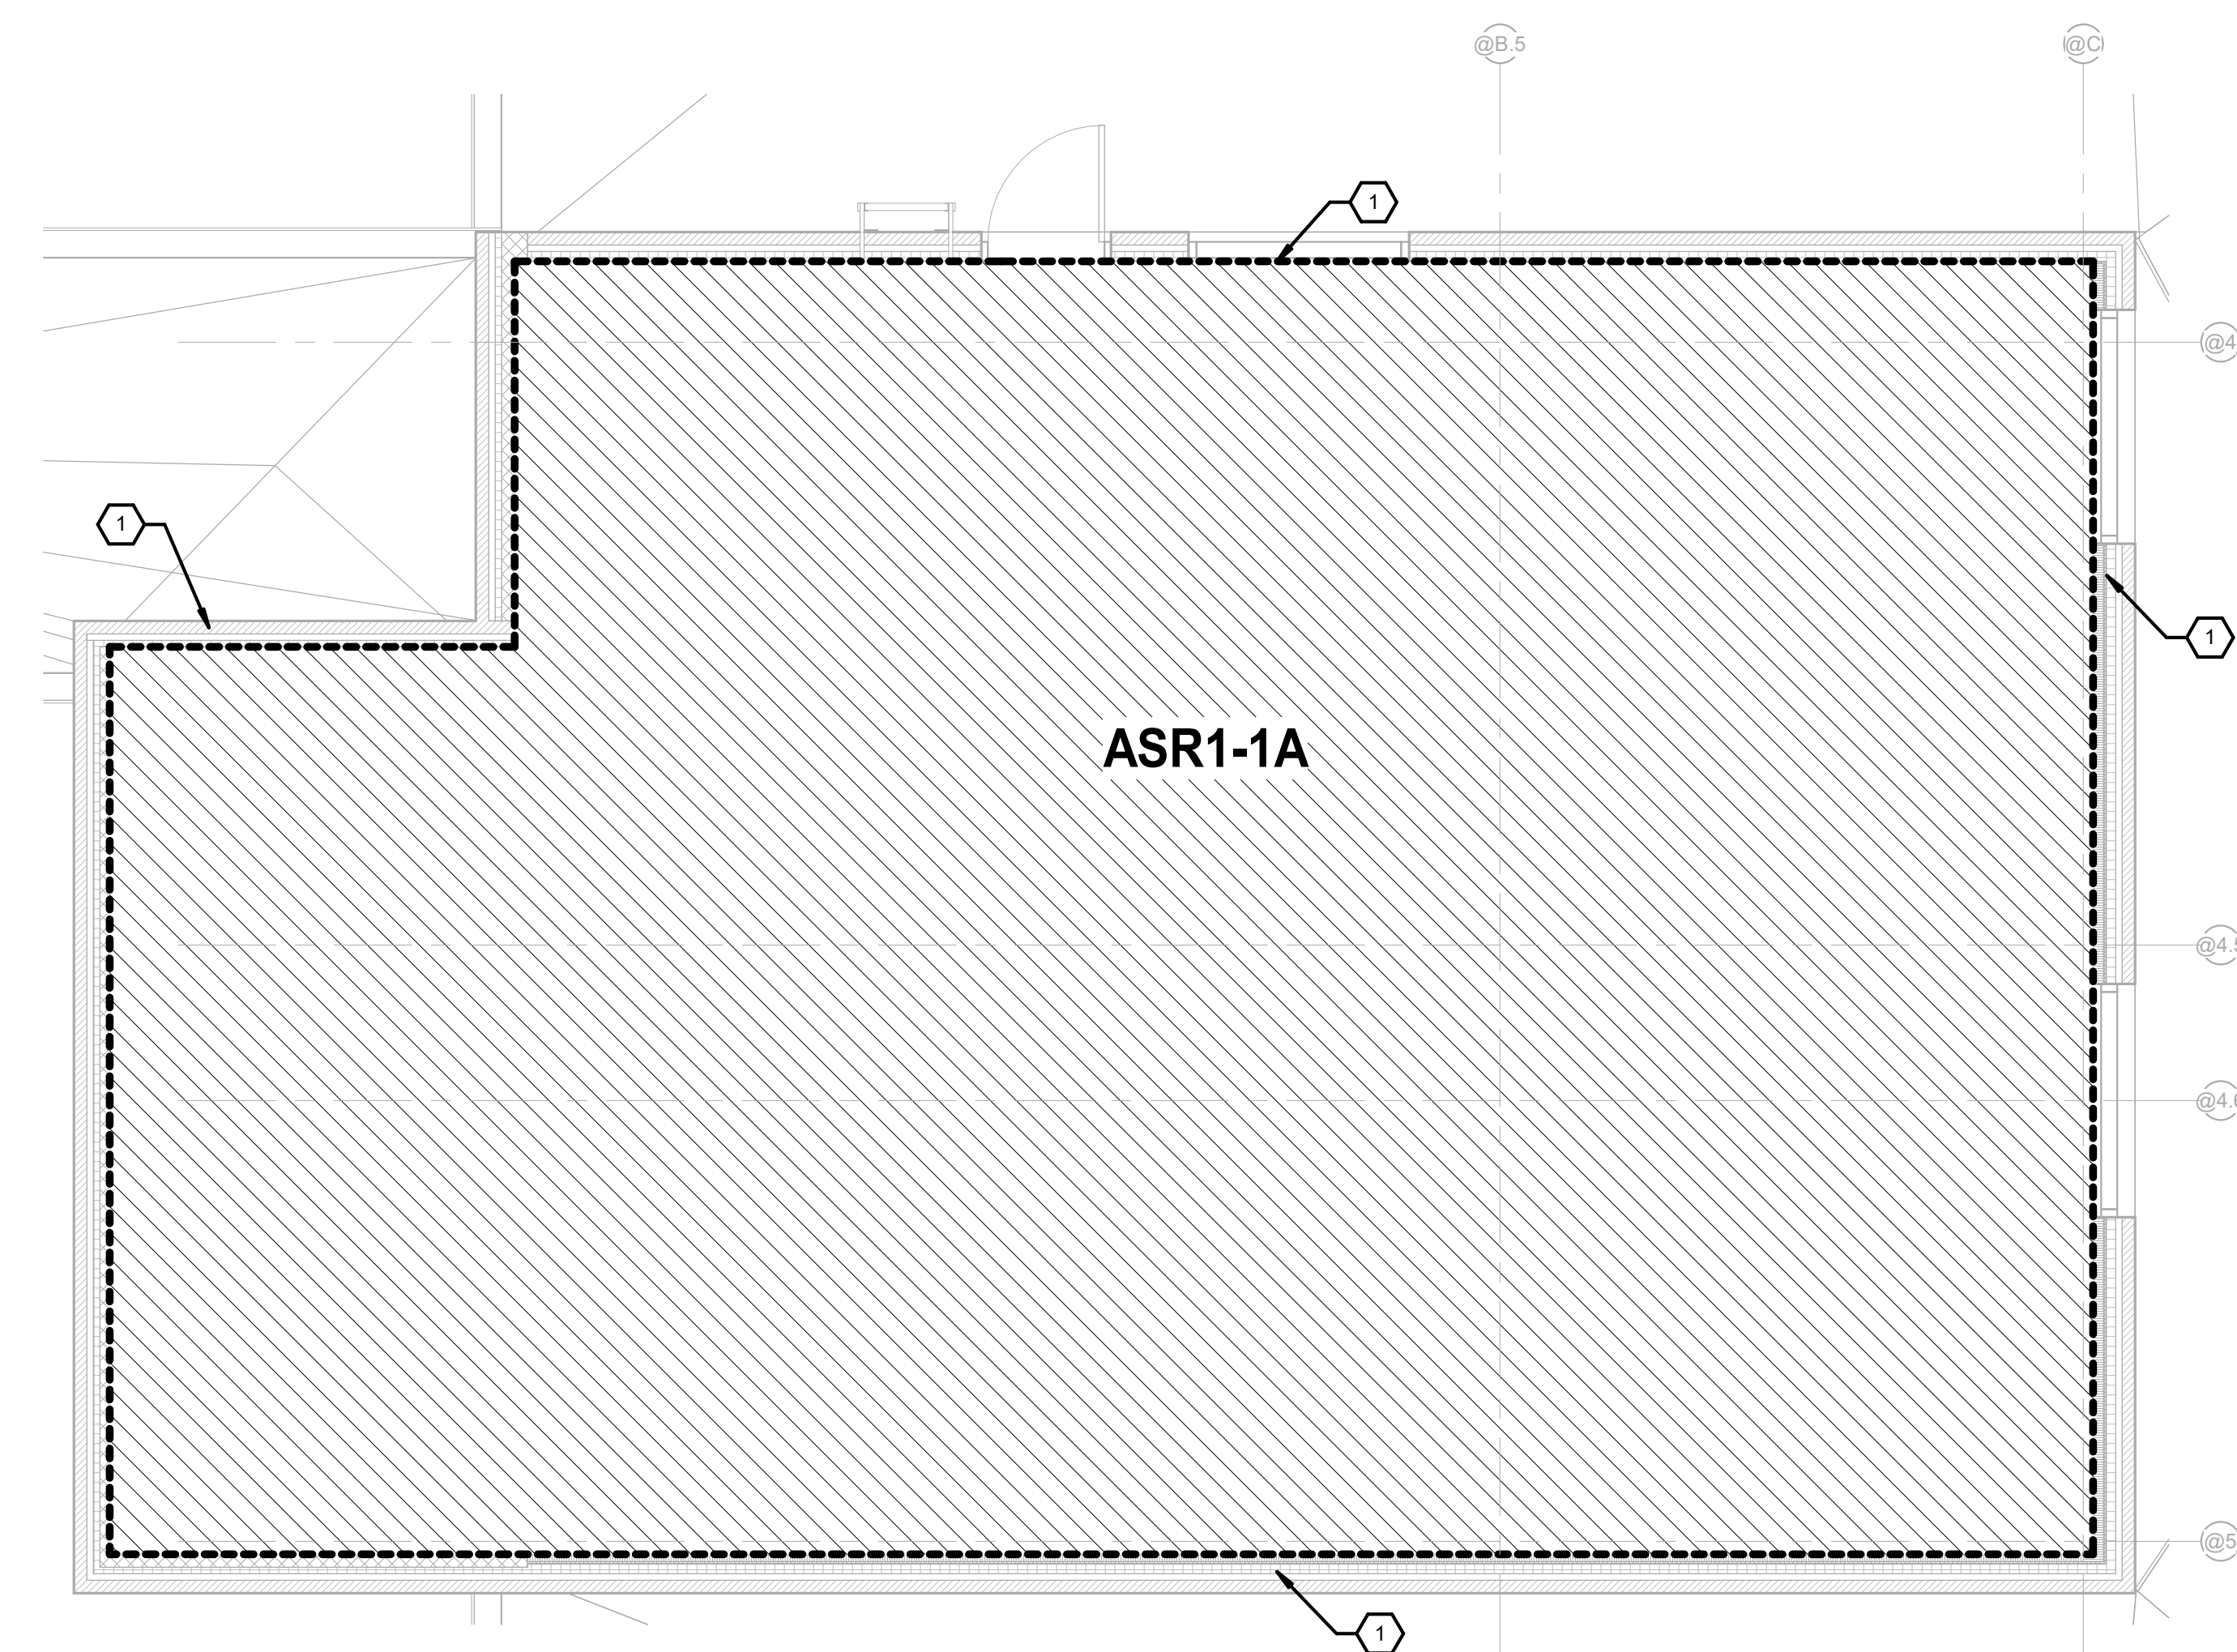

PENTHOUSE FIRE PROTECTION ZONING PLAN
SCALE: 1/4" = 1'-0"

FIRE PROTECTION GENERAL NOTES:

- 1 THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION/SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL, CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- 2 INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- 3 NO SPRINKLER PIPING SHALL BE ROUTED THROUGH ELECTRICAL EQUIPMENT ROOMS, TELECOMMUNICATION EQUIPMENT ROOMS, ELEVATOR EQUIPMENT ROOMS OR SIMILAR ROOMS. ONLY SPRINKLER PIPING SERVING SPRINKLER HEADS IN THOSE ROOMS SHALL BE ALLOWED.
- 4 PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- 5 MINIMUM RUN-OUT PIPE SIZE TO SPRINKLER HEADS SHALL BE 1".
- 6 PROVIDE AN AUTOMATIC WET PIPE SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13 <<LIGHT HAZARD>> CLASSIFICATION. HYDRAULIC CALCULATIONS SHALL BE BASED ON DENSITY OF <<0.10>> GPM/SQ. FT. OVER THE MOST REMOTE <<1500>> SQ. FT.
- 7 ACCORDING TO THE MOST RECENT FLOW TEST INFORMATION, THE STATIC PRESSURE AVAILABLE AT THE CITY WATER MAIN AT THE STREET IS <<XX>> PSIG. RESIDUAL PRESSURE WITH <<XXX>> GPM FLOWING IS <<XX>> PSIG. CONTRACTOR SHALL MAKE HIS OWN PRESSURE AND FLOW TEST PRIOR TO SYSTEM DESIGN.
- 8 FIRE PROTECTION WATER SERVICE ENTRANCE PIPING SHALL BE BURIED WITH DEPTH OF COVER OVER TOP OF PIPE OF AT LEAST <<72">>, OR WITH TOP OF PIPE AT LEAST 12" BELOW LEVEL OF MAXIMUM FROST PENETRATION, OR AS REQUIRED BY AUTHORITIES HAVING JURISDICTION, WHICHEVER IS DEEPEST.

CONSTRUCTION KEY NOTES:

- 1 PROVIDE FULLY FUNCTIONING SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA13, OWNERS INSURING AGENCY AND AUTHORITY HAVING JURISDICTION IN AREA INDICATED.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

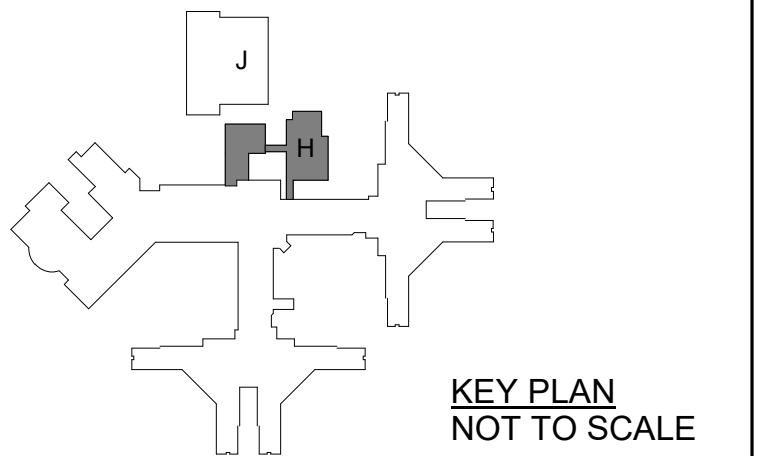

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN**
SALINE, MICHIGAN

SHEET TITLE
**FIRE PROTECTION ZONING
PLAN**

PROJECT NUMBER
2021094

SHEET NUMBER


PROJECT DATE
SEPTEMBER 6, 2023

M1.01

CHECKED BY
WEK

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0402

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

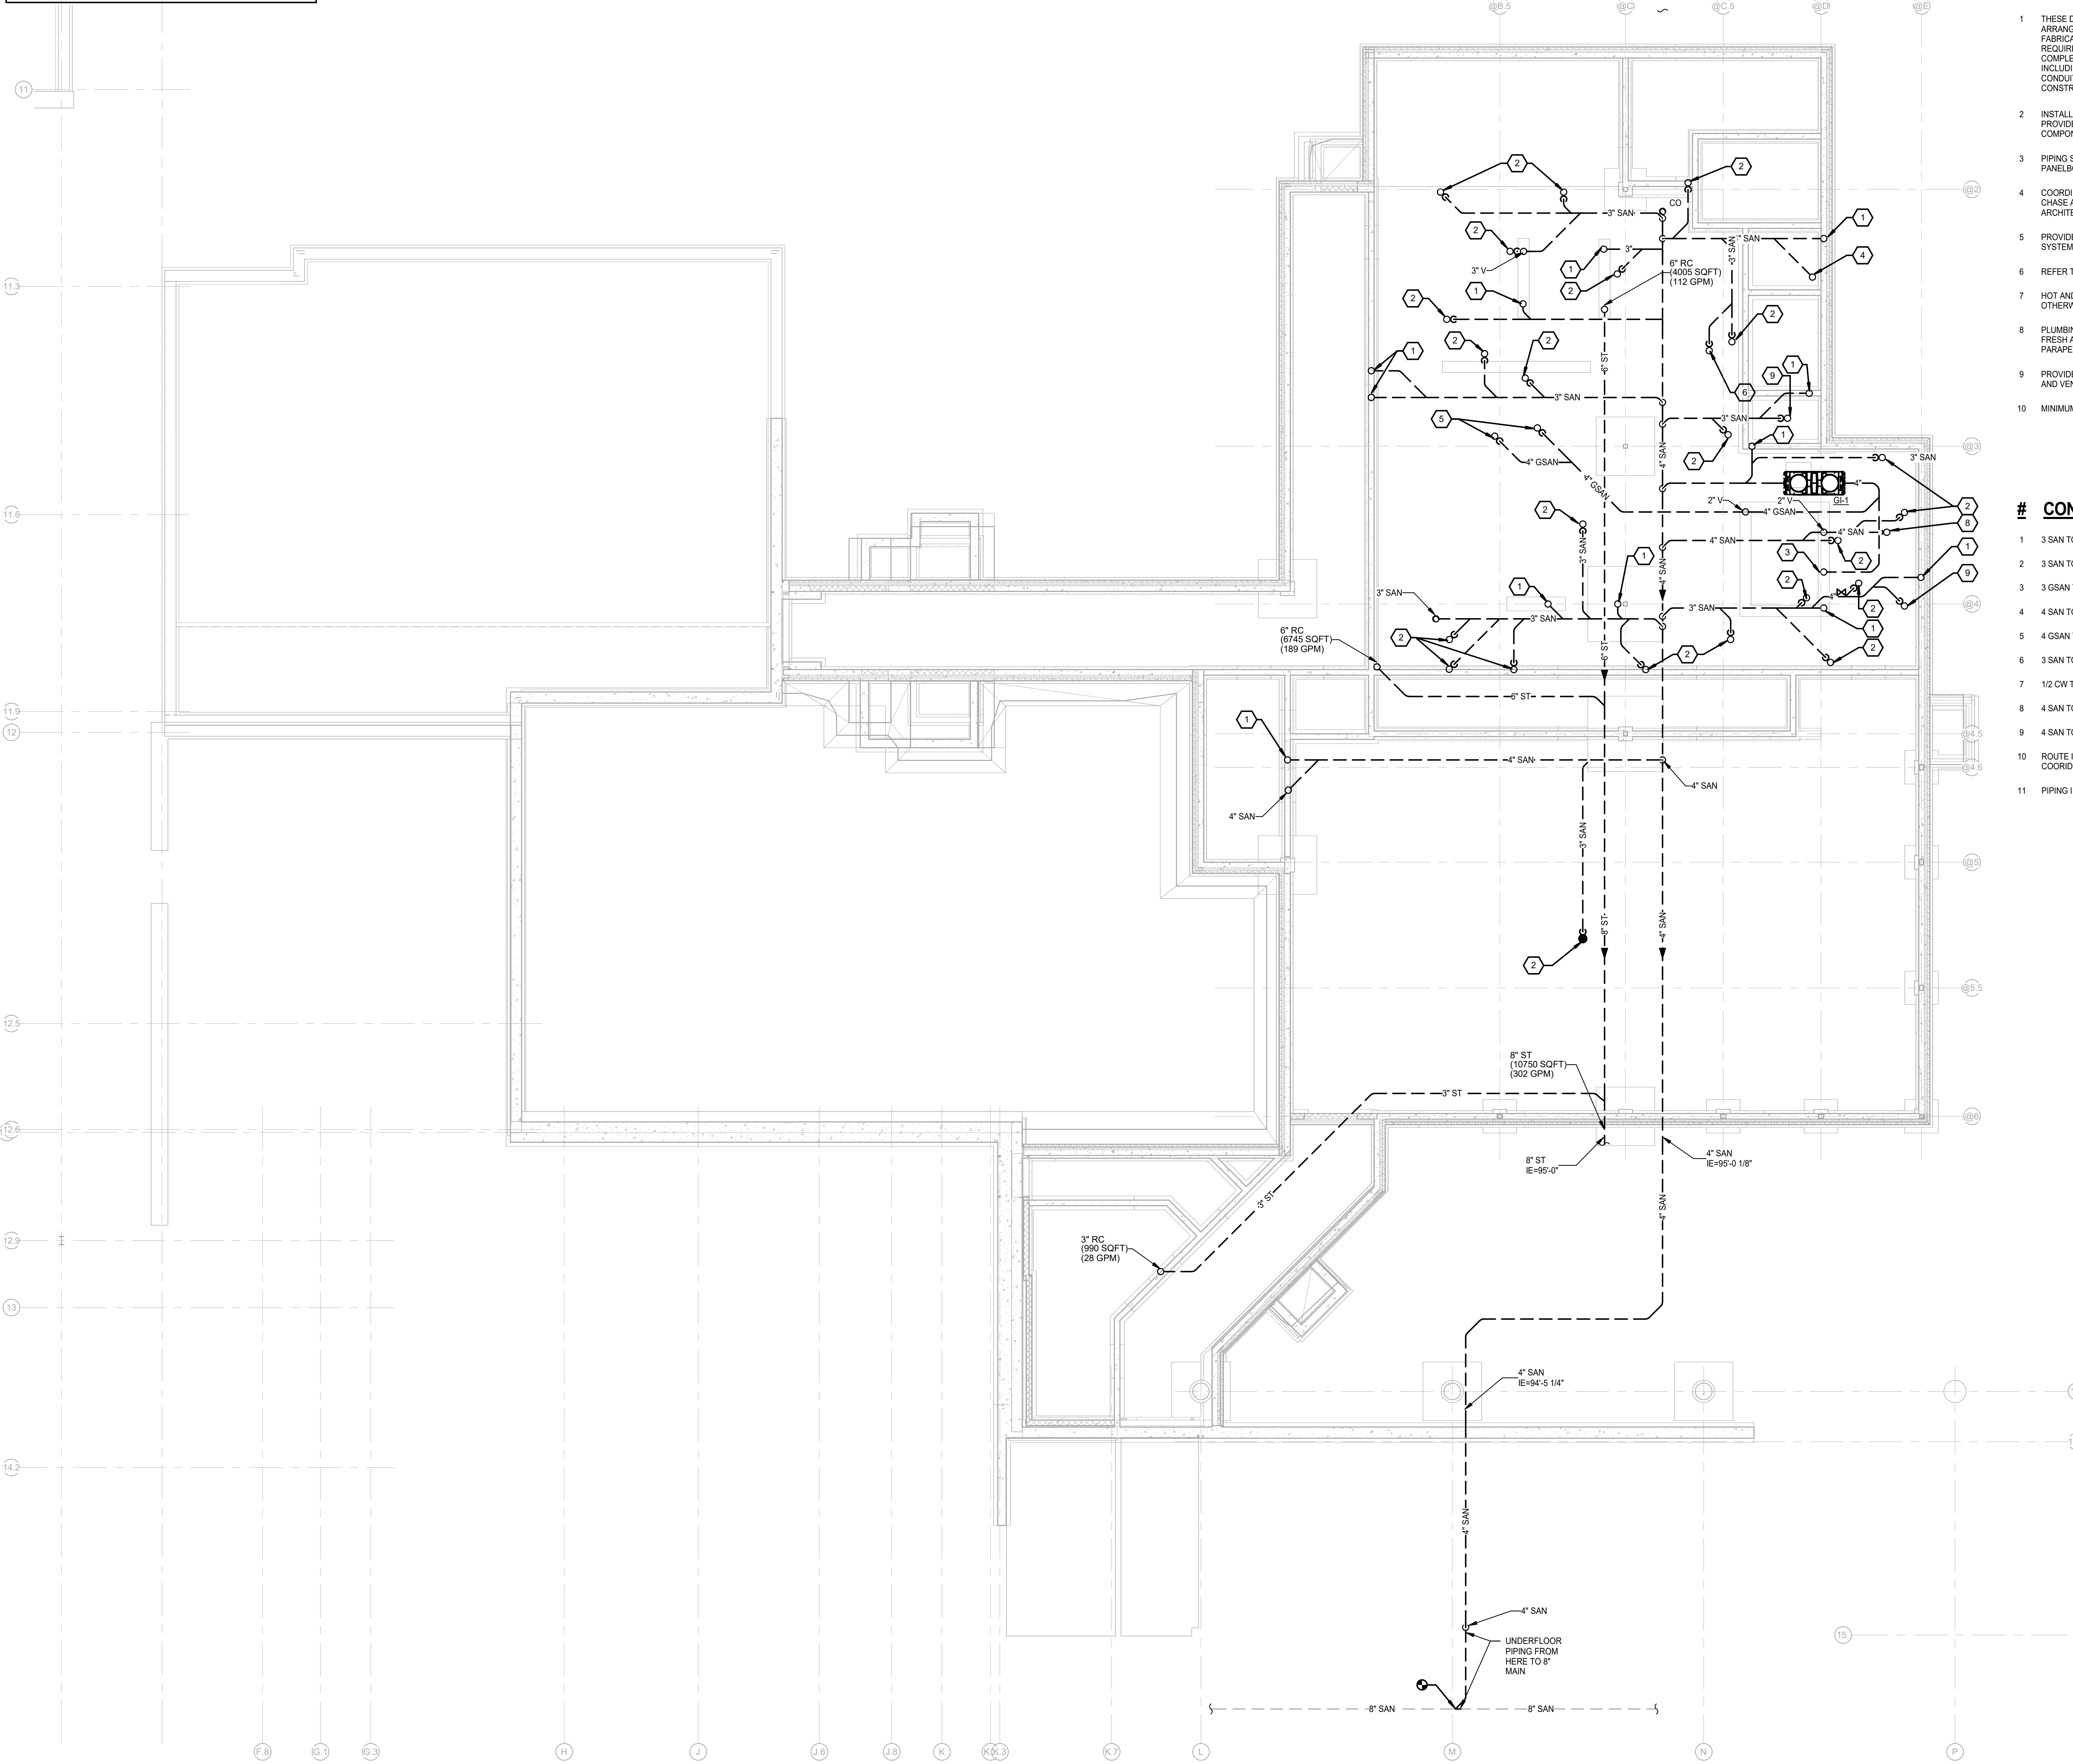

PLUMBING GENERAL NOTES:

- 1 THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION/SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- 2 INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- 3 PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- 4 COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- 5 PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- 6 REFER TO ARCHITECTURAL PLANS FOR DIMENSIONED LOCATIONS OF PLUMBING FIXTURES.
- 7 HOT AND COLD WATER PIPING RUN-OUTS TO LAVATORIES AND SINKS SHALL BE 1/2" UNLESS OTHERWISE NOTED.
- 8 PLUMBING VENT PIPING THROUGH ROOF SHALL BE LOCATED A MINIMUM OF 10'-0" FROM ANY FRESH AIR INTAKE LOCATION AND A MINIMUM OF 18" CLEAR FROM THE INSIDE FACE OF PARAPET.
- 9 PROVIDE CODE REQUIRED CLEARANCE FOR ALL CLEANOUTS INSTALLED IN SANITARY WASTE AND VENT PIPING.
- 10 MINIMUM UNDERGROUND PIPE SIZE SHALL BE 3".

CONSTRUCTION KEY NOTES:


- 1 3 SAN TO LAV/SINK.
- 2 3 SAN TO FLOOR DRAIN/SINK.
- 3 GSAN TO SINK.
- 4 4 SAN TO WC.
- 5 4 GSAN TO FLOOR TROUGH.
- 6 3 SAN TO FLOOR TROUGH.
- 7 1/2 CW TO DRAIN COOLER.
- 8 4 SAN TO FLOOR TROUGH.
- 9 4 SAN TO FLOOR DRAIN/SINK.
- 10 ROUTE IN CEILING SPACE OF GYM. ROUTE ALONG SIDE NEW MECHANICAL PIPING. COORDINATE FINAL ROUTING WITH MECHANICAL TRADES.
- 11 PIPING IN THIS AREA ROUTED WITHIN SECOND FLOOR CEILING SPACE.

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

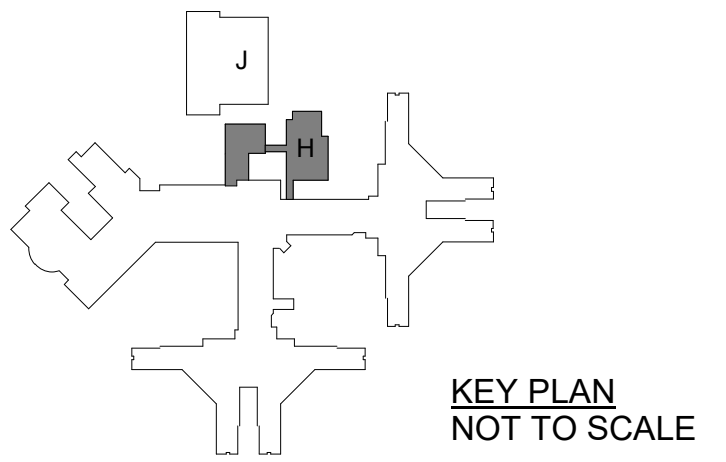

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107 COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
UNDERGROUND PLUMBING PLAN

PROJECT NUMBER 2021094 SHEET NUMBER



PROJECT DATE SEPTEMBER 6, 2023 **M2.00**

CHECKED BY WEK

UNDERGROUND PLUMBING PLAN
SCALE: 1/8" = 1'-0"

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0402

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

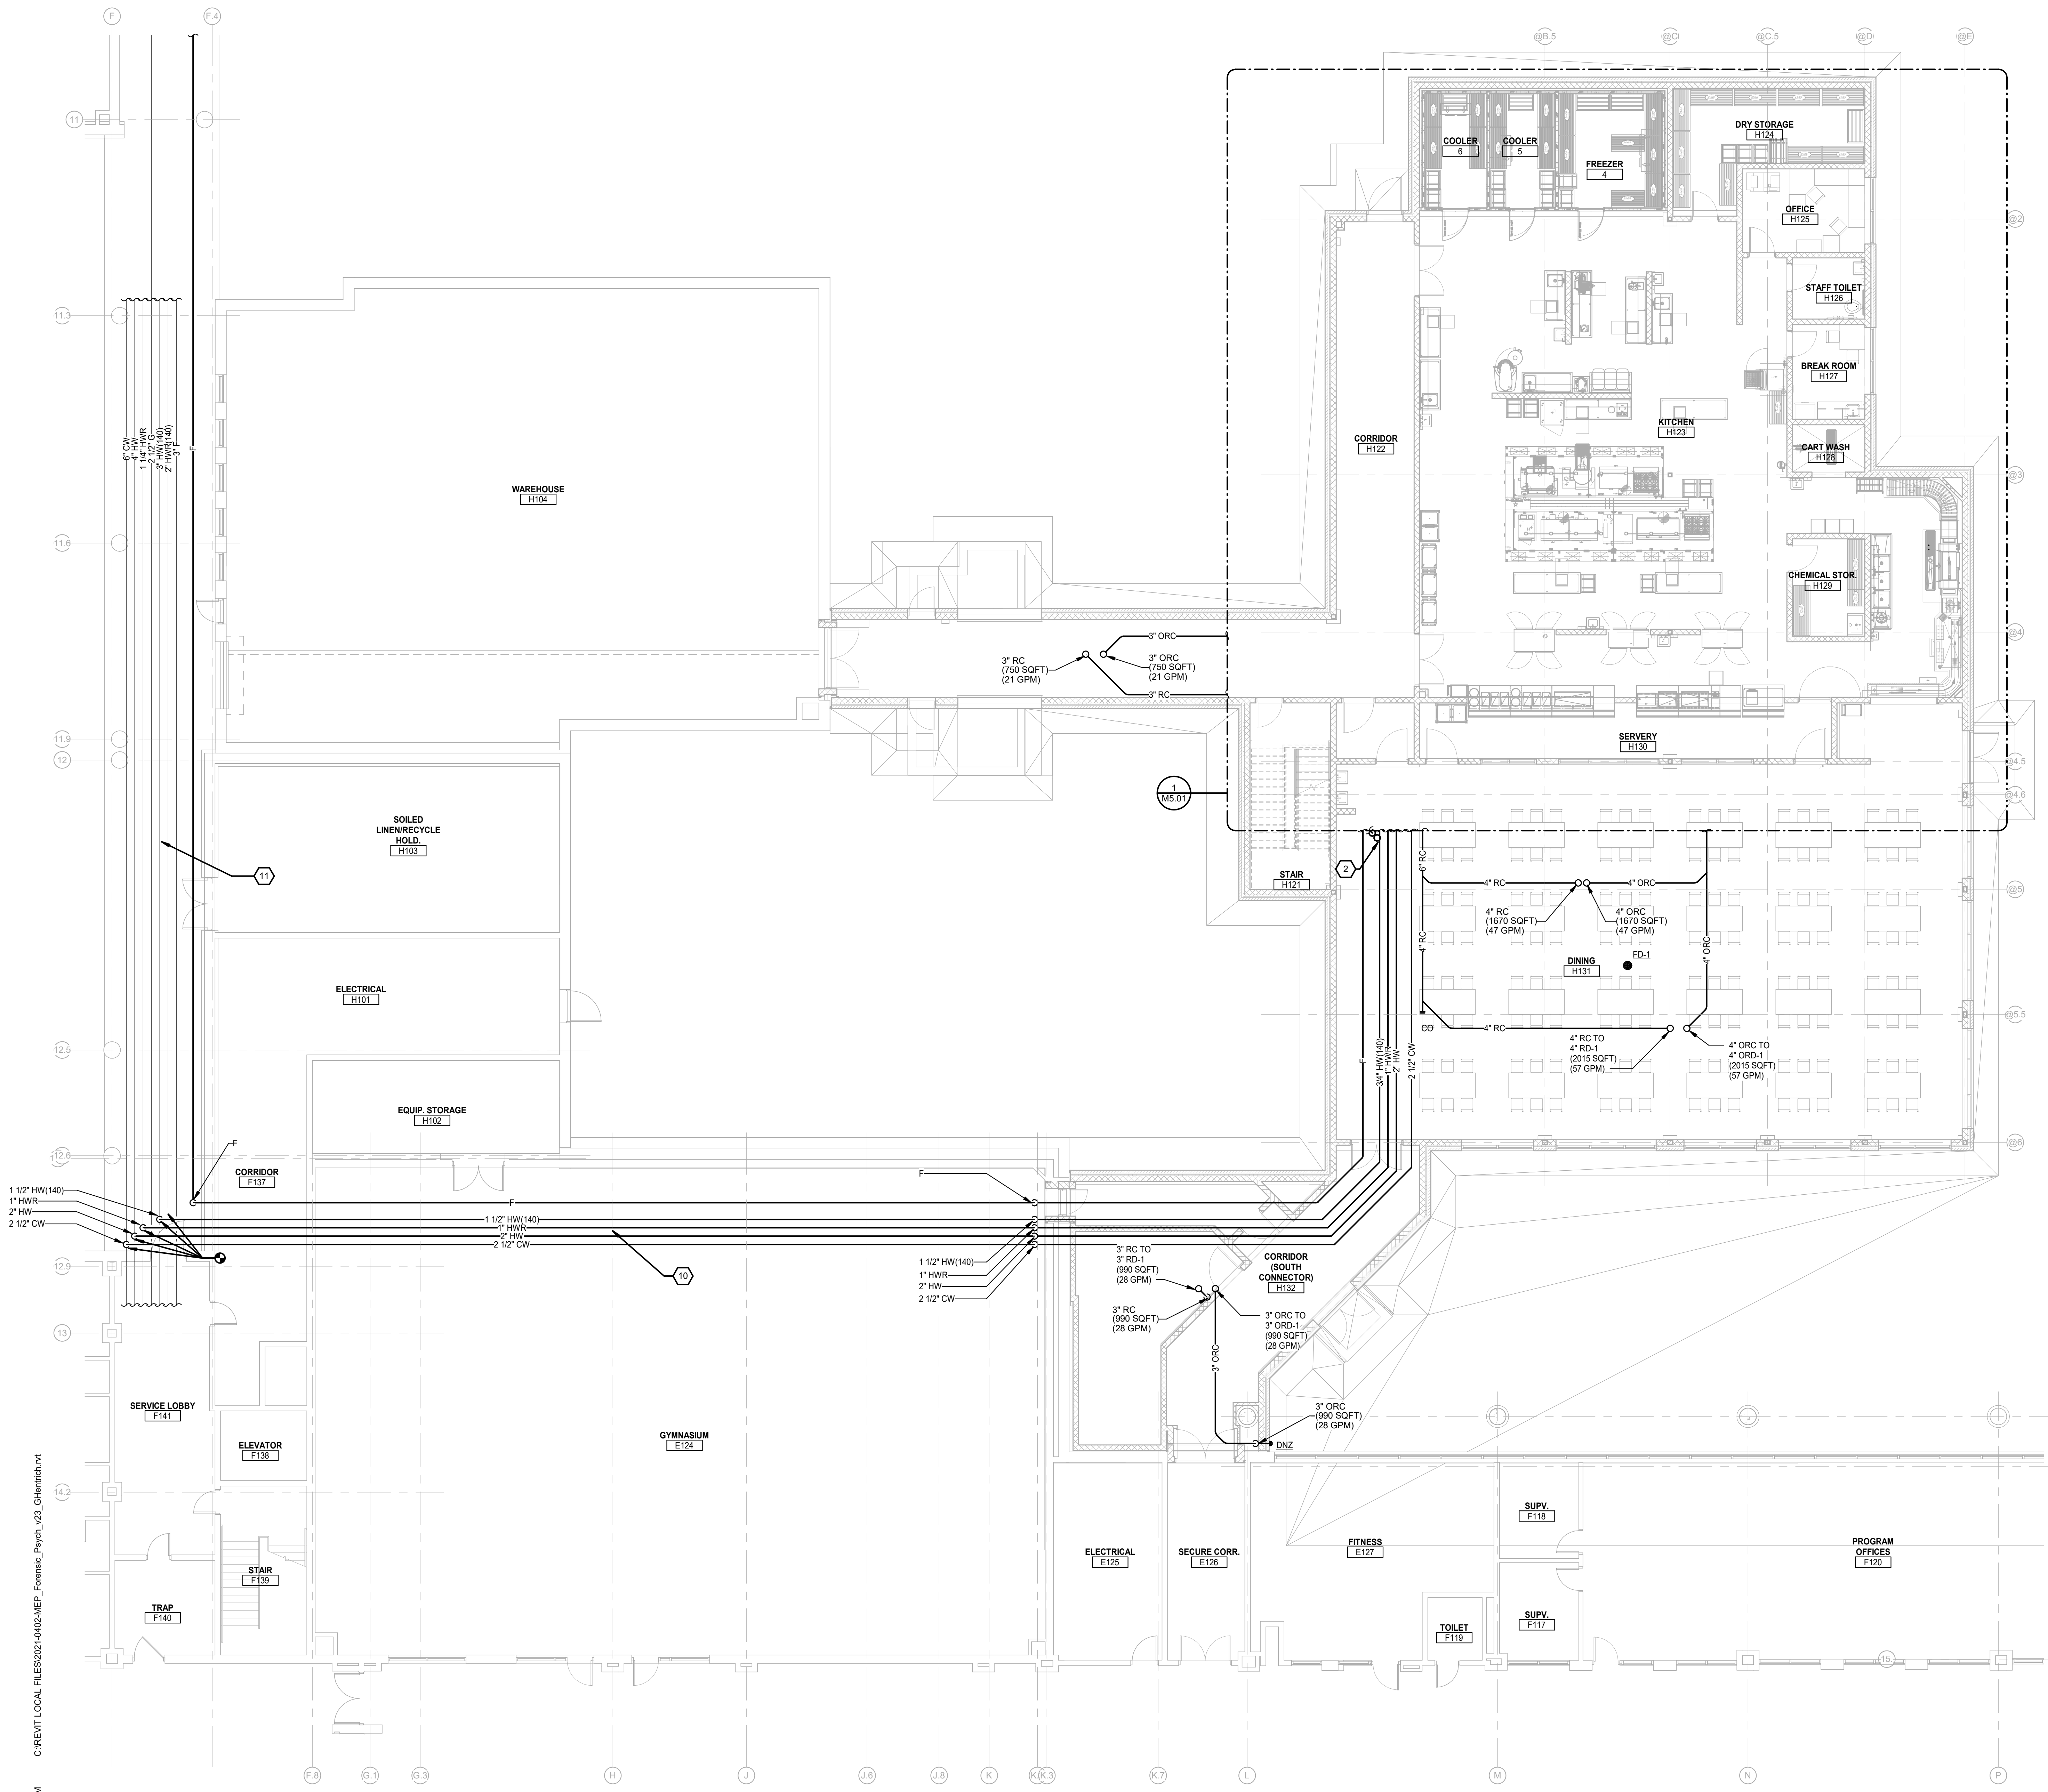

FIRE PROTECTION GENERAL NOTES:

- 1 THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- 2 INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- 3 NO SPRINKLER PIPING SHALL BE ROUTED THROUGH ELECTRICAL EQUIPMENT ROOMS, TELECOMMUNICATION EQUIPMENT ROOMS, ELEVATOR EQUIPMENT ROOMS OR SIMILAR ROOMS. ONLY SPRINKLER PIPING SERVING SPRINKLER HEADS IN THOSE ROOMS SHALL BE ALLOWED.
- 4 PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- 5 MINIMUM RUN-OUT PIPE SIZE TO SPRINKLER HEADS SHALL BE 1".
- 6 PROVIDE AN AUTOMATIC WET PIPE SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13 <<<LIGHT HAZARD>>> CLASSIFICATION. HYDRAULIC CALCULATIONS SHALL BE BASED ON DENSITY OF <<<0.10>>> GPM/SQ FT. OVER THE MOST REMOTE <<<1500>>> SQ. FT.
- 7 ACCORDING TO THE MOST RECENT FLOW TEST INFORMATION, THE STATIC PRESSURE AVAILABLE AT THE CITY WATER MAIN AT THE STREET IS <<<90>>> PSIG. RESIDUAL PRESSURE WITH <<<000>>> GPM FLOWING IS <<<80>>> PSIG. CONTRACTOR SHALL MAKE HIS OWN PRESSURE AND FLOW TEST PRIOR TO SYSTEM DESIGN.
- 8 FIRE PROTECTION WATER SERVICE ENTRANCE PIPING SHALL BE BURIED WITH DEPTH OF COVER OVER TOP OF PIPE OF AT LEAST <<<12>>>, OR WITH TOP OF PIPE AT LEAST 12" BELOW LEVEL OF MAXIMUM FROST PENETRATION, OR AS REQUIRED BY AUTHORITIES HAVING JURISDICTION, WHICHEVER IS DEEPEST.

PLUMBING GENERAL NOTES:

- 1 THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- 2 INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- 3 PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- 4 COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- 5 PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- 6 REFER TO ARCHITECTURAL PLANS FOR DIMENSIONED LOCATIONS OF PLUMBING FIXTURES.
- 7 HOT AND COLD WATER PIPING RUN-OUTS TO LAVATORIES AND SINKS SHALL BE 1/2" UNLESS OTHERWISE NOTED.
- 8 PLUMBING VENT PIPING THROUGH ROOF SHALL BE LOCATED A MINIMUM OF 10'-0" FROM ANY FRESH AIR INTAKE LOCATION AND A MINIMUM OF 18" CLEAR FROM THE INSIDE FACE OF PARAPET.
- 9 PROVIDE CODE REQUIRED CLEARANCE FOR ALL CLEANOUTS INSTALLED IN SANITARY WASTE AND VENT PIPING.
- 10 MINIMUM UNDERGROUND PIPE SIZE SHALL BE 3".

CONSTRUCTION KEY NOTES:

- 1 3 SAN TO LAV/SINK.
- 2 3 SAN TO FLOOR DRAIN/SINK.
- 3 3 GSAN TO SINK.
- 4 4 SAN TO WC.
- 5 4 GSAN TO FLOOR TROUGH.
- 6 3 SAN TO FLOOR TROUGH.
- 7 1/2 CW TO DRAIN COOLER.
- 8 4 SAN TO FLOOR TROUGH.
- 9 4 SAN TO FLOOR DRAIN/SINK.
- 10 ROUTE IN CEILING SPACE OF GYM. ROUTE ALONG SIDE NEW MECHANICAL PIPING. COORDINATE FINAL ROUTING WITH MECHANICAL TRADES.
- 11 PIPING IN THIS AREA ROUTED WITHIN SECOND FLOOR CEILING SPACE.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

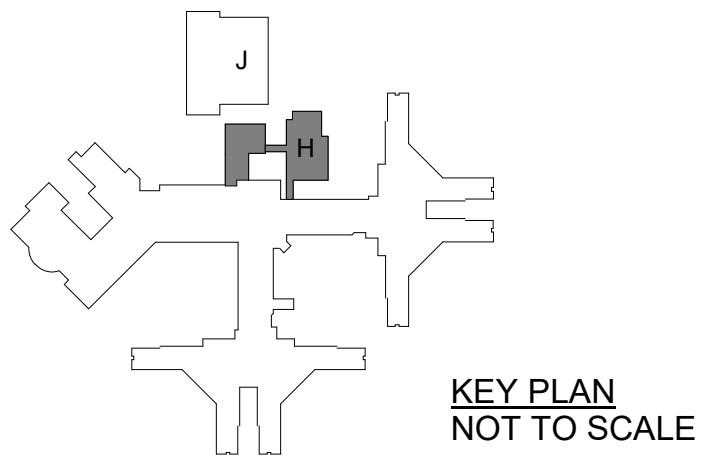

WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN**
SALINE, MICHIGAN

SHEET TITLE
**FIRST FLOOR PLUMBING
AND FIRE PROTECTION
PLAN - UNIT H**

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
SEPTEMBER 6, 2023

M2.01



CHECKED BY
WEK

Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PEA Project No. 303-0492

FIRST FLOOR PLUMBING AND FIRE PROTECTION PLAN - UNIT H
SCALE: 1/8" = 1'-0"

9/20/2023 4:36:48 PM C:\REVIT LOCAL FILES\2023-0402-MEZ_Forensic_Plan_v23_Gheintch.rvt

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

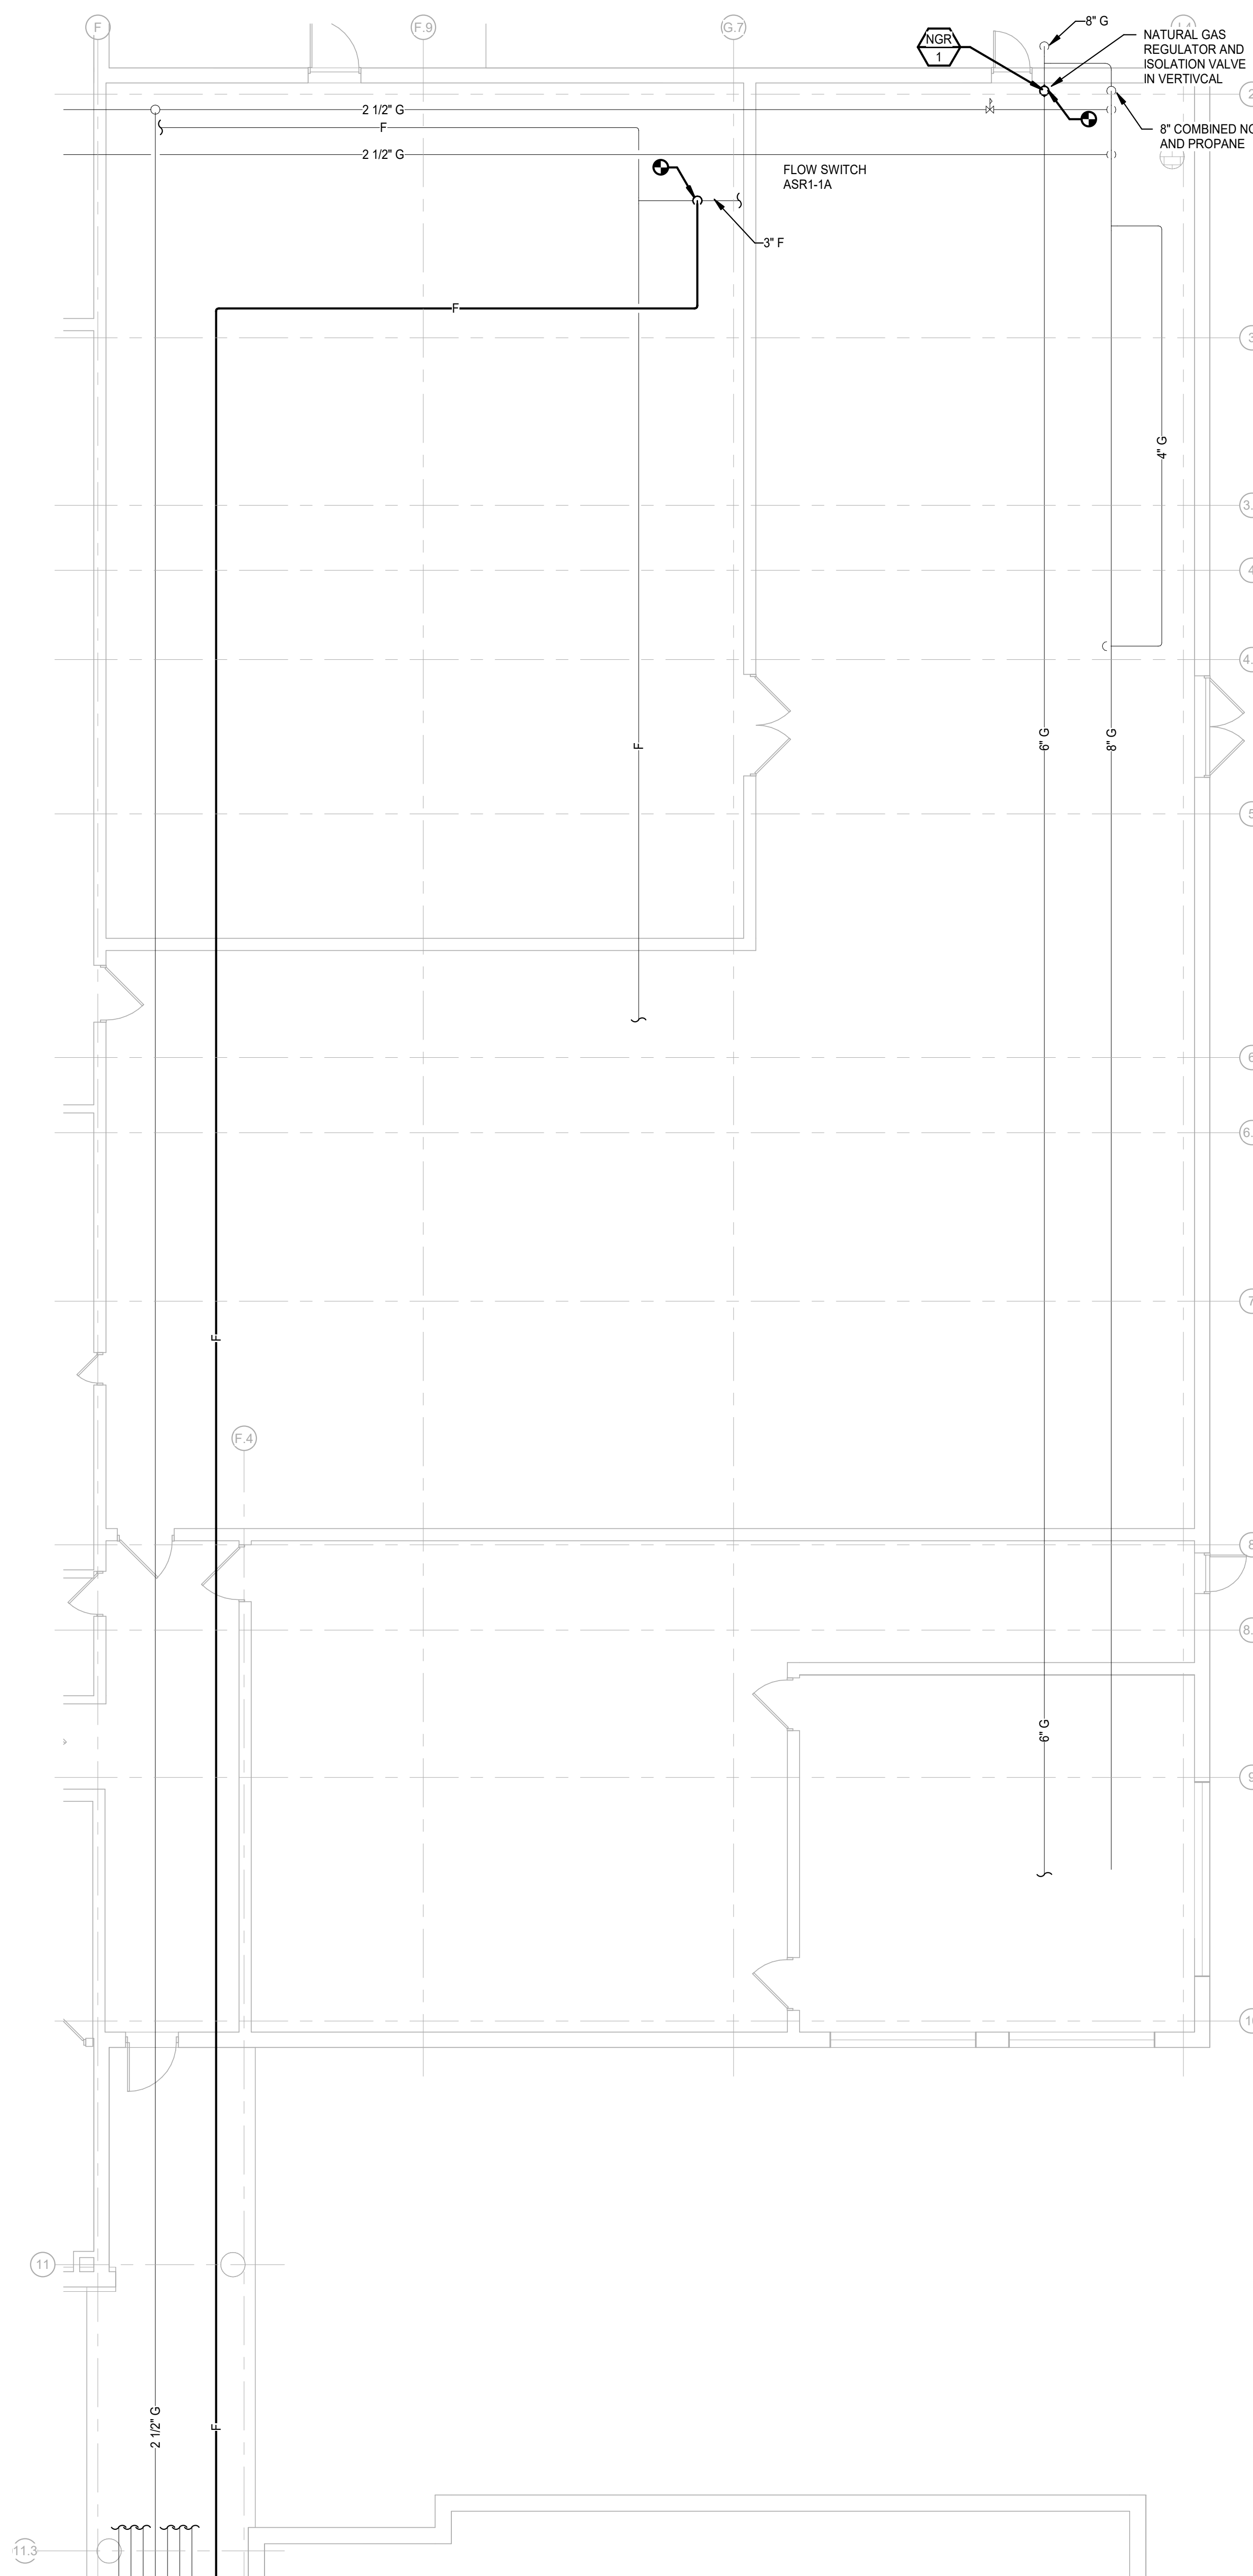

FIRE PROTECTION GENERAL NOTES:

- 1 THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- 2 INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- 3 NO SPRINKLER PIPING SHALL BE ROUTED THROUGH ELECTRICAL EQUIPMENT ROOMS, TELECOMMUNICATION EQUIPMENT ROOMS, ELEVATOR EQUIPMENT ROOMS OR SIMILAR ROOMS. ONLY SPRINKLER PIPING SERVING SPRINKLER HEADS IN THOSE ROOMS SHALL BE ALLOWED.
- 4 PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- 5 MINIMUM RUN-OUT PIPE SIZE TO SPRINKLER HEADS SHALL BE 1\".
- 6 PROVIDE AN AUTOMATIC WET PIPE SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13 <<<LIGHT HAZARD>>> CLASSIFICATION. HYDRAULIC CALCULATIONS SHALL BE BASED ON DENSITY OF <<<0.10>>> GPM/SQ FT. OVER THE MOST REMOTE <<<1500>>> SQ. FT.
- 7 ACCORDING TO THE MOST RECENT FLOW TEST INFORMATION, THE STATIC PRESSURE AVAILABLE AT THE CITY WATER MAIN AT THE STREET IS <<<90>>> PSIG. RESIDUAL PRESSURE WITH <<<XXX>>> GPM FLOWING IS <<<XX>>> PSIG. CONTRACTOR SHALL MAKE HIS OWN PRESSURE AND FLOW TEST PRIOR TO SYSTEM DESIGN.
- 8 FIRE PROTECTION WATER SERVICE ENTRANCE PIPING SHALL BE BURIED WITH DEPTH OF COVER OVER TOP OF PIPE OF AT LEAST <<<72\">>>, OR WITH TOP OF PIPE AT LEAST 12\" BELOW LEVEL OF MAXIMUM FROST PENETRATION, OR AS REQUIRED BY AUTHORITIES HAVING JURISDICTION, WHICHEVER IS DEEPEST.

PLUMBING GENERAL NOTES:

- 1 THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- 2 INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- 3 PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- 4 COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- 5 PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- 6 REFER TO ARCHITECTURAL PLANS FOR DIMENSIONED LOCATIONS OF PLUMBING FIXTURES.
- 7 HOT AND COLD WATER PIPING RUN-OUTS TO LAVATORIES AND SINKS SHALL BE 1/2\" UNLESS OTHERWISE NOTED.
- 8 PLUMBING VENT PIPING THROUGH ROOF SHALL BE LOCATED A MINIMUM OF 10'-0\" FROM ANY FRESH AIR INTAKE LOCATION AND A MINIMUM OF 18\" CLEAR FROM THE INSIDE FACE OF PARAPET.
- 9 PROVIDE CODE REQUIRED CLEARANCE FOR ALL CLEANOUTS INSTALLED IN SANITARY WASTE AND VENT PIPING.
- 10 MINIMUM UNDERGROUND PIPE SIZE SHALL BE 3\".

CONSTRUCTION KEY NOTES:

- 1 3 SAN TO LAV/SINK.
- 2 3 SAN TO FLOOR DRAIN/SINK.
- 3 3 GSAN TO SINK.
- 4 4 SAN TO WC.
- 5 4 GSAN TO FLOOR TROUGH.
- 6 3 SAN TO FLOOR TROUGH.
- 7 1/2 CW TO DRAIN COOLER.
- 8 4 SAN TO FLOOR TROUGH.
- 9 4 SAN TO FLOOR DRAIN/SINK.
- 10 ROUTE IN CEILING SPACE OF GYM. ROUTE ALONG SIDE NEW MECHANICAL PIPING. COORDINATE FINAL ROUTING WITH MECHANICAL TRADES.
- 11 PIPING IN THIS AREA ROUTED WITHIN SECOND FLOOR CEILING SPACE.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

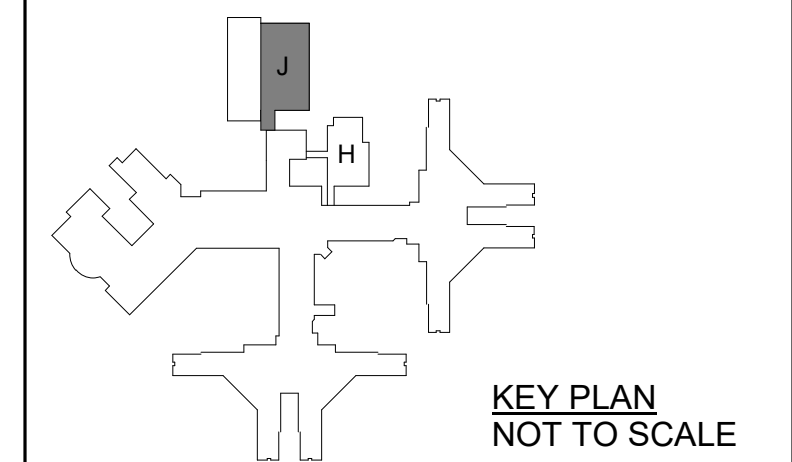

WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

WTAARCH.COM

COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN


SHEET TITLE
FIRST FLOOR PLUMBING AND FIRE PROTECTION PLAN - UNIT J

PROJECT NUMBER 2021094	SHEET NUMBER M2.02
PROJECT DATE SEPTEMBER 6, 2023	CHECKED BY WEK

FIRST FLOOR PLUMBING AND FIRE PROTECTION PLAN - UNIT J
SCALE: 1/8" = 1'-0"

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0492

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

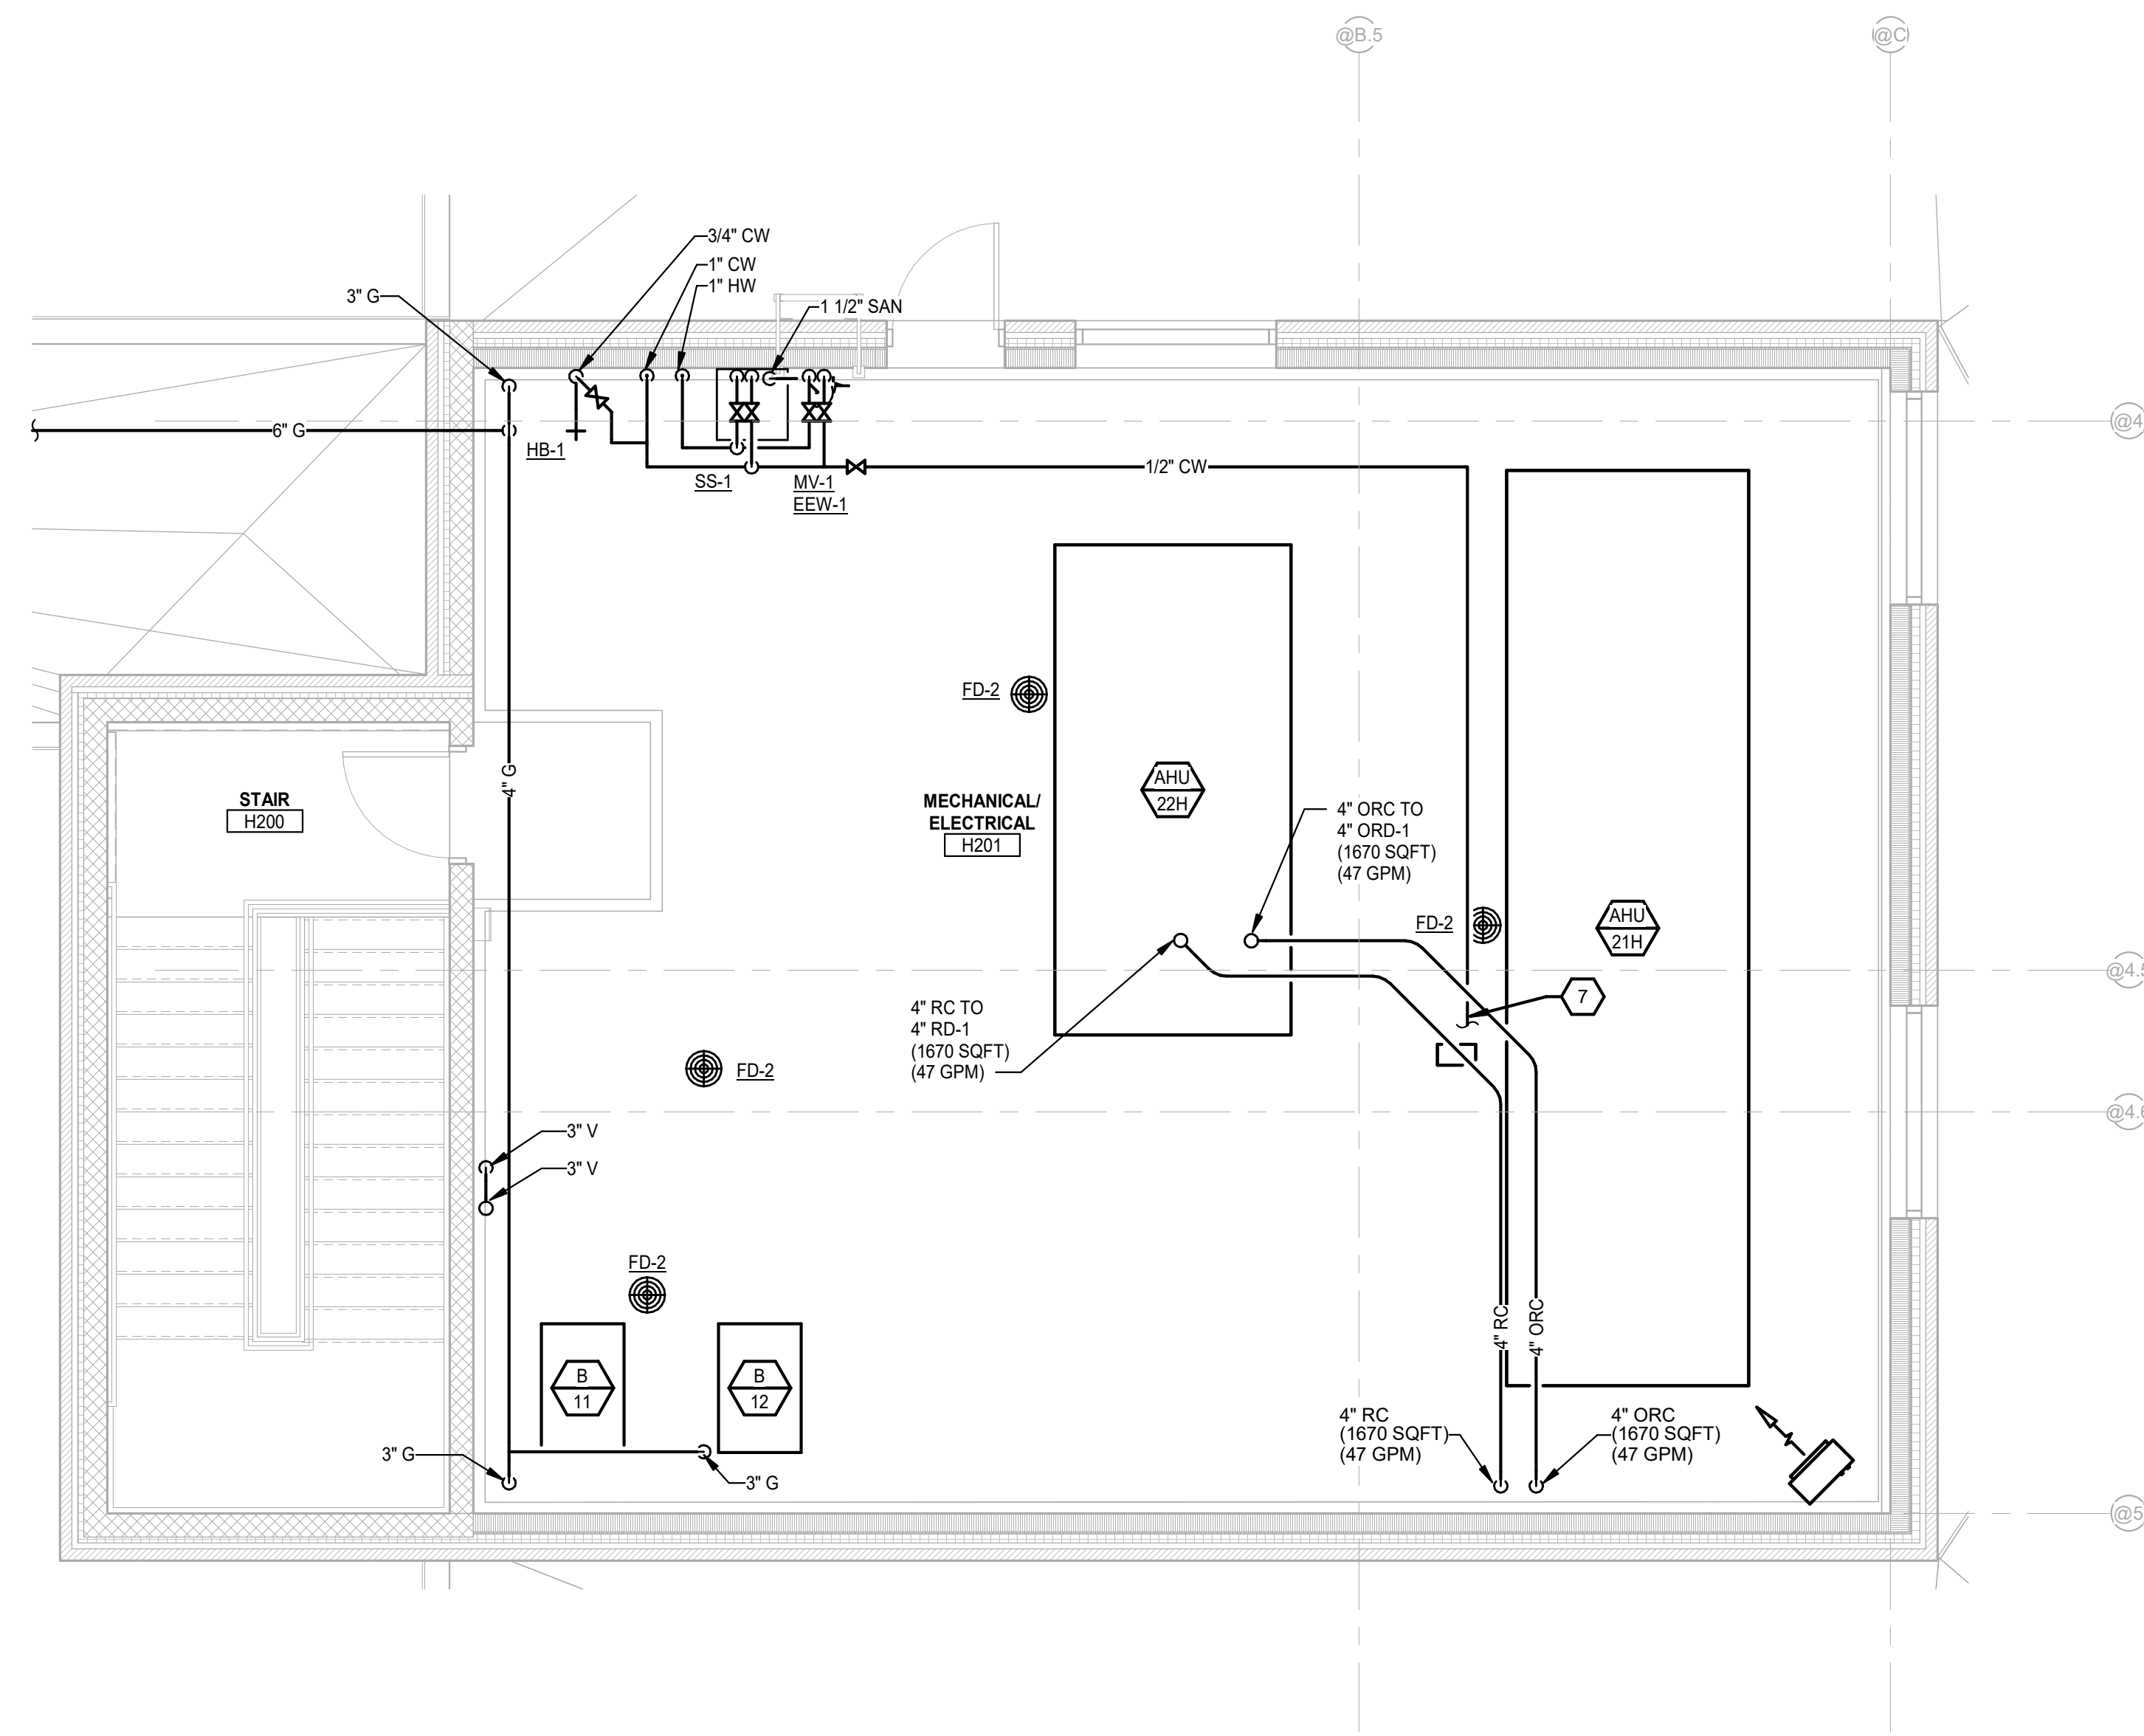

PENTHOUSE PLUMBING PLAN
SCALE: 1/4" = 1'-0"

FIRE PROTECTION GENERAL NOTES:

- THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- NO SPRINKLER PIPING SHALL BE ROUTED THROUGH ELECTRICAL EQUIPMENT ROOMS, TELECOMMUNICATION EQUIPMENT ROOMS, ELEVATOR EQUIPMENT ROOMS OR SIMILAR ROOMS. ONLY SPRINKLER PIPING SERVING SPRINKLER HEADS IN THOSE ROOMS SHALL BE ALLOWED.
- PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- MINIMUM RUN-OUT PIPE SIZE TO SPRINKLER HEADS SHALL BE 1".
- PROVIDE AN AUTOMATIC WET PIPE SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13 <<<LIGHT HAZARD>>> CLASSIFICATION. HYDRAULIC CALCULATIONS SHALL BE BASED ON DENSITY OF <<<0.10>>> GPM/SQ FT. OVER THE MOST REMOTE <<<1500>>> SQ. FT.
- ACCORDING TO THE MOST RECENT FLOW TEST INFORMATION, THE STATIC PRESSURE AVAILABLE AT THE CITY WATER MAIN AT THE STREET IS <<<92>>> PSIG. RESIDUAL PRESSURE WITH <<<XXX>>> GPM FLOWING IS <<<XX>>> PSIG. CONTRACTOR SHALL MAKE HIS OWN PRESSURE AND FLOW TEST PRIOR TO SYSTEM DESIGN.
- FIRE PROTECTION WATER SERVICE ENTRANCE PIPING SHALL BE BURIED WITH DEPTH OF COVER OVER TOP OF PIPE OF AT LEAST <<<72">>>, OR WITH TOP OF PIPE AT LEAST 12" BELOW LEVEL OF MAXIMUM FROST PENETRATION, OR AS REQUIRED BY AUTHORITIES HAVING JURISDICTION, WHICHEVER IS DEEPEST.

PLUMBING GENERAL NOTES:

- THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- REFER TO ARCHITECTURAL PLANS FOR DIMENSIONED LOCATIONS OF PLUMBING FIXTURES.
- HOT AND COLD WATER PIPING RUN-OUTS TO LAVATORIES AND SINKS SHALL BE 1/2" UNLESS OTHERWISE NOTED.
- PLUMBING VENT PIPING THROUGH ROOF SHALL BE LOCATED A MINIMUM OF 10'-0" FROM ANY FRESH AIR INTAKE LOCATION AND A MINIMUM OF 18" CLEAR FROM THE INSIDE FACE OF PARAPET.
- PROVIDE CODE REQUIRED CLEARANCE FOR ALL CLEANOUTS INSTALLED IN SANITARY WASTE AND VENT PIPING.
- MINIMUM UNDERGROUND PIPE SIZE SHALL BE 3".

CONSTRUCTION KEY NOTES:

- 3 SAN TO LAV/SINK.
- 3 SAN TO FLOOR DRAIN/SINK.
- 3 G SAN TO SINK.
- 4 SAN TO WC.
- 4 G SAN TO FLOOR TROUGH.
- 3 SAN TO FLOOR TROUGH.
- 1/2 CW TO DRAIN COOLER.
- 4 SAN TO FLOOR TROUGH.
- 4 SAN TO FLOOR DRAIN/SINK.
- ROUTE IN CEILING SPACE OF GYM. ROUTE ALONG SIDE NEW MECHANICAL PIPING. COORDINATE FINAL ROUTING WITH MECHANICAL TRADES.
- PIPING IN THIS AREA ROUTED WITHIN SECOND FLOOR CEILING SPACE.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

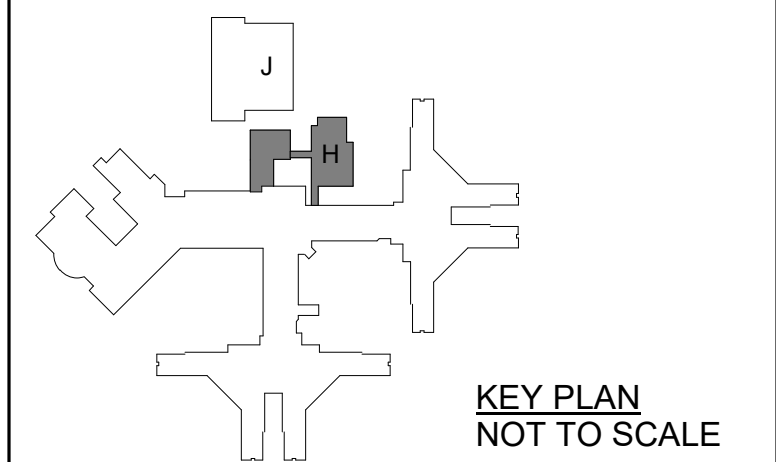

WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023


PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
PENTHOUSE PLUMBING PLAN

PROJECT NUMBER 2021094	SHEET NUMBER
PROJECT DATE SEPTEMBER 6, 2023	M2.03
CHECKED BY WEK	

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0492

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

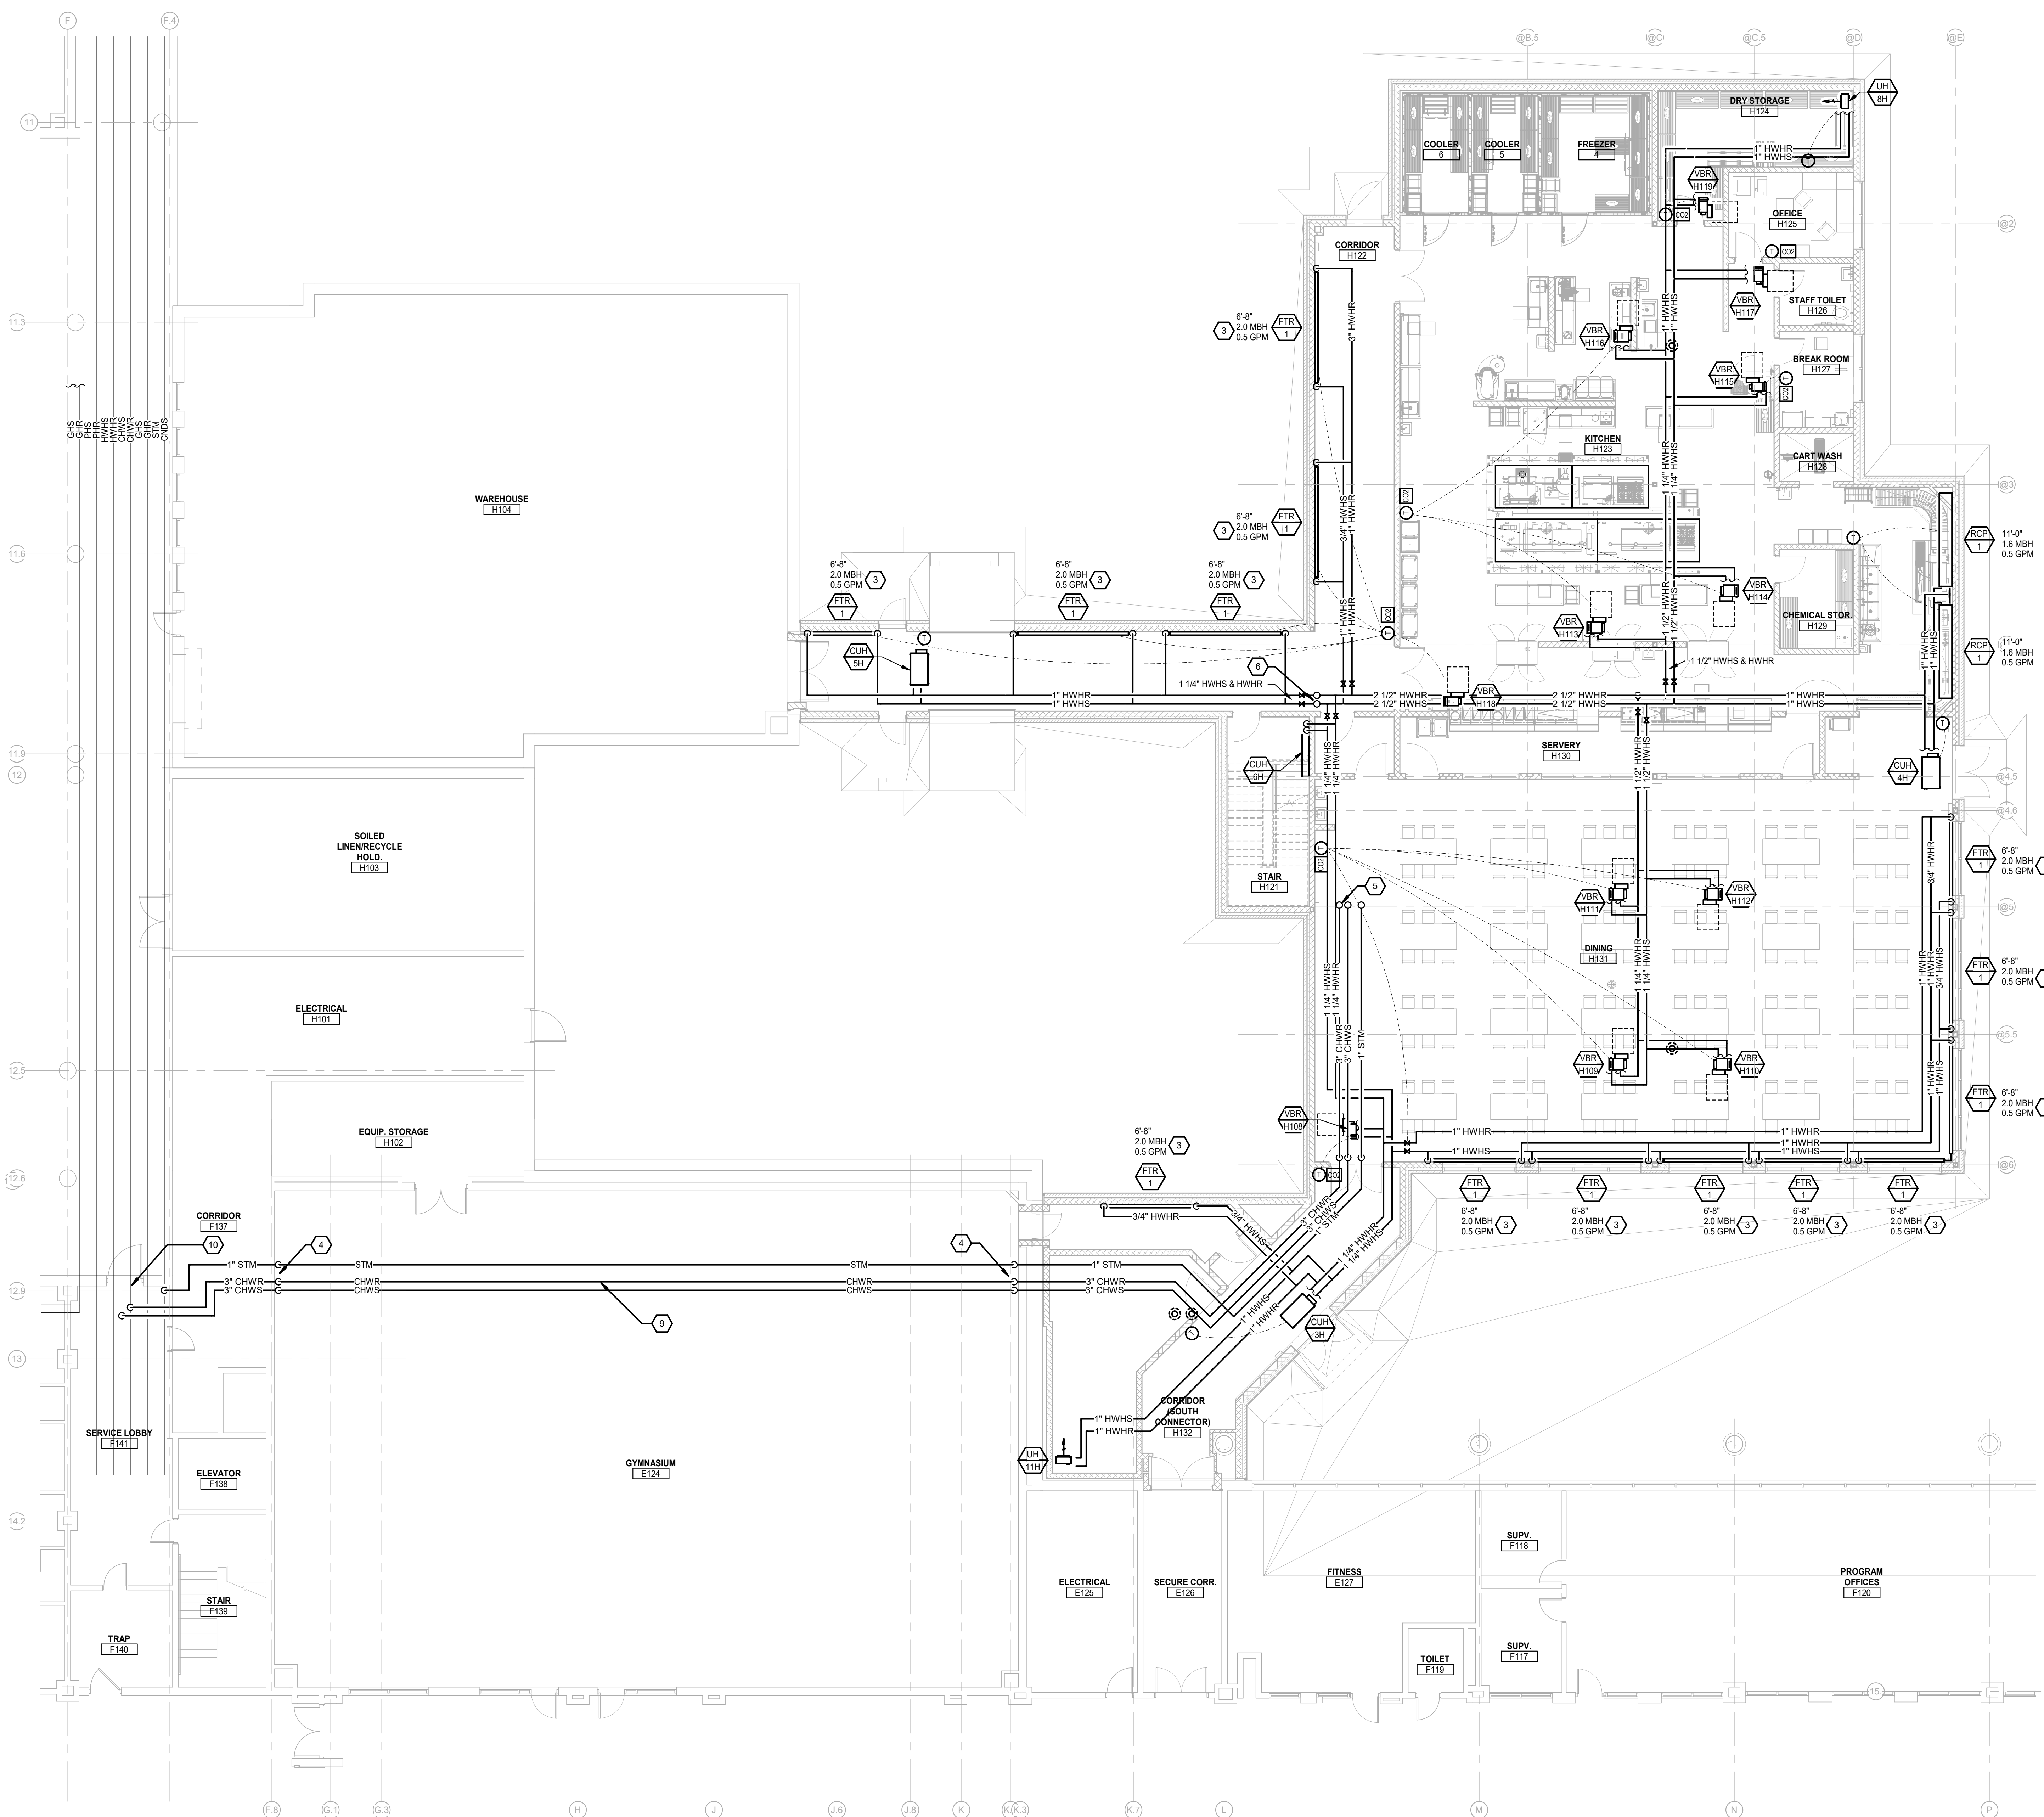

HVAC PIPING GENERAL NOTES:

- THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION/SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- PIPING AND DUCTWORK SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- SUBMIT PROPOSED METHODS OF ANCHORING AND GUIDING PIPING SYSTEMS TO STRUCTURAL ENGINEER FOR APPROVAL.
- COORDINATE LOCATION OF DUCT-MOUNTED HYDRONIC DEVICES WITH SHEET METAL TRADES.
- BRANCH PIPING SERVING TERMINAL UNIT HEATING COILS OR RADIANT CEILING PANELS SHALL BE 3/4" UNLESS OTHERWISE NOTED. BRANCH PIPING SERVING MORE THAN ONE TERMINAL UNIT HEATING COIL SHALL BE 1" UNLESS OTHERWISE NOTED. BRANCH PIPING SERVING HOT WATER UNIT HEATERS AND CABINET UNIT HEATERS SHALL BE 1" UNLESS OTHERWISE NOTED.
- REFER TO TEMPERATURE CONTROLS STANDARD MOUNTING HEIGHTS DETAIL FOR ELEVATIONS OF WALL MOUNTED TEMPERATURE CONTROL DEVICES.

CONSTRUCTION KEY NOTES:

- EMERGENCY BOILER SHUT OFF
- GLYCOL FILL STATION
- LENGTHS SHOWN ARE ACTIVE ELEMENT LENGTH. CONTRACTOR TO SUPPLY FULL LENGTH COVER.
- ROUTE CHWS, CHWR, AND STEAM UP TO CEILING SPACE AND ROUTE THROUGH JOIST SPACE.
- 3" CHWS, 3" CHWR, 1" STEAM UP TO PENTHOUSE. REFER TO SHEET M3.03 FOR CONTINUATION.
- 3" HWHS AND HWHR UP TO PENTHOUSE. REFER TO SHEET M3.03 FOR CONTINUATION.
- 3" CHWS, 3" CHWR, 1" STEAM DOWN TO FIRST FLOOR. REFER TO SHEET M3.01 FOR CONTINUATION.
- 3" HWHS AND HWHR DOWN TO FIRST FLOOR. REFER TO SHEET M3.01 FOR CONTINUATION.
- ROUTE MECHANICAL PIPING IN CEILING SPACE OF GYM. COORDINATE FINAL ROUTING WITH MECHANICAL TRADES.
- EXISTING LINES THAT NEW MECHANICAL PIPING WILL TIE INTO ARE LOCATED ON SECOND FLOOR.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

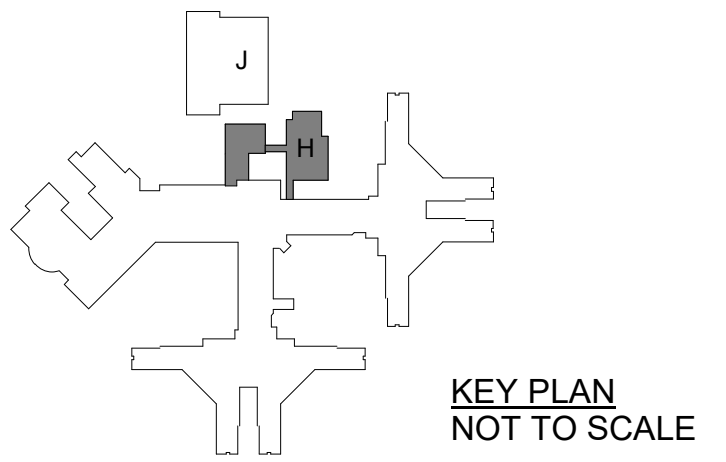

WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN

SALINE, MICHIGAN

SHEET TITLE
FIRST FLOOR HVAC PIPING
PLAN - UNIT H

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
WEK


M3.01

FIRST FLOOR HVAC PIPING PLAN - UNIT H
SCALE: 1/8" = 1'-0"

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0492

9/2/2023 4:37:23 PM C:\REVIT LOCAL FILES\2023-09-02-ME2_Forensic_Plan_v23_Ghent.rvt

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

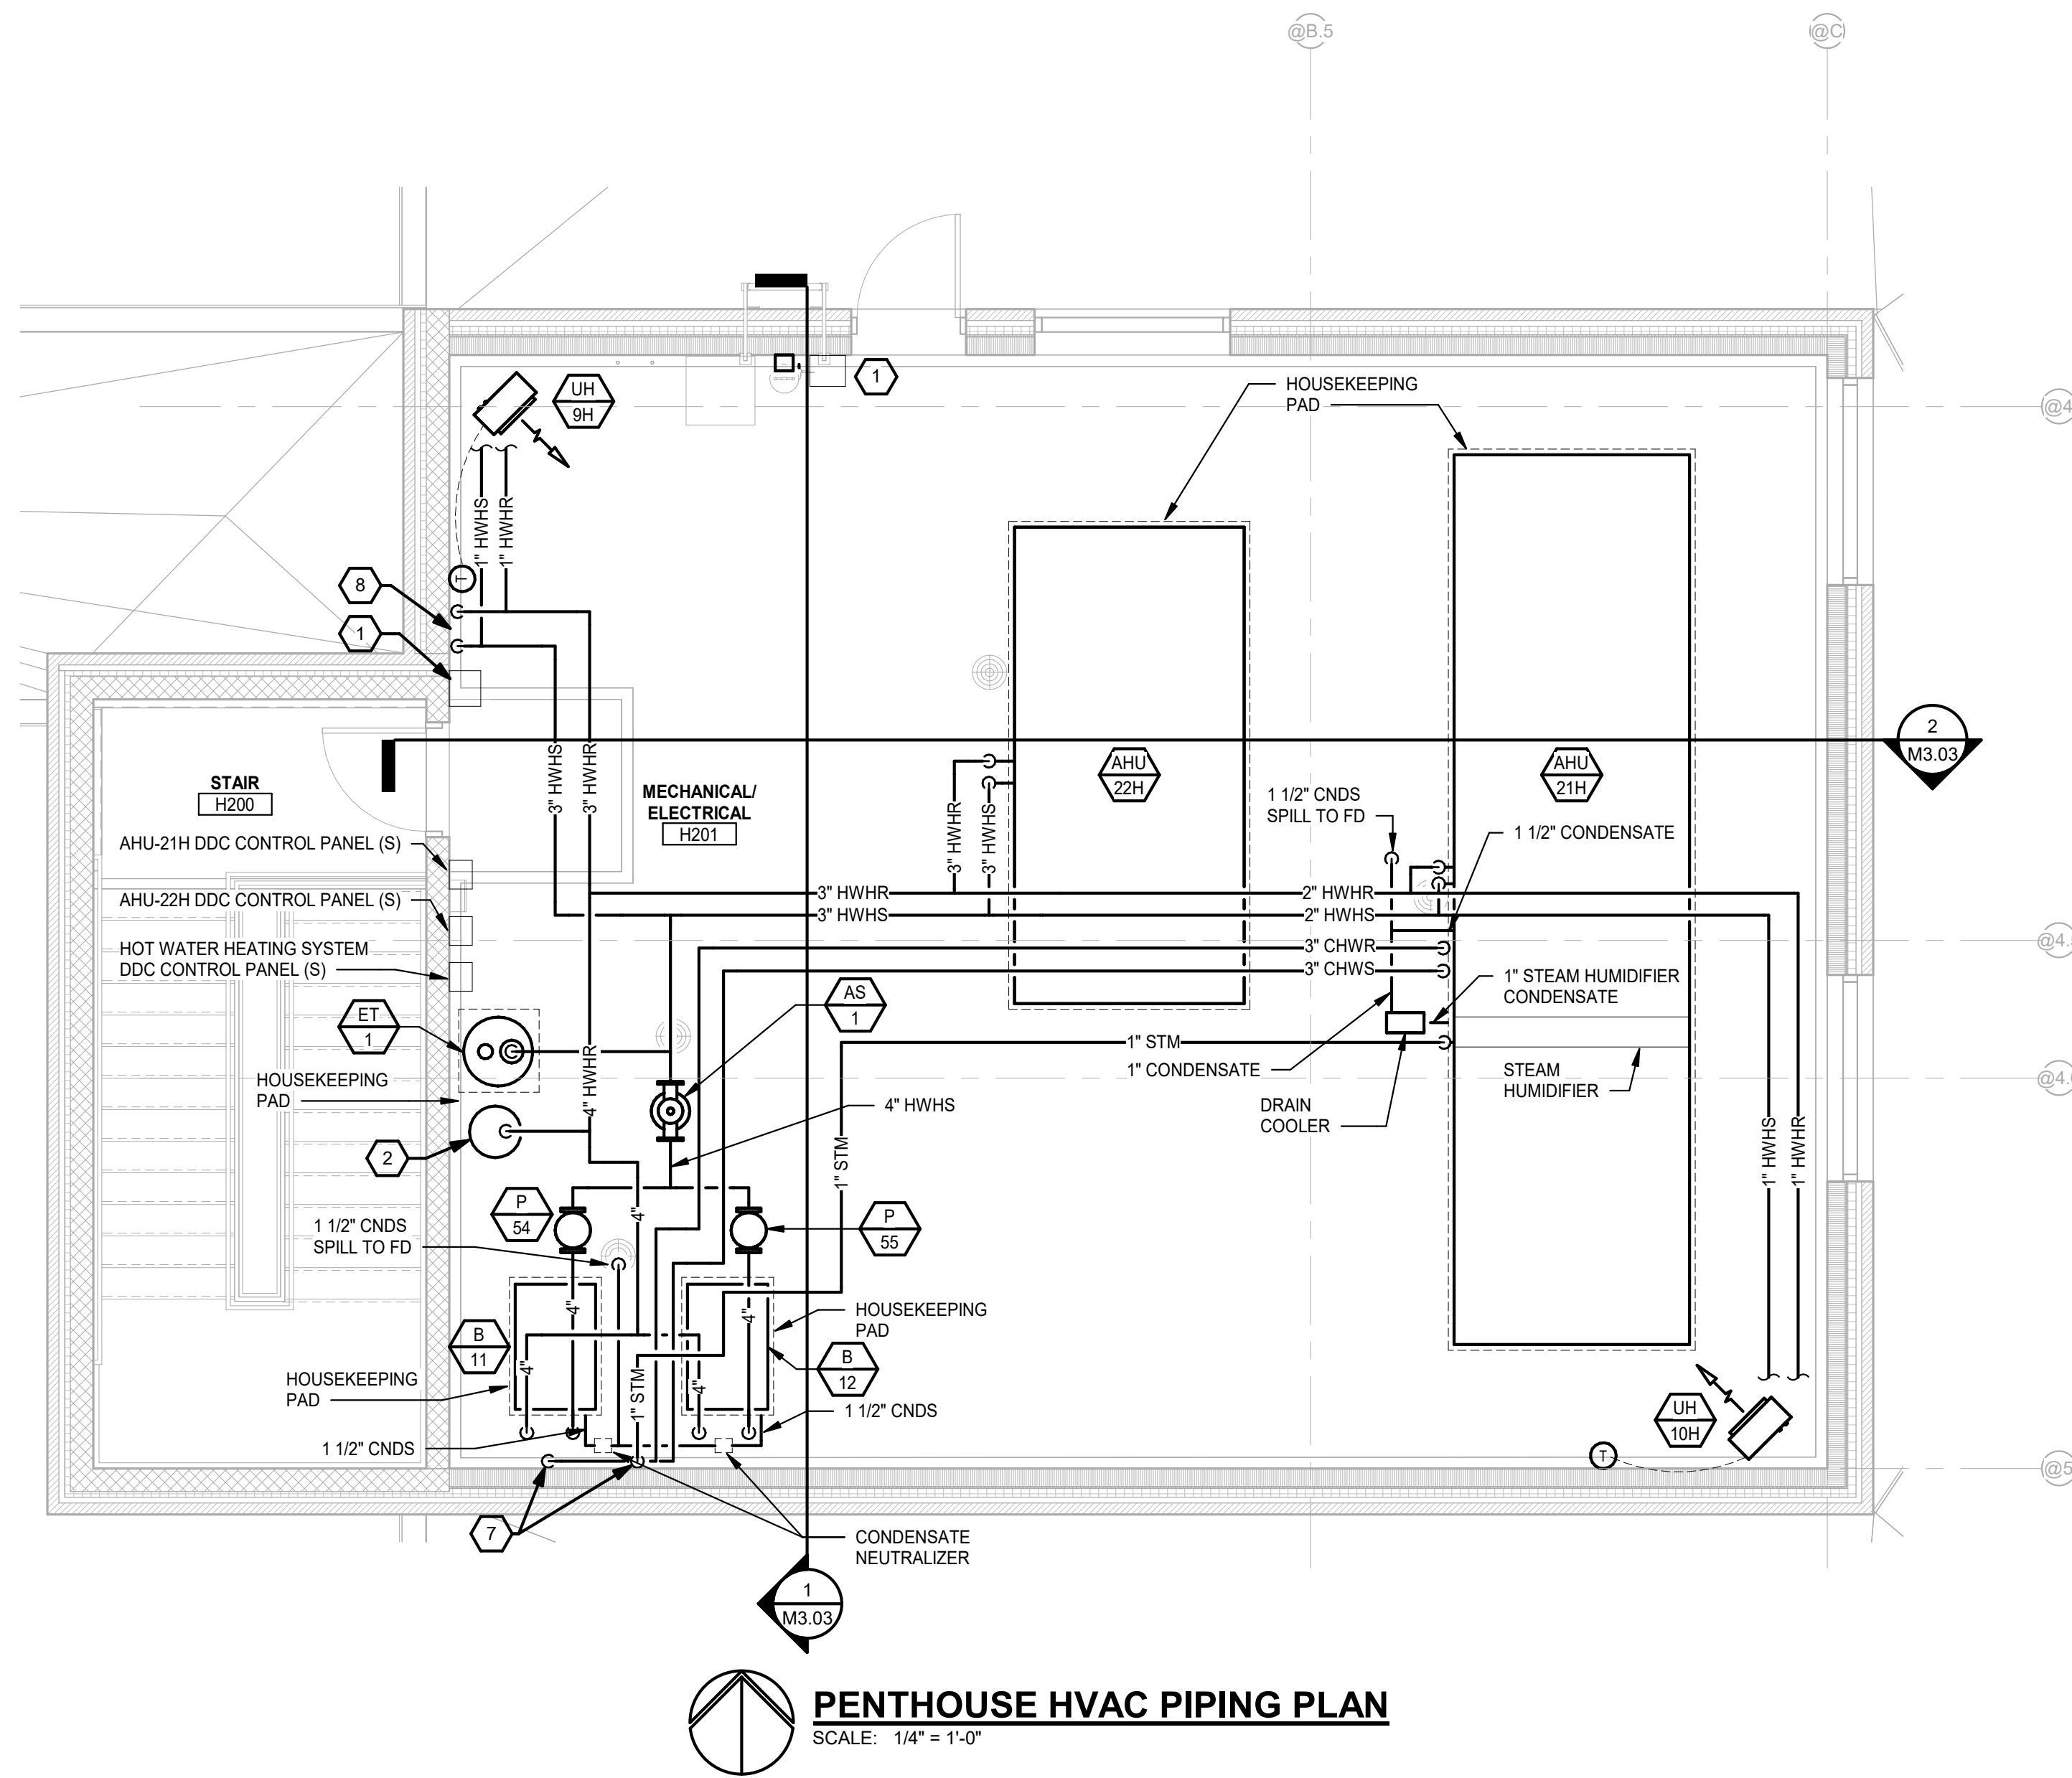


PENTHOUSE HVAC PIPING PLAN
SCALE: 1/4" = 1'-0"

HVAC PIPING GENERAL NOTES:


- THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION/SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- PIPING AND DUCTWORK SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- SUBMIT PROPOSED METHODS OF ANCHORING AND GUIDING PIPING SYSTEMS TO STRUCTURAL ENGINEER FOR APPROVAL.
- COORDINATE LOCATION OF DUCT-MOUNTED HYDRONIC DEVICES WITH SHEET METAL TRADES.
- BRANCH PIPING SERVING TERMINAL UNIT HEATING COILS OR RADIANT CEILING PANELS SHALL BE 3/4" UNLESS OTHERWISE NOTED. BRANCH PIPING SERVING MORE THAN ONE TERMINAL UNIT HEATING COIL SHALL BE 1" UNLESS OTHERWISE NOTED. BRANCH PIPING SERVING HOT WATER UNIT HEATERS AND CABINET UNIT HEATERS SHALL BE 1" UNLESS OTHERWISE NOTED.
- REFER TO TEMPERATURE CONTROLS STANDARD MOUNTING HEIGHTS DETAIL FOR ELEVATIONS OF WALL MOUNTED TEMPERATURE CONTROL DEVICES.

CONSTRUCTION KEY NOTES:

- EMERGENCY BOILER SHUT OFF
- GLYCOL FILL STATION
- LENGTHS SHOWN ARE ACTIVE ELEMENT LENGTH. CONTRACTOR TO SUPPLY FULL LENGTH COVER.
- ROUTE CHWS, CHWR, AND STEAM UP TO CEILING SPACE AND ROUTE THROUGH JOIST SPACE.
- 3" CHWS, 3" CHWR, 1" STEAM UP TO PENTHOUSE. REFER TO SHEET M3.03 FOR CONTINUATION.
- 3" CHWS AND HWHR UP TO PENTHOUSE. REFER TO SHEET M3.03 FOR CONTINUATION.
- 3" CHWS, 3" CHWR, 1" STEAM DOWN TO FIRST FLOOR. REFER TO SHEET M3.01 FOR CONTINUATION.
- 3" HWHS AND HWHR DOWN TO FIRST FLOOR. REFER TO SHEET M3.01 FOR CONTINUATION.
- ROUTE MECHANICAL PIPING IN CEILING SPACE OF GYM. COORDINATE FINAL ROUTING WITH MECHANICAL TRADES.
- EXISTING LINES THAT NEW MECHANICAL PIPING WILL TIE INTO ARE LOCATED ON SECOND FLOOR.

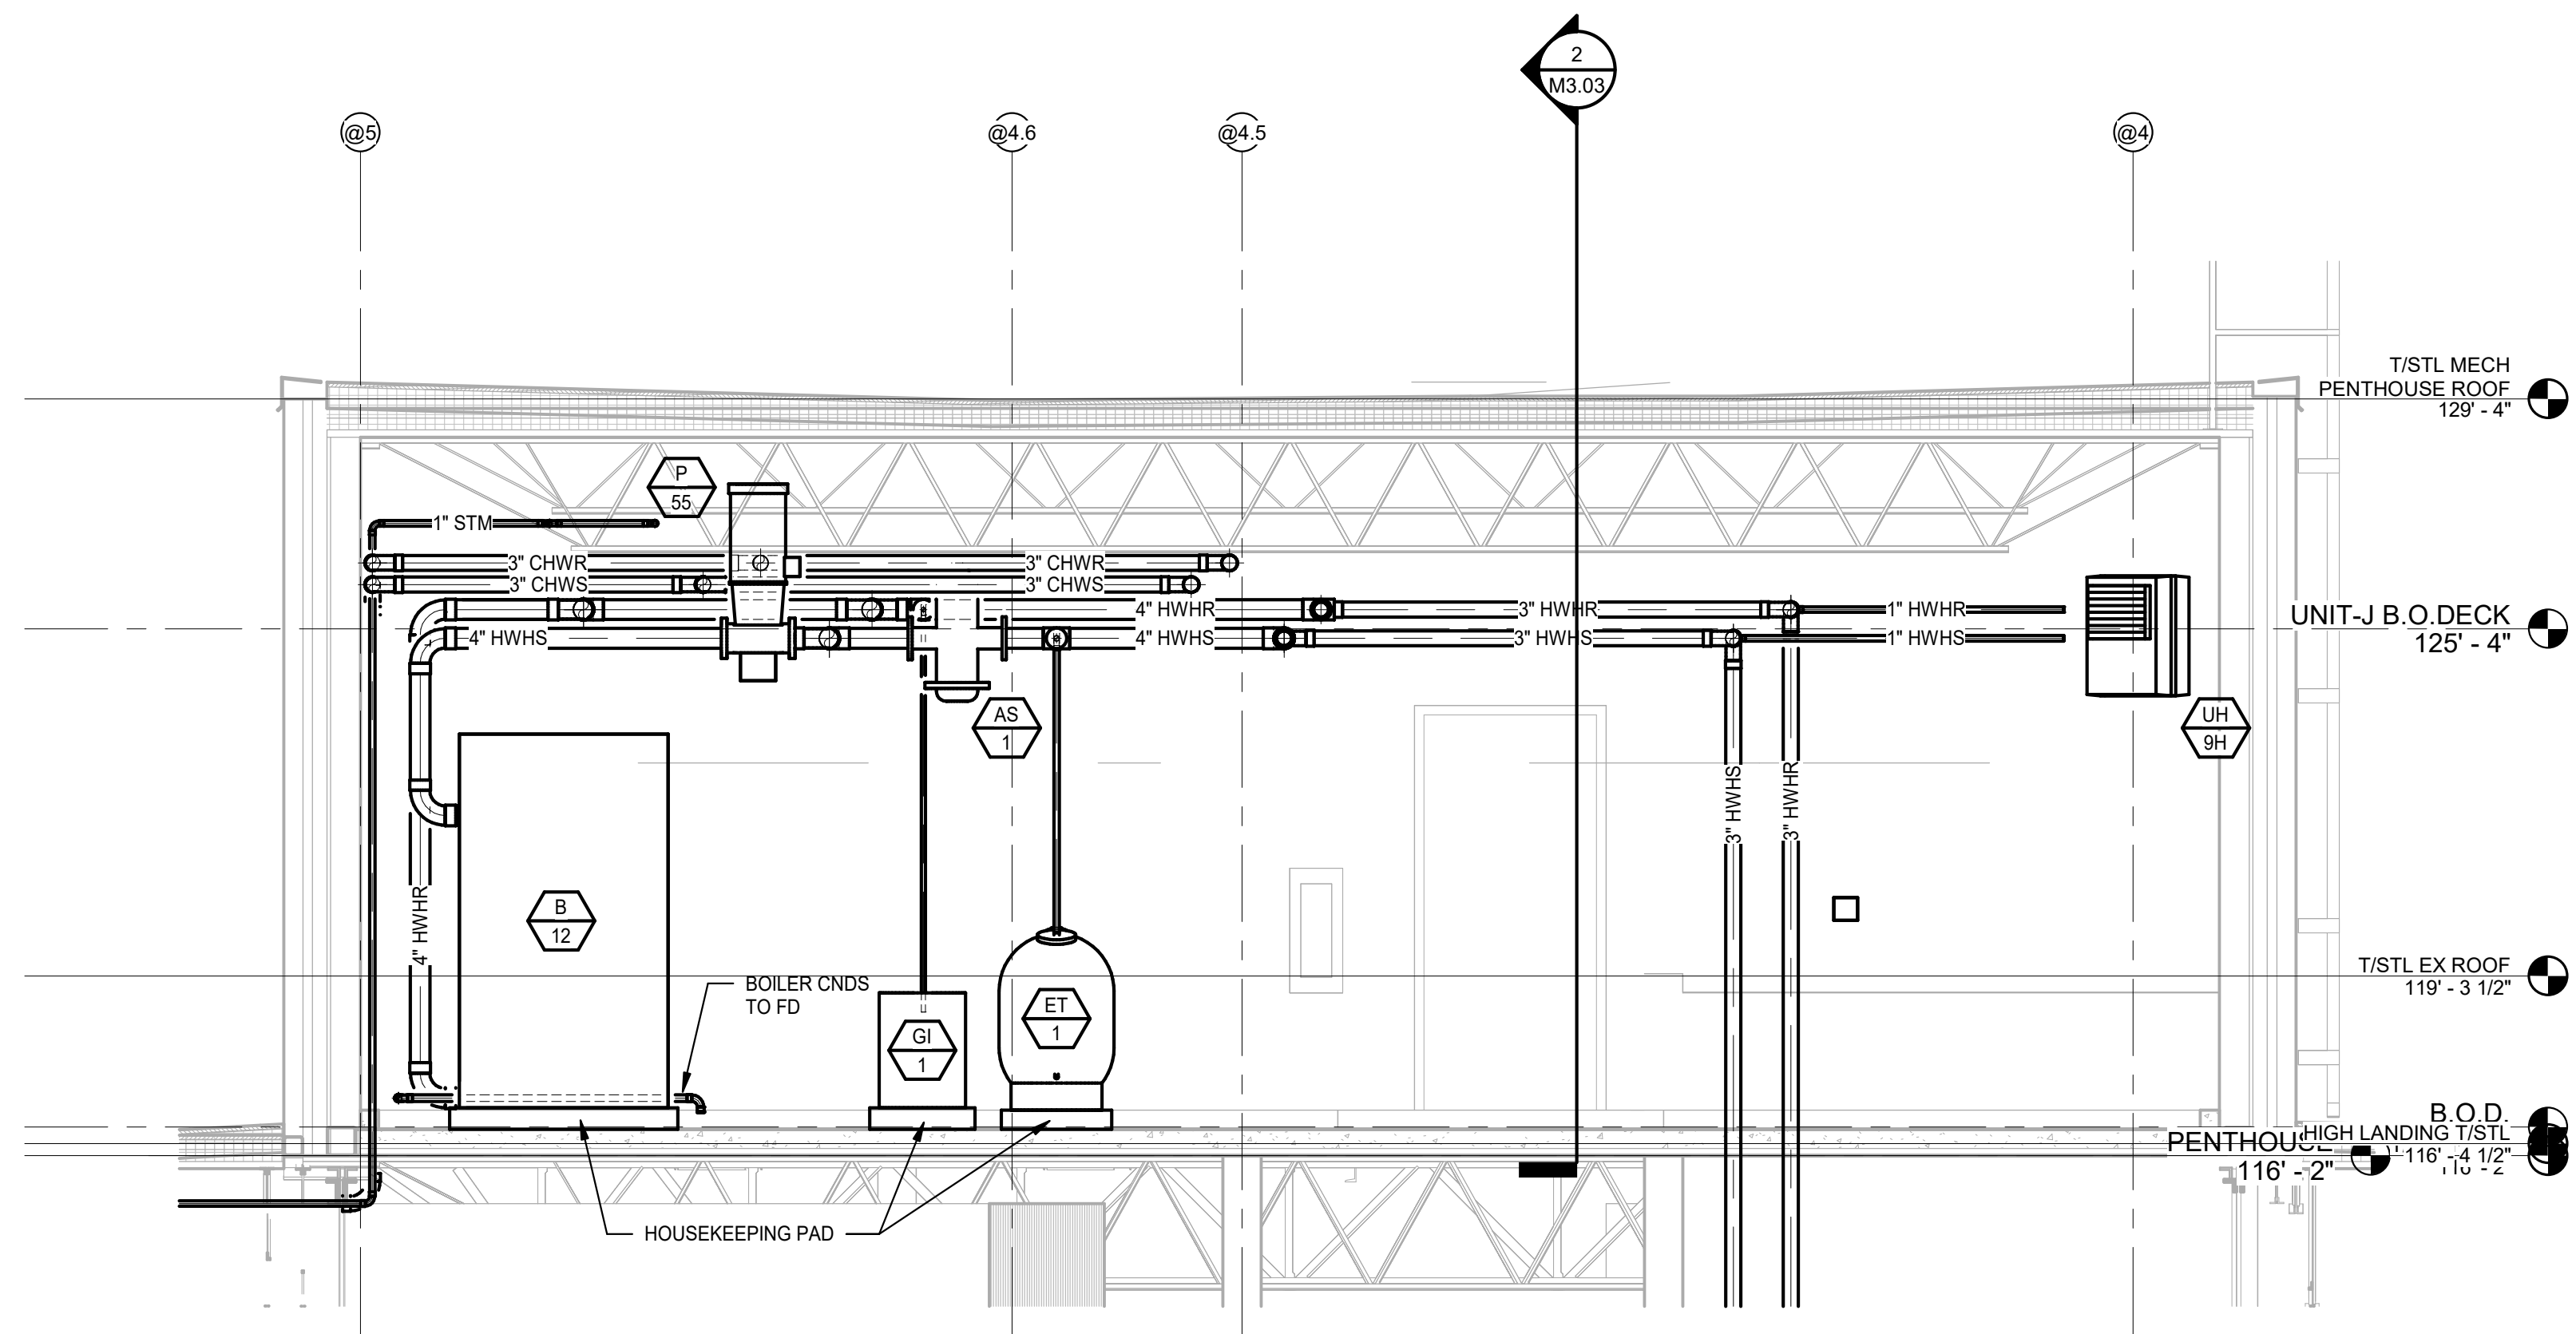

1 HVAC PIPING 1
SCALE: 3/8" = 1'-0"

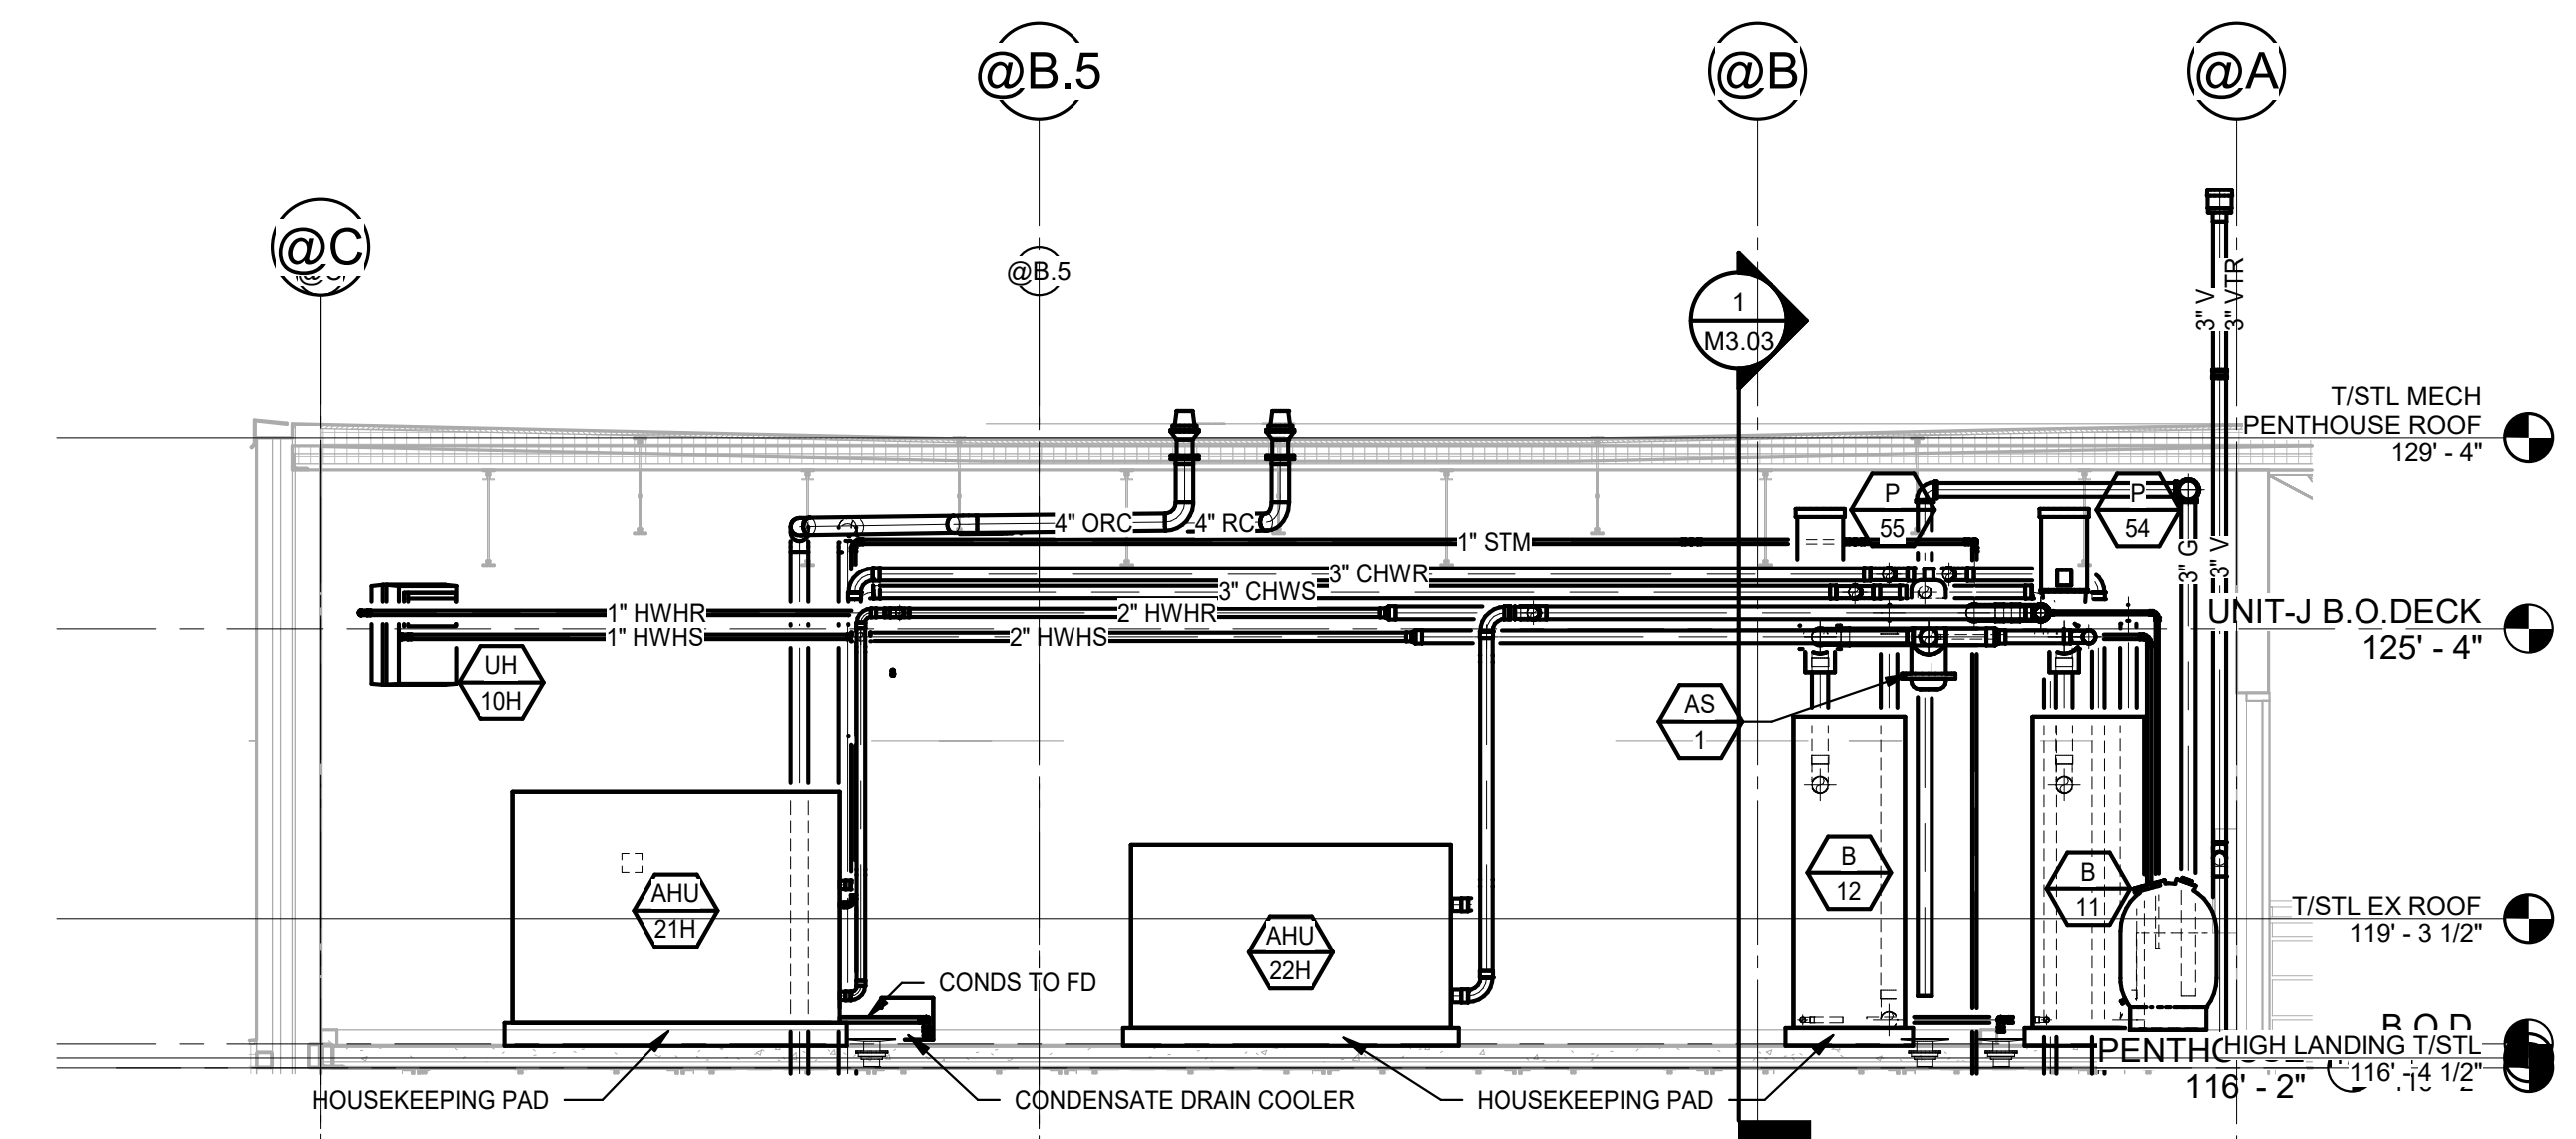

2 HVAC PIPING 2
SCALE: 1/4" = 1'-0"


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

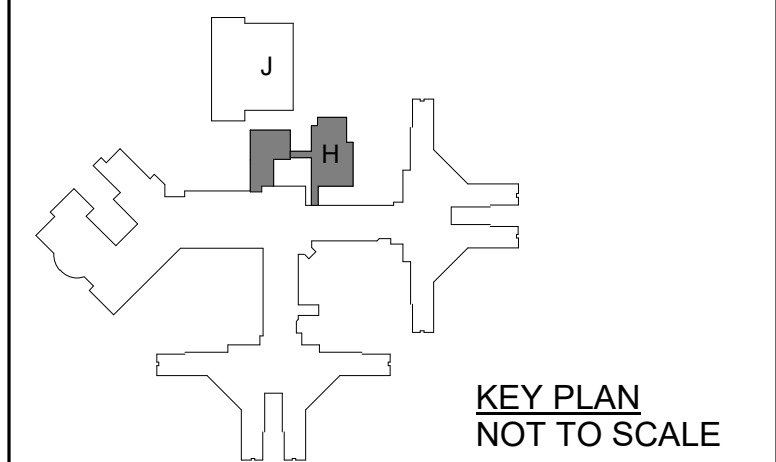

WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023


PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
PENTHOUSE HVAC PIPING
PLAN

PROJECT NUMBER 2021094	SHEET NUMBER M3.03
PROJECT DATE SEPTEMBER 6, 2023	CHECKED BY WEK

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0402

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

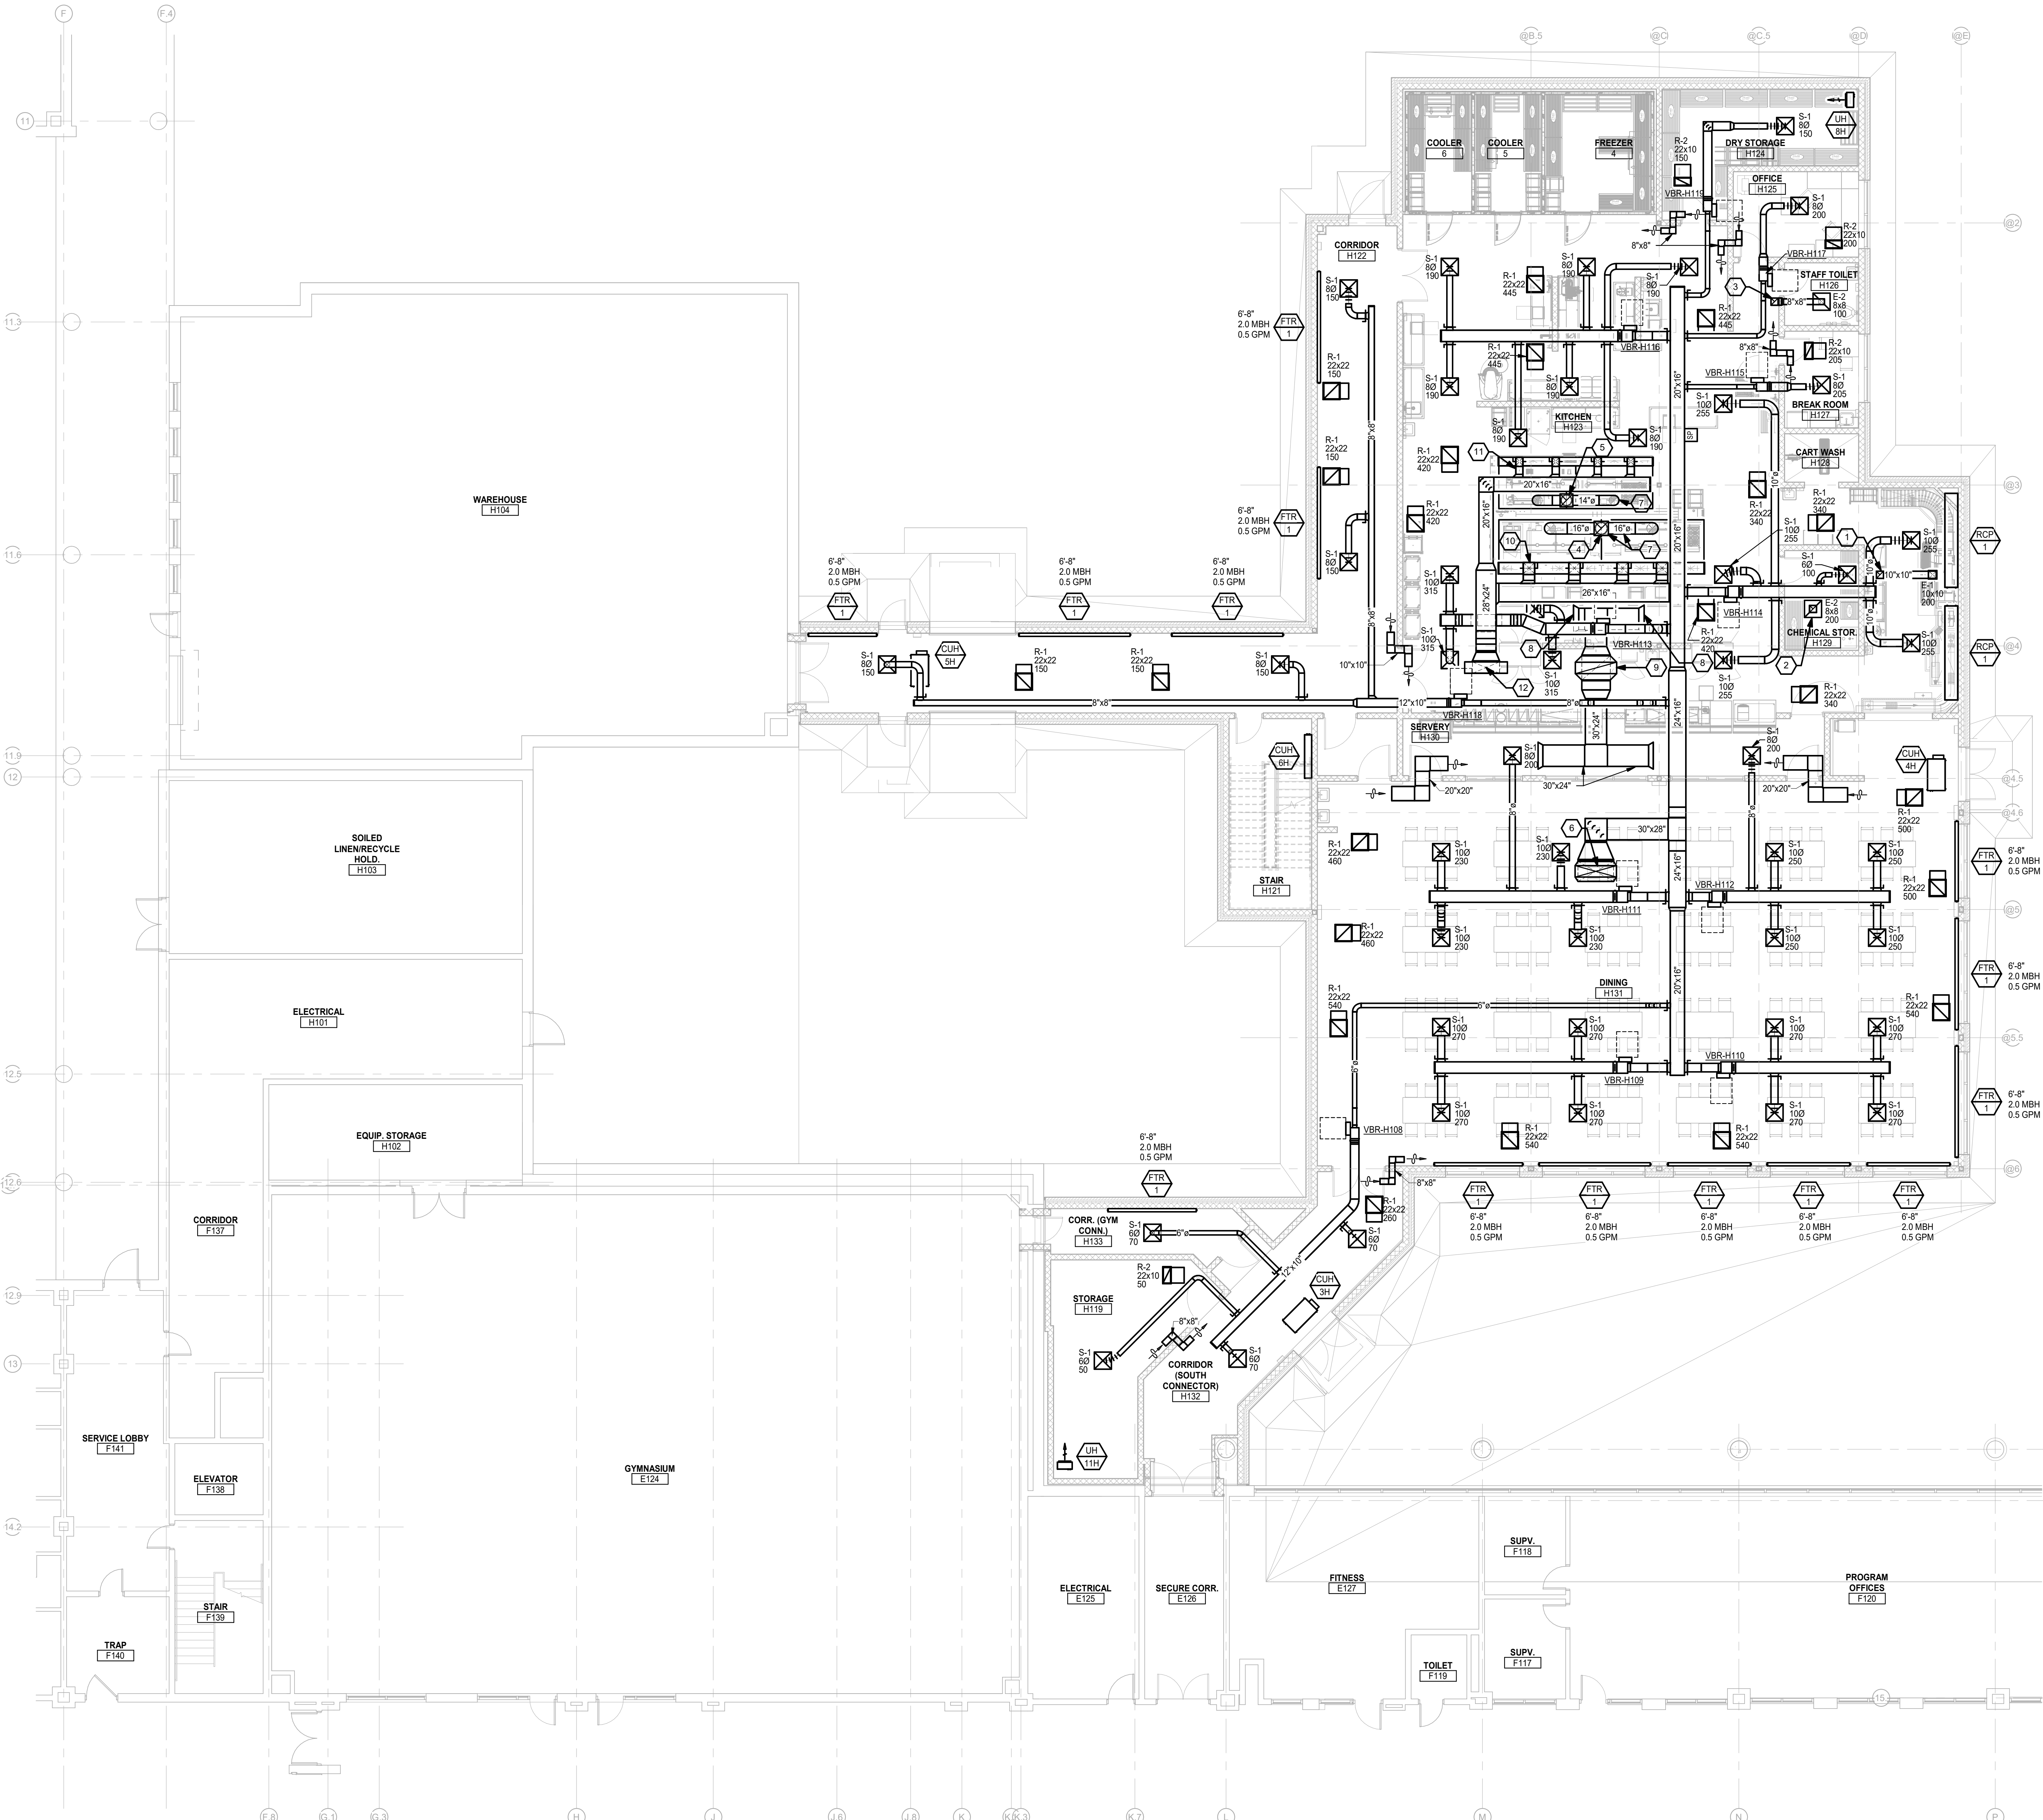

SHEET METAL GENERAL NOTES:

- THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION/SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- PIPING AND DUCTWORK SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR DIMENSIONED LOCATION OF GRILLES, REGISTERS, AND DIFFUSERS.
- REFER TO TEMPERATURE CONTROLS STANDARD MOUNTING HEIGHTS DETAIL FOR ELEVATIONS OF WALL MOUNTED TEMPERATURE CONTROL DEVICES.

CONSTRUCTION KEY NOTES:

- 10x10 EXHAUST DUCT UP TO EF-6H
- 10x10 EXHAUST DUCT UP TO EF-7H
- 10x10 EXHAUST DUCT UP TO EF-6H
- 20x20 DUCT UP TO EF-10H
- 18x18 EXHAUST UP TO EF-6H
- 58x16 UP TO AHU-21H. REFER TO SHEET M4.03 FOR CONTINUATION.
- REFER TO DUCT SYSTEM APPLICATION SCHEDULE FOR DUCT TYPE.
- 30"x30" RETURN DUCT WITH BELLMOUTH AT END.
- 16"x28" RETURN AIR DUCT UP TO AHU-21H. REFER TO SHEET M4.03 FOR CONTINUATION.
- 16"x16" MAKEUP AIR TO EXHAUST HOODS. (TYP. x 4)
- 10"x12" MAKEUP AIR TO EXHAUST HOODS. (TYP. x 4)
- 60"x16" UP TO AHU-22H. REFER TO SHEET M4.03 FOR CONTINUATION.
- RECOMMENDED LOCATION FOR PIPE PORTAL.
- 60"x16" SUPPLY AIR DUCT DOWN TO FIRST FLOOR. REFER TO SHEET M4.01 FOR CONTINUATION.
- 58"x16" RETURN AIR DOWN TO FIRST FLOOR. REFER TO SHEET M4.01 FOR CONTINUATION.
- 58"x16" SUPPLY AIR DOWN TO FIRST FLOOR. REFER TO SHEET M4.01 FOR CONTINUATION.
- EVACUATE SYSTEM. RELOCATE EXISTING CONDENSING UNITS TO LOCATION SHOWN. PROVIDE NEW REFRIGERANT LINES. RECHARGE AND RECOMMISSION UNITS.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

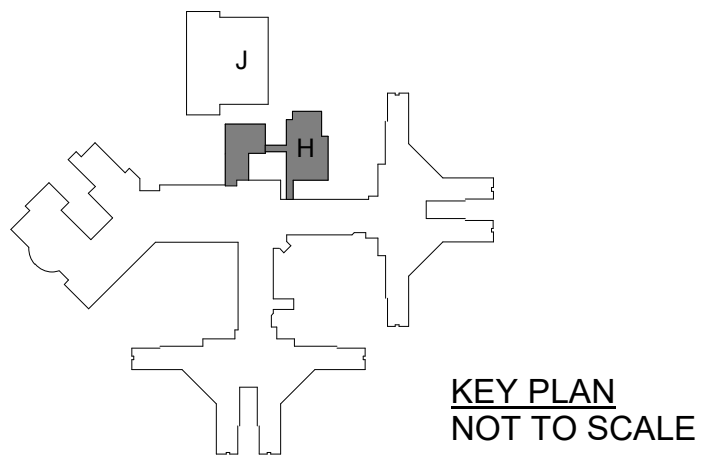

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN**
SALINE, MICHIGAN

SHEET TITLE
**FIRST FLOOR SHEET METAL
PLAN - UNIT H**

PROJECT NUMBER
2021094

PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
WEK


SHEET NUMBER
M4.01

FIRST FLOOR SHEET METAL PLAN - UNIT H
SCALE: 1/8" = 1'-0"

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0492

9/25/2023 4:37:34 PM C:\REVIT\LOCAL FILES\2023\0402\MEP_Forensic_Psyeh_v23_Ghent.rvt

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

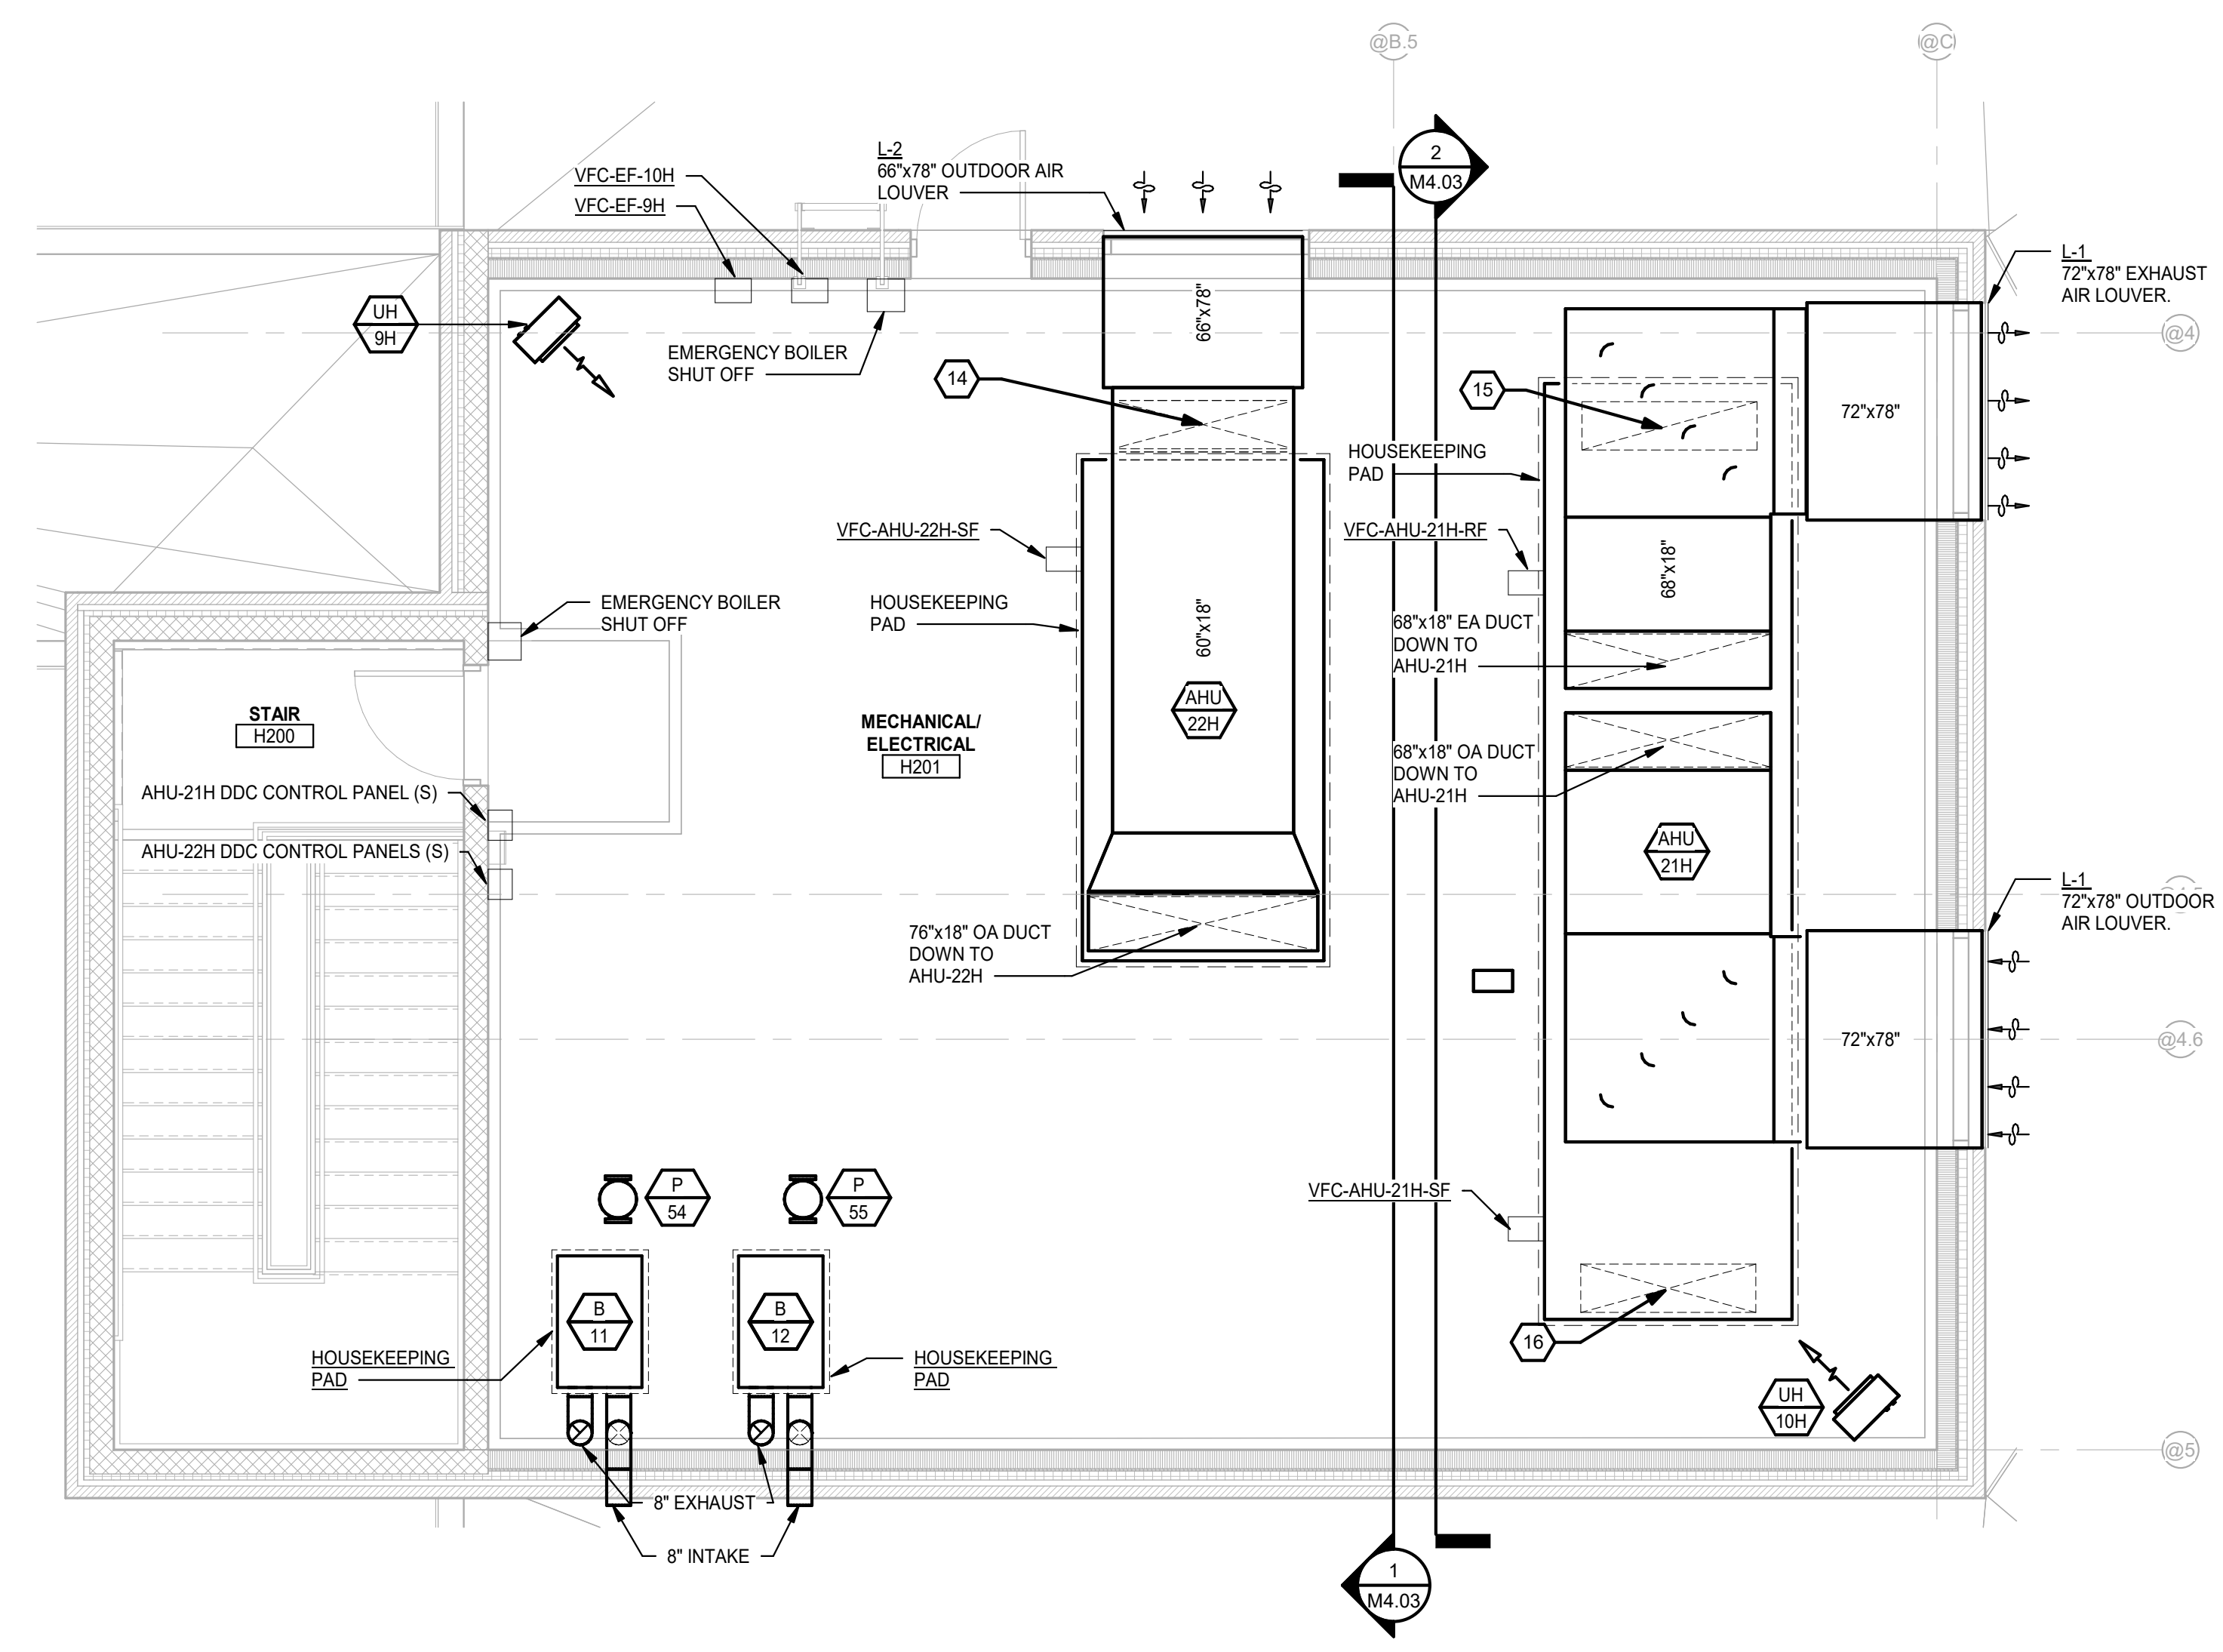


PENTHOUSE SHEET METAL PLAN
SCALE: 1/4" = 1'-0"

SHEET METAL GENERAL NOTES:


- THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION/SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- PIPING AND DUCTWORK SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR DIMENSIONED LOCATION OF GRILLES, REGISTERS, AND DIFFUSERS.
- REFER TO TEMPERATURE CONTROLS STANDARD MOUNTING HEIGHTS DETAIL FOR ELEVATIONS OF WALL MOUNTED TEMPERATURE CONTROL DEVICES.

CONSTRUCTION KEY NOTES:

- 10x10 EXHAUST DUCT UP TO EF-8H
- 10x10 EXHAUST DUCT UP TO EF-7H
- 10x10 EXHAUST DUCT UP TO EF-6H
- 20x20 DUCT UP TO EF-10H
- 18x18 EXHAUST UP TO EF-9H
- 58x16 UP TO AHU-21H. REFER TO SHEET M4.03 FOR CONTINUATION.
- REFER TO DUCT SYSTEM APPLICATION SCHEDULE FOR DUCT TYPE.
- 30"x30" RETURN DUCT WITH BELLMOUTH AT END.
- 16"x28" RETURN AIR DUCT UP TO AHU-21H. REFER TO SHEET M4.03 FOR CONTINUATION.
- 16"x16" MAKEUP AIR TO EXHAUST HOODS. (TYP. x 4)
- 10"x12" MAKEUP AIR TO EXHAUST HOODS. (TYP. x 4)
- 60"x16" UP TO AHU-22H. REFER TO SHEET M4.03 FOR CONTINUATION.
- RECOMMENDED LOCATION FOR PIPE PORTAL.
- 60"x16" SUPPLY AIR DUCT DOWN TO FIRST FLOOR. REFER TO SHEET M4.01 FOR CONTINUATION.
- 58"x16" RETURN AIR DOWN TO FIRST FLOOR. REFER TO SHEET M4.01 FOR CONTINUATION.
- 58"x16" SUPPLY AIR DOWN TO FIRST FLOOR. REFER TO SHEET M4.01 FOR CONTINUATION.
- EVACUATE SYSTEM. RELOCATE EXISTING CONDENSING UNITS TO LOCATION SHOWN. PROVIDE NEW REFRIGERANT LINES. RECHARGE AND RECOMMISSION UNITS.

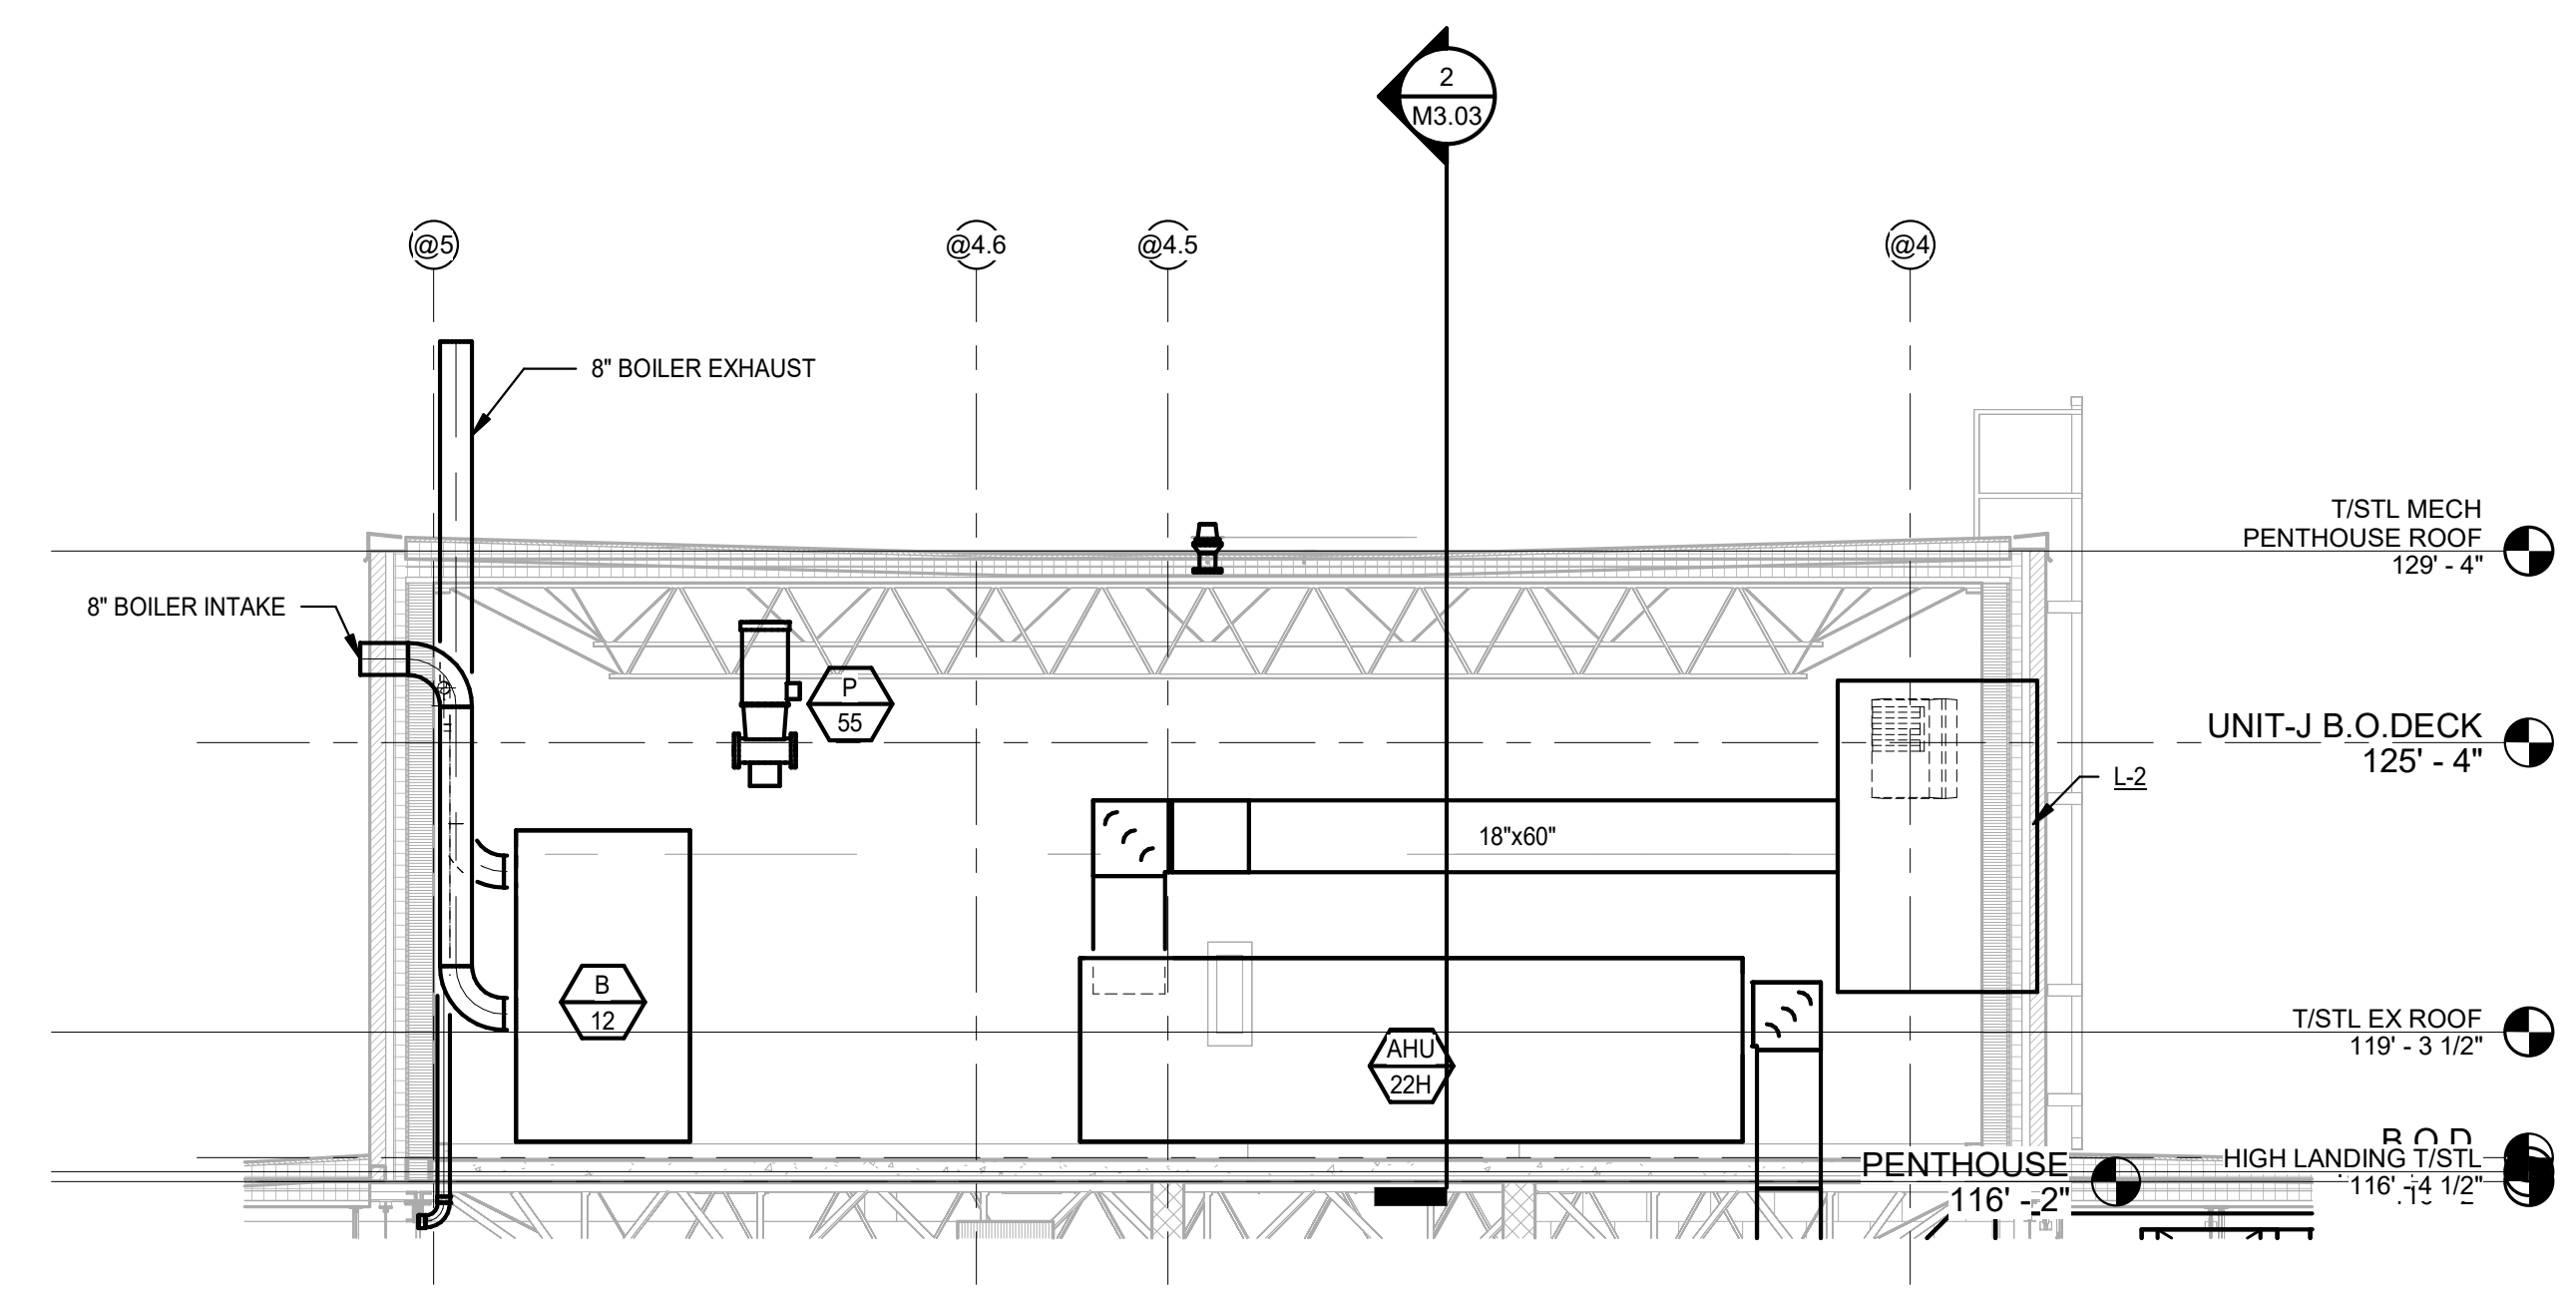

1 SHEET METAL 1
SCALE: 1/4" = 1'-0"

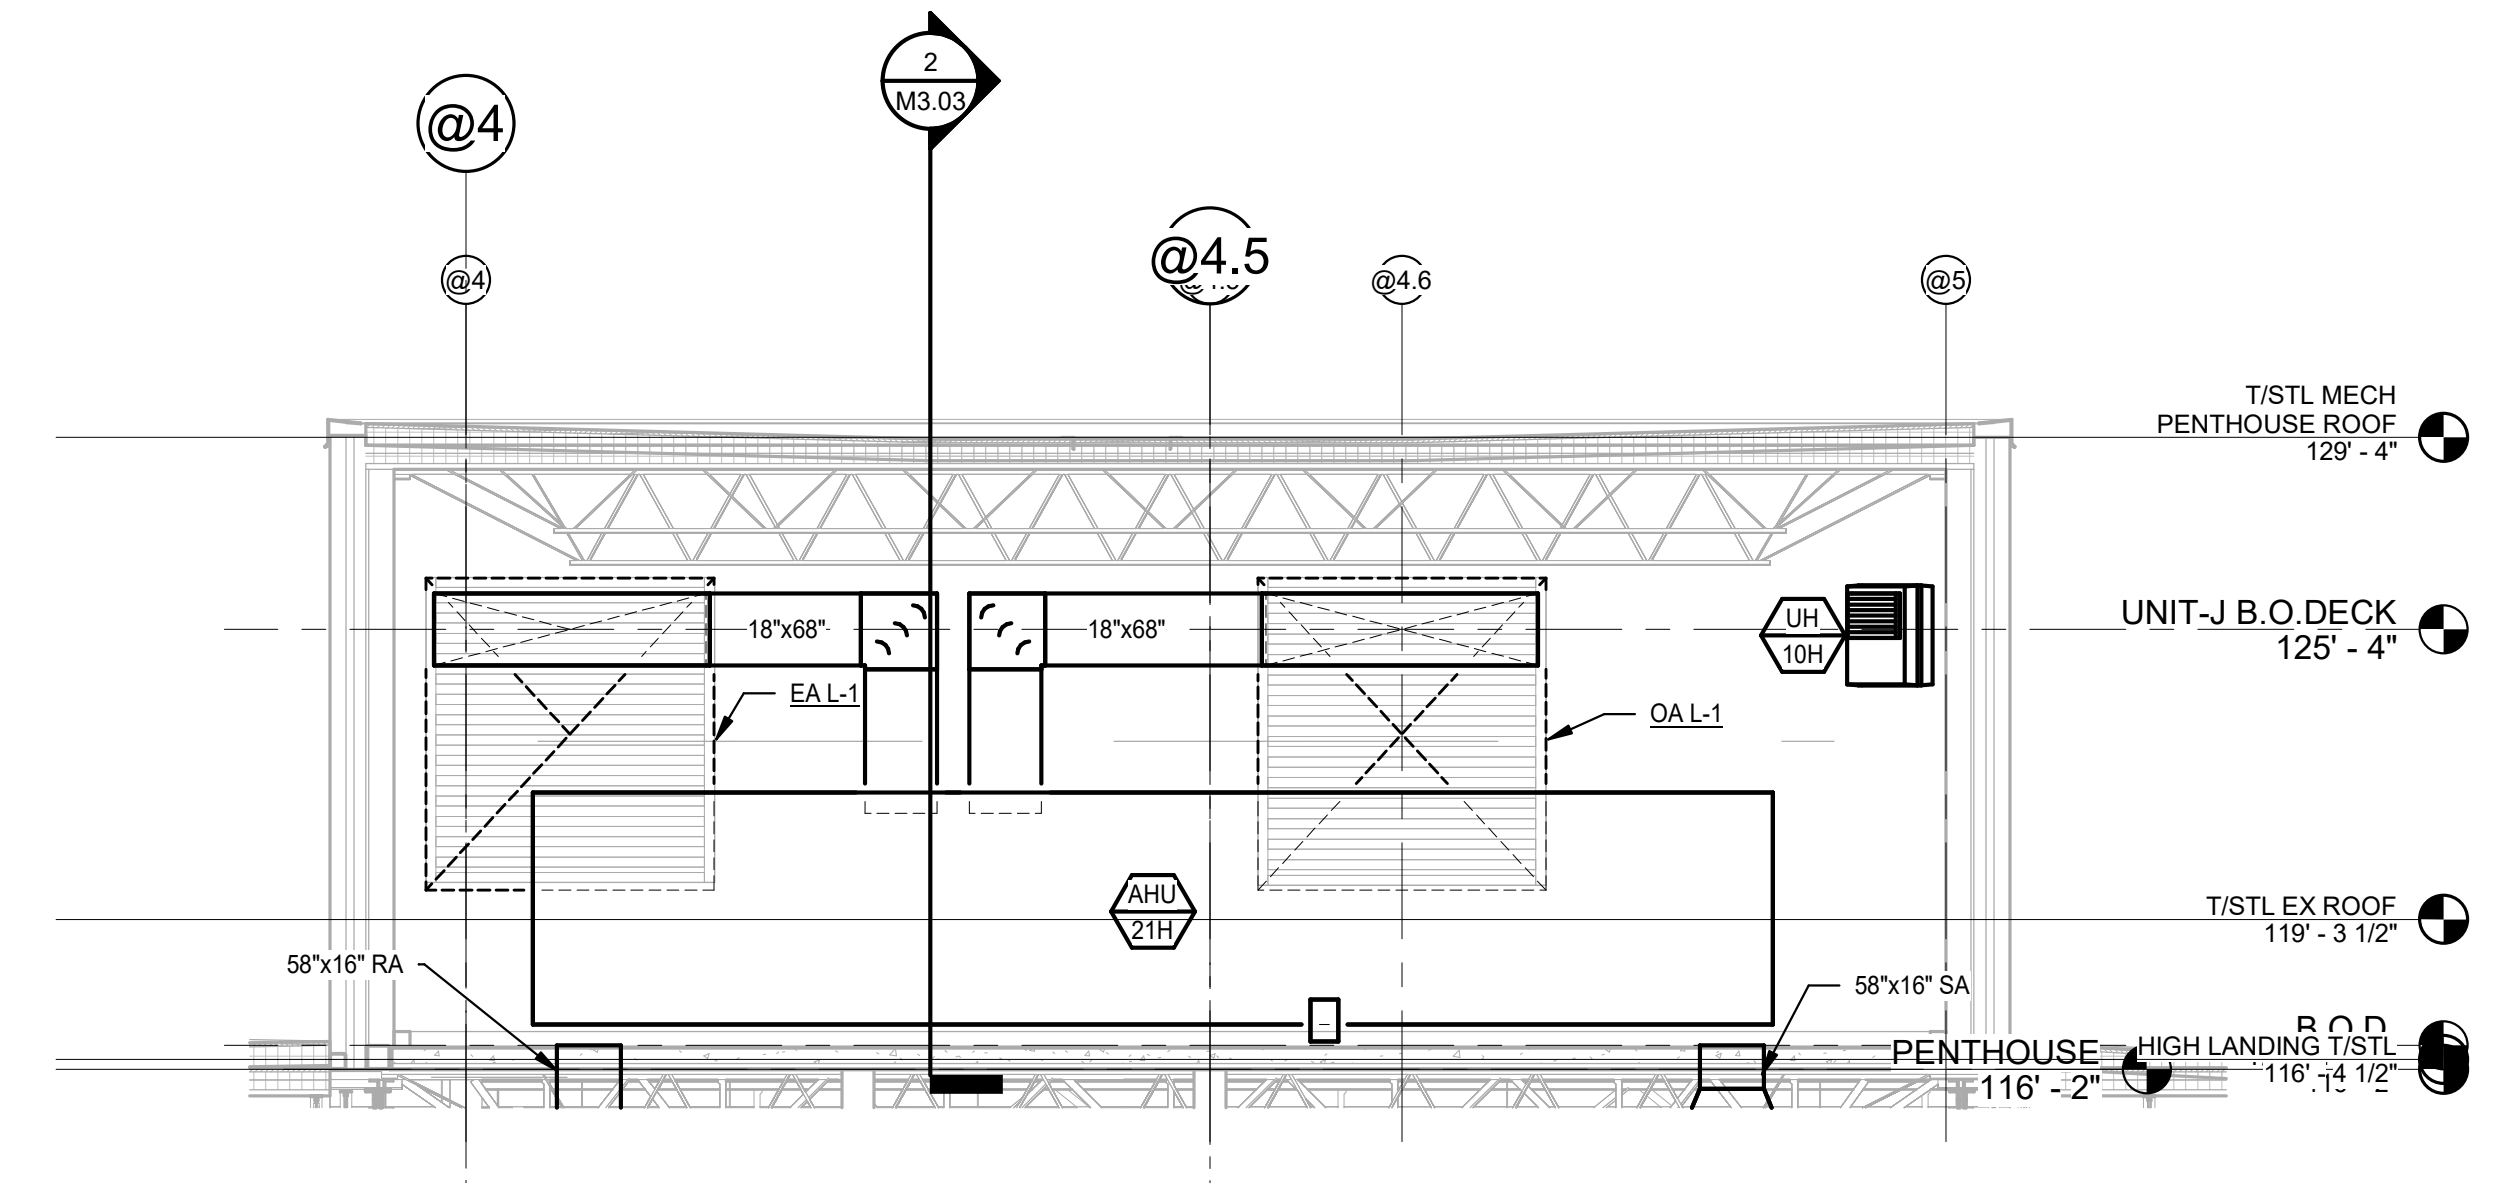

2 SHEET METAL 2
SCALE: 1/4" = 1'-0"


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHST255

CONTRACT NO.
Y22003

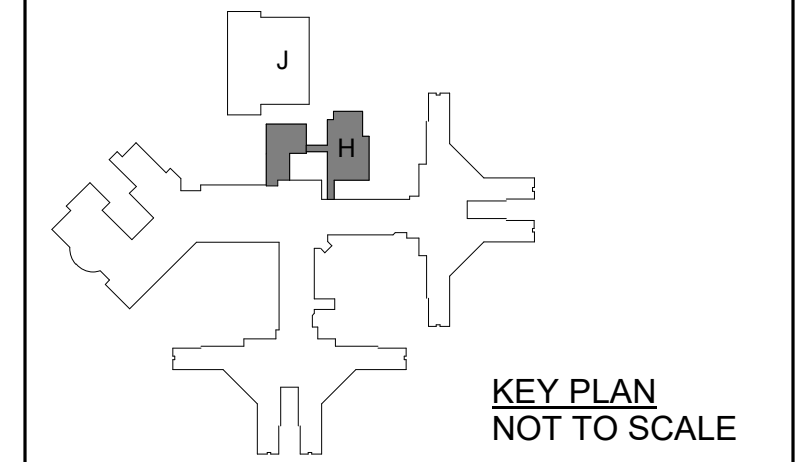

WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023



PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
PENTHOUSE SHEET METAL
PLAN


PROJECT NUMBER 2021094	SHEET NUMBER M4.03
PROJECT DATE SEPTEMBER 6, 2023	
CHECKED BY WEK	

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5445 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0402

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

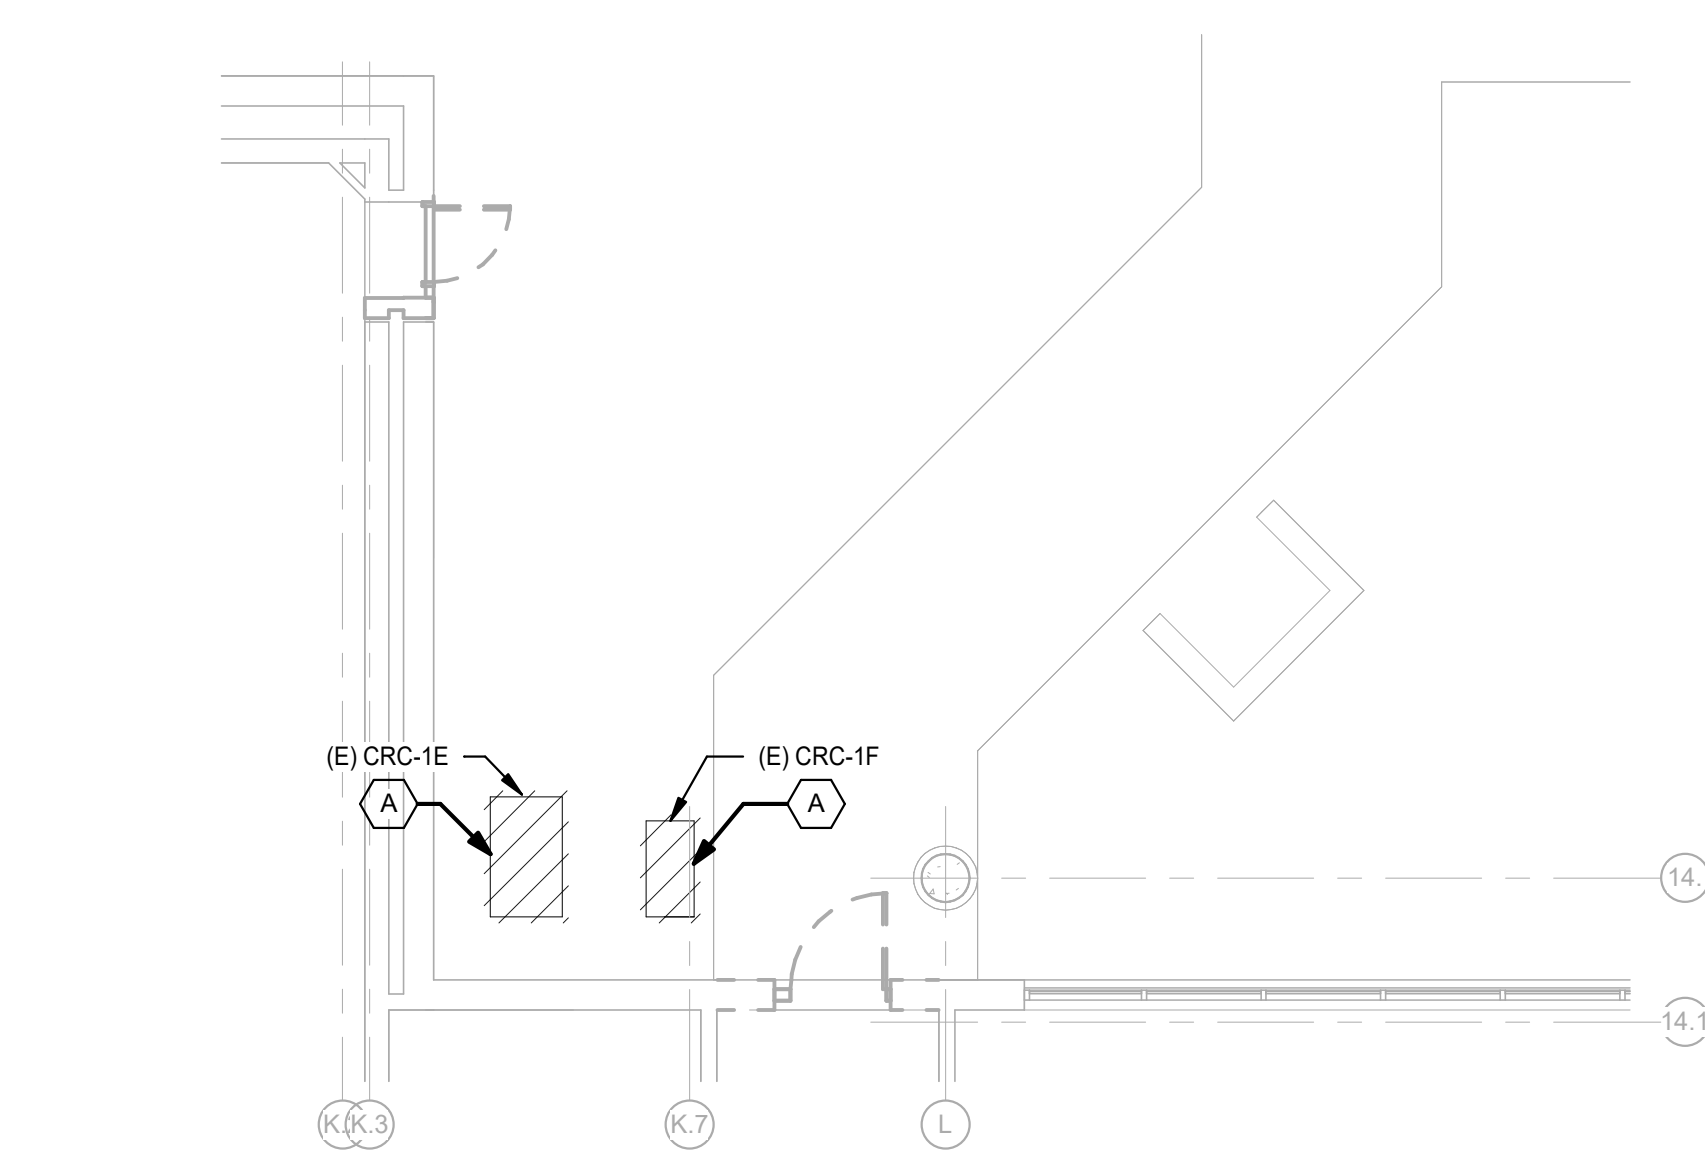

DEMOLITION KEY NOTES:
 A EVALUATE SYSTEM, REMOVE AND RELOCATE EXISTING CONDENSING UNIT. REFER TO MECHANICAL ROOF PLAN FOR NEW LOCATION.

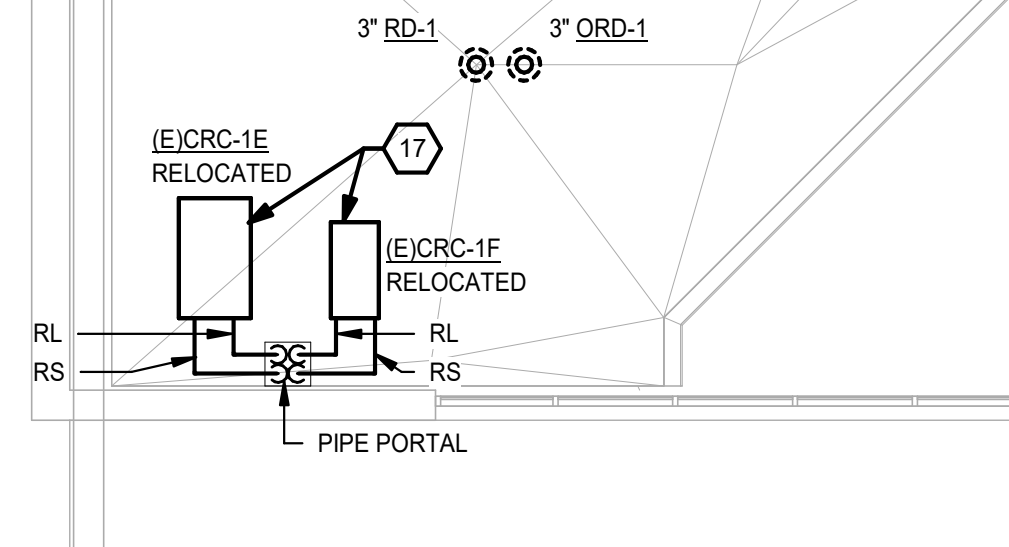

MECHANICAL ROOF PLAN
 SCALE: 1/8" = 1'-0"

FIRST FLOOR MECHANICAL DEMOLITION PLAN
 SCALE: 1/8" = 1'-0"

PLUMBING GENERAL NOTES:

- THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION/SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- REFER TO ARCHITECTURAL PLANS FOR DIMENSIONED LOCATIONS OF PLUMBING FIXTURES.
- HOT AND COLD WATER PIPING RUN-OUTS TO LAVATORIES AND SINKS SHALL BE 1/2" UNLESS OTHERWISE NOTED.
- PLUMBING VENT PIPING THROUGH ROOF SHALL BE LOCATED A MINIMUM OF 10'-0" FROM ANY FRESH AIR INTAKE LOCATION AND A MINIMUM OF 18" CLEAR FROM THE INSIDE FACE OF PARAPET.
- PROVIDE CODE REQUIRED CLEARANCE FOR ALL CLEANOUTS INSTALLED IN SANITARY WASTE AND VENT PIPING.
- MINIMUM UNDERGROUND PIPE SIZE SHALL BE 3".

SHEET METAL GENERAL NOTES:

- THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION/COORDINATION/SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- PIPING AND DUCTWORK SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR DIMENSIONED LOCATION OF GRILLES, REGISTERS, AND DIFFUSERS.
- REFER TO TEMPERATURE CONTROLS STANDARD MOUNTING HEIGHTS DETAIL FOR ELEVATIONS OF WALL MOUNTED TEMPERATURE CONTROL DEVICES.

CONSTRUCTION KEY NOTES:

- 10x10 EXHAUST DUCT UP TO EF-8H
- 10x10 EXHAUST DUCT UP TO EF-7H
- 10x10 EXHAUST DUCT UP TO EF-6H
- 20x20 DUCT UP TO EF-10H
- 18x18 EXHAUST UP TO EF-9H
- 58x16 UP TO AHU-21H. REFER TO SHEET M4.03 FOR CONTINUATION.
- REFER TO DUCT SYSTEM APPLICATION SCHEDULE FOR DUCT TYPE.
- 30"x30" RETURN DUCT WITH BELLMOUTH AT END.
- 16"x58" RETURN AIR DUCT UP TO AHU-21H. REFER TO SHEET M4.03 FOR CONTINUATION.
- 16"x16" MAKEUP AIR TO EXHAUST HOODS. (TYP. x 4)
- 10"x12" MAKEUP AIR TO EXHAUST HOODS. (TYP. x 4)
- 60"x16" UP TO AHU-22H. REFER TO SHEET M4.03 FOR CONTINUATION.
- RECOMMENDED LOCATION FOR PIPE PORTAL.
- 80"x16" SUPPLY AIR DUCT DOWN TO FIRST FLOOR. REFER TO SHEET M4.01 FOR CONTINUATION.
- 58"x16" RETURN AIR DOWN TO FIRST FLOOR. REFER TO SHEET M4.01 FOR CONTINUATION.
- 58"x16" SUPPLY AIR DOWN TO FIRST FLOOR. REFER TO SHEET M4.01 FOR CONTINUATION.
- EVACUATE SYSTEM. RELOCATE EXISTING CONDENSING UNITS TO LOCATION SHOWN. PROVIDE NEW REFRIGERANT LINES, RECHARGE AND RECOMMISSION UNITS.


NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, RA, DIRECTOR

FILE NO.
 491/20167.SDW

FUNDING CODE
 171CODHHS7255

CONTRACT NO.
 Y22003

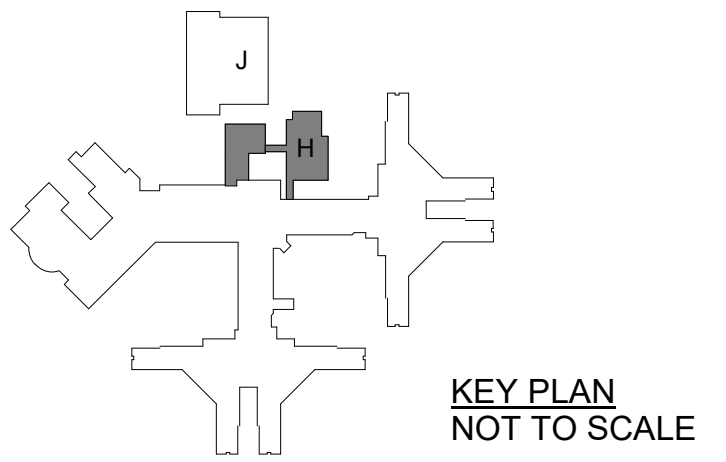

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
 Saginaw, Michigan 48607
 989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
 491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
 PSYCHIATRY - CREATE
 KITCHEN**
 SALINE, MICHIGAN

SHEET TITLE
MECHANICAL ROOF PLAN

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
SEPTEMBER 6, 2023


M4.04

CHECKED BY
WEK

PBA
 Peter Basso Associates Inc
 CONSULTING ENGINEERS
 5145 Livernois, Suite 100
 Troy, Michigan 48068-3276
 Tel: 248-879-5666
 Fax: 248-879-0007
 www.PeterBassoAssociates.com
 PBA Project No. 303-0402

9/25/2023 4:36:51 PM C:\REVIT LOCAL FILES\2023-0402-MEP_Forensic_Psyeh_v23_Ghent.rvt

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

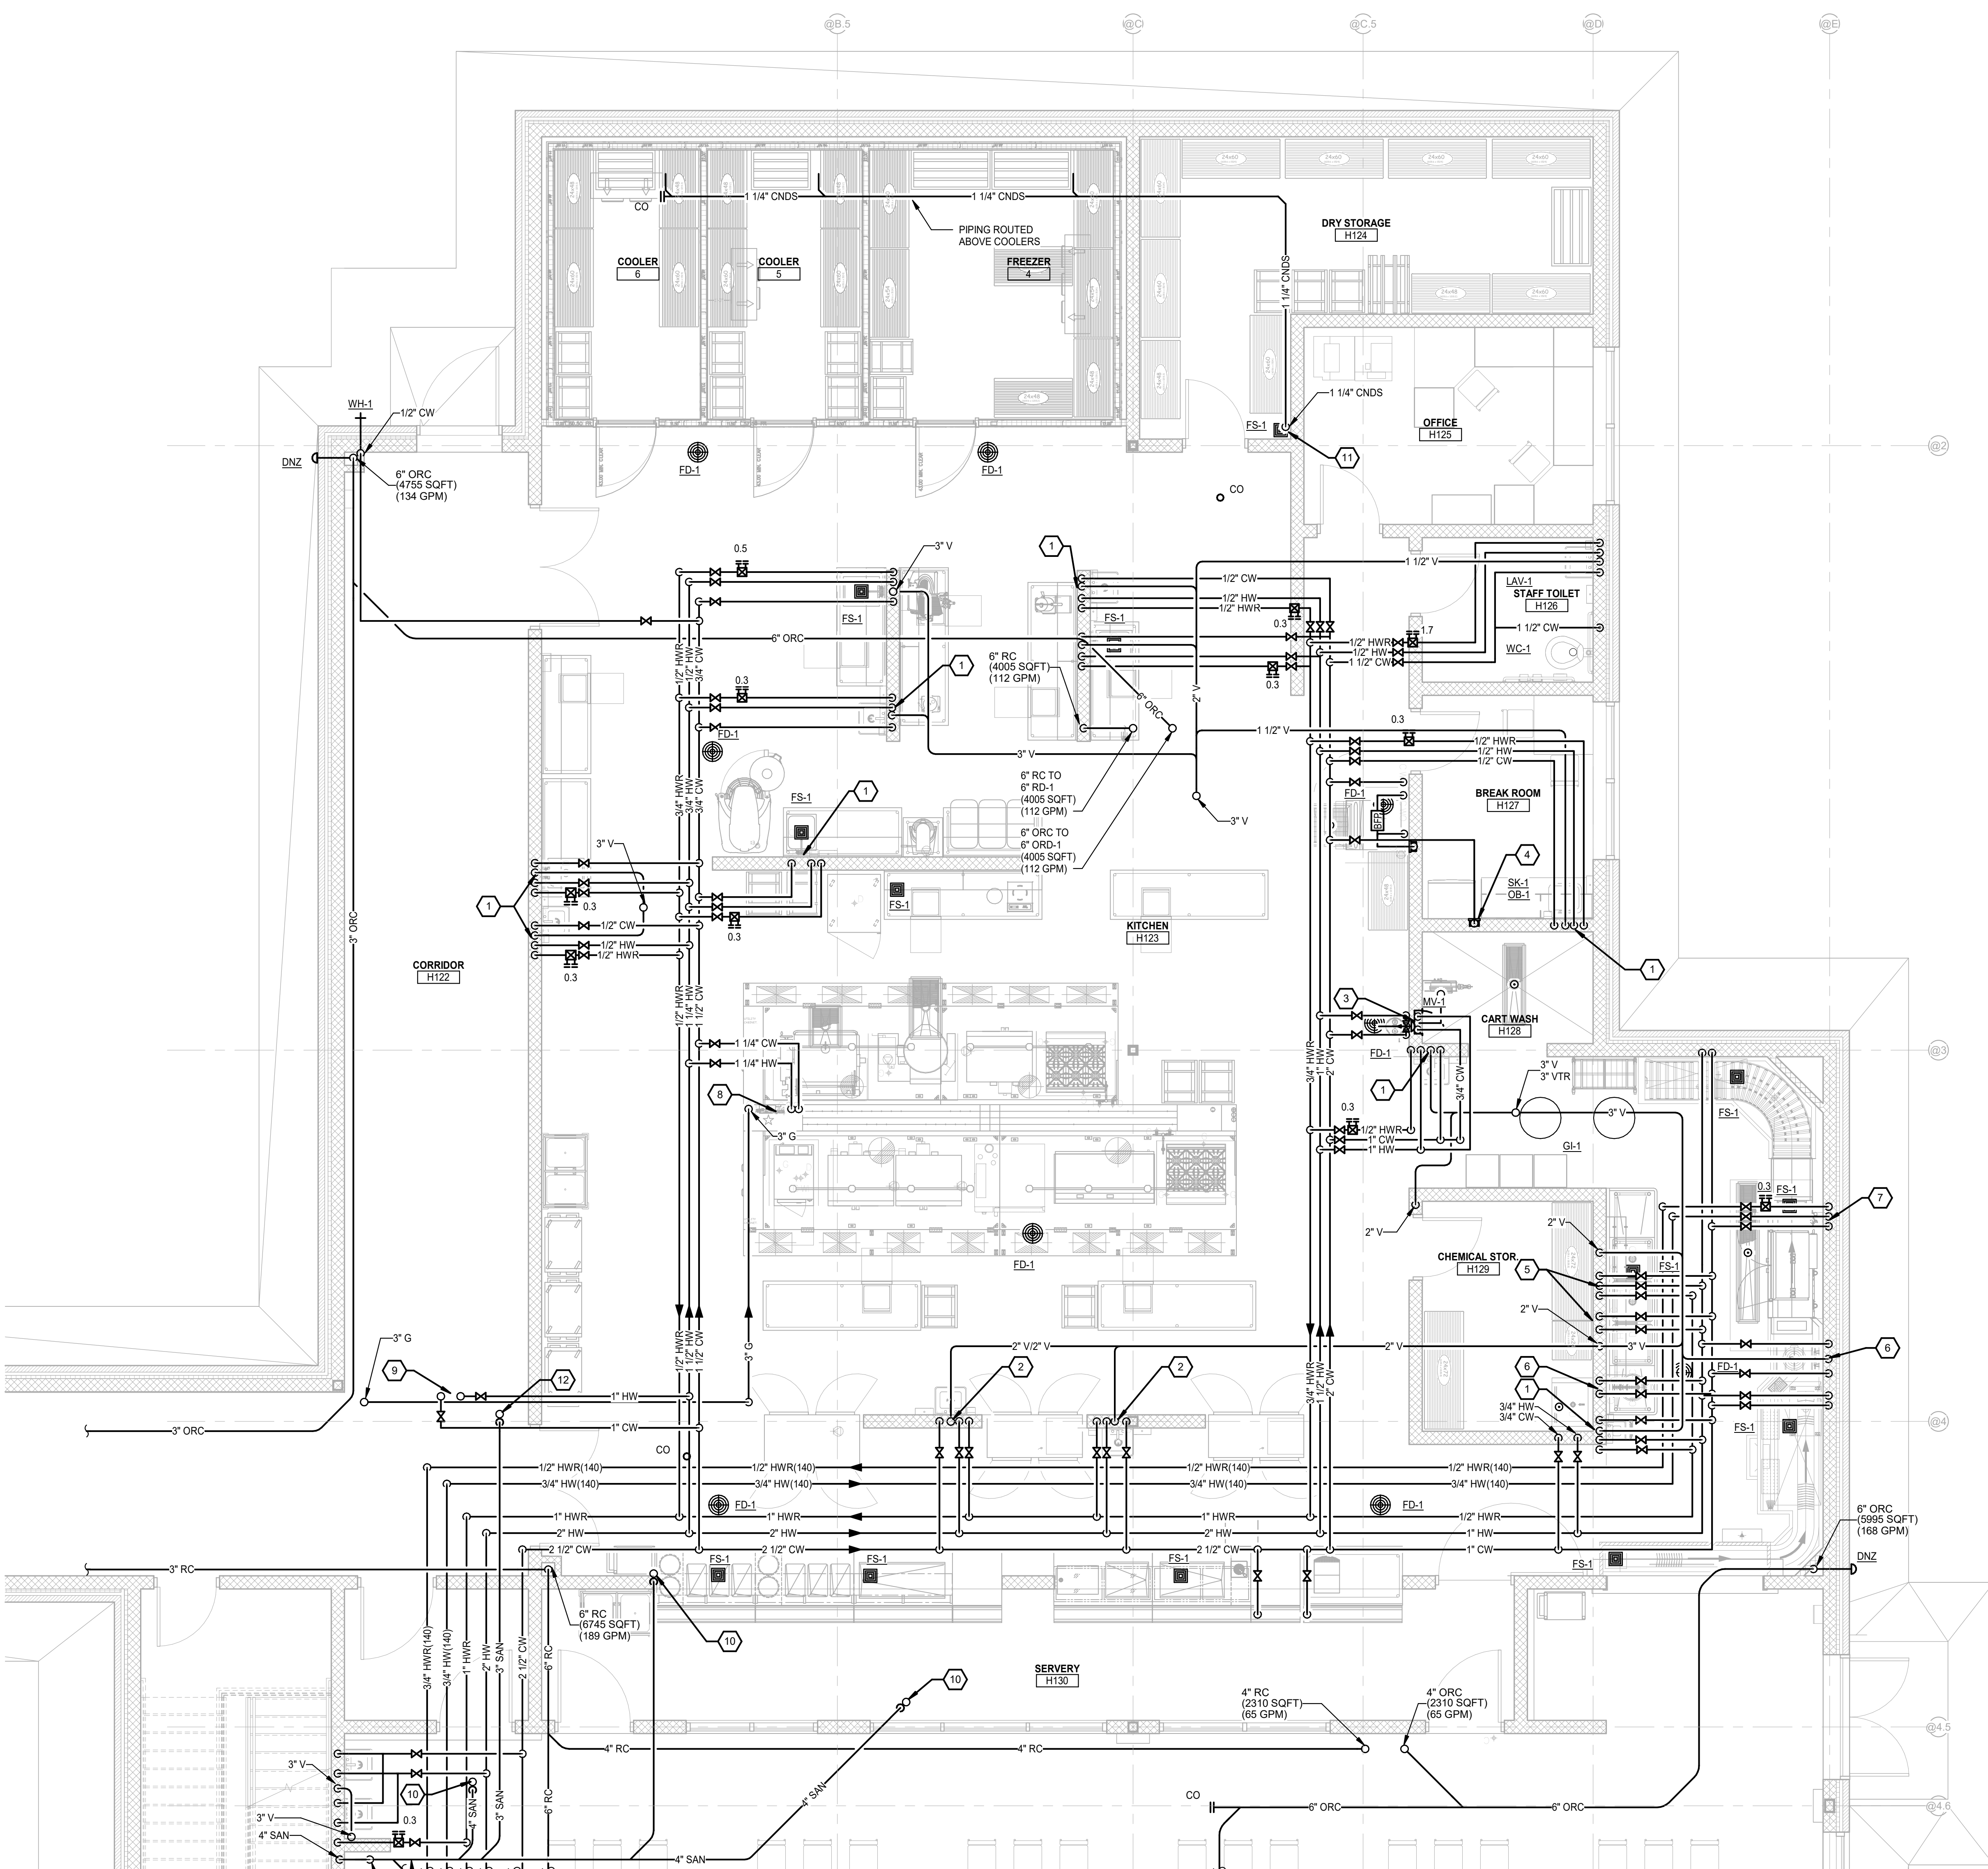

1 FIRST FLOOR PLUMBING ENLARGED KITCHEN PLAN
SCALE: 1/4" = 1'-0"

PLUMBING GENERAL NOTES:

- 1 THESE DRAWINGS ARE DIAGRAMMATIC, AND REPRESENT THE GENERAL INTENT AND ARRANGEMENT OF SYSTEMS. THEY ARE NOT TO BE CONSIDERED FABRICATION OR COORDINATION SHOP DRAWINGS. COORDINATION WITH OTHER TRADES IS REQUIRED. PROVIDE THE ADDITIONAL FITTINGS AND OFFSETS THAT WILL BE REQUIRED TO COMPLETE EACH SYSTEM AND TO AVOID INTERFERENCES WITH ALL OTHER SYSTEMS INCLUDING THE STRUCTURE, SHEET METAL, OTHER PIPING SYSTEMS, ELECTRICAL CONDUITS, BUS DUCTS, CABLE TRAY, LIGHT FIXTURES, ETC. AND/OR OTHER SPACE CONSTRAINTS.
- 2 INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- 3 PIPING SHALL NOT BE INSTALLED ABOVE ELECTRICAL TRANSFORMERS, SWITCHBOARDS, PANELBOARDS OR MOTOR CONTROL CENTERS.
- 4 COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- 5 PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- 6 REFER TO ARCHITECTURAL PLANS FOR DIMENSIONED LOCATIONS OF PLUMBING FIXTURES.
- 7 HOT AND COLD WATER PIPING RUN-OUTS TO LAVATORIES AND SINKS SHALL BE 1/2" UNLESS OTHERWISE NOTED.
- 8 PLUMBING VENT PIPING THROUGH ROOF SHALL BE LOCATED A MINIMUM OF 10'-0" FROM ANY FRESH AIR INTAKE LOCATION AND A MINIMUM OF 18" CLEAR FROM THE INSIDE FACE OF PARAPET.
- 9 PROVIDE CODE REQUIRED CLEARANCE FOR ALL CLEANOUTS INSTALLED IN SANITARY WASTE AND VENT PIPING.
- 10 MINIMUM UNDERGROUND PIPE SIZE SHALL BE 3".

CONSTRUCTION KEY NOTES:


- 1 3 SAN, 2 V, 1/2 CW, 1/2 HW, AND 1/2 HWR TO SINK.
- 2 3 SAN, 1 1/2 V, 1/2 CW, 1/2 HW TO SINK.
- 3 3/4 CW AND 3/4 HW THROUGHOUT CODE REQUIRED BACKFLOW PREVENTER AND CONNECT TO HOSE REEL MIXING VALVE.
- 4 1/2 CW TO OULETBOX FOR ICE MAKER.
- 5 3/4 CW, 3/4 HW TO 3 COMPARTMENT SINK. ROUTE 3 GSAN FROM WASH COMPARTMENT ROUTE W FROM RINSE AND SANITIZE COMPARTMENT AND TERMINATE AT CODE REQUIRED DISTANCE ABOVE FLOOR SINK.
- 6 3/4 CW, 3/4 HW TO PRE-SPRAY AND FOOD GRINDER.
- 7 1/2 CW, 1/2 HW(140), AND 1/2 HWR(140) THROUGHOUT CODE REQUIRED BACKFLOW PREVENTER. ROUTE 1/2 CW, 1/2 HW(140) FROM BACKFLOW PREVENTER TO DISHWASHER. ROUTE W FROM BACKFLOW PREVENTER AND DISHWASHER AND TERMINATE AT CODE REQUIRED DISTANCE ABOVE FLOOR SINK.
- 8 3/4 CW, 3/4 HW, 1/2 HWR, AND 3 GAS TO UTILITY DISTRIBUTIONS SYSTEM.
- 9 1 CW AND 1 HW TO PENTHOUSE ABOVE.
- 10 4 SAN TO FLOOR DRAIN/SINK.
- 11 TERMINATE CONDENSATE AT CODE REQUIRED DISTANCE ABOVE FLOOR DRAIN/SINK.
- 12 3 SAN FOR FLOOR DRAIN/SINK.

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

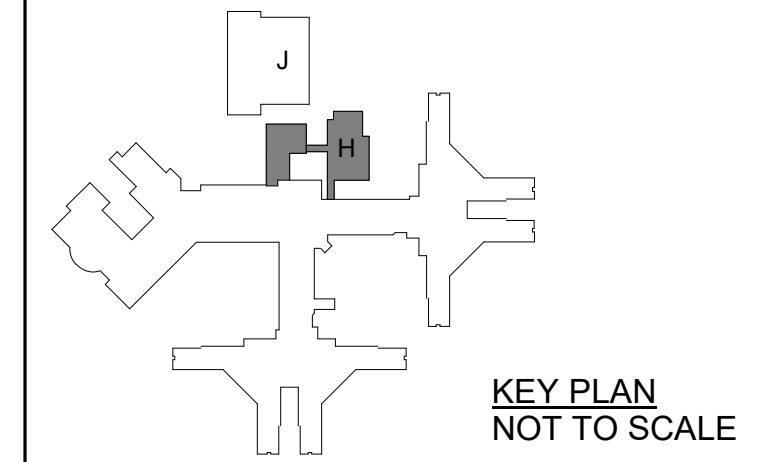

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
PLUMBING ENLARGED PLAN


PROJECT NUMBER 2021094 SHEET NUMBER

PROJECT DATE SEPTEMBER 6, 2023 **M5.01**


CHECKED BY WEK

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0492


THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

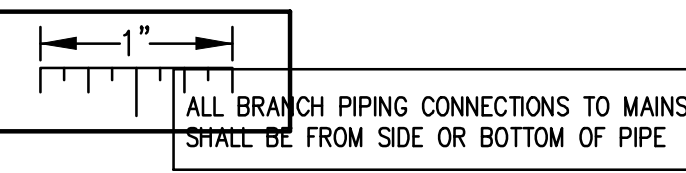


ALL BRANCH PIPING CONNECTIONS TO MAINS SHALL BE FROM SIDE OR BOTTOM OF PIPE

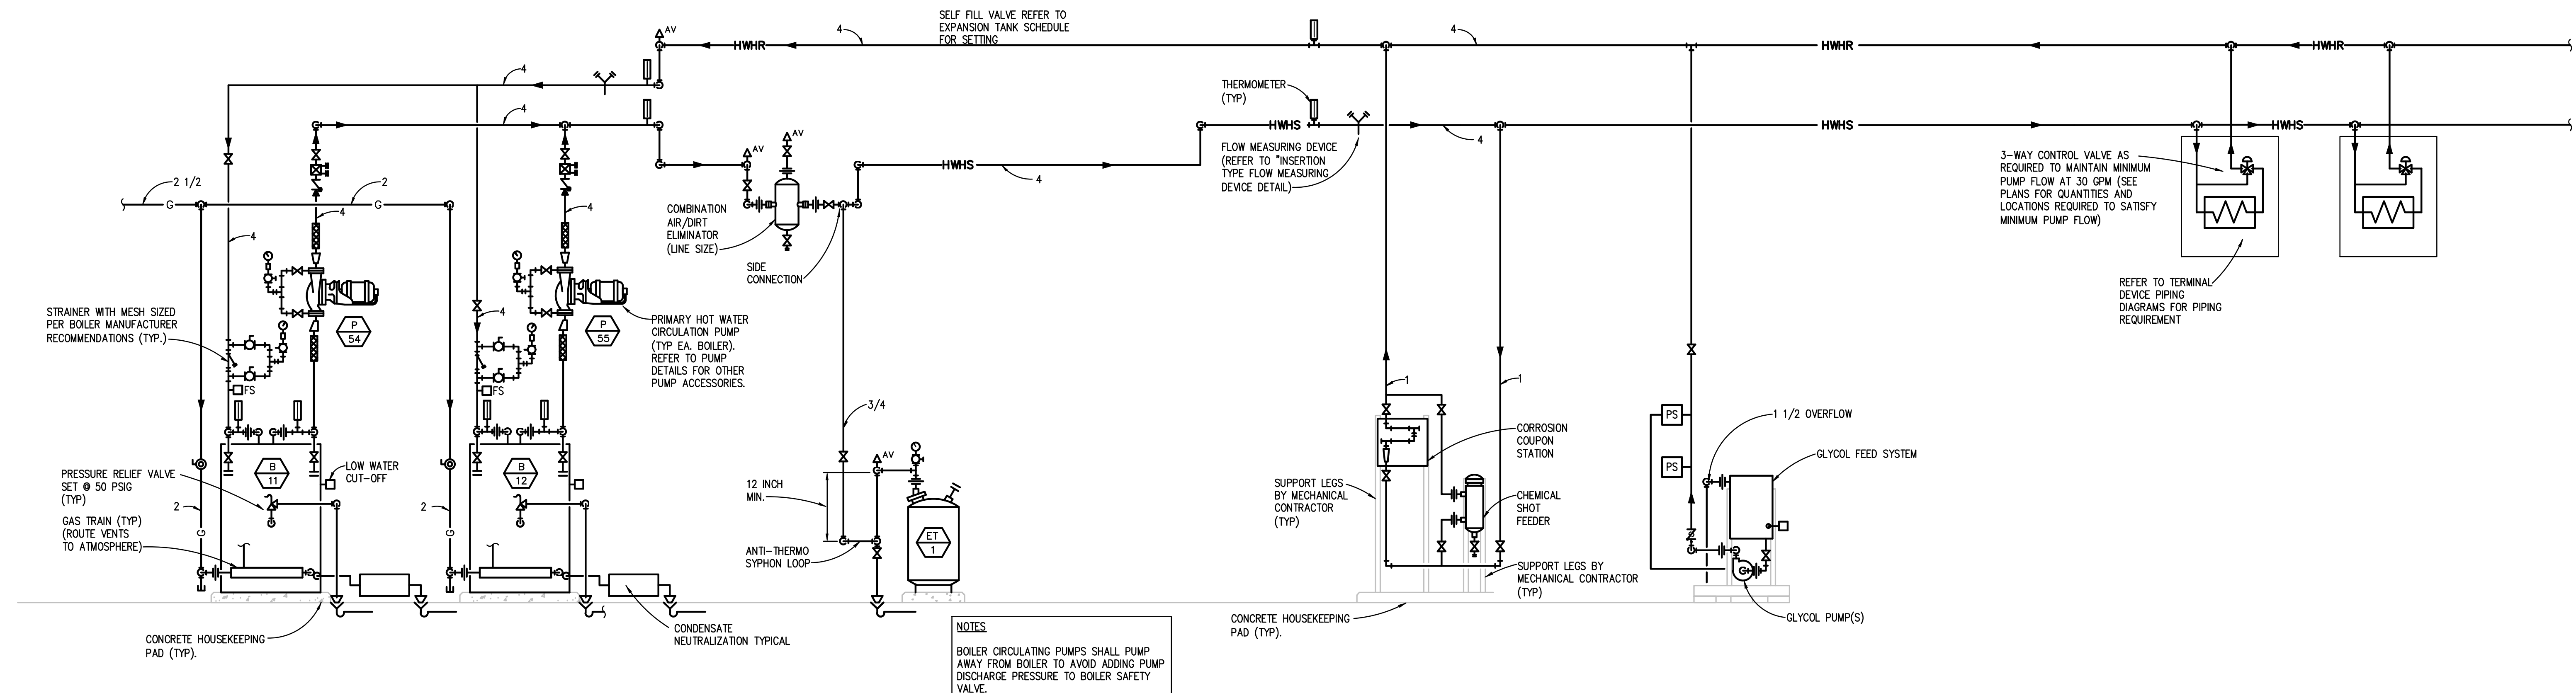


BOILER PIPING DIAGRAM
NO SCALE

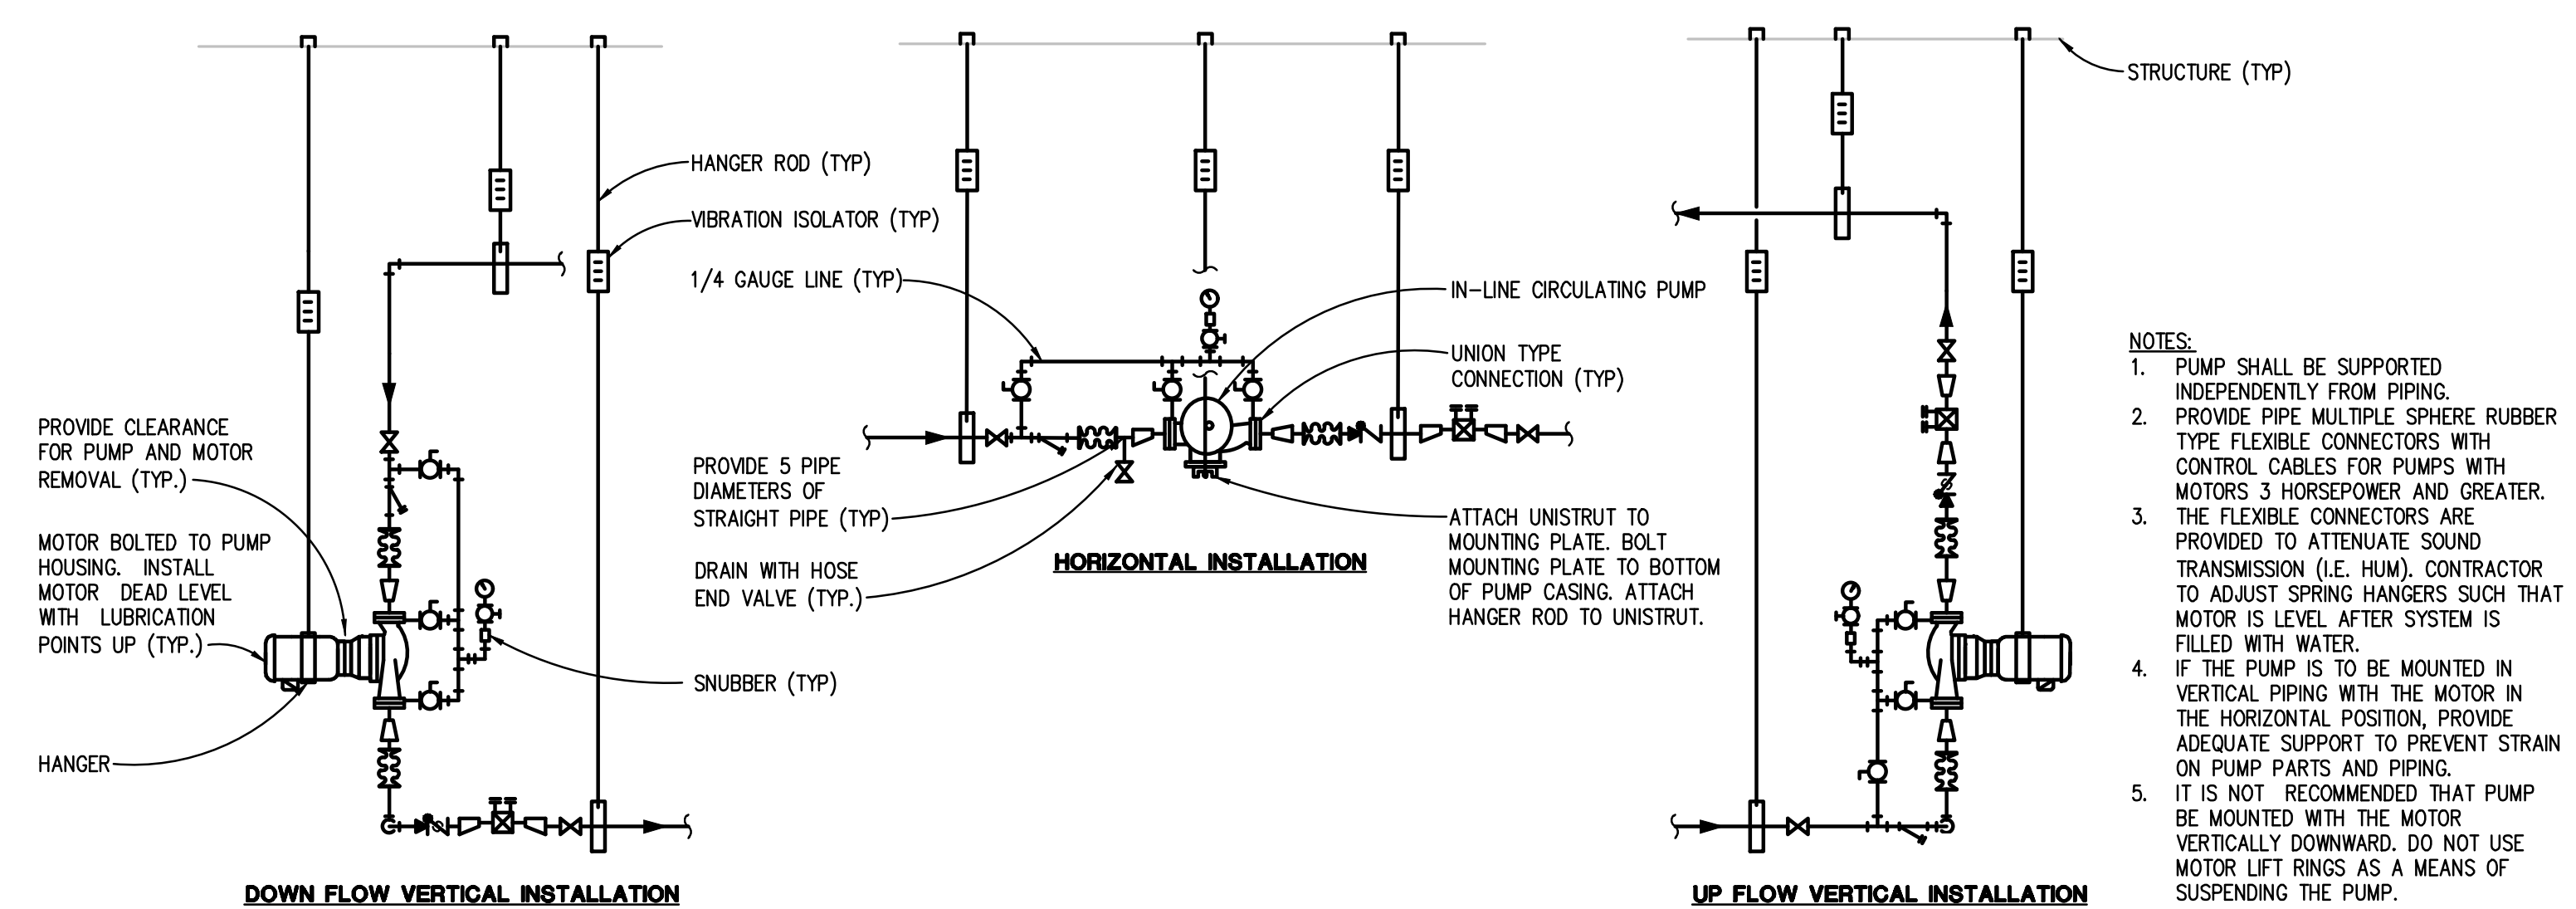

IN-LINE CLOSE COUPLED (BELL AND GOSSETT SERIES 80 AND 90) TYPE CIRCULATING PUMP PIPING DIAGRAM
NO SCALE

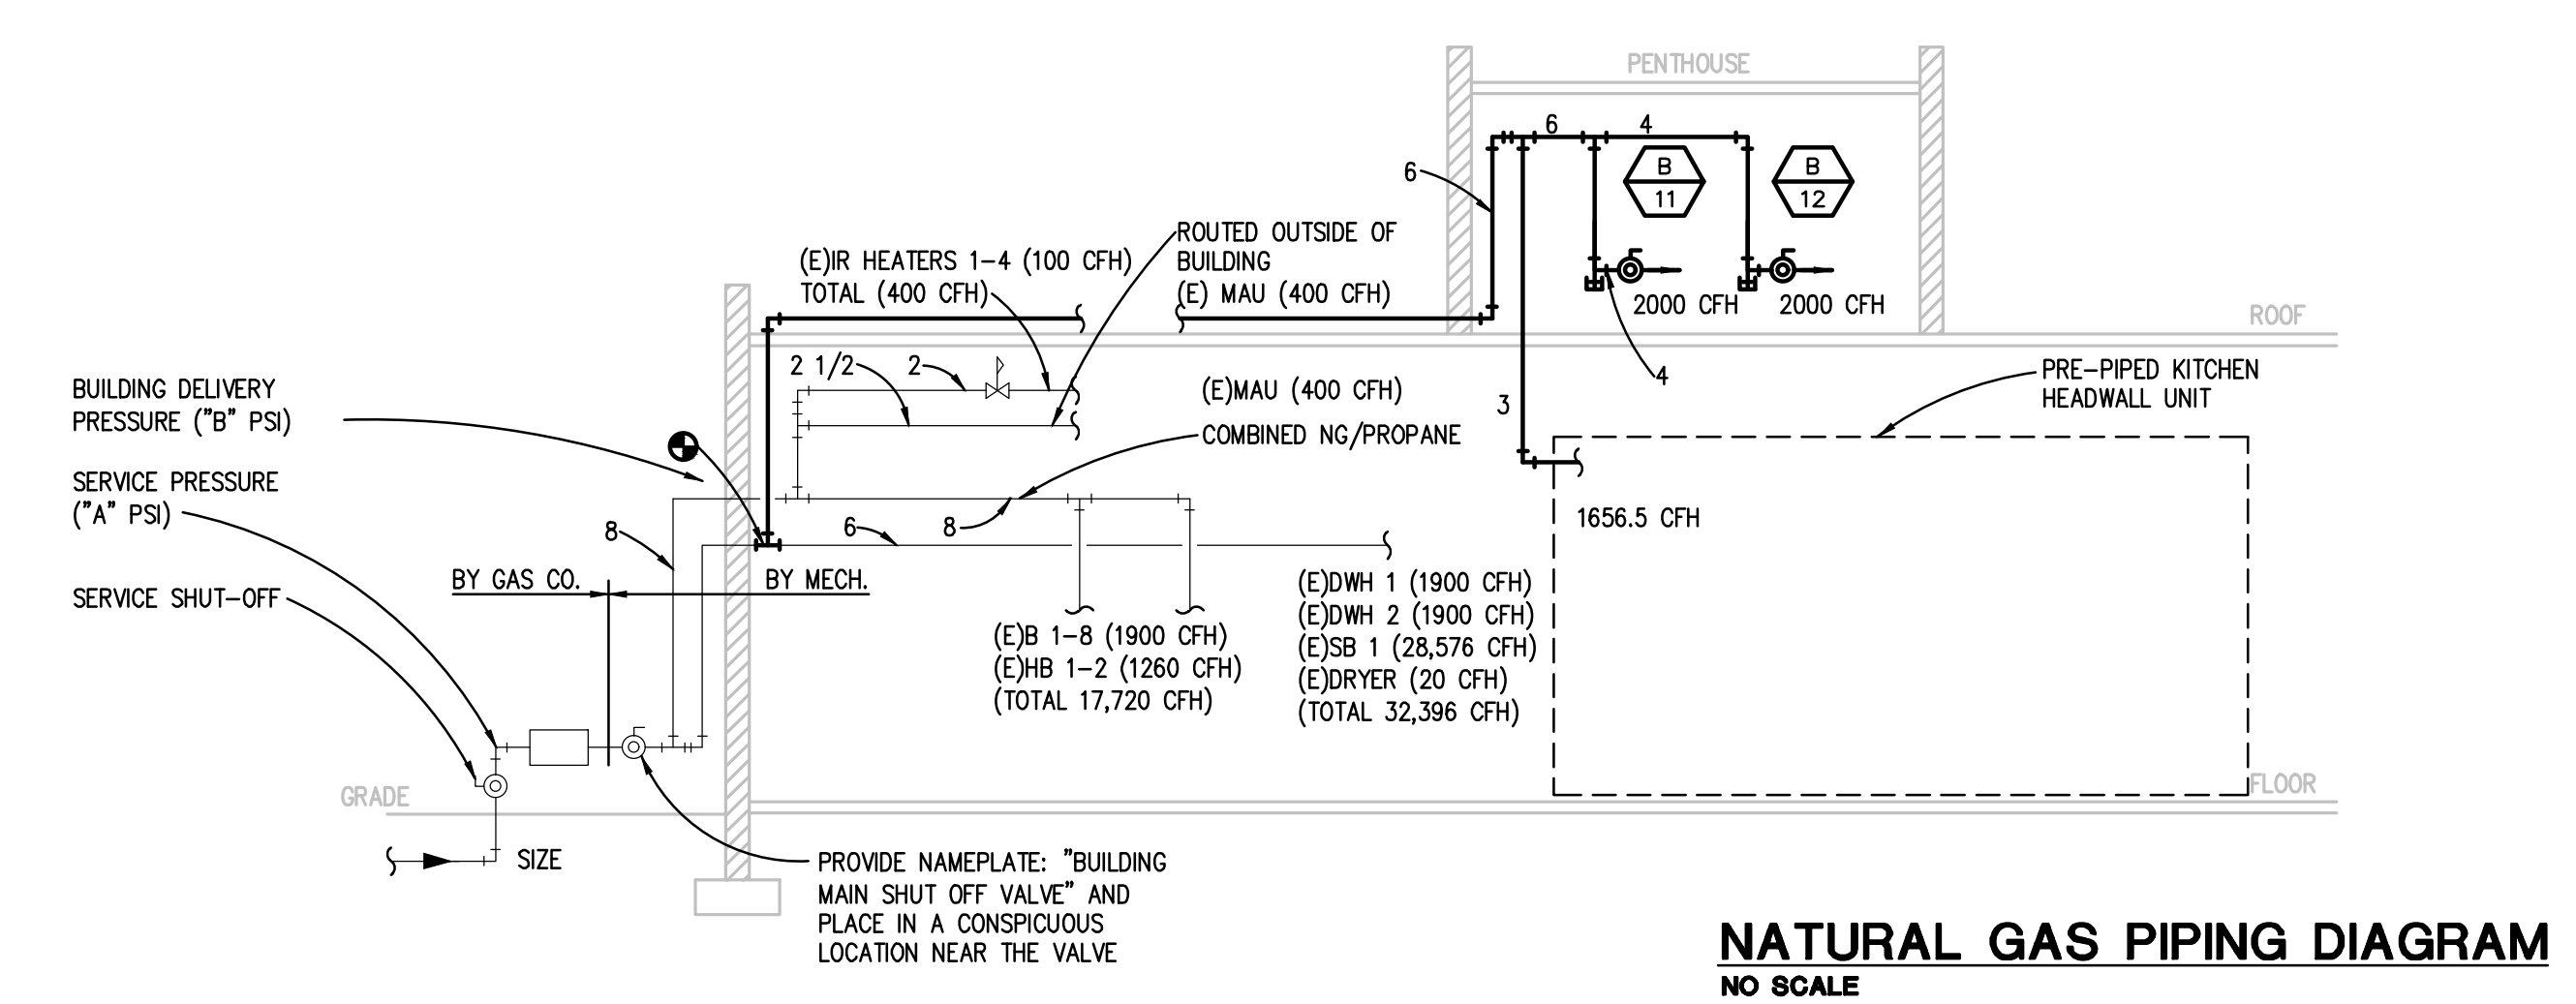

NATURAL GAS PIPING DIAGRAM
NO SCALE

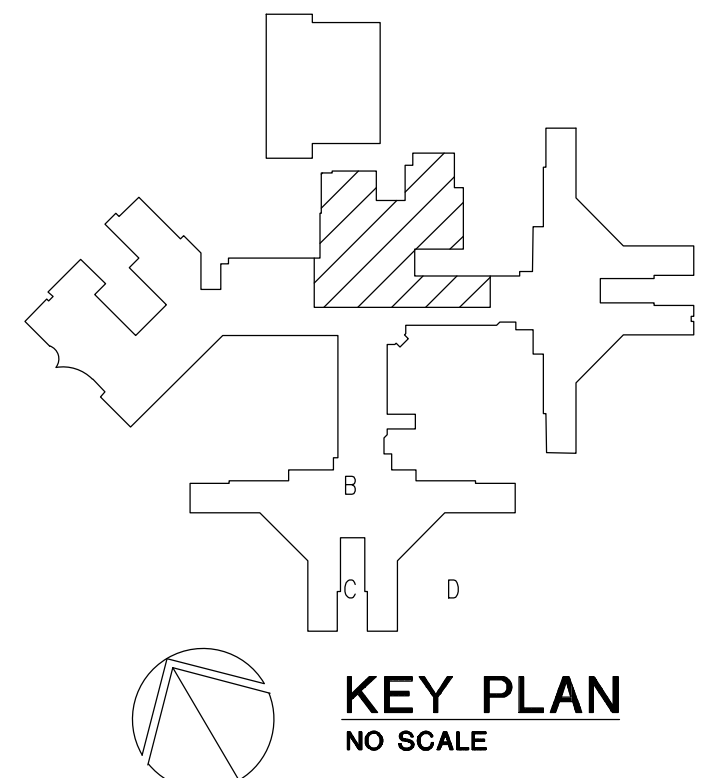

KEY PLAN
NO SCALE

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

WTAARCH.COM
WTA ARCHITECTS
100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN


SHEET TITLE
MECHANICAL DETAILS

PROJECT NUMBER 2021094	SHEET NUMBER
PROJECT DATE AUGUST 23, 2023	M6.01
CHECKED BY WEK	

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2021-0942


g:\2021\2021-0402-00\CA0\2021-0402-M6-DT.dwg, M-601, 9/5/2023, 4:32:45 PM, Gerard Henrich, Peter Basso Associates Inc.

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

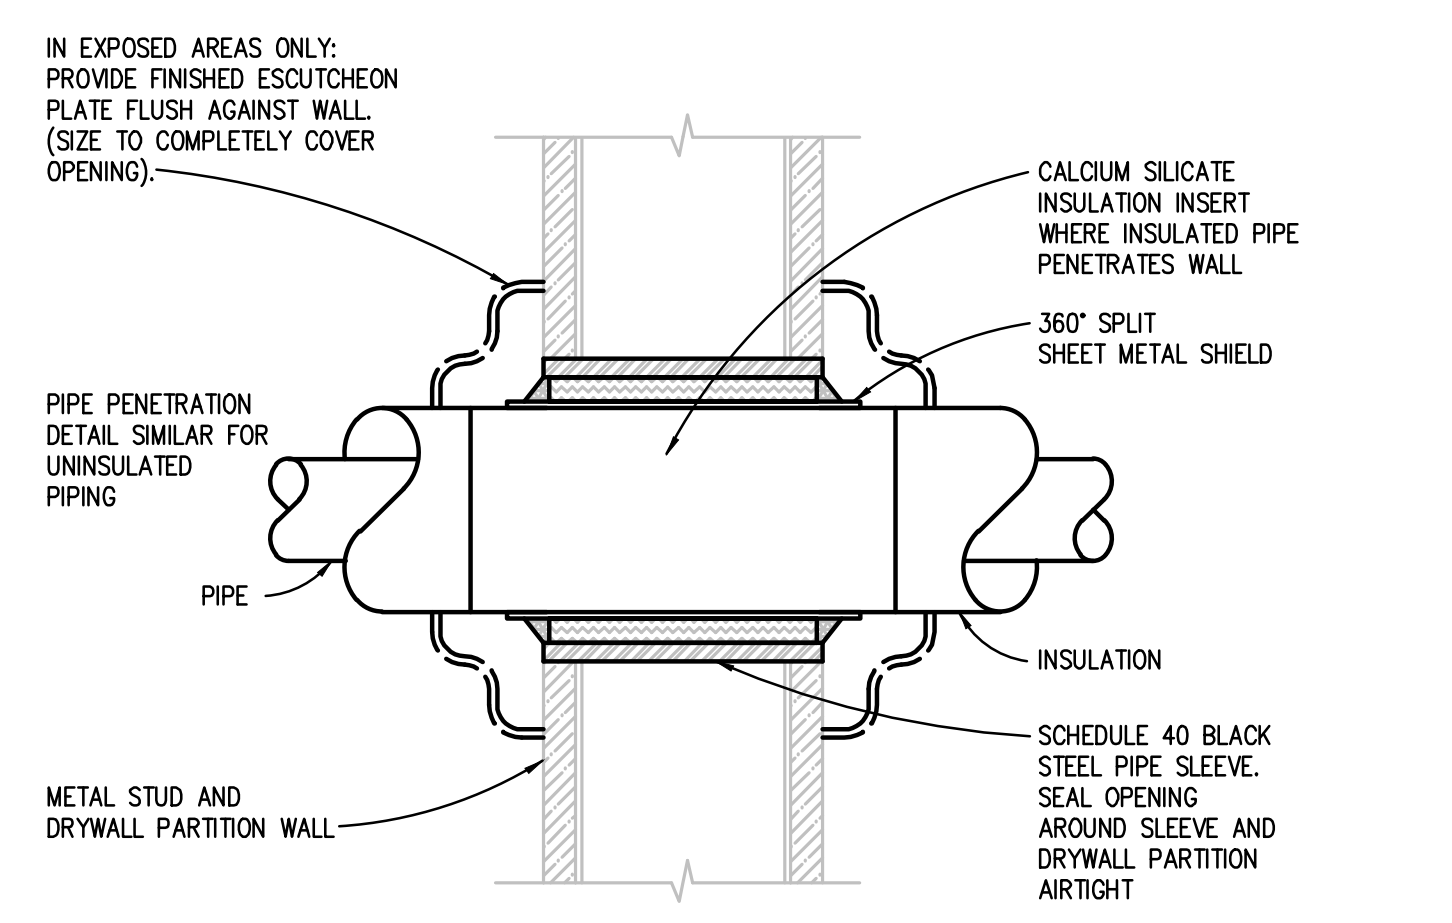


DETAIL INDICATES THE INSTALLATION REQUIREMENTS FOR A FIRE RATED ASSEMBLY. FOR A NON-FIRE RATED ASSEMBLY PACK SLEEVED OPENING WITH INSULATION MATERIAL AND CAULK WITH NON-HARDENING SEALANT.

FIRE RATED AND NON-FIRE RATED METAL STUD AND DRYWALL PARTITION WALL PIPE PENETRATION DETAIL
NO SCALE

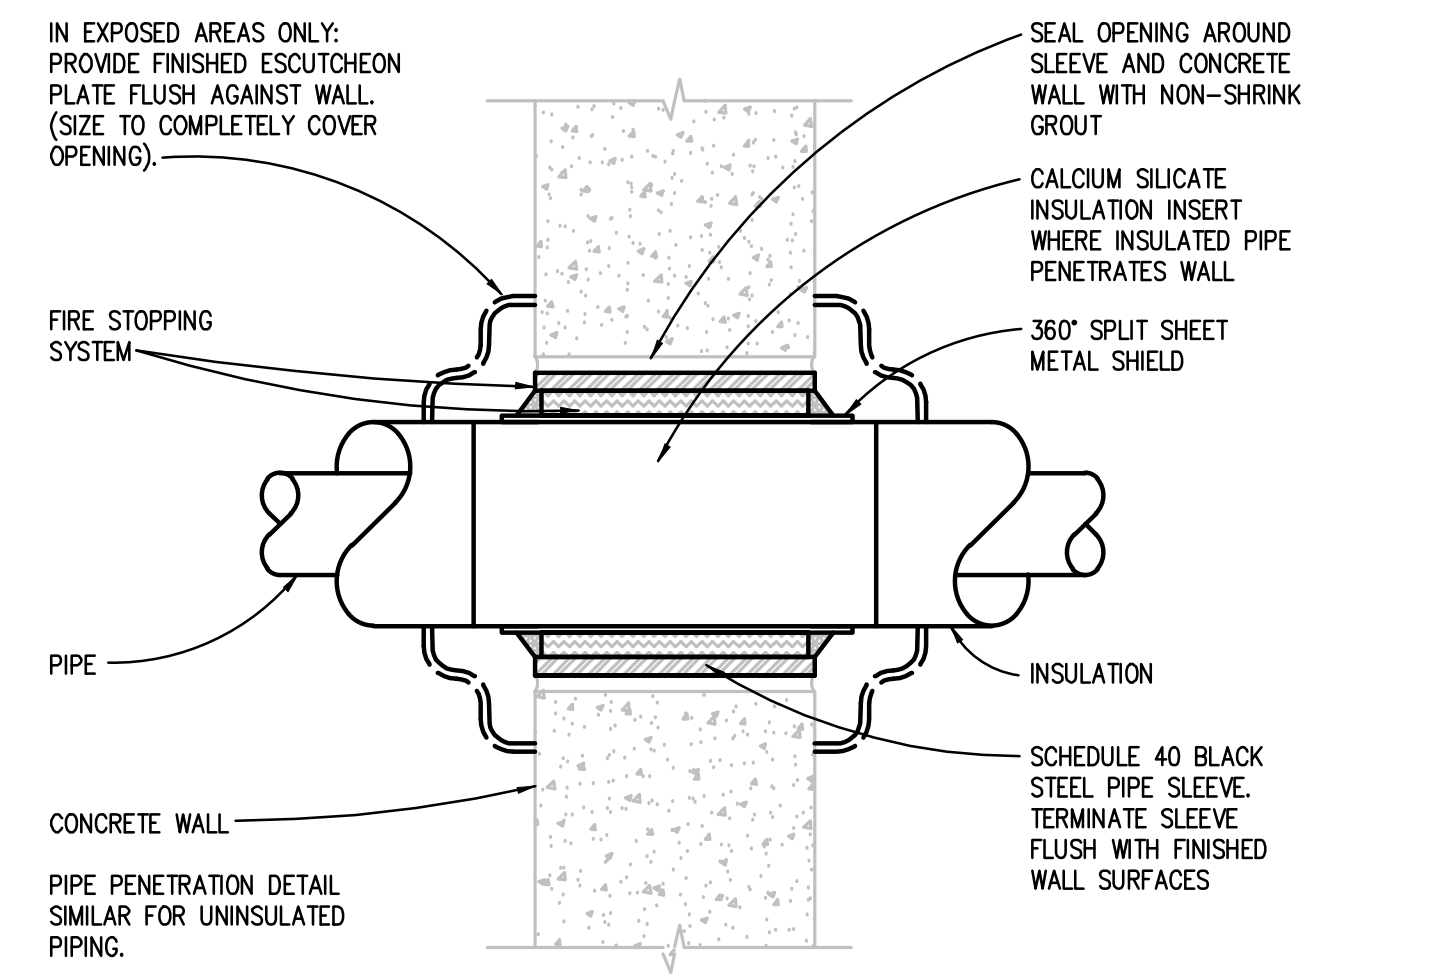


DETAIL INDICATES THE INSTALLATION REQUIREMENTS FOR A FIRE RATED ASSEMBLY. FOR A NON-FIRE RATED ASSEMBLY PACK SLEEVED OPENING WITH INSULATION MATERIAL AND CAULK WITH NON-HARDENING SEALANT.


FIRE RATED AND NON-FIRE RATED POURED CONCRETE OR BLOCK WALL PIPE PENETRATION DETAIL
NO SCALE

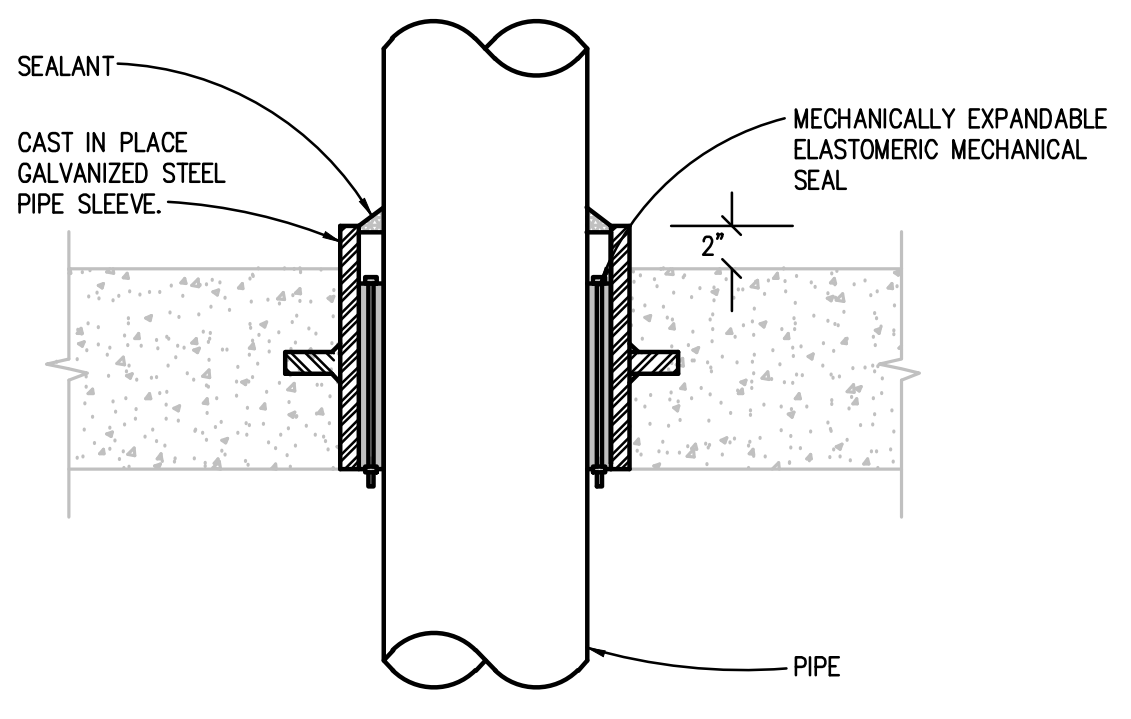


NEW SLAB ON GRADE FLOOR PIPE PENETRATION DETAIL
NO SCALE

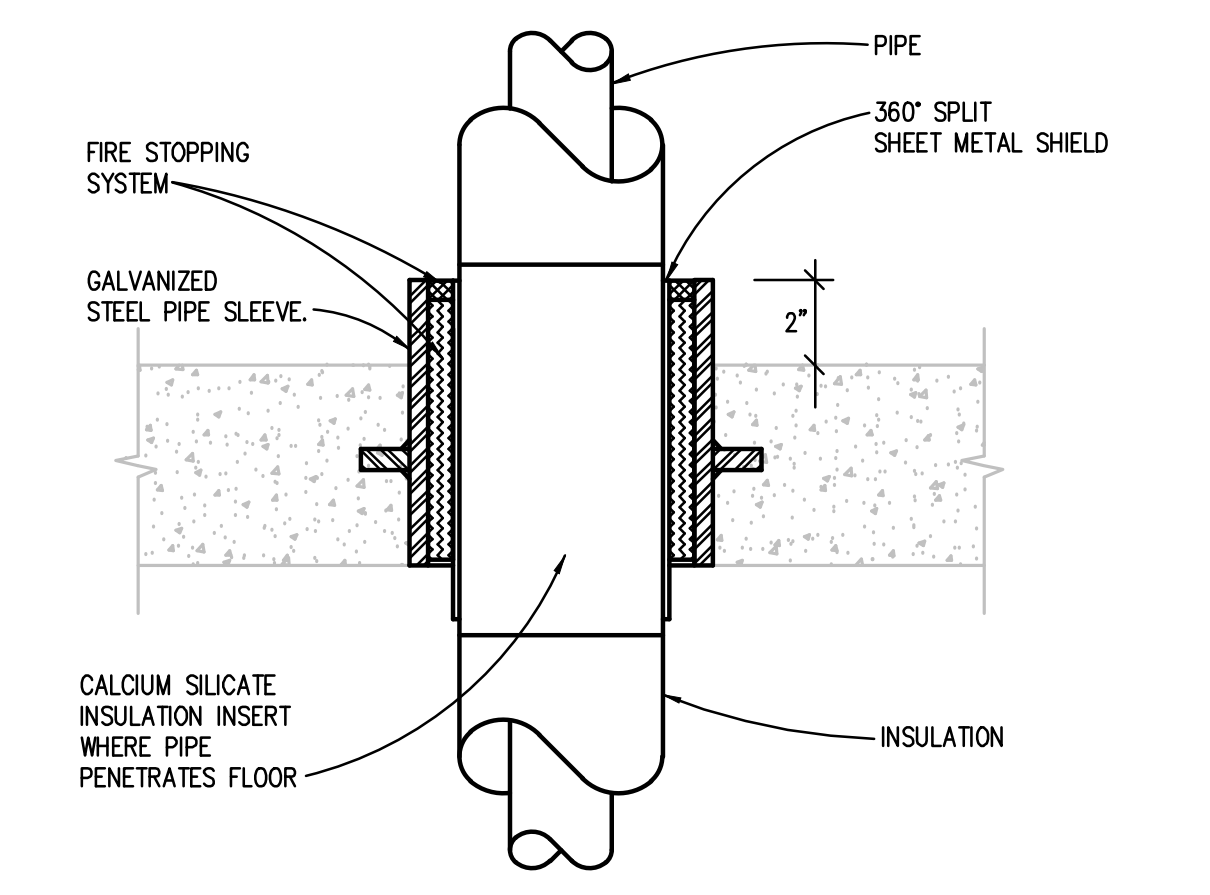


NEW FLOOR PIPE PENETRATION DETAIL
NO SCALE

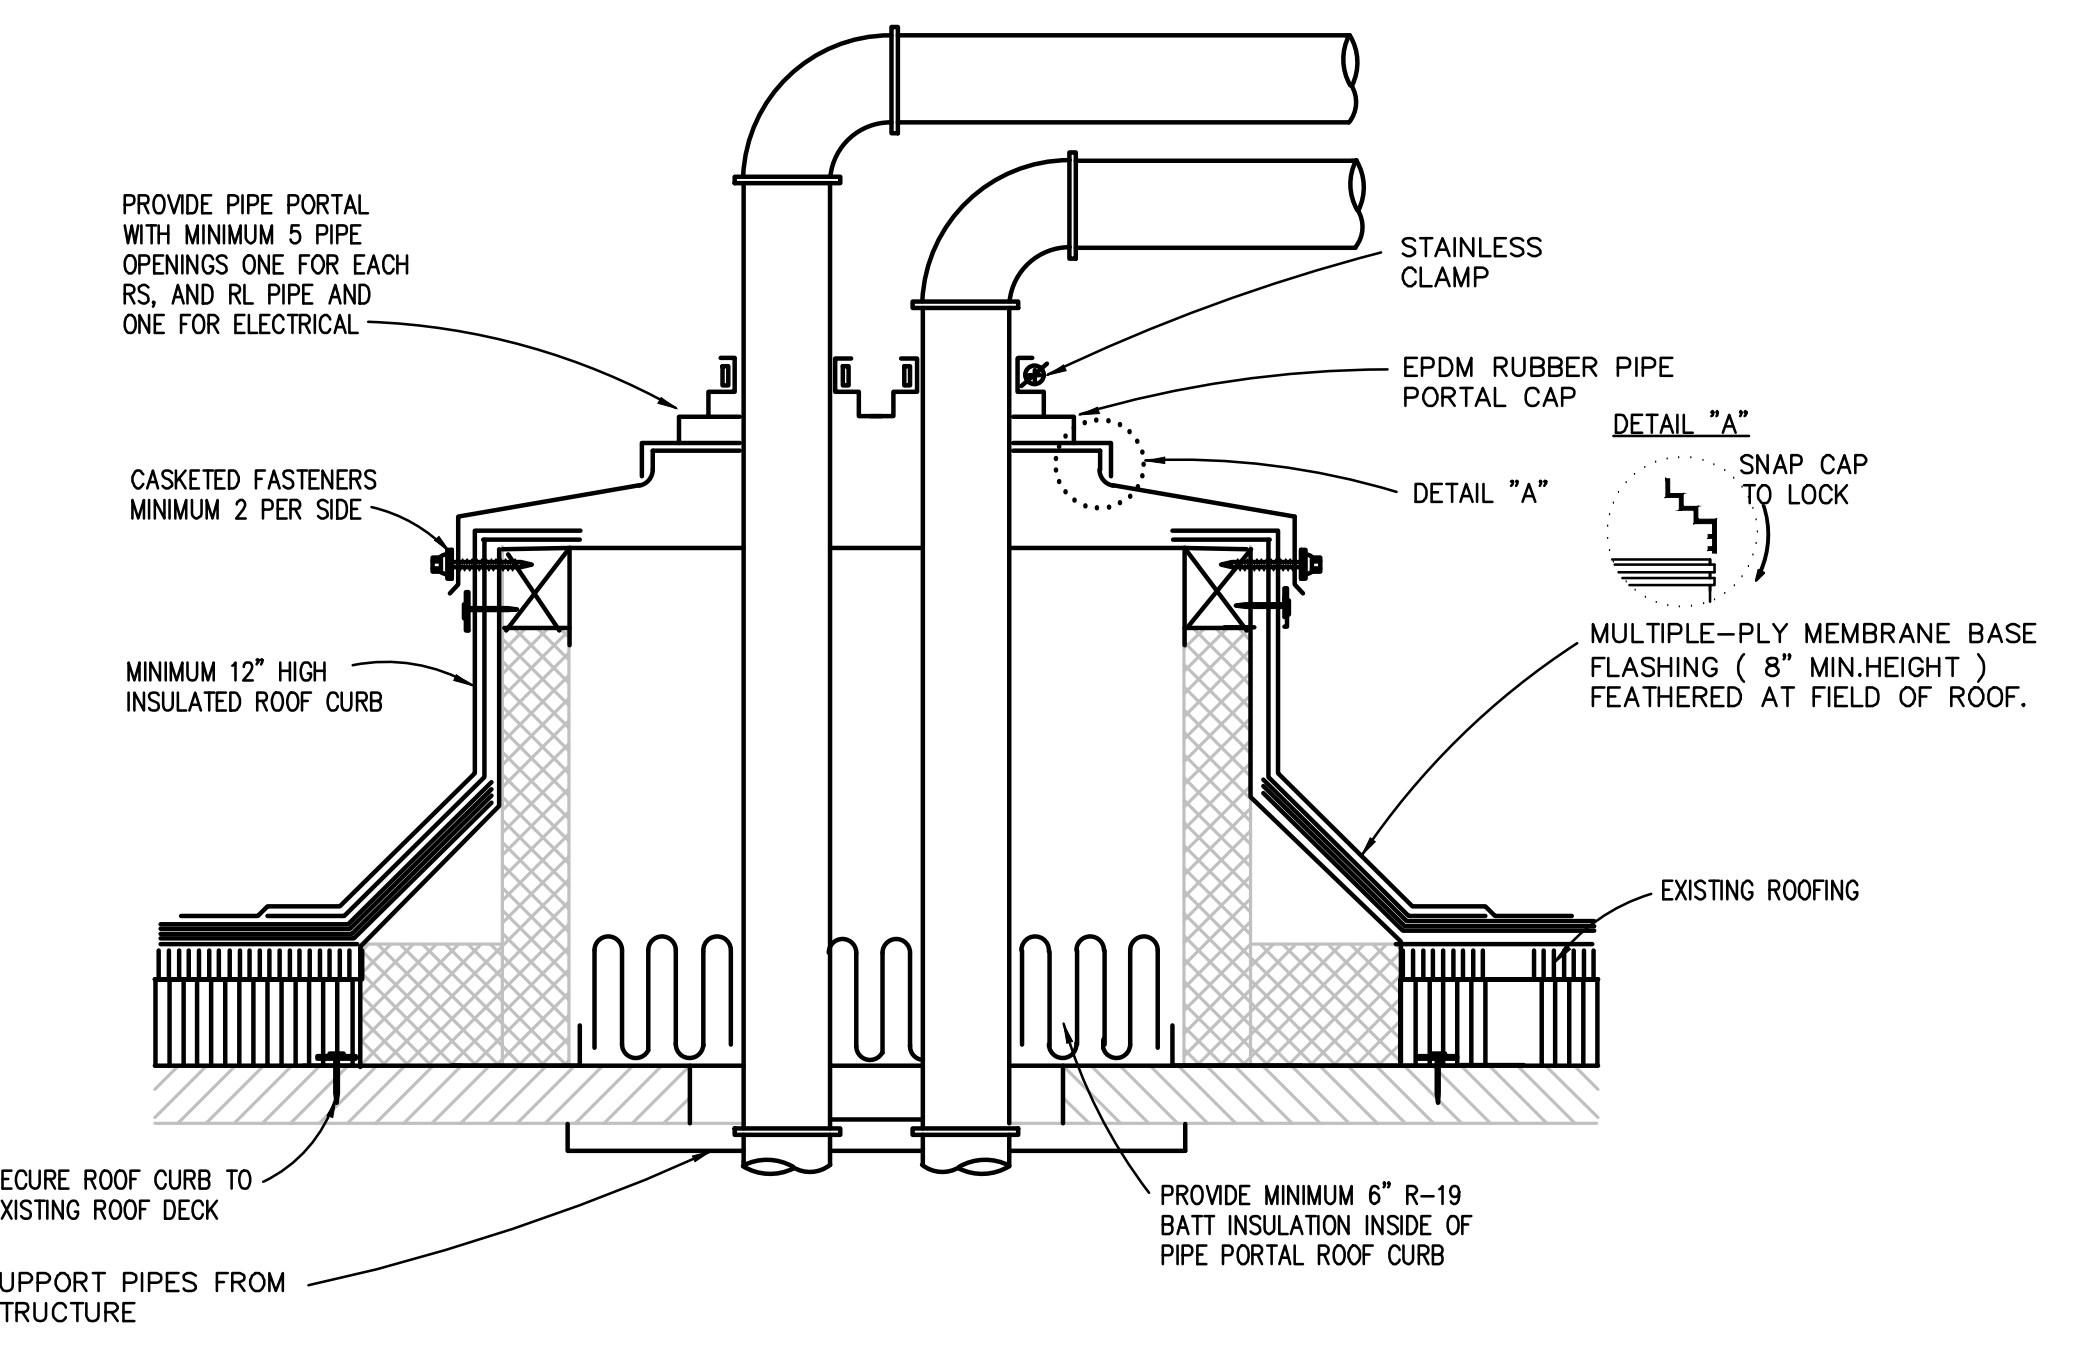


CONDENSING UNIT PIPE PORTAL DETAIL
NO SCALE

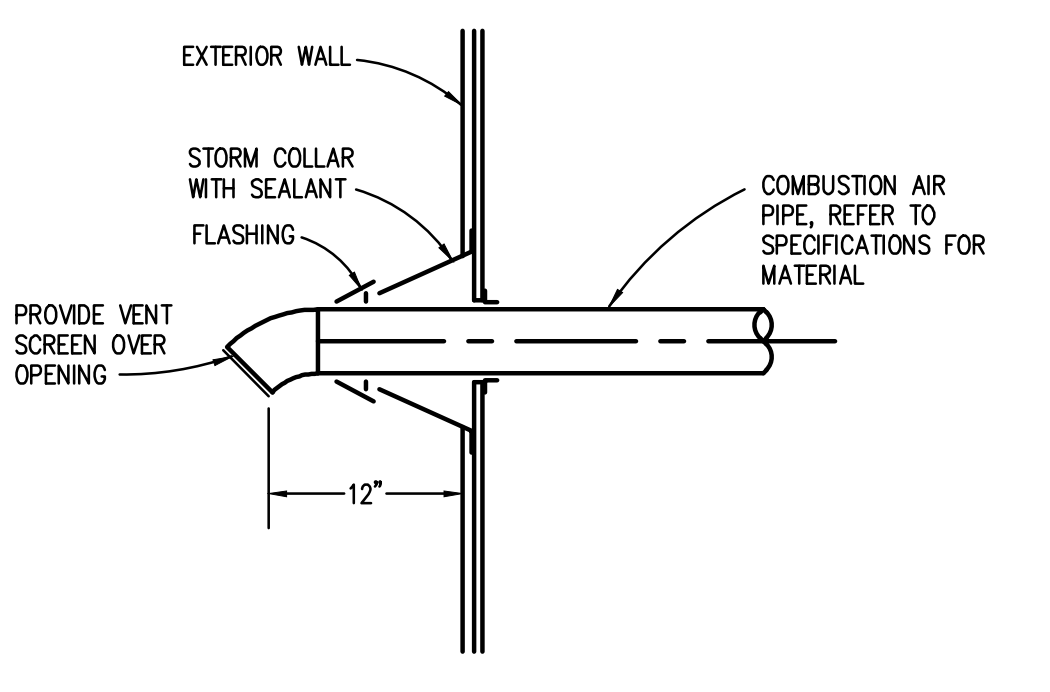


COMBUSTION AIR INTAKE DETAIL
NO SCALE

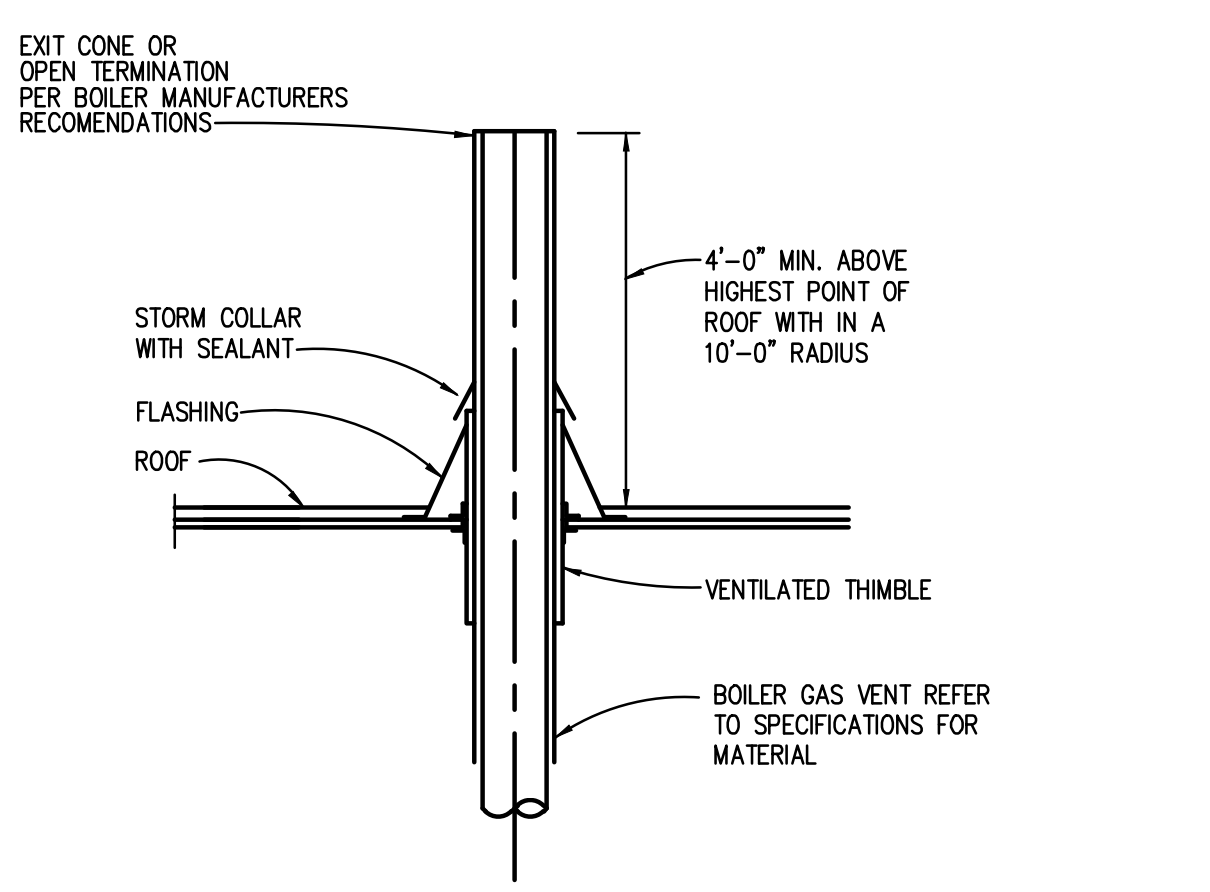


FLUE THRU ROOF DETAIL
NO SCALE

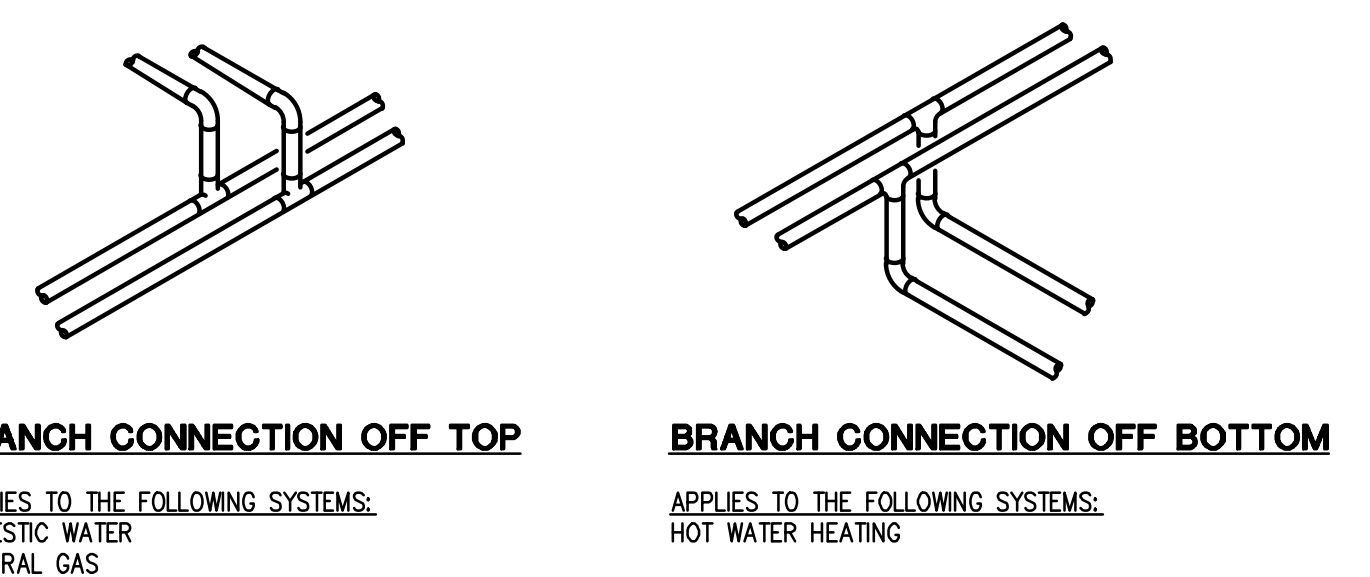


TYPICAL BRANCH TAKE-OFF CONNECTION PIPING DETAIL
NO SCALE

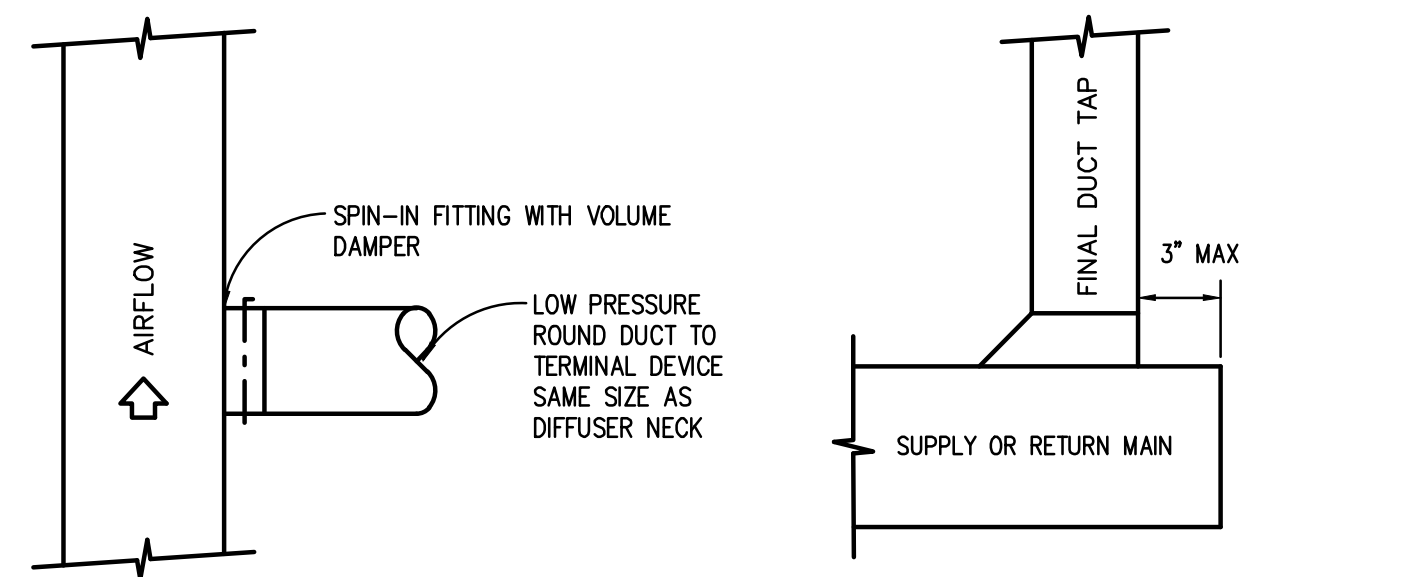

LOW PRESSURE INLET/OUTLET TO/FROM DIFFUSER, REGISTER OR GRILLE

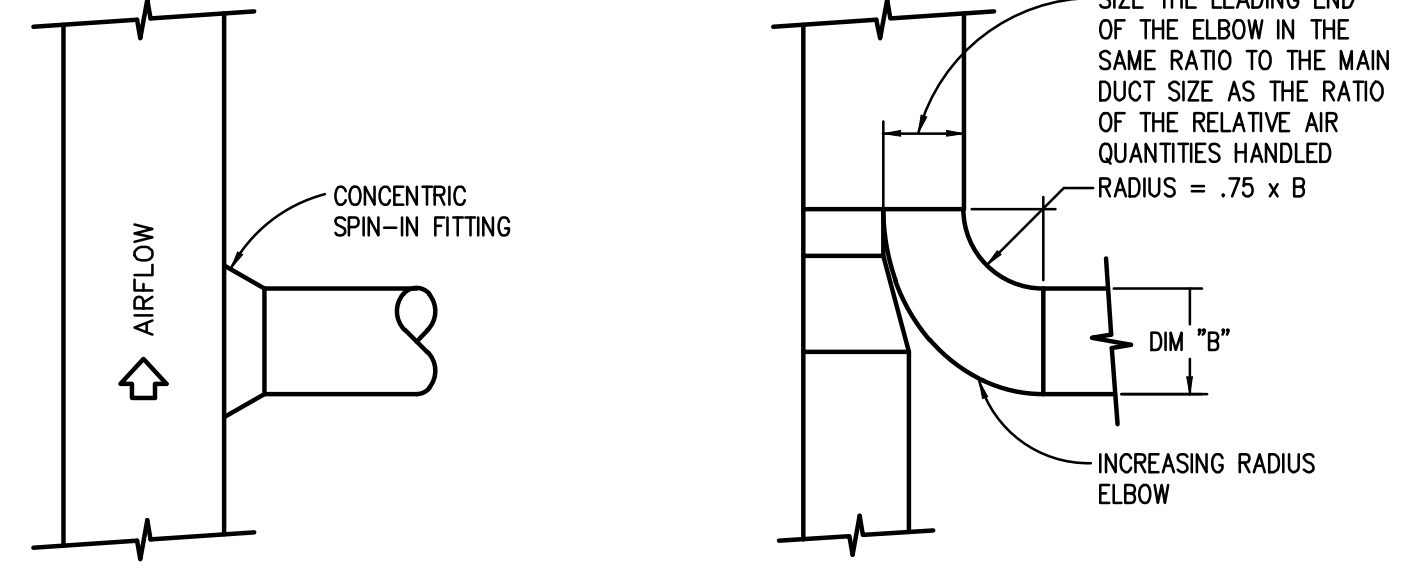

LOW PRESSURE END OF RUN

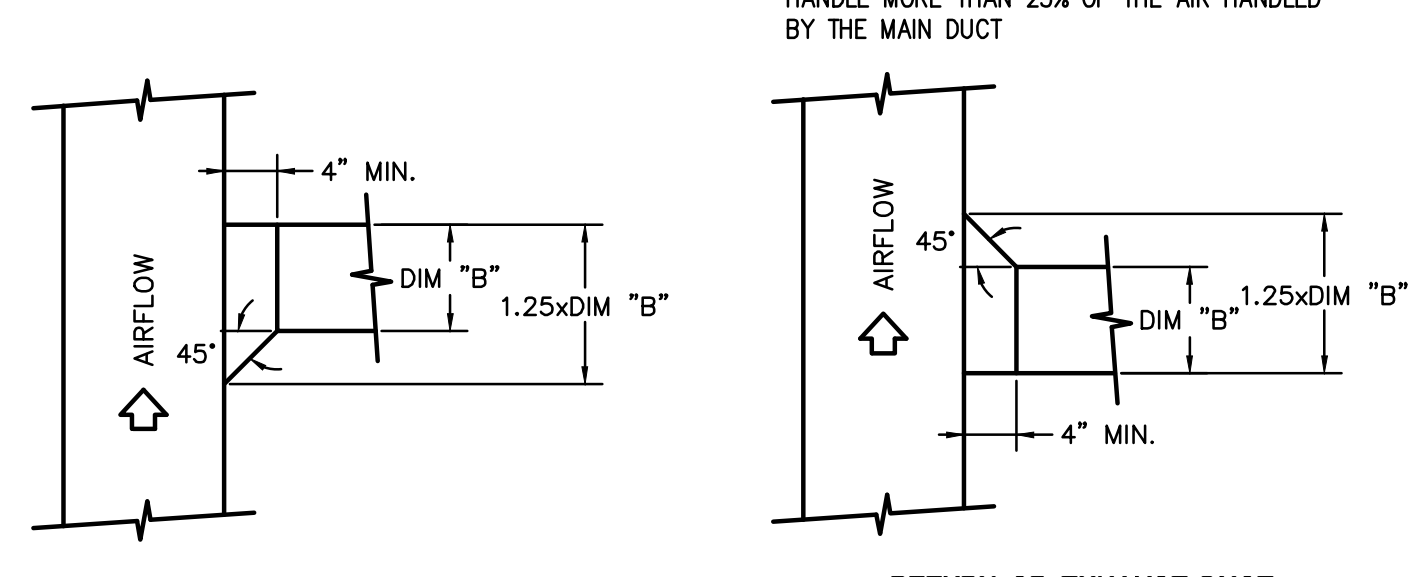

RECTANGULAR TO ROUND DUCT




SUPPLY DUCT




RETURN OR EXHAUST DUCT


RECTANGULAR DUCT BRANCH TAKE-OFF DETAILS
NO SCALE

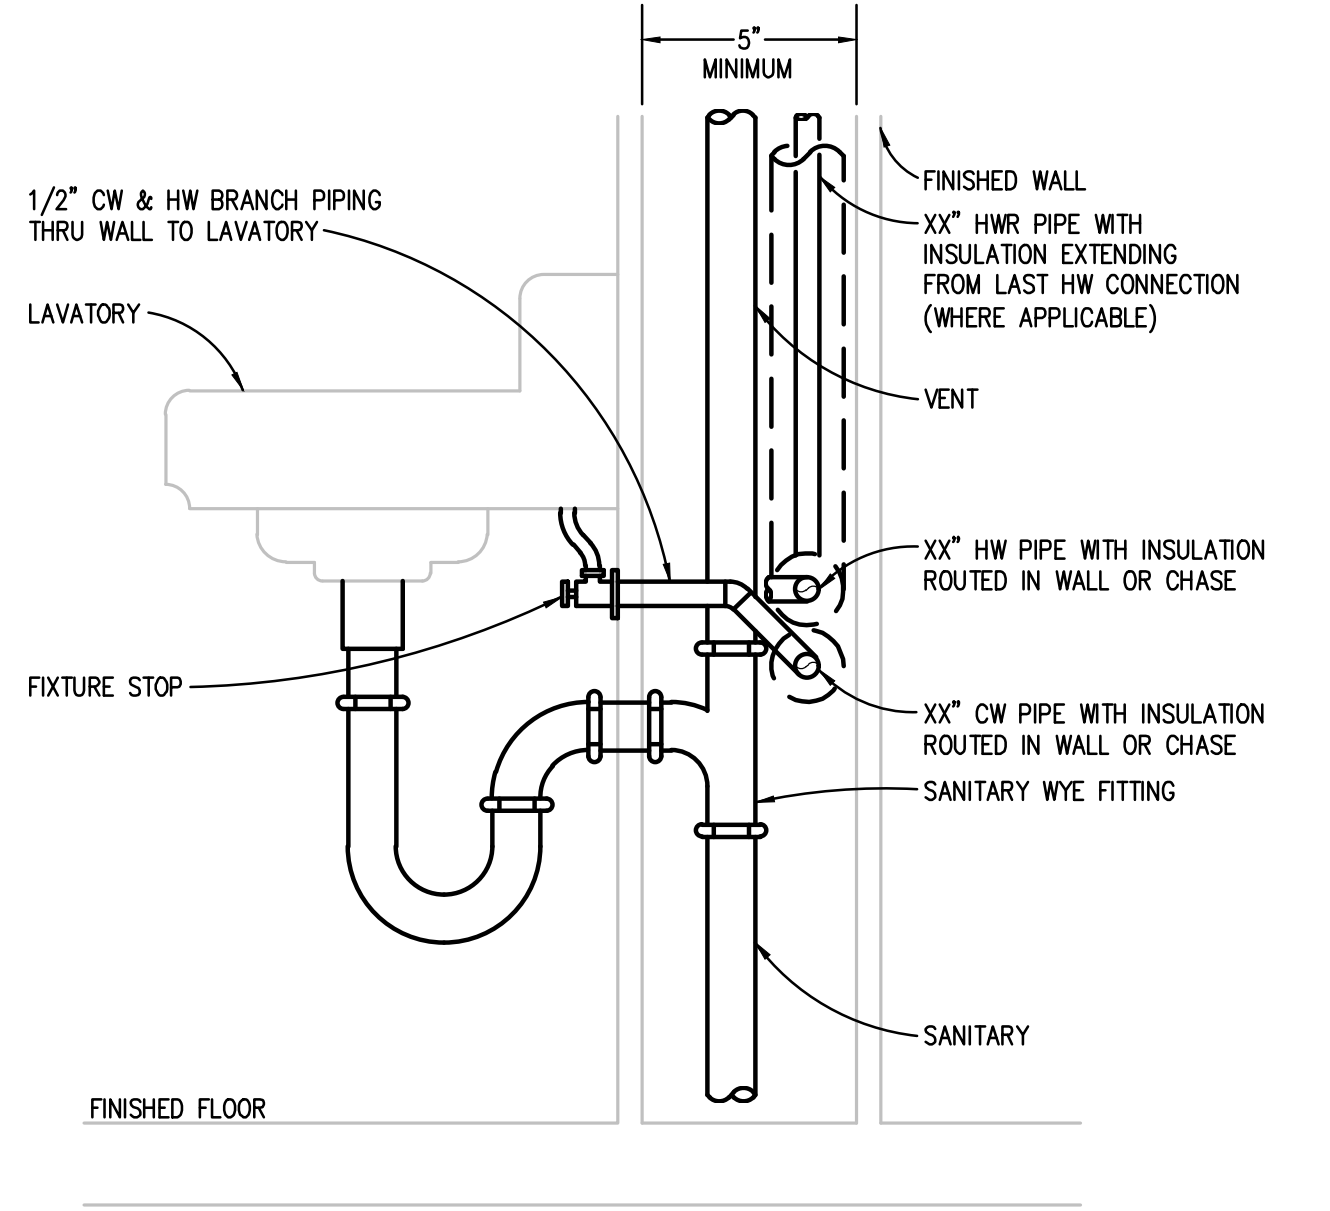


TYPICAL LAVATORY DETAIL
NO SCALE

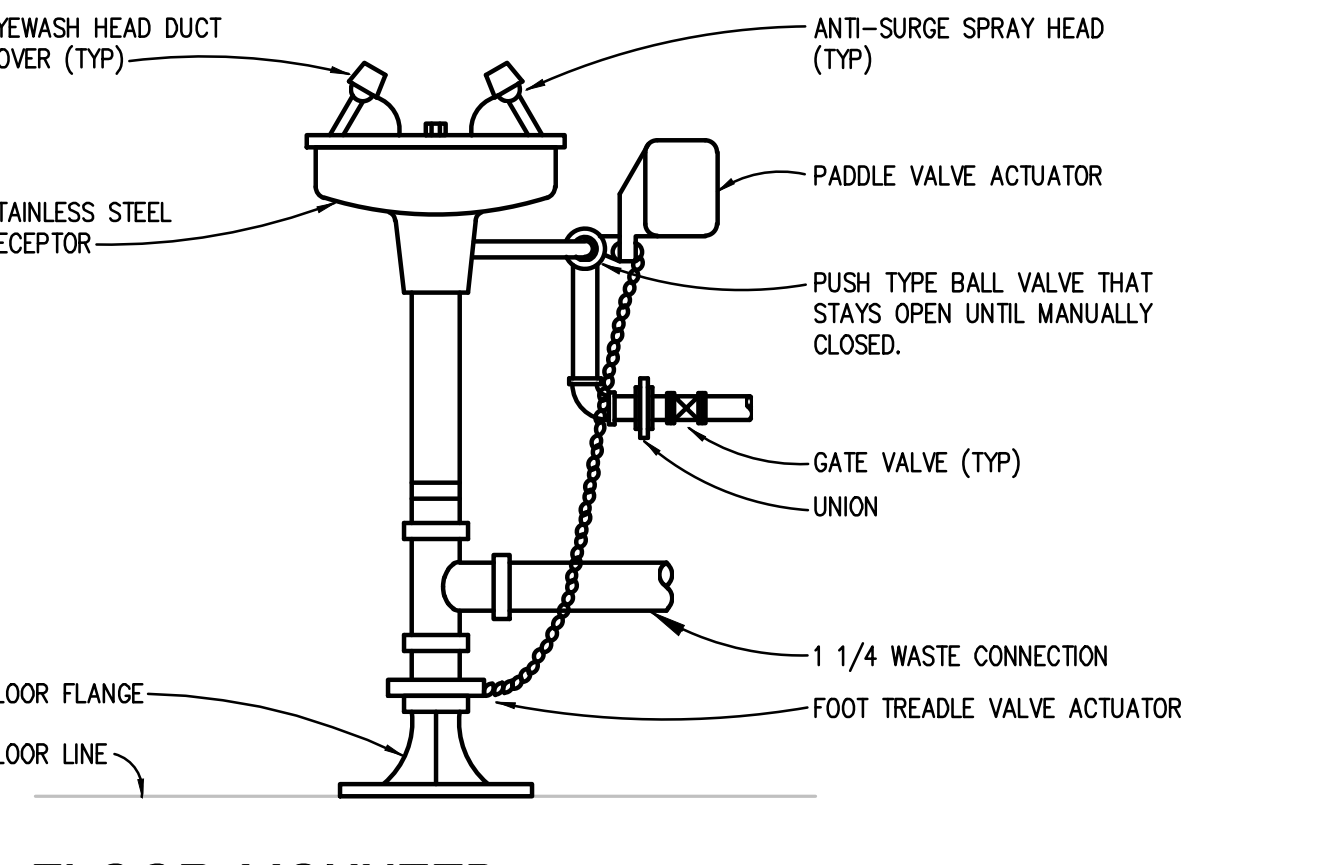


FLOOR MOUNTED EMERGENCY EYEWASH PIPING DIAGRAM
NO SCALE

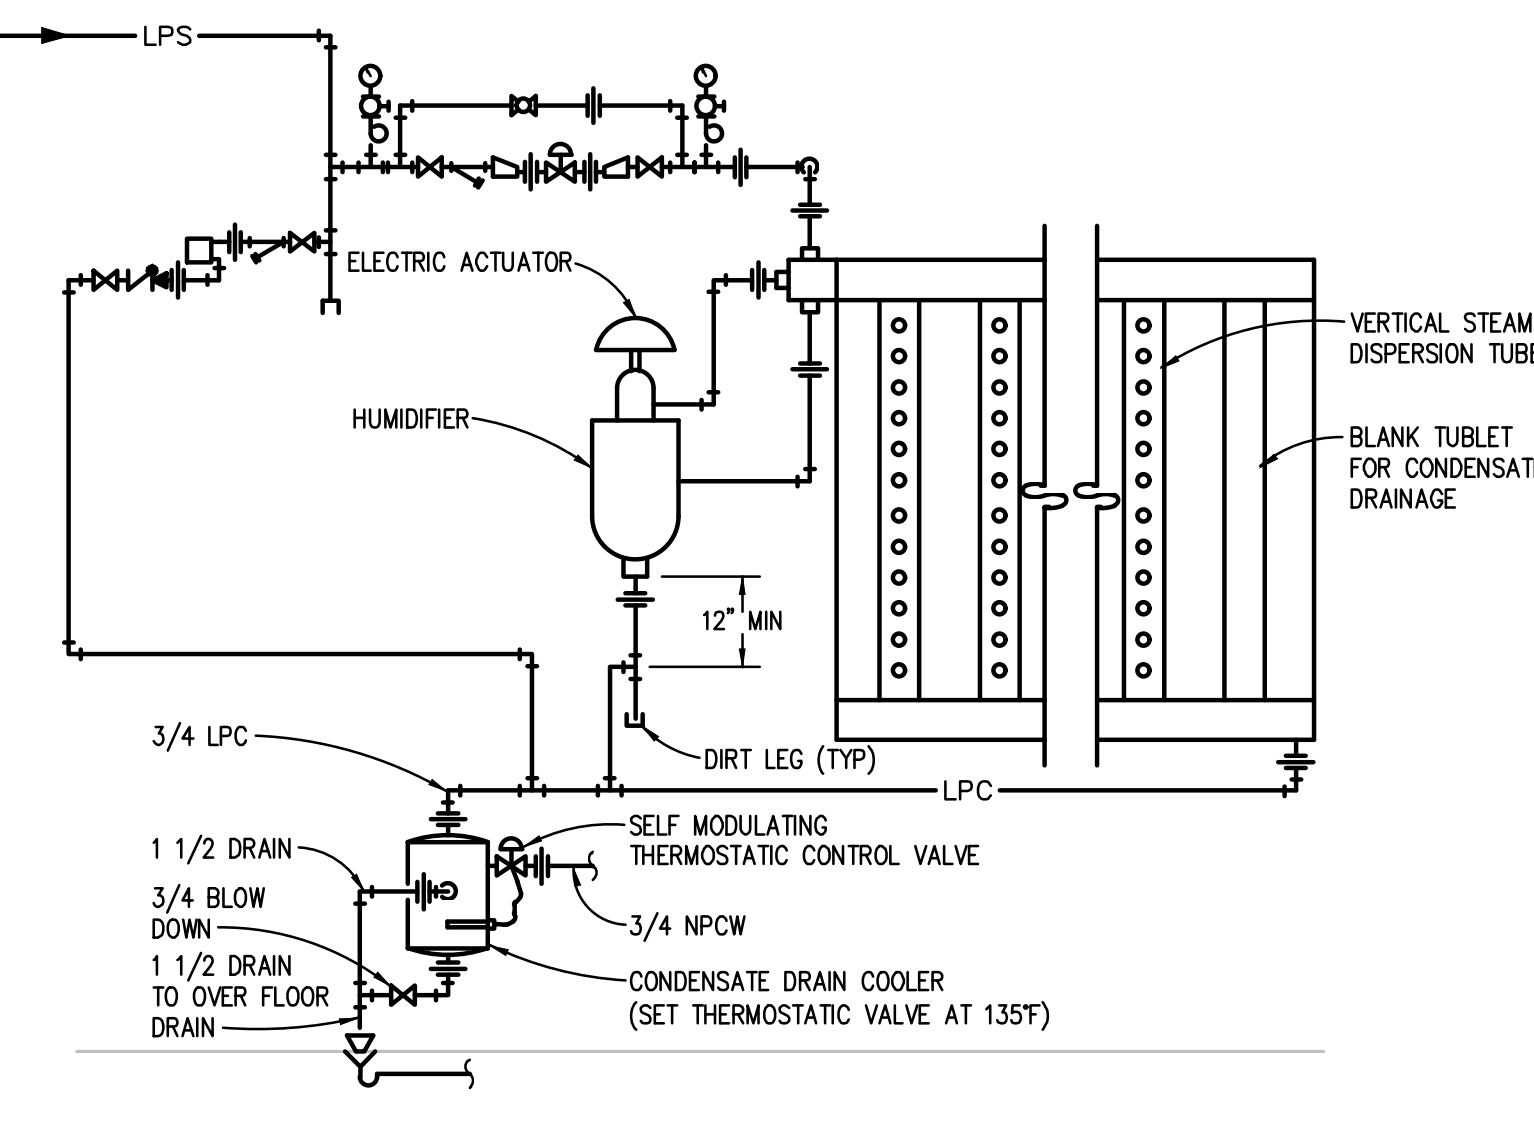


VERTICAL STEAM DISPERSION TUBE HUMIDIFIER PANEL PIPING DIAGRAM
NO SCALE

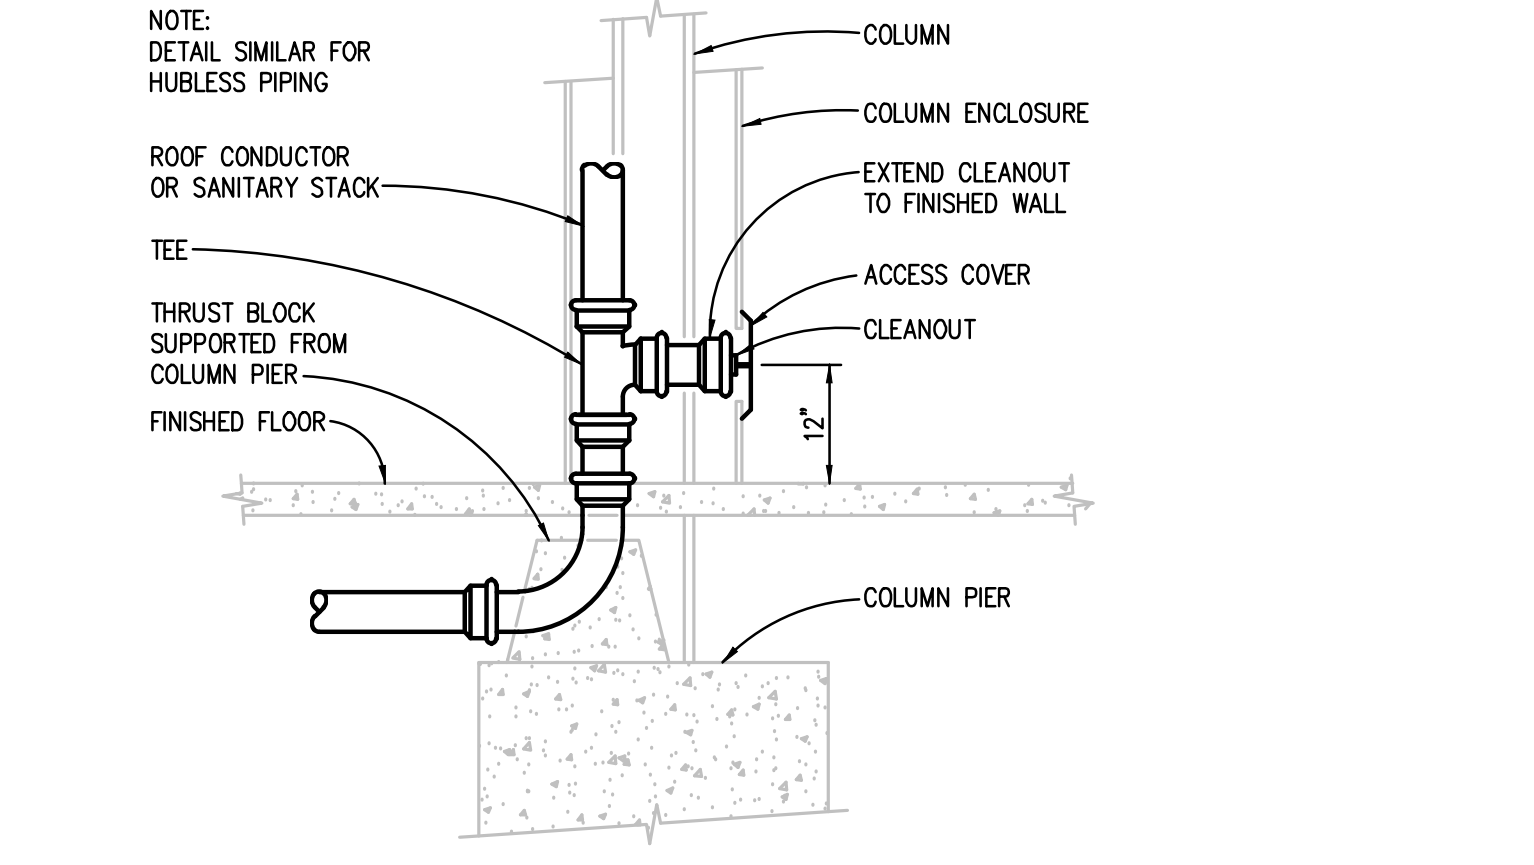


ROOF CONDUCTOR AND SANITARY STACK BASE CONNECTION DETAIL
NO SCALE

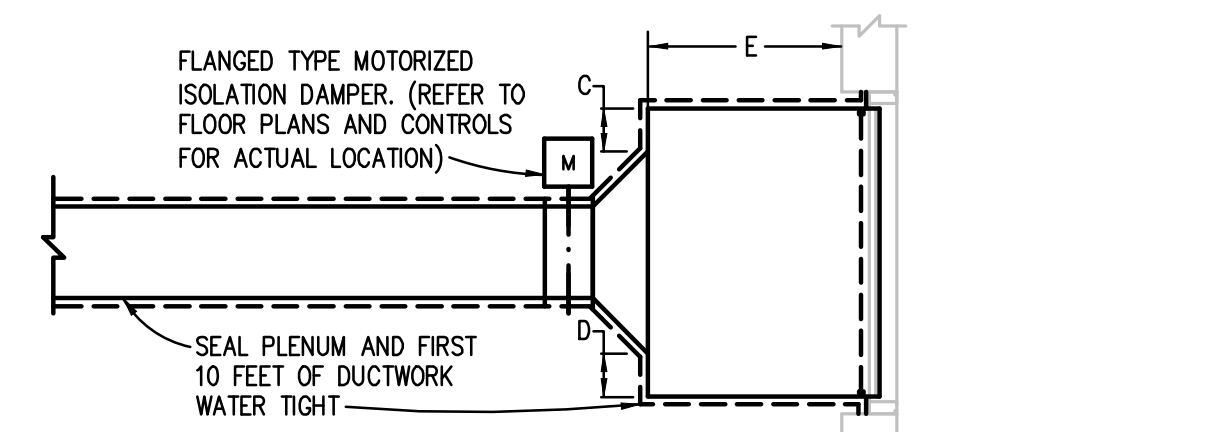

OUTDOOR AIR INTAKE OR EXHAUST/RELIEF PLENUM DETAIL
NO SCALE

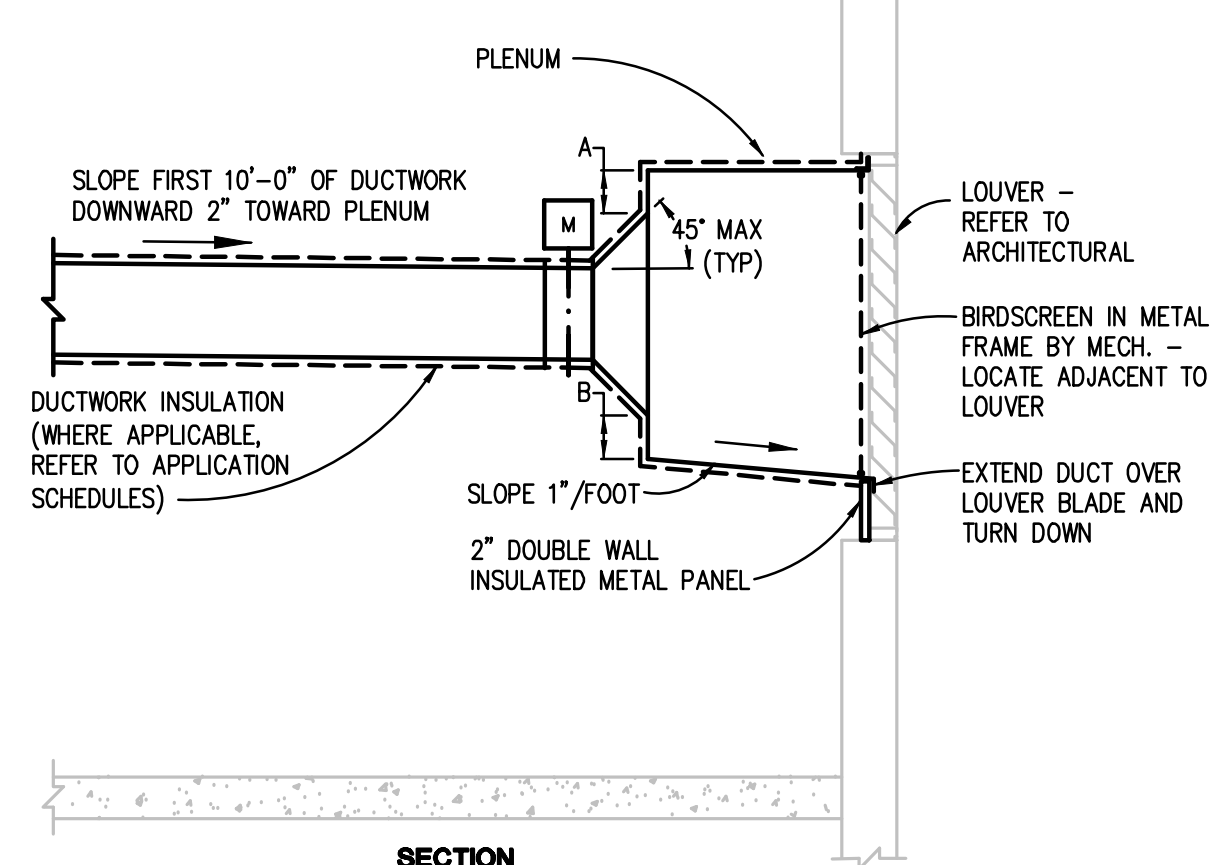

OUTDOOR AIR INTAKE OR EXHAUST/RELIEF PLENUM DETAIL
NO SCALE

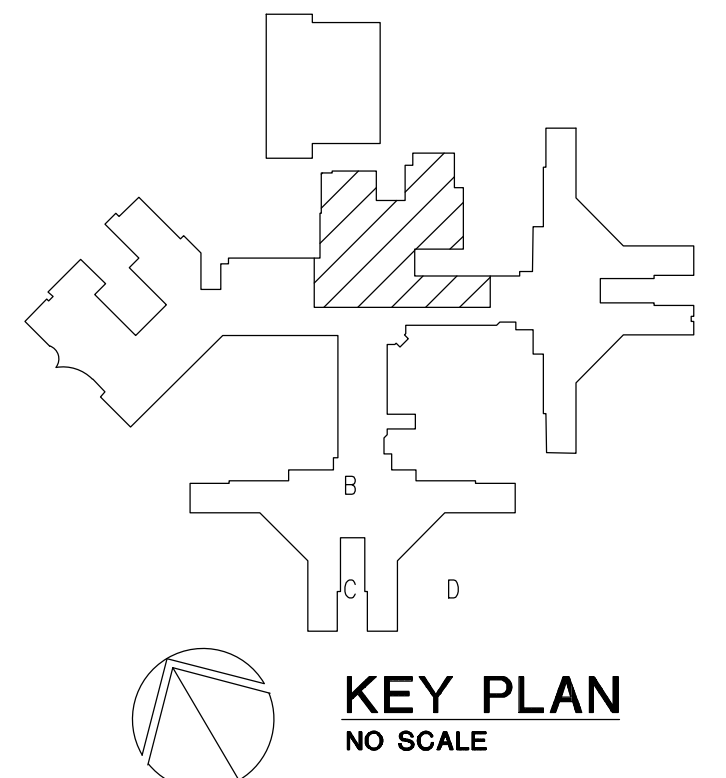

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
49120167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

WTAARCH.COM
WTA ARCHITECTS
100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
49120167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
MECHANICAL DETAILS

PROJECT NUMBER
2021094

PROJECT DATE
AUGUST 23, 2023



CHECKED BY
WEK

SHEET NUMBER
M6.02

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2021.0942



g:\2021\2021-0402-00\CA0\2021-0402-ME-DT.dwg, M=602, 9/5/2023, 4:32:46 PM, Gerard Henrich, Peter Basso Associates Inc.

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

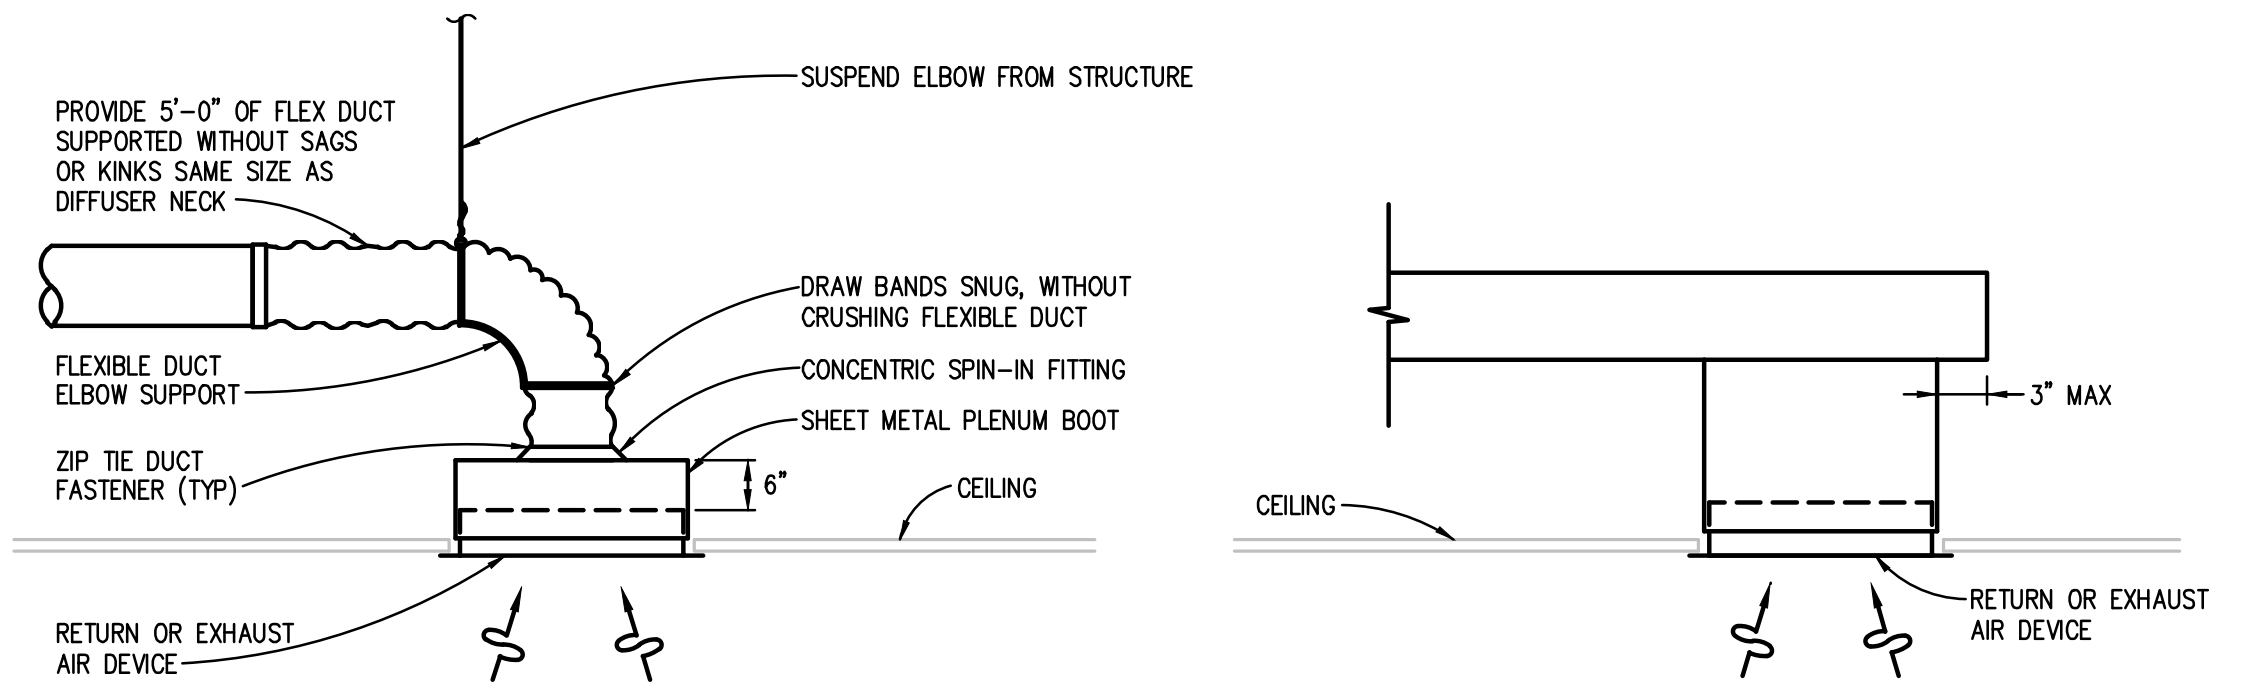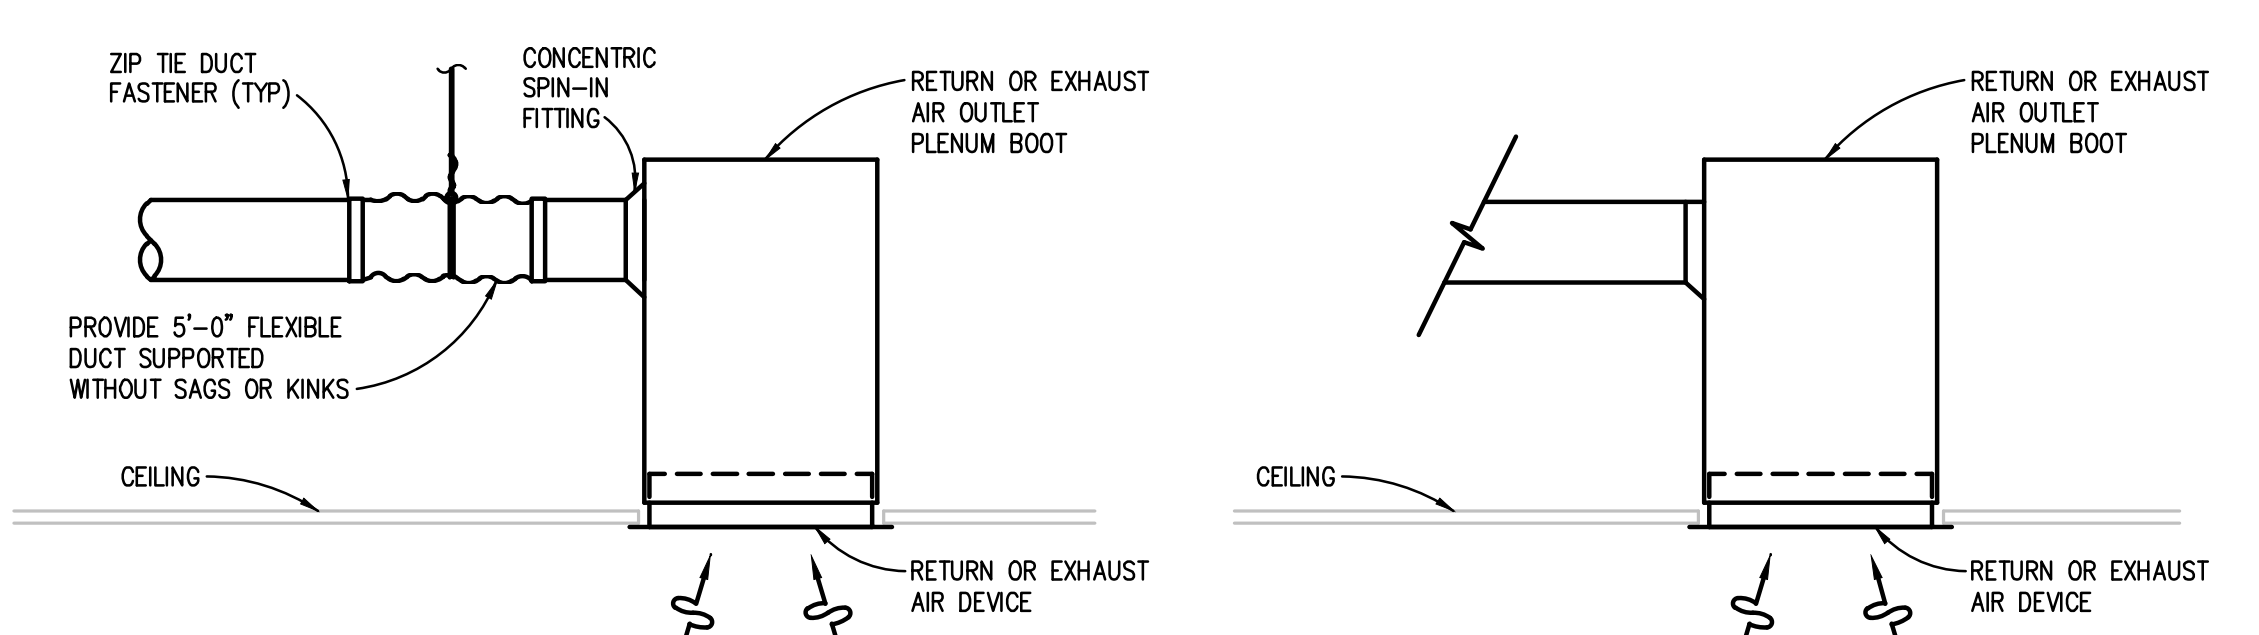



RETURN OR EXHAUST AIR DEVICE INSTALLATION DETAIL

NO SCALE
NOTE: PAINT INTERIOR SURFACE OF PLENUM BOX FLAT BLACK.

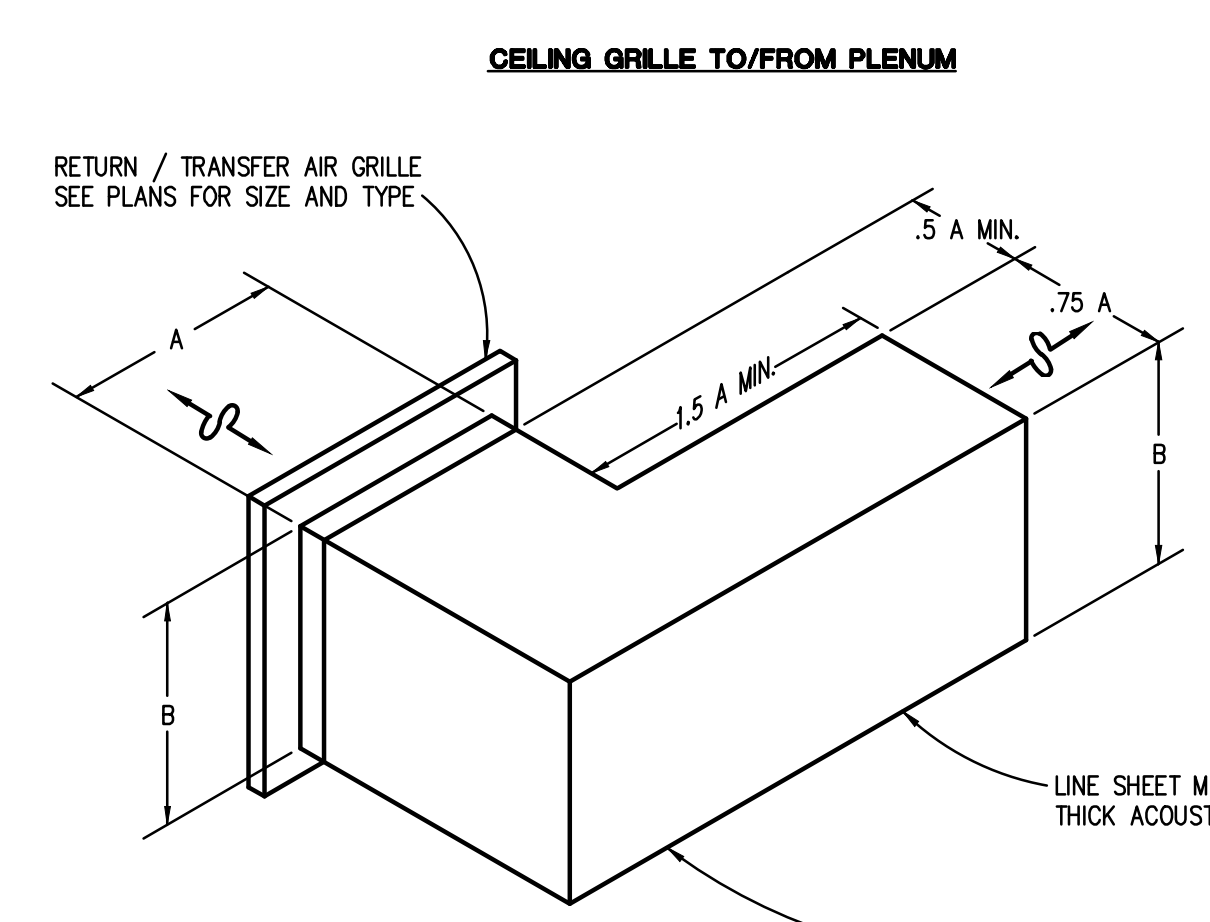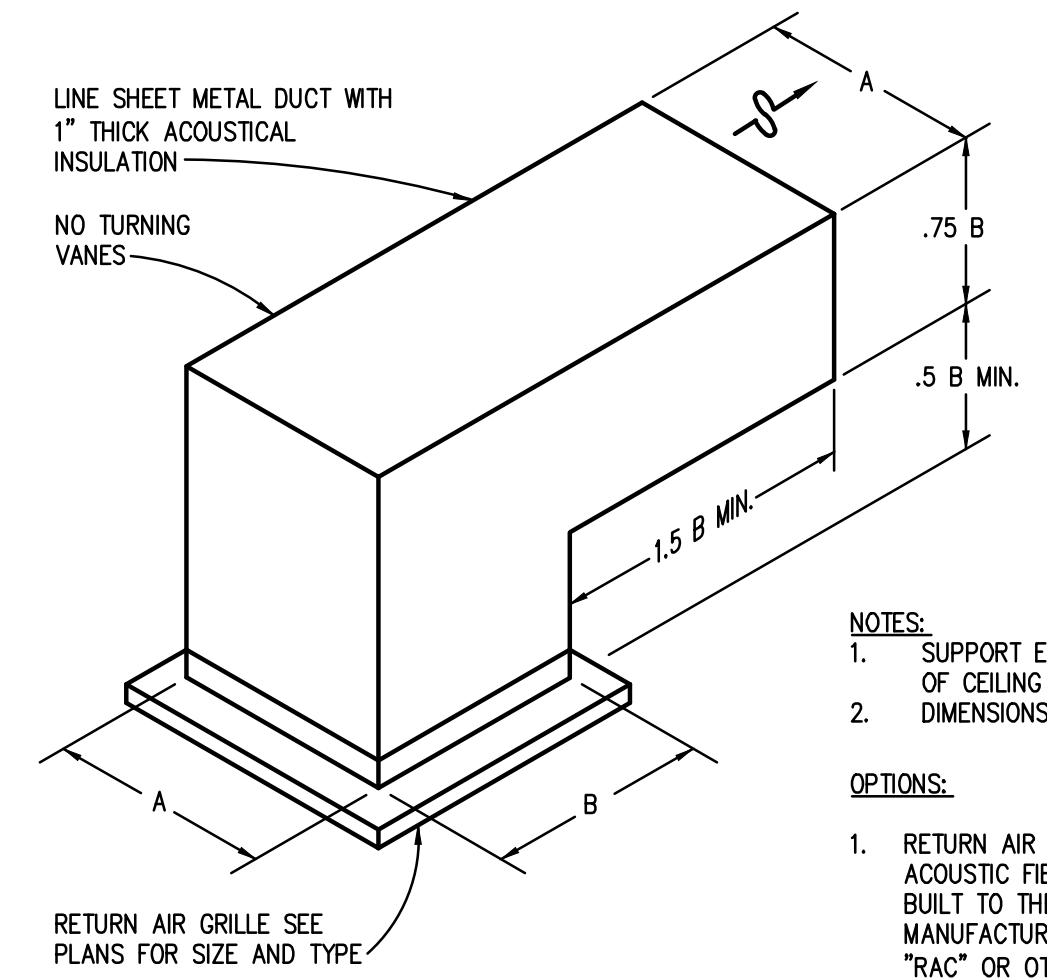


CEILING GRILLE TO/FROM PLENUM

NO SCALE
NOTE: DIMENSIONS ARE INSIDE CLEAR.
OPTION: RIGID FIBER BOARD IN LIEU OF LINED SHEET METAL DUCT.

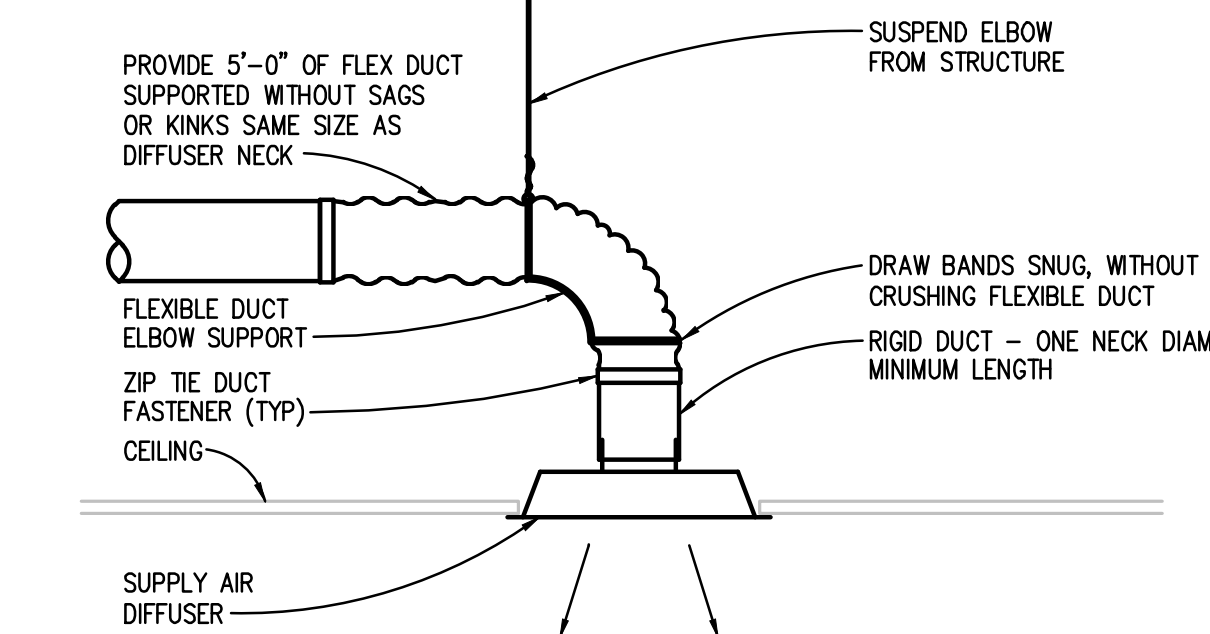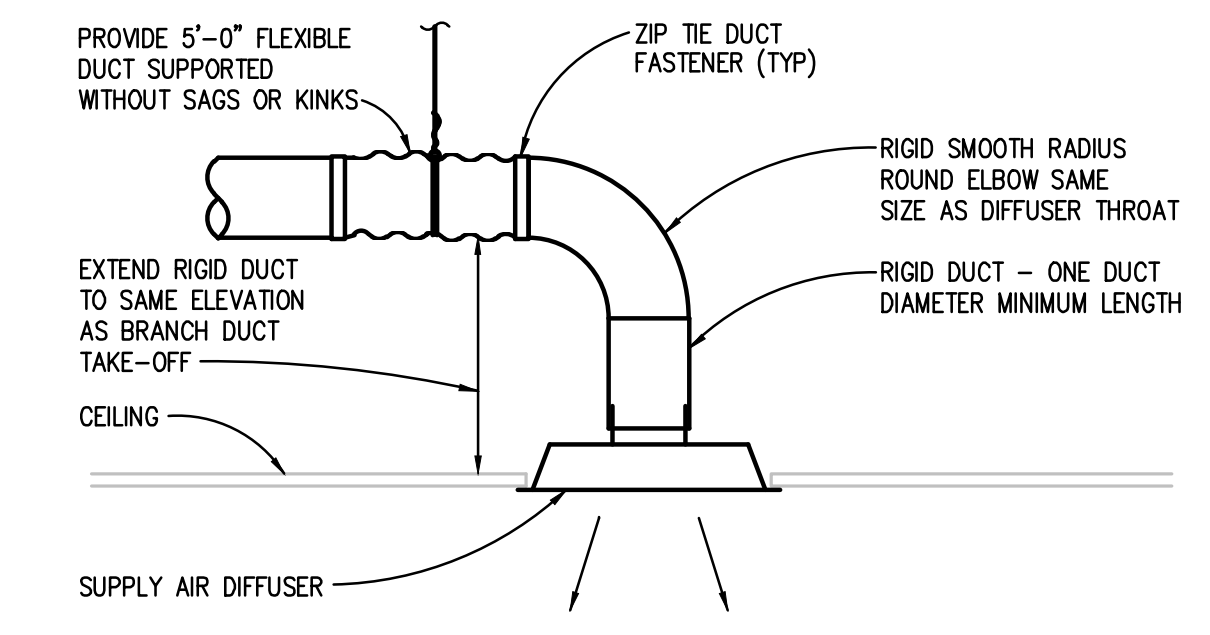


ROUND NECK SUPPLY AIR DIFFUSER DETAIL

NO SCALE

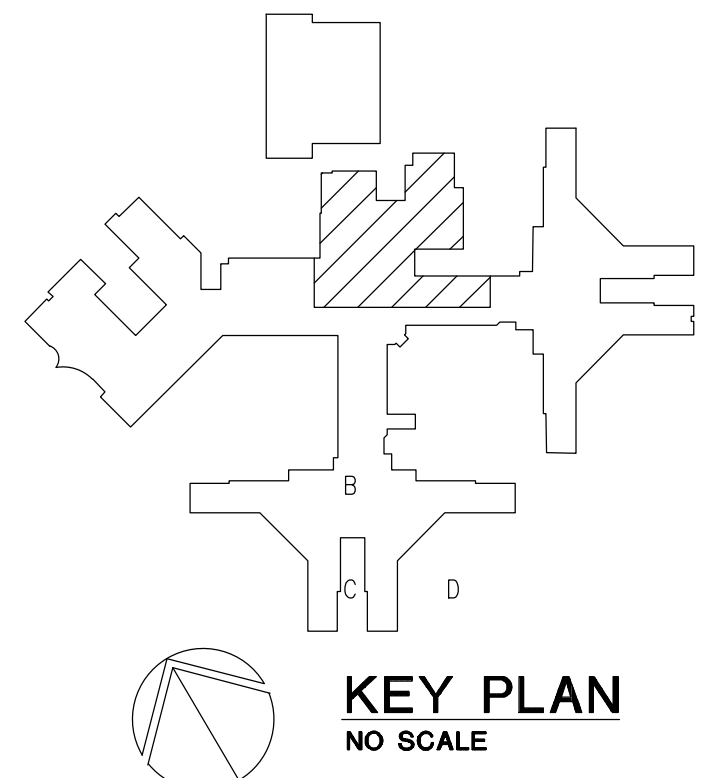


KEY PLAN

NO SCALE

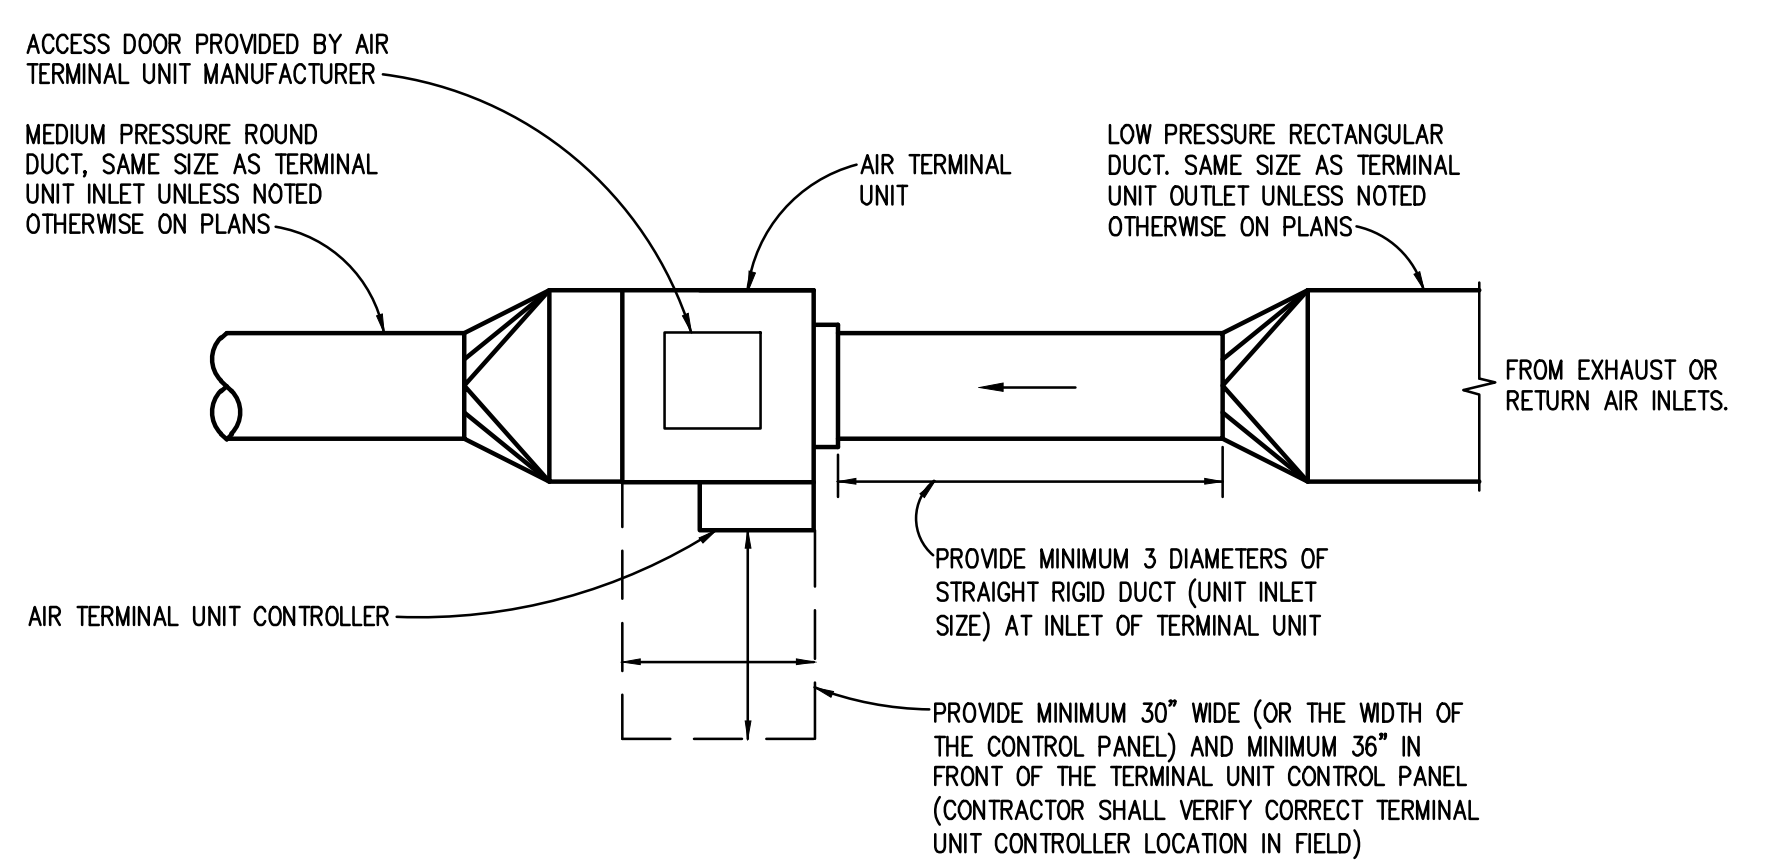


EXHAUST TU CONFIGURATION

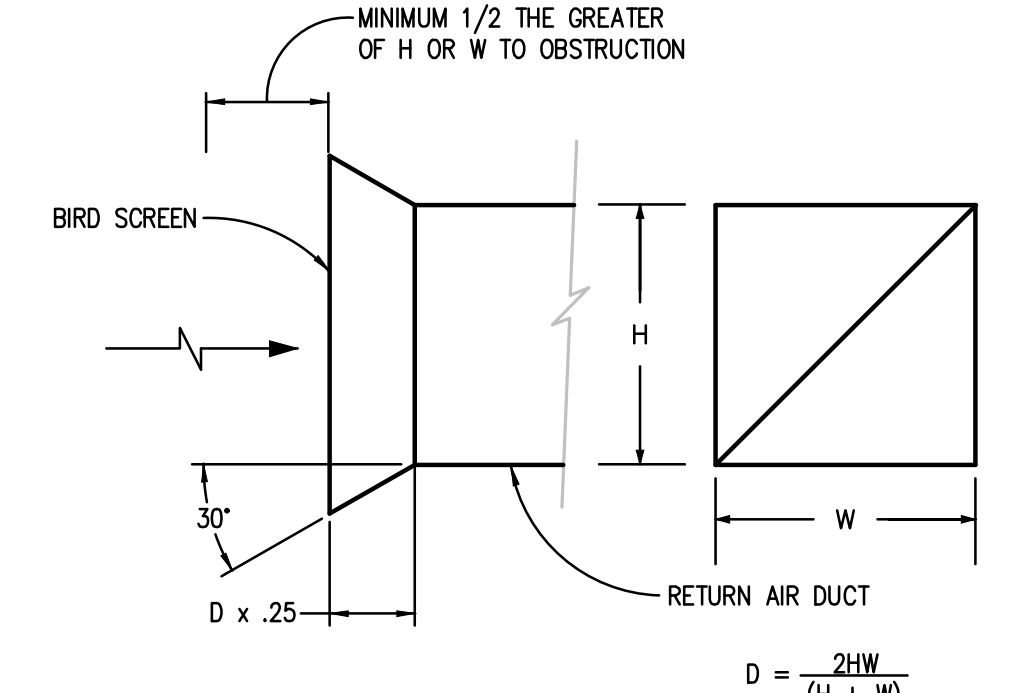


BELLMOUTH DETAIL

NO SCALE

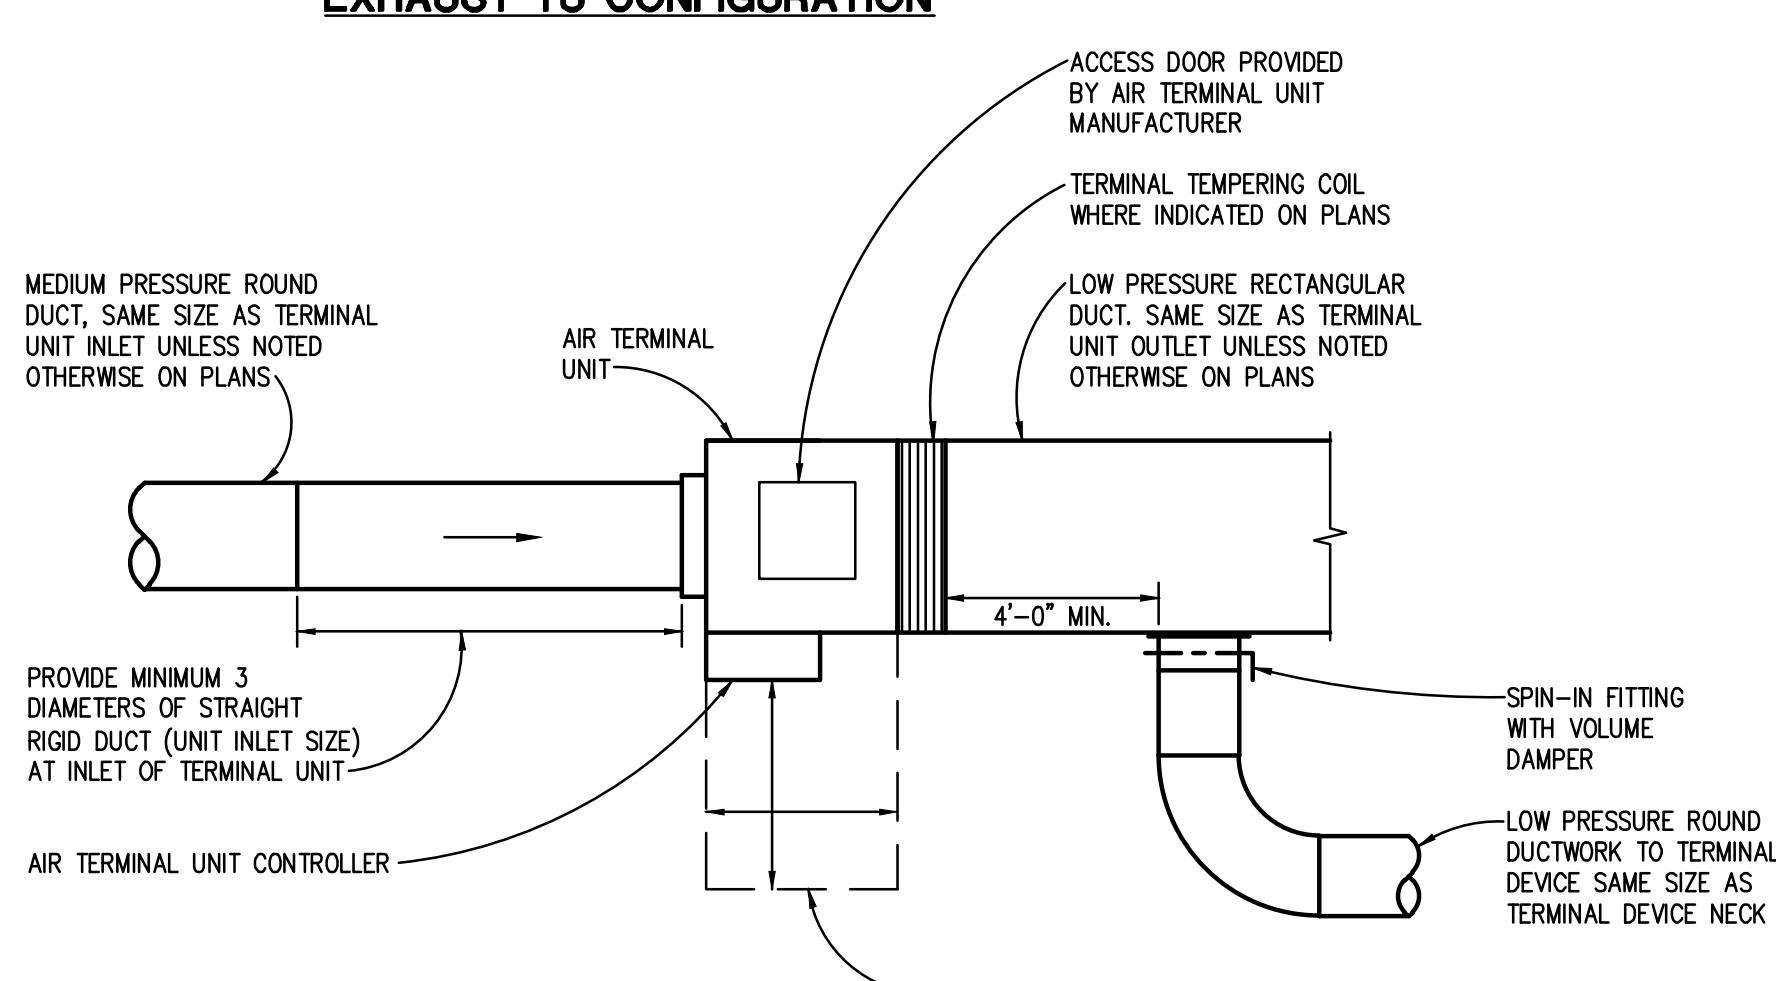


SUPPLY TU CONFIGURATION

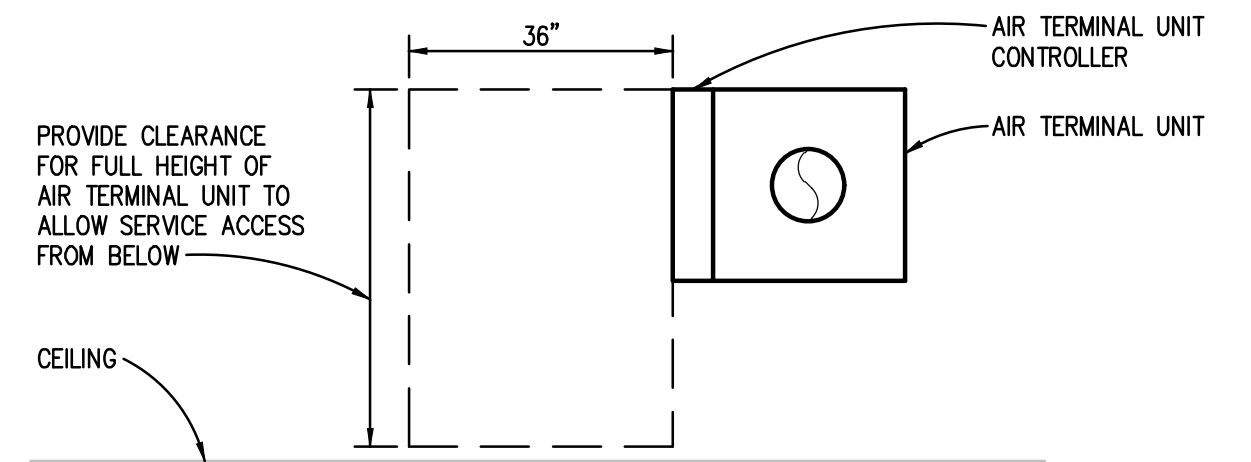

TERMINAL UNIT SECTION


AIR TERMINAL UNIT (TU) DETAIL

NO SCALE

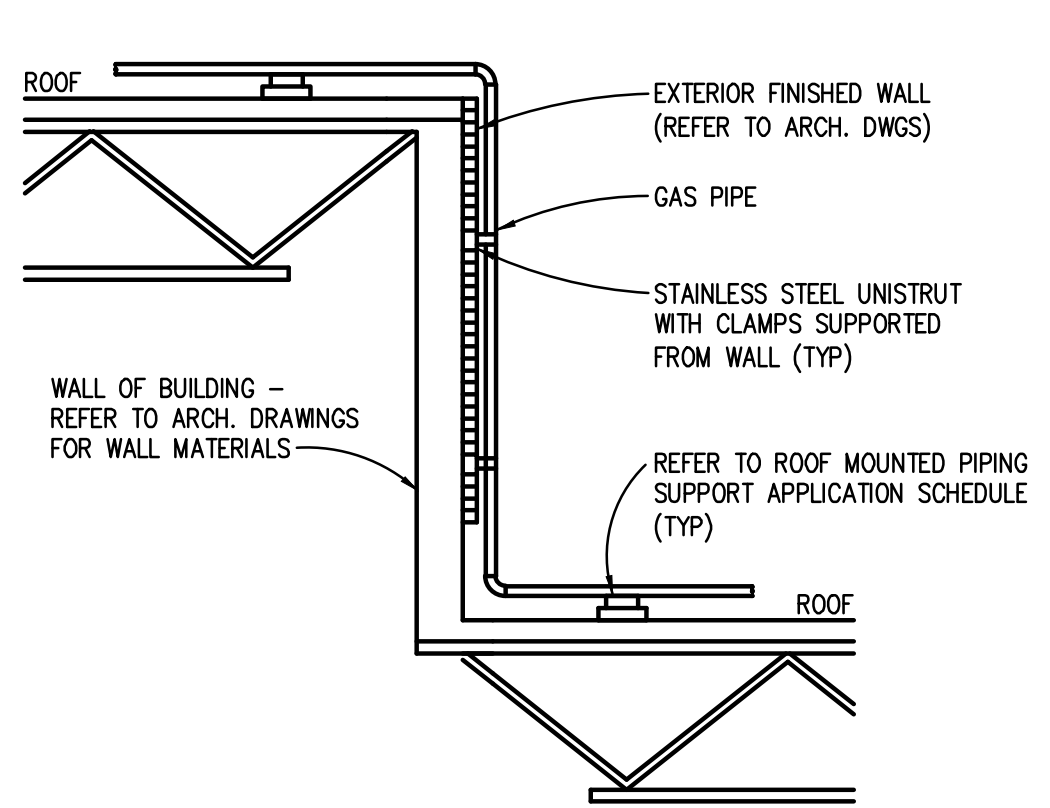


GAS PIPE MOUNTING DETAIL

NO SCALE

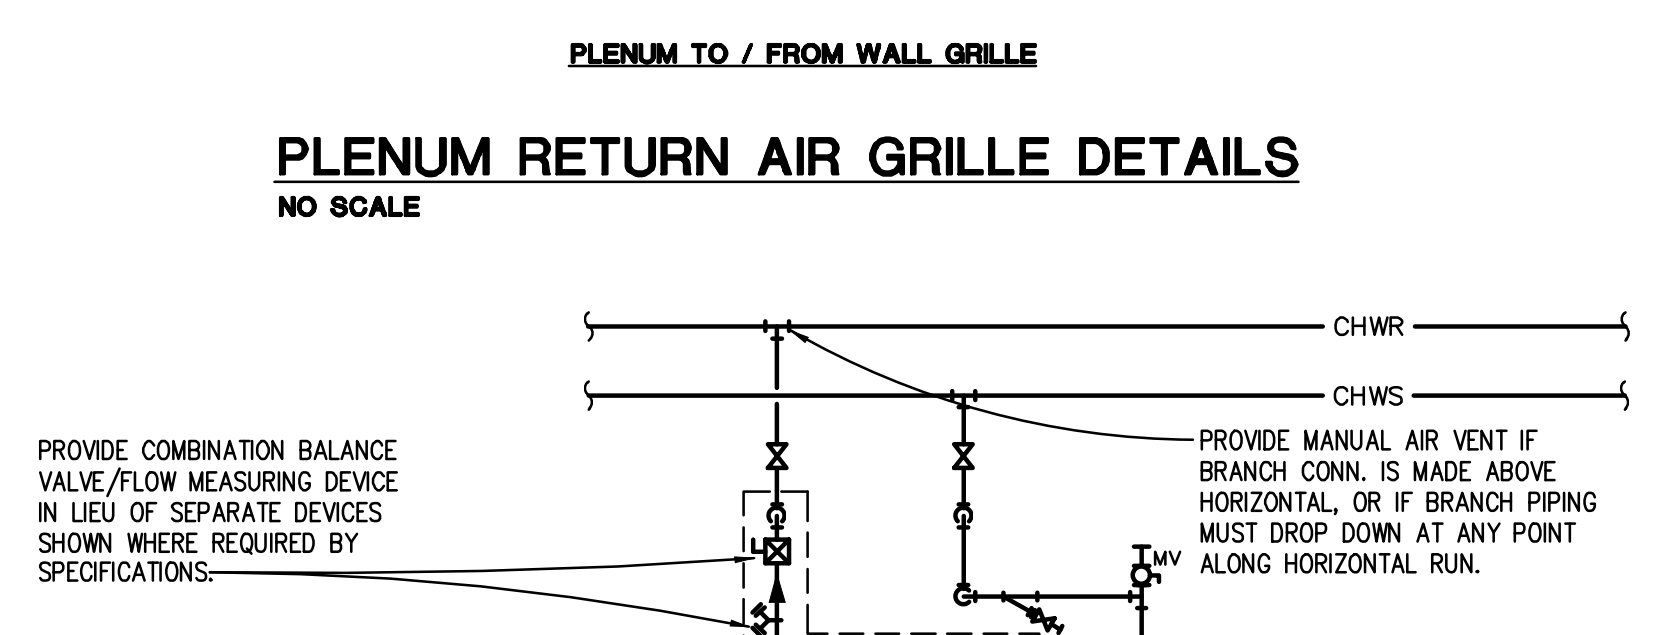


PLENUM RETURN AIR GRILLE DETAILS

NO SCALE

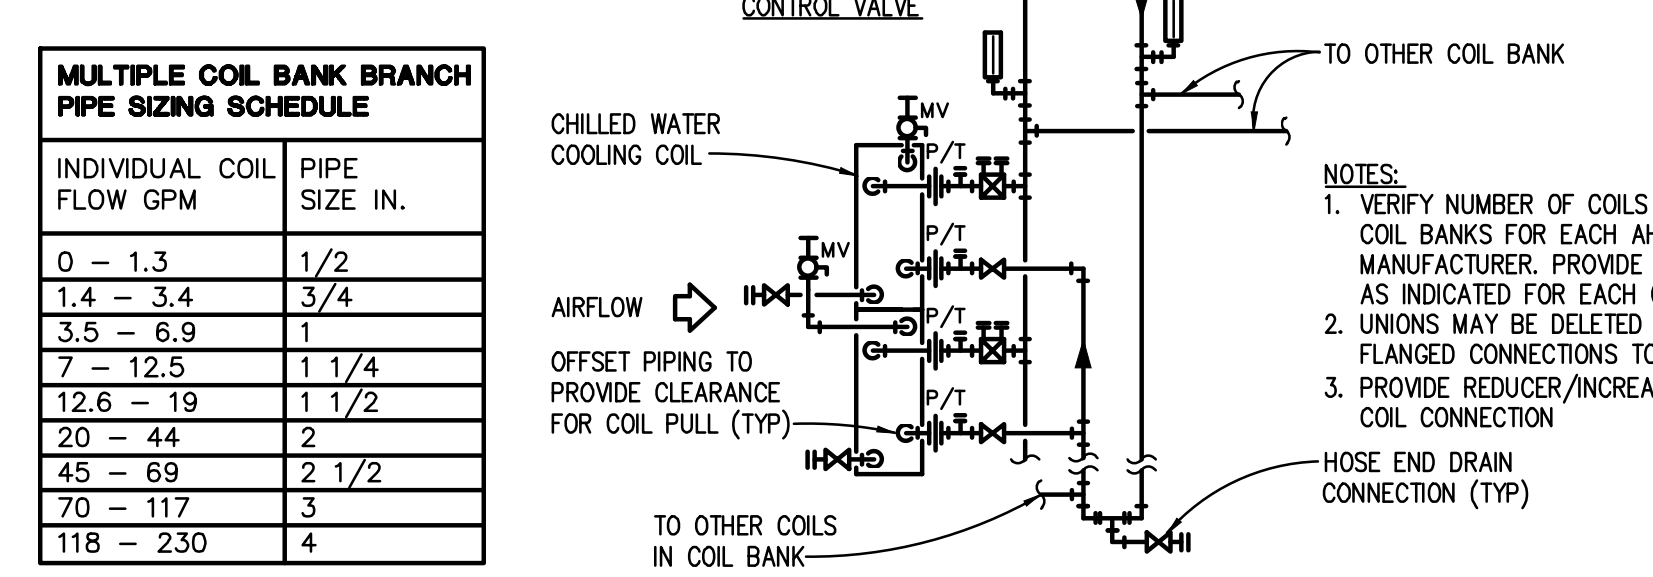


AHU CHILLED WATER COOLING COIL WITH TWO-WAY CONTROL VALVE PIPING DIAGRAM

NO SCALE

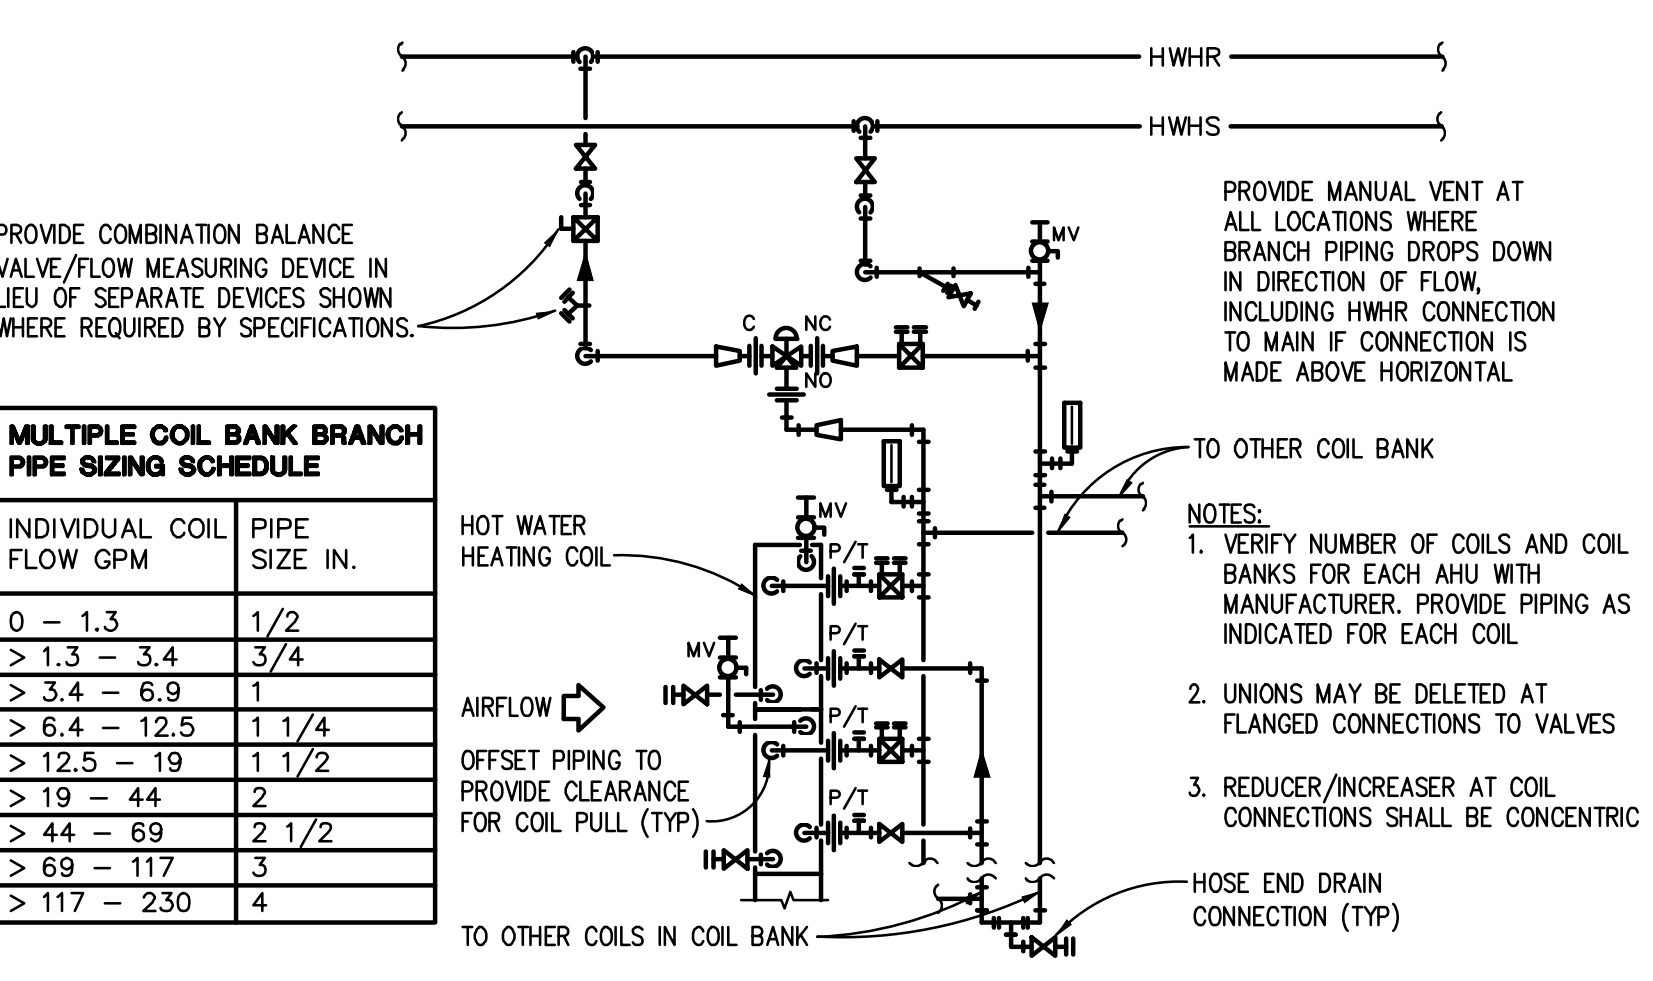


AHU HOT WATER HEATING COIL PIPING DIAGRAM

NO SCALE

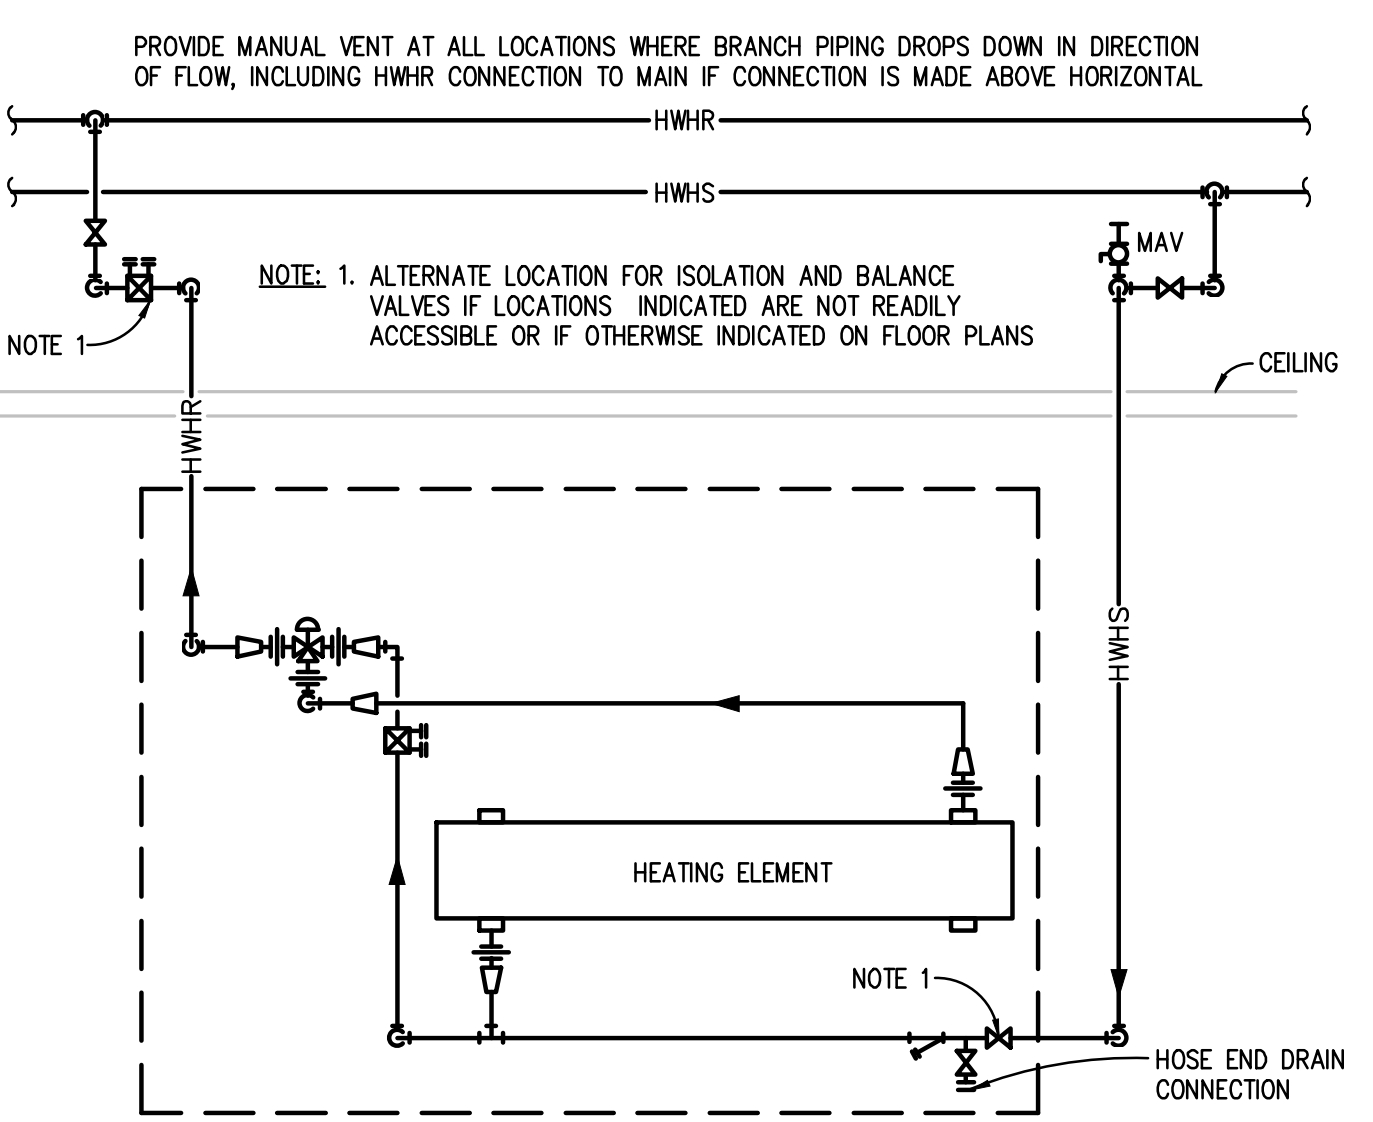

DOWNFEED CONV. OR CUH WITH THREE WAY CONTROL VALVE PIPING DIAGRAM

NO SCALE

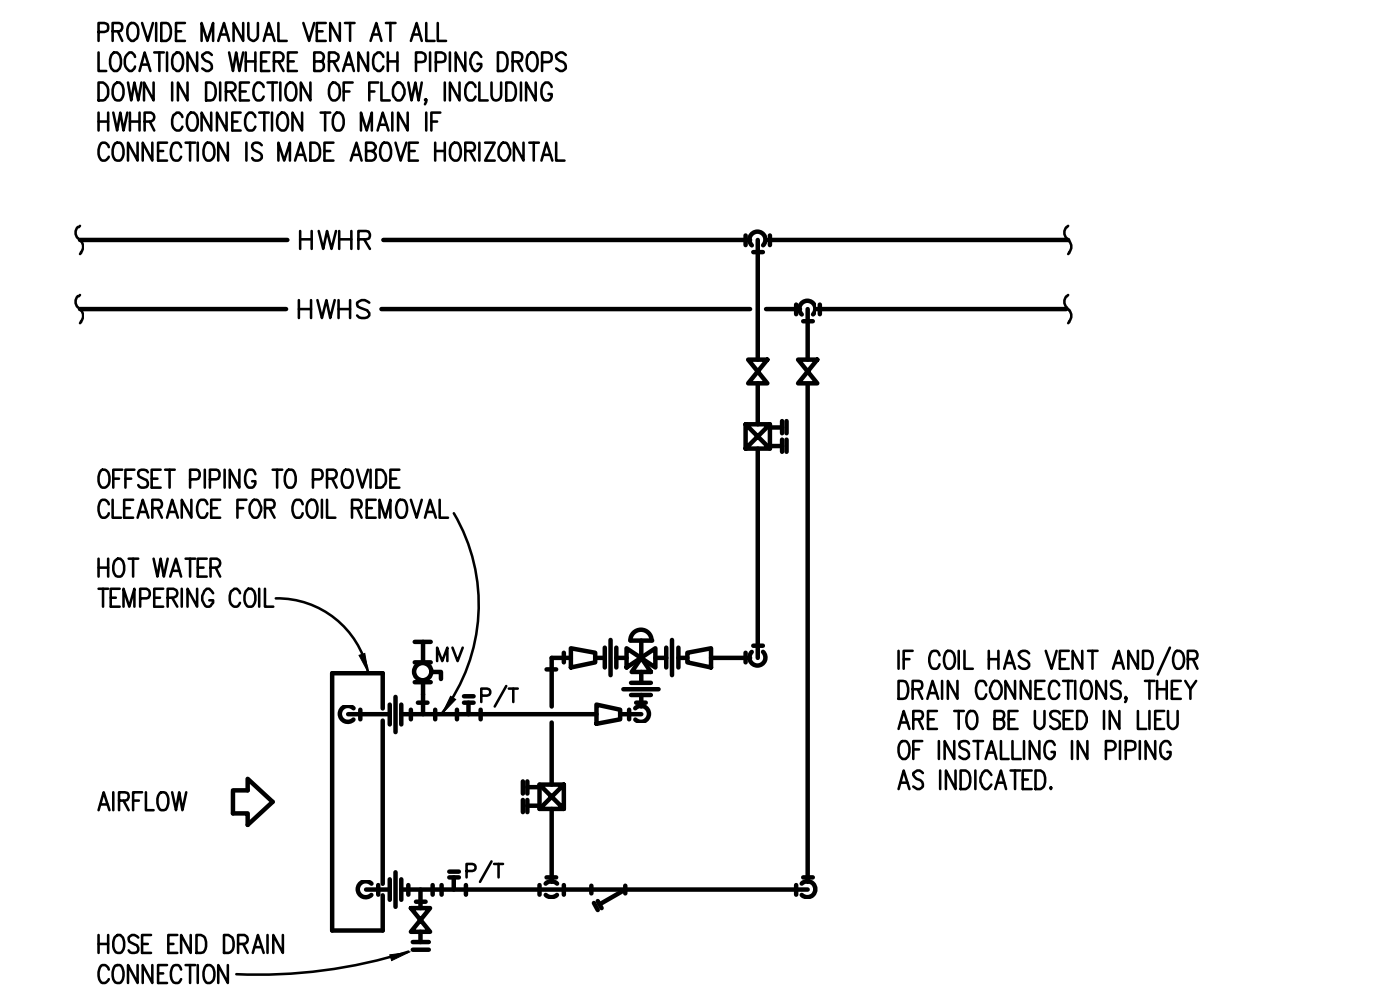

HOT WATER TEMPERING COIL WITH THREE-WAY CONTROL VALVE PIPING DIAGRAM

NO SCALE


NO.	REVISION	DATE
1	OWNER REVIEW	08/02/23

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
49120167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

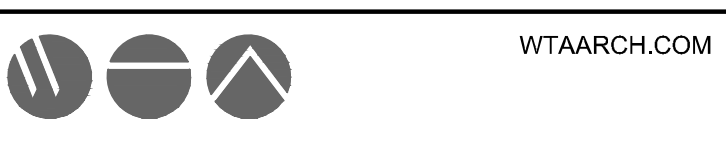

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
49120167.SDW - PHASE 500:

CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN

SALINE, MICHIGAN

SHEET TITLE
MECHANICAL DETAILS

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
AUGUST 23, 2023


M6.03

CHECKED BY
WEK


Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No.: 2023.0002

en:\2021\2021-0402-00\CA0\2021-0402-M6-DT.dwg, M=603, 9/5/2023, 4:32:48 PM, Gerard Henrich, Peter Basso Associates Inc.


THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

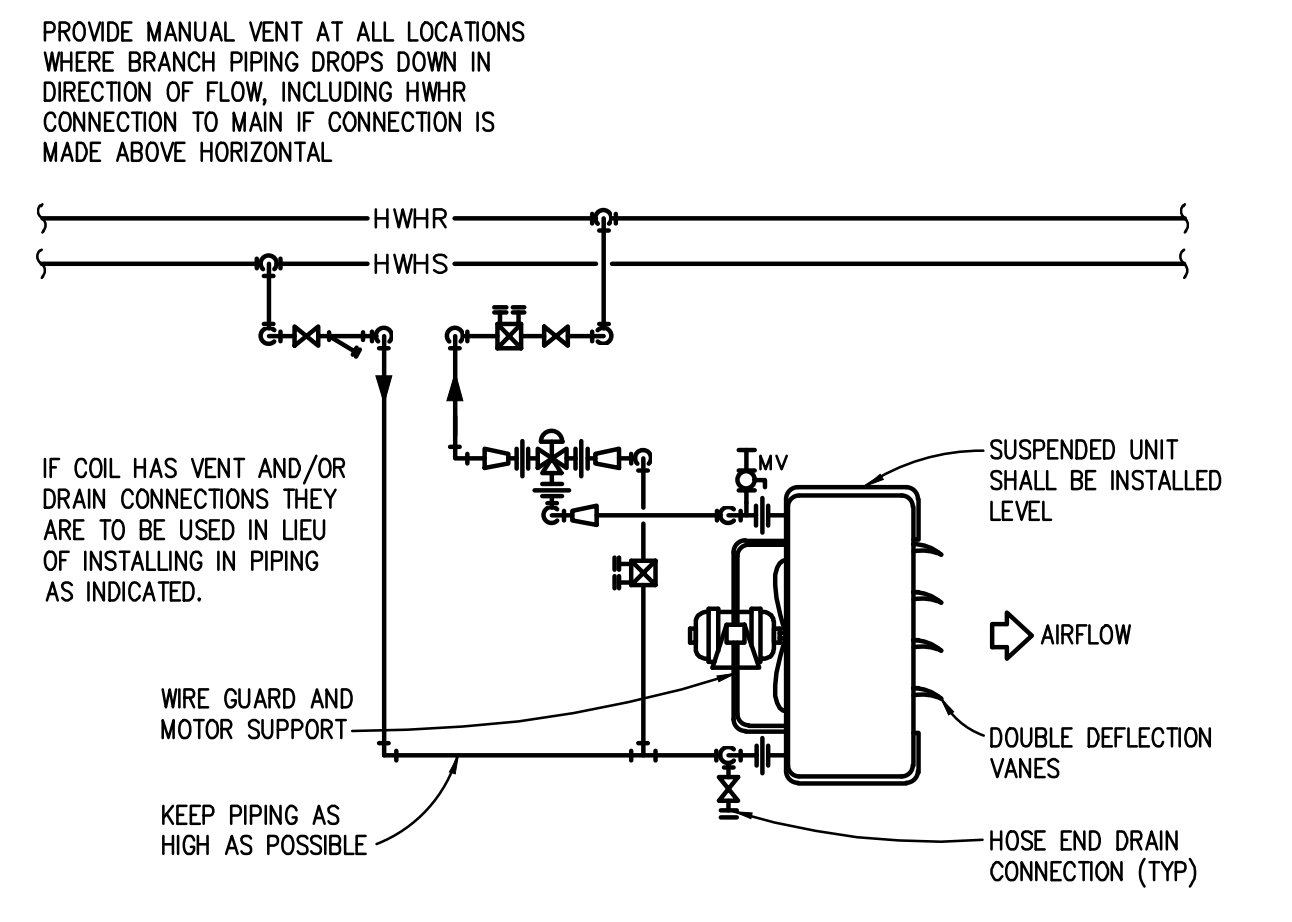


HOT WATER UNIT HEATER WITH THREE-WAY CONTROL VALVE PIPING DIAGRAM
NO SCALE

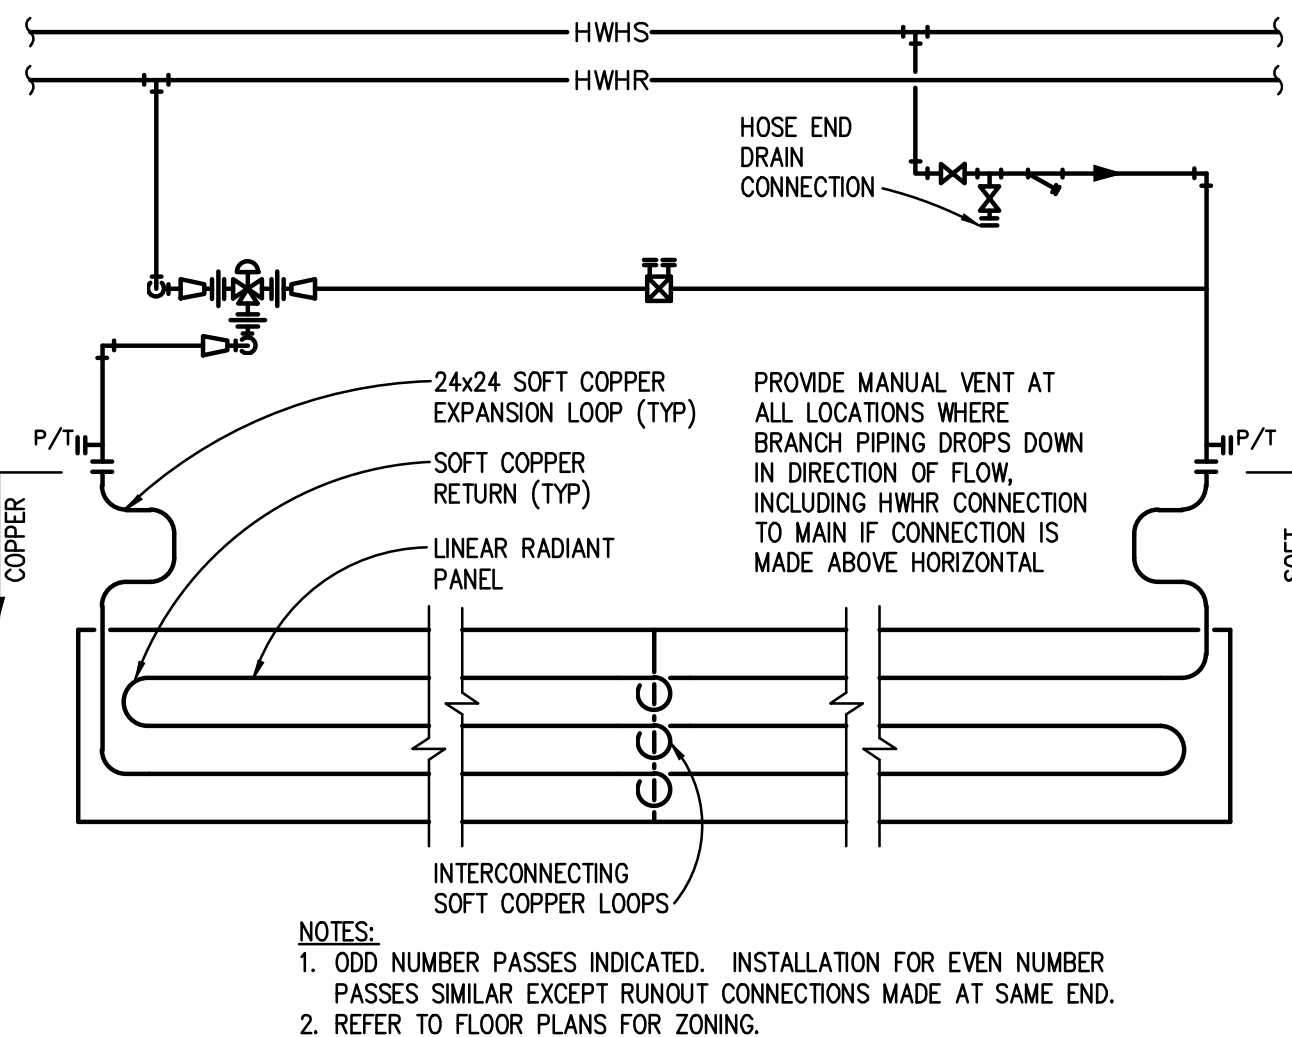


END FEED LINEAR RADIANT CEILING PANEL WITH THREE-WAY CONTROL VALVE PIPING DIAGRAM
NO SCALE

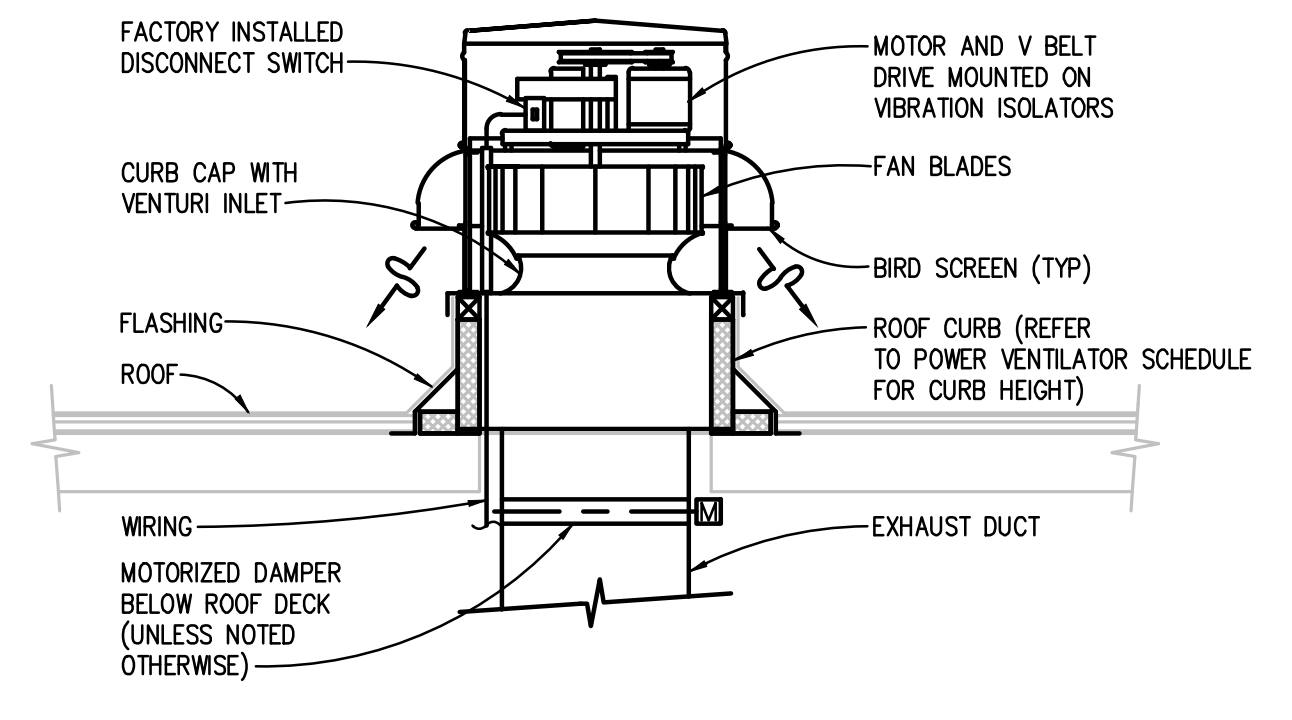


ROOF MOUNTED POWER VENTILATOR EXHAUST FAN DETAIL
NO SCALE

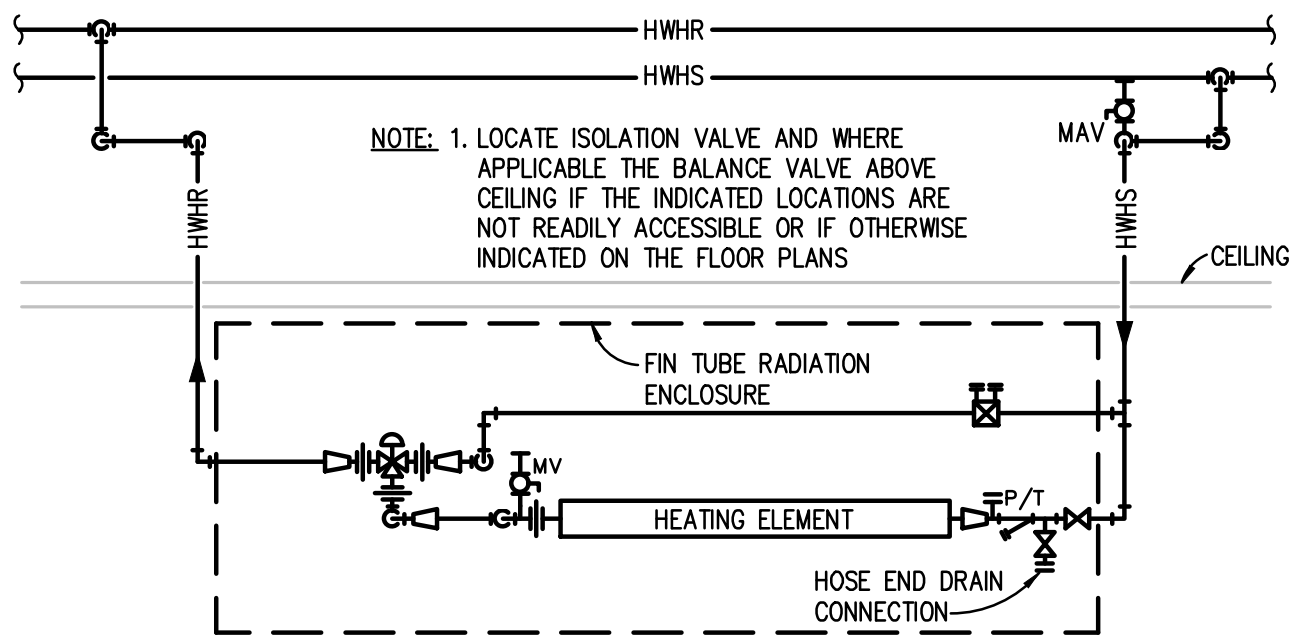


FIN TUBE RADIATION WITH THREE-WAY CONTROL VALVE PIPING DIAGRAM
NO SCALE

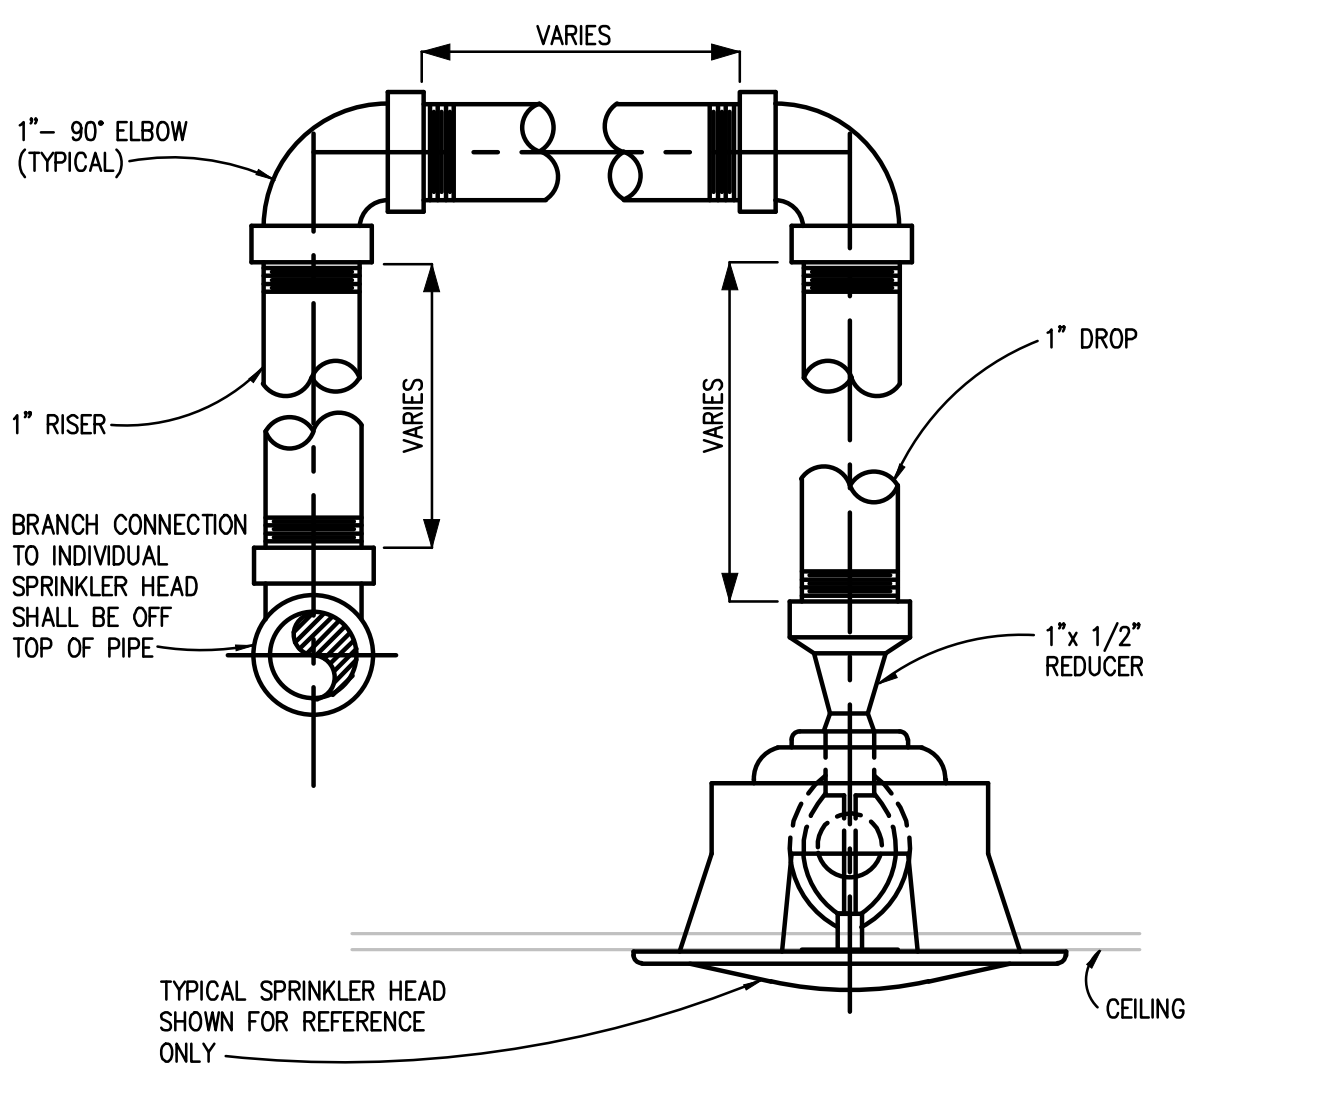

TYPICAL SPRINKLER PIPING DETAIL
NO SCALE

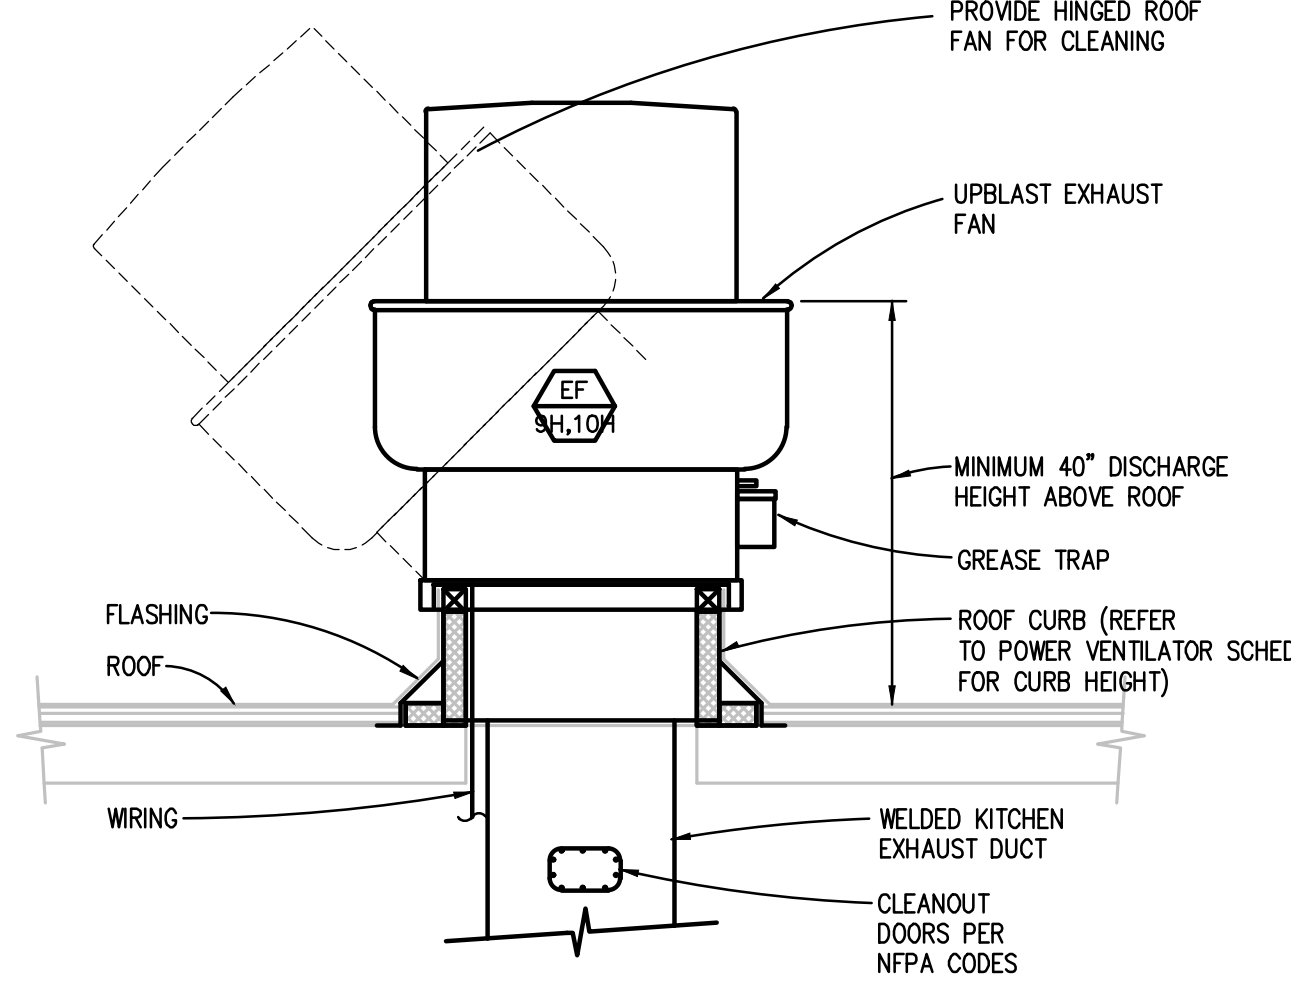

ROOF MOUNTED UPBLAST KITCHEN EXHAUST FAN DETAIL
NO SCALE

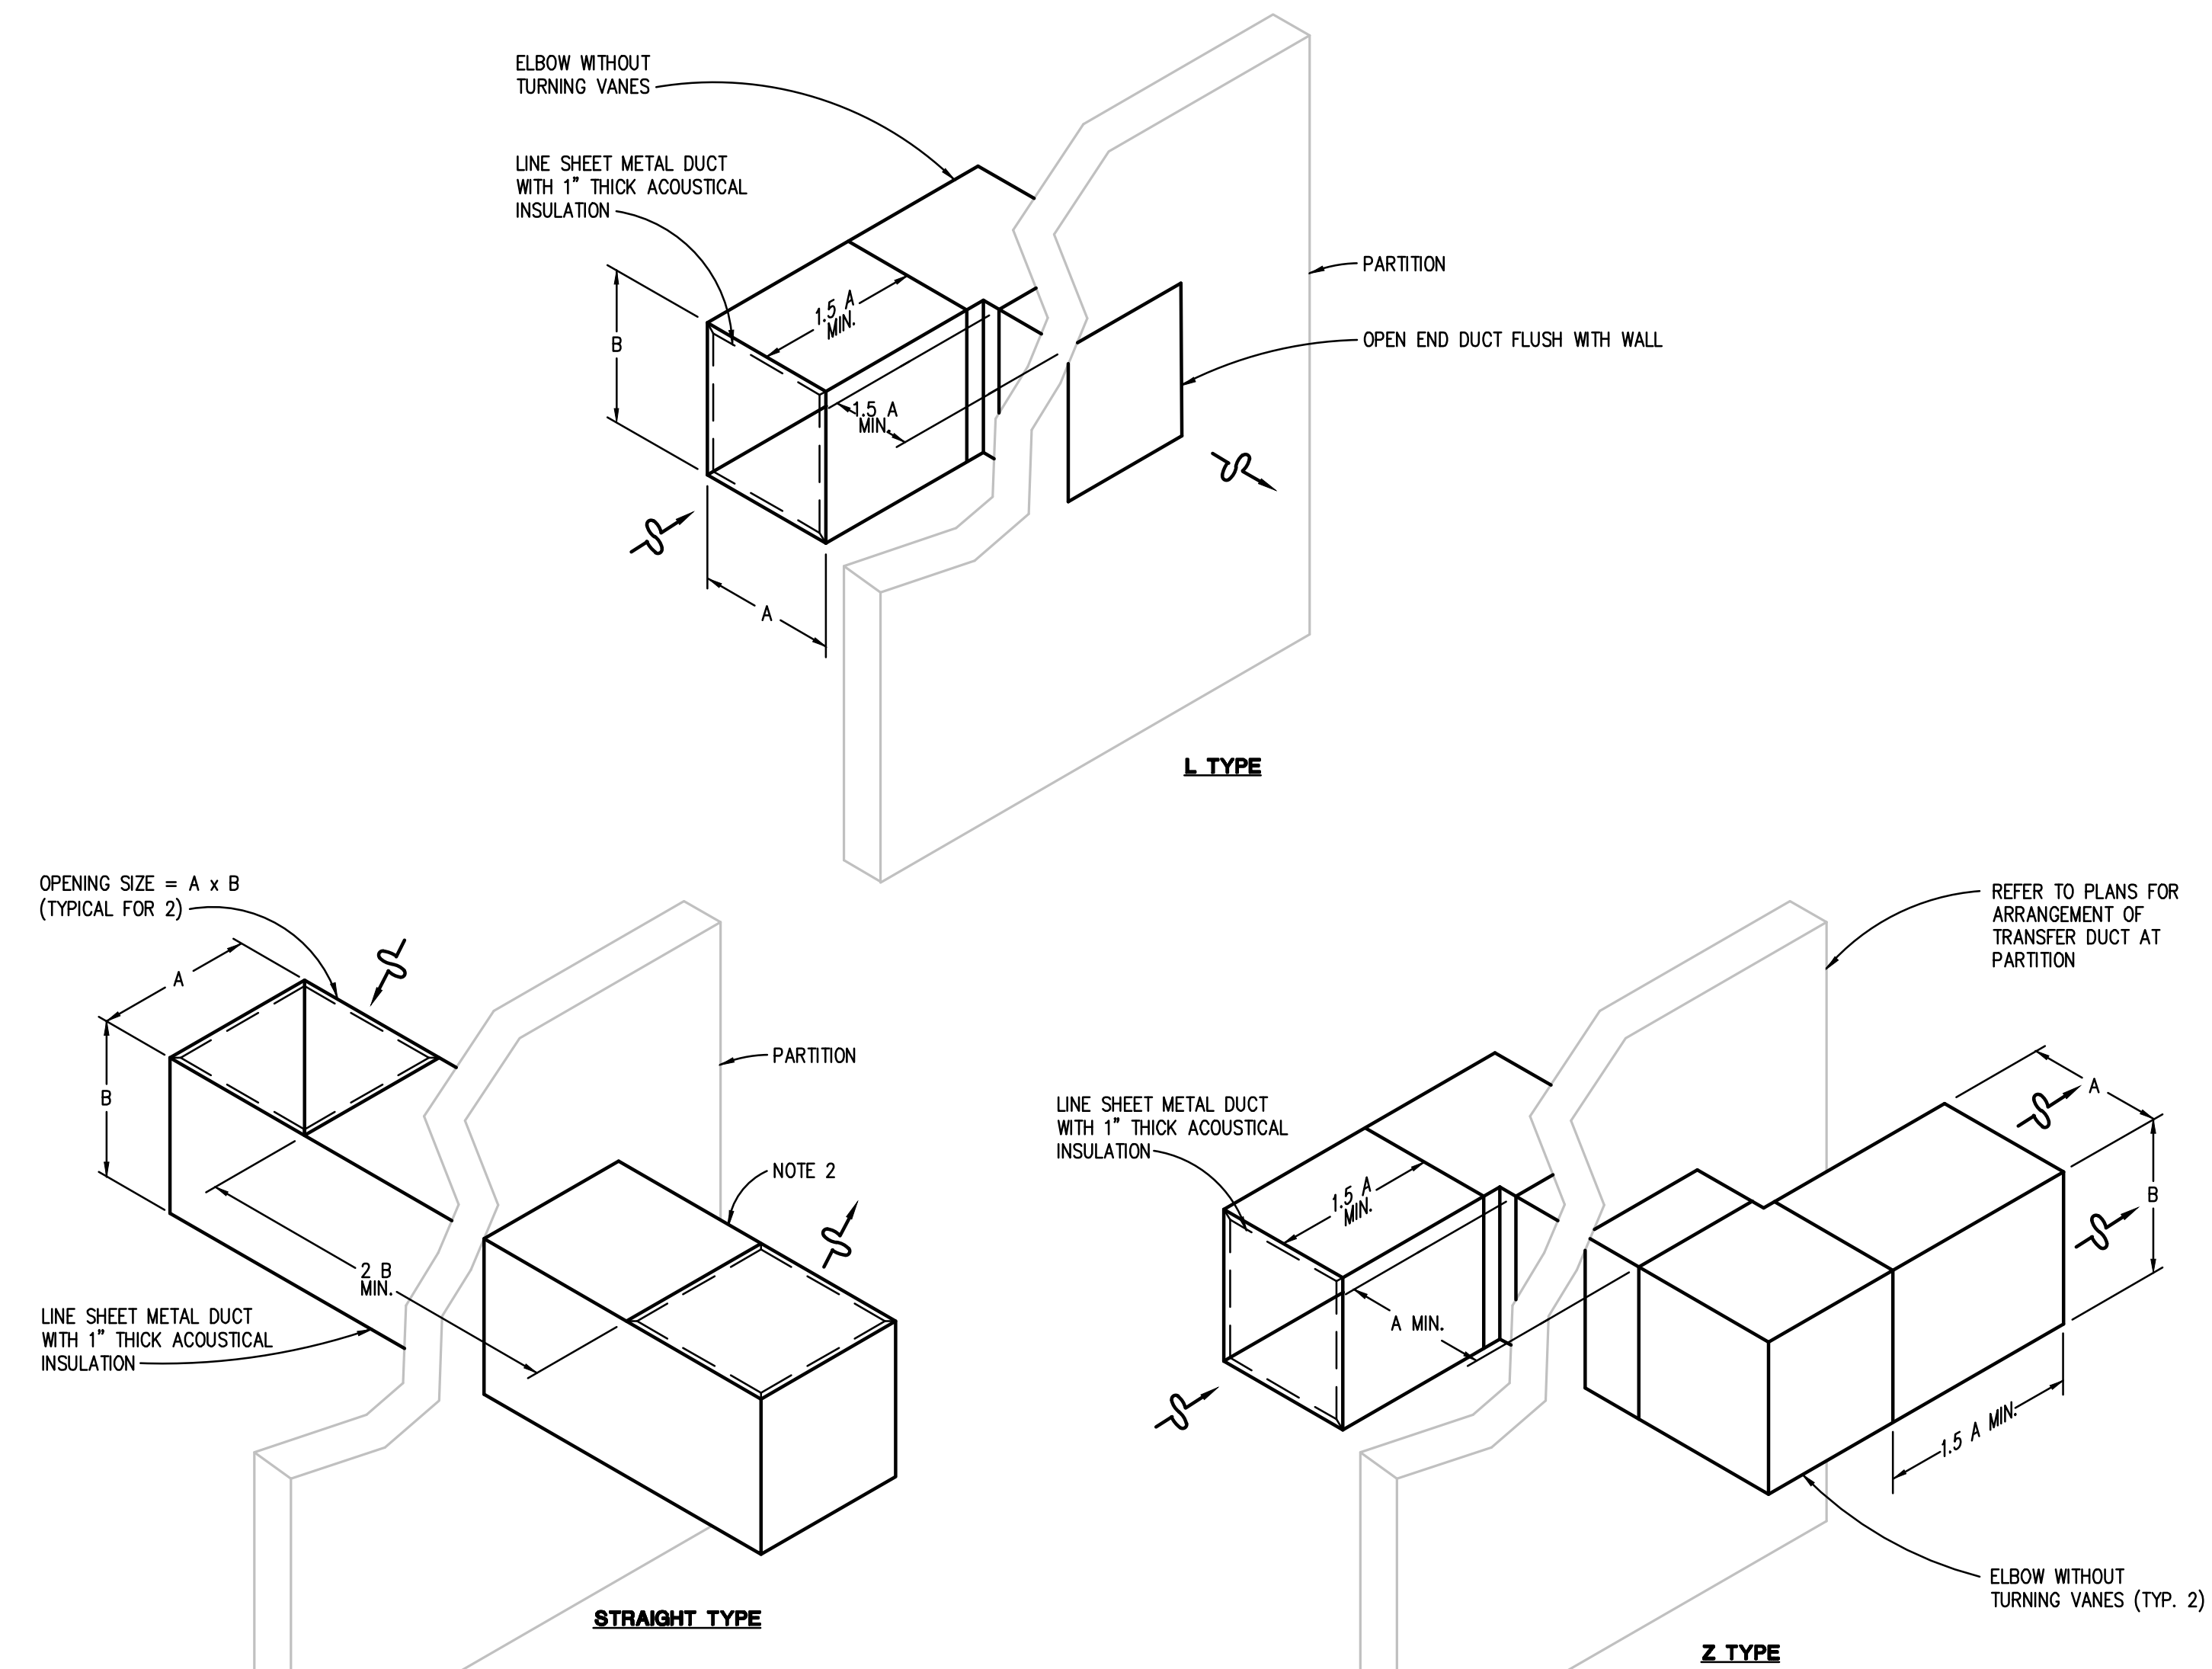


- NOTES:**
- WHERE INDICATED ON DRAWING OR WHERE DISTANCE FROM TOP OF DUCT TO SLAB/DECK IS LESS THAN .5B INSTALL Z TYPE DETAIL.
 - SIZE DUCTS FOR 400 FPM MAX BASED ON CLEAR INSIDE DIMENSIONS AND 100% OF THE SUPPLY AIR TO THE SPACE UNLESS OTHERWISE NOTED.
 - ROTATE DETAILS 90° WHERE VERTICAL INSTALLATION IS INDICATED.
 - DIMENSIONS ARE INSIDE CLEAR.
- OPTIONS:**
- RIGID FIBER BOARD MAY BE USED IN LIEU OF LINED SHEET METAL DUCT.

AIR TRANSFER DUCT DETAILS
NO SCALE


TRAP DIMENSION TABLE

TYPE OF SYSTEM	S.P. AT DRAIN PAN (IN.) (NOTE A)	DIMENSION "A" (INCHES) MIN.	DIMENSION "B" (INCHES)	DIMENSION "C" (INCHES) (TRAP SEAL)	DIMENSION "D" (INCHES)	DIMENSION "E" (INCHES)	DIMENSION "F" (INCHES)			
							DRAIN PIPE SIZE (INCHES)			
							1 1/2	2	2 1/2	3
DRAW THROUGH	-5.1 TO -6	5.0	5.0	2	6	2	13.0	14.0	15.0	16.0
	-4.1 TO -5	4.5	4.5	2	5	2	12.0	13.0	14.0	15.0
	-3.1 TO -4	4.0	4.0	2	4	2	11.0	12.0	13.0	14.0
	-2.1 TO -3	3.5	3.5	2	3	2	10.0	11.0	12.0	13.0
BLOW THROUGH	UP TO -2	3.0	3.0	2	2	2	9.0	10.0	11.0	12.0
	UP TO +2	4.0	2.0	2	2	4	9.0	10.0	11.0	12.0
	+2.1 TO +3	5.0	2.0	2	3	5	10.0	11.0	12.0	13.0
	+3.1 TO +4	6.0	2.0	2	4	6	11.0	12.0	13.0	14.0
	+4.1 TO +5	7.0	2.0	2	5	7	12.0	13.0	14.0	15.0
	+5.1 TO +6	8.0	2.0	2	6	8	13.0	14.0	15.0	16.0

- NOTES:**
- REFER TO AIR HANDLING UNIT SCHEDULE FOR (-) OR (+) STATIC PRESSURE AT DRAIN PAN.
 - DIMENSION "C" IS MIN: 3" FOR UP TO 1 1/2" DRAIN PIPE
4" FOR 2" DRAIN PIPE
5" FOR 2 1/2" OR 3" DRAIN PIPE
6" FOR 4" DRAIN PIPE

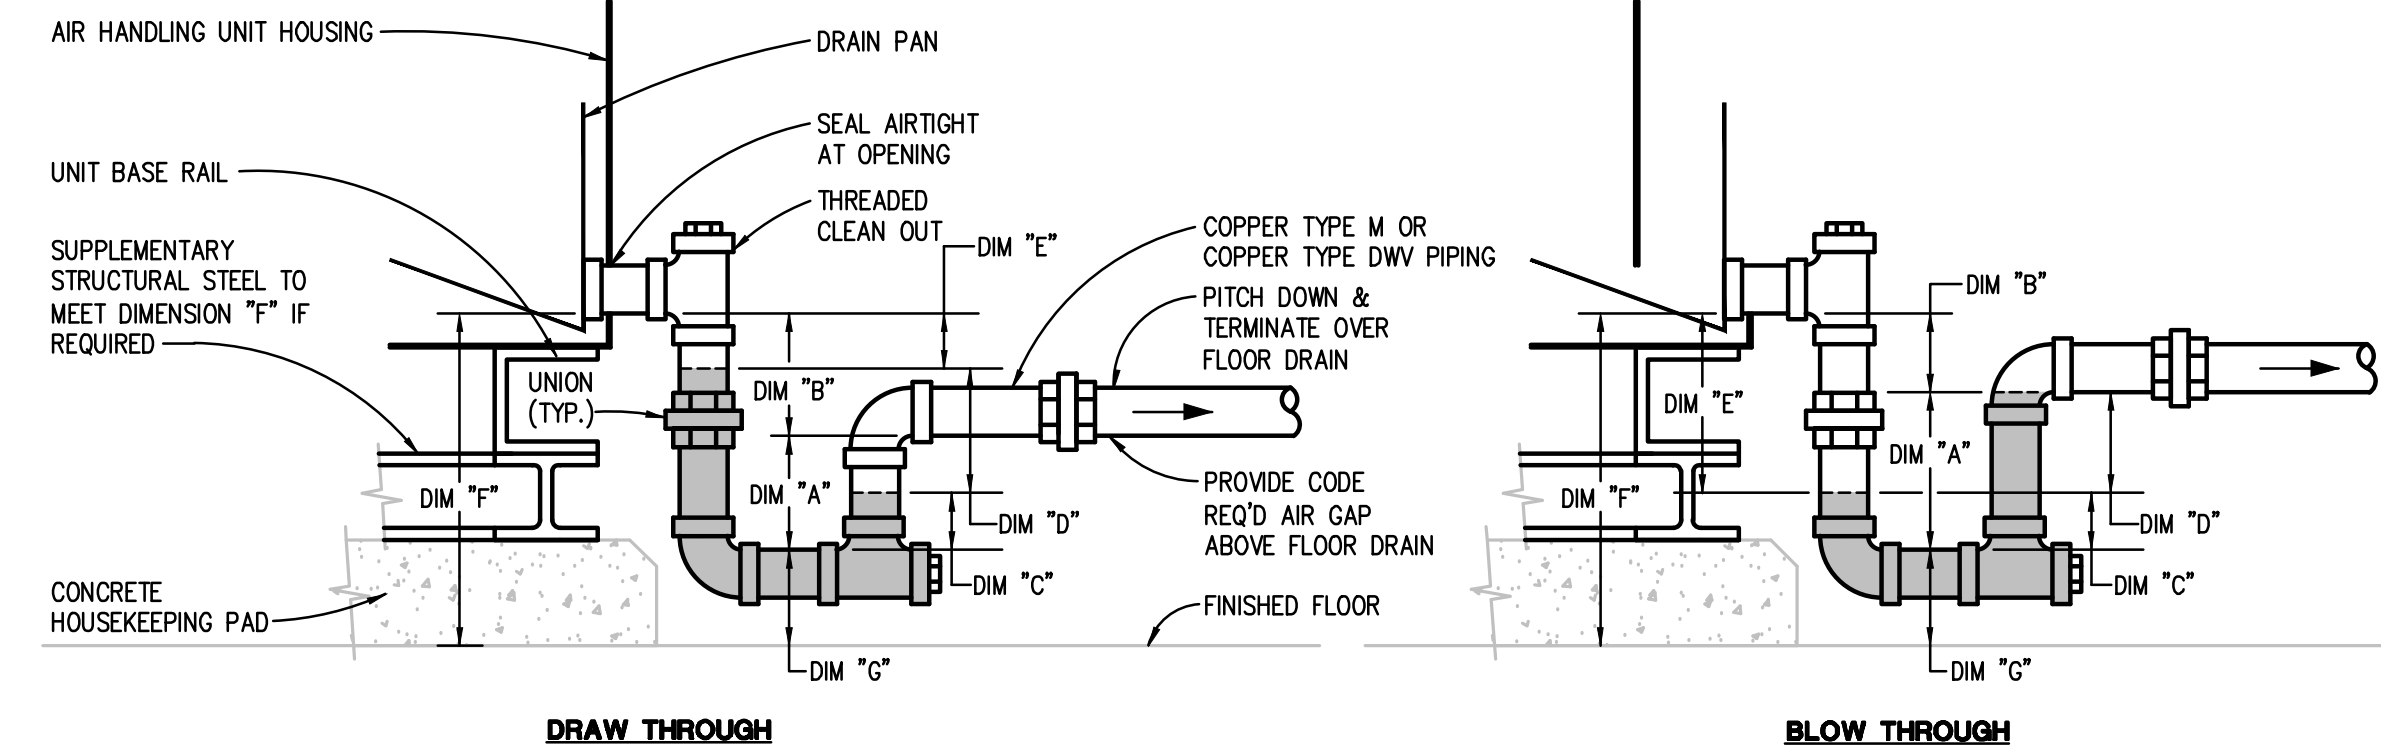

INDOOR AIR HANDLING UNIT CONDENSATE DRAIN PAN TRAP DETAIL
NO SCALE

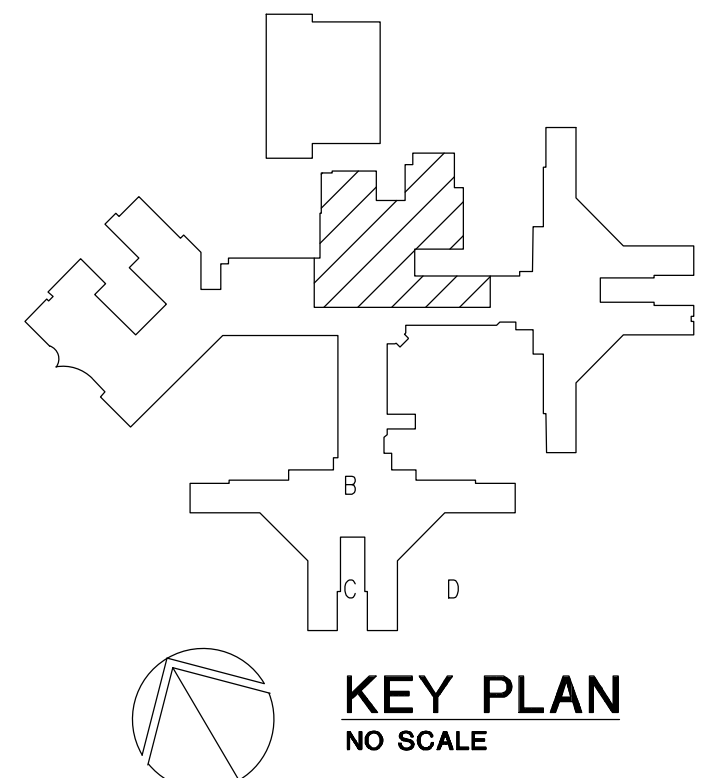

KEY PLAN
NO SCALE

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACHT, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHST255

CONTRACT NO.
Y22003

WTAARCH.COM
WTA ARCHITECTS
100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
MECHANICAL DETAILS

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
AUGUST 23, 2023

M6.04

CHECKED BY
WEK

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2021094

en:\2021\2021-0402-00\CA0\2021-0402-M6-DT.dwg, M-604, 9/5/2023 4:32:49 PM, Gerard Henrich, Peter Basso Associates Inc.

ABOVEGROUND HVAC PIPE & ACCESSORY INSULATION APPLICATION SCHEDULE														
	INSULATION MATERIAL & THICKNESS (INCHES)				FIELD-APPLIED JACKET MATERIAL									
	FLEXIBLE ELASTOMERIC	FIBERGLASS	MINERAL WOOL	POLYISOCYANURATE	PHENOLIC	CELLULAR GLASS	CALCIUM SILICATE	ALUMINUM	STAINLESS STEEL	PVC	SELF-ADHESIVE (FOR OUTDOOR APPLICATIONS)	PVC (INDOOR)	PVC (OUTDOOR)	KEYED NOTES
INDOOR PIPE SYSTEM AND SIZE (INCHES)														
CHILLED WATER & BRINE BELOW 40 DEG F:														
NPS 6 AND SMALLER			1					X	X					A
NPS 8 AND LARGER			1.5					X	X					A
CHILLED WATER & BRINE 40 DEG F TO 60 DEG F:														
NPS 1-1/2 AND LARGER	1	1						X	X					A
HEATING HOT WATER SUPPLY & RETURN 200 DEG F AND LOWER:														
NPS 1-1/4 AND SMALLER			1.5					X	X					A
NPS 1-1/2 AND LARGER			2					X	X					A
LOW PRESS. STEAM, CONDENSATE & PUMPED CONDENSATE:														
NPS 1-1/4 AND SMALLER			2.5	2.5				X	X					A
NPS 1-1/2 AND LARGER			3	3				X	X					A
MED. & HIGH PRESS. STEAM, CONDENSATE & PUMPED CONDENSATE:														
NPS 3/4 AND SMALLER			3	3				X	X					A
NPS 1 TO 1-1/4			4	4				X	X					A
NPS 1-1/2 AND LARGER			4.5	4.5				X	X					A
REFRIGERANT SUCTION & HOT GAS (RIGID COPPER)														
NPS 6 AND SMALLER			1	1				X	X					
NPS 8 AND LARGER			1.5	1.5				X	X					
REFRIGERANT SUCTION & HOT GAS (SOFT COPPER)														
			1					X	X					

UNLESS OTHERWISE INDICATED OR SCHEDULED, THE FOLLOWING DO NOT REQUIRE INSULATION:
 DIRECT BURIED COOLING SYSTEM PIPING
 PIPING THAT CONVEYS FLUIDS HAVING DESIGN OPERATING TEMPERATURE RANGE BETWEEN 60 DEG F. AND 105 DEG F., INCLUSIVE.

GENERAL NOTES

- "X" OR THICKNESS IN INCHES INDICATES ACCEPTABLE SELECTION. IF MORE THAN ONE SELECTION IS INDICATED, CONTRACTOR MAY SELECT FROM THOSE INDICATED SELECTIONS.
- INSULATE PIPING WITHIN AIR HANDLING EQUIPMENT THE SAME AS INDOOR PIPING. PROVIDE ALUMINUM OR STAINLESS STEEL JACKET.
- FOR PIPING NPS 1-1/4 AND SMALLER WITHIN PARTITIONS IN CONDITIONED SPACES INSULATION MAY BE REDUCED BY ONE-INCH THICKNESS, BUT NOT TO LESS THAN ONE-INCH THICKNESS.
- FOR PIPING NPS 1 AND SMALLER, INSULATION IS NOT REQUIRED FOR STRAINERS, CONTROL VALVES, AND BALANCING VALVES.

KEYED NOTES

- PROVIDE FIELD APPLIED JACKET FOR PIPING EXPOSED IN EQUIPMENT ROOMS, STORAGE ROOMS, JANITORS CLOSETS, RECEIVING ROOMS, TEST AREAS, CIRCULATION AREAS AND SUCH AREAS SUBJECT TO DAMAGE, WITHIN 10 FEET (3 METERS) OF FINISHED FLOOR.
- PROVIDE MANUFACTURER'S RECOMMENDED PROTECTIVE COATING FOR FLEXIBLE ELASTOMERIC THERMAL INSULATION.
- STEAM AND CONDENSATE PIPING JACKET SHALL BE STUCCO EMBOSSED.
- PIPING WITHIN ENERGY RECOVERY UNITS SHALL BE TYPE 304 STAINLESS STEEL, SMOOTH; 0.010 INCH THICK. SEAMS AND JOINTS CAULKED WITH CHEMICALLY RESISTANT SEALER.

DUCT SYSTEM INSULATION APPLICATION SCHEDULE											
	INSULATION MATERIAL & THICKNESS (INCHES)								FIELD APPLIED JACKET MATERIAL		
	FIBERGLASS BLANKET 0.75 LB/QU FT	FIBERGLASS BLANKET 1.0 LB/QU FT	FIBERGLASS BOARD 2.25 LB/QU FT	FIBERGLASS BOARD 4.0 LB/QU FT	FLEXIBLE ELASTOMERIC	ASTM E2396 2-HOUR FIRE RATED BLANKET	2-HOUR FIRE RATED BLANKET	ALUMINUM	SELF-ADHESIVE (FOR OUTDOOR APPLICATIONS)	KEYED NOTES	
DUCT SYSTEMS LOCATED INDOORS											
SUPPLY AIR, EXCEPT AS NOTED BELOW											
RECTANGULAR SUPPLY AIR IN MECHANICAL ROOMS										A, E	
ROUND & FLAT OVAL SUPPLY AIR IN MECHANICAL ROOMS										1.5	
RECTANGULAR RETURN AIR IN MECHANICAL EQUIPMENT ROOMS										1.5	
ROUND RETURN AIR IN MECHANICAL ROOMS										1.5	
OUTSIDE AIR AND MIXED AIR, EXCEPT AS NOTED BELOW										1.5	
RECTANGULAR OUTSIDE AIR AND MIXED AIR IN MECHANICAL ROOMS										1.5	
ROUND OUTSIDE AIR AND MIXED AIR IN MECHANICAL ROOMS										1.5	
EXHAUST AND RELIEF AIR BETWEEN ISOLATION DAMPER AND PENETRATION OF BUILDING EXTERIOR, EXCEPT AS NOTED BELOW										1.5	
RECTANGULAR EXHAUST AND RELIEF AIR BETWEEN ISOLATION DAMPER AND PENETRATION OF BUILDING EXTERIOR, IN MECHANICAL ROOMS										1.5	
ROUND & FLAT OVAL EXHAUST AND RELIEF AIR BETWEEN ISOLATION DAMPER AND PENETRATION OF BUILDING EXTERIOR, IN MECHANICAL ROOMS										1.5	
DUCT SYSTEMS LOCATED IN ATTICS, CRAWL SPACES, OR PARKING GARAGES HAVING NATURAL OR MECHANICAL VENTILATION											
RECTANGULAR DUCTS AND AIR PLENUMS, ALL TYPES										3	2
ROUND & FLAT OVAL SUPPLY AIR										3	
ROUND & FLAT OVAL RETURN & EXHAUST AIR										3	

PLENUMS, DUCTS, AND DUCT ACCESSORIES NOT REQUIRING INSULATION:
 FIBROUS-GLASS DUCTS
 DOUBLE-WALL METAL DUCTS WITH INSULATION OF SUFFICIENT THICKNESS TO COMPLY WITH ENERGY CODE AND ASHRAE/IESNA 90.1 - 2013
 METAL DUCTS WITH DUCT LINER OF SUFFICIENT THICKNESS TO COMPLY WITH ENERGY CODE AND ASHRAE/IESNA 90.1 - 2013
 FABRIC SUPPLY DUCTS
 FACTORY-INSULATED FLEXIBLE DUCTS
 FACTORY-INSULATED PLENUMS AND CASINGS
 FLEXIBLE CONNECTORS
 VIBRATION-CONTROL DEVICES
 FACTORY-INSULATED ACCESS PANELS AND DOORS

GENERAL NOTES

- "X" OR THICKNESS IN INCHES INDICATES ACCEPTABLE SELECTION. IF MORE THAN ONE SELECTION IS INDICATED FOR A DUCT SYSTEM, CONTRACTOR MAY SELECT FROM THOSE INDICATED SELECTIONS.
- REFER TO METAL DUCT SECTION OF SPECIFICATIONS FOR DUCT LINING AND DOUBLE-WALL INSULATED DUCT.
- REFER TO HVAC CASINGS SECTION OF SPECIFICATIONS FOR DOUBLE-WALL INSULATED PLENUMS.

KEYED NOTES

- INCLUDE INSULATION AROUND DUCT MOUNTED COILS AND AIR TERMINAL UNIT COILS.
- NUMBER OF LAYERS AND TOTAL INSULATION THICKNESS AS RECOMMENDED BY SELECTED MANUFACTURER.
- DOES NOT APPLY TO PREFABRICATED, ZERO-CLEARANCE, GREASE DUCT.
- PROVIDE MANUFACTURER'S RECOMMENDED PROTECTIVE COATING FOR FLEXIBLE ELASTOMERIC THERMAL DUCT INSULATION.
- EXPOSED SUPPLY DUCTWORK LOCATED IN CONDITIONED SPACE SERVED BY THAT SYSTEM IS NOT REQUIRED TO BE INSULATED.

ABOVEGROUND PLUMBING PIPE & ACCESSORY INSULATION APPLICATION SCHEDULE														
	INSULATION MATERIAL & THICKNESS (INCHES)								FIELD-APPLIED JACKET MATERIAL					
	FLEXIBLE ELASTOMERIC	FIBERGLASS	MINERAL WOOL	POLYISOCYANURATE	PHENOLIC	CELLULAR GLASS	CALCIUM SILICATE	ALUMINUM	STAINLESS STEEL	PVC	SELF-ADHESIVE (FOR OUTDOOR APPLICATIONS)	PVC (INDOOR)	PVC (OUTDOOR)	KEYED NOTES
INDOOR PIPE SYSTEM AND SIZE (INCHES)														
DOMESTIC COLD WATER														
1" to 2"	1	1						X	X					A
DOMESTIC HOT WATER SUPPLY & RETURN 140 DEG F AND LESS:														
NPS 1-1/4 AND SMALLER	1	1						X	X					A
NPS 1-1/2 AND LARGER	1.5	1.5						X	X					A
STORM WATER & OVERFLOW														
1" to 2"	1	1						X	X					A
ROOF DRAIN AND OVERFLOW DRAIN BODIES														
1" to 2"	1	1						X	X					A
CONDENSATE AND EQUIPMENT DRAIN PIPING BELOW 60 DEG F														
0.75" to 1"	0.75	1						X	X					A
FLOOR DRAINS, TRAPS AND SANITARY DRAIN PIPING WITHIN 10 FEET OF DRAIN RECEIVING CONDENSATE AND EQUIPMENT DRAIN WATER BELOW 60 DEG F														
0.75" to 1"	0.75	1						X	X					A
OUTDOOR (ABOVEGROUND) AND TUNNEL PIPE SYSTEM AND SIZE (INCHES)														
DOMESTIC COLD WATER														
2" to 4"	2	2						X	X	X				B
DOMESTIC HOT WATER SUPPLY & RETURN														
2" to 4"	2	2						X	X	X				B
SANITARY WHERE HEAT TRACING IS INSTALLED														
2" to 4"	2	2						X	X	X				B
STORM WATER AND OVERFLOW WHERE HEAT TRACING IS INSTALLED														
2" to 4"	2	2						X	X	X				B

UNLESS OTHERWISE INDICATED OR SCHEDULED, DO NOT INSULATE THE FOLLOWING:
 FIRE SUPPRESSION PIPING
 UNDERGROUND PIPING
 LABORATORY GAS AND VACUUM PIPING
 MEDICAL GAS AND VACUUM PIPING
 FUEL GAS PIPING
 FUEL OIL PIPING

GENERAL NOTES

- "X" OR THICKNESS IN INCHES INDICATES ACCEPTABLE SELECTION. IF MORE THAN ONE SELECTION IS INDICATED FOR A SYSTEM, CONTRACTOR MAY SELECT FROM THOSE INDICATED SELECTIONS.
- INSULATE PIPING WITHIN AIR HANDLING EQUIPMENT THE SAME AS INDOOR PIPING. PROVIDE ALUMINUM OR STAINLESS STEEL JACKET.

KEYED NOTES

- PROVIDE FIELD APPLIED JACKET FOR PIPING EXPOSED IN EQUIPMENT ROOMS, STORAGE ROOMS, JANITORS CLOSETS, RECEIVING ROOMS, TEST AREAS, CIRCULATION AREAS AND SUCH AREAS SUBJECT TO DAMAGE, WITHIN 10 FEET (3 METERS) OF FINISHED FLOOR.
- INSULATE PIPING WITHIN AIR HANDLING EQUIPMENT THE SAME AS INDOOR PIPING. PROVIDE ALUMINUM OR STAINLESS STEEL JACKET.

HORIZONTAL PIPING AND SUPPORT APPLICATION SCHEDULE										
	HANGER OR SUPPORT TYPE				SHIELD TYPE					
	MSS TYPE 1 CLEVIS HANGER	MSS TYPE 10 SWIVEL RING BAND HANGER	MSS TYPE 41 DOUBLE ROD PIPE ROLLER	MSS TYPE 43 SINGLE ROD ROLLER HANGER	MSS TYPE 44 PIPE ROLLER & STAND	MSS TYPE 46 ADJUSTABLE PIPE ROLL STAND	MSS TYPE 49 PROTECTION SADDLE	MSS TYPE 40 INSULATION PROTECTION SHIELD	THERMAL-HANGER SHIELD	KEYED NOTES
METAL PIPE TYPE & SIZE										
UNINSULATED SINGLE PIPE										
UP TO 2 INCH	X	X								
2-1/2 INCH TO 4 INCH	X	X								
6 INCH TO 8 INCH	X									
10 INCH	X									
12 INCH				X						
14 INCH AND LARGER				X						
INSULATED SINGLE COLD PIPES										
UP TO 2 INCH	X	X						X	X	A
2-1/2 INCH TO 4 INCH	X								X	
6 INCH TO 8 INCH	X								X	
10 INCH	X								X	
12 INCH	X								X	
14 INCH AND LARGER	X								X	
INSULATED SINGLE HOT PIPES										
UP TO 2 INCH	X	X						X	X	A, C
2-1/2 INCH TO 4 INCH		X	X	X	X	X	X	X	X	B, C
6 INCH TO 8 INCH		X	X	X	X	X	X	X	X	B, C
10 INCH		X	X	X	X	X	X	X	X	B, C
12 INCH		X	X	X	X	X	X	X	X	B, C
14 INCH AND LARGER		X	X	X	X	X	X	X	X	B, C

GENERAL NOTES

- "X" INDICATES APPROVED HANGER OR SUPPORT ELEMENTS. IF MORE THAN ONE HANGER OR SUPPORT ELEMENT IS INDICATED, SELECTION FROM APPROVED ELEMENTS IS CONTRACTOR'S OPTION.
- REFER TO HANGER AND SUPPORT SECTION FOR APPROVED MANUFACTURERS.
- HANGERS AND SUPPORTS USED FOR FIRE PROTECTION SERVICES SHALL BE UL LISTED OR FMG APPROVED.
- HANGER ELEMENTS IN CONTACT WITH BARE COPPER PIPE SHALL BE COPPER PLATED, PLASTIC COATED, FELT LINED, OR USE MANUFACTURED COPPER TUBE ISOLATORS.
- REFER TO INDIVIDUAL PIPING SPECIFICATION SECTIONS FOR HANGER SPACING.
- MULTIPLE PARALLEL COLD PIPES MAY BE TRAPEZE SUPPORTED FROM BELOW USING U-BOLTS OR STRUT CLAMPS AND THERMAL HANGER SHIELDS. REFER TO KEYED NOTE A.
- MULTIPLE PARALLEL COLD PIPES MAY BE TRAPEZE SUPPORTED FROM ABOVE USING STANDARD HANGER ELEMENTS INDICATED FOR SINGLE COLD PIPES.
- MULTIPLE PARALLEL HOT PIPES MAY BE TRAPEZE SUPPORTED FROM BELOW USING ROLLER ELEMENTS AND THERMAL HANGER SHIELD OR INSULATION PROTECTION SADDLE. REFER TO KEYED NOTES B AND C.
- MULTIPLE PARALLEL HOT PIPES MAY BE TRAPEZE SUPPORTED FROM ABOVE USING STANDARD ROLLER HANGERS INDICATED AND THERMAL HANGER SHIELD OR INSULATION PROTECTION SADDLE. REFER TO KEY NOTES B AND C.
- REFER TO INDIVIDUAL PIPING SPECIFICATION SECTIONS FOR ADDITIONAL SYSTEM SPECIFIC HANGER APPLICATIONS.

KEYED NOTES

- USE THERMAL HANGER SHIELD ON TRAPEZE SUPPORTED INSULATED PIPE TO PREVENT CRUSHING OF INSULATION.
- USE THERMAL HANGER SHIELD DESIGNED FOR USE ON ROLLER SUPPORTS FOR INSULATED HOT PIPE.
- USE TYPE 39 PROTECTION SADDLES IF INSULATION WITHOUT VAPOR BARRIER IS INDICATED. FILL INTERIOR VOIDS WITH INSULATION MATCHING ADJOINING INSULATION.

ABOVEGROUND HVAC PIPING & VALVE APPLICATION SCHEDULE																			
PIPE SIZE (INCHES)	MATERIAL						CONNECTION					ISOLATION VALVES							
	SOFT COPPER TYPE K	HARD COPPER TYPE L	HARD COPPER TYPE M	CARBON STEEL (SCH. 40)	CARBON STEEL (SCH. 80)	CARBON STEEL (STD.)	COPPER TYPE DWV	SOLDERED	WELDED	THREADED	FLANGED	GROOVED	PRESSURE SEAL	MECHANICALLY FORMED TEE	BALL	GENERAL SERVICE BUTTERFLY	IN-PIPE BUTTERFLY	GATE	KEYED NOTES
CHILLED WATER SUPPLY & RETURN - MIN. WORKING PRESS. & TEMP., 125 PSIG AT 200 DEG F																			
UP TO 2"			X						X						X				
UP TO 2"	X							X	X						X	X	X		
2-1/2 TO 4"			X						X	X	X				X				A
2-1/2 TO 4"	X							X	X	X	X				X	X	X		A
HEATING HOT WATER SUPPLY & RETURN - MIN. WORKING PRESS. & TEMP., 125 PSIG AT 200 DEG F																			
UP TO 2"			X						X						X				
UP TO 2"	X							X	X				X	X	X	X			
2-1/2 TO 4"			X						X	X	X				X				A
2-1/2 TO 4"	X							X	X	X	X				X	X	X		A
LOW PRESSURE STEAM - MAX. 15 PSIG STEAM WORKING PRESSURE																			
UP TO 2-1/2"			X						X	X					X				C
3 TO 4"			X						X	X					X				A

GENERAL NOTES

- "X" INDICATES ACCEPTABLE SELECTION. IF MORE THAN ONE SELECTION IS INDICATED FOR A PIPING SYSTEM, CONTRACTOR MAY SELECT FROM THOSE INDICATED SELECTIONS.
- DISSIMILAR-METAL PIPING JOINTS: CONSTRUCT JOINTS USING DIELECTRIC FITTINGS COMPATIBLE WITH BOTH PIPING MATERIALS. IF A BRONZE VALVE CONNECTS THE DISSIMILAR METALS NO FURTHER DIELECTRIC ISOLATION IS REQUIRED.
 - NPS 2 AND SMALLER: USE BRASS COUPLING, NIPPLE, OR UNION.
 - NPS 2-1/2 AND LARGER: USE DIELECTRIC FLANGE KITS.
- USE UNIONS OR FLANGES AT VALVE AND EQUIPMENT CONNECTIONS.
- HVAC EQUIPMENT DRAINS, VENTS, SAFETY VALVE PIPING, BLOWDOWN PIPING AND THE LIKE SHALL BE SAME PIPING MATERIAL AS ASSOCIATED PIPING SYSTEM.
- GROOVED END VALVES MAY BE USED WITH GROOVED PIPING.

KEYED NOTES

- GROOVED AND FLANGED FITTINGS, JOINTS, AND COUPLINGS, IF INDICATED AS AN ACCEPTABLE SELECTION, MAY BE USED IN ACCESSIBLE LOCATIONS FOR THIS PIPING SYSTEM ONLY. ACCESSIBLE LOCATIONS ARE DEFINED AS EXPOSED CONSTRUCTION OR ABOVE-LAY-IN CEILINGS.
- BALL VALVE WITH 250 PSIG STEAM TRIM.
- BALL VALVE WITH 150 PSIG STEAM TRIM.

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, RA, DIRECTOR

FILE NO.
49120167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
 Saginaw, Michigan 48607
 989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
49120167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN

SALINE, MICHIGAN

SHEET TITLE
MECHANICAL SCHEDULES

PROJECT NUMBER 2021094	SHEET NUMBER
PROJECT DATE AUGUST 23, 2023	M7.02
CHECKED BY WEK	

Peter Basso Associates Inc.
 CONSULTING ENGINEERS
 5145 Livernois, Suite 100
 Troy, Michigan 48068-3276
 Tel: 248-879-5666
 Fax: 248-879-0007
 www.PeterBassoAssociates.com
 PBA-Project No.: 0021-0102

UNIT IDENTIFICATION	SYSTEM SERVED	TYPE	AIRFLOW CFM	E.S.P. IN. W.G.	T.S.P. IN. W.G.	MINIMUM WHEEL DIAMETER INCHES	RPM	FAN CLASS	MOTOR				MODULATION/CONTROL TYPE	ELECTRICAL				MODEL NUMBER	KEYED NOTES
									BHP	HP	RPM	DRIVE TYPE		VOLTS	PHASE	SCCR KA (NOTE 5)	OPTIONS/ACCESSORIES		
RF-1	AHU-21H	CENTRIFUGAL	10,000	1.0	1.19	22.25	2403	2	5.12	7.5	1750	DIRECT	VFD	460	3		CAH021GDCG		

- GENERAL NOTES:**
 1. REFER TO SCHEDULES GENERAL NOTES.
 2. MODEL NUMBERS ARE DAIKIN UNLESS OTHERWISE NOTED.
 3. DESIGN MINIMUM OUTSIDE AIRFLOW CFM (VENTILATION) LISTED IS BASED ON THE ESTIMATED MAXIMUM OCCUPANT LOAD. REFER TO TEMPERATURE CONTROL DRAWINGS FOR OUTSIDE AIR CONTROL SEQUENCE.
 4. REFER TO AIR HANDLING UNIT FILTER SCHEDULE FOR AIR PRESSURE DROP TO BE USED FOR TOTAL STATIC PRESSURE CALCULATIONS.
 5. CONTROLLER (E.G. VARIABLE FREQUENCY CONTROLLER, MOTOR STARTER) FOR SPECIFIED EQUIPMENT SHALL BE MANUFACTURED AND MARKED PER NEC WITH A MINIMUM SHORT CIRCUIT CURRENT RATING AS INDICATED.

- KEYED NOTES:**
 1. PROVIDE BUNNY CORD MAINTENANCE LED LIGHT 235" LONG, WITH MAGNETIC BASE AND FLEXIBLE CORD
 2. PROVIDE TWO BLANK OFF SHEETS FOR SUPPLY FAN

UNIT IDENTIFICATION	MAXIMUM UNIT LENGTH	MAXIMUM UNIT WIDTH	MAXIMUM UNIT HEIGHT	MAXIMUM UNIT WEIGHT POUNDS	MANUFACTURER LEAD TIME	MANUFACTURER	KEYED NOTES
AHU-21H	310"	90"	58"	5504	---	DAIKIN	1
AHU-22H	166"	80"	52"	2877	---	DAIKIN	1

- GENERAL NOTES:**
 1. FOR REFERENCE ONLY

- KEYED NOTES:**
 1. AHU TO BE SHIPPED IN SECTIONS AND THEN BROKEN DOWN TO FIT THROUGH DOORWAYS. CONTRACTOR TO REASSEMBLE AHU IN ROOM UNDER DIRECTION FROM MANUFACTURER

UNIT IDENTIFICATION	POSITION NUMBER 1	POSITION NUMBER 2	POSITION NUMBER 3	POSITION NUMBER 4	POSITION NUMBER 5	POSITION NUMBER 6	POSITION NUMBER 7	POSITION NUMBER 8	POSITION NUMBER 9	KEYED NOTES
AHU-21H	PLENUM	ACCESS	RF-1	ECONOMIZER	AF-1	HC-1	CC-1	ACCESS	SF-1	1
AHU-22H	PLENUM	AF-2	HC-2	ACCESS	SF-2	---	---	---	---	1

- GENERAL NOTES:**
 1. MODULES SELECTED BASED ON DAIKIN INDOOR MODULAR CLIMATE CHANGER AIR HANDLING UNIT.
 2. POSITION NUMBERS ARE INDICATED IN THE DIRECTION OF AIRFLOW FROM RETURN AIR INLET TO SUPPLY AIR DISCHARGE.

- KEYED NOTES:**
 1. AHU TO BE SHIPPED IN SECTIONS AND THEN BROKEN DOWN TO FIT THROUGH EXISTING DOORWAYS. CONTRACTOR TO REASSEMBLE AHU IN ROOM UNDER DIRECTION FROM MANUFACTURER
 2. AHU IS PRE-PURCHASED AND ASSIGNED TO THE CONTRACTOR FOR DELIVERY AND INSTALLATION

UNIT I.D.	SYSTEM SERVED	TYPE	AIRFLOW CFM	AIR PRESS. DROP			EFFICIENCIES	FILTER MEDIA				HOUSING		MODEL NO.	KEYED NOTES
				INITIAL IN. W.G.	DIRTY IN. W.G.	MERV		QUAN.	WIDTH IN.	DEPTH IN.	MIN. MEDIA FACE AREA SQ. FT.	ACCESS TYPE	WIDTH IN.		
AF-1	AHU-21H	PLEATED	10,000	0.22	1.0	8	3/3	24/24	24/20	2	20	SIDE	18	48	CAH021GDCG
AF-1	AHU-21H	VARICEL SH CARTRIDGE	10,000	0.53	1.5	13	3/3	24/24	24/20	12	20	SIDE	18	48	CAH021GDCG
AF-2	AHU-22H	PLEATED	8700	0.08	1.0	8	3/6/3	24/20/12	24/24/24	2/2/2	12/20/6	SIDE	26	42	CAH018GDGM

- GENERAL NOTES:**
 1. MODEL NUMBERS ARE FAIR UNLESS OTHERWISE NOTED.
 2. PROVIDE 25% TO 30% EFFICIENT 2 INCH THROW AWAY PREFILTERS
 3. MERV DESIGNATES THE "MINIMUM EFFICIENCY REPORTING VALUE" AS EVALUATED UNDER ASHRAE STANDARD 52.2 1999.
 4. AIR HANDLING UNIT TOTAL STATIC PRESSURE FOR VARIABLE AIR VOLUME SYSTEMS IS BASED ON THE FILTER DIRTY AIR PRESSURE DROP AND AVERAGE/MOULFE FILTER AIR PRESSURE DROP FOR CONSTANT VOLUME SYSTEMS UNLESS NOTED OTHERWISE.

- KEYED NOTES:**
 1. PROVIDE THREE SETS OF EACH TYPE OF FILTER

UNIT IDENTIFICATION	SYSTEM SERVED	TYPE	AIRFLOW CFM	OUTSIDE AIR FLOW CFM	E.S.P. IN. W.G.	T.S.P. IN. W.G.	MINIMUM WHEEL DIAMETER INCHES	RPM	FAN CLASS	MOTOR				MODULATION/CONTROL TYPE	ELECTRICAL				MODEL NUMBER	KEYED NOTES
										BHP	HP	RPM	DRIVE TYPE		VOLTS	PHASE	SCCR KA (NOTE 5)	OPTIONS/ACCESSORIES		
SF-1	AHU-21H	CENTRIFUGAL	10,000	3000	2.0	4.89	24.5	1796	2	11.29	15.0	1750	DIRECT	VFD	460	3		CAH021GDCG		
SF-2	AHU-22H	CENTRIFUGAL	8700	8700	1.5	3.51	18.25	3650	2	7.9	10	3500	DIRECT	VFD	460	3				

- GENERAL NOTES:**
 1. REFER TO SCHEDULES GENERAL NOTES.
 2. MODEL NUMBERS ARE DAIKIN UNLESS OTHERWISE NOTED.
 3. DESIGN MINIMUM OUTSIDE AIRFLOW CFM (VENTILATION) LISTED IS BASED ON THE ESTIMATED MAXIMUM OCCUPANT LOAD. REFER TO TEMPERATURE CONTROL DRAWINGS FOR OUTSIDE AIR CONTROL SEQUENCE.
 4. REFER TO AIR HANDLING UNIT FILTER SCHEDULE FOR AIR PRESSURE DROP TO BE USED FOR TOTAL STATIC PRESSURE CALCULATIONS.
 5. CONTROLLER (E.G. VARIABLE FREQUENCY CONTROLLER, MOTOR STARTER) FOR SPECIFIED EQUIPMENT SHALL BE MANUFACTURED AND MARKED PER NEC WITH A MINIMUM SHORT CIRCUIT CURRENT RATING AS INDICATED.

- KEYED NOTES:**
 1. PROVIDE BUNNY CORD MAINTENANCE LED LIGHT 235" LONG, WITH MAGNETIC BASE AND FLEXIBLE CORD
 2. PROVIDE TWO BLANK OFF SHEETS FOR SUPPLY FAN

UNIT IDENTIFICATION	SYSTEM SERVED	MAXIMUM NUMBER ROWS	MAXIMUM FIN DENSITY FINS/INCH	TOTAL CAPACITY MBH	AIRFLOW CFM	AIR					MINIMUM FACE AREA SQ. FT.	WATER				CONTROL VALVE W.P.D. FT. HEAD	MODEL NUMBER	KEYED NOTES	
						E.D.B. °F	E.W.B. °F	L.D.B. °F	L.W.B. °F	MAXIMUM A.P.D. IN. W.G.		FLOW GPM	FLUID TYPE	E.W.T. °F	L.W.T. °F				MAXIMUM W.P.D. FT. HEAD
CC-1	AHU-21H	6	9	388.6	10000	79.7	65.9	53.9	53.0	0.69	20.1	63.7	W	44.0	56.2	16.0	15	SWL0906B	#

- GENERAL NOTES:**
 1. MODEL NUMBERS ARE DAIKIN UNLESS OTHERWISE NOTED.
 2. COIL SELECTIONS BASED ON .0025 FOULING FACTOR.
 3. FLUID TYPE: W = WATER, PGXX = PROPYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL, EGXX = ETHYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL.

UNIT IDENTIFICATION	SYSTEM SERVED	MAXIMUM NUMBER ROWS	MAXIMUM FIN DENSITY FINS/INCH	CAPACITY MBH	AIRFLOW CFM	AIR			MINIMUM FACE AREA SQ. FT.	WATER				CONTROL VALVE W.P.D. FT. HD.	MODEL NUMBER	KEYED NOTES	
						E.D.B. °F	L.D.B. °F	MAXIMUM A.P.D. IN. W.G.		FLOW GPM	FLUID TYPE	E.W.T. °F	L.W.T. °F				MAXIMUM W.P.D. FT. HEAD
HC-1	AHU-21H	2	10	305.5	10000	43.0	70.9	0.30	15.1	19.7	PG35	130	99	2.00	15	5WH1002B	
HC-2	AHU-22H	2	10	804.5	8700	-10.0	82.0	0.33	16.0	42.2	PG35	130	94	8.6	15	5WH1002C	

- GENERAL NOTES:**
 1. MODEL NUMBERS ARE DAIKIN UNLESS OTHERWISE NOTED.
 2. COIL SELECTION BASED ON .0025 FOULING FACTOR.
 3. FLUID TYPE: W = WATER, PGXX = PROPYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL, EGXX = ETHYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL.

DUCT CONNECTIONS		DISCHARGE SOUND POWER/RADIATED SOUND POWER - dB						DIMENSIONS		MODEL NUMBER	KEYED NOTES
INLET SIZE INCHES	OUTLET SIZE INCHES	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	LENGTH INCHES	HEIGHT INCHES		
6e	12x8	73/66	69/63	62/52	56/42	53/40	49/36			ESV	1
8e	12x10	72/68	70/59	66/53	63/47	57/46	53/46			ESV	2
10e	14x12-1/2	78/71	70/61	65/56	61/50	58/47	53/45			ESV	3
12e	16x15	76/72	73/63	69/59	65/53	61/48	57/46			ESV	4
16e	24x18	78/70	73/63	70/58	68/53	64/52	59/50			ESV	5
24x16	38x18	83/74	81/69	76/63	74/54	73/48	68/41			ESV	6

- GENERAL NOTES:**
 1. MODEL NUMBERS ARE TITUS UNLESS OTHERWISE NOTED.
 2. MAXIMUM SOUND POWER LEVEL BASED ON 2" PRESSURE DROP ACROSS UNIT WITH NO ALLOWANCE FOR EXTERNAL ATTENUATION.

- KEYED NOTES:**
 1. BASED ON 350 CFM
 2. BASED ON 650 CFM
 3. BASED ON 900 CFM
 4. BASED ON 1500 CFM
 5. BASED ON 2500 CFM
 6. BASED ON 5300 CFM

UNIT IDENTIFICATION	INLET SIZE	AREA SERVED	UNIT SERVED FROM	AIR FLOW				CAPACITY MBH	NUMBER ROWS	AIR	HEATING COIL (NOTE 3)								KEYED NOTES	
				COOLING MAX CFM	COOLING MIN. CFM	HEATING MIN. CFM	HEATING MAX CFM				MAXIMUM A.P.D. W/COL IN. W.G.	WATER				CONTROL VALVE				
				E.D.B. °F	L.D.B. °F	FLOW GPM	FLUID TYPE	E.W.T. °F	L.W.T. °F	MAXIMUM W.P.D. FT. HEAD	CONTROL VALVE W.P.D. FT. HEAD	CONTROL VALVE TYPE								
VBR-H108	6	H132,H119,H133	AHU-21H	260	80	80	260	0.11	5.0	2	55.0	90.0	0.5	PG35	130	100	0.29	15	3-WAY	
VBR-H109	12	DINING H131	AHU-21H	1080	325	325	1080	0.16	20.6	2	55.0	90.0	1.2	PG35	130	100	1.41	15	3-WAY	
VBR-H110	12	DINING H131	AHU-21H	1080	325	325	1080	0.16	20.6	2	55.0	90.0	1.2	PG35	130	100	1.41	15	3-WAY	
VBR-H111	12	DINING H131/SERVERY H130	AHU-21H	1280	325	325	1280	0.22	24.4	2	55.0	90.0	1.5	PG35	130	100	2.77	15	3-WAY	
VBR-H112	12	DINING H131/SERVERY H130	AHU-21H	1280	325	325	1280	0.22	24.4	2	55.0	90.0	1.5	PG35	130	100	2.77	15	3-WAY	
VBR-H113	12	KITCHEN H123	AHU-21H	1260	325	325	1260	0.21	24.0	2	55.0	90.0	1.4	PG35	130	100	2.63	15	3-WAY	
VBR-H114	12	KITCHEN H123	AHU-21H	1375	325	325	1375	0.22	24.3	2	55.0	90.0	1.5	PG35	130	100	2.74	15	3-WAY	
VBR-H115	6	BREAK ROOM H127	AHU-21H	205	80	80	205	0.08	4.0	2	55.0	90.0	0.5	PG35	130	100	0.11	15	3-WAY	
VBR-H116	12	KITCHEN H123	AHU-21H	1330	325	325	1330	0.30	25.3	2	55.0	90.0	1.5	PG35	130	100	1.78	15	3-WAY	
VBR-H117	6	OFFICE H125	AHU-21H	200	80	80	200	0.07	3.9	2	55.0	90.0	0.5	PG35	130	100	0.10	15	3-WAY	
VBR-H118	8	CORRIDOR H122	AHU-21H	600	145	145	600	0.34	11.5	2	55.0	90.0	0.7	PG35	130	100	4.95	15	3-WAY	
VBR-H119	6	STORAGE H124	AHU-21H	150	80	80	150	0.03	3.1	1	55.0	90.0	0.5	PG35	130	100	0.05	15	3-WAY	

- GENERAL NOTES:**
 1. MODEL NUMBERS ARE TITUS UNLESS OTHERWISE NOTED.
 2. MAXIMUM PRESSURE DROP SCHEDULED SHALL BE THE MAXIMUM ALLOWABLE STATIC PRESSURE FOR BOX AND COIL AT THE MAXIMUM CFM.
 3. HEATING COIL SELECTION BASED ON HEATING MAXIMUM AIR FLOW.
 4. FLUID TYPE: W = WATER, PGXX = PROPYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL, EGXX = ETHYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL.

EXHAUST SYSTEM	MINIMUM DESIGN PRESSURE	MINIMUM DESIGN TEMPERATURE (DEG. F)	WORKING PRESSURE	TEST PRESSURE	LIGHT TEST	TEST TIME	ALLOWABLE LEAKAGE
GREASE DUCT	20 PSIG	>200	-5" PSIG	20 PSIG	TEST ALL JOINTS PER NFPA 96	2 HOURS	NONE

- NOTES:**
 1. CONTRACTOR TO TEST ALL JOINT PER NFPA 96
 2. CAP END OF GREASE DUCTS AND TEST WITH COMPRESSED AIR, REDD JOINT THAT DO NOT PASS, HOLD TEST FOR MINIMUM 2 HOURS

UNIT IDENTIFICATION	SYSTEM SERVED	LOCATION	TYPE	COUPLING TYPE	WATERFLOW GPM	FLUID TYPE	COLDEST SYSTEM OPERATING TEMP. °F FOR PUMP SELECTION	PUMP HEAD FT.	OVERLOAD GPM	MINIMUM EFFICIENCY %	MOTOR			MODULATION/CONTROL TYPE	ELECTRICAL				MODEL NUMBER	KEYED NOTES
											BHP	HP	RPM		VOLTS	PHASE	SCCR KA (NOTE 4)	OPTIONS/ACCESSORIES		
P-54	HWH	PENTHOUSE	IN-LINE	CLOSE	140	PG35	70 °F	20	NON-OVERLOADING	74.3	0.85	1	1800	AUTO	480	3	5	---	E-90-3AAB	
P-55	HWH	PENTHOUSE	IN-LINE	CLOSE	140	PG35	70 °F	20	NON-OVERLOADING	74.3	0.85	1	1800	AUTO	480	3	5	---	E-90-3AAB	

- GENERAL NOTES:**
 1. REFER TO SCHEDULES GENERAL NOTES.
 2. MODEL NUMBER ARE BELL & GOSSETT UNLESS OTHERWISE NOTED.
 3. FLUID TYPE: W = WATER, PGXX = PROPYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL, EGXX = ETHYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL.
 4. CONTROLLER (E.G. VARIABLE FREQUENCY CONTROLLER, MOTOR STARTER) FOR SPECIFIED EQUIPMENT SHALL BE MANUFACTURED AND MARKED PER NEC WITH A MINIMUM SHORT CIRCUIT CURRENT RATING AS INDICATED.

- KEYED NOTES:**
 1. PUMPS SIZED FOR CURRENT CONNECTED LOAD, PIPING SIZE FOR WEST BUILDING FUTURE CONNECTED LOAD

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, RA, DIRECTOR

FILE NO.
 491/20167.SDW

FUNDING CODE
 171CODHHS7255

CONTRACT NO.
 Y22003

WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
 Saginaw, Michigan 48607
 989 752 8107

WTAARCH.COM

COPYRIGHT © 2023

PROJECT TITLE
 491/20167.SDW - PHASE 500:

CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN

SALINE, MICHIGAN

SHEET TITLE
MECHANICAL SCHEDULES

PROJECT NUMBER
2021094

PROJECT DATE
 AUGUST 23, 2023

CHECKED BY
 WEK

SHEET NUMBER

M7.03

PBA

Peter Basso Associates Inc
 CONSULTING ENGINEERS

5145 Livernois, Suite 100
 Troy, Michigan 48068-3276
 Tel: 248-879-5666
 Fax: 248-879-0007
 www.PeterBassoAssociates.com
 PBA Project No. 2021-0942

POWER VENTILATOR SCHEDULE																																		
UNIT IDENTIFICATION	SYSTEM SERVED	TYPE	AIRFLOW CFM	T.S.P. IN. W.G.	TIP SPEED FPM	FAN RPM	MOTOR				CURB HEIGHT INCHES	MODULATION/CONTROL TYPE	ELECTRICAL				MAXIMUM SOUND POWER LEVELS												MODEL NUMBER	KEYED NOTES				
							BHP	HP	RPM	DRIVE TYPE			VOLTS	PHASE	SCCR KA	OPTIONS/ACCESSORIES	UNIT DISCHARGE Lw BY OCTAVE BAND						UNIT INLET Lw BY OCTAVE BAND											
																	63 HZ (DB)	125 HZ (DB)	250 HZ (DB)	500 HZ (DB)	1000 HZ (DB)	2000 HZ (DB)	4000 HZ (DB)	8000 HZ (DB)	63 HZ (DB)	125 HZ (DB)	250 HZ (DB)	500 HZ (DB)			1000 HZ (DB)	2000 HZ (DB)	4000 HZ (DB)	8000 HZ (DB)
EF-6H	TOILET H126	CENTRIFUGAL	100	0.25	3161	1486	0.01	1/10	1725	DIRECT	18	AUTO	120	1	5	8	----	----	----	----	----	----	----	----	57	61	58	48	47	48	39	32	G-060-VG	
EF-7H	CHEMICAL STORAGE H129	CENTRIFUGAL	200	0.5	3669	1725	0.03	1/15	1725	DIRECT	18	AUTO	120	1	5	8	----	----	----	----	----	----	----	----	68	71	69	54	49	47	43	38	G-070-VG	
EF-8H	DISHWASHER HOOD	CENTRIFUGAL	200	0.5	3669	1725	0.03	1/15	1725	DIRECT	18	AUTO	120	1	5	8	----	----	----	----	----	----	----	----	68	71	69	54	49	47	43	38	G-070-VG	
EF-9H	KITCHEN HOOD	CENTRIFUGAL	3600	1.0	6693	1538	1.39	2	1725	DIRECT	18	AUTO	208	1	5	8	----	----	----	----	----	----	----	----	78	85	86	84	78	74	71	68	CUE-160-VG	
EF-10H	KITCHEN HOOD	CENTRIFUGAL	5100	1.5	7299	1304	2.53	3	1360	DIRECT	18	AUTO	208	3	5	8	----	----	----	----	----	----	----	----	93	81	88	74	70	69	67	62	CUE-200-VG	

GENERAL NOTES:
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE GREENHECK UNLESS OTHERWISE NOTED.

STEAM HUMIDIFIER SCHEDULE											
UNIT IDENTIFICATION	SYSTEM SERVED	AHU DISTRIBUTION TUBE BANK							MODULATION/CONTROL TYPE	REMARKS	
		QUANTITY REQUIRED	TYPE	MODEL LBS/HR	AHU AIR TEMPERATURE °F	AHU WIDTH INCHES	AHU HEIGHT INCHES	MAXIMUM ABSORPTION DISTANCE INCHES			MODEL
H-1	AHU-21H	1	INSULATED MULTIPLE TUBES	62.8	88.9	78	48	26"	DRISTEEM	AUTO	

NOTE:
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE DRISTEEM UNLESS OTHERWISE NOTED.
3. PROVIDE STEAM DISTRIBUTION ASSEMBLY TO AHU MANUFACTURE FOR MOUNTING IN AHU HUMIDIFIER SECTION.

GAS FIRED CONDENSING BOILER SCHEDULE																				
UNIT IDENTIFICATION	TURNDOWN	FUEL		AGA INPUT MBH	AGA OUTPUT MBH	MINIMUM EFFICIENCY (%)	DIMENSIONS			WATER			UNIT CONTROL TYPE	ELECTRICAL				MODEL NUMBER	KEYED NOTES	
		TYPE	MAXIMUM ALLOWABLE OUTPUT AT MINIMUM FIRING RATE (MBH)				DEPTH (IN.)	WIDTH (IN.)	HEIGHT (IN.)	E.W.T. °F	L.W.T. °F	FLOW GPM		MAXIMUM W.P.D. FT. HD.	VOLTS	PHASE	FLA			OPTIONS/ACCESSORIES
B-11	20:1	NAT GAS	100	2000	1800	90	43.6	28	78	90	130	140	7	AUTO	120	1	16	B	BMK2000	
B-12	20:1	NAT GAS	100	2000	1800	90	43.6	28	78	90	130	140	7	AUTO	120	1	16	B	BMK2000	

GENERAL NOTES:
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE AERCO UNLESS OTHERWISE NOTED.
3. PROVIDE BOILER WITH CONDENSATE NEUTRALIZATION TANK ASSEMBLY.
4. MINIMUM PRESSURE RATING OF 125 PSIG.

GRILLE, REGISTER, AND DIFFUSER SCHEDULE									
UNIT IDENTIFICATION	TYPE	FACE SIZE	NECK SIZE	FRAME TYPE	ACCESSORY	CONSTRUCTION	FINISH	MODEL NUMBER	KEYED NOTES
S-1	DIFFUSER	24x24	SEE PLANS	LAY-IN	NONE	STEEL	WHITE	500	
R-1	GRILLE	24x24	SEE PLANS	LAY-IN	NONE	ALUMINUM	WHITE	80	
R-2	GRILLE	24x12	SEE PLANS	LAY-IN	NONE	ALUMINUM	WHITE	80	
E-1	GRILLE	12x12	SEE PLAN	LAY-IN	NONE	ALUMINUM	WHITE	80	
E-2	GRILLE	24x24	SEE PLAN	LAY-IN	NONE	ALUMINUM	WHITE	80	
L-1	LOUVER	72x78	SEE PLAN	FLANGED	NONE	ALUMINUM	MILL	ESD-635	1
L-2	LOUVER	66x78	SEE PLAN	FLANGED	NONE	ALUMINUM	MILL	ESD-635	1

GENERAL NOTES:
1. MODEL NUMBERS ARE PRICE UNLESS OTHERWISE NOTED.

KEYED NOTES:
1. MODEL NUMBERS ARE GREENHECK.

HOT WATER CABINET UNIT HEATER SCHEDULE																									
UNIT IDENTIFICATION	CAPACITY MBH	AIR			FAN		WATER				CONTROL VALVE W.P.D. FT. HEAD	DIMENSIONS			RECESS DEPTH INCHES	FILTER TYPE	AREA SQ. FT.	MODULATION/CONTROL TYPE	ELECTRICAL				MODEL NUMBER	KEYED NOTES	
		AIRFLOW CFM	E.D.B. °F	L.D.B. °F	HP	RPM	FLOW GPM	FLUID TYPE	E.W.T. °F	L.W.T. °F		MAXIMUM W.P.D. FT. HEAD	LENGTH INCHES	HEIGHT INCHES					DEPTH INCHES	VOLTS	PHASE	SCCR KA			OPTIONS/ACCESSORIES
CUH-3H	19.0	860	60	80.4	1/10	1050	2.8	PG35	130	100	1.5	15	61	44	9.5	9	WASHABLE	3.5	AUTO	120	1	5	B	RC-1200-08	
CUH-4H	19.0	860	60	80.4	1/10	1050	2.8	PG35	130	100	1.5	15	61	44	9.5	9	WASHABLE	3.5	AUTO	120	1	5	B	RC-1200-08	
CUH-5H	30.4	1040	60	86.9	1/10	1050	4.4	PG35	130	100	1.5	15	66	49	9.5	9	WASHABLE	3.5	AUTO	120	1	5	B	RC-1200-10	1
CUH-6H	28.2	845	60	90.8	1/10	1050	4.1	PG35	130	100	1.5	15	61	44	9.5	0	WASHABLE	3.5	AUTO	120	1	5	B	W-1110-08	1

GENERAL NOTES:
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE STERLING UNLESS OTHERWISE NOTED.
3. FLUID TYPE: W = WATER, PGXX = PROPYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL, EDGX = ETHYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL.

KEYED NOTES:
1. HIGH CAPACITY COIL

HOT WATER PROPELLER FAN UNIT HEATER SCHEDULE																		
UNIT IDENTIFICATION	CAPACITY MBH	AIRFLOW CFM	LEAVING AIR TEMPERATURE °F	FAN		WATER				CONTROL VALVE W.P.D. FT. HEAD	MODULATION/CONTROL TYPE	ELECTRICAL				MODEL NUMBER	KEYED NOTES	
				HP	RPM	FLOW GPM	FLUID TYPE	E.W.T. °F	L.W.T. °F			MAXIMUM W.P.D. FT. HEAD	VOLTS	PHASE	SCCR KA			OPTIONS/ACCESSORIES
UH-8H	12.7	750	104	1/20	1000	1.8	PG35	130	100	0.12	15	AUTO	120	1	----	B	HS-48	
UH-9H	53.0	1800	103	1/12	1000	3.9	PG35	130	100	0.36	15	AUTO	120	1	----	B	HS-108	
UH-10H	53.0	1800	103	1/12	1000	3.9	PG35	130	100	0.36	15	AUTO	120	1	----	B	HS-108	
UH-11H	12.7	750	104	1/20	1000	1.8	PG35	130	100	0.12	15	AUTO	120	1	----	B	HS-48	

GENERAL NOTES:
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE STERLING UNLESS OTHERWISE NOTED.
3. FLUID TYPE: W = WATER, PGXX = PROPYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL, EDGX = ETHYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL.

HOT WATER FINNED TUBE RADIATION SCHEDULE															
UNIT IDENTIFICATION	CAPACITY BTUH / LINEAR FT.	ENTERING AIR TEMP °F	FLUID TYPE	WATER TEMP.		ENCLOSURE		ELEMENT				CONTROL VALVE W.P.D. FT. HEAD	MODEL NUMBER	KEYED NOTES	
				E.W.T. °F	AVERAGE °F	TYPE	LENGTH INCHES	HEIGHT INCHES	TUBE DIAMETER INCHES	WIDTH INCHES	HEIGHT INCHES				NUMBER OF TIERS
FTR-1	300	65	W	130	110	SLOPE TOP (LWB-S-LT)	SEE PLAN	14	0.75	4.25	3.63	1	15	C3/4-433-14B	

GENERAL NOTES:
1. MODEL NUMBERS ARE STERLING UNLESS OTHERWISE NOTED.
2. FLUID TYPE: W = WATER, PGXX = PROPYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL, EDGX = ETHYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL.

HOT WATER RADIANT CEILING PANEL SCHEDULE											
UNIT IDENTIFICATION	CAPACITY BTUH / LINEAR FT.	FLUID TYPE	WATER TEMP.		DIMENSIONS		FINISH	CONSTRUCTION	CONTROL VALVE W.P.D. FT. HEAD	MODEL NUMBER	KEYED NOTES
			E.W.T. °F	L.W.T. °F	LENGTH INCHES	WIDTH INCHES					
ROP-1	142	PG35	130	100	SEE PLANS	12	WHITE	STEEL	15	RC-4	

GENERAL NOTES:
1. MODEL NUMBERS ARE RENTAL UNLESS OTHERWISE NOTED.
2. EXTRUDED ARCHITECTURAL SPACE MASTERY SERIES HEF-2 FLUTED.
3. FLUID TYPE: W = WATER, PGXX = PROPYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL, EDGX = ETHYLENE GLYCOL SOLUTION XX PERCENTAGE OF GLYCOL.

VARIABLE FREQUENCY CONTROLLER SCHEDULE					
UNIT IDENTIFICATION	SYSTEM SERVED	LOCATION	RATED HORSEPOWER	OPERATING HORSEPOWER	REMARKS
VFC-AHU-21H-SF	SF-1	SEE DRAWINGS	15	11.3	PRIMARY
VFC-AHU-21H-RF	RF-1	SEE DRAWINGS	7.5	5.1	PRIMARY
VFC-AHU-22H-SF	SF-2	SEE DRAWINGS	10	7.9	PRIMARY
VFC-EF-9H	EF-9H	SEE DRAWINGS	2	1.4	PRIMARY
VFC-EF-10H	EF-10H	SEE DRAWINGS	3	2.5	BACKUP

NOTE:
1. REFER TO SPECIFICATIONS FOR APPROVED MANUFACTURERS.
2. REFER TO ELECTRICAL WIRING DIAGRAM FOR CONNECTION REQUIREMENTS.

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, R.A. DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

WTAARCH.COM
WTA ARCHITECTS
100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107 COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN


SHEET TITLE
MECHANICAL SCHEDULES

PROJECT NUMBER 2021094	SHEET NUMBER M7.04
PROJECT DATE AUGUST 23, 2023	
CHECKED BY WEK	


Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2021.0942

TEMPERATURE CONTROL - SYMBOLS LIST


SCHEMATIC SYMBOLS		SCHEMATIC SYMBOLS (CONT.)		WIRING SYMBOLS (CONT.)	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
[Symbol]	AIR FLOW CONTROLLER	[DD]	SMOKE DETECTOR - DUCT MOUNTED	[Symbol]	SWITCH - 2 POSITION SELECTOR
[Symbol]	AQUASTAT, STRAP ON BULB	[SD]	SMOKE DETECTOR - SPACE MOUNTED	[Symbol]	SWITCH - 3 POSITION SELECTOR HAND/OFF/AUTO
[CO2]	CARBON DIOXIDE SENSOR - WALL MOUNTED	[S/S]	START/STOP RELAY	[Symbol]	SWITCH - FLOW (AIR, WATER, ETC.), NO
[CO2]	CARBON DIOXIDE SENSOR - DUCT MOUNTED	[SP1]	STATIC PRESSURE TRANSMITTER	[Symbol]	SWITCH - LIMIT, NO
[CO]	CARBON MONOXIDE SENSOR - WALL MOUNTED	[SP]	STATIC PRESSURE SENSOR OR PROBE	[Symbol]	SWITCH - LIMIT, NO, HELD CLOSED
[CO]	CARBON MONOXIDE SENSOR - DUCT MOUNTED	[SW]	SWITCH	[Symbol]	SWITCH - LIMIT, NC
[CS]	CURRENT SWITCH	[T]	TEMPERATURE SENSOR - RIGID ELEMENT IN WELL	[Symbol]	SWITCH - LIMIT, NC, HELD OPEN
[CT]	CURRENT TRANSMITTER	[T]	TEMPERATURE SENSOR - STRAP ON BULB	[Symbol]	SWITCH - LIQUID LEVEL, NO
[Symbol]	DAMPER - INLET VANES	[T]	TEMPERATURE SENSOR - DUCT MOUNTED AVG ELEMENT	[Symbol]	SWITCH - LIQUID LEVEL, NC
[Symbol]	DAMPER - OPPOSED BLADE	[T]	TEMPERATURE SENSOR - DUCT MOUNTED RIGID ELEMENT	[Symbol]	SWITCH - MANUAL SPST, NO
[Symbol]	DAMPER - PARALLEL BLADE	[T]	THERMOSTAT OR TEMPERATURE SENSOR (AS DEFINED ON TC DRAWINGS)	[Symbol]	SWITCH - MANUAL DPDT, NO
[M]	DAMPER MOTOR	[T]	THERMOSTAT FOR NIGHT SETBACK	[Symbol]	SWITCH - MANUAL SPST, NC
[M]	DAMPER MOTOR W/ POSITIVE POSITIONER	[XF]	TRANSFORMER	[Symbol]	SWITCH - MANUAL DPDT, NC
[DPT]	DIFFERENTIAL PRESSURE TRANSMITTER	[V]	VALVE - 2 WAY CONTROL VALVE	[Symbol]	SWITCH - MANUAL SPDT
[DPS]	DIFFERENTIAL PRESSURE SWITCH	[V]	VALVE - 3 WAY CONTROL VALVE	[Symbol]	SWITCH - PRESSURE & VACUUM, NO
[EP]	ELECTRIC-PNEUMATIC RELAY	[V]	VALVE - 2 WAY CONTROL W/ POSITIONER	[Symbol]	SWITCH - PRESSURE & VACUUM, NC
[EP1]	ELECTRIC TO PNEUMATIC TRANSDUCER	[VSD]	VARIABLE SPEED DRIVE	[Symbol]	SWITCH - TEMPERATURE ACTUATED, NO
[CM]	FIRE ALARM SYSTEM, ADDRESSABLE CONTROL MODULE	[V]	VELOCITY SENSOR	[Symbol]	SWITCH - TEMPERATURE ACTUATED, NC
[M]	FIRE ALARM SYSTEM, ADDRESSABLE INTERFACE MODULE	[VIB]	VIBRATION SWITCH	[Symbol]	THERMAL OVERLOAD, SINGLE PHASE
[FMS]	FLOW MEASURING STATION	[V]	VOLTAGE SENSOR	[Symbol]	THERMAL OVERLOAD CONTACTS - 3 PHASE
[FM]	FLOW METER			[Symbol]	TRANSFORMER
[FS]	FLOW SWITCH			[Symbol]	WIRE TERMINATION AT DEVICE
[FZ]	FREEZE/STAT			[Symbol]	WIRE TO WIRE TERMINATION
[F]	GAUGE - FLOW			[Symbol]	WRING NOT CONNECTED
[P]	GAUGE - PRESSURE				
[T]	GAUGE - TEMPERATURE				
[Symbol]	GUARD FOR STAT OR SENSOR				
[Symbol]	HUMIDIFIER				
[H]	HUMIDISTAT OR HUMIDITY SENSOR (AS DEFINED ON TC DRAWINGS)				
[H]	HUMIDITY SENSOR, DUCT MOUNTED				
[LVL]	LEVEL SWITCH OR TRANSMITTER				
[LS]	LIMIT SWITCH				
[Symbol]	LINE - ELECTRIC				
[Symbol]	LINE - PNEUMATIC				
[M]	MAIN CONTROL AIR SUPPLY				
[MS]	MOTOR STARTER				
[OS]	OCCUPANCY SENSOR				
[R]	PILOT LIGHT OR BEACON R - RED LENS A - AMBER LENS B - BLUE LENS G - GREEN LENS				
[PE]	PNEUMATIC-ELECTRIC SWITCH				
[PS]	PRESSURE SWITCH				
[PT]	PRESSURE TRANSMITTER				
[R]	RELAY, ELECTRIC				
[Symbol]	SELECTOR SWITCH, (N=NUMBER OF POSITIONS)				
[AI]	SIGNAL - DDC/EMS, ANALOG INPUT				
[AO]	SIGNAL - DDC/EMS, ANALOG OUTPUT				
[DI]	SIGNAL - DDC/EMS, DIGITAL INPUT				
[DO]	SIGNAL - DDC/EMS, DIGITAL OUTPUT				
[AI]	SIGNAL - PACKAGED EQUIPMENT, ANALOG INPUT				
[AO]	SIGNAL - PACKAGED EQUIPMENT, ANALOG OUTPUT				
[DI]	SIGNAL - PACKAGED EQUIPMENT, DIGITAL INPUT				
[DO]	SIGNAL - PACKAGED EQUIPMENT, DIGITAL OUTPUT				

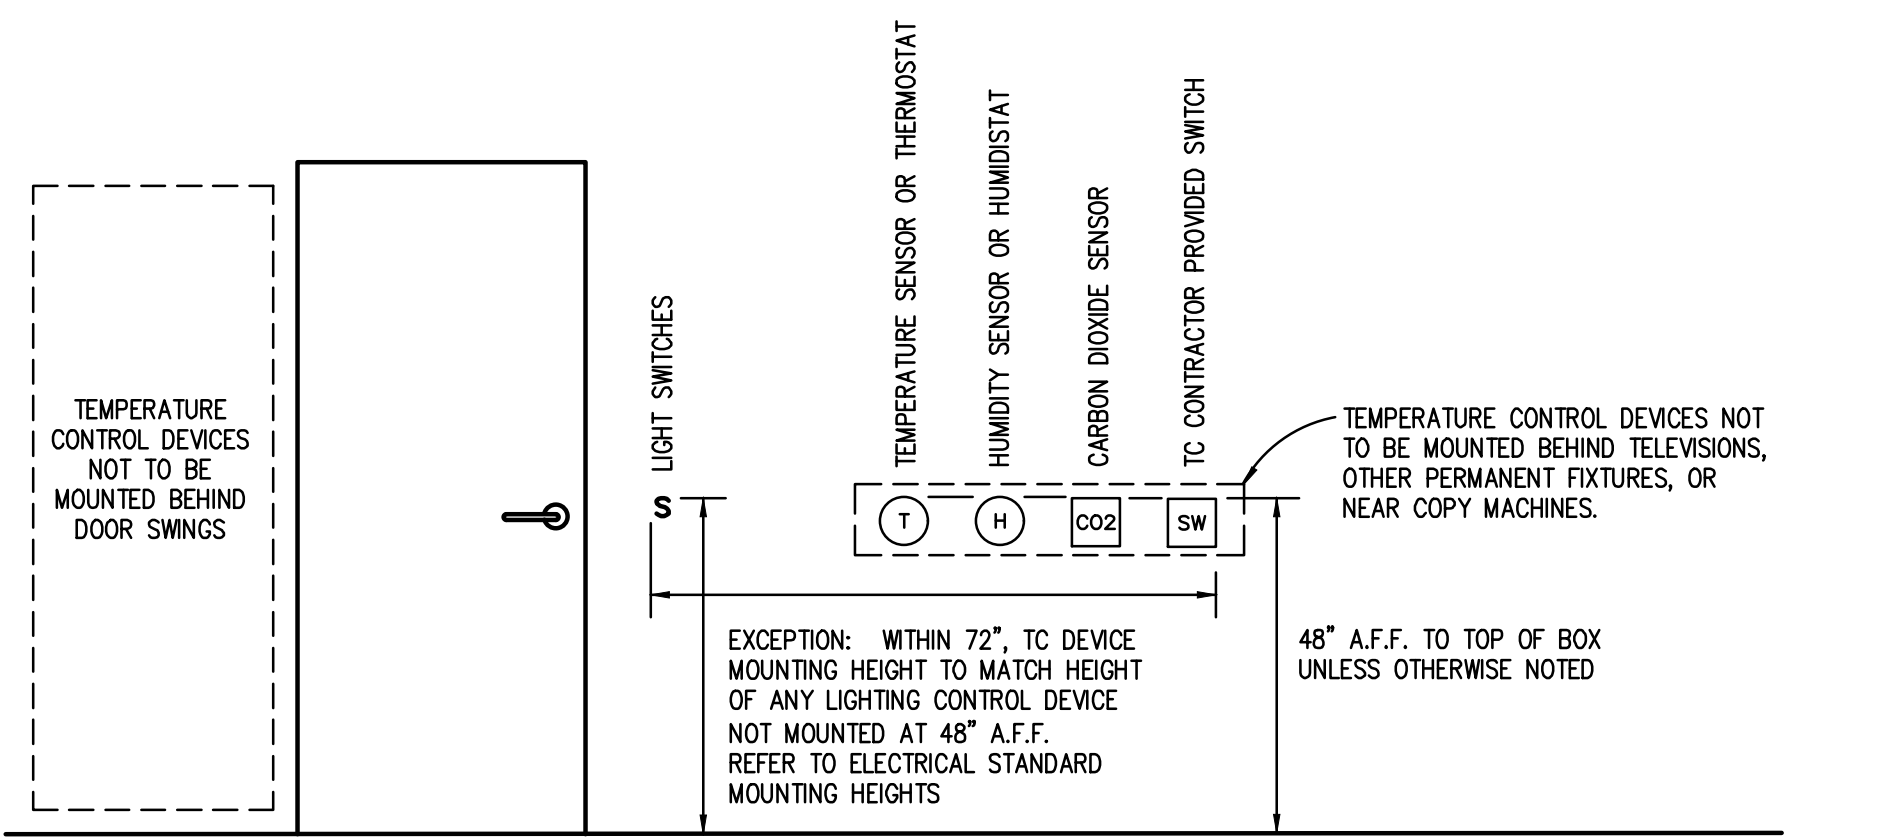


TC DEVICE STANDARD MOUNTING HEIGHTS DETAIL
NO SCALE

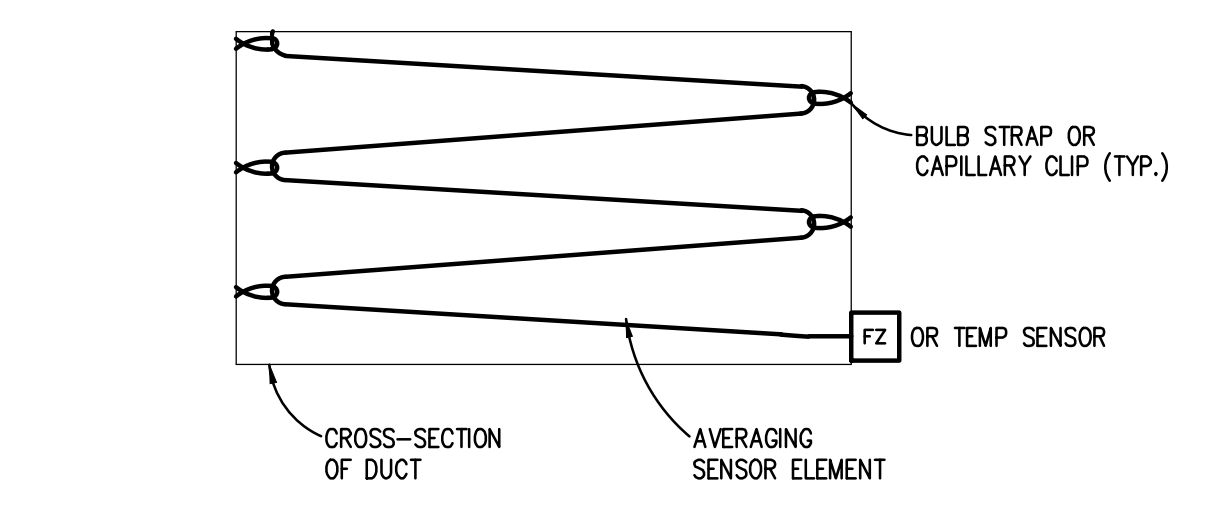

AVERAGING ELEMENT INSTALLATION DETAIL
NO SCALE

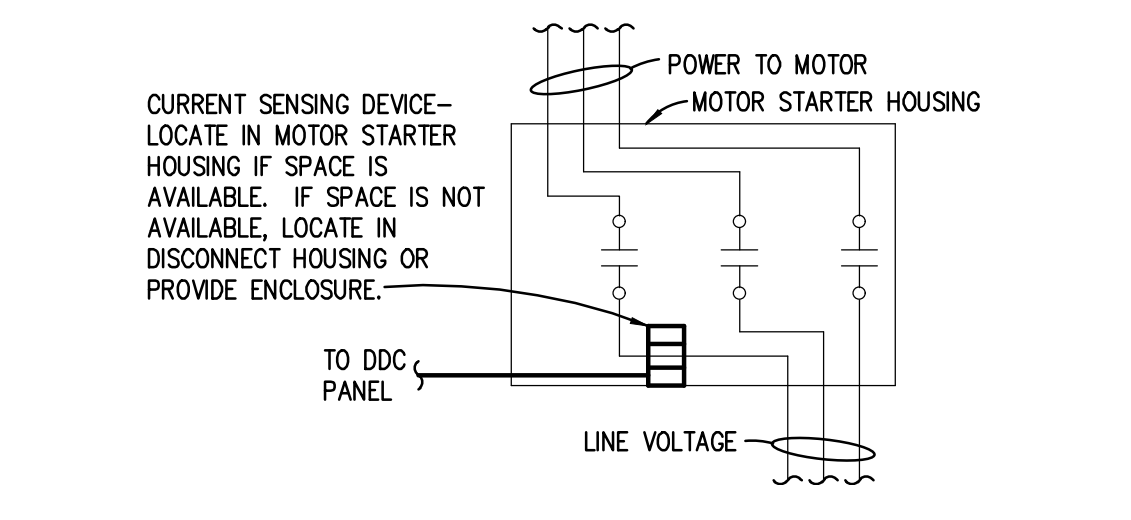

CURRENT SWITCH INSTALLATION DETAIL
NO SCALE

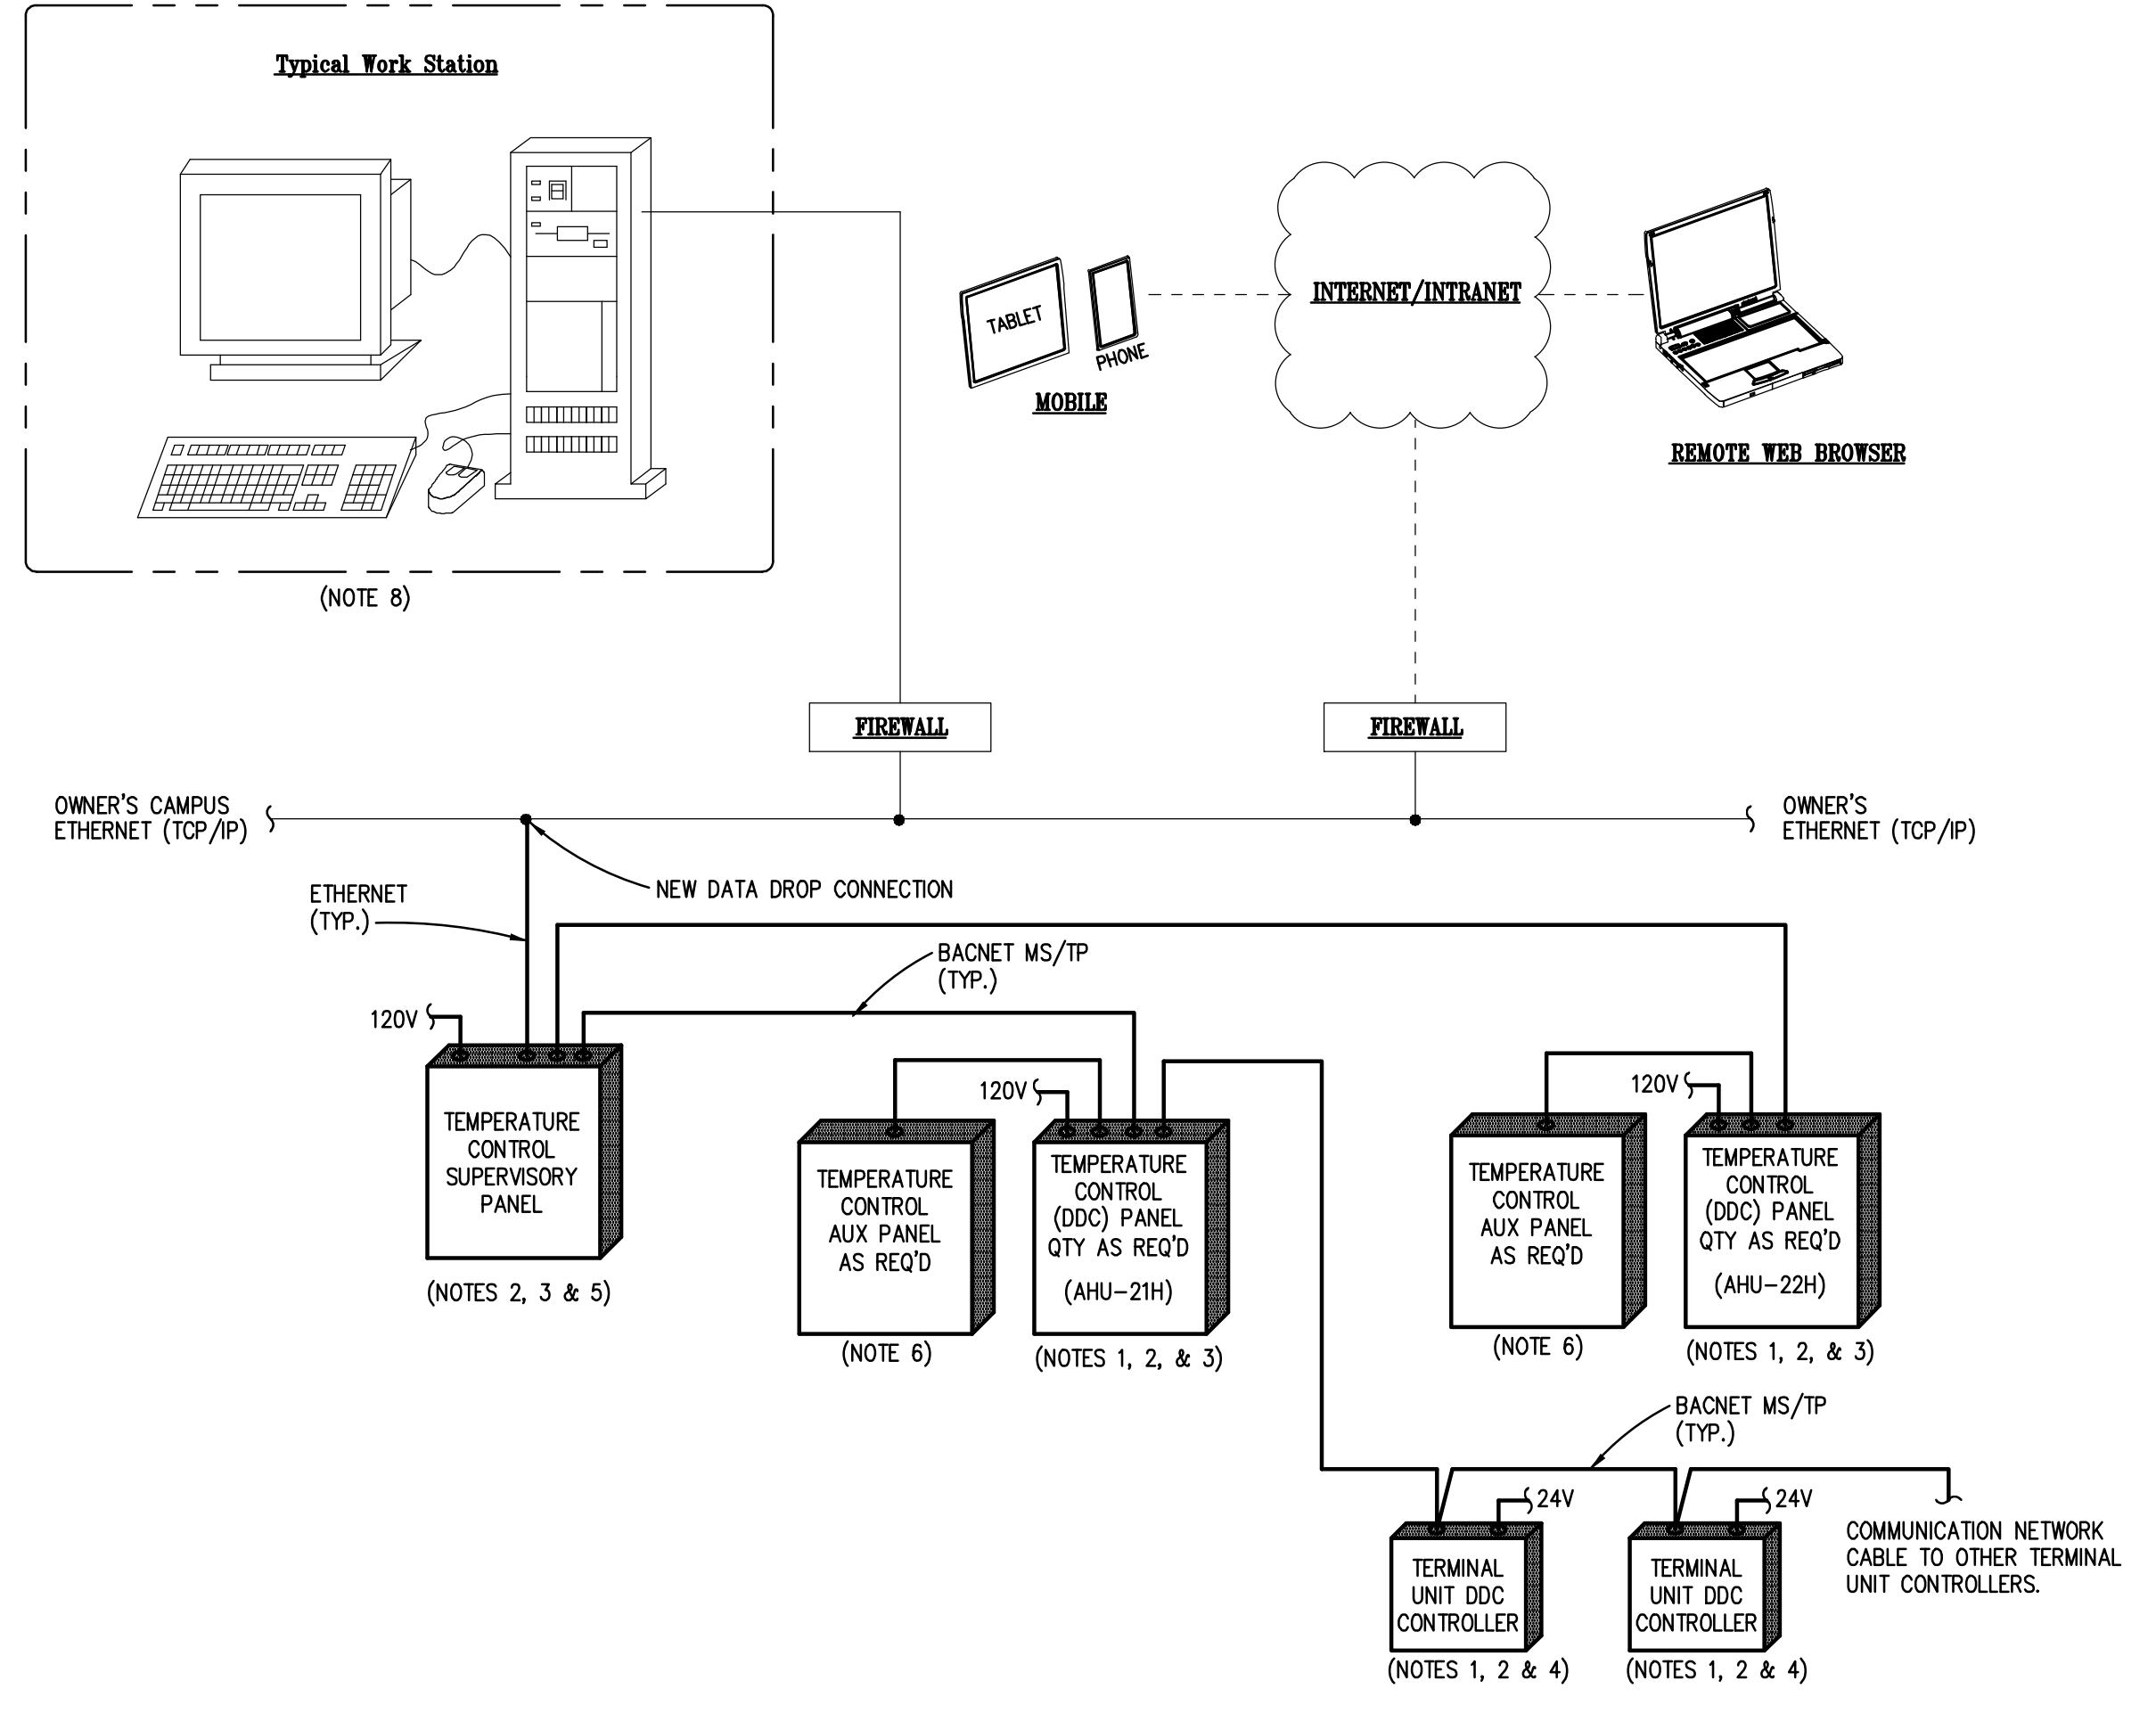

DDC SYSTEM ARCHITECTURE

- NO SCALE (JOHNSON CONTROL SYSTEM)
- NOTES:
- REFER TO TEMPERATURE CONTROL SCHEMATICS FOR THE REQUIRED POINTS ASSOCIATED FOR EACH SYSTEM.
 - TC CONTRACTOR SHALL DETERMINE DDC PANEL QUANTITY BASED ON POINT DENSITIES AND AVAILABLE MOUNTING SPACE. UNLESS SPECIFICALLY NOTED IN DESIGN DRAWINGS, TC CONTRACTOR SHALL LOCATE DDC PANELS AND COORDINATE WITH OTHER TRADES.
 - TC CONTRACTOR SHALL PROVIDE REQUIRED POWER SUPPLIES FROM SPARE CIRCUITS WHERE IDENTIFIED ON ELECTRICAL PANEL SCHEDULES. COORDINATE WITH ELEC CONTRACTOR. REFER TO ELECTRICAL DWGS FOR PANEL LOCATIONS.
 - 24V TRANSFORMERS REQUIRED FOR TERMINAL UNIT DDC CONTROLLERS SHALL BE LOCATED IN MECHANICAL OR ELECTRICAL ROOMS - COORDINATE LOCATIONS. MAXIMUM TRANSFORMER SIZE SHALL BE 100VA. PROVIDE ENCLOSURE(S) FOR TRANSFORMERS.
 - BUILDING DDC NETWORK SHALL BE CONNECTED TO THE ETHERNET, TC CONTRACTOR SHALL PROVIDE DDC PANEL OR OTHER INTERFACE COMPONENT COMPATIBLE FOR THIS CONNECTION. COORDINATE ETHERNET CONNECTION AND I/P ADDRESS WITH OWNER'S INFORMATION TECHNOLOGY PERSONNEL.
 - AUXILIARY PANEL FOR GAUGES, TRANSMITTERS, RELAYS, POWER TRANSFORMERS, ETC.
 - TC CONTRACTOR SHALL CONNECT ALL NEW TERMINAL UNIT CONTROLLERS TO NEW CAMPUS BMS NETWORK VIA IT ASSOCIATED AHU CONTROL PANEL.
 - PROVIDE COMPLETE GRAPHICS FOR THE NEW HVAC SYSTEMS.

TEMPERATURE CONTROL GENERAL NOTES

- THESE GENERAL NOTES SHALL BE APPLICABLE FOR ALL TC DRAWINGS.
- "PROVIDE" IS DEFINED AS "FURNISH AND INSTALL".
- TC CONTRACTOR SHALL BE RESPONSIBLE TO COMPLY WITH ALL APPLICABLE CODES AND STANDARDS.
- THE PORTIONS OF CONTROL DIAGRAMS AND WIRING DIAGRAMS DRAWN IN HEAVY LINE WEIGHT INDICATE NETWORK. THE PORTIONS DRAWN IN LIGHT LINE WEIGHT INDICATE EXISTING.
- ALL CONTROL SCHEMATICS AND WIRING DIAGRAMS ARE FOR THE CLARIFICATION OF EQUIPMENT INTERLOCKING FUNCTIONS AND THE INTERFACE OF VARIOUS CONTRACTOR'S WORK AND SHALL NOT BE MISTAKEN AS SHOP DRAWINGS FOR ACTUAL INSTALLATION.
- TC CONTRACTOR SHALL PROVIDE DDC CONTROLLERS AS REQUIRED TO MEET INTENT OF DESIGN DOCUMENTS. REFER TO THE PLANS FOR THE DDC FUNCTIONS THAT APPLY TO EACH MECHANICAL SYSTEM.
- ALL TO PROVIDED COMPONENTS, AND ALL TO CONTRACTOR INSTALLED WIRING AND SHALL BE LABELED PER SPECIFICATIONS.
- ALL WIRING AND SYSTEM CONTROL VOLTAGES SHALL BE IN ACCORDANCE WITH THE EQUIPMENT MANUFACTURER'S RECOMMENDATION AND THE ELECTRICAL SPECIFICATIONS.
- DESIGNATES DEVICE TO BE MOUNTED IN T.C. PANEL.
- DUCT SMOKE DETECTORS SHALL BE FURNISHED, INSTALLED AND WIRED TO THE FIRE ALARM SYSTEM BY THE ELECTRICAL TC CONTRACTOR SHALL PROVIDE DUCT SMOKE DETECTOR WIRING INTERLOCK TO MOTOR STARTERS OR VSD'S.
- ALL DDC AND CONTROL INTERLOCK WIRING SHALL BE BY TC CONTRACTOR UNLESS OTHERWISE NOTED. TC CONTRACTOR SHALL COORDINATE WITH VSD AND MOTOR STARTER SUPPLIERS TO DETERMINE EXACT WIRING REQUIREMENTS AND TERMINATION POINTS.
- ALL DDC AND CONTROL INTERLOCK WIRING BETWEEN COMPONENTS SHALL BE INSTALLED WITHOUT INTERMEDIATE STOPS. WIRE SPLICING AT INTERMEDIATE TERMINAL STRIPS IS NOT ACCEPTABLE.
- ALL ELECTRICAL WIRING AND RACEWAY SYSTEMS SHALL COMPLY WITH ELECTRICAL SPECIFICATION REQUIREMENTS. TWO SEPARATE ELECTRICAL RACEWAY SYSTEMS SHALL BE PROVIDED: ONE FOR A.C. WIRING AND THE OTHER FOR D.C. WIRING.
- TC CONTRACTOR SHALL BE RESPONSIBLE FOR ALL POWER SUPPLIES REQUIRED FOR TC SYSTEM UNLESS OTHERWISE NOTED. REFER TO ELECTRICAL PANEL SCHEDULES FOR SPARE CIRCUITS OR CIRCUITS DEDICATED TO TEMPERATURE CONTROLS. COORDINATE CIRCUIT USE WITH ELECTRICAL CONTRACTOR.
- TC CONTRACTOR SHALL VERIFY EXACT LOCATION OF ALL FIELD MOUNTED COMPONENTS.
- THERMOSTATS AND SPACE TEMPERATURE SENSORS SHALL BE MOUNTED 4'-0" ABOVE FINISHED FLOOR UNLESS NOTED OTHERWISE.
- TC CONTRACTOR SHALL PROVIDE AUXILIARY PANELS FOR REQUIRED PANEL MOUNTED EQUIPMENT SUCH AS RELAYS, TRANSDUCERS, CONTROL TRANSFORMERS, ETC. AUXILIARY PANELS SHALL BE LOCATED NEXT TO ASSOCIATED DDC PANEL.
- RELOCATED MOUNTED FIELD DEVICES SUCH AS RELAYS, CONTROL TRANSFORMERS, ETC., SHALL BE HOUSE IN AN ENCLOSURE PROVIDED BY THE TC CONTRACTOR.
- CONTROL TRANSFORMERS WHEN REQUIRED SHALL BE SIZED FOR 150% OF ACTUAL LOAD.
- FREEZE-STATS SHALL BE MOUNTED ON UPSTREAM FACE OF COOLING COILS.
- CURRENT SWITCHES USED FOR OPERATIONAL STATUS SHALL HAVE CURRENT THRESHOLD SETPOINT ADJUSTED TO INDICATE BELT OR DRIVE FAILURE.
- ALL CONTROL VALVES, CONTROL DAMPERS AND ASSOCIATED CONTROL ACTUATORS IDENTIFIED ON TC DRAWINGS SHALL BE FURNISHED BY TC CONTRACTOR UNLESS OTHERWISE NOTED. DAMPER SIZE AND LOCATIONS ARE INDICATED ON MECHANICAL FLOOR PLAN DRAWINGS.
- ALL CONTROL VALVES AND DAMPERS FURNISHED BY THE TC CONTRACTOR SHALL BE INSTALLED BY THE MECHANICAL CONTRACTOR. ALL PIPE PENETRATIONS AND BASIC FITTINGS REQUIRED FOR SENSOR INSTALLATIONS SHALL BE PROVIDED BY MECHANICAL CONTRACTOR.
- DAMPER ACTUATORS SHALL BE INSTALLED BY TC CONTRACTOR.
- ALL INSTRUMENTATION TUBING REQUIRED FOR DPS, DPT AND SPT COMPONENT INSTALLATIONS SHALL BE PROVIDED BY TC CONTRACTOR.
- TC CONTRACTOR SHALL FIELD MOUNT ALL REQUIRED PACKAGED CONTROL COMPONENTS FURNISHED BY EQUIPMENT SUPPLIERS WHERE INDICATED. ALL REQUIRED 24V PACKAGED CONTROL FIELD WIRING AND 120V FAN INTERLOCK WIRING SHALL BE PROVIDED BY TC CONTRACTOR UNLESS NOTED OTHERWISE. TC CONTRACTOR SHALL COORDINATE SPECIFIC SYSTEM WIRING REQUIREMENTS WITH PACKAGED EQUIPMENT SUPPLIERS.
- ROOM TEMPERATURE SENSORS ARE IDENTIFIED IN GENERAL LOCATIONS TEMPERATURE CONTROL CONTRACTOR SHALL VERIFY FINAL LOCATION IN FIELD PRIOR TO INSTALLATION.

REFER TO SHEET M801 FOR T.C. (TEMPERATURE CONTROL) GENERAL NOTES.


1	OWNER REVIEW	08/02/23
---	--------------	----------

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, R.A. DIRECTOR

FILE NO.
49120167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

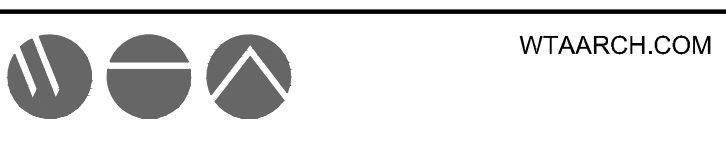

100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
49120167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
TEMPERATURE CONTROL
STANDARDS AND GENERAL
NOTES


PROJECT NUMBER
2021094

SHEET NUMBER
M8.01

PROJECT DATE
AUGUST 23, 2023

CHECKED BY
WEK


Peter Basso Associates Inc.
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2023.0102

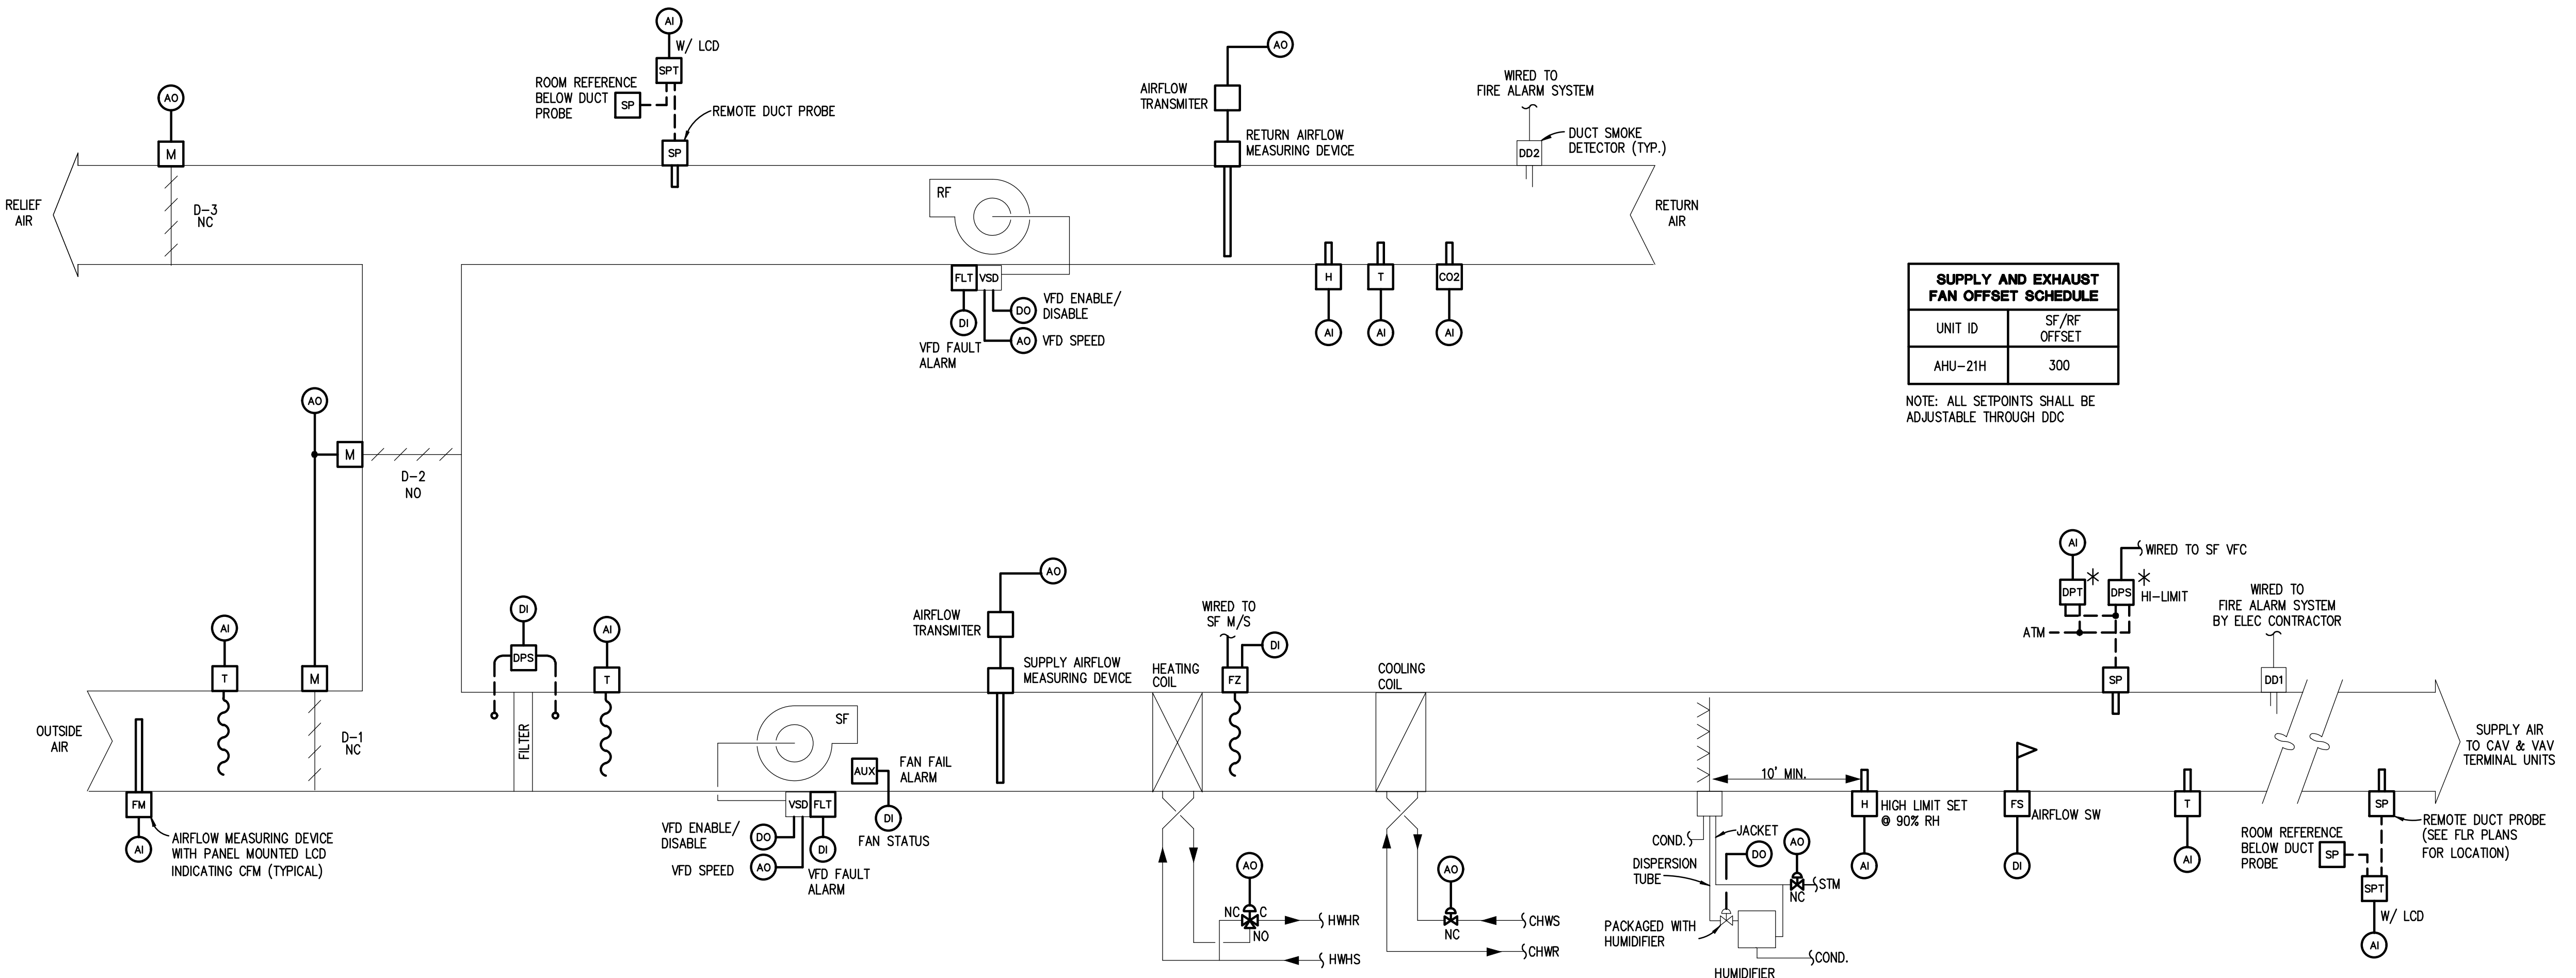

SEQUENCE OF OPERATION


- AIR HANDLING UNIT AHU-21H CONTROL:**
- NOTE: ALL SETPOINTS DESCRIBED IN SEQUENCE SHALL BE ADJUSTABLE BY SYSTEM OPERATORS (CREATE REQUIRED VIRTUAL POINTS). APPROPRIATE DEADBANDS SHALL BE USED TO PREVENT SHORT CYCLING SITUATIONS. ALL FAN MOTOR CONTROL SWITCHES SHALL BE IN 'AUTO' POSITION.
- SUPPLY SHALL HAVE START/STOP CAPABILITY FROM THE DDC SYSTEM. AHU SHALL OPERATE BASED ON TIME SCHEDULED OCCUPIED MODE COMPENSATED BY OPTIMUM START PROGRAM AND UNOCCUPIED CYCLE MODE. OPTIMUM START PROGRAM SHALL DETERMINE REQUIRED LEAD TIME TO ACHIEVE DESIRED SPACE TEMP AT BUILDING OCCUPANCY (BASED ON TRENDED DATA).
 - RETURN FAN SHALL BE ACTIVATED WITH SUPPLY FAN DURING OCCUPIED MODE.
 - EACH SF AND RF STATUS SHALL BE MONITORED BY DDC THRU RESPECTIVE FAN AUX CONTACT SWITCH. ABNORMAL STATUS CONDITION SHALL ACTIVATE ALARM.
 - VFC COMMON FAILURE ALARM FOR EACH FAN OR FAN WALL SYSTEM SHALL BE MONITORED BY DDC THRU FAULT STATUS AT RESPECTIVE FAN VFC.
 - WHEN AHU IS ACTIVATED DURING OCCUPIED MODE, OUTSIDE & RETURN AIR (MIXED AIR) DAMPERS SHALL BE ALLOWED TO MODULATE, AS DESCRIBED. WHEN AHU IS DEACTIVATED OR OPERATING IN UNOCCUPIED CYCLE MODE OR MORNING WARM-UP MODE, DAMPERS SHALL REMAIN IN NORMAL POSITIONS (FULL CLOSED TO OA).
 - DURING THE OCCUPIED PERIOD, THE OUTSIDE AIR FLOW MEASURING DEVICE THROUGH DDC SHALL MODULATE THE OUTSIDE AIR DAMPER (D-1) AND RECIRCULATION DAMPER (D-2) TO MAINTAIN A MINIMUM OUTSIDE AIR FLOW VOLUME RANGE BETWEEN OA MINIMUM AND OA MAXIMUM BASED ON DEMAND VENTILATION RESET CONTROL. THE DEMAND VENTILATION CONTROL THROUGH DDC SHALL MONITOR THE AHU'S RESPECTIVE RETURN AIR CO2 SENSOR. IF ALL THE ASSOCIATED AHU'S RETURN CO2 SENSOR IS READING 800 PPM OR BELOW, THE AHU'S OA MINIMUM SHALL BE MAINTAINED. IF THE ASSOCIATED AHU'S RETURN CO2 SENSOR IS READING ABOVE 800 PPM, THE AHU'S OUTSIDE AIR DAMPER SHALL BE MODULATED TOWARD THE OA MINIMUM MAXIMUM POSITION TO PREVENT CO2 LEVELS FROM RISING ABOVE 1,100 PPM. IF THE RETURN CO2 LEVEL RISES ABOVE 1,100 PPM, THE ASSOCIATED AHU'S OUTSIDE AIR DAMPERS SHALL BE CONTROLLED TO THE MINIMUM MAXIMUM POSITION. ALL SETPOINTS SHALL BE ADJUSTABLE THROUGH THE DDC SYSTEM.
 - WHEN DISCHARGE AIR TEMP IS BELOW HEATING SETPOINT, DDC SHALL KEEP MIXED AIR DAMPERS AT MINIMUM OA POSITION AND MODULATE HEATING COIL VALVE TO ACHIEVE DISCHARGE AIR SETPOINT.
 - DURING MORNING WARM-UP OR UNOCCUPIED MODE HEATING CYCLE, DAT SETPOINT SHALL BE 95F UNTIL BUILDING OCCUPANCY TIME OR WHEN SPACE TEMPERATURE SETPOINT IS REACHED.
 - WHEN SPACE TEMP IS ABOVE COOLING SETPOINT AND OUTDOOR AIR TEMPERATURE IS GREATER THAN 70F, DDC SHALL KEEP MIXED AIR DAMPERS AT MINIMUM OA POSITION AND THE COOLING COIL CONTROL VALVE SHALL BE MODULATED TO MAINTAIN DISCHARGE AIR TEMP SETPOINT.
 - WHEN DISCHARGE TEMP IS ABOVE COOLING SETPOINT AND OUTDOOR AIR TEMPERATURE IS LESS THAN 70F, DDC SHALL MODULATE MIXED AIR DAMPERS ABOVE MINIMUM OA POSITION TO MAINTAIN SPACE TEMP SETPOINT.
 - DDC SHALL MODULATE HEATING COIL VALVE CONTROL TO MAINTAIN DISCHARGE AIR TEMP SETPOINT BASED ON THE FOLLOWING OUTDOOR AIR TEMP RESET SCHEDULE:

OA1	OA2
≤ 25F	60F
2 55F	55F
 - SF VFC SHALL BE MODULATED BY DDC TO MAINTAIN REMOTE SYSTEM SUPPLY AIR STATIC PRESSURE SETPOINT OF .75" W.G. (TO BE ADJUSTED BY THE AIR BALANCE CONTRACTOR). (REFER TO PLANS FOR LOCATION OF REMOTE STATIC PRESSURE SENSOR).
 - DISCHARGE STATIC PRESSURE HIGH LIMIT AT ERU WITH SETPOINT OF 5.0" W.G. SHALL PROVIDE OVERRIDE CONTROL OF SUPPLY FAN SPEED AND HIGH LIMIT SWITCH WITH SETPOINT OF 5.5" W.G. SHALL PROVIDE HARDWIRED SAFETY. DDC SHALL ACTIVATE ALARM IF OPERATING IN OVERRIDE CONDITION.
 - RF VFC SHALL BE MODULATED TO MAINTAIN A CFM DIFFERENTIAL SETPOINT BETWEEN SUPPLY AIRFLOW AND EXHAUST AIRFLOW. REFER TO CFM OFFSET SCHEDULES THIS SHEET FOR SUPPLY AND EXHAUST AIRFLOW DIFFERENTIAL.
 - FREESTAT(S) SHALL DEACTIVATE SF & INTERLOCKED EF WHEN TEMPERATURE IS 35F OR BELOW. DDC SHALL MONITOR FREESTAT STATUS AND ACTIVATE ALARM IF CONDITION OCCURS.
 - DUCT SMOKE DETECTOR(S) SHALL DEACTIVATE SF & EF WHEN PRODUCTS OF COMBUSTION ARE DETECTED.
 - IF AHU IS DEACTIVATED, OUTDOOR AIR DAMPER SHALL CLOSE, CHILLED WATER COOLING COIL VALVE SHALL REMAIN CLOSED AND HEATING COIL VALVE SHALL BE MODULATED TO MAINTAIN A LOW LIMIT PLENUM TEMPERATURE SETPOINT OF 50F (BASED ON READING AT NEAREST TEMP SENSOR).

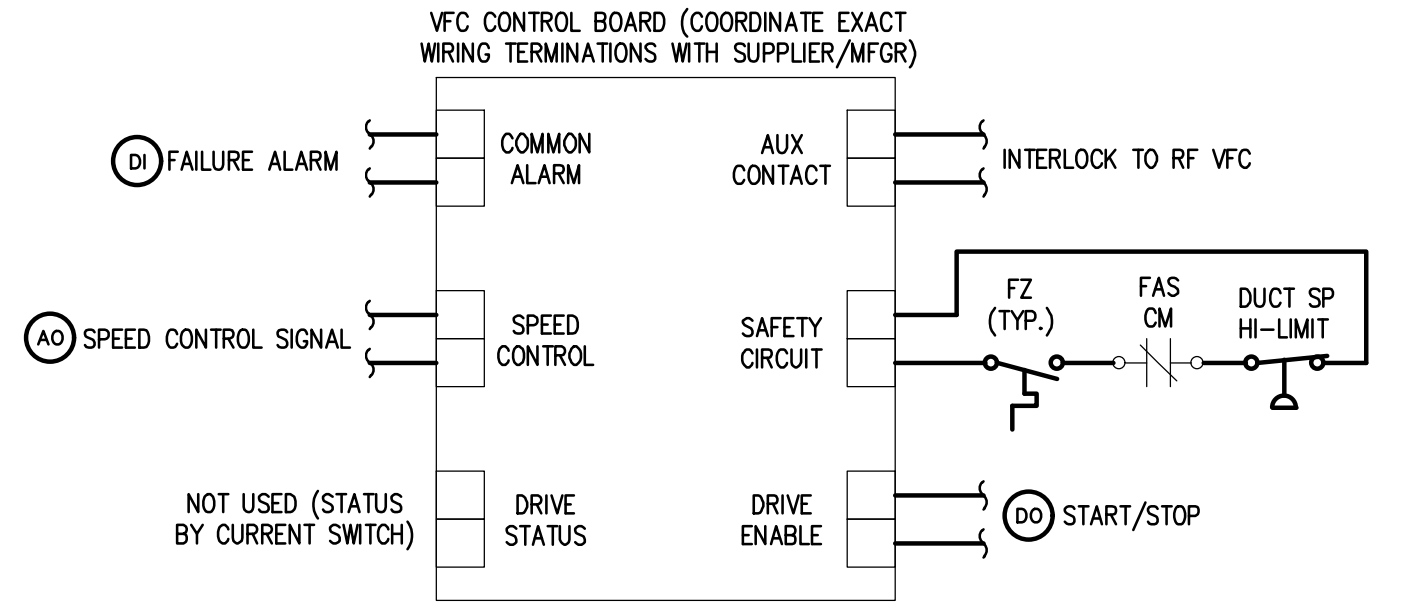

AHU-21H SF VFC WIRING

NOTE:
1. WIRING DETAIL IDENTIFIES INTENT AND DOES NOT INDICATE ACTUAL WIRING REQUIREMENTS. CONSULT WITH VFC SUPPLIER FOR THE ACTUAL WIRING REQUIREMENTS.

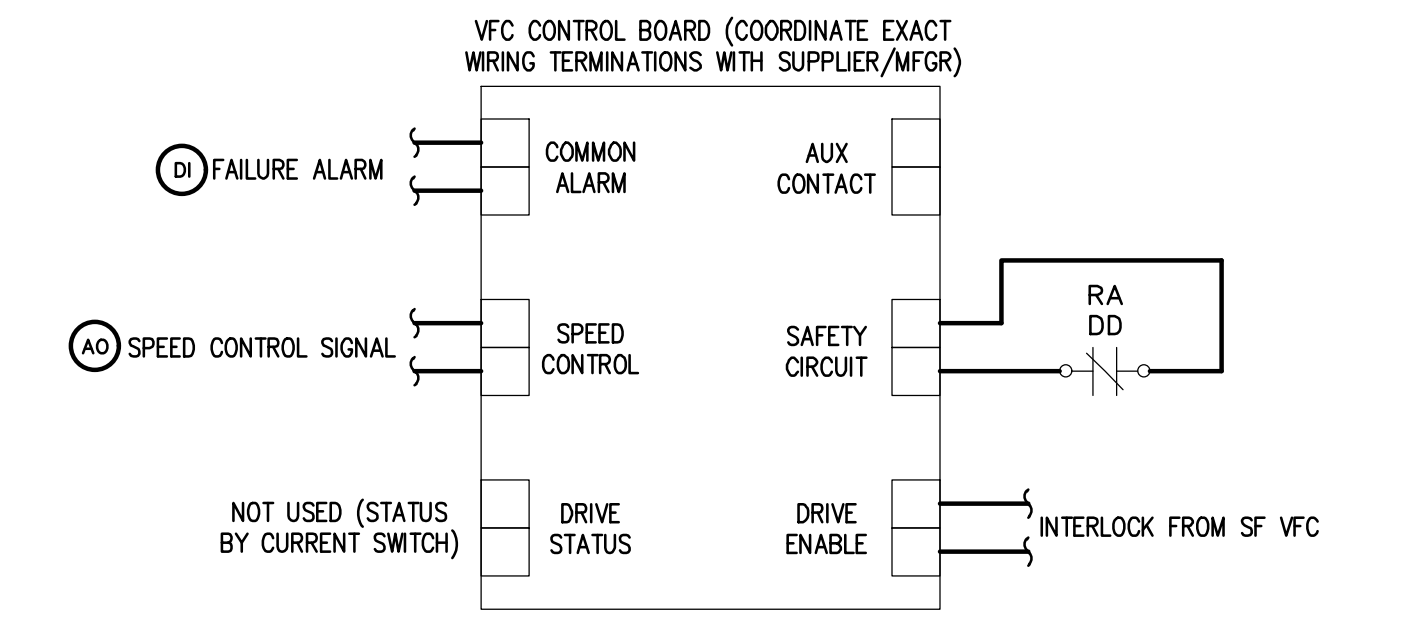


AHU-21H RF VFC WIRING

NOTE:
1. WIRING DETAIL IDENTIFIES INTENT AND DOES NOT INDICATE ACTUAL WIRING REQUIREMENTS. CONSULT WITH VFC SUPPLIER FOR THE ACTUAL WIRING REQUIREMENTS.

AIR HANDLING UNIT AHU-21H CONTROL SCHEMATIC

- NO SCALE SERVES DINING ROOM AND KITCHEN
- NOTES:**
- DAMPERS SHALL BE FURNISHED AND FACTORY INSTALLED BY AHU MANUFACTURER. TO CONTRACTOR SHALL PROVIDE DAMPER ACTUATORS.
 - ELECTRICAL CONTRACTOR SHALL PROVIDE FIRE ALARM SYSTEM COMPONENTS AND WIRING FROM FIRE ALARM PANEL TO CONTROL MODULE. TO CONTRACTOR SHALL PROVIDE WIRING FROM CONTROL MODULE TO VFC SAFETY CIRCUIT.
 - COORDINATE EXACT CONTROL, WIRING, AND INTERFACE REQUIREMENTS WITH EQUIPMENT SUPPLIER. REQUIREMENTS MAY VARY DEPENDING ON MANUFACTURER.

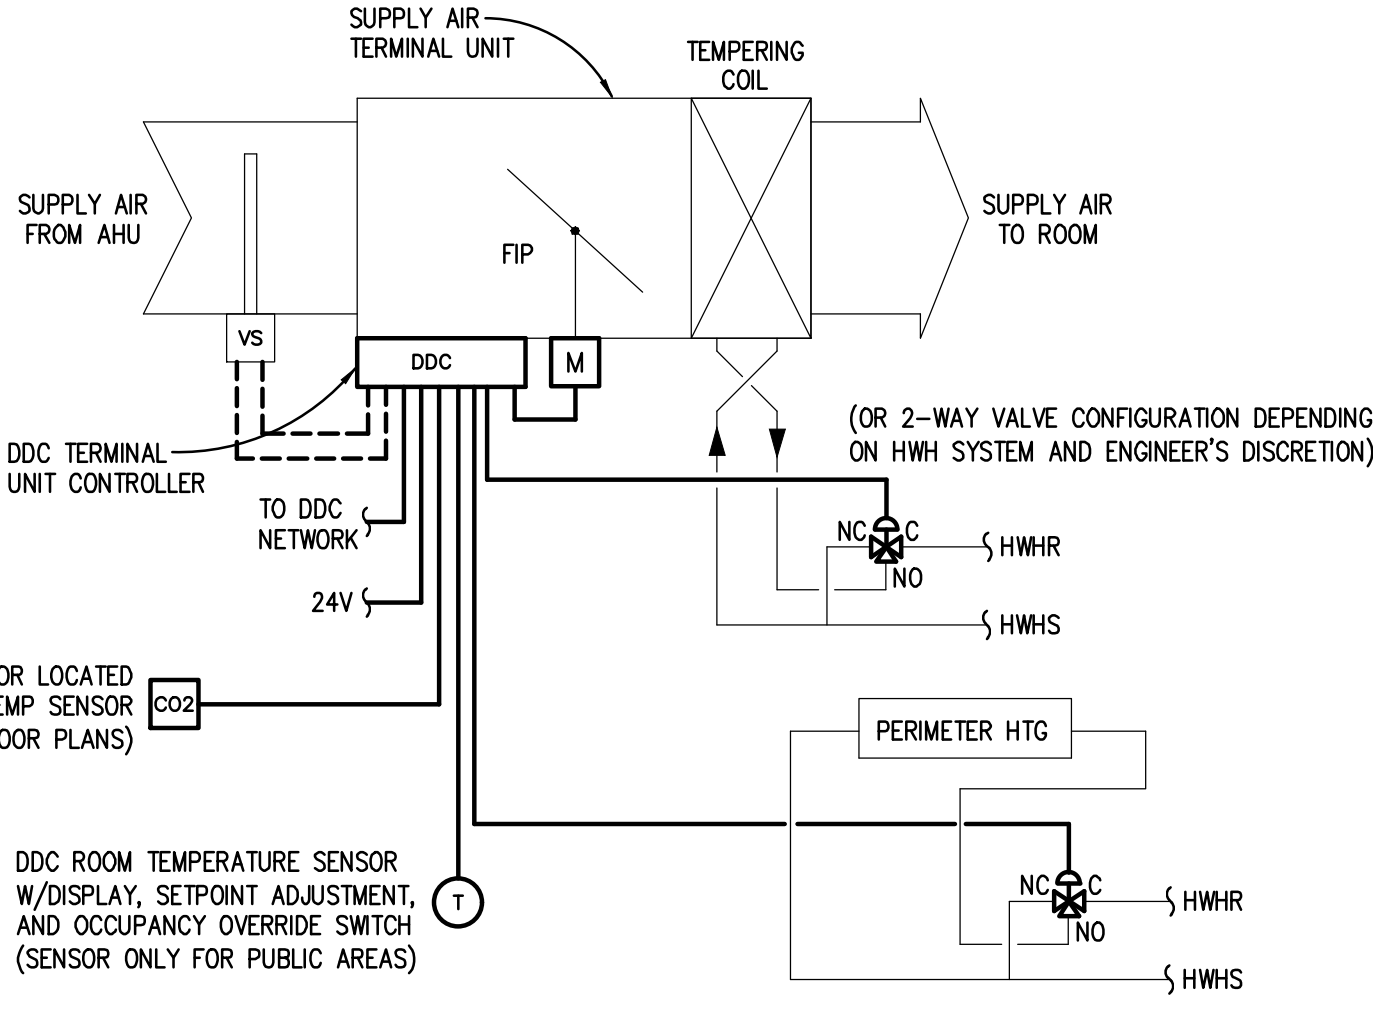

AIR TERMINAL UNIT WITH PERIMETER HTG CONTROL

- NOTES:**
- REFER TO PIPING & SHEET METAL PLANS FOR LOCATIONS AND QUANTITY OF UNITS AND LOCATIONS OF ROOM TEMP SENSORS.
 - WHERE INDICATED ON FLOOR PLANS, SPACE TEMPERATURE SHALL BE REFERENCED TO MULTIPLE AIR TERMINAL UNIT CONTROLLERS VIA DDC NETWORK.
 - PERIMETER HEATING CONTROL VALVE SHALL BE CONTROLLED FROM THE ASSOCIATED TERMINAL UNIT CONTROLLER AS SHOWN ON HVAC PIPING PLANS.
 - TO CONTRACTOR SHALL PROVIDE 24V POWER SUPPLY TO TERMINAL UNIT CONTROLLER.
 - TERMINAL UNIT MANUFACTURER SHALL PROVIDE DAMPER AND TO CONTRACTOR SHALL PROVIDE DAMPER ACTUATOR.
 - TERMINAL UNIT MANUFACTURER SHALL PROVIDE VELOCITY SENSOR FOR SYSTEM CONTROL. TO CONTRACTOR SHALL COORDINATE WITH TAB CONTRACTOR TO DETERMINE DAMPER CONTROL SETTINGS TO ACHIEVE SCHEDULED MINIMUM AND MAXIMUM CFM.
 - TO CONTRACTOR SHALL FURNISH CONTROL VALVES FOR HEATING ELEMENTS PER THE MECHANICAL DETAILS. SELECT CONTROL VALVES TO ACHIEVE THE SCHEDULED FLOW RATES.

SEQUENCE OF OPERATION

- AIR TERMINAL UNIT WITH PERIMETER HEATING:**
- NOTE: ALL SETPOINTS DESCRIBED IN SEQUENCE SHALL BE ADJUSTABLE BY SYSTEM OPERATORS (CREATE REQUIRED VIRTUAL POINTS). APPROPRIATE DEADBANDS SHALL BE USED TO PREVENT SHORT CYCLING SITUATIONS.
- ALL TU'S ASSOCIATED WITH A SINGLE SPACE TEMP SENSOR SHALL CONTROL IN UNISON.
 - SUPPLY AIR TERMINAL UNITS (TU) VAV MINIMUM AND MAXIMUM AIRFLOW SETTINGS SHALL BE AS INDICATED ON THE MECHANICAL SCHEDULES. WHERE MINIMUM AND MAXIMUM AIRFLOW SETTINGS ARE THE SAME, THE TU CONTROLLER SHALL PERFORM CONSTANT AIR VOLUME CONTROL.
 - IN ALL MODES OF HEATING, TU DISCHARGE AIR TEMP SENSOR SHALL PROVIDE HIGH LIMIT SETPOINT CONTROL AT 90F DAT.
 - WHEN ROOM TEMPERATURE RISES ABOVE THE SETPOINT, THE SUPPLY AIR TERMINAL UNIT CONTROLLER SHALL KEEP THE TEMPERING COIL VALVE AND PERIMETER HEATING CONTROL VALVE CLOSED AND SHALL MODULATE THE SUPPLY AIRFLOW BETWEEN ITS MINIMUM AND MAXIMUM SETTING TO MAINTAIN ROOM TEMPERATURE.
 - WHEN OA TEMP IS 60 DEG F OR BELOW AND ROOM TEMPERATURE FALLS BELOW SETPOINT, THE SUPPLY AIRFLOW AT ITS MINIMUM SETTING AND SHALL FIRST MODULATE THE PERIMETER HEATING CONTROL VALVE FOLLOWED BY TEMPERING COIL CONTROL VALVE (WHEN PERIMETER HEATING CONTROL VALVE IS FULL OPEN) TO MAINTAIN THE ROOM TEMPERATURE SETPOINT.
 - WHEN OA TEMP IS ABOVE 60 DEG F AND ROOM TEMPERATURE FALLS BELOW SETPOINT, THE SUPPLY AIRFLOW AT ITS MINIMUM SETTING AND SHALL MODULATE THE TEMPERING COIL CONTROL VALVE TO MAINTAIN THE ROOM TEMPERATURE SETPOINT. PERIMETER HEATING CONTROL VALVE SHALL REMAIN CLOSED.
 - THE SUPPLY AIR TERMINAL UNITS MINIMUM AND MAXIMUM VOLUME AIRFLOW SETTINGS SHALL BE AS INDICATED ON THE SHEET METAL FLOOR PLANS.
 - WHEN SPACE CARBON DIOXIDE LEVEL RISES ABOVE 1100 PPM SETPOINT, THE SUPPLY AIR TU CONTROLLER SHALL OVERRIDE TEMPERATURE CONTROL AND MODULATE DAMPER OPEN TO INCREASE SUPPLY AIRFLOW UNTIL CO2 SETPOINT IS SATISFIED. THE TEMPERING COIL VALVE SHALL BE MODULATED TO MAINTAIN SPACE TEMP SETPOINT. [NOTE: THERE IS NOT A REQUIREMENT TO INCREASE OUTSIDE AIRFLOW AT RELATED RTU IF CO2 LEVEL IS ABOVE SETPOINT WHEN TU DAMPER IS AT MAX POSITION].
 - WHEN SPACE CARBON DIOXIDE LEVEL FALLS BELOW 800 PPM SETPOINT AFTER BEING IN VENTILATION OVERRIDE MODE, THE TU DAMPER SHALL BE MODULATED CLOSED TOWARDS MINIMUM POSITION. THE TEMPERING COIL VALVE SHALL BE MODULATED TO MAINTAIN SPACE TEMP SETPOINT.
 - SPACE TEMPERATURE SETPOINTS SHALL BE AS FOLLOWS:

HEATING UNOCCUPIED SETPOINT = 62F
HEATING TEMPORARY UNOCCUPIED SETPOINT = 68F
HEATING OCCUPIED SETPOINT = 70F
COOLING OCCUPIED SETPOINT = 75F
COOLING TEMPORARY UNOCCUPIED SETPOINT = 77F
COOLING UNOCCUPIED SETPOINT = 80F
 - DURING BUILDING UNOCCUPANCY, RELATED AHU (RTU OR ERU) SHALL CYCLE AS REQUIRED TO MAINTAIN BUILDING SETBACK AND SETUP TEMP SETPOINTS.
 - WHEN RESPECTIVE AHU (RTU OR ERU) IS DEACTIVATED, THE AIR TERMINAL UNIT DAMPER SHALL REMAIN IN MINIMUM POSITION AND THE TEMPERING COIL VALVE SHALL REMAIN CLOSED. THE PERIMETER HEATING VALVE SHALL BE MODULATED TO MAINTAIN HEATING UNOCCUPIED SETPOINT.
 - THE DDC TERMINAL UNIT CONTROLLER SHALL RE-CALIBRATE THE AIRFLOW SENSOR ONCE A WEEK MINIMUM. THE RE-CALIBRATION PROCESS SHALL BE STAGGERED AMONGST THE TERMINAL UNITS SO THE DUCT STATIC PRESSURE DOES NOT EXCEED LIMITS.
 - CONTROL SIGNALS FOR AIR TERMINAL UNIT DAMPER ACTUATOR AND HEATING CONTROL OUTPUT(S) SHALL BE DISPLAYED WITH SYSTEM GRAPHICS.

REFER TO SHEET N801 FOR T.C. (TEMPERATURE CONTROL) GENERAL NOTES.

NO.	REVISION	DATE
1	OWNER REVIEW	08/02/23

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACHT, RA, DIRECTOR

FILE NO.
49120167.SDW
FUNDING CODE
171CODHHS7255
CONTRACT NO.
Y22003


WTAARCH.COM
WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
49120167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN


SHEET TITLE
TEMPERATURE CONTROLS

PROJECT NUMBER 2021094	SHEET NUMBER
PROJECT DATE AUGUST 23, 2023	M8.02
CHECKED BY WEK	


Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-679-5666
Fax: 248-679-0007
www.PeterBassoAssociates.com
PBA Project No.: 0021094

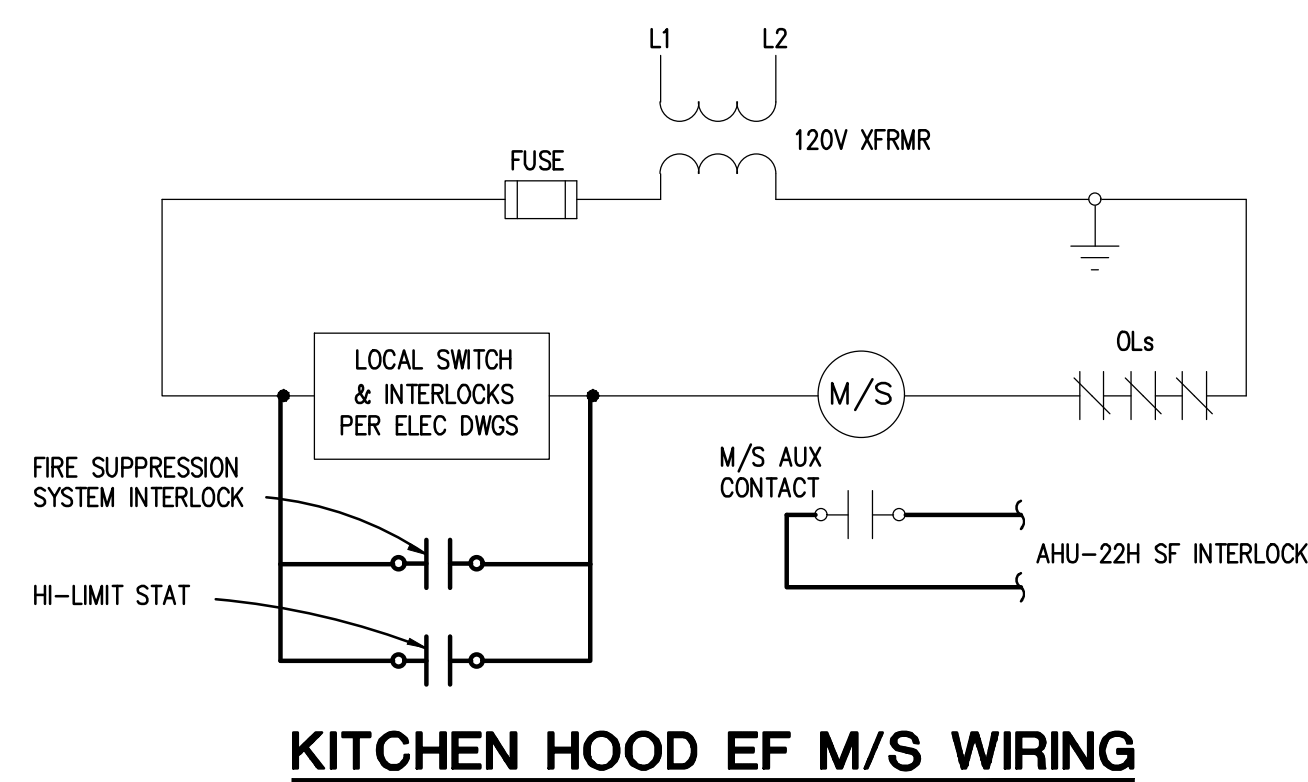

KITCHEN HOOD EF M/S WIRING

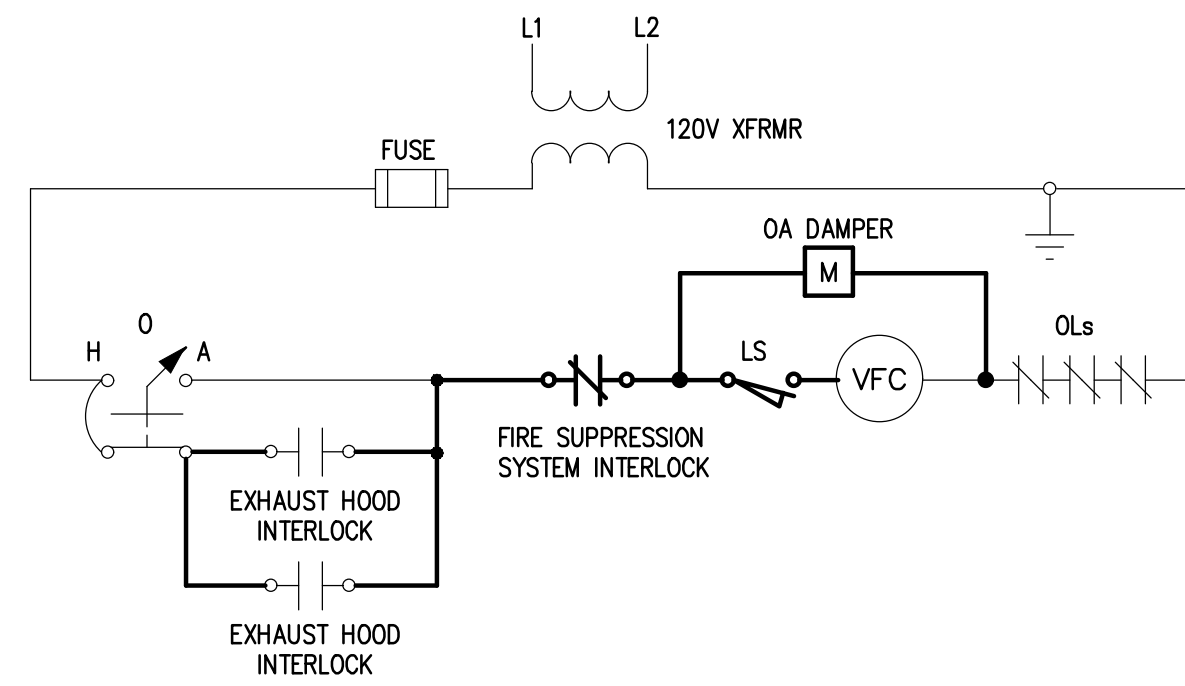


AHU-22H SF M/S WIRING

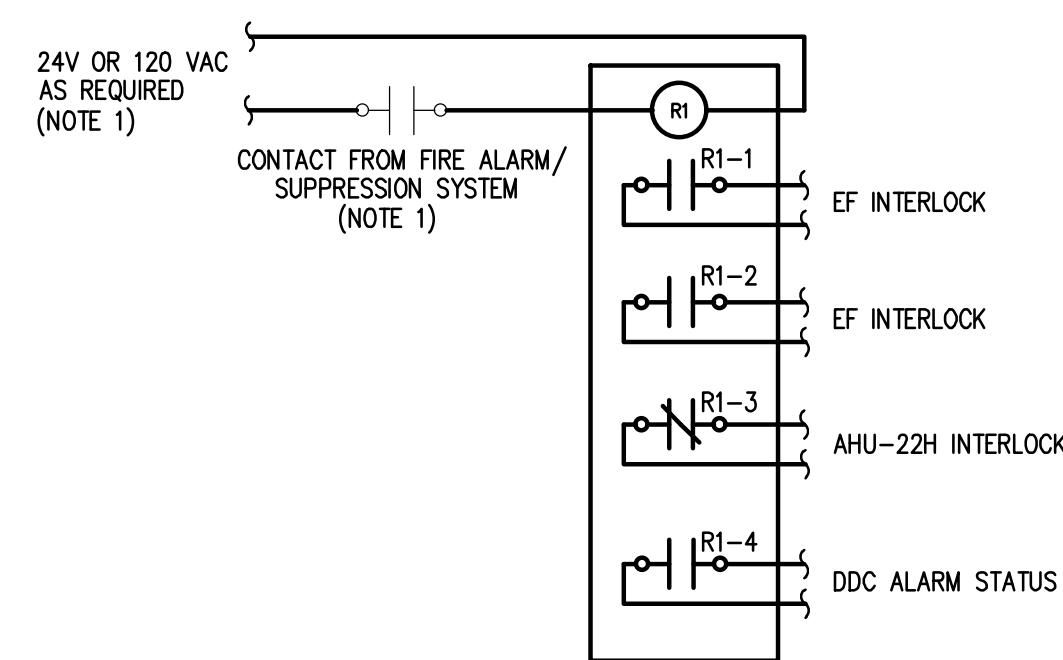

KEF'S AND AHU-22H CONTROL


- NOTE:
- FIRE SUPPRESSION SYSTEM IS NEW. COORDINATE VOLTAGE REQUIREMENTS, WIRING, ETC. WITH FIRE SUPPRESSION SYSTEM MANUFACTURER.

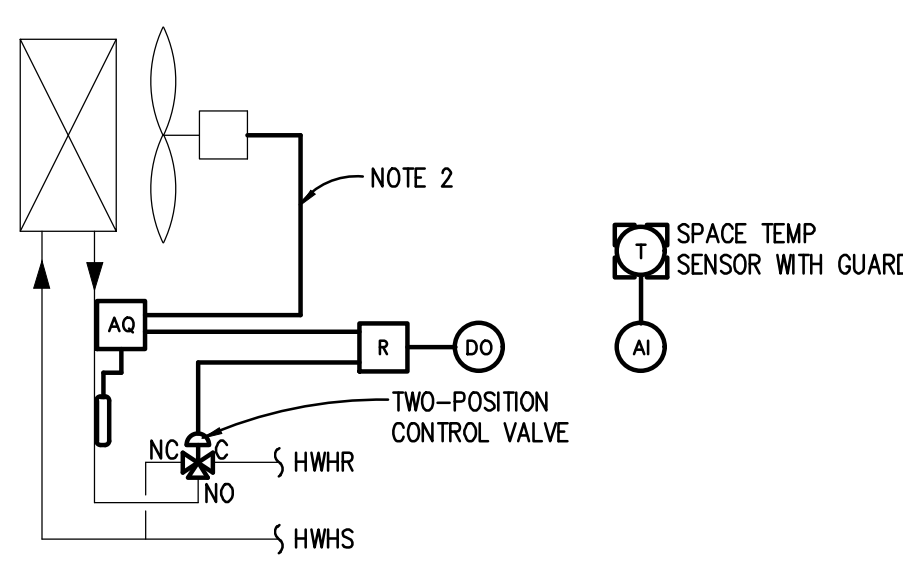

HWH UH & CUH CONTROL - NEW WORK


- NOTES:
- REFER TO FLOOR PLANS FOR QUANTITY AND LOCATION OF UNITS.
 - AQUASTAT SHALL BE WIRED IN SERIES WITH FAN CONTROL WIRING CIRCUIT.

SEQUENCE OF OPERATION:
 DDC SHALL ENABLE/DISABLE FAN CIRCUIT AND OPEN/CLOSE HEATING VALVE AS REQUIRED TO MAINTAIN SPACE TEMP SETPOINT OF 68F DURING BLDG OCCUPANCY AND 55 F DURING BLDG UNOCCUPANCY. FAN SHALL ACTIVATE UPON PROOF OF HWHR FLOW BY AQ.

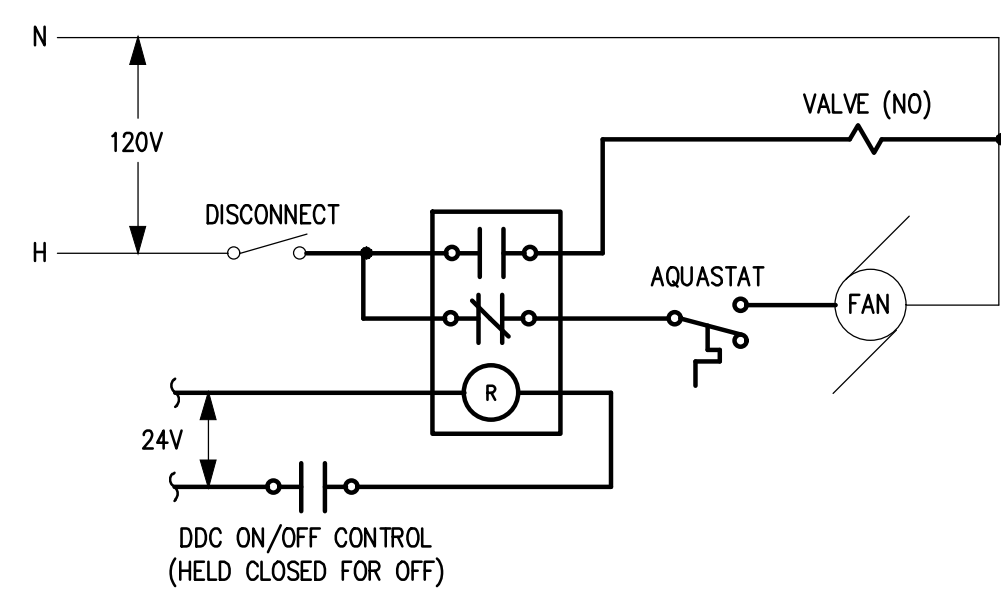

HWH UH & CUH WIRING

TYPICAL

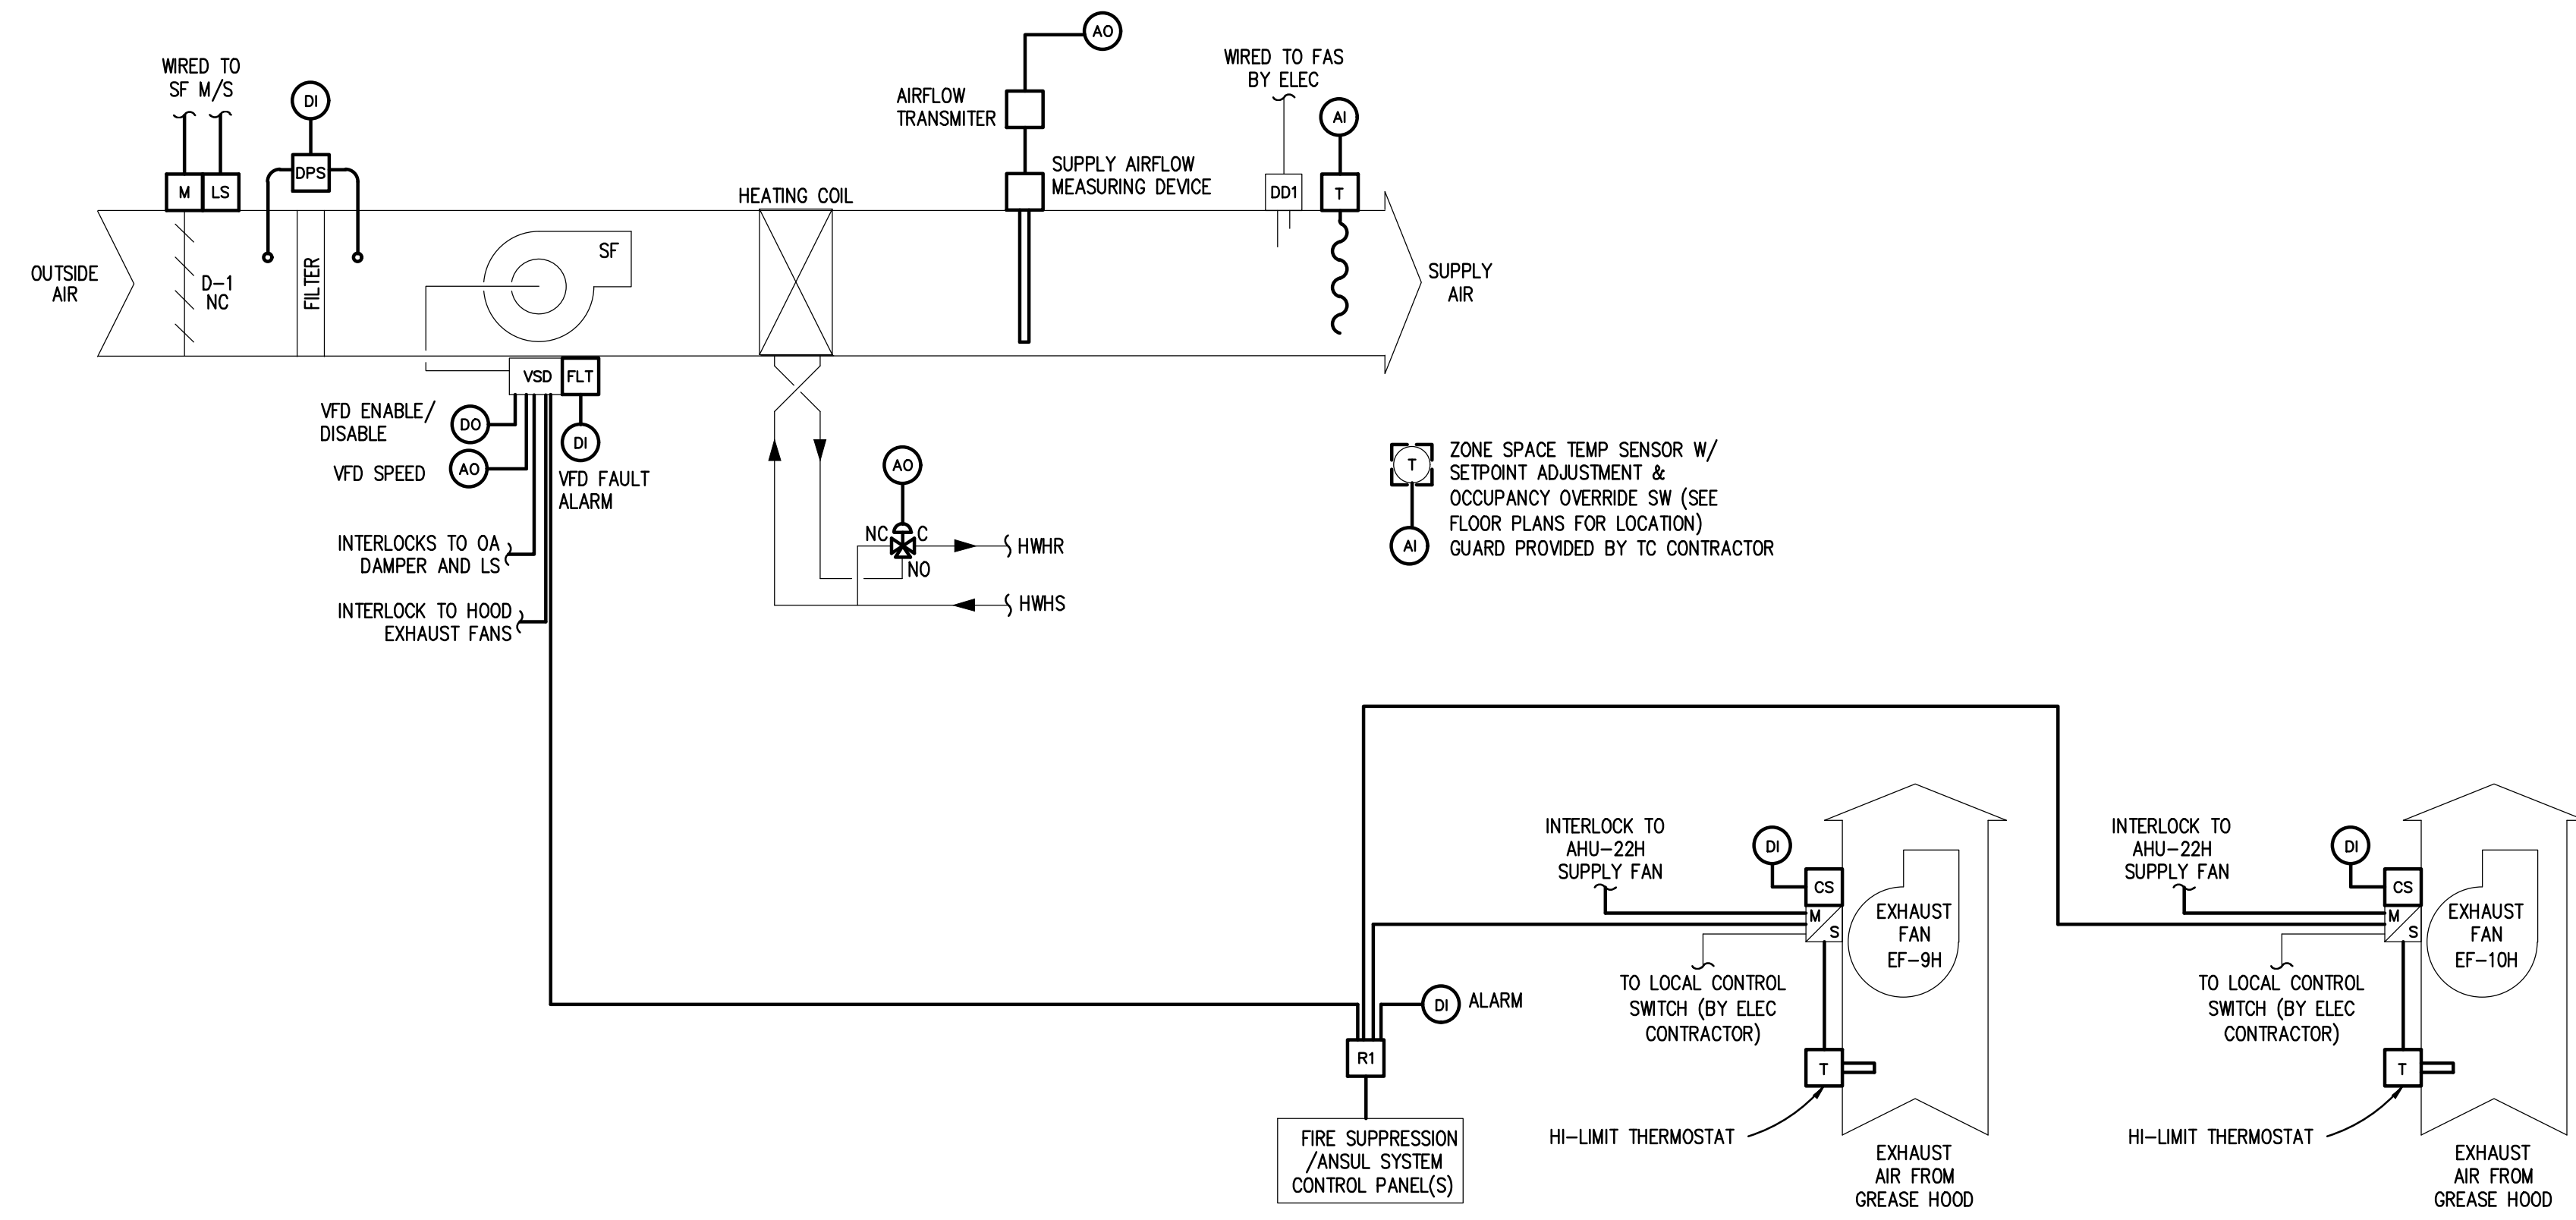

KITCHEN EXHAUST HOODS (EF-9H & EF-10H) AND MAKE-UP AIR UNIT (AHU-22H) CONTROL


- NOTES:
- COORDINATE WIRING WITH EQUIPMENT SUPPLIERS.

SEQUENCE OF OPERATION

- KITCHEN EXHAUST HOOD AND MAKE-UP AIR UNIT CONTROL:
- AHU-22H/EF-9H/EF-10H SHALL BE CAPABLE OF BEING CONTROLLED INDIVIDUALLY.
 - EF-9H AND EF-10H SHALL BE STARTED AND STOPPED MANUALLY BY ITS ON/OFF SWITCH LOCATED NEAR THE KITCHEN EXHAUST HOOD.
 - WITH THE SUPPLY FAN VFC HAND/OFF/AUTO SWITCH AND EXHAUST MOTOR STARTER HAND/OFF/AUTO SWITCH(S) IN THE "AUTO" POSITION, THE SUPPLY FAN SHALL BE INTERLOCKED WITH THE KITCHEN HOOD EXHAUST FANS. WHENEVER THE KITCHEN HOOD EXHAUST FAN IS ENERGIZED, THE MAKE UP AIR UNIT SHALL BE ENERGIZED. WHENEVER THE KITCHEN HOOD EXHAUST FAN IS DE-ENERGIZED, THE MAKE UP AIR UNIT SHALL BE DE-ENERGIZED.
 - WHEN THE CONTROL CIRCUIT OF THE SUPPLY FAN IS ENERGIZED TO START, ITS OUTSIDE AIR DAMPER SHALL FULLY OPEN FIRST. AFTER THE DAMPER IS FULLY OPEN, THE OUTSIDE AIR DAMPER LIMIT SWITCH SHALL COMPLETE. THE CONTROL CIRCUITS TO START THE SUPPLY FAN.
 - PROOF OF FLOW STATUS FOR THE SUPPLY FAN AND EXHAUST SHALL BE PROVEN TO THE DDC SYSTEM BY MEANS OF THE FAN MOTOR CURRENT SWITCH.
 - THE SUPPLY FAN VARIABLE FREQUENCY CONTROLLER SHALL BE MODULATED BASED ASSOCIATED KITCHEN HOOD EXHAUST FAN OPERATION. WHEN AN ASSOCIATED KITCHEN HOOD EXHAUST FAN IS ENERGIZED AS SENSED BY DDC THRU THE FAN MOTOR CURRENT SWITCH THE SUPPLY FAN VFC SHALL BE MODULATED TO THE EF CFM RATE.
 - THE DISCHARGE AIR TEMPERATURE SENSOR THROUGH DDC SHALL MODULATE THE UNITS HOT WATER HEATING (G/YOU) COIL CONTROL VALVE TO MAINTAIN DISCHARGE AIR TEMPERATURE SET POINT. THE DISCHARGE AIR SET POINT SHALL BE RESET BY THE SPACE TEMPERATURE BETWEEN 55 DEGREES F AND 95 DEGREES F TO MAINTAIN SPACE TEMPERATURE SET POINT OF 68 DEGREES F (ADJUSTABLE).
 - THE FILTER DIFFERENTIAL PRESSURE SWITCH SHALL ISSUE A DIRTY FILTER ALARM IF IT'S SET POINT IS REACHED.
 - IF THE LOW LIMIT SET POINT (40 DEGREES F ADJUSTABLE) OF THE DISCHARGE AIR SENSOR IS REACHED FOR MORE THAN 1 MINUTE (ADJUSTABLE) THROUGH DDC, THE SUPPLY AND EXHAUST FAN SHALL BE DE-ENERGIZED AND AN ALARM SHALL BE SENT THROUGH THE DDC SYSTEM.
 - WHEN THE SUPPLY FAN IS DE-ENERGIZED, THE OUTSIDE AIR DAMPER (D-1) SHALL CLOSE.
 - WHEN FIRE SUPPRESSION SYSTEM IS ACTIVATED, THE MAU SUPPLY FAN WILL BE DE-ACTIVATED AND THE KITCHEN HOOD EXHAUST FAN SHALL BE ACTIVATED REGARDLESS OF LOCAL CONTROL SWITCH POSITION. THIS CONDITION WILL ACTIVATE A DDC SYSTEM ALARM.
 - KITCHEN HOOD EXHAUST FAN MAY ALSO BE ACTIVATED BY HI-LIMIT THERMOSTAT REGARDLESS OF LOCAL CONTROL SWITCH POSITION, IF HEAT IS DETECTED UNDER THE KITCHEN HOOD.

SEQUENCE OF OPERATION

- AIR TERMINAL UNIT WITH PERIMETER HEATING - DISH WASH AREA:
- NOTE: ALL SETPOINTS DESCRIBED IN SEQUENCE SHALL BE ADJUSTABLE BY SYSTEM OPERATORS (CREATE REQUIRED VIRTUAL POINTS). APPROPRIATE DEADBANDS SHALL BE USED TO PREVENT SHORT CYCLING SITUATIONS.
- ALL TU'S ASSOCIATED WITH A SINGLE SPACE TEMP SENSOR SHALL CONTROL IN UNISON.
 - SUPPLY AIR TERMINAL UNIT'S (TU) VAV MINIMUM AND MAXIMUM AIRFLOW SETTINGS SHALL BE AS INDICATED ON THE MECHANICAL SCHEDULES. WHERE MINIMUM AND MAXIMUM AIRFLOW SETTINGS ARE THE SAME, THE TU CONTROLLER SHALL PERFORM CONSTANT AIR VOLUME CONTROL.
 - IN ALL MODES OF HEATING, TU DISCHARGE AIR TEMP SENSOR SHALL PROVIDE HIGH LIMIT SETPOINT CONTROL AT 90°F DAT.
 - WHEN ROOM TEMPERATURE RISES ABOVE THE SETPOINT, THE SUPPLY AIR TERMINAL UNIT CONTROLLER SHALL KEEP THE TEMPERING COIL VALVE AND PERIMETER HEATING CONTROL VALVE CLOSED AND SHALL MODULATE THE SUPPLY AIRFLOW BETWEEN ITS MINIMUM AND MAXIMUM SETTING TO MAINTAIN ROOM TEMPERATURE.
 - WHEN OA TEMP IS 60 DEG F OR BELOW AND ROOM TEMPERATURE FALLS BELOW SETPOINT, THE SUPPLY TERMINAL UNIT CONTROLLER SHALL KEEP THE SUPPLY AIRFLOW AT ITS MINIMUM SETTING AND SHALL FIRST MODULATE THE PERIMETER HEATING CONTROL VALVE FOLLOWED BY TEMPERING COIL CONTROL VALVE (WHEN PERIMETER HEATING CONTROL VALVE IS FULL OPEN) TO MAINTAIN THE ROOM TEMPERATURE SETPOINT.
 - WHEN OA TEMP IS ABOVE 60 DEG F AND ROOM TEMPERATURE FALLS BELOW SETPOINT, THE SUPPLY TERMINAL UNIT CONTROLLER SHALL KEEP THE SUPPLY AIRFLOW AT ITS MINIMUM SETTING AND SHALL MODULATE THE TEMPERING COIL CONTROL VALVE TO MAINTAIN THE ROOM TEMPERATURE SETPOINT. PERIMETER HEATING CONTROL VALVE SHALL REMAIN CLOSED.
 - WHENEVER THE DISH WASH EXHAUST FAN IS ENERGIZED THE VAV TERMINAL UNITS AIR FLOW SHALL INCREASE TO MAKE UP EXHAUST AIR 100 CFM LESS THE EXHAUST AIR FLOW (ADJUSTABLE).
 - THE SUPPLY AIR TERMINAL UNIT'S MINIMUM AND MAXIMUM VOLUME AIRFLOW SETTINGS SHALL BE AS INDICATED ON THE SHEET METAL FLOOR PLANS.
 - WHEN SPACE CARBON DIOXIDE LEVEL RISES ABOVE 1100 PPM SETPOINT, THE SUPPLY AIR TU CONTROLLER SHALL OVERRIDE TEMPERATURE CONTROL AND MODULATE DAMPER OPEN TO INCREASE SUPPLY AIRFLOW UNTIL CO2 SETPOINT IS SATISFIED. THE TEMPERING COIL VALVE SHALL BE MODULATED TO MAINTAIN SPACE TEMP SETPOINT. (NOTE: THERE IS NOT A REQUIREMENT TO INCREASE OUTSIDE AIRFLOW AT RELATED RTU IF CO2 LEVEL IS ABOVE SETPOINT WHEN TU DAMPER IS AT MAX POSITION).
 - WHEN SPACE CARBON DIOXIDE LEVEL FALLS BELOW 800 PPM SETPOINT AFTER BEING IN VENTILATION OVERRIDE MODE, THE TU DAMPER SHALL BE MODULATED CLOSED TOWARDS MINIMUM POSITION. THE TEMPERING COIL VALVE SHALL BE MODULATED TO MAINTAIN SPACE TEMP SETPOINT.
 - SPACE TEMPERATURE SETPOINTS SHALL BE AS FOLLOWS:
 HEATING UNOCCUPIED SETPOINT = 62F
 HEATING TEMPORARY UNOCCUPIED SETPOINT = 68F
 HEATING OCCUPIED SETPOINT = 70F
 COOLING OCCUPIED SETPOINT = 75F
 COOLING TEMPORARY UNOCCUPIED SETPOINT = 77F
 COOLING UNOCCUPIED SETPOINT = 80F
 - DURING BUILDING UNOCCUPANCY, RELATED AHU (RTU OR ERU) SHALL CYCLE AS REQUIRED TO MAINTAIN BUILDING SETBACK AND SETUP TEMP SETPOINTS.
 - WHEN RESPECTIVE AHU (RTU OR ERU) IS DEACTIVATED, THE AIR TERMINAL UNIT DAMPER SHALL REMAIN IN MINIMUM POSITION AND THE TEMPERING COIL VALVE SHALL REMAIN CLOSED. THE PERIMETER HEATING VALVE SHALL BE MODULATED TO MAINTAIN HEATING UNOCCUPIED SETPOINT.
 - THE DDC TERMINAL UNIT CONTROLLER SHALL RE-CALIBRATE THE AIRFLOW SENSOR ONCE A WEEK MINIMUM. THE RE-CALIBRATION PROCESS SHALL BE STAGGERED AMONGST THE TERMINAL UNITS SO THE DUCT STATIC PRESSURE DOES NOT EXCEED LIMITS.
 - CONTROL SIGNALS FOR AIR TERMINAL UNIT DAMPER ACTUATOR AND HEATING CONTROL OUTPUT(S) SHALL BE DISPLAYED WITH SYSTEM GRAPHICS.

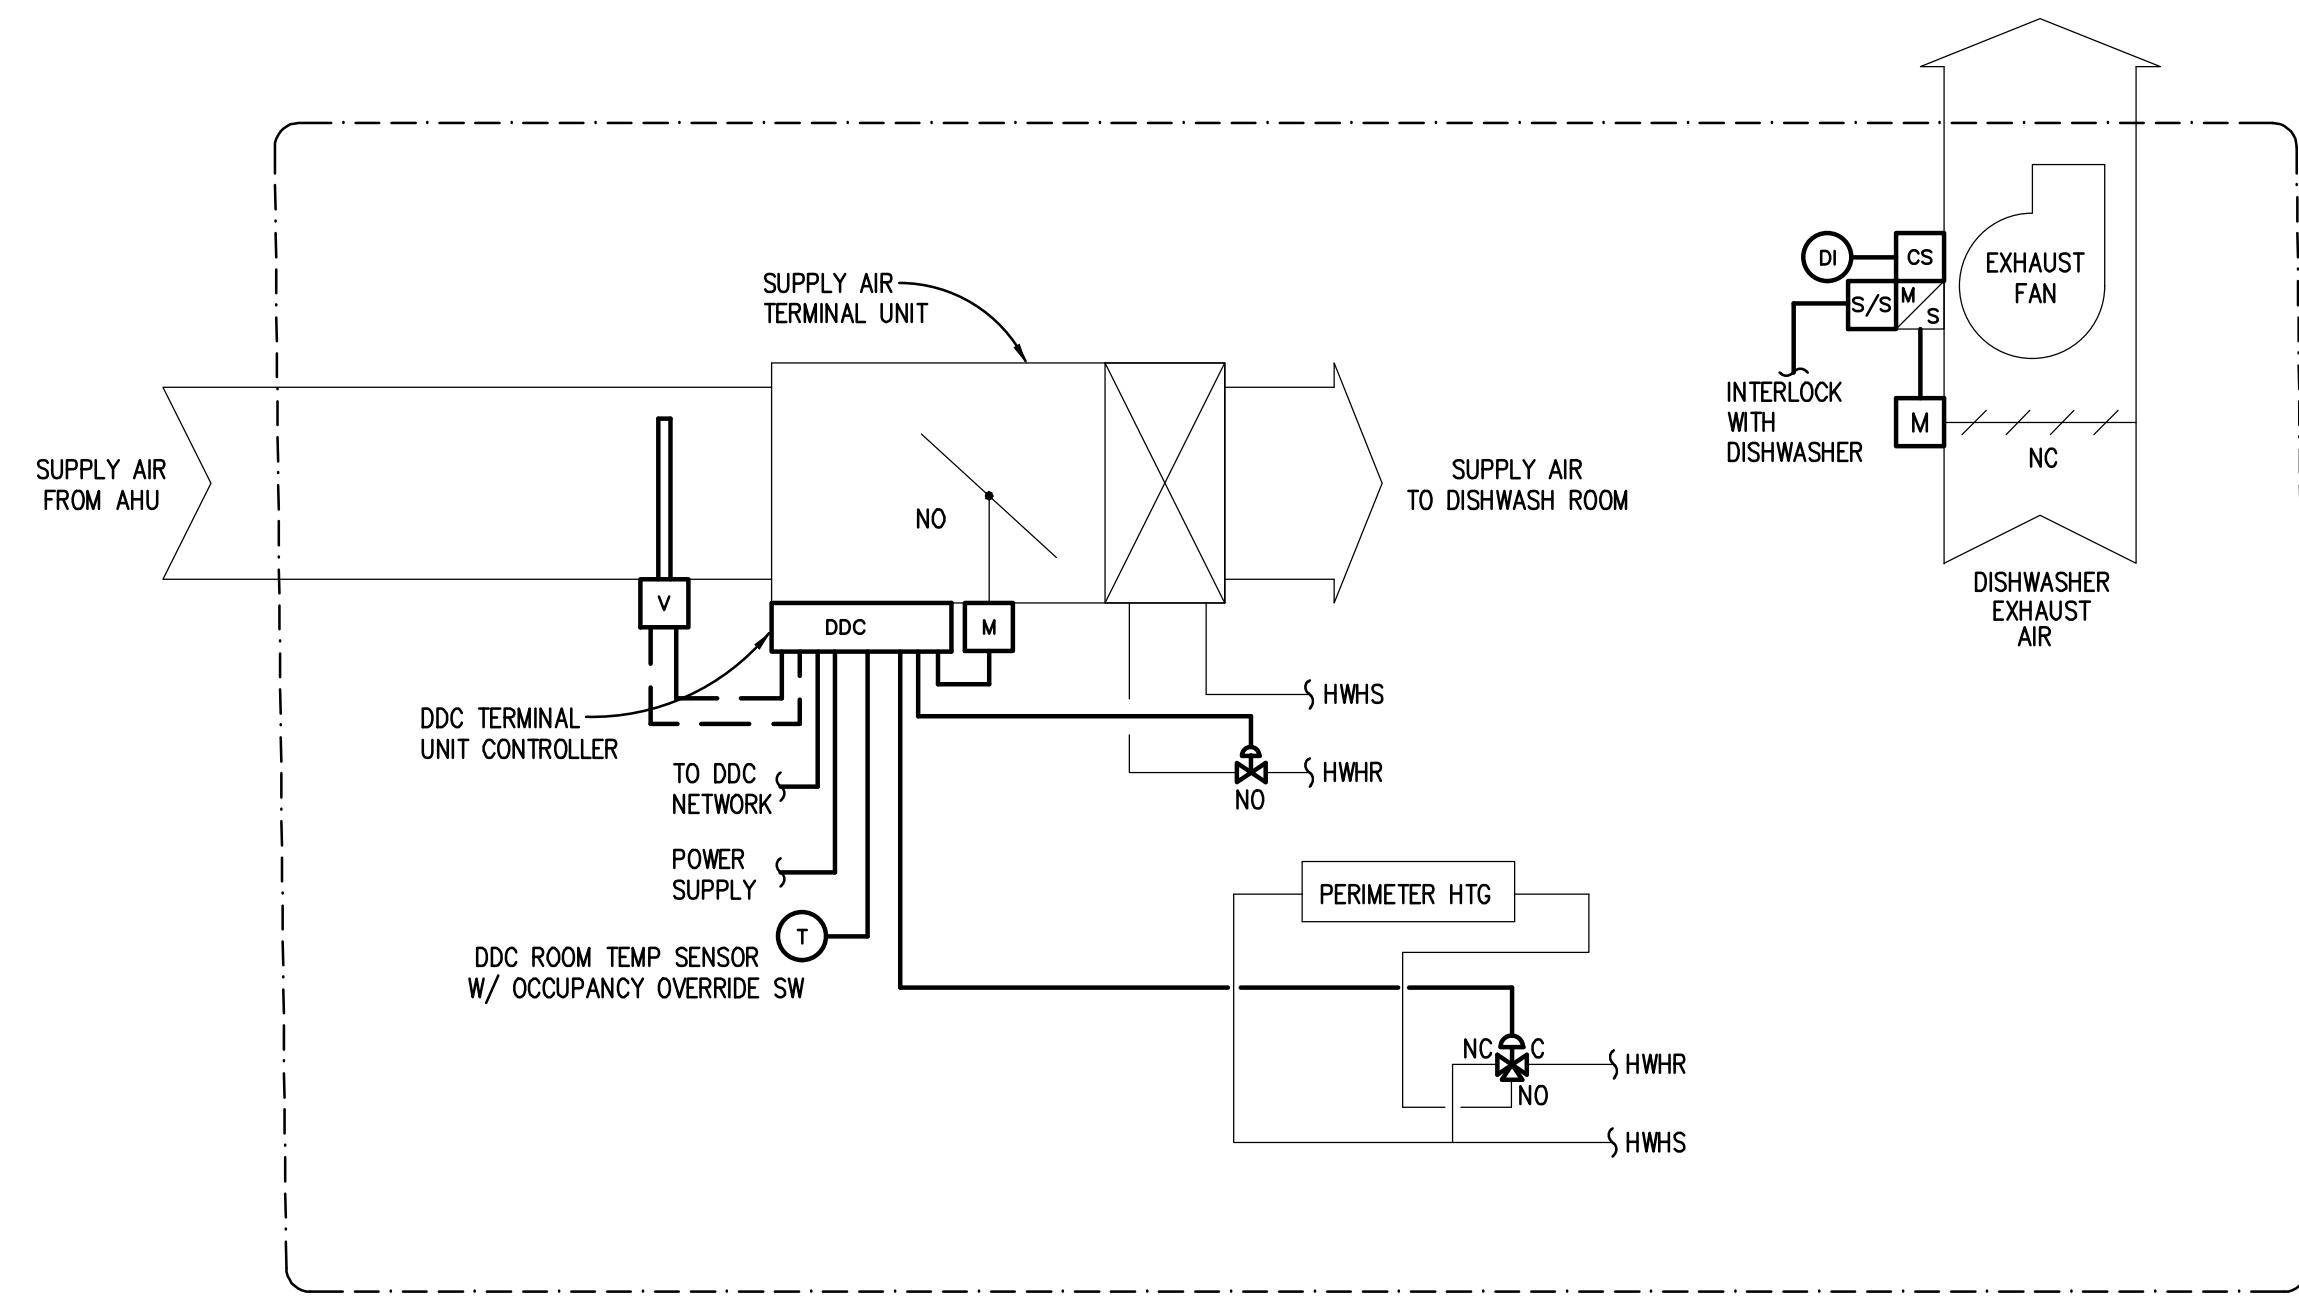

DISHWASH AREA TERMINAL UNIT CONTROL WITH PERIMETER HEAT CONTROL DIAGRAM

- NOTES:
- REFER TO SHEET METAL PLANS FOR LOCATIONS AND QUANTITY OF UNITS. REFER TO HVAC PIPING PLANS FOR LOCATIONS OF ROOM TEMP SENSORS.

REFER TO SHEET M801 FOR T.C. (TEMPERATURE CONTROL) GENERAL NOTES.

1	OWNER REVIEW	08/02/23
---	--------------	----------

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, R. DIRECTOR

FILE NO:
 491/20167.SDW

FUNDING CODE: 171CODH57255 CONTRACT NO.: Y22003

WTA ARCHITECTS
 100 S. Jefferson Ave, Suite 601
 Saginaw, Michigan 48607
 989 752 8107
 COPYRIGHT © 2023

PROJECT TITLE:
 491/20167.SDW - PHASE 500:
 CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
 SALINE, MICHIGAN

SHEET TITLE:
 TEMPERATURE CONTROLS


PROJECT NUMBER: 2021094 SHEET NUMBER:

PROJECT DATE: AUGUST 23, 2023 **M8.03**

CHECKED BY: WEK

Peter Basso Associates Inc
 CONSULTING ENGINEERS
 5145 Livernois, Suite 100
 Troy, Michigan 48068-3276
 Tel: 248-879-5666
 Fax: 248-879-0007
 www.PeterBassoAssociates.com
 PBA Project No. 2021-002

en:\2021\2021-0402-00\CA01\2021-0402-M8-CP.dwg, M-803, 9/5/2023, 4:33:20 PM, Gerard Henrich, Peter Basso Associates Inc.

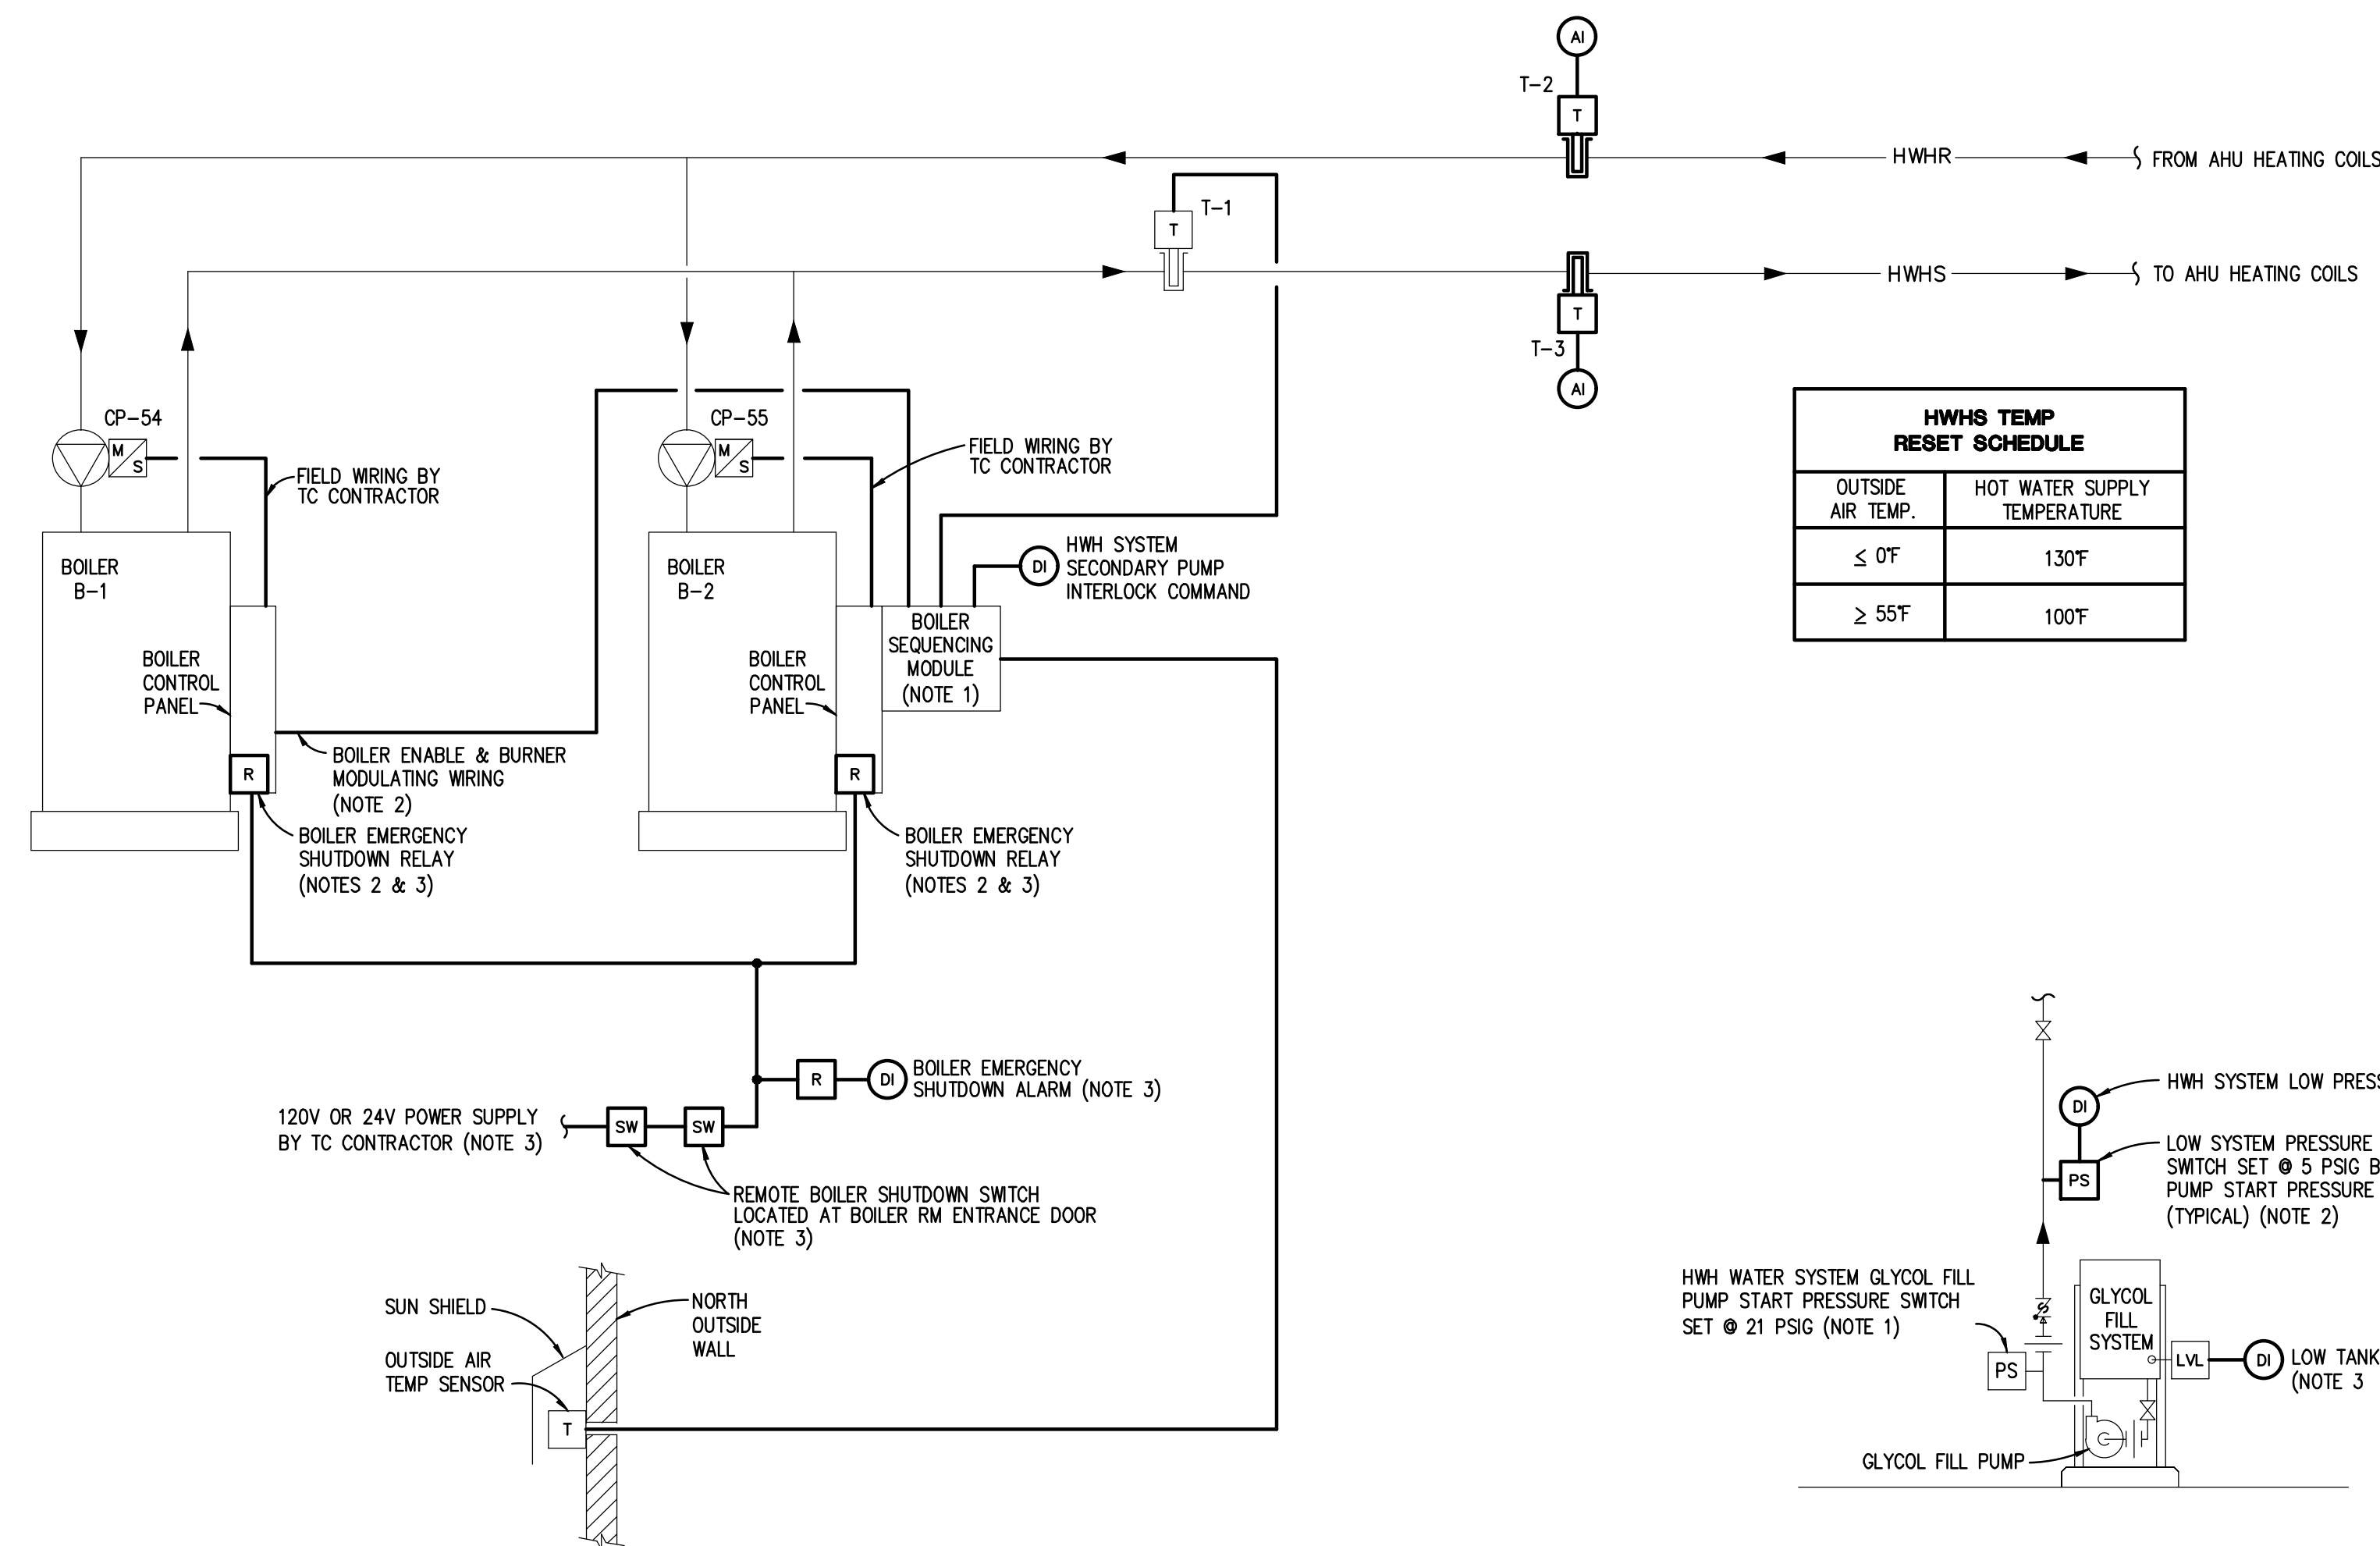

HHWS TEMP RESET SCHEDULE	
OUTSIDE AIR TEMP.	HOT WATER SUPPLY TEMPERATURE
≤ 0°F	130°F
≥ 55°F	100°F

SEQUENCE OF OPERATION

PENTHOUSE HOT WATER HEATING SYSTEM.

NOTE: ALL SETPOINTS, RESET SCHEDULE SETPOINTS, DEADBANDS, AND TIME INTERVALS DESCRIBED IN SEQUENCE SHALL BE ADJUSTABLE BY SYSTEM OPERATORS (CREATE REQUIRED VIRTUAL POINTS). ALL MOTOR CONTROL SWITCHES SHALL BE IN "AUTO" POSITION.

- HOT WATER HEATING SYSTEM SHALL BE ACTIVATED BY BOILER SEQUENCING PANEL WHEN OUTDOOR AIR TEMPERATURE IS BELOW 55°F.
- THE BOILER SEQUENCING PANEL SHALL ACTIVATE OR DEACTIVATE BOILERS AND CONTROL BOILER MODULATION AS REQUIRED TO MAINTAIN HHWS SUPPLY TEMP (T-1) SETPOINT BASED ON OUTSIDE AIR RESET SCHEDULE.
- THE BOILER SEQUENCING PANEL SHALL INCLUDE OPERATOR SELECTABLE BOILER LEAD/LAG OPERATION OR FIRST ON/FIRST OFF OPERATION.
- WHENEVER A BOILER CIRCUIT IS ACTIVATED, ITS ASSOCIATED PRIMARY CIRC PUMP SHALL BE ACTIVATED BY FACTORY WIRED PUMP RELAY.
- WHENEVER A BOILER IS DEACTIVATED, ITS ASSOCIATED PRIMARY CIRC PUMP SHALL CONTINUE TO RUN BASED ON BOILER CONTROLLER TIME DELAY RELAY TO DISSIPATE HEAT FROM THE DEACTIVATED BOILER.
- IF REMOTE CONTROL IS LOST, LOCAL BURNER MODULATING CONTROL AT EACH BOILER SHALL BE SET TO MAINTAIN 130°F LEAVING WATER TEMPERATURE.
- EACH BOILER SAFETY CONTROLS SHALL INCLUDE AN AUTO-RESET H-LIMIT (BOILER OPERATOR) WITH SETPOINT OF 195°F AND A MANUAL-RESET H-LIMIT WITH SETPOINT OF 215°F.
- DDC SYSTEM SHALL MONITOR SYSTEM TEMPERATURE T-2 THRU T-3 FOR SYSTEM DIAGNOSTICS.
- WHEN ONE OF THE REMOTE BOILER SYSTEM SHUTDOWN SWITCHES IS PUSHED, BURNER CONTROLS FOR ALL BOILERS SHALL BE DE-ENERGIZED THRU HARDWIRE INTERLOCK. DDC SHALL MONITOR SWITCH CIRCUIT AND ACTIVATE LOCAL ALARM INDICATION LIGHT WHEN REMOTE BOILER SYSTEM SHUTDOWN CONDITION OCCURS.

HOT WATER HEATING SYSTEM CONTROL

NOTES:


- BOILER SEQUENCING PANEL SHALL BE FURNISHED BY THE BOILER SUPPLIER AND INSTALLED AND WIRED BY THE TC CONTRACTOR. NOTE: SEQUENCING PANEL MAY BE INCLUDED WITHIN ONE OF THE BOILER CONTROL PANELS, COORDINATE WITH BOILER SUPPLIER. IF A REMOTE SEQUENCING PANEL IS PROVIDED, THE TC CONTRACTOR SHALL PROVIDE 120V POWER SUPPLY FROM NEAREST AVAILABLE POWER PANEL SPARE CIRCUIT.
- COORDINATE ALL WIRING AND TERMINATIONS WITH BOILER SUPPLIER.
- TC CONTRACTOR SHALL PROVIDE BOILER EMERGENCY AND DOMESTIC HW NATURAL GAS SHUTDOWN COMPONENTS AND WIRING. REFER TO REMOTE BOILER SHUTDOWN WIRING DIAGRAM.

GLYCOL FILL STATION MONITORING

GLYCOL FILL STATION SERVES HHWS SYSTEM


NOTES:

- PUMP CONTROL PRESSURE SWITCH AND ASSOCIATED CONTROL WIRING ARE PROVIDED WITH GLYCOL FILL STATION.
- PRESSURE SWITCH FOR ALARM MONITORING SHALL BE FURNISHED BY TC CONTRACTOR AND INSTALLED BY MECHANICAL CONTRACTOR.
- DRY CONTACTS FOR REMOTE MONITORING OF LOW TANK RESERVE ALARM PROVIDED WITH GLYCOL FILL STATION.

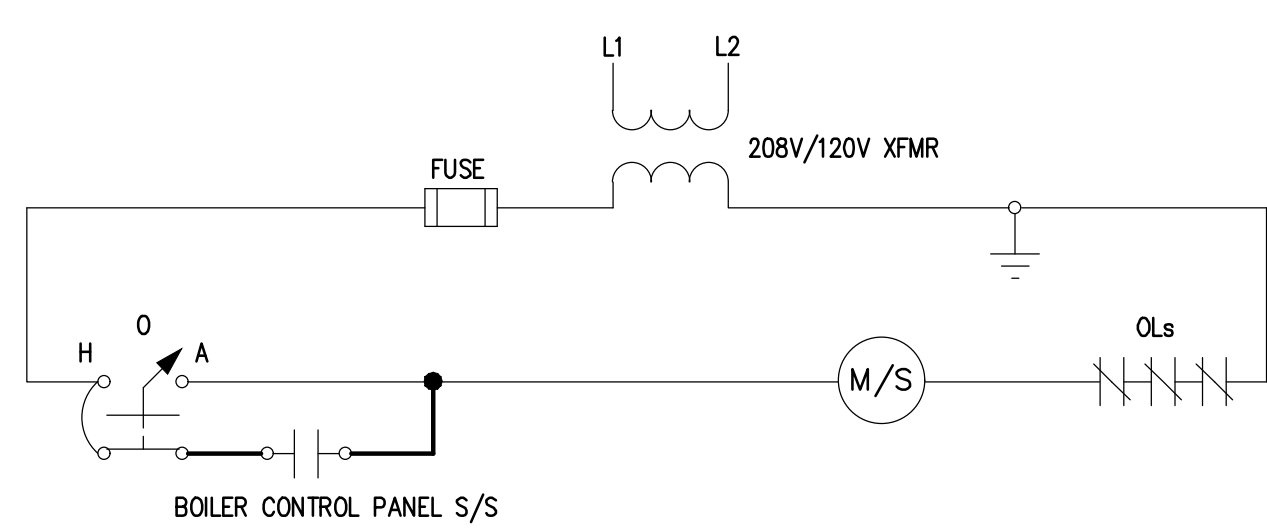

TYPICAL BOILER CP M/S WIRING

INTERLOCKED TO RESPECTIVE BOILER

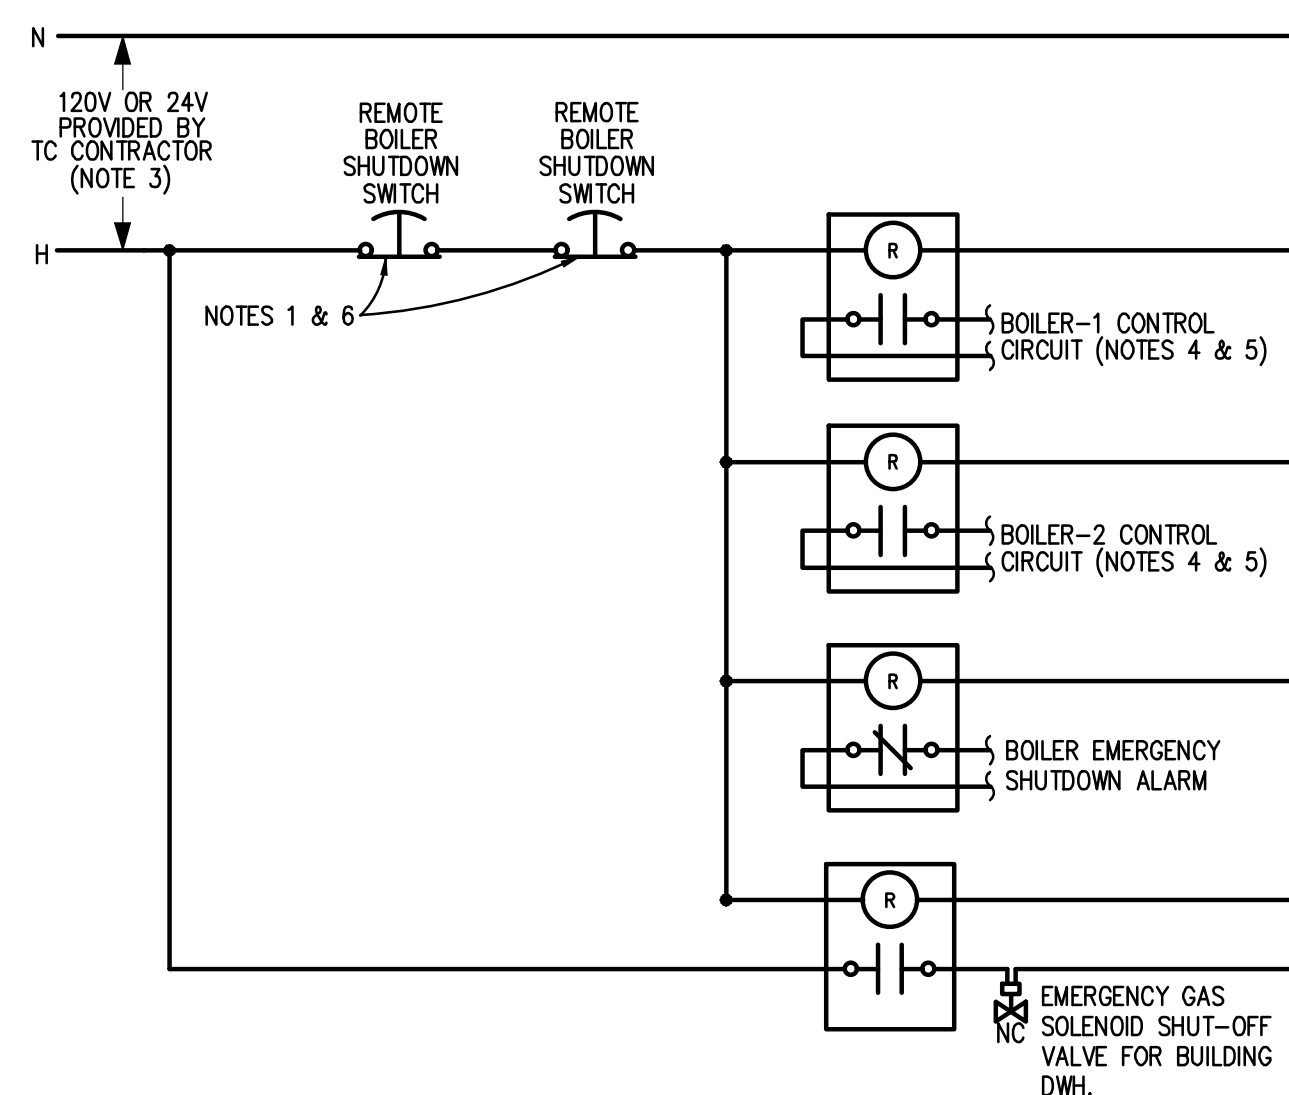

REMOTE BOILER EMERGENCY SHUTDOWN WIRING

SEQUENCE OF OPERATION


SEQUENCE OF OPERATION:

- UNDER NORMAL OPERATING CONDITIONS THE CIRCUIT SHALL BE ENERGIZED AND THE CUT-OUT RELAYS NORMALLY OPEN (NO) CONTACTS SHALL BE CLOSED TO ENERGIZE BOILER CONTROL CIRCUITS AND OPEN THE DOMESTIC HW SYSTEMS NATURAL GAS SOLENOID VALVES. WHEN A SWITCH IS PUSHED (LATCHED) THE CUT-OUT RELAY CONTACTS SHALL INTERRUPT BOILERS CONTROL CIRCUITS AND CLOSE THE DOMESTIC HW SYSTEM SOLENOID VALVE. THE SWITCH MUST BE MANUALLY RELEASED TO ALLOW NORMAL OPERATION.
- DDC SHALL ACTIVATE EMERGENCY SHUTDOWN ALARM IN DDC SYSTEM WHEN A REMOTE SWITCH HAS BEEN PUSHED.

OA SENSOR INSTALLATION DETAIL

NO SCALE

- TC CONTRACTOR HAS THE OPTION OF USING EXISTING OA TEMP AND HUMIDITY SENSORS AS AVAILABLE FOR BUILDING.
- CALCULATE OA ENTHALPY OR DEW POINT TEMPERATURE AS REQUIRED PER SEQUENCE OF OPERATION REQUIREMENTS.
- BROADCAST OUTSIDE AIR TEMPERATURE, HUMIDITY, AND CALCULATED OA ENTHALPY OR DEWPOINT TEMPERATURE, AS REQUIRED, THROUGH BAS COMMUNICATION NETWORK TO CONTROLLERS REQUIRING INFORMATION FOR DDC PROGRAMMING LOGIC.

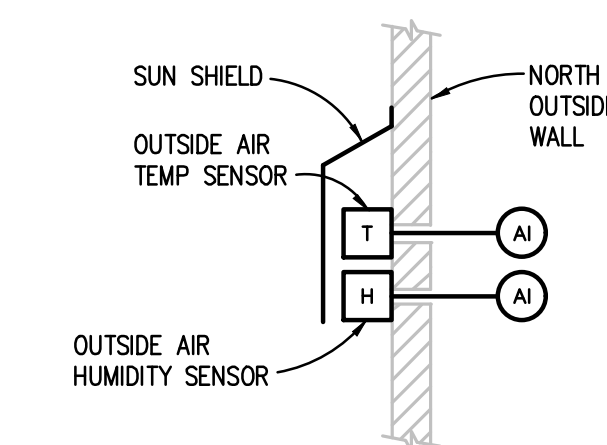

en:\2021\2021-0402-00\CAD\2021-0402-MB-CP.dwg, M-804, 9/5/2023 4:33:21 PM, Gerard Henrich, Peter Basso Associates Inc.

REFER TO SHEET M801 FOR T.C. (TEMPERATURE CONTROL) GENERAL NOTES.

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, R.A. DIRECTOR

FILE NO.

491/20167.SDW

FUNDING CODE

171CODHHS7255

CONTRACT NO.

Y22003



WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

WTAARCH.COM

COPYRIGHT © 2023

PROJECT TITLE

491/20167.SDW - PHASE 500:

CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN

SALINE, MICHIGAN

SHEET TITLE

TEMPERATURE CONTROLS

PROJECT NUMBER

2021094

SHEET NUMBER

M8.04

PROJECT DATE



AUGUST 23, 2023

CHECKED BY

WEK

Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2021094

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

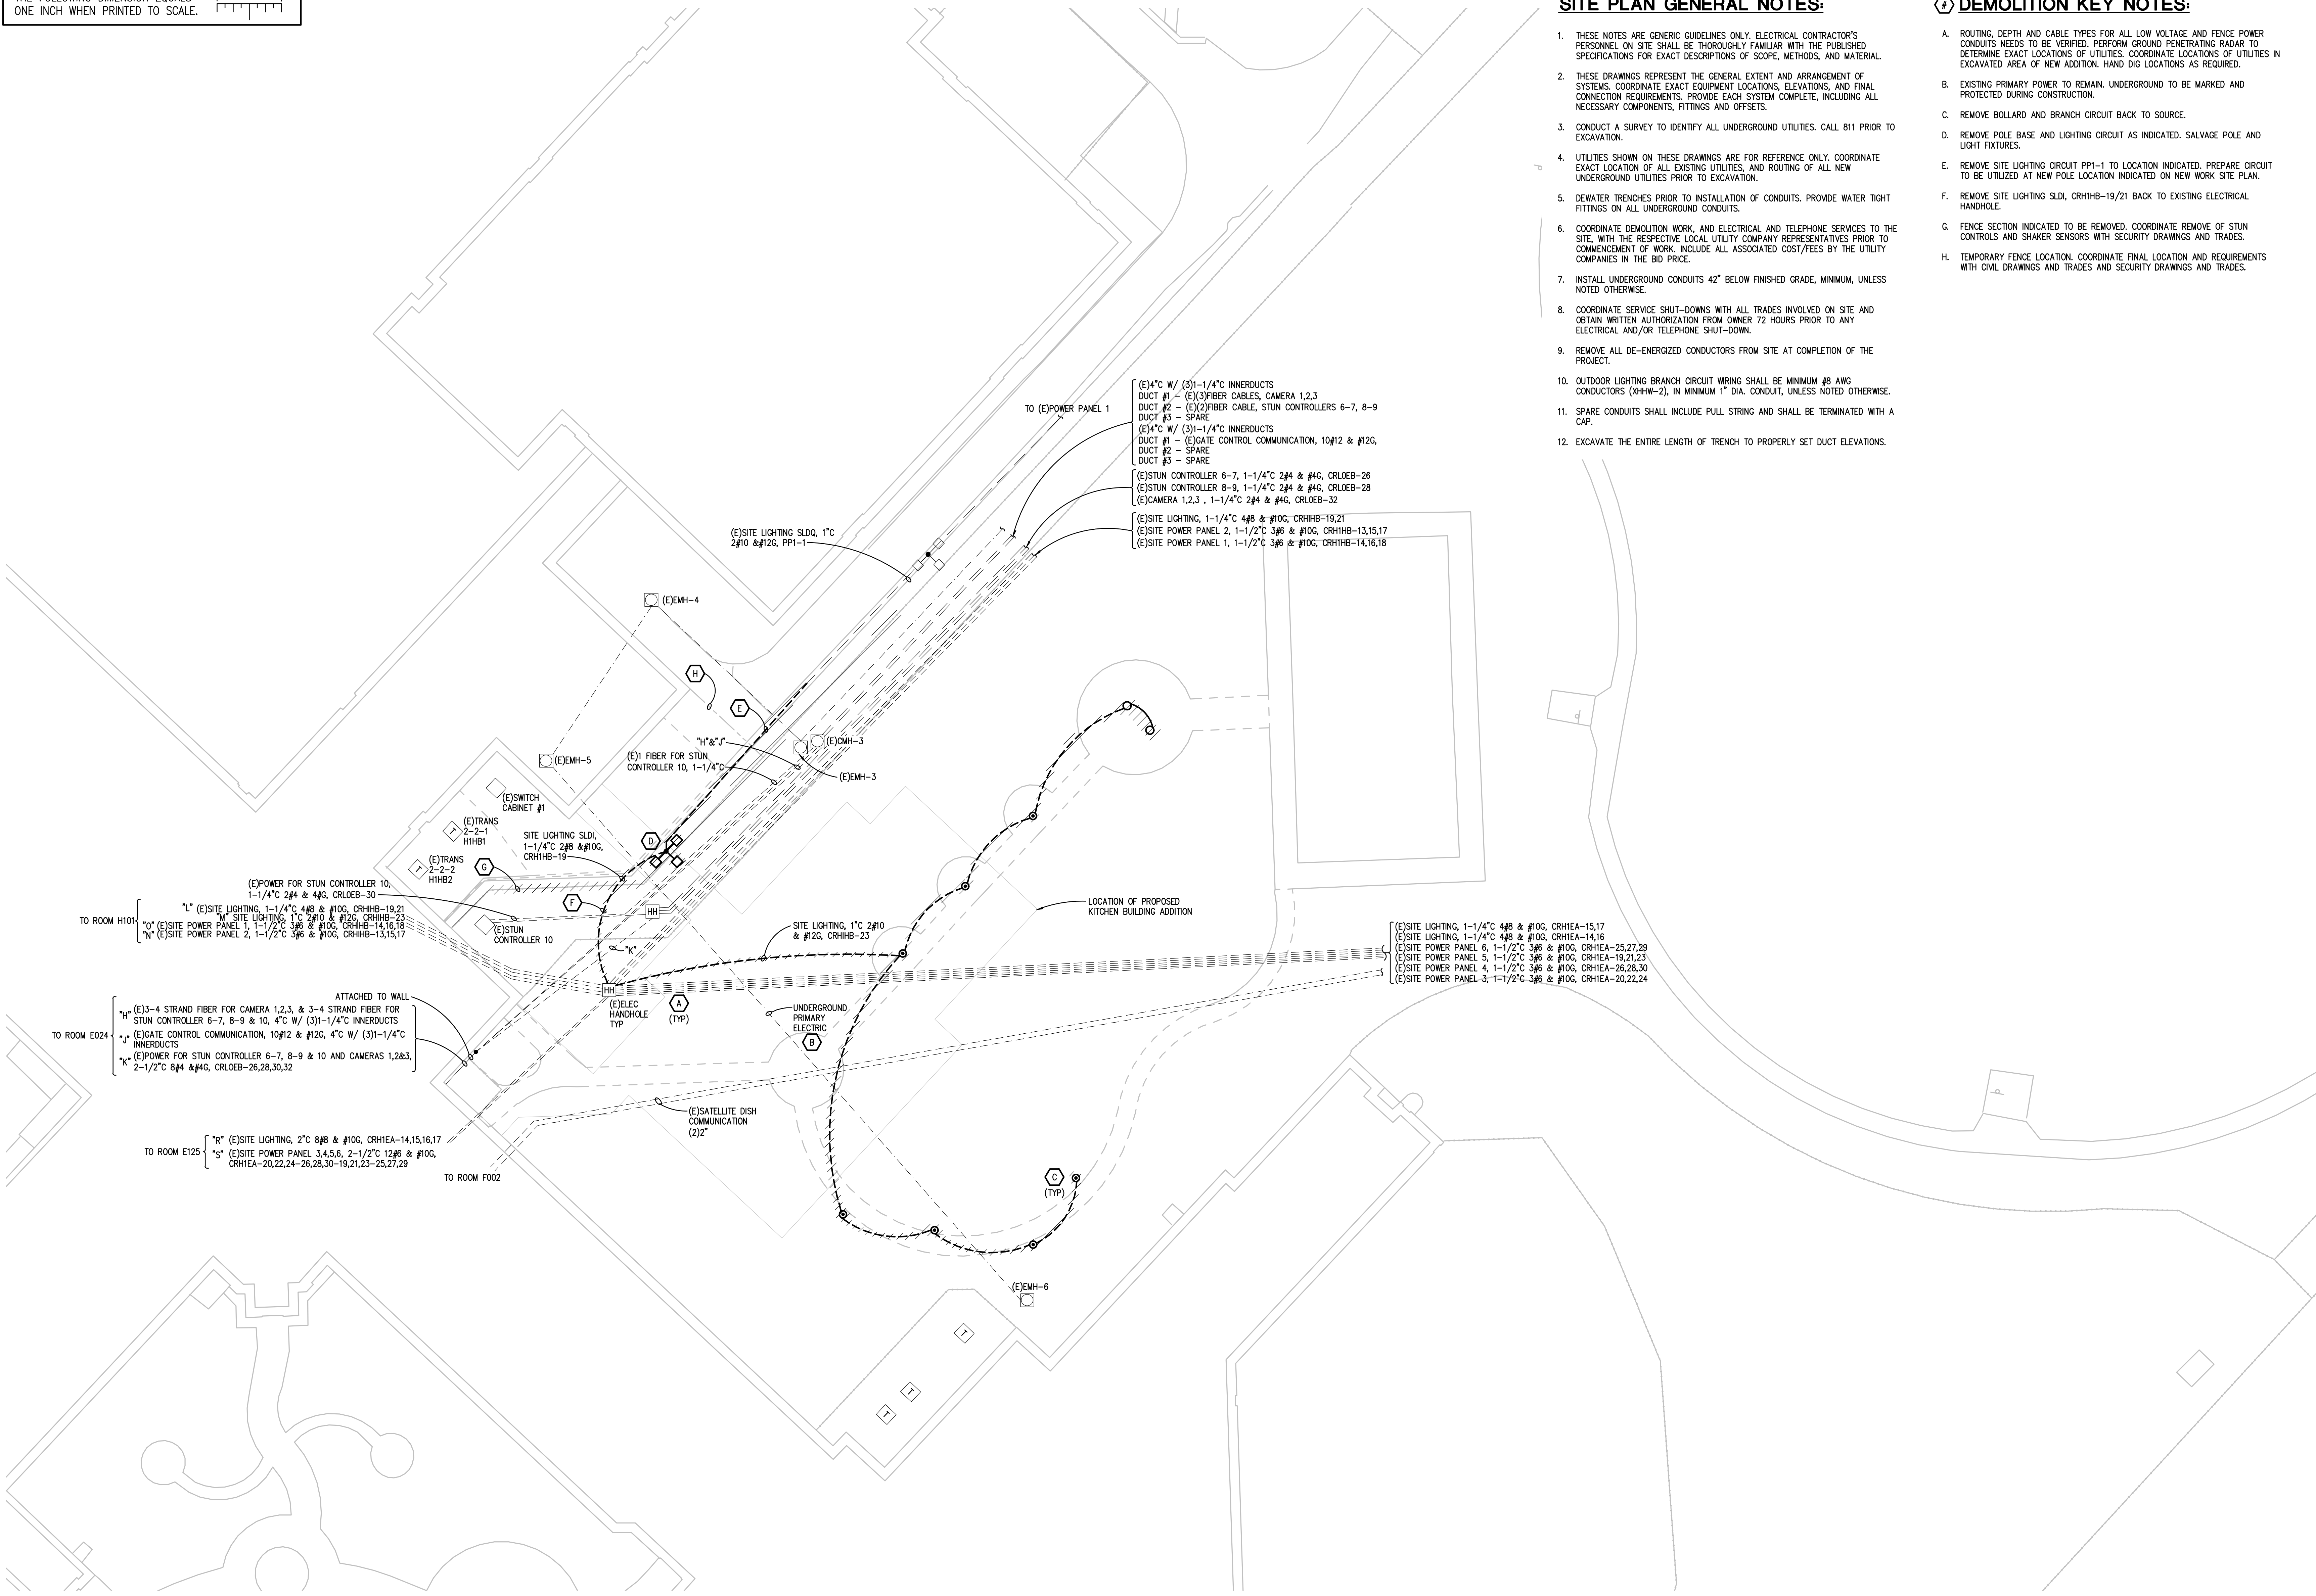

SITE PLAN GENERAL NOTES:

- THESE NOTES ARE GENERIC GUIDELINES ONLY. ELECTRICAL CONTRACTOR'S PERSONNEL ON SITE SHALL BE THOROUGHLY FAMILIAR WITH THE PUBLISHED SPECIFICATIONS FOR EXACT DESCRIPTIONS OF SCOPE, METHODS, AND MATERIAL.
- THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- CONDUCT A SURVEY TO IDENTIFY ALL UNDERGROUND UTILITIES. CALL 811 PRIOR TO EXCAVATION.
- UTILITIES SHOWN ON THESE DRAWINGS ARE FOR REFERENCE ONLY. COORDINATE EXACT LOCATION OF ALL EXISTING UTILITIES, AND ROUTING OF ALL NEW UNDERGROUND UTILITIES PRIOR TO EXCAVATION.
- DEWATER TRENCHES PRIOR TO INSTALLATION OF CONDUITS. PROVIDE WATER TIGHT FITTINGS ON ALL UNDERGROUND CONDUITS.
- COORDINATE DEMOLITION WORK, AND ELECTRICAL AND TELEPHONE SERVICES TO THE SITE, WITH THE RESPECTIVE LOCAL UTILITY COMPANY REPRESENTATIVES PRIOR TO COMMENCEMENT OF WORK. INCLUDE ALL ASSOCIATED COSTS/FEE'S BY THE UTILITY COMPANIES IN THE BID PRICE.
- INSTALL UNDERGROUND CONDUITS 42" BELOW FINISHED GRADE, MINIMUM, UNLESS NOTED OTHERWISE.
- COORDINATE SERVICE SHUT-DOWNS WITH ALL TRADES INVOLVED ON SITE AND OBTAIN WRITTEN AUTHORIZATION FROM OWNER 72 HOURS PRIOR TO ANY ELECTRICAL AND/OR TELEPHONE SHUT-DOWN.
- REMOVE ALL DE-ENERGIZED CONDUCTORS FROM SITE AT COMPLETION OF THE PROJECT.
- OUTDOOR LIGHTING BRANCH CIRCUIT WIRING SHALL BE MINIMUM #8 AWG CONDUCTORS (XHHW-2), IN MINIMUM 1" DIA. CONDUIT, UNLESS NOTED OTHERWISE.
- SPARE CONDUITS SHALL INCLUDE PULL STRING AND SHALL BE TERMINATED WITH A CAP.
- EXCAVATE THE ENTIRE LENGTH OF TRENCH TO PROPERLY SET DUCT ELEVATIONS.

DEMOLITION KEY NOTES:

- ROUTING, DEPTH AND CABLE TYPES FOR ALL LOW VOLTAGE AND FENCE POWER CONDUITS NEEDS TO BE VERIFIED. PERFORM GROUND PENETRATING RADAR TO DETERMINE EXACT LOCATIONS OF UTILITIES. COORDINATE LOCATIONS OF UTILITIES IN EXCAVATED AREA OF NEW ADDITION. HAND DIG LOCATIONS AS REQUIRED.
- EXISTING PRIMARY POWER TO REMAIN UNDERGROUND TO BE MARKED AND PROTECTED DURING CONSTRUCTION.
- REMOVE BOLLARD AND BRANCH CIRCUIT BACK TO SOURCE.
- REMOVE POLE BASE AND LIGHTING CIRCUIT AS INDICATED. SALVAGE POLE AND LIGHT FIXTURES.
- REMOVE SITE LIGHTING CIRCUIT PP1-1 TO LOCATION INDICATED. PREPARE CIRCUIT TO BE UTILIZED AT NEW POLE LOCATION INDICATED ON NEW WORK SITE PLAN.
- REMOVE SITE LIGHTING SLDI, CRHHB-19/21 BACK TO EXISTING ELECTRICAL HANDHOLE.
- FENCE SECTION INDICATED TO BE REMOVED. COORDINATE REMOVE OF STUN CONTROLS AND SHAKER SENSORS WITH SECURITY DRAWINGS AND TRADES.
- TEMPORARY FENCE LOCATION. COORDINATE FINAL LOCATION AND REQUIREMENTS WITH CIVIL DRAWINGS AND TRADES AND SECURITY DRAWINGS AND TRADES.

(E)4" W / (3)1-1/4" INNERDUCTS
 DUCT #1 - (E)3" FIBER CABLES, CAMERA 1,2,3
 DUCT #2 - (E)3" FIBER CABLE, STUN CONTROLLERS 6-7, 8-9
 DUCT #3 - SPARE
 (E)4" W / (3)1-1/4" INNERDUCTS
 DUCT #1 - (E)GATE CONTROL COMMUNICATION, 10#12 & #12G,
 DUCT #2 - SPARE
 DUCT #3 - SPARE
 (E)STUN CONTROLLER 6-7, 1-1/4" 2#4 & #4G, CRLOEB-26
 (E)STUN CONTROLLER 8-9, 1-1/4" 2#4 & #4G, CRLOEB-28
 (E)CAMERA 1,2,3, 1-1/4" 2#4 & #4G, CRLOEB-32
 (E)SITE LIGHTING, 1-1/4" 4#8 & #10G, CRHHB-19,21
 (E)SITE POWER PANEL 2, 1-1/2" 3#6 & #10G, CRHHB-13,15,17
 (E)SITE POWER PANEL 1, 1-1/2" 3#6 & #10G, CRHHB-14,16,18

(E)SITE LIGHTING, 1-1/4" 4#8 & #10G, CRHEA-15,17
 (E)SITE LIGHTING, 1-1/4" 4#8 & #10G, CRHEA-14,16
 (E)SITE POWER PANEL 6, 1-1/2" 3#6 & #10G, CRHEA-25,27,29
 (E)SITE POWER PANEL 5, 1-1/2" 3#6 & #10G, CRHEA-19,21,23
 (E)SITE POWER PANEL 4, 1-1/2" 3#6 & #10G, CRHEA-26,28,30
 (E)SITE POWER PANEL 3, 1-1/2" 3#6 & #10G, CRHEA-20,22,24

ELECTRICAL DEMOLITION SITE PLAN
 SCALE: 1" = 20'

en:\2021\2021-0402-00\CAD\2021-0402-ED-SPD.dwg, E0.03, 9/5/2023, 4:31:11 PM, Gerard Henrich, Peter Basso Associates Inc.

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW
 FUNDING CODE
171CODHHS7255
 CONTRACT NO.
Y22003



WTA ARCHITECTS
 100 S. Jefferson Ave., Suite 601
 Saginaw, Michigan 48607
 989 752 8107
 COPYRIGHT © 2023

PROJECT TITLE 491/20167.SDW - PHASE 500: CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN SALINE, MICHIGAN	
SHEET TITLE ELECTRICAL DEMOLITION SITE PLAN	
PROJECT NUMBER 2021094	SHEET NUMBER E0.03
PROJECT DATE AUGUST 23, 2023	
CHECKED BY TLC	

811
 Know what's below.
 Call before you dig.

PBA
 Peter Basso Associates Inc
 CONSULTING ENGINEERS
 5145 Livernois, Suite 100
 Troy, Michigan 48068-3276
 Tel: 248-879-5666
 Fax: 248-879-0007
 www.PeterBassoAssociates.com
 PBA Project No. 2021-0402

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

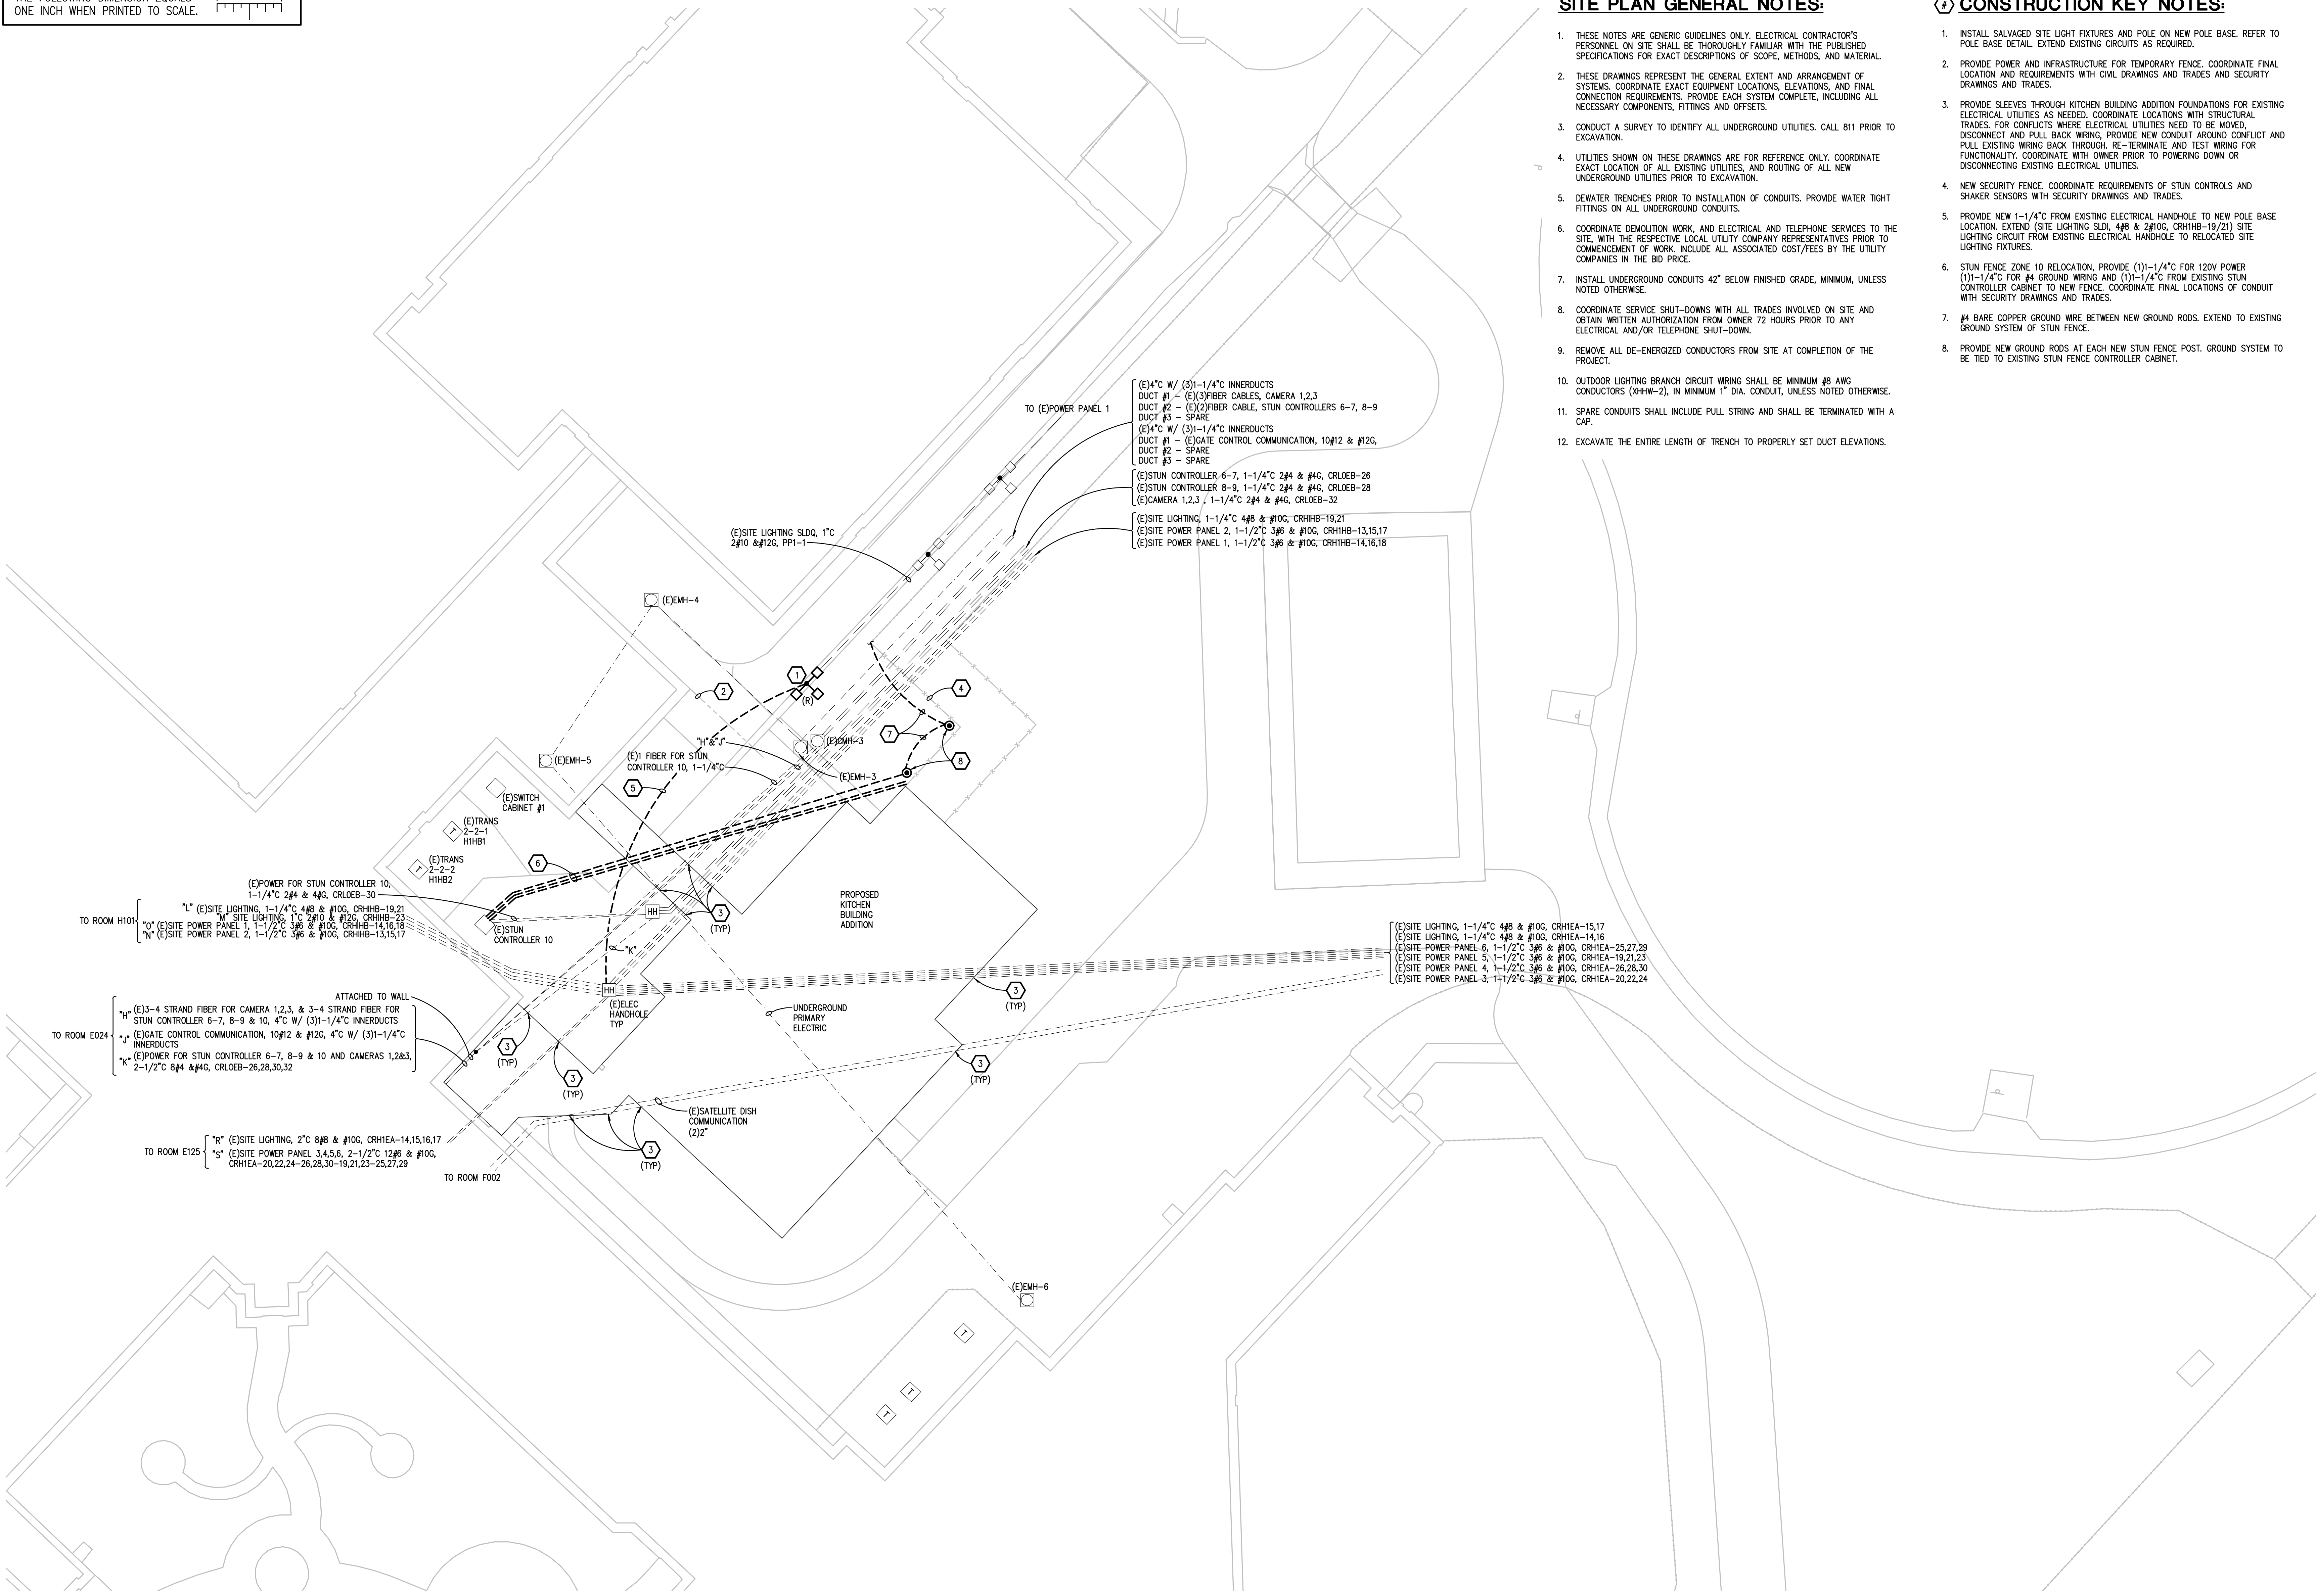

SITE PLAN GENERAL NOTES:

1. THESE NOTES ARE GENERIC GUIDELINES ONLY. ELECTRICAL CONTRACTOR'S PERSONNEL ON SITE SHALL BE THOROUGHLY FAMILIAR WITH THE PUBLISHED SPECIFICATIONS FOR EXACT DESCRIPTIONS OF SCOPE, METHODS, AND MATERIAL.
2. THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
3. CONDUCT A SURVEY TO IDENTIFY ALL UNDERGROUND UTILITIES. CALL 811 PRIOR TO EXCAVATION.
4. UTILITIES SHOWN ON THESE DRAWINGS ARE FOR REFERENCE ONLY. COORDINATE EXACT LOCATION OF ALL EXISTING UTILITIES, AND ROUTING OF ALL NEW UNDERGROUND UTILITIES PRIOR TO EXCAVATION.
5. DEWATER TRENCHES PRIOR TO INSTALLATION OF CONDUITS. PROVIDE WATER TIGHT FITTINGS ON ALL UNDERGROUND CONDUITS.
6. COORDINATE DEMOLITION WORK, AND ELECTRICAL AND TELEPHONE SERVICES TO THE SITE, WITH THE RESPECTIVE LOCAL UTILITY COMPANY REPRESENTATIVES PRIOR TO COMMENCEMENT OF WORK. INCLUDE ALL ASSOCIATED COSTS/FEE'S BY THE UTILITY COMPANIES IN THE BID PRICE.
7. INSTALL UNDERGROUND CONDUITS 42" BELOW FINISHED GRADE, MINIMUM, UNLESS NOTED OTHERWISE.
8. COORDINATE SERVICE SHUT-DOWNS WITH ALL TRADES INVOLVED ON SITE AND OBTAIN WRITTEN AUTHORIZATION FROM OWNER 72 HOURS PRIOR TO ANY ELECTRICAL, AND/OR TELEPHONE SHUT-DOWN.
9. REMOVE ALL DE-ENERGIZED CONDUCTORS FROM SITE AT COMPLETION OF THE PROJECT.
10. OUTDOOR LIGHTING BRANCH CIRCUIT WIRING SHALL BE MINIMUM #8 AWG CONDUCTORS (XHHW-2), IN MINIMUM 1" DIA. CONDUIT, UNLESS NOTED OTHERWISE.
11. SPARE CONDUITS SHALL INCLUDE PULL STRING AND SHALL BE TERMINATED WITH A CAP.
12. EXCAVATE THE ENTIRE LENGTH OF TRENCH TO PROPERLY SET DUCT ELEVATIONS.

CONSTRUCTION KEY NOTES:

1. INSTALL SALVAGED SITE LIGHT FIXTURES AND POLE ON NEW POLE BASE. REFER TO POLE BASE DETAIL. EXTEND EXISTING CIRCUITS AS REQUIRED.
2. PROVIDE POWER AND INFRASTRUCTURE FOR TEMPORARY FENCE. COORDINATE FINAL LOCATION AND REQUIREMENTS WITH CIVIL DRAWINGS AND TRADES AND SECURITY DRAWINGS AND TRADES.
3. PROVIDE SLEEVES THROUGH KITCHEN BUILDING ADDITION FOUNDATIONS FOR EXISTING ELECTRICAL UTILITIES AS NEEDED. COORDINATE LOCATIONS WITH STRUCTURAL TRADES. FOR CONDUITS WHERE ELECTRICAL UTILITIES NEED TO BE MOVED, DISCONNECT AND PULL BACK THROUGH. PROVIDE NEW CONDUIT AROUND CONFLICT AND PULL EXISTING WIRING BACK THROUGH. RE-TERMINATE AND TEST WIRING FOR FUNCTIONALITY. COORDINATE WITH OWNER PRIOR TO POWERING DOWN OR DISCONNECTING EXISTING ELECTRICAL UTILITIES.
4. NEW SECURITY FENCE. COORDINATE REQUIREMENTS OF STUN CONTROLS AND SHAKER SENSORS WITH SECURITY DRAWINGS AND TRADES.
5. PROVIDE NEW 1-1/4" FROM EXISTING ELECTRICAL HANDHOLE TO NEW POLE BASE LOCATION. EXTEND (SITE LIGHTING SLDL, #8 & #10G, CRHHB-19/21) SITE LIGHTING CIRCUIT FROM EXISTING ELECTRICAL HANDHOLE TO RELOCATED SITE LIGHTING FIXTURES.
6. STUN FENCE ZONE 10 RELOCATION, PROVIDE (1)1-1/4" FOR 120V POWER (1)1-1/4" FOR #4 GROUND WIRING AND (1)1-1/4" FROM EXISTING STUN CONTROLLER CABINET TO NEW FENCE. COORDINATE FINAL LOCATIONS OF CONDUIT WITH SECURITY DRAWINGS AND TRADES.
7. #4 BARE COPPER GROUND WIRE BETWEEN NEW GROUND RODS. EXTEND TO EXISTING GROUND SYSTEM OF STUN FENCE.
8. PROVIDE NEW GROUND RODS AT EACH NEW STUN FENCE POST. GROUND SYSTEM TO BE TIED TO EXISTING STUN FENCE CONTROLLER CABINET.

TO (E)POWER PANEL 1
 (E)4" W / (3)1-1/4" INNERDUCTS
 DUCT #1 - (E)3" FIBER CABLES, CAMERA 1,2,3
 DUCT #2 - (E)2" FIBER CABLE, STUN CONTROLLERS 6-7, 8-9
 DUCT #3 - SPARE
 (E)4" W / (3)1-1/4" INNERDUCTS
 DUCT #1 - (E)GATE CONTROL COMMUNICATION, 10#12 & #12G,
 DUCT #2 - SPARE
 DUCT #3 - SPARE
 (E)STUN CONTROLLER 6-7, 1-1/4" 2#4 & #4G, CRLOEB-26
 (E)STUN CONTROLLER 8-9, 1-1/4" 2#4 & #4G, CRLOEB-28
 (E)CAMERA 1,2,3, 1-1/4" 2#4 & #4G, CRLOEB-32
 (E)SITE LIGHTING, 1-1/4" 4#8 & #10G, CRHIB-19,21
 (E)SITE POWER PANEL 2, 1-1/2" 3#6 & #10G, CRHIB-13,15,17
 (E)SITE POWER PANEL 1, 1-1/2" 3#6 & #10G, CRHIB-14,16,18

(E)SITE LIGHTING, 1-1/4" 4#8 & #10G, CRHIEA-15,17
 (E)SITE LIGHTING, 1-1/4" 4#8 & #10G, CRHIEA-14,16
 (E)SITE POWER PANEL 6, 1-1/2" 3#6 & #10G, CRHIEA-25,27,29
 (E)SITE POWER PANEL 5, 1-1/2" 3#6 & #10G, CRHIEA-19,21,23
 (E)SITE POWER PANEL 4, 1-1/2" 3#6 & #10G, CRHIEA-26,28,30
 (E)SITE POWER PANEL 3, 1-1/2" 3#6 & #10G, CRHIEA-20,22,24

ELECTRICAL NEW WORK SITE PLAN
 SCALE: 1" = 20'

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, RA, DIRECTOR

FILE NO.
 491/20167.SDW
 FUNDING CODE
 171CODHHS7255
 CONTRACT NO.
 Y22003

WTA ARCHITECTS
 100 S. Jefferson Ave, Suite 601
 Saginaw, Michigan 48607
 989 752 8107
 COPYRIGHT © 2023


PROJECT TITLE 491/20167.SDW - PHASE 500: CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN SALINE, MICHIGAN	
SHEET TITLE ELECTRICAL NEW WORK SITE PLAN	
PROJECT NUMBER 2021094	SHEET NUMBER E0.04
PROJECT DATE AUGUST 23, 2023	CHECKED BY TLC

811
 Know what's below.
 Call before you dig.

Peter Basso Associates Inc
 CONSULTING ENGINEERS
 5145 Livernois, Suite 100
 Troy, Michigan 48068-3276
 Tel: 248-879-5666
 Fax: 248-879-0007
 www.PeterBassoAssociates.com
 PBA Project No. 2023.0002

en:\2021\2021-0402-00\CAD\2021-0402-ED-SPN.dwg, ED.04, 9/5/2023 4:31:17 PM, Gerard Henrich, Peter Basso Associates Inc.

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

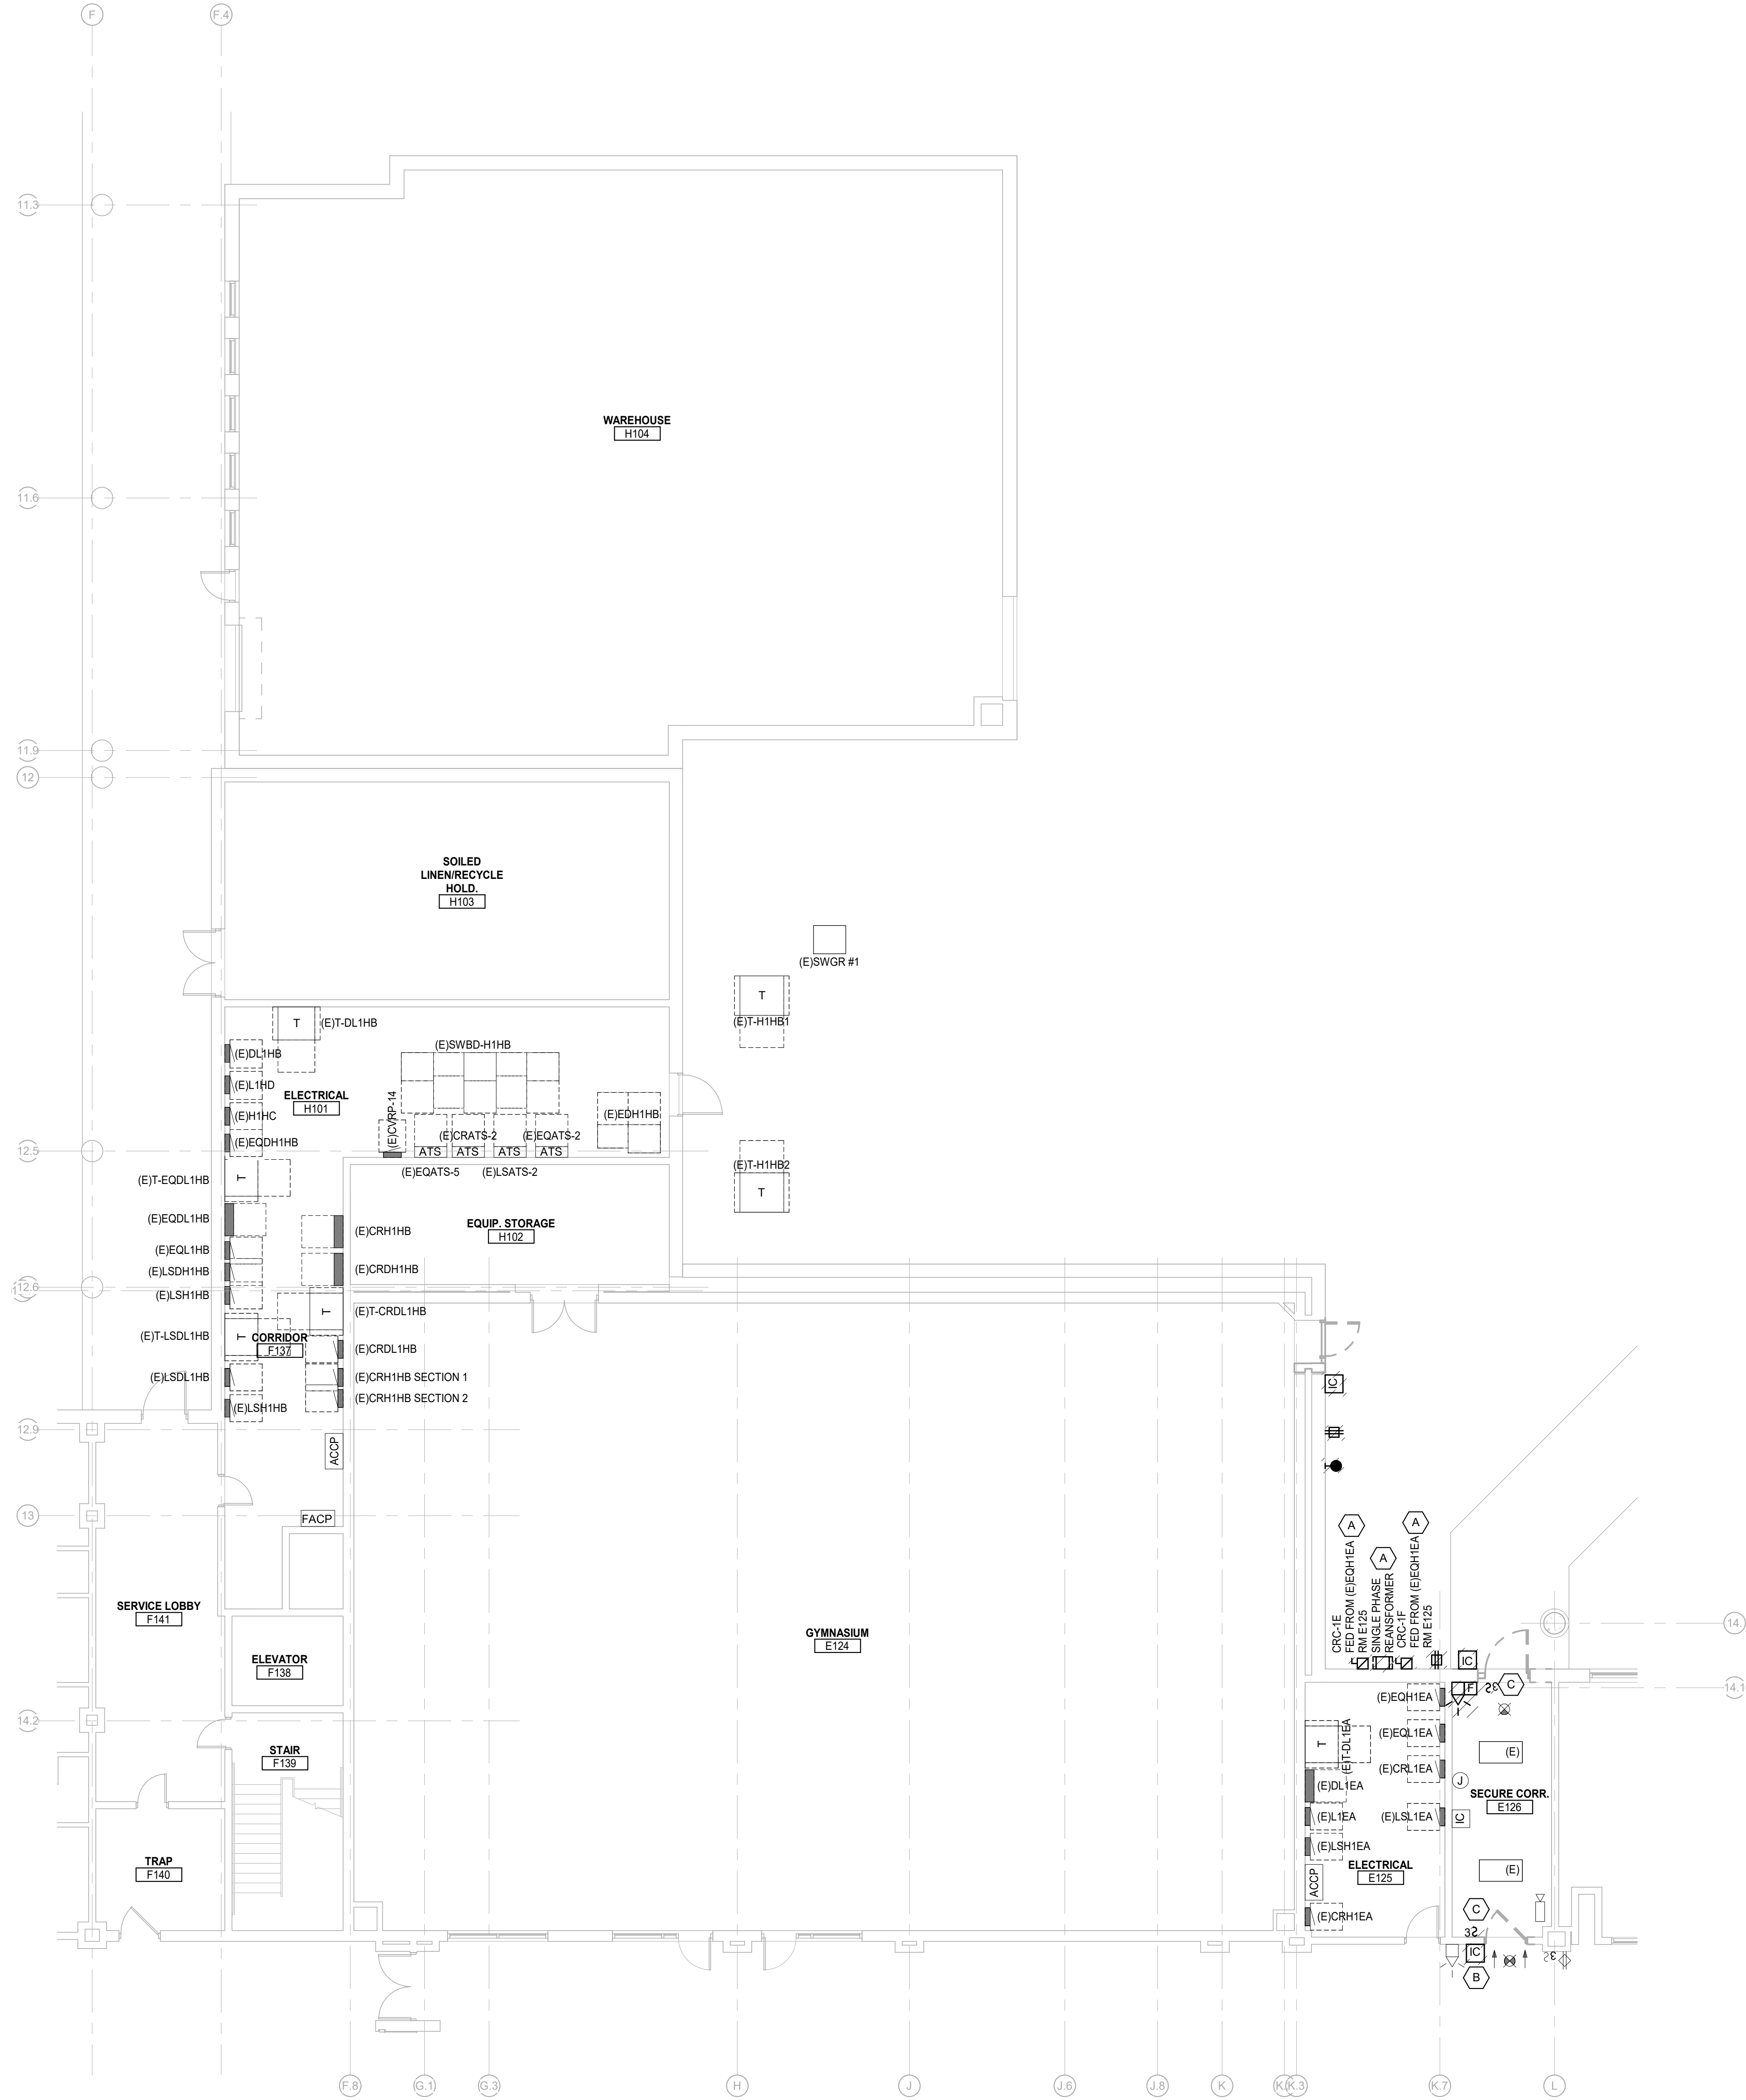

ELECTRICAL DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

ELECTRICAL DEMOLITION GENERAL NOTES:

- 1 VISIT THE SITE PRIOR TO SUBMISSION OF BID TO EXAMINE THE EXISTING CONDITIONS AND THE EXTENT OF DEMOLITION WORK.
- 2 EXAMINE THE DRAWINGS OF OTHER TRADES AND BE FAMILIAR WITH THE DEMOLITION REQUIRED BY OTHER TRADES. PERFORM ALL INCIDENTAL ELECTRICAL DEMOLITION AND/OR RELOCATION REQUIRED TO FACILITATE THE DEMOLITION WORK OF OTHER TRADES, WHETHER OR NOT SPECIFICALLY INDICATED.
- 3 REMOVE EQUIPMENT OR MATERIALS AS INDICATED ON PLAN WITH CROSS HATCHING. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE COMPONENTS SHOWN.
- 4 COORDINATE WITH NEW WORK PLANS, ONE LINE DIAGRAMS AND RISER DIAGRAMS FOR EXTENT OF DEMOLITION WORK.
- 5 PROVIDE PROPER SUPPORT FOR EXISTING TO REMAIN CONDUITS AND BOXES WHERE EXISTING SUPPORT IS TO BE REMOVED. RE-ROUTE BRANCH CIRCUIT CONDUITS AND RELOCATE JUNCTION BOXES AS REQUIRED TO FACILITATE INSTALLATION OF NEW EQUIPMENT AND SYSTEMS IN CEILING SPACES.
- 6 REMOVE ALL CONDUIT AND WIRE BACK TO THE SOURCE OR NEAREST UPSTREAM DEVICE REMAINING IN SERVICE.
- 7 MAINTAIN ELECTRICAL SERVICE TO ALL LIGHTING FIXTURES, DEVICES AND EQUIPMENT THAT ARE TO REMAIN. EXTEND CONDUIT AND WIRE AS REQUIRED WHERE DEMOLITION WORK AFFECTS ELECTRICAL SERVICE TO DOWNSTREAM LOADS THAT ARE TO REMAIN.
- 8 DISPOSE OF ALL MATERIALS OFF SITE AND INCLUDE ALL COSTS FOR DISPOSAL IN BID. ALL MATERIALS SHALL BE DISPOSED OF IN ACCORDANCE WITH ALL FEDERAL, STATE, AND LOCAL REGULATIONS, INCLUDING TCLP TESTING, PROPER DISPOSAL AND/OR RECYCLING OF FLUORESCENT LAMPS.
- 9 PROVIDE BLANK COVER PLATES WHERE SWITCHES AND DEVICES ARE REMOVED BUT EXISTING WALLS REMAIN INTACT.
- 10 RING OUT AND TAG ALL CIRCUITS AFFECTED BY THIS ALTERATION AT BOTH ENDS. MARK ALL UNUSED CIRCUIT BREAKERS 'SPARE'.
- 11 PROVIDE UPDATED TYPED-IN DIRECTORIES FOR ALL PANELS AFFECTED BY THIS ALTERATION.
- 12 VERIFY ALL UNDERGROUND AND IN SLAB UTILITY LOCATIONS PRIOR TO SAW-CUTTING OR PENETRATING ANY FLOOR SLAB.
- 13 COORDINATE ANY SHUT DOWN OF EXISTING SERVICES AND EQUIPMENT THAT ARE REMAINING IN USE WITH THE OWNER'S REPRESENTATIVE. WHERE EXISTING BUILDING SERVICE IS REQUIRED TO BE SHUT DOWN, INCLUDE ALL ASSOCIATED OVERTIME COSTS TO PERFORM THIS WORK DURING WEEKENDS AND EVENINGS INCLUDE ALL COSTS FOR PROVIDING TEMPORARY POWER WHERE SHUT DOWNS MUST OCCUR FOR PERIODS LONGER THAN THESE HOURS. COORDINATE ELECTRICAL SHUT DOWNS WITH THE OWNER 72 HOURS PRIOR TO SHUT DOWN.

DEMOLITION KEY NOTES:


- A SALVAGE FOR RELOCATION. EXISTING BRANCH CIRCUIT TO REMAIN.
- B SALVAGE FOR RELOCATION. REMOVE CONTROL WIRING UP TO CEILING SPACE.
- C SALVAGE FOR RELOCATION. EXISTING LIGHTING BRANCH CIRCUIT TO REMAIN.

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, R.A. DIRECTOR

FILE NO.
49120167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

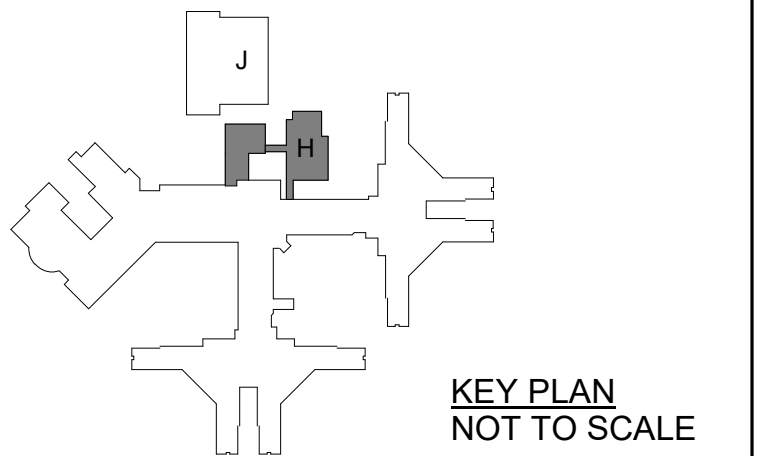

WTA ARCHITECTS
100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
49120167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
FIRST FLOOR ELECTRICAL DEMOLITION PLAN



PROJECT NUMBER 2021094 SHEET NUMBER

PROJECT DATE SEPTEMBER 6, 2023 **ED1.01**

CHECKED BY TLC

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0402

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

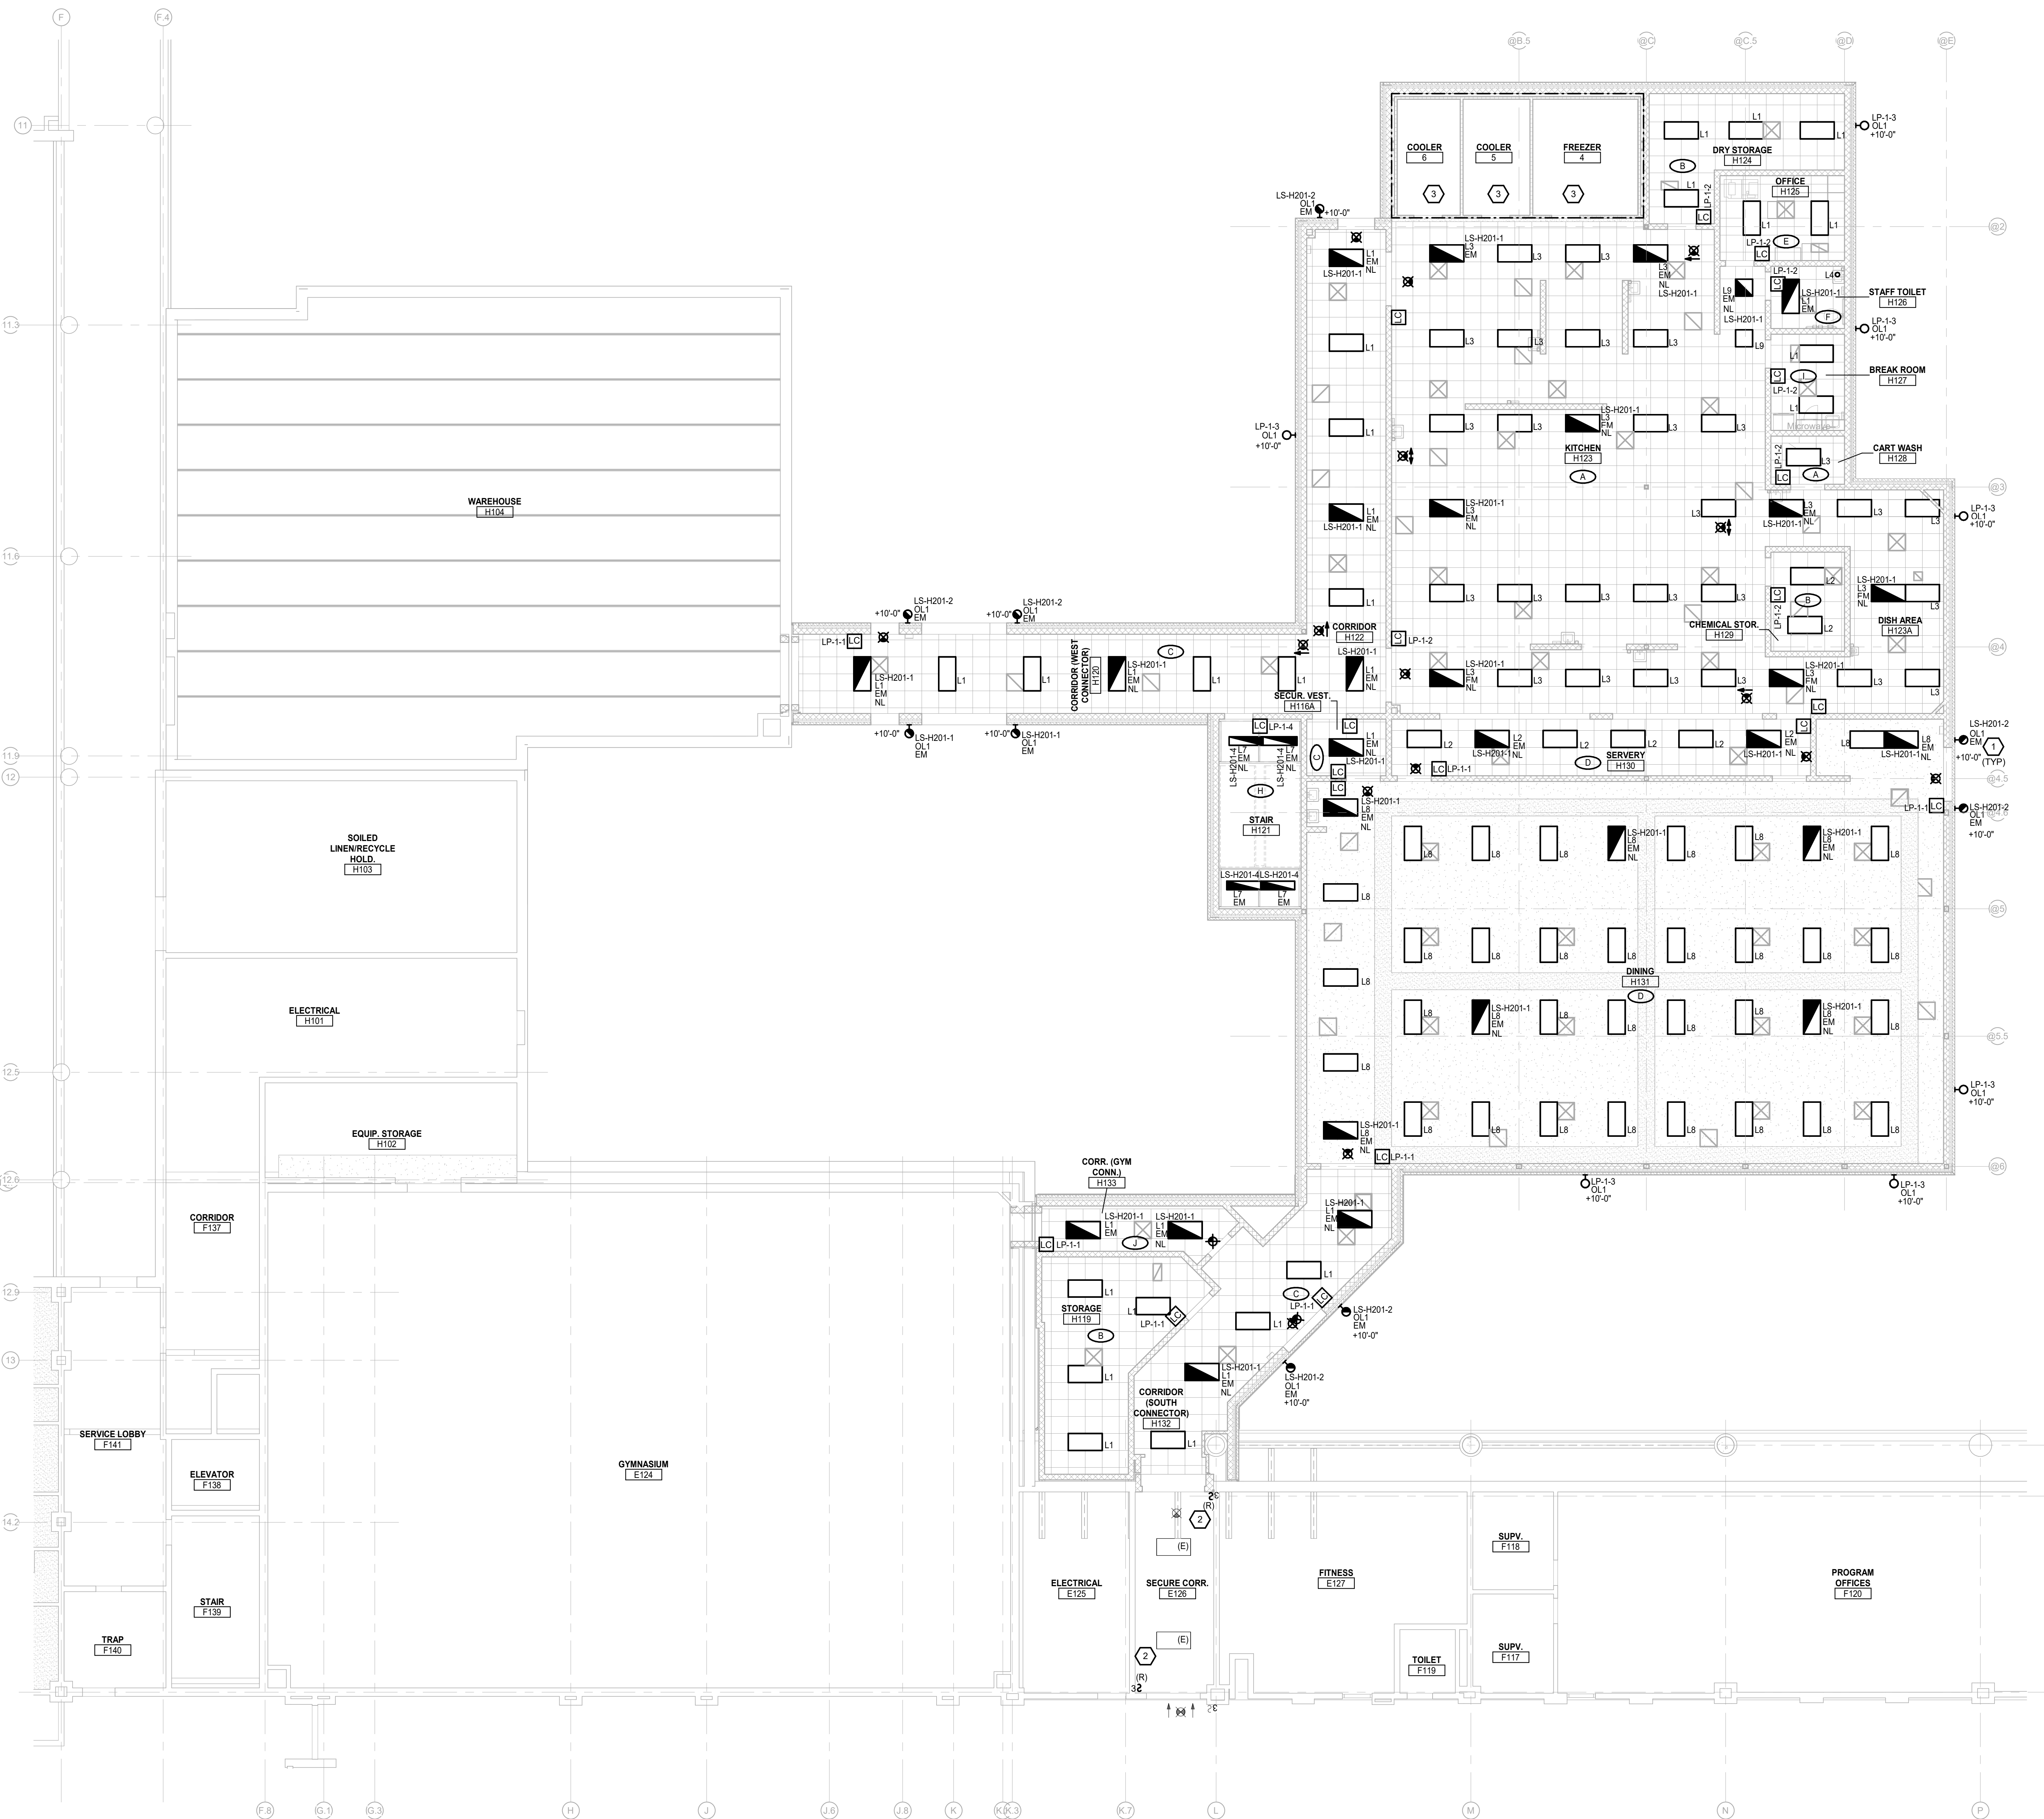

ELECTRICAL GENERAL NOTES:

- THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH TRANSFORMER CIRCUIT SIZING SCHEDULE SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH MOTOR CIRCUIT SIZING SCHEDULES SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- COORDINATE THE MOUNTING HEIGHTS OF DEVICES WITH ARCHITECTURAL ELEVATIONS AND THE TRADES INSTALLING THE WORK.
- REFER TO MECHANICAL SCHEDULE SHEETS FOR ELECTRICAL REQUIREMENTS FOR MECHANICAL EQUIPMENT. PROVIDE ALL CONNECTIONS, STARTERS, DISCONNECTS, ETC. AS REQUIRED BY SCHEDULES AND WHERE NOTED ELSEWHERE. VERIFY REQUIREMENTS OF ALL MECHANICAL EQUIPMENT WITH SHOP DRAWINGS SUBMITTALS. NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN EQUIPMENT SUBMITTALS AND ELECTRICAL DRAWINGS. WHERE CIRCUIT SIZES ARE SHOWN ON THE ELECTRICAL DRAWINGS THAT DIFFER FROM WHAT IS INDICATED ON THE MECHANICAL SCHEDULES, PROVIDE THE CIRCUIT OF HIGHER AMPACITY.
- REFER TO TEMPERATURE CONTROLS SHEETS FOR REQUIRED FIRE ALARM CONTROL MODULES, DUCT SMOKE DETECTORS, AND MOTOR CONTROLLERS. PROVIDE ALL ACCESSORIES INDICATED.
- REFER TO LIGHTING CONTROL SCHEDULE FOR ROOM CONTROL AND EMERGENCY LIGHTING CIRCUIT CONTROL REQUIREMENTS. DESIGNATION FOR ROOM IS INDICATED AS A LETTERED OVAL SYMBOL.
- ALL FIRE ALARM DEVICES SHALL BE COMPATIBLE WITH EXISTING SIMPLEX GRINNEL 4120 FIRE ALARM SYSTEM. PROVIDE NECESSARY COMPONENTS, MODULES, ETC. AS REQUIRED FOR A FULLY FUNCTIONAL SYSTEM. RE-TEST AND CERTIFY EXISTING FIRE ALARM SYSTEM AT COMPLETION OF PROJECT.
- PROVIDE TAMPER RESISTANT COVER PLATE KENALL WPP SERIES OR EQUAL WHERE PATIENTS WILL HAVE ACCESS TO DEVICES.
- REFER TO SECURITY/TELECOMMUNICATION DRAWINGS FOR FINAL DEVICE LOCATIONS AND RACEWAY REQUIREMENTS. COORDINATE WITH SECURITY REQUIREMENTS WITH INSTALLING TRADES.
- COORDINATE ELECTRICAL REQUIREMENTS DEVICE LOCATIONS AND MOUNTING HEIGHTS WITH KITCHEN EQUIPMENT DRAWINGS, SHOP DRAWINGS AND KITCHEN EQUIPMENT INSTALLER.

CONSTRUCTION KEY NOTES:

- EXTERIOR LIGHTING TO BE CONTROLLED VIA LIGHTING CONTACTOR IN H201. REFER TO DETAIL FOR CIRCUITING.
- INSTALL SALVAGED SWITCH IN EXISTING BLOCK WALL. EXTEND EXISTING BRANCH CIRCUIT.
- COOLER AND FREEZER LIGHTING PROVIDED BY ENCLOSURE PACKAGE. REFER TO ENLARGED PLAN FOR CIRCUITING INFORMATION.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
49120167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

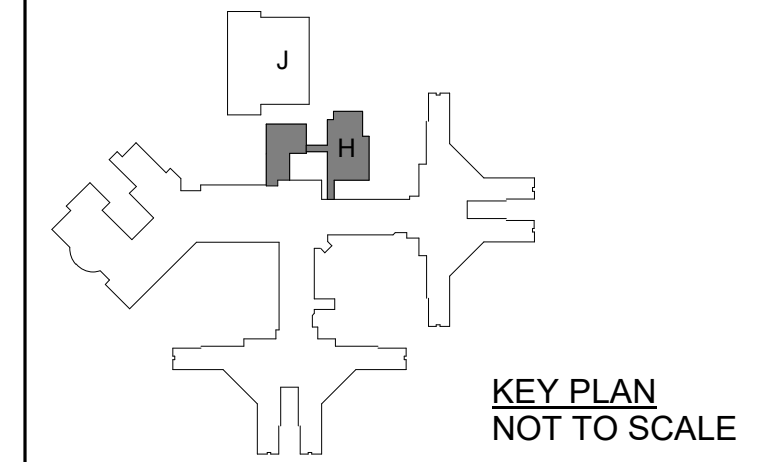

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
49120167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN

SALINE, MICHIGAN

SHEET TITLE
FIRST FLOOR LIGHTING
PLAN - UNIT H

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
SEPTEMBER 6, 2023

E2.01


CHECKED BY
TLC

FIRST FLOOR LIGHTING PLAN - UNIT H
SCALE: 1/8" = 1'-0"

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0402

9/26/2023 4:37:02 PM C:\REVIT LOCAL FILES\2023-0402-ME2_Forensic_Plan_v23_Gheintich.rvt

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.




ELECTRICAL GENERAL NOTES:

1. THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
2. INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
3. COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
4. PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
5. TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH TRANSFORMER CIRCUIT SIZING SCHEDULE SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
6. MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH MOTOR CIRCUIT SIZING SCHEDULES SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
7. COORDINATE THE MOUNTING HEIGHTS OF DEVICES WITH ARCHITECTURAL ELEVATIONS AND THE TRADES INSTALLING THE WORK.
8. REFER TO MECHANICAL SCHEDULE SHEETS FOR ELECTRICAL REQUIREMENTS FOR MECHANICAL EQUIPMENT. PROVIDE ALL CONNECTIONS, STARTERS, DISCONNECTS, ETC. AS REQUIRED BY SCHEDULES AND WHERE NOTED ELSEWHERE. VERIFY REQUIREMENTS OF ALL MECHANICAL EQUIPMENT WITH SHOP DRAWINGS SUBMITTALS. NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN EQUIPMENT SUBMITTALS AND ELECTRICAL DRAWINGS. WHERE CIRCUIT SIZES ARE SHOWN ON THE ELECTRICAL DRAWINGS THAT DIFFER FROM WHAT IS INDICATED ON THE MECHANICAL SCHEDULES, PROVIDE THE CIRCUIT OF HIGHER AMPACITY.
9. REFER TO TEMPERATURE CONTROLS SHEETS FOR REQUIRED FIRE ALARM CONTROL MODULES, DUCT SMOKE DETECTORS, AND MOTOR CONTROLLERS. PROVIDE ALL ACCESSORIES INDICATED.
10. REFER TO LIGHTING CONTROL SCHEDULE FOR ROOM CONTROL AND EMERGENCY LIGHTING CIRCUIT CONTROL REQUIREMENTS. DESIGNATION FOR ROOM IS INDICATED AS A LETTERED OVAL SYMBOL.
11. ALL FIRE ALARM DEVICES SHALL BE COMPATIBLE WITH EXISTING SIMPLEX GRINNEL 4120 FIRE ALARM SYSTEMS. PROVIDE NECESSARY COMPONENTS, MODULES, ETC. AS REQUIRED FOR A FULLY FUNCTIONAL SYSTEM. RE-TEST AND CERTIFY EXISTING FIRE ALARM SYSTEM AT COMPLETION OF PROJECT.
12. PROVIDE TAMPER RESISTANT COVER PLATE KENALL WPP SERIES OR EQUAL WHERE PATIENTS WILL HAVE ACCESS TO DEVICES.
13. REFER TO SECURITY/TELECOMMUNICATION DRAWINGS FOR FINAL DEVICE LOCATIONS AND RACEWAY REQUIREMENTS. COORDINATE WITH SECURITY REQUIREMENTS WITH INSTALLING TRADES.
14. COORDINATE ELECTRICAL REQUIREMENTS DEVICE LOCATIONS AND MOUNTING HEIGHTS WITH KITCHEN EQUIPMENT DRAWINGS, SHOP DRAWINGS AND KITCHEN EQUIPMENT INSTALLER.

CONSTRUCTION KEY NOTES:

1. PROVIDE (2) 120V 20A DEDICATED BRANCH CIRCUITS FROM SPARE CIRCUIT BREAKERS IN (E)CRL0EB FOR NEW IT RACK IN SECURITY ELECTRONICS E024.
2. EXISTING LINE VOLTAGE MASTER CLOCK HEAD-END. EXTEND CIRCUITING TO NEW CLOCKS AS REQUIRED.

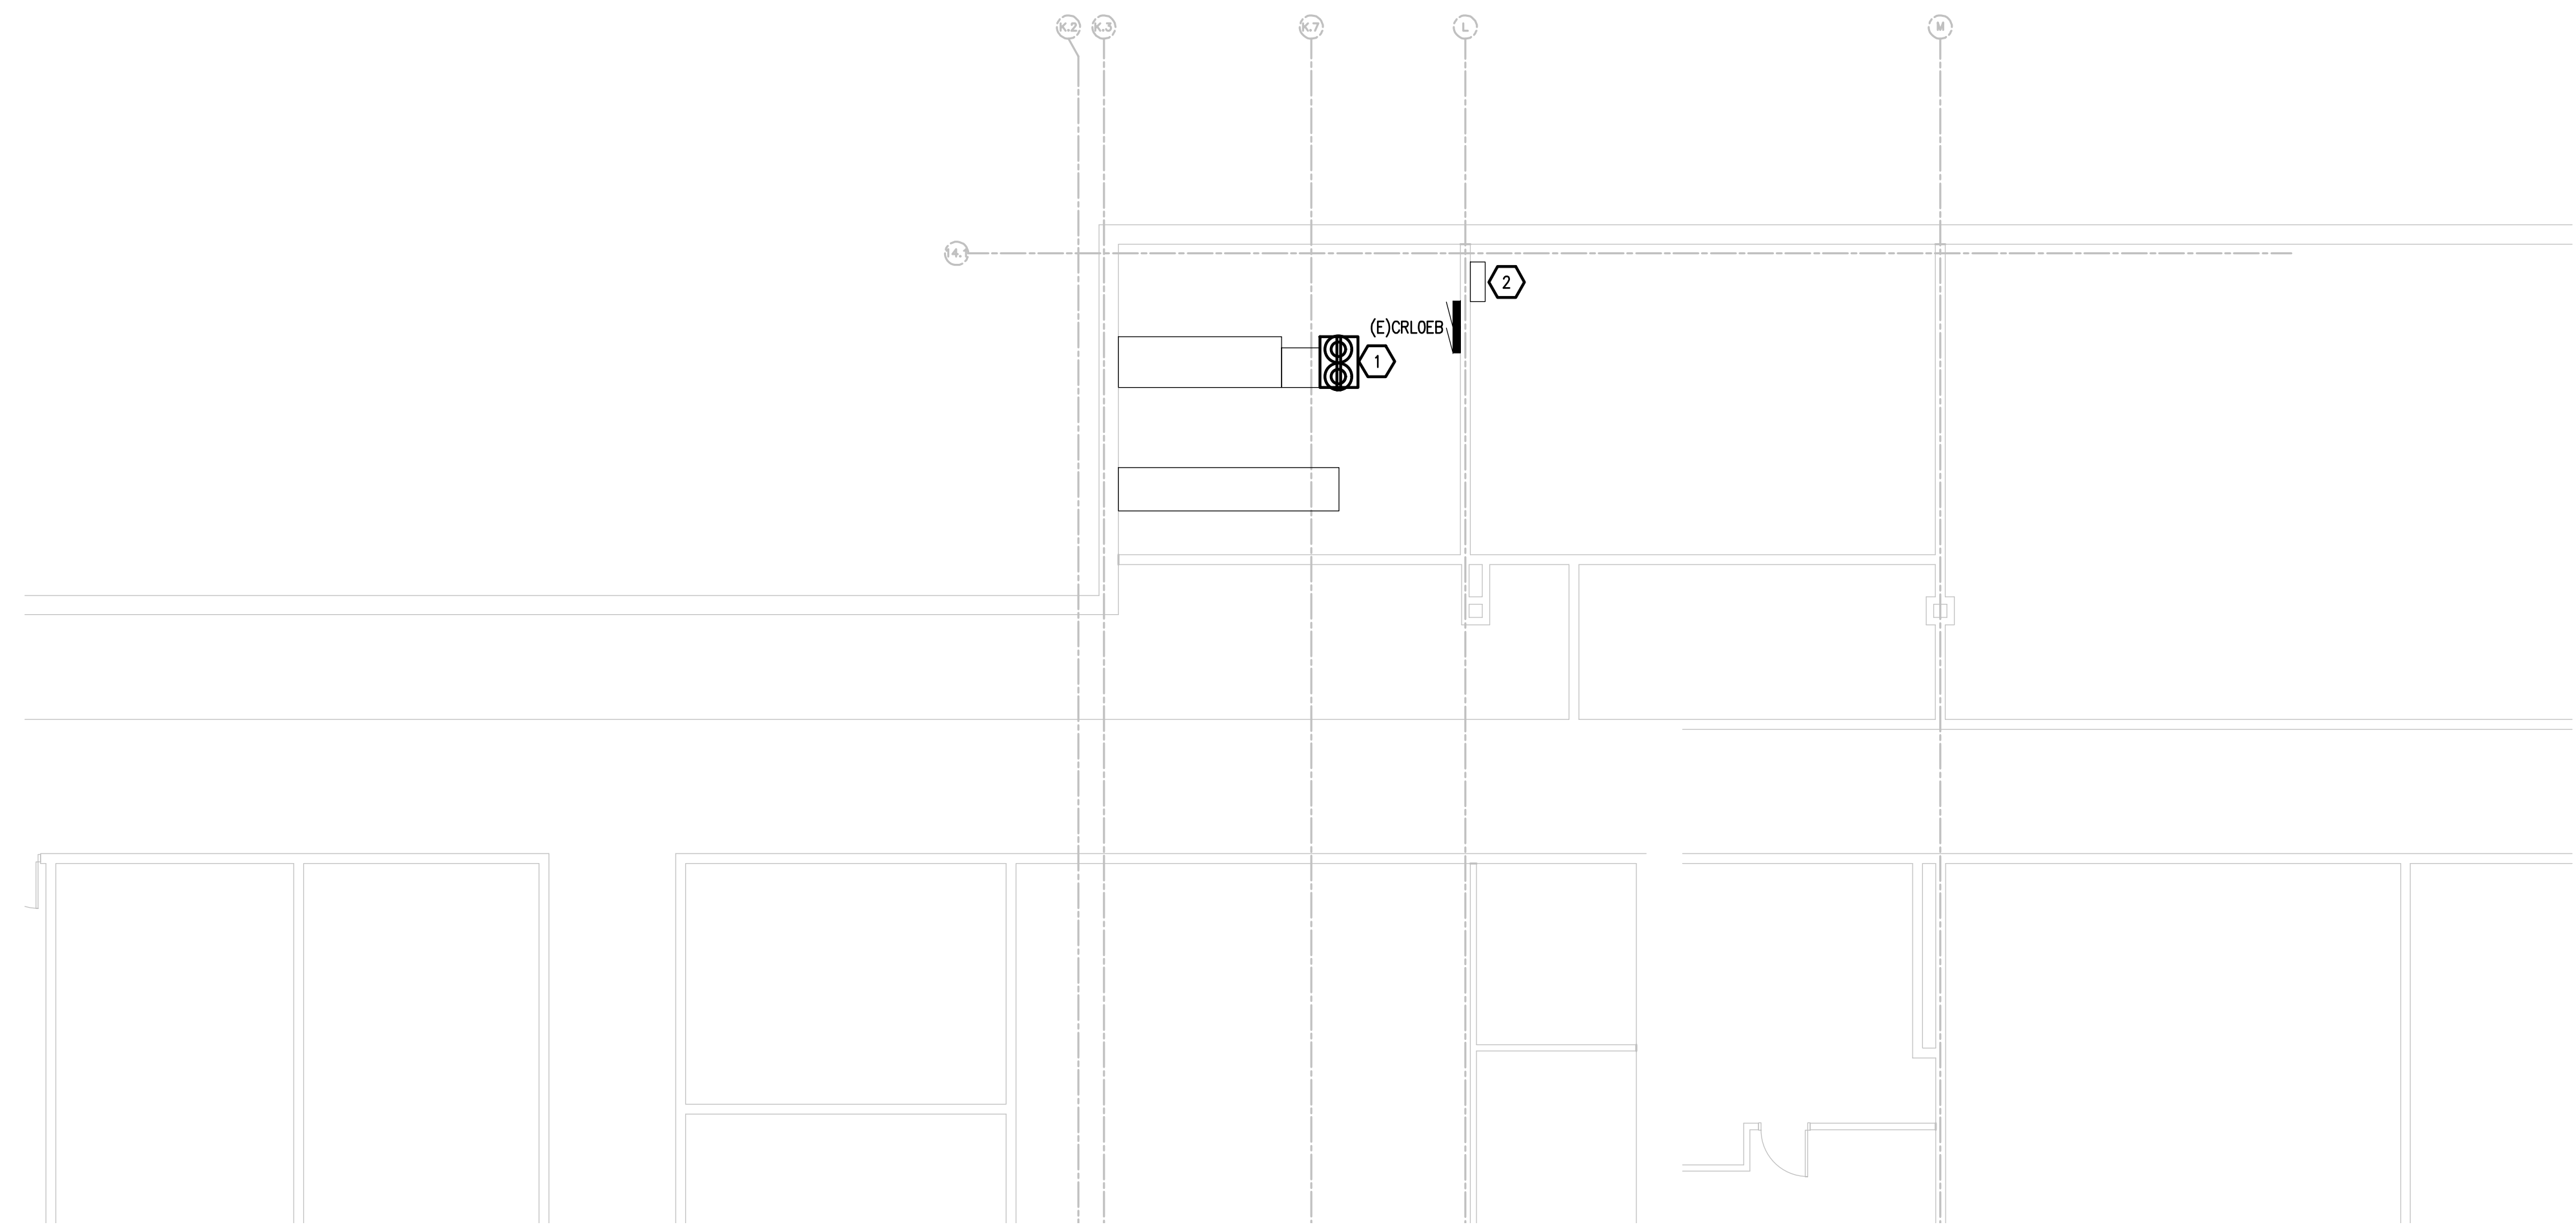

BASEMENT FLOOR POWER PLAN - UNIT H
SCALE: 1" = 20'

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

WTA ARCHITECTS

100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107

WTAARCH.COM
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
BASEMENT FLOOR POWER PLAN - UNIT H


PROJECT NUMBER 2021094	SHEET NUMBER E3.00
PROJECT DATE AUGUST 23, 2023	CHECKED BY TCL

Peter Basso Associates Inc
CONSULTING ENGINEERS

5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2021.0102

g:\2021\2021-0402-00\CAD\2021-0402-E300.dwg, E3.00, 9/5/2023 4:32:31 PM, Gerard Henrich, Peter Basso Associates Inc.

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

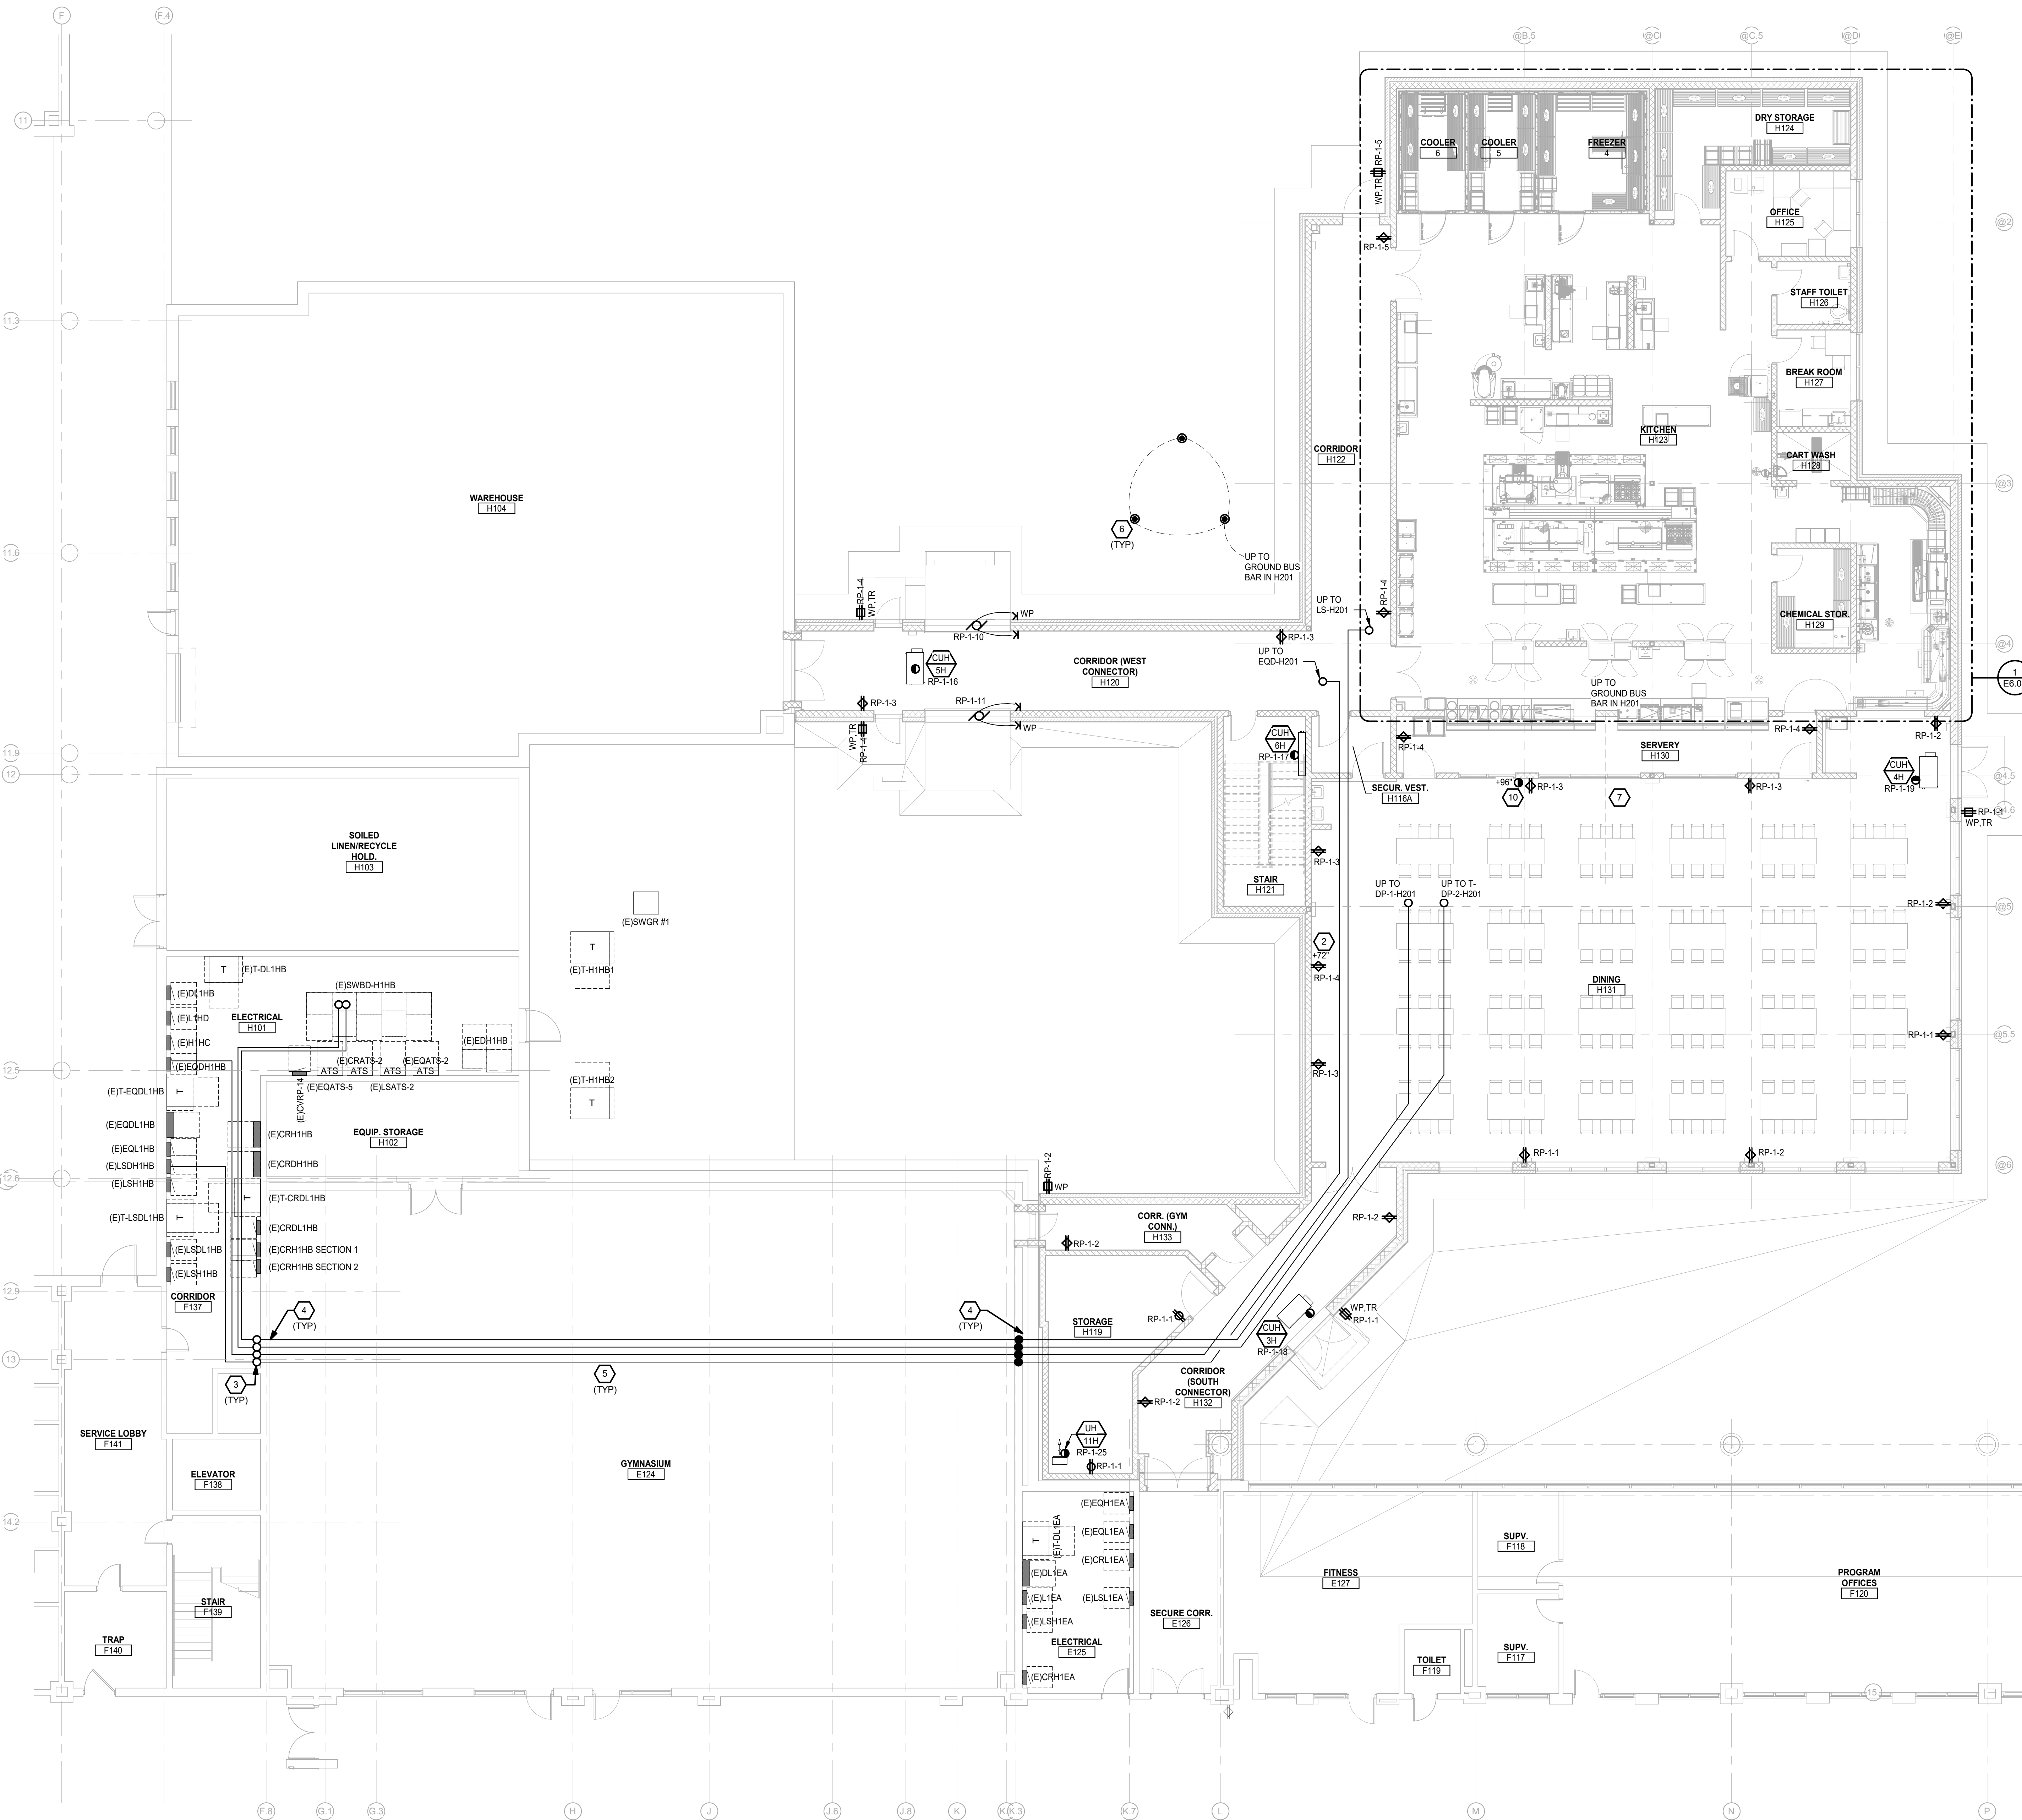

ELECTRICAL GENERAL NOTES:

- THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH TRANSFORMER CIRCUIT SIZING SCHEDULE SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH MOTOR CIRCUIT SIZING SCHEDULES SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- COORDINATE THE MOUNTING HEIGHTS OF DEVICES WITH ARCHITECTURAL ELEVATIONS AND THE TRADES INSTALLING THE WORK.
- REFER TO MECHANICAL SCHEDULE SHEETS FOR ELECTRICAL REQUIREMENTS FOR MECHANICAL EQUIPMENT. PROVIDE ALL CONNECTIONS, STARTERS, DISCONNECTS, ETC. AS REQUIRED BY SCHEDULES AND WHERE NOTED ELSEWHERE. VERIFY REQUIREMENTS OF ALL MECHANICAL EQUIPMENT WITH SHOP DRAWINGS SUBMITTALS. NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN EQUIPMENT SUBMITTALS AND ELECTRICAL DRAWINGS. WHERE CIRCUIT SIZES ARE SHOWN ON THE ELECTRICAL DRAWINGS THAT DIFFER FROM WHAT IS INDICATED ON THE MECHANICAL SCHEDULES, PROVIDE THE CIRCUIT OF HIGHER AMPACITY.
- REFER TO TEMPERATURE CONTROLS SHEETS FOR REQUIRED FIRE ALARM CONTROL MODULES, DUCT SMOKE DETECTORS, AND MOTOR CONTROLLERS. PROVIDE ALL ACCESSORIES INDICATED.
- REFER TO LIGHTING CONTROL SCHEDULE FOR ROOM CONTROL AND EMERGENCY LIGHTING CIRCUIT CONTROL REQUIREMENTS. DESIGNATION FOR ROOM IS INDICATED AS A LETTERED OVAL SYMBOL.
- ALL FIRE ALARM DEVICES SHALL BE COMPATIBLE WITH EXISTING SIMPLEX GRINNEL 4120 FIRE ALARM SYSTEM. PROVIDE NECESSARY COMPONENTS, MODULES, ETC. AS REQUIRED FOR A FULLY FUNCTIONAL SYSTEM. RE-TEST AND CERTIFY EXISTING FIRE ALARM SYSTEM AT COMPLETION OF PROJECT.
- PROVIDE TAMPER RESISTANT COVER PLATE KENALL WPP SERIES OR EQUAL WHERE PATIENTS WILL HAVE ACCESS TO DEVICES.
- REFER TO SECURITY/TELECOMMUNICATION DRAWINGS FOR FINAL DEVICE LOCATIONS AND RACEWAY REQUIREMENTS. COORDINATE WITH SECURITY REQUIREMENTS WITH INSTALLING TRADES.
- COORDINATE ELECTRICAL REQUIREMENTS DEVICE LOCATIONS AND MOUNTING HEIGHTS WITH KITCHEN EQUIPMENT DRAWINGS, SHOP DRAWINGS AND KITCHEN EQUIPMENT INSTALLER.

CONSTRUCTION KEY NOTES:

- INSTALL SALVAGED EQUIPMENT ON NEW ROOF. EXTEND EXISTING BRANCH CIRCUITS AS REQUIRED.
- COORDINATE FINAL LOCATION OF TV WITH ARCHITECTURAL DRAWINGS AND TRADES PRIOR TO ROUGH IN.
- UP TO SECOND FLOOR ELECTRICAL ROOM E203 CORE EXISTING FLOOR.
- CORE EXISTING WALL.
- ROUTE IN CEILING SPACE OF GYM. ROUTE ALONG SIDE NEW MECHANICAL PIPING. COORDINATE FINAL ROUTING WITH MECHANICAL TRADES.
- COORDINATE GROUND ROD PLACEMENT WITH EXISTING UTILITIES PRIOR TO DRIVING THEM IN.
- 20'-0" #40 BARE COPPER CONDUCTOR FOR CONCRETE-ENCASED ELECTRODE IN FOUNDATION ENCASED BY AT LEAST 2" OF CONCRETE.
- PROVIDE LIGHTNING PROTECTION FOR WHOLE BUILDING ADDITION. LIGHTNING PROTECTION SYSTEM SHALL BE UL LISTED MASTER LABEL. REFER TO SPECIFICATIONS FOR SYSTEM REQUIREMENTS.
- TIE INTO THE EXISTING LIGHTNING PROTECTION ON EXISTING BUILDING AS REQUIRED.
- LINE VOLTAGE CLOCK STANDARD ELECTRIC TIME FARADAY 2384 OR OTHER CLOCK COMPATIBLE WITH EXISTING SYSTEM. EXTEND WIRING FROM EXISTING CLOCK HEAD END SYSTEM AS REQUIRED.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, R.A. DIRECTOR

FILE NO.
49120167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

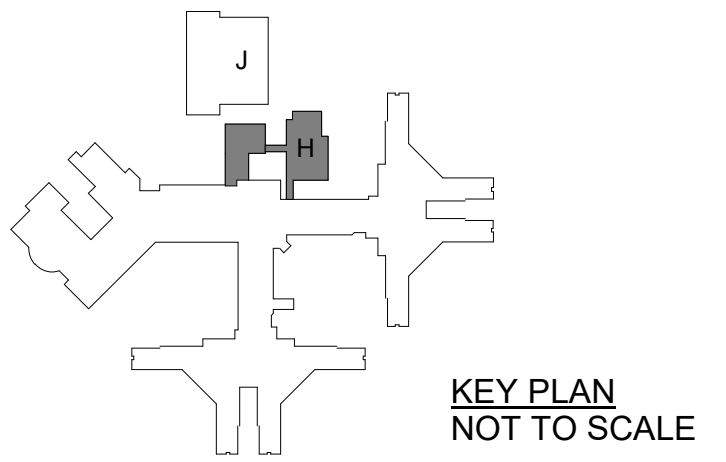

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
49120167.SDW - PHASE 500:
**CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN**
SALINE, MICHIGAN

SHEET TITLE
**FIRST FLOOR POWER PLAN
- UNIT H**

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
SEPTEMBER 6, 2023

E3.01



CHECKED BY
TLC

FIRST FLOOR POWER PLAN - UNIT H
SCALE: 1/8" = 1'-0"

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5445 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 3024-002

9/2/2023 4:37:06 PM C:\REVIT LOCAL FILES\2023-09-02-ME2_Forensic_Plan_v23_Ghienrich.rvt

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

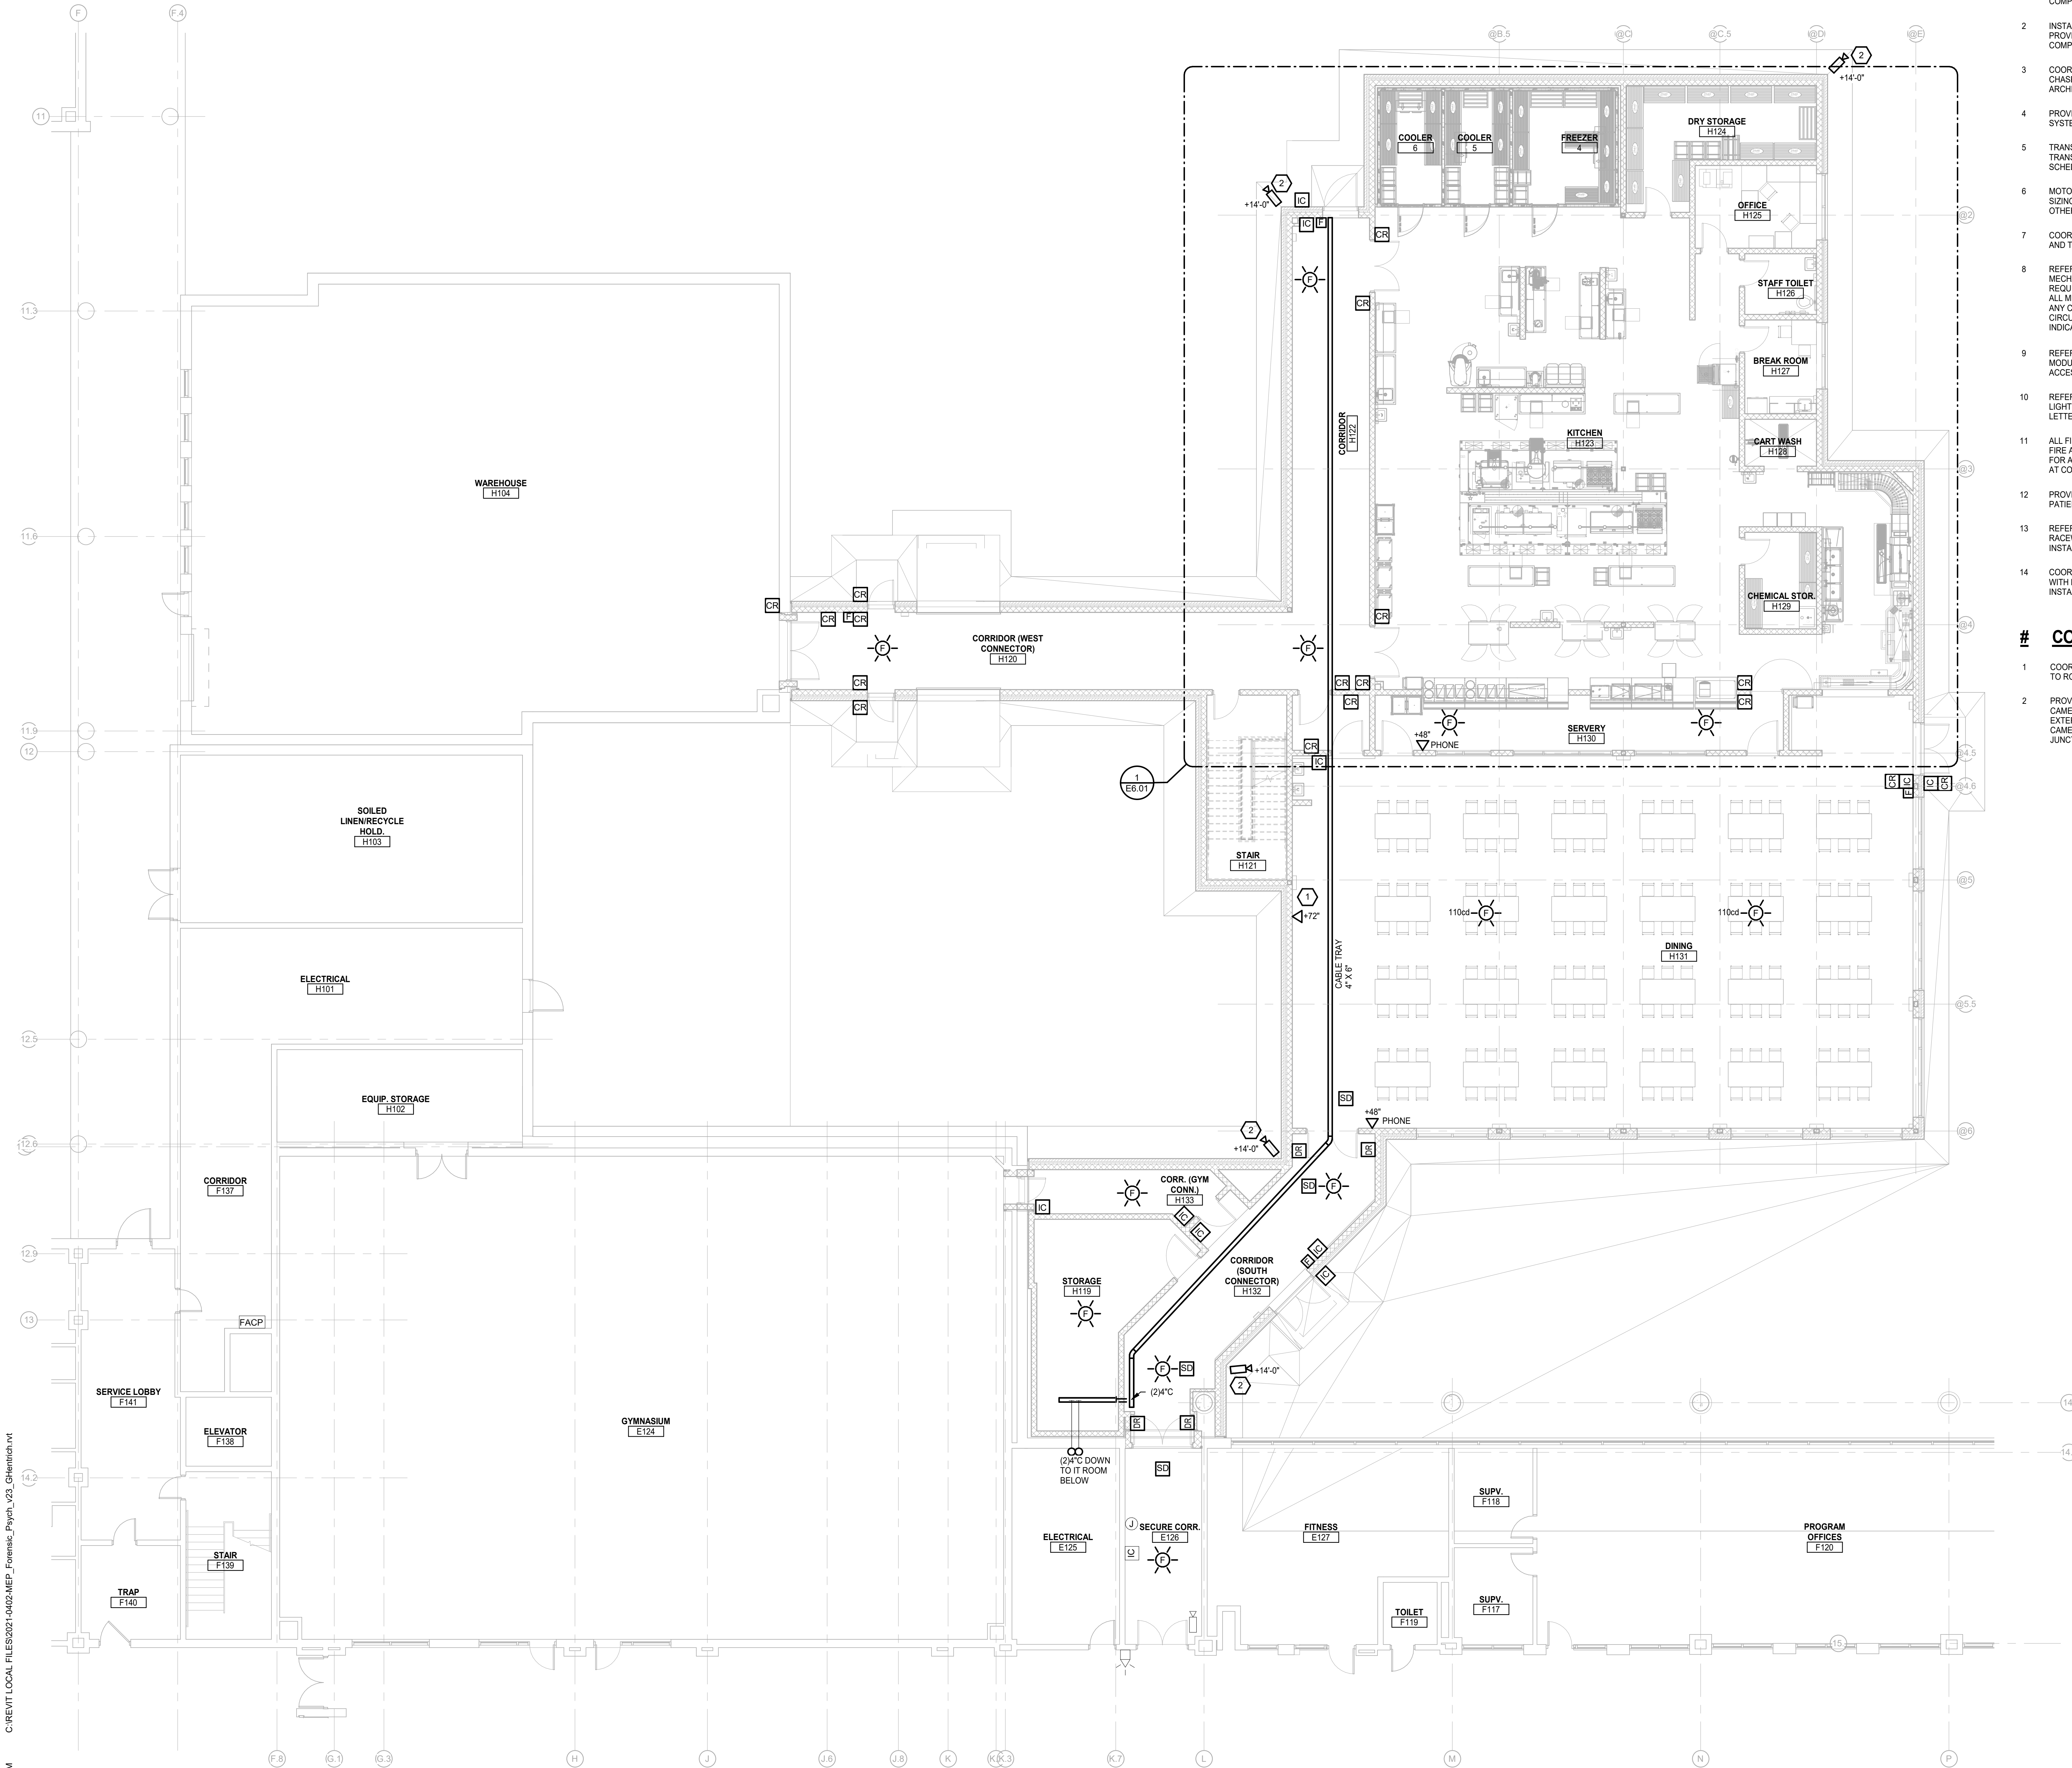

ELECTRICAL GENERAL NOTES:

- 1 THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- 2 INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- 3 COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- 4 PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- 5 TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH TRANSFORMER CIRCUIT SIZING SCHEDULE SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- 6 MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH MOTOR CIRCUIT SIZING SCHEDULES SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- 7 COORDINATE THE MOUNTING HEIGHTS OF DEVICES WITH ARCHITECTURAL ELEVATIONS AND THE TRADES INSTALLING THE WORK.
- 8 REFER TO MECHANICAL SCHEDULE SHEETS FOR ELECTRICAL REQUIREMENTS FOR MECHANICAL EQUIPMENT. PROVIDE ALL CONNECTIONS, STARTERS, DISCONNECTS, ETC. AS REQUIRED BY SCHEDULES AND WHERE NOTED ELSEWHERE. VERIFY REQUIREMENTS OF ALL MECHANICAL EQUIPMENT WITH SHOP DRAWINGS SUBMITTALS. NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN EQUIPMENT SUBMITTALS AND ELECTRICAL DRAWINGS. WHERE CIRCUIT SIZES ARE SHOWN ON THE ELECTRICAL DRAWINGS THAT DIFFER FROM WHAT IS INDICATED ON THE MECHANICAL SCHEDULES, PROVIDE THE CIRCUIT OF HIGHER AMPACITY.
- 9 REFER TO TEMPERATURE CONTROLS SHEETS FOR REQUIRED FIRE ALARM CONTROL MODULES, DUCT SMOKE DETECTORS, AND MOTOR CONTROLLERS. PROVIDE ALL ACCESSORIES INDICATED.
- 10 REFER TO LIGHTING CONTROL SCHEDULE FOR ROOM CONTROL AND EMERGENCY LIGHTING CIRCUIT CONTROL REQUIREMENTS. DESIGNATION FOR ROOM IS INDICATED AS A LETTERED OVAL SYMBOL.
- 11 ALL FIRE ALARM DEVICES SHALL BE COMPATIBLE WITH EXISTING SIMPLEX GRINNEL 4120 FIRE ALARM SYSTEM. PROVIDE NECESSARY COMPONENTS, MODULES, ETC. AS REQUIRED FOR A FULLY FUNCTIONAL SYSTEM. RE-TEST AND CERTIFY EXISTING FIRE ALARM SYSTEM AT COMPLETION OF PROJECT.
- 12 PROVIDE TAMPER RESISTANT COVER PLATE KENALL WPP SERIES OR EQUAL WHERE PATIENTS WILL HAVE ACCESS TO DEVICES.
- 13 REFER TO SECURITY/TELECOMMUNICATION DRAWINGS FOR FINAL DEVICE LOCATIONS AND RACEWAY REQUIREMENTS. COORDINATE WITH SECURITY REQUIREMENTS WITH INSTALLING TRADES.
- 14 COORDINATE ELECTRICAL REQUIREMENTS DEVICE LOCATIONS AND MOUNTING HEIGHTS WITH KITCHEN EQUIPMENT DRAWINGS, SHOP DRAWINGS AND KITCHEN EQUIPMENT INSTALLER.

CONSTRUCTION KEY NOTES:

- 1 COORDINATE FINAL LOCATION OF TV WITH ARCHITECTURAL DRAWINGS AND TRADES PRIOR TO ROUGH IN.
- 2 PROVIDE SINGLE GANG JUNCTION BOX AT 14'-0" ADJACENT TO EXTERIOR MOUNTED CAMERA. PROVIDE SEAL TIGHT CONDUIT AND ASSOCIATED FITTINGS/SEALS FROM EXTERIOR BOX TO CAMERA HOUSING. COORDINATE FINAL MOUNTING LOCATION WITH CAMERA INSTALLER AND DRAWINGS. PROVIDE 1/4" CONDUIT FROM SINGLE GANG JUNCTION BOX TO CABLE TRAY.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

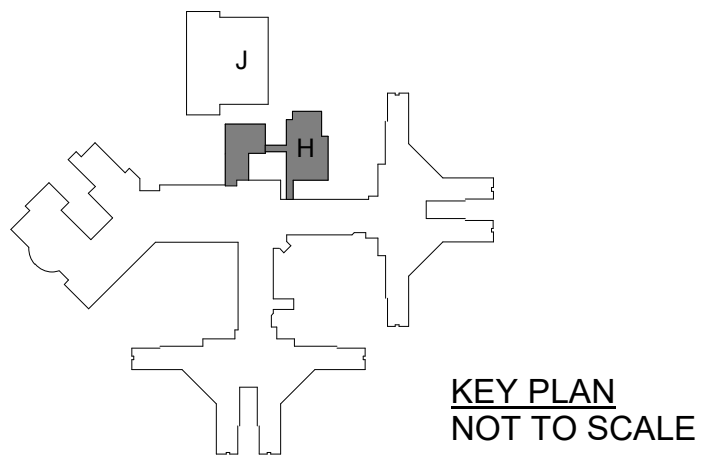

WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
FIRST FLOOR AUXILIARY SYSTEMS PLAN - UNIT H

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
SEPTEMBER 6, 2023

E4.01



CHECKED BY
TLC

FIRST FLOOR AUXILIARY SYSTEMS PLAN - UNIT H
SCALE: 1/8" = 1'-0"

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0402

9/26/2023 4:37:10 PM C:\REVIT LOCAL FILES\2023-0402-ME2_Forensic_Plan_H_v23_Ghienhch.rvt

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

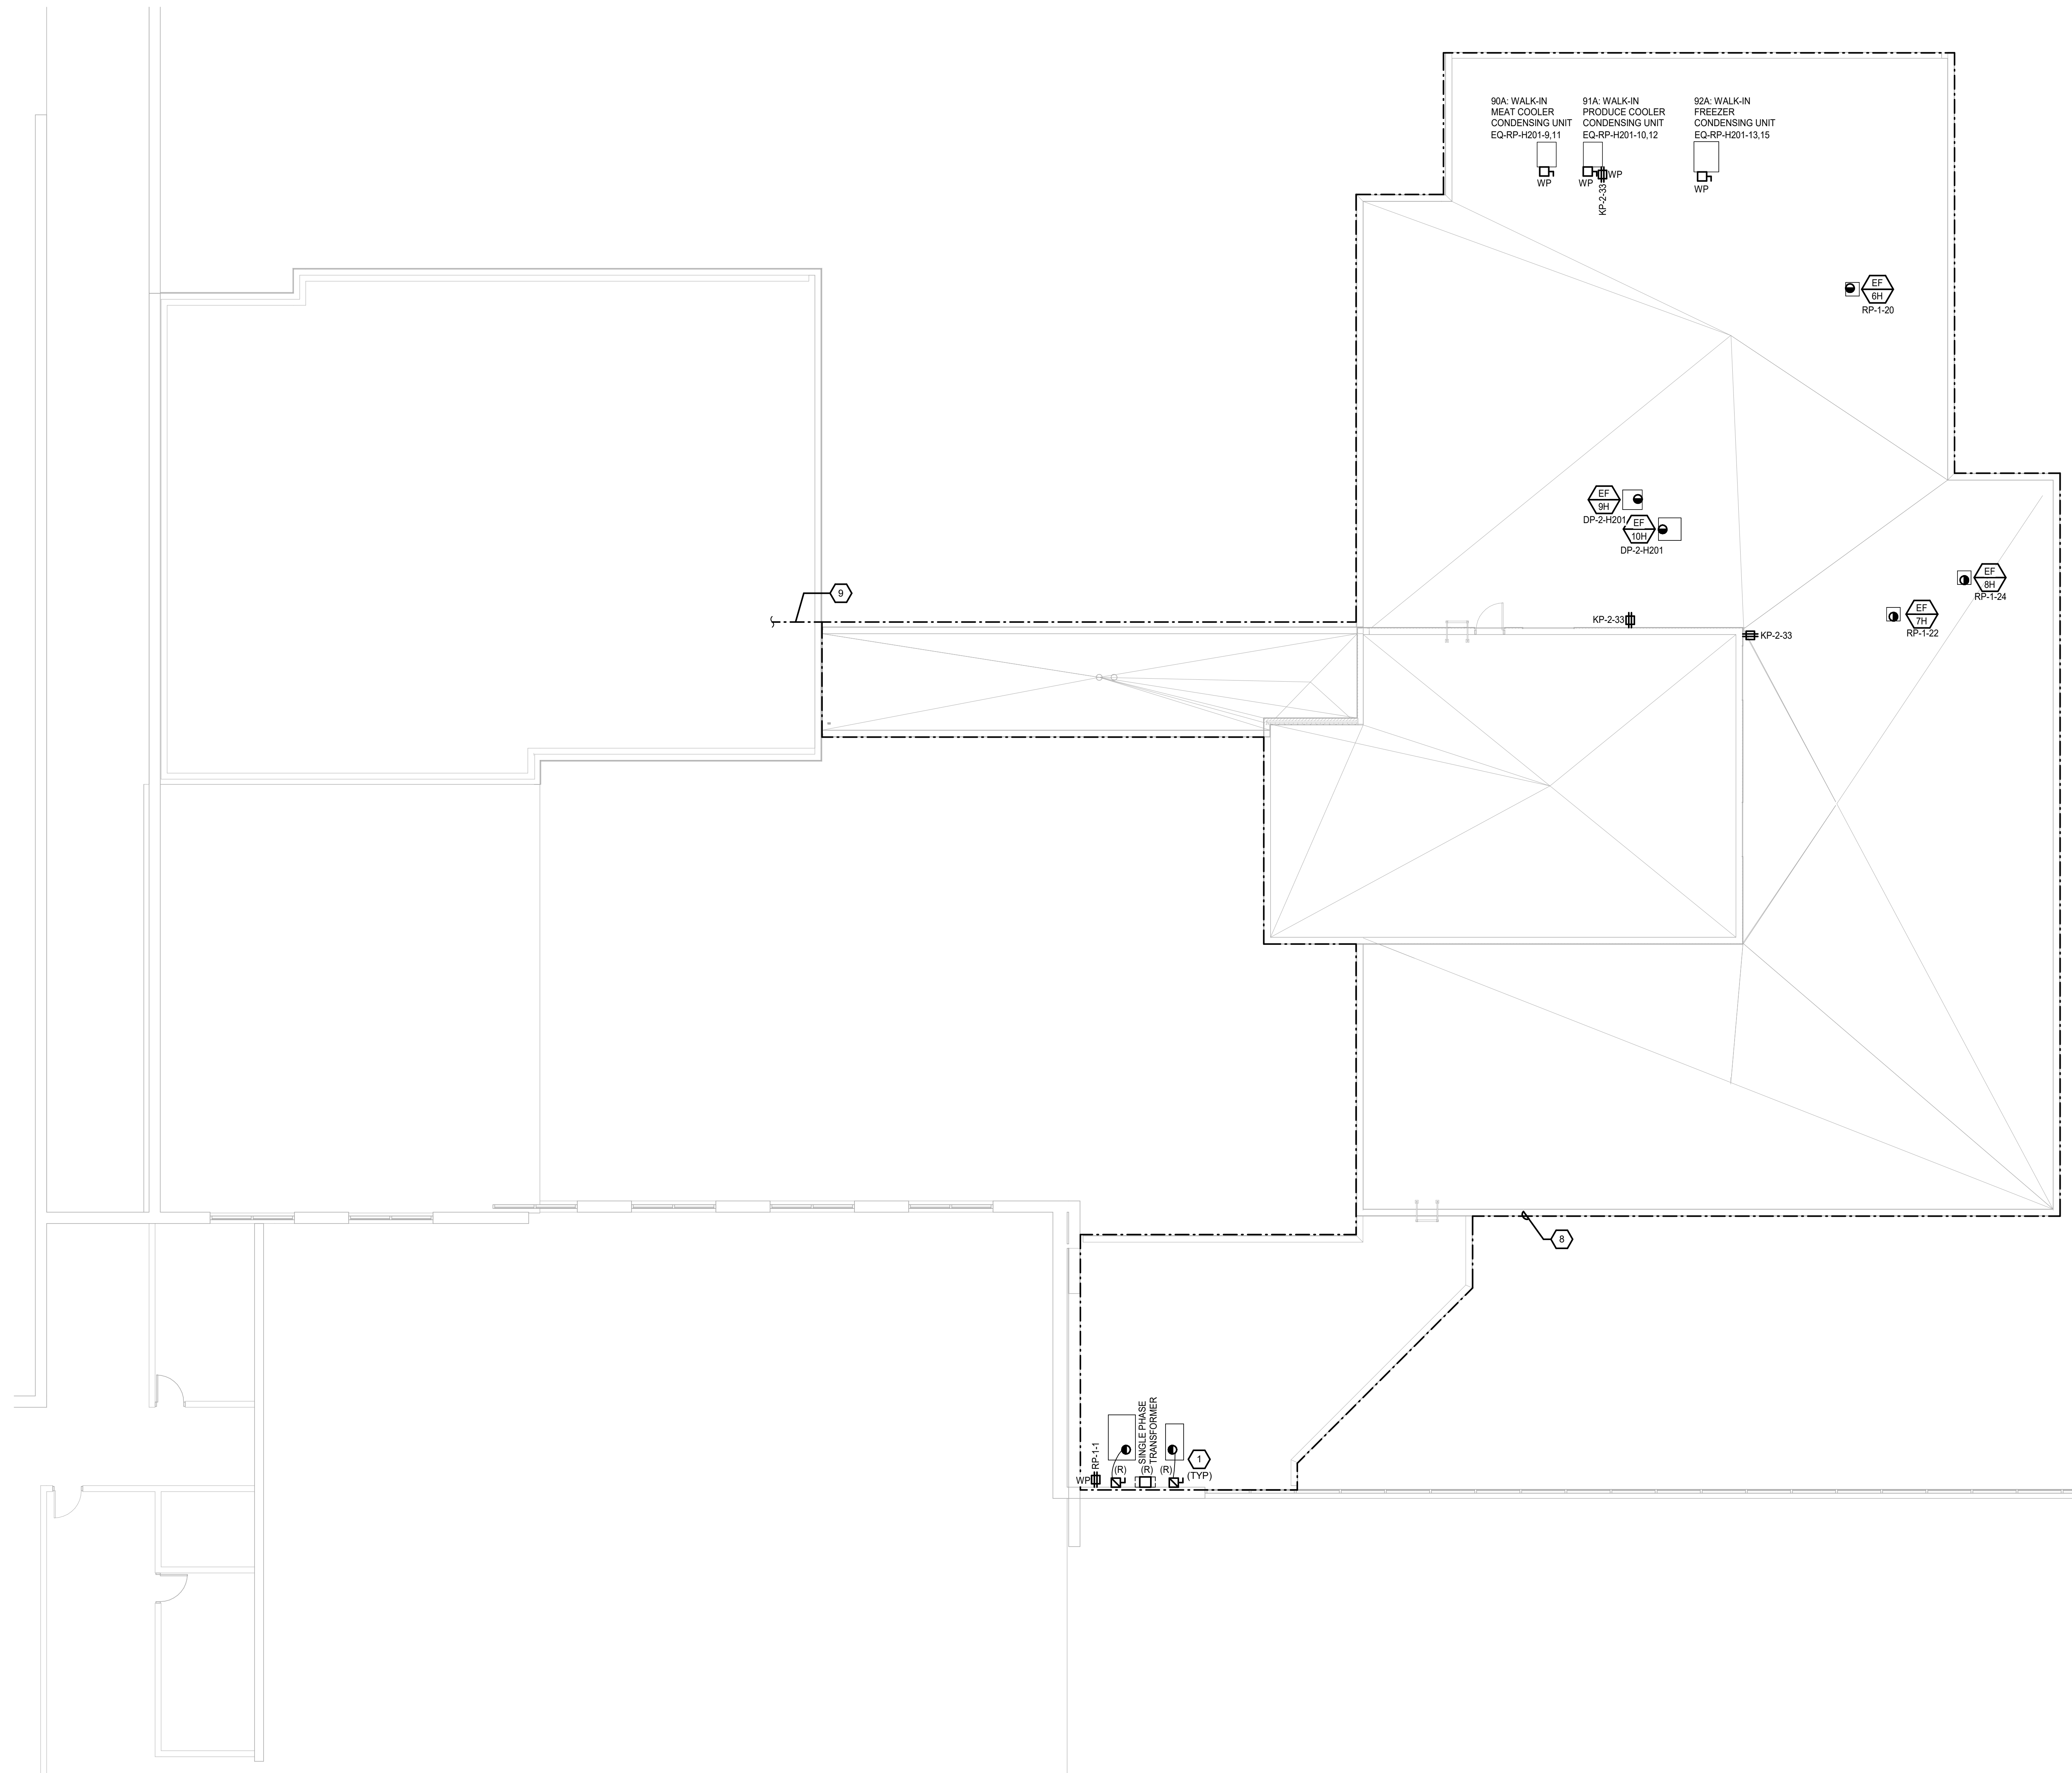

ELECTRICAL GENERAL NOTES:

- 1 THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- 2 INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- 3 COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- 4 PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- 5 TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH TRANSFORMER CIRCUIT SIZING SCHEDULE SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- 6 MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH MOTOR CIRCUIT SIZING SCHEDULES SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- 7 COORDINATE THE MOUNTING HEIGHTS OF DEVICES WITH ARCHITECTURAL ELEVATIONS AND THE TRADES INSTALLING THE WORK.
- 8 REFER TO MECHANICAL SCHEDULE SHEETS FOR ELECTRICAL REQUIREMENTS FOR MECHANICAL EQUIPMENT. PROVIDE ALL CONNECTIONS, STARTERS, DISCONNECTS, ETC. AS REQUIRED BY SCHEDULES AND WHERE NOTED ELSEWHERE. VERIFY REQUIREMENTS OF ALL MECHANICAL EQUIPMENT WITH SHOP DRAWINGS SUBMITTALS. NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN EQUIPMENT SUBMITTALS AND ELECTRICAL DRAWINGS. WHERE CIRCUIT SIZES ARE SHOWN ON THE ELECTRICAL DRAWINGS THAT DIFFER FROM WHAT IS INDICATED ON THE MECHANICAL SCHEDULES, PROVIDE THE CIRCUIT OF HIGHER AMPACITY.
- 9 REFER TO TEMPERATURE CONTROLS SHEETS FOR REQUIRED FIRE ALARM CONTROL MODULES, DUCT SMOKE DETECTORS, AND MOTOR CONTROLLERS. PROVIDE ALL ACCESSORIES INDICATED.
- 10 REFER TO LIGHTING CONTROL SCHEDULE FOR ROOM CONTROL AND EMERGENCY LIGHTING CIRCUIT CONTROL REQUIREMENTS. DESIGNATION FOR ROOM IS INDICATED AS A LETTERED OVAL SYMBOL.
- 11 ALL FIRE ALARM DEVICES SHALL BE COMPATIBLE WITH EXISTING SIMPLEX GRINNEL 4120 FIRE ALARM SYSTEM. PROVIDE NECESSARY COMPONENTS, MODULES, ETC. AS REQUIRED FOR A FULLY FUNCTIONAL SYSTEM. RE-TEST AND CERTIFY EXISTING FIRE ALARM SYSTEM AT COMPLETION OF PROJECT.
- 12 PROVIDE TAMPER RESISTANT COVER PLATE KENALL WPP SERIES OR EQUAL WHERE PATIENTS WILL HAVE ACCESS TO DEVICES.
- 13 REFER TO SECURITY/TELECOMMUNICATION DRAWINGS FOR FINAL DEVICE LOCATIONS AND RACEWAY REQUIREMENTS. COORDINATE WITH SECURITY REQUIREMENTS WITH INSTALLING TRADES.
- 14 COORDINATE ELECTRICAL REQUIREMENTS DEVICE LOCATIONS AND MOUNTING HEIGHTS WITH KITCHEN EQUIPMENT DRAWINGS, SHOP DRAWINGS AND KITCHEN EQUIPMENT INSTALLER.

CONSTRUCTION KEY NOTES:

- 1 INSTALL SALVAGED EQUIPMENT ON NEW ROOF. EXTEND EXISTING BRANCH CIRCUITS AS REQUIRED.
- 2 COORDINATE FINAL LOCATION OF TV WITH ARCHITECTURAL DRAWINGS AND TRADES PRIOR TO ROUGH IN.
- 3 UP TO SECOND FLOOR ELECTRICAL ROOM E203. CORE EXISTING FLOOR.
- 4 CORE EXISTING WALL.
- 5 ROUTE IN CEILING SPACE OF GYM. ROUTE ALONG SIDE NEW MECHANICAL PIPING. COORDINATE FINAL ROUTING WITH MECHANICAL TRADES.
- 6 COORDINATE GROUND ROD PLACEMENT WITH EXISTING UTILITIES PRIOR TO DRIVING THEM IN.
- 7 20'-0" #40 BARE COPPER CONDUCTOR FOR CONCRETE-ENCASED ELECTRODE IN FOUNDATION. ENCASED BY AT LEAST 2" OF CONCRETE.
- 8 PROVIDE LIGHTNING PROTECTION FOR WHOLE BUILDING ADDITION. LIGHTNING PROTECTION SYSTEM SHALL BE UL LISTED MASTER LABEL. REFER TO SPECIFICATIONS FOR SYSTEM REQUIREMENTS.
- 9 TIE INTO THE EXISTING LIGHTNING PROTECTION ON EXISTING BUILDING AS REQUIRED.
- 10 LINE VOLTAGE CLOCK STANDARD ELECTRIC TIME FARADAY 2364 OR OTHER CLOCK COMPATIBLE WITH EXISTING SYSTEM. EXTEND WIRING FROM EXISTING CLOCK HEAD END SYSTEM AS REQUIRED.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

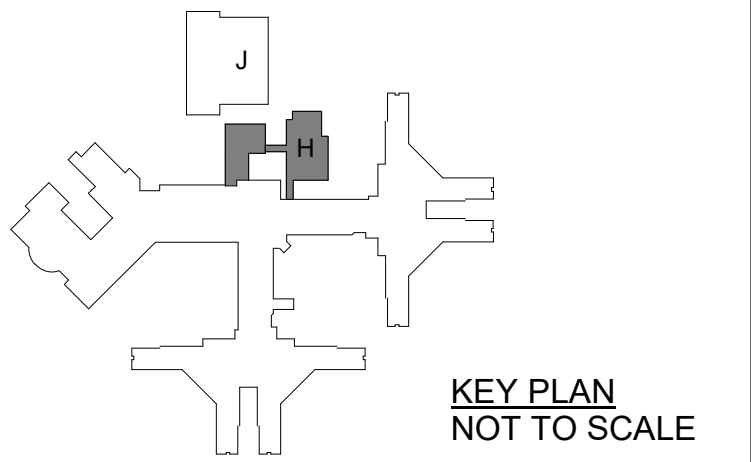

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107

WTAARCH.COM

COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
ELECTRICAL ROOF PLAN

PROJECT NUMBER 2021094	SHEET NUMBER E4.04
PROJECT DATE SEPTEMBER 6, 2023	CHECKED BY TLC

ELECTRICAL ROOF PLAN
SCALE: 1/8" = 1'-0"

Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0402

9/26/2023 4:37:11 PM C:\REVIT LOCAL FILES\2023-06-02-MEP_Forensic_Psyeh_v23_Gheintch.rvt

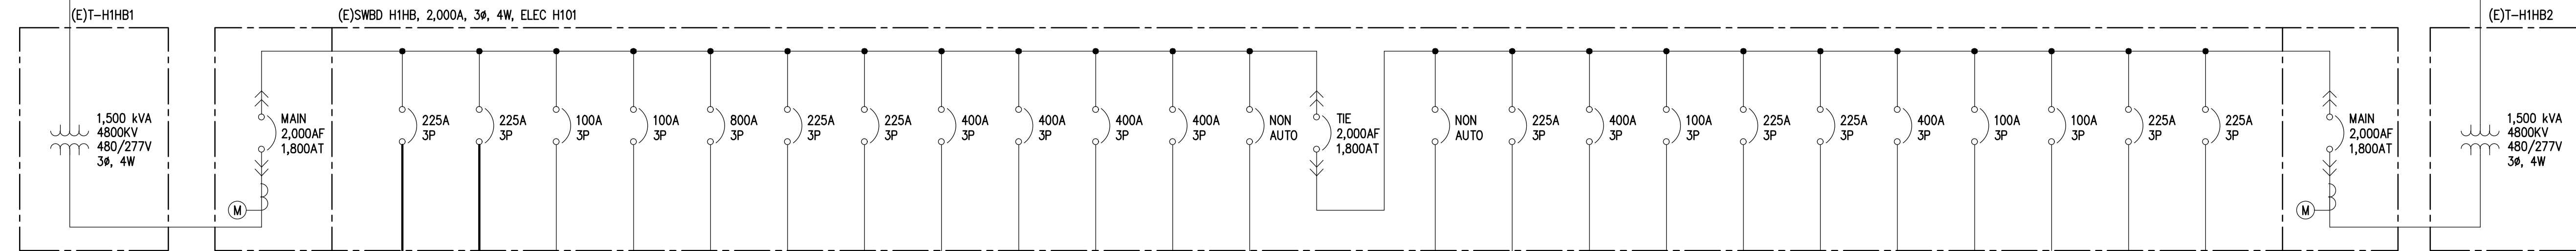


DIAGRAM GENERAL NOTES:

- THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS, COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- FEEDER AND BRANCH CIRCUIT CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH THE "FEEDER AND BRANCH CIRCUIT SIZING SCHEDULE-GENERAL PURPOSE" ON THE "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS SPECIFICALLY NOTED OTHERWISE.
- TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH THE "TRANSFORMER CIRCUIT SIZING SCHEDULE-GENERAL PURPOSE" ON THE "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS SPECIFICALLY NOTED OTHERWISE.
- MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH THE MOTOR CIRCUIT SIZING SCHEDULES ON THE "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS SPECIFICALLY NOTED OTHERWISE.
- BASIS OF DESIGN IS EATON/CUTLER-HAMMER POW-R-LINE DISTRIBUTION EQUIPMENT. IF THE CONTRACTOR ELECTS TO PROVIDE EQUIPMENT FROM OTHER APPROVED MANUFACTURERS, THE CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE THE LAYOUT AND CLEARANCE REQUIREMENTS IN ALL SPACES CONTAINING ELECTRICAL EQUIPMENT AND PROVIDE EQUIPMENT MEETING THE SPECIFICATIONS AND ACHIEVING CODE REQUIRED CLEARANCES WITHIN THE SPACE PROVIDED.
- VARIABLE FREQUENCY CONTROLLERS (VFC) FURNISHED BY MECHANICAL TRADES. ELECTRICAL CONTRACTOR SHALL INSTALL VFC. PROVIDE POWER FEEDER FROM VFC TO MOTOR. REFER TO SPECIFICATIONS FOR APPLICATION OF VFC POWER CABLE FROM VFC TO MOTOR.

CONSTRUCTION KEY NOTES:


- PROVIDE PADLOCKABLE HANDLE.
- PROVIDE NEW CIRCUIT BREAKER IN EXISTING SPACE OF PANEL. EXISTING PANEL IS CUTLER-HAMMER POW-R-LINE PRL4 SERIES.



(E)GENERATOR SWGR	
METERED AND DEMAND LOAD	ADDED INTO TOTAL (KVA)
METERED LOAD:	1463.75
ADDED LOAD:	63.35
FEEDER DEMAND LOAD:	1527.10
TOTAL (KVA):	1836.82
TOTAL (AMPS):	1527.72
OVERCURRENT LOAD:	
TOTAL (KVA):	1837.26
TOTAL (AMPS):	1837.26

(E)SHH1HB	
METERED AND DEMAND LOAD	ADDED INTO TOTAL (KVA)
METERED LOAD:	113.88
ADDED LOAD:	2.47
FEEDER DEMAND LOAD:	116.35
TOTAL (KVA):	139.94
TOTAL (AMPS):	116.97
OVERCURRENT LOAD:	
TOTAL (KVA):	140.69
TOTAL (AMPS):	140.69

(E)EDH1HB	
METERED AND DEMAND LOAD	ADDED INTO TOTAL (KVA)
METERED LOAD:	780.75
ADDED LOAD:	63.35
FEEDER DEMAND LOAD:	844.10
TOTAL (KVA):	1015.30
TOTAL (AMPS):	844.72
OVERCURRENT LOAD:	
TOTAL (KVA):	1016.04
TOTAL (AMPS):	1016.04

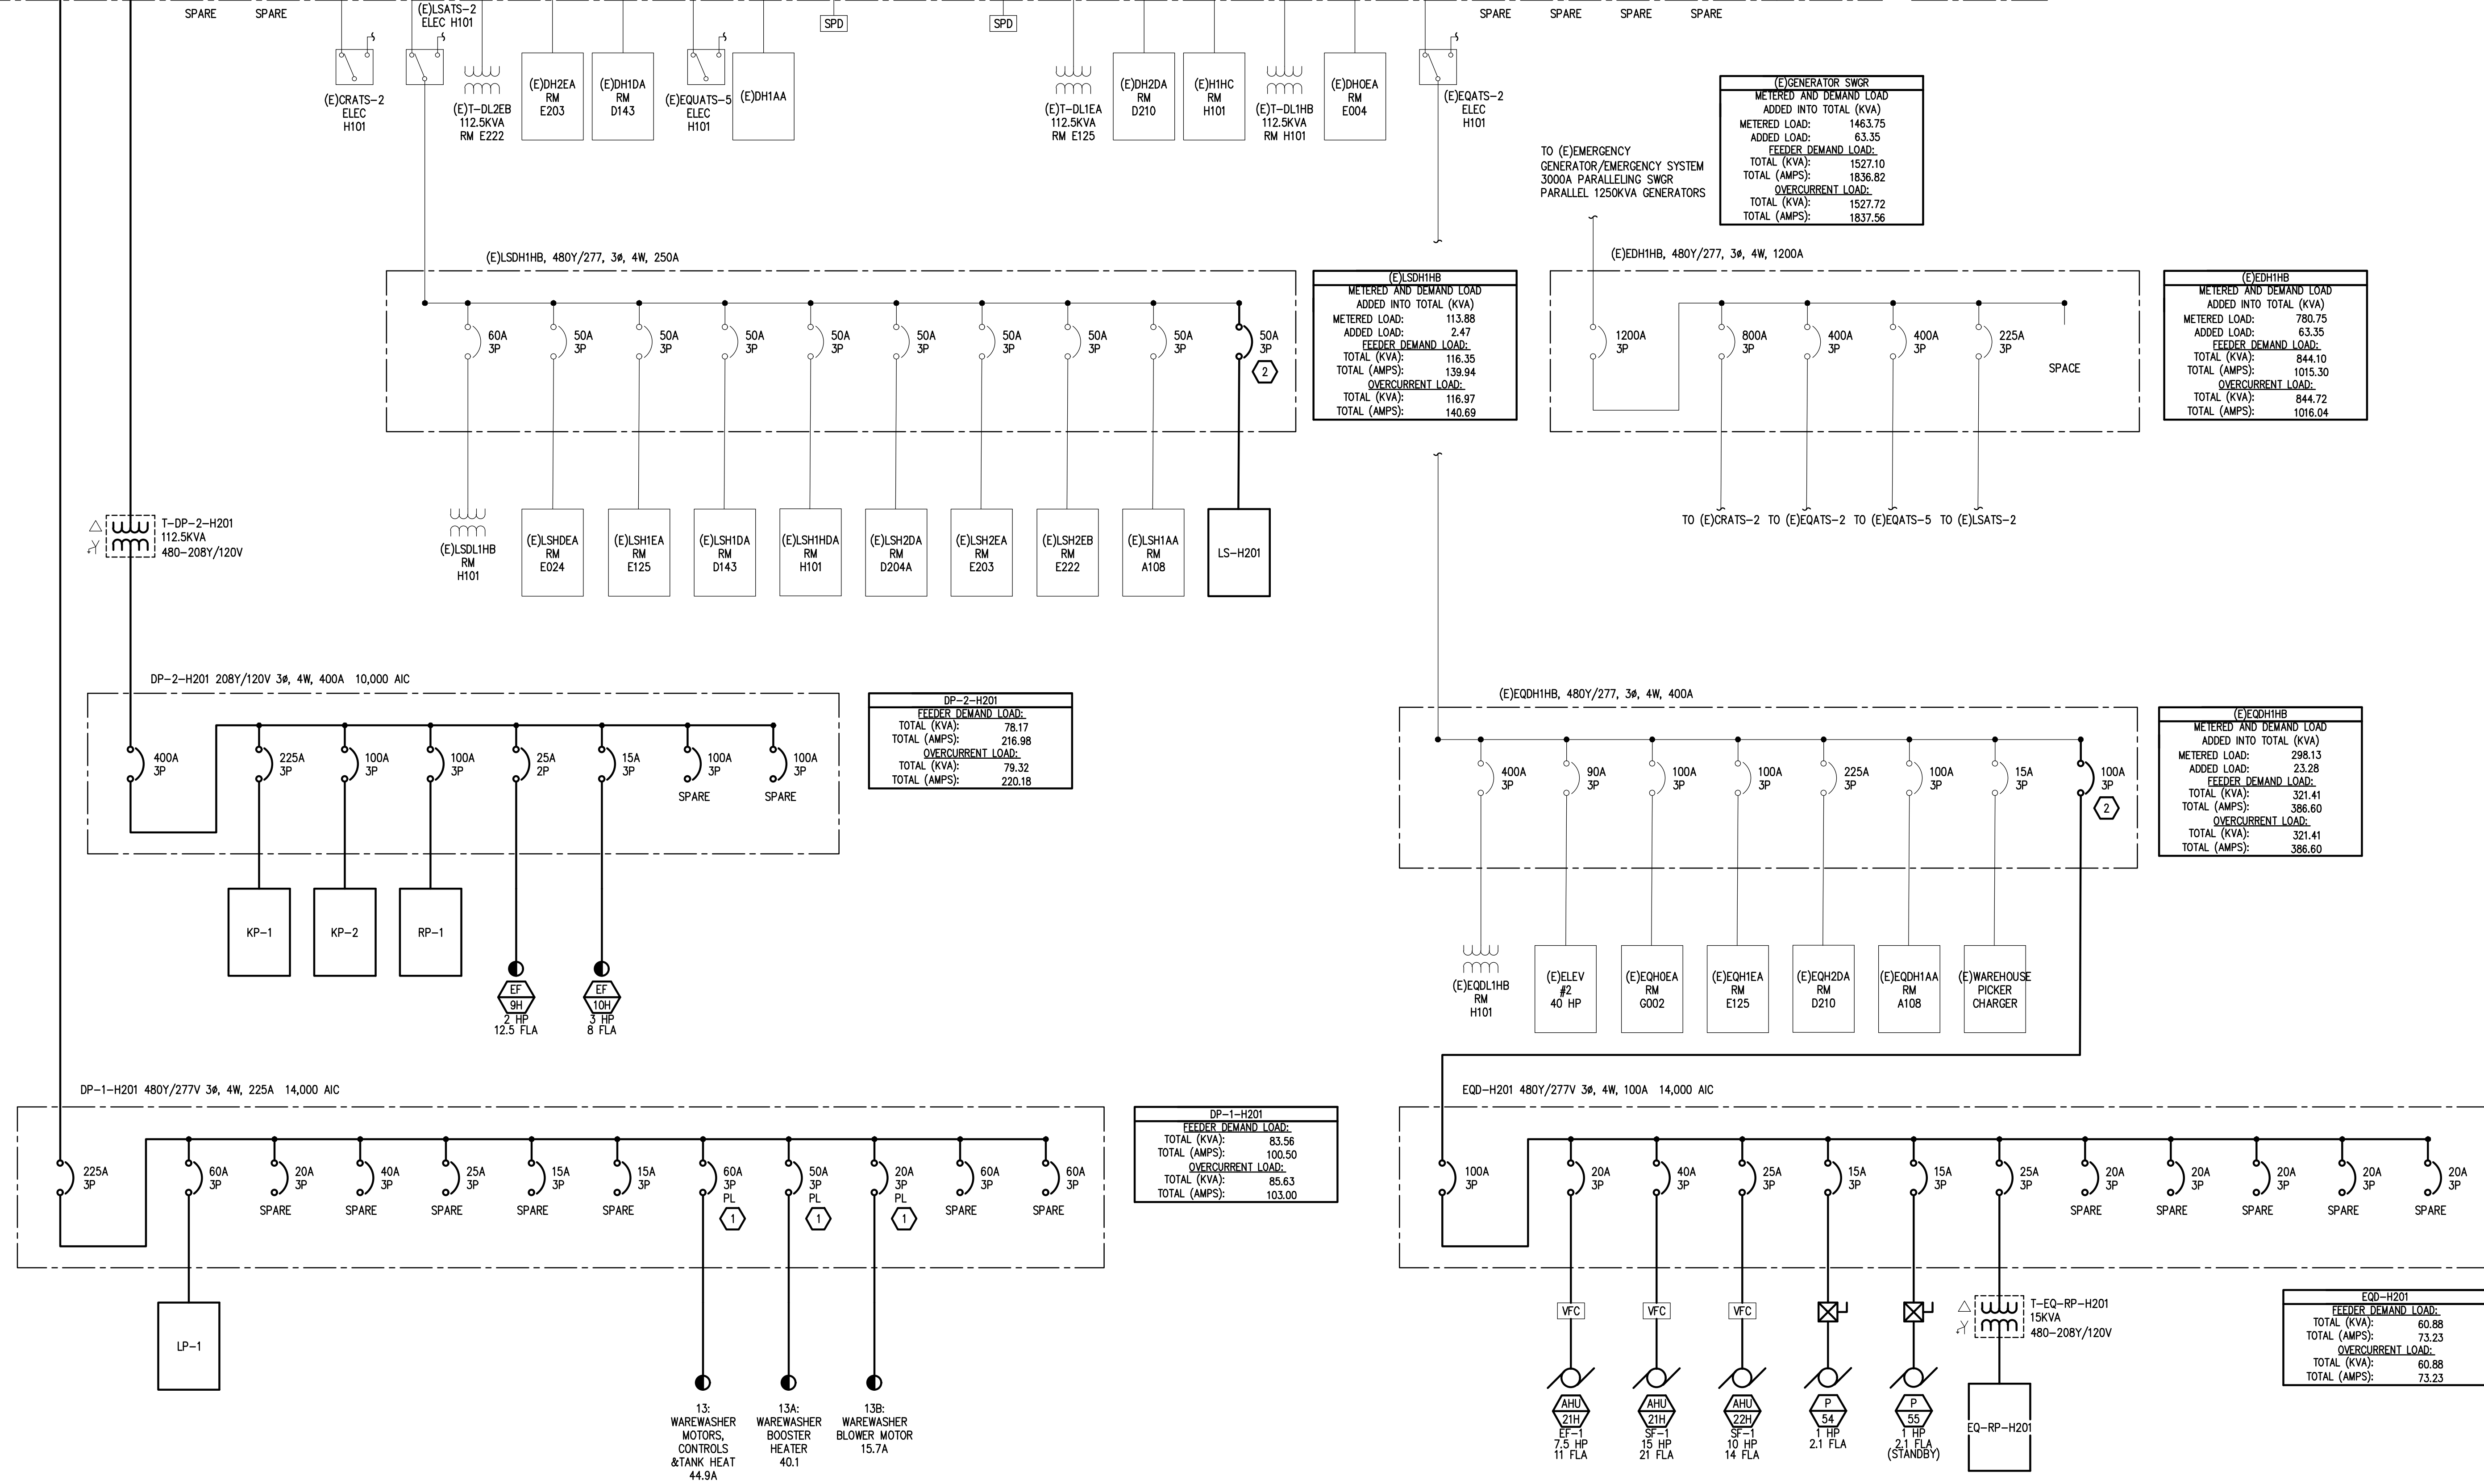

ONE-LINE DIAGRAM - SWITCHBOARD H1HB
NO SCALE

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
ONE LINE DIAGRAM - NEW
WORK

PROJECT NUMBER
2021094

PROJECT DATE
AUGUST 23, 2023

CHECKED BY
TLC

SHEET NUMBER
E5.01

Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2021094

9/5/2021\2021-0402-00\CA0\2021-0402-E5-01.dwg, E-501, 9/5/2023 4:32:25 PM, Gerard Henrich, Peter Basso Associates Inc.

PANELBOARD KP-1													
#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#	
1	K	86: FOOD PROCESSOR		20	1200	960		20		85: FOOD PROCESSOR	K	2	
3	K	84: SLICER		20		672	180	20		69: MIXER, COUNTER	K	4	
5				20			1439	1199				6	
7	K	68: MIXER, FLOOR		20	1439	1199		20	GFCI	65: CHILLER/FREEZER, BLAST	K	8	
9				20		1439	1199	2233				10	
11				20			2233	4798				12	
13	K	61: INDUCTION CHARGER	GFCI	20	2233	4798		50		41: UDS SYSTEM	K	14	
15				20		2233	4798					16	
17	K	40: FIRE SUPPRESSION...		20			1500	1500	20	40: FIRE SUPPRESSION...	K	18	
19	K	39: HOOD		20	1500	1500		20		39: HOOD	K	20	
21				20		396	1428			20: ICE MAKER/BIN	K	22	
23	K	26: DISPOSER, GARBAGE		15			396	720	15			24	
25				20		396	720			12: DISPOSER, GARBAGE	K	26	
27	K	6: COFFEE MAKER		20		1440	720					28	
29				20			1612	1272	20	GFCI	4: DISPLAY, CASE REFRIGERATED	K	30
31	K	5: CABINET, HEATED PASS-THRU	GFCI	20	1612	1272		20	GFCI	4: DISPLAY, CASE REFRIGERATED	K	32	
33	K	65A: CHILLER/FREEZER, BLAST, EVAP	GFCI	20		240	1800		20	41: UDS SYSTEM FUEL/SHUNT...	K	34	
35				20			1799	420	20	GFCI	1D: SERVING LINE - COLD FOOD	K	36
37	K	8: SOILED DISHWASHABLE TRAY CONVEYOR		20	1799	420		20	GFCI	1C: SERVING LINE - COLD FOOD	K	38	
39				20		1799	420		20	GFCI	1C: SERVING LINE - COLD FOOD	K	40
41				20			0	0	20		SPARE		42
					21049	18765		18889					
					0A	0B	0C						
PANELBOARD INFORMATION			BRANCH CIRCUIT CONNECTED LOAD			DEMAND FACTOR		CALCULATED LOAD		FEEDER AND OVERCURRENT...		NOTES	
VOLTAGE: 208Y/120V			CONTINUOUS LOAD (C):			0		100% 0		125% 0			
BUS AMPACITY: 225A			ELECTRIC HEAT (E)			0		100% 0		125% 0			
MAIN TYPE: MLO			NON-CONTINUOUS LOAD (NC):			0		100% 0		100% 0			
MINIMUM A.I.C.: 10,000			KITCHEN LOAD (K):			58702.19		65.00% 38156.42		100% 38156.42			
MOUNTING: SURFACE			RECEPT BASE LOAD (R):			0		100% 0		100% 0			
			RECEPT DEMAND LOAD (R):			0		50% 0		100% 0			
			LIGHTING LOAD (L):			0		100% 0		125% 0			
			ADDITIONAL TRACK LIGHTING...:			0		100% 0		100% 0			
			MOTORS, HIGHEST LOAD (M):			0		125% 0		100% 0			
PANELBOARD LOCATION			MOTORS, REMAINING			0		100% 0		100% 0			
NOTE: DEMAND AND SIZING INFORMATION IS CALCULATED...					TOTAL (kVA): 38.16		TOTAL... 105.91		TOTAL... 105.91				

© Copr. 2022 by Peter Basso Associates...

PANELBOARD KP-2													
#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#	
1				20	0	0		20		SPARE		2	
3				20	0	0		20		SPARE		4	
5				20			0	0	20		SPARE	6	
7				20	0	0		0	20		SPARE	8	
9	R	RECEPTS: H123,H125		20		1080	0		20		SPARE	10	
11	R	RECEPTS: H124,H126,H127		20			1080	1260	20		RECEPTS:H123,H127	R	12
13	R	RECEPTS:H123,H124		20	900	900		20		RECEPTS:H123	R	14	
15	R	RECEPTS:H123,H124		20		720	1272		20	KITCHEN COUNTERTOP	K	16	
17	C	REFRIGERATOR:H112	GFCI	20			1200	1500	20	COFFEE:H112	NC	18	
19	NC	MICROWAVE:H112		20	1500	1200		20		GARBAGE DISPOSAL:H112	NC	20	
21				20		0	0		20		SPARE	22	
23				20			0	0	20		SPARE	24	
25				20	0	1654			20	GFCI	1B:SERVING LINE - HOT/COLD FOOD COMBO	K	26
27	K	1BA: SERVING LINE - HC FOOD...	GFCI	20		420	1654		20			28	
29	K	1A:SERVING LINE - HOT FOOD	GFCI	20			1654	1654	20	GFCI	1A:SERVING LINE - HOT FOOD	K	30
31				20	1654	1654			20			32	
33	R	ROOF MECH/ELEC ROOM RECEPTS		20		1080	0		20		SPARE	34	
35				20			0	0	20		SPARE	36	
37				20	0	0			20		SPARE	38	
39				20		0	0		20		SPARE	40	
41				20			0	0	20		SPARE	42	
					9401	6220		8347					
					0A	0B	0C						
PANELBOARD INFORMATION			BRANCH CIRCUIT CONNECTED LOAD			DEMAND FACTOR		CALCULATED LOAD		FEEDER AND OVERCURRENT...		NOTES	
VOLTAGE: 208Y/120V			CONTINUOUS LOAD (C):			1200		100% 1200		125% 1500			
BUS AMPACITY: 100A			ELECTRIC HEAT (E)			0		100% 0		125% 0			
MAIN TYPE: MLO			NON-CONTINUOUS LOAD (NC):			4200		100% 4200		100% 4200			
MINIMUM A.I.C.: 10,000			KITCHEN LOAD (K):			11613.6		70.00% 8129.52		100% 8129.52			
MOUNTING: SURFACE			RECEPT BASE LOAD (R):			7020		100% 7020		100% 7020			
			RECEPT DEMAND LOAD (R):			0		50% 0		100% 0			
			LIGHTING LOAD (L):			0		100% 0		125% 0			
			ADDITIONAL TRACK LIGHTING...:			0		100% 0		100% 0			
			MOTORS, HIGHEST LOAD (M):			0		125% 0		100% 0			
PANELBOARD LOCATION			MOTORS, REMAINING			0		100% 0		100% 0			
NOTE: DEMAND AND SIZING INFORMATION IS CALCULATED...					TOTAL (kVA): 20.55		TOTAL... 57.04		TOTAL... 57.04				


© Copr. 2022 by Peter Basso Associates...

PANELBOARD RP-1													
#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#	
1	R	RECEPTS:H119,H131,EXT. ROOF		20	1260	1260		20			R	2	
3	R	RECEPTS:H131,H120		20		1080	1080		20		RECEPTS:H107,H130,H131,EXT	R	4
5				20			360	0	20		SPARE	6	
7				20	0	0			20		SPARE	8	
9				20		0	600		20		NORTH OVERHEAD DOOR:H120	M	10
11	M	SOUTH OVERHEAD DOOR: H120		20			600	1000	20		FIRE ALARM NAC: H201	C	12
13	M	UH-8H: H201		15	528	528			15		UH-9H: H201	M	14
15	M	UH-10H: H201		15		528	528		15		CUH-5H: H120	M	16
17	M	CUH-6H: H121		15			528	528	15		CUH-3H: H132	M	18
19	M	CUH-4H: H131		15	528	528			15		EF-5H: ROOF	M	20
21	C	TEMPERATURE CONTROL PANEL		20		1200	528		20		EF-7H: ROOF	M	22
23	C	TEMPERATURE CONTROL PANEL		20			1200	528	15		EF-8H: ROOF	M	24
25	M	CUH-11H: H119		15	528	0			20		SPARE	26	
27				20		0	0		20		SPARE	28	
29				20			0	0	20		SPARE	30	
31				20	0	0			20		SPARE	32	
33				20		0	0		20		SPARE	34	
35				20			0	0	20		SPARE	36	
37				20	0	0			20		SPARE	38	
39				20		0	0		20		SPARE	40	
41				20			0	0	20		SPARE	42	
					5160	8544		4744					
					0A	0B	0C						
PANELBOARD INFORMATION			BRANCH CIRCUIT CONNECTED LOAD			DEMAND FACTOR		CALCULATED LOAD		FEEDER AND OVERCURRENT...		NOTES	
VOLTAGE: 208Y/120V			CONTINUOUS LOAD (C):			3400		100% 3400		125% 4250			
BUS AMPACITY: 100A			ELECTRIC HEAT (E)			0		100% 0		125% 0			
MAIN TYPE: MLO			NON-CONTINUOUS LOAD (NC):			0		100% 0		100% 0			
MINIMUM A.I.C.: 10,000			KITCHEN LOAD (K):			0		0		100% 0			
MOUNTING: SURFACE			RECEPT BASE LOAD (R):			5940		100% 5940		100% 5940			
			RECEPT DEMAND LOAD (R):			0		50% 0		100% 0			
			LIGHTING LOAD (L):			0		100% 0		125% 0			
			ADDITIONAL TRACK LIGHTING...:			0		100% 0		100% 0			
			MOTORS, HIGHEST LOAD (M):			600		125% 750		100% 750			
PANELBOARD LOCATION			MOTORS, REMAINING			6408		100% 6408		100% 6408			
NOTE: DEMAND AND SIZING INFORMATION IS CALCULATED...					TOTAL (kVA): 15.6		TOTAL... 43.30		TOTAL... 45.66				

© Copr. 2022 by Peter Basso Associates...

PANELBOARD LS-H201												
#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#
1	L	LIGHTING EM LIGHTS		20	1924	280		20		EXTERIOR BUILDING MOUNTED...	L	2
3				20		0	368		20	LIGHTING STAIR H121	L	4
5				20			0	0	20		SPARE	6
7				20	0	0			20		SPARE	8
9				20		0	0		20		SPARE	10
11				20			0	0	20		SPARE	12
13				20	0	0			20		SPARE	14
15				20		0	0		20		SPARE	16
17				20			0	0	20		SPARE	18
19				20	0	0			20		SPARE	20
21				20		0	0		20		SPARE	22
23				20			0	0	20		SPARE	24
25				20	0	0			20		SPARE	26
27				20		0	0		20		SPARE	28
29				20			0	0	20		SPARE	30
31				20	0	0			20		SPARE	32
33				20		0	0		20			

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

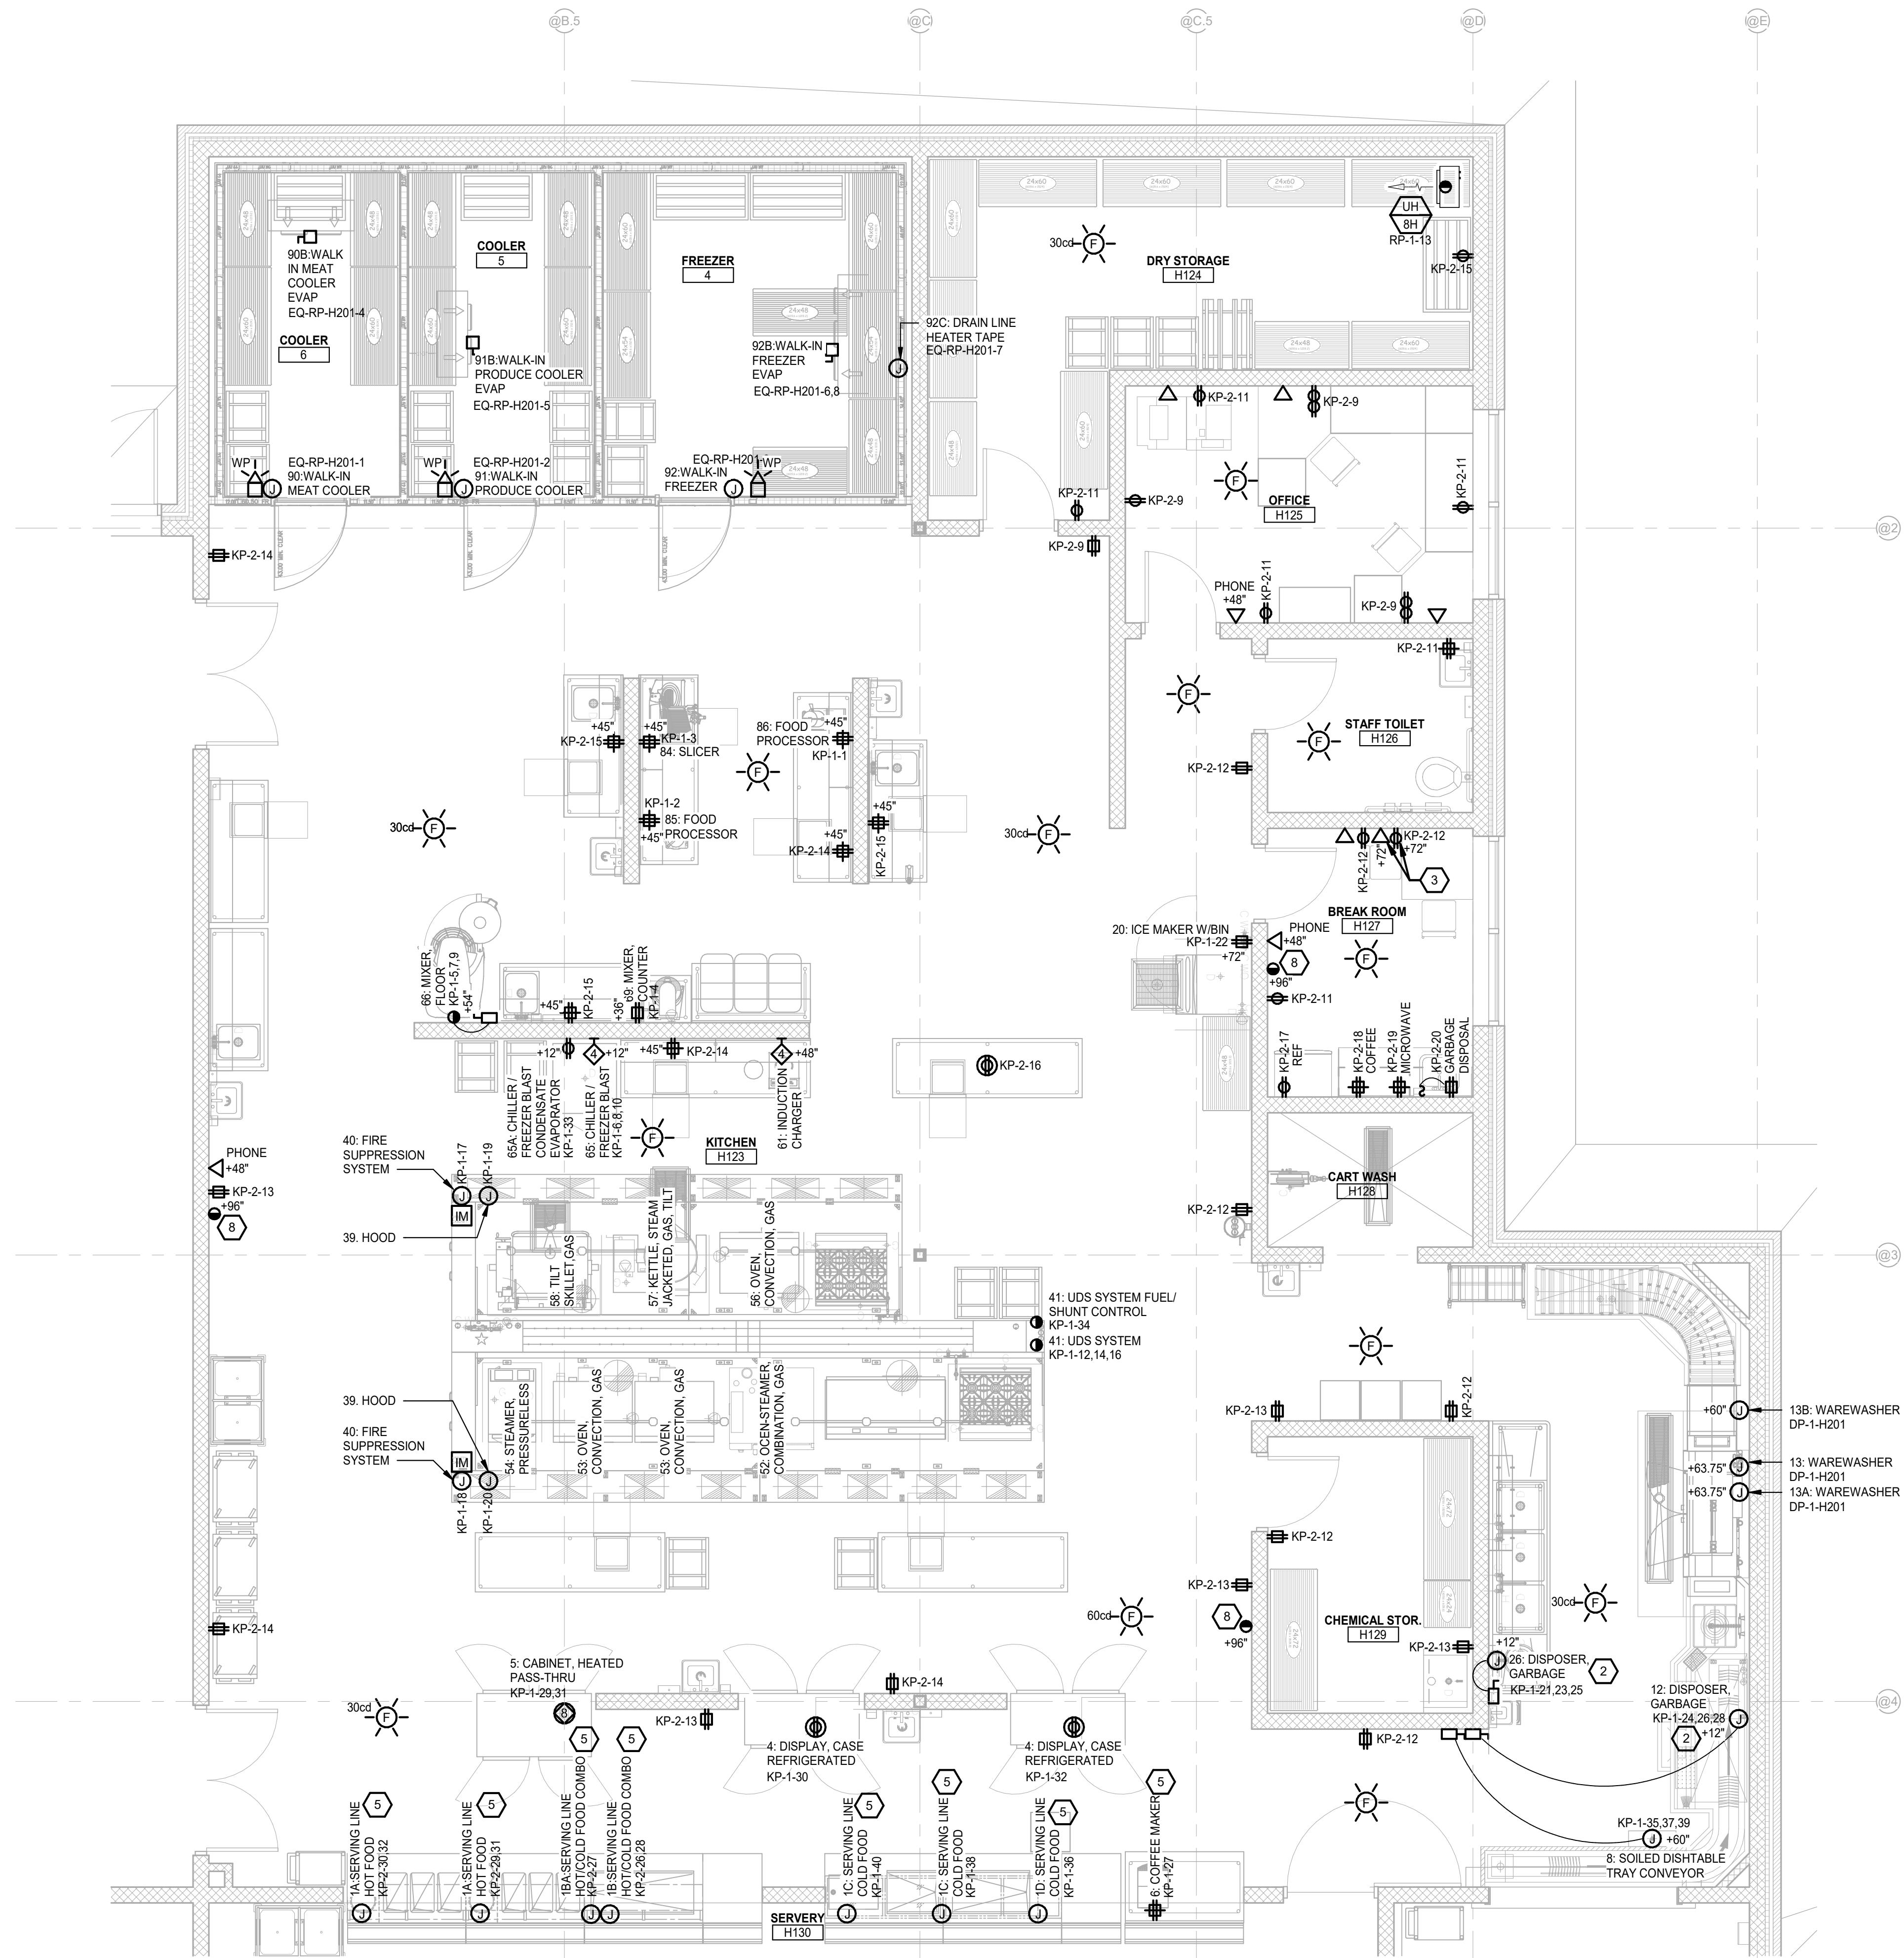

1
E3.01 FIRST FLOOR ELECTRICAL ENLARGED KITCHEN PLAN
SCALE: 1/4" = 1'-0"

ELECTRICAL GENERAL NOTES:

- THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH TRANSFORMER CIRCUIT SIZING SCHEDULE SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH MOTOR CIRCUIT SIZING SCHEDULES SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- COORDINATE THE MOUNTING HEIGHTS OF DEVICES WITH ARCHITECTURAL ELEVATIONS AND THE TRADES INSTALLING THE WORK.
- REFER TO MECHANICAL SCHEDULE SHEETS FOR ELECTRICAL REQUIREMENTS FOR MECHANICAL EQUIPMENT. PROVIDE ALL CONNECTIONS, STARTERS, DISCONNECTS, ETC. AS REQUIRED BY SCHEDULES AND WHERE NOTED ELSEWHERE. VERIFY REQUIREMENTS OF ALL MECHANICAL EQUIPMENT WITH SHOP DRAWINGS SUBMITTALS. NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN EQUIPMENT SUBMITTALS AND ELECTRICAL DRAWINGS. WHERE CIRCUIT SIZES ARE SHOWN ON THE ELECTRICAL DRAWINGS THAT DIFFER FROM WHAT IS INDICATED ON THE MECHANICAL SCHEDULES, PROVIDE THE CIRCUIT OF HIGHER AMPACITY.
- REFER TO TEMPERATURE CONTROLS SHEETS FOR REQUIRED FIRE ALARM CONTROL MODULES, DUCT SMOKE DETECTORS, AND MOTOR CONTROLLERS. PROVIDE ALL ACCESSORIES INDICATED.
- REFER TO LIGHTING CONTROL SCHEDULE FOR ROOM CONTROL AND EMERGENCY LIGHTING CIRCUIT CONTROL REQUIREMENTS. DESIGNATION FOR ROOM IS INDICATED AS A LETTERED OVAL SYMBOL.
- ALL FIRE ALARM DEVICES SHALL BE COMPATIBLE WITH EXISTING SIMPLEX GRINNEL 4120 FIRE ALARM SYSTEM. PROVIDE NECESSARY COMPONENTS, MODULES, ETC. AS REQUIRED FOR A FULLY FUNCTIONAL SYSTEM. RE-TEST AND CERTIFY EXISTING FIRE ALARM SYSTEM AT COMPLETION OF PROJECT.
- PROVIDE TAMPERS RESISTANT COVER PLATE KENALL WPP SERIES OR EQUAL WHERE PATIENTS WILL HAVE ACCESS TO DEVICES.
- REFER TO SECURITY/TELECOMMUNICATION DRAWINGS FOR FINAL DEVICE LOCATIONS AND RACEWAY REQUIREMENTS. COORDINATE WITH SECURITY REQUIREMENTS WITH INSTALLING TRADES.
- COORDINATE ELECTRICAL REQUIREMENTS DEVICE LOCATIONS AND MOUNTING HEIGHTS WITH KITCHEN EQUIPMENT DRAWINGS, SHOP DRAWINGS AND KITCHEN EQUIPMENT INSTALLER.

CONSTRUCTION KEY NOTES:


- PROVIDE TOGGLE SWITCH LOCK GUARD FOR BOILER DISCONNECT LOCKING MEANS.
- PROVIDE INTERWIRE TO CONTROL PANEL. COORDINATE WITH FOOD SERVICE INSTALLER AND INSTALLATION INSTRUCTIONS.
- COORDINATE FINAL LOCATION OF TV WITH ARCHITECTURAL DRAWINGS AND TRADES PRIOR TO ROUGH IN.
- INSTALL BOTTOM OF LIGHT FIXTURE AT 8'-0" AFF.
- ROUTE BRANCH CIRCUIT IN FLOOR AND STUB UP TO FINAL LOCATION. COORDINATE FINAL LOCATION WITH FOOD SERVICE DRAWINGS AND TRADES.
- MATCH ON-OFF TIMES WITH EXISTING SITE LIGHTING. COORDINATE EXACT TIMES WITH OWNER. CONNECT PHOTO CELL CONTROL TO EXISTING MAIN BUILDING PHOTO CELL WIRING/CONTROL.
- 4" HOUSEKEEPING PAD.
- LINE VOLTAGE CLOCK STANDARD ELECTRIC TIME FARADAY 2384 OR OTHER CLOCK COMPATABLE WITH EXISTING SYSTEM. EXTEND WIRING FROM EXISTING CLOCK HEAD END SYSTEM AS REQUIRED.

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

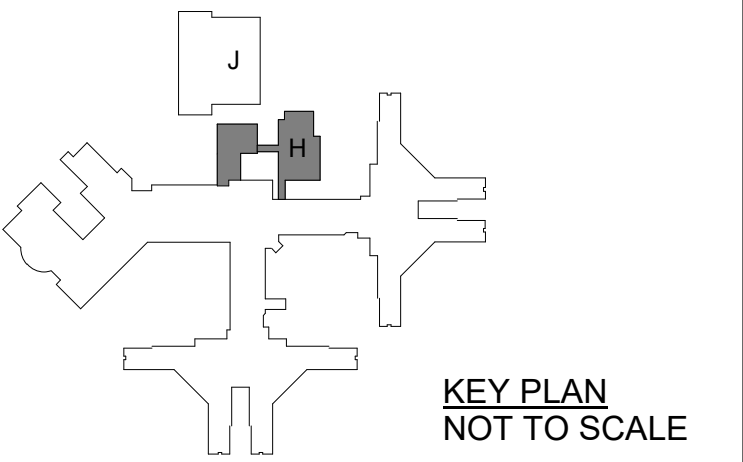

WTA ARCHITECTS
100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
ELECTRICAL ENLARGED
PLAN


PROJECT NUMBER
2021094 SHEET NUMBER

PROJECT DATE
SEPTEMBER 6, 2023 **E6.01**

CHECKED BY
TLC

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0492

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

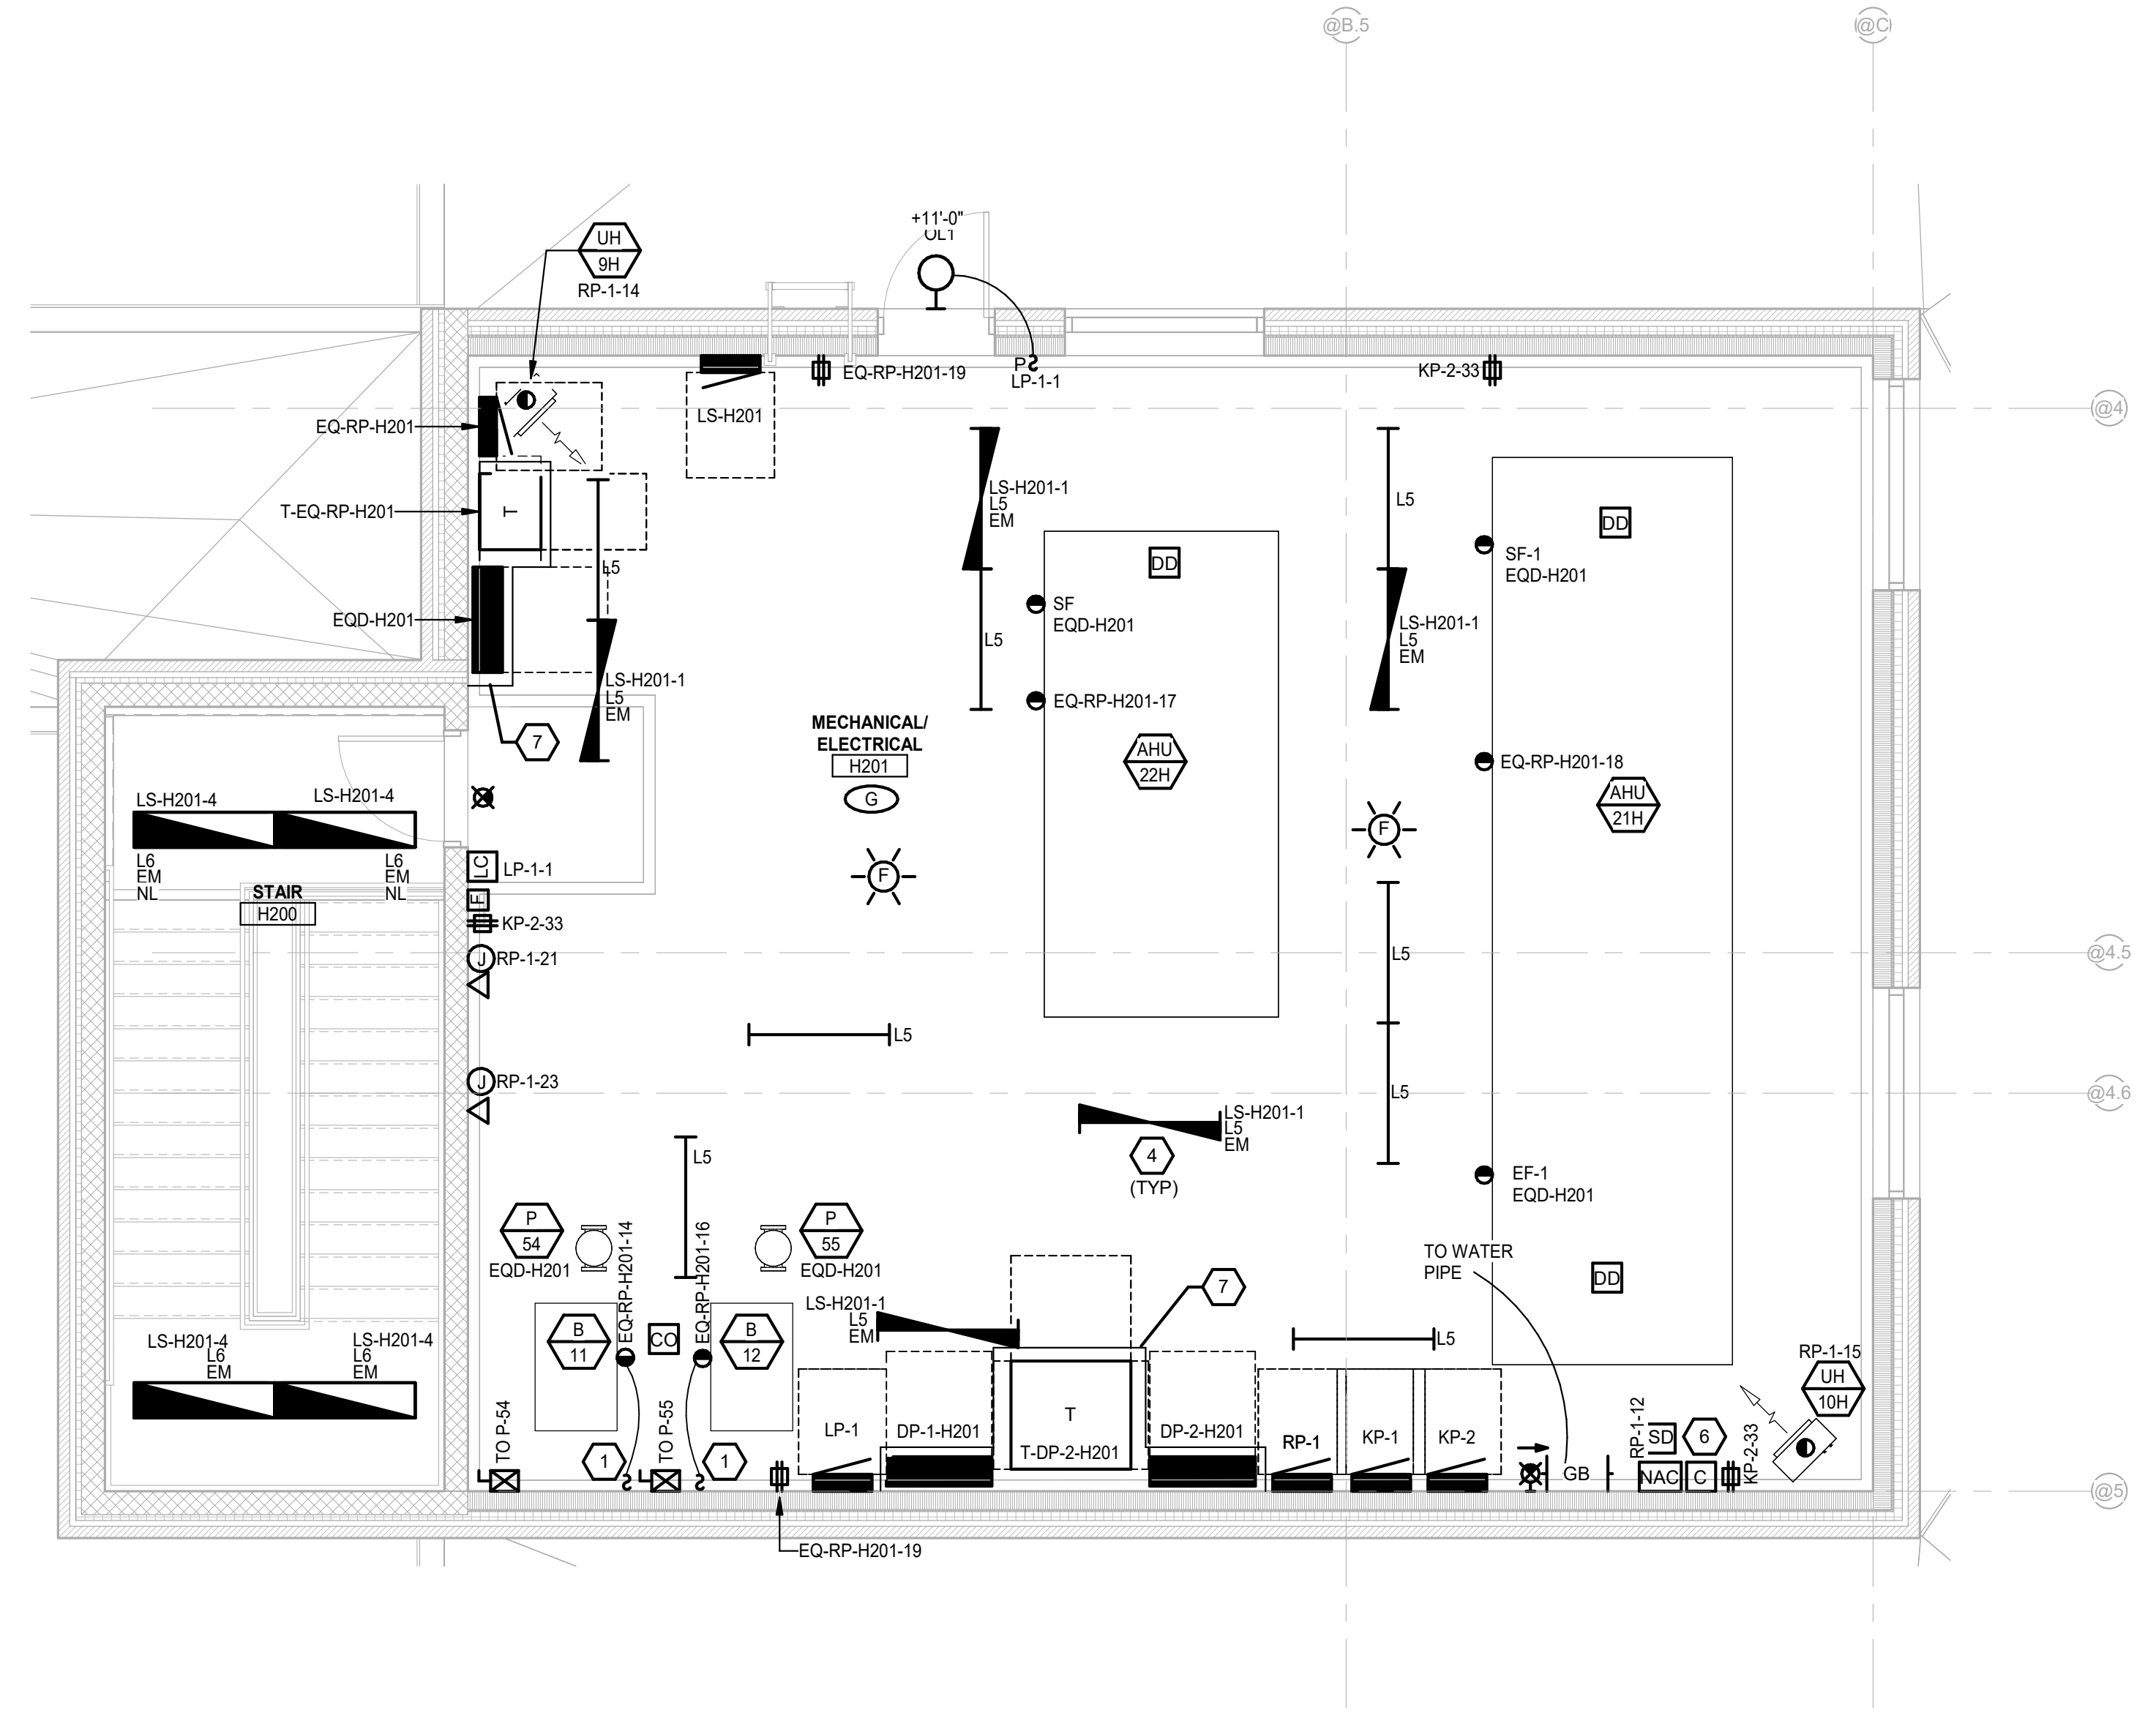

PENTHOUSE ELECTRICAL ENLARGED PLAN
SCALE: 1/4" = 1'-0"

ELECTRICAL GENERAL NOTES:

- THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH TRANSFORMER CIRCUIT SIZING SCHEDULE SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH MOTOR CIRCUIT SIZING SCHEDULES SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- COORDINATE THE MOUNTING HEIGHTS OF DEVICES WITH ARCHITECTURAL ELEVATIONS AND THE TRADES INSTALLING THE WORK.
- REFER TO MECHANICAL SCHEDULE SHEETS FOR ELECTRICAL REQUIREMENTS FOR MECHANICAL EQUIPMENT. PROVIDE ALL CONNECTIONS, STARTERS, DISCONNECTS, ETC. AS REQUIRED BY SCHEDULES AND WHERE NOTED ELSEWHERE. VERIFY REQUIREMENTS OF ALL MECHANICAL EQUIPMENT WITH SHOP DRAWINGS SUBMITTALS. NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN EQUIPMENT SUBMITTALS AND ELECTRICAL DRAWINGS. WHERE CIRCUIT SIZES ARE SHOWN ON THE ELECTRICAL DRAWINGS THAT DIFFER FROM WHAT IS INDICATED ON THE MECHANICAL SCHEDULES, PROVIDE THE CIRCUIT OF HIGHER AMPACITY.
- REFER TO TEMPERATURE CONTROLS SHEETS FOR REQUIRED FIRE ALARM CONTROL MODULES, DUCT SMOKE DETECTORS, AND MOTOR CONTROLLERS. PROVIDE ALL ACCESSORIES INDICATED.
- REFER TO LIGHTING CONTROL SCHEDULE FOR ROOM CONTROL AND EMERGENCY LIGHTING CIRCUIT CONTROL REQUIREMENTS. DESIGNATION FOR ROOM IS INDICATED AS A LETTERED OVAL SYMBOL.
- ALL FIRE ALARM DEVICES SHALL BE COMPATIBLE WITH EXISTING SIMPLEX GRINNEL 4120 FIRE ALARM SYSTEM. PROVIDE NECESSARY COMPONENTS, MODULES, ETC. AS REQUIRED FOR A FULLY FUNCTIONAL SYSTEM. RE-TEST AND CERTIFY EXISTING FIRE ALARM SYSTEM AT COMPLETION OF PROJECT.
- PROVIDE TAMPER RESISTANT COVER PLATE KENALL WPP SERIES OR EQUAL WHERE PATIENTS WILL HAVE ACCESS TO DEVICES.
- REFER TO SECURITY/TELECOMMUNICATION DRAWINGS FOR FINAL DEVICE LOCATIONS AND RACEWAY REQUIREMENTS. COORDINATE WITH SECURITY REQUIREMENTS WITH INSTALLING TRADES.
- COORDINATE ELECTRICAL REQUIREMENTS DEVICE LOCATIONS AND MOUNTING HEIGHTS WITH KITCHEN EQUIPMENT DRAWINGS, SHOP DRAWINGS AND KITCHEN EQUIPMENT INSTALLER.

CONSTRUCTION KEY NOTES:

- PROVIDE TOGGLE SWITCH LOCK GUARD FOR BOILER DISCONNECT LOCKING MEANS.
- PROVIDE INTERWIRE TO CONTROL PANEL. COORDINATE WITH FOOD SERVICE INSTALLER AND INSTALLATION INSTRUCTIONS.
- COORDINATE FINAL LOCATION OF TV WITH ARCHITECTURAL DRAWINGS AND TRADES PRIOR TO ROUGH IN.
- INSTALL BOTTOM OF LIGHT FIXTURE AT 8'-0" AFF.
- ROUTE BRANCH CIRCUIT IN FLOOR AND STUB UP TO FINAL LOCATION. COORDINATE FINAL LOCATION WITH FOOD SERVICE DRAWINGS AND TRADES.
- MATCH ON-OFF TIMES WITH EXISTING SITE LIGHTING. COORDINATE EXACT TIMES WITH OWNER. CONNECT PHOTO CELL CONTROL TO EXISTING MAIN BUILDING PHOTO CELL WIRING/CONTROL.
- 4" HOUSEKEEPING PAD.
- LINE VOLTAGE CLOCK STANDARD ELECTRIC TIME FARADAY 2384 OR OTHER CLOCK COMPATABLE WITH EXISTING SYSTEM. EXTEND WIRING FROM EXISTING CLOCK HEAD END SYSTEM AS REQUIRED.


NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

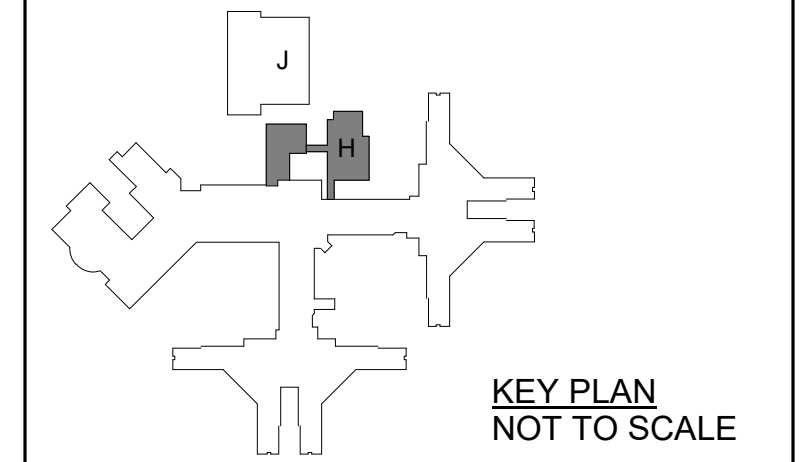


WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN


SHEET TITLE
ELECTRICAL ENLARGED PLAN

PROJECT NUMBER 2021094	SHEET NUMBER E6.02
PROJECT DATE SEPTEMBER 6, 2023	CHECKED BY TLC

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 303-0492

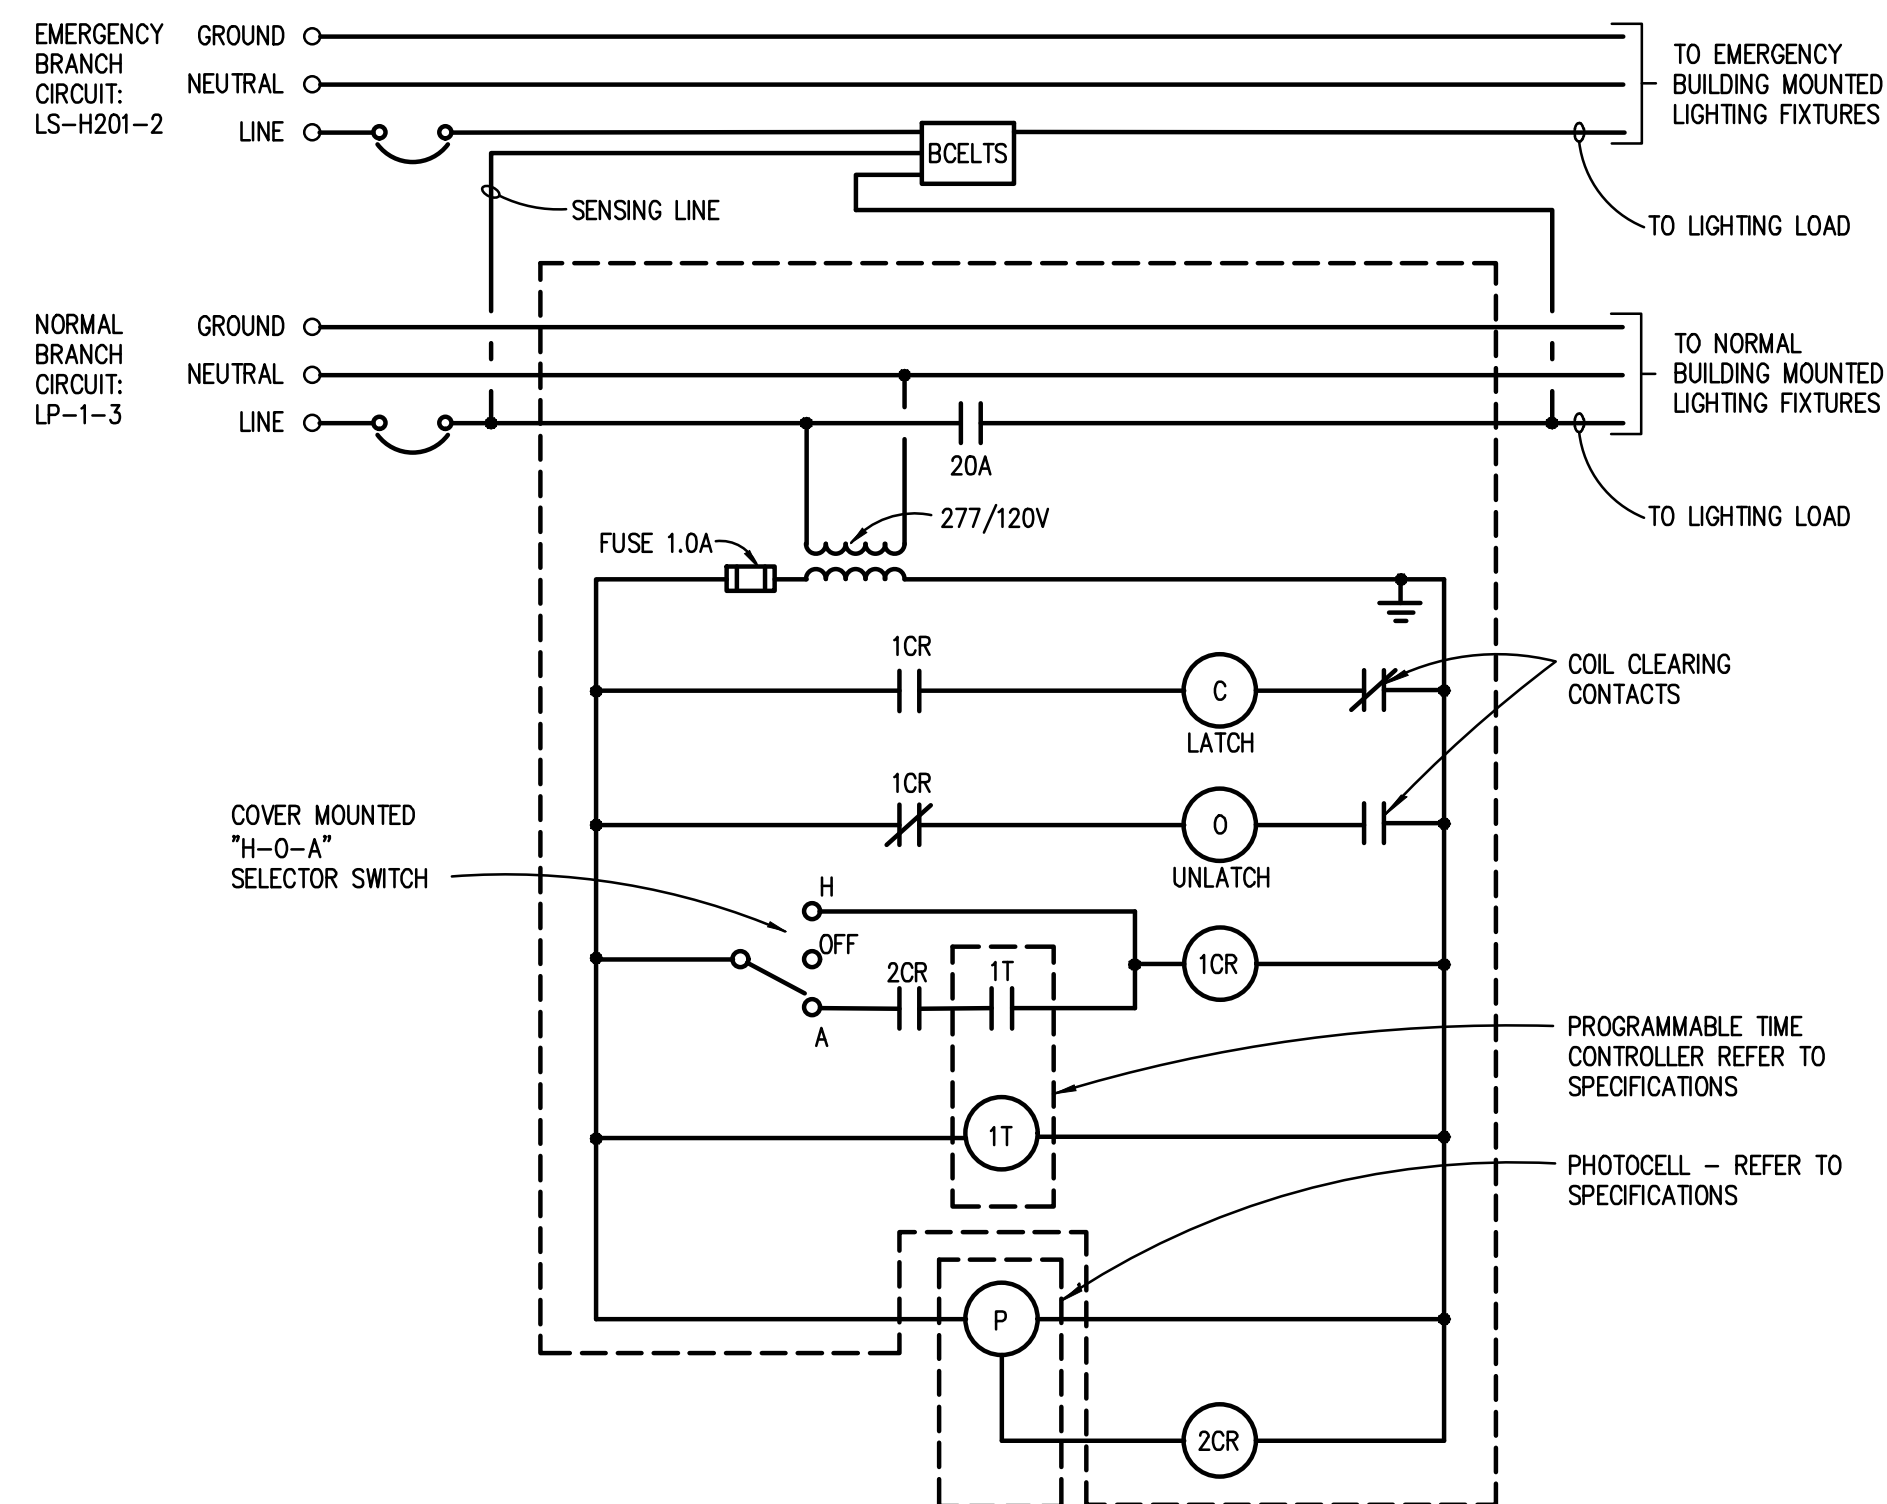


LIGHTING CONTACTOR WITH TIME CLOCK CONTROL AND BCELTS WIRING DIAGRAM
NO SCALE

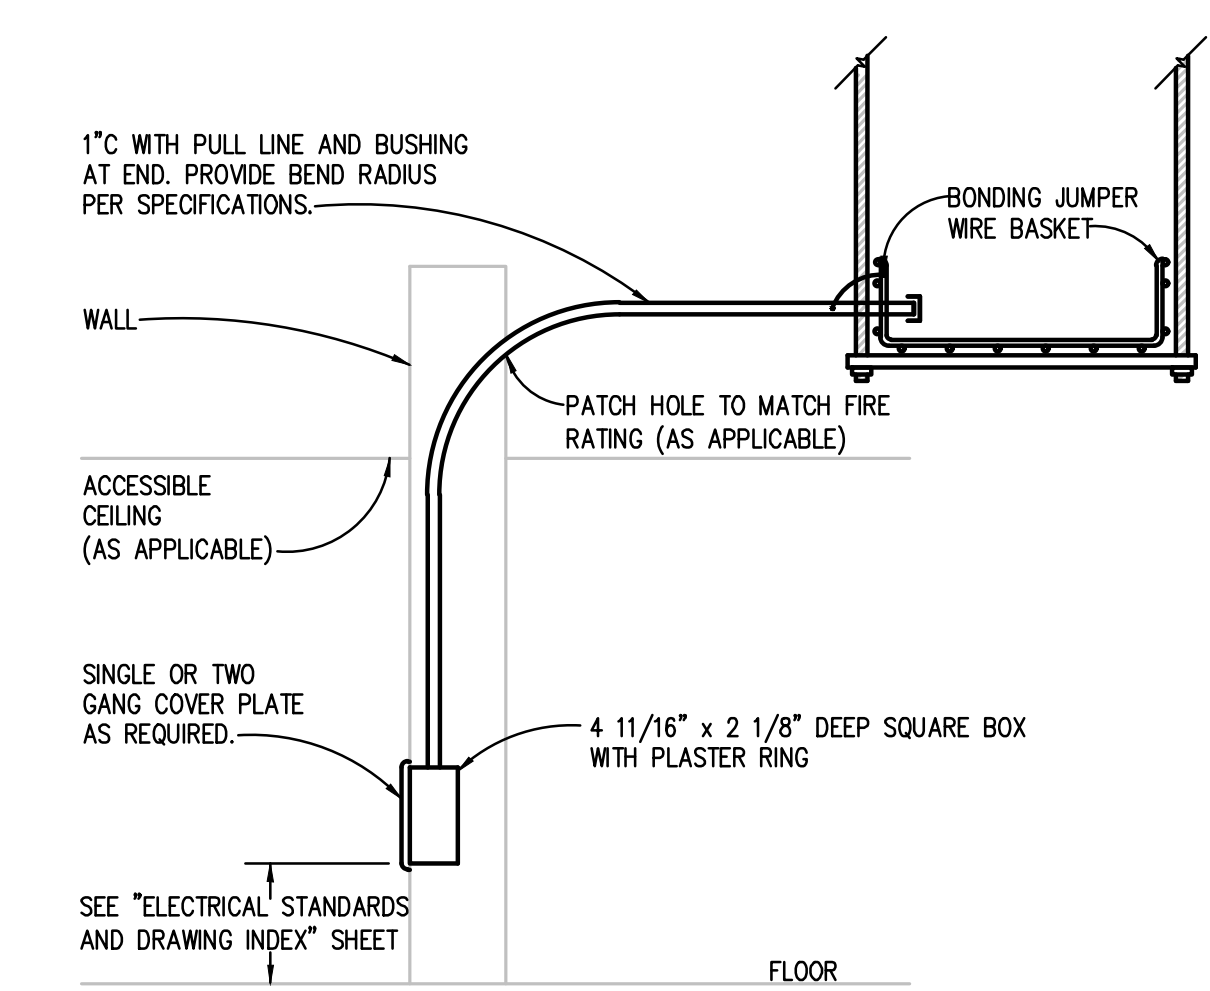


TELECOMMUNICATION OUTLET DETAIL

- NOTES:
1. IF CEILING IN ROOM IS NOT ACCESSIBLE, ROUTE CONDUIT THROUGH NEAREST ACCESSIBLE CEILING TO CABLE/WIRE BASKET TRAY.

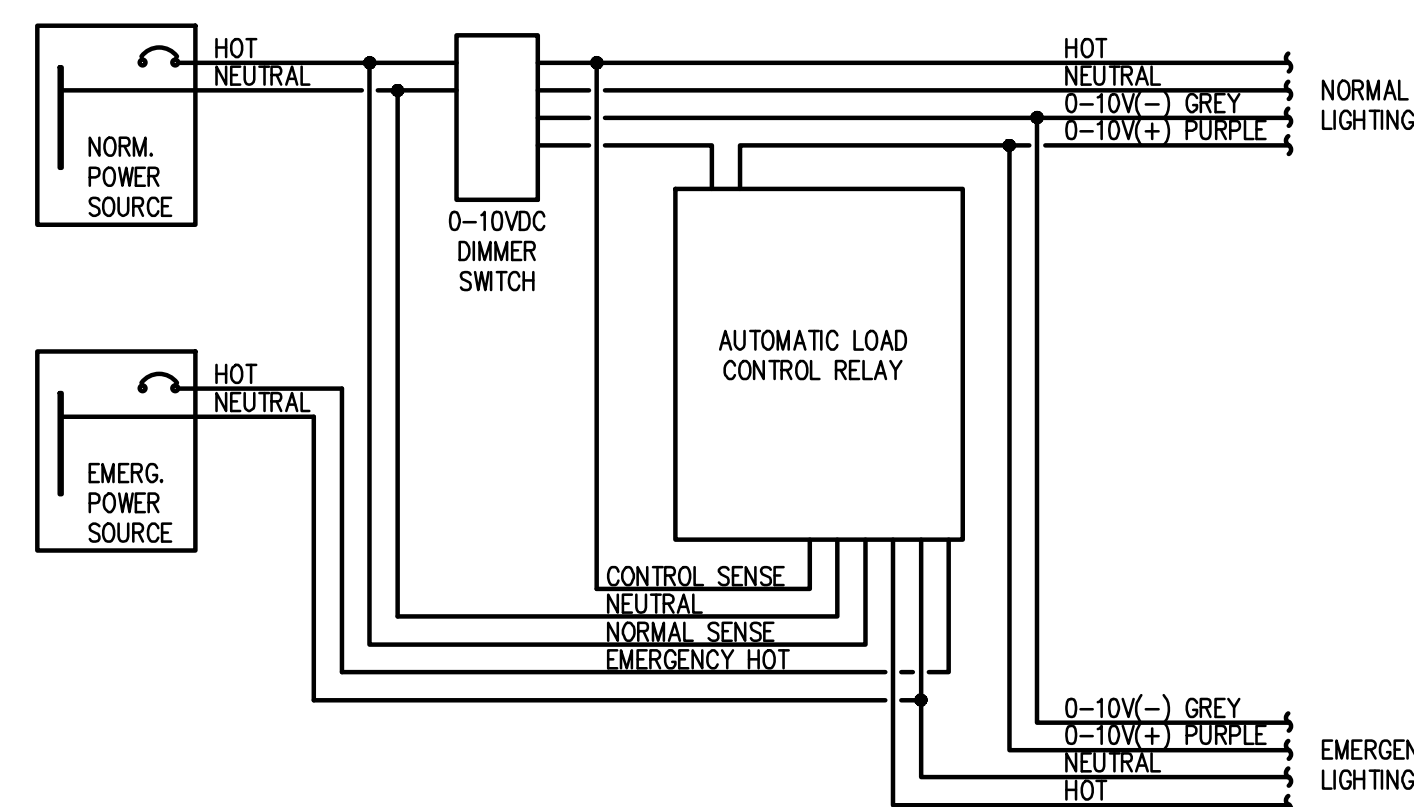

AUTOMATIC LOAD CONTROL RELAY FOR 0-10V DIMMING
NO SCALE

- NOTES:
1. BASIS OF DESIGN IS LVS CONTROLS EPC-2-D. REFER TO SPECIFICATIONS FOR APPROVED MANUFACTURERS. ADJUST WIRING AS NECESSARY FOR OTHER APPROVED MANUFACTURERS.
2. PROVIDE ONE AUTOMATIC LOAD CONTROL RELAY PER SWITCHING CIRCUIT.

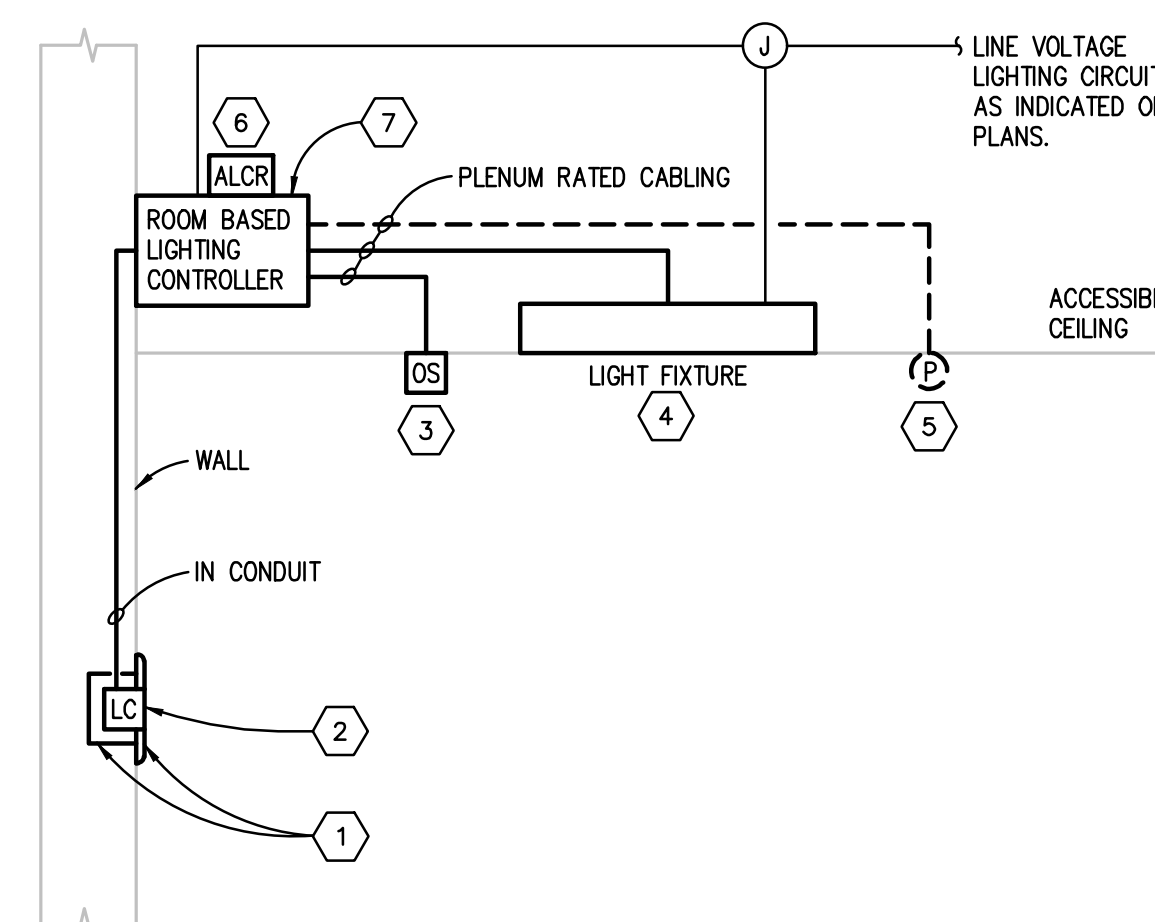


ROOM BASED LIGHTING CONTROL SYSTEM DIAGRAM WIRED - LOW VOLTAGE
NO SCALE


- GENERAL NOTES:
1. REFER TO SPECIFICATIONS FOR ACCEPTED MANUFACTURERS.
2. PROVIDE QUANTITY OF ROOM BASED LIGHTING CONTROLLERS AS REQUIRED TO MEET FUNCTIONALITY INDICATED ON PLAN.
3. REFER TO MANUFACTURER'S INSTALLATION GUIDE FOR EXACT WIRING METHOD, WIRING METHOD AND CONFIGURATION TO BE PER MANUFACTURER'S RECOMMENDATIONS.
4. LOCATE SENSORS IN CENTER OF A FULL CEILING TILE, WHERE APPLICABLE.
5. MOUNTING LOCATION OF SENSORS PER MANUFACTURER'S RECOMMENDATION.
6. REFER TO INTERIOR LIGHTING CONTROL SCHEDULE FOR SYSTEM CONFIGURATIONS SETTINGS. SENSOR ADJUSTMENT: BEFORE MAKING ADJUSTMENTS, MAKE SURE ROOM FURNITURE IS INSTALLED, LIGHTING CIRCUITS ARE TURNED ON, AND THE HVAC SYSTEMS ARE IN THE ON POSITION. VAV SYSTEMS SHOULD BE SET TO THEIR HIGHEST AIRFLOW.

KEYED NOTES:


1. GANG LIGHTING CONTROL DEVICES IN COMMON GANGED BOX. PROVIDE SAME SIZE GANG COVER PLATE FROM THE SAME MANUFACTURER AS THE LIGHTING CONTROL DEVICE AS REQUIRED.
2. LIGHTING CONTROL DEVICE(SWITCH). REFER TO LIGHTING CONTROL DEVICE BUTTON LAYOUT DETAIL FOR ENGRAVING REQUIREMENTS AND PLANS FOR LOCATIONS.
3. CEILING MOUNTED SENSOR. MANUFACTURE TO PROVIDE LAYOUT AND QUANTITIES FOR FULL COVERAGE OF SPACE.
4. REFER TO LIGHTING FIXTURE SCHEDULE. REFER TO PLANS FOR LAYOUT AND QUANTITIES.
5. CEILING MOUNTED PHOTOCELL (AS REQUIRED). REFER TO PLANS FOR PRIMARY AND SECONDARY ZONE CONTROL.
6. PROVIDE ONE AUTOMATIC LOAD CONTROL RELAY PER SWITCHING CIRCUIT WHERE EMERGENCY LIGHTING FROM A GENERATOR OR LIGHTING INVERTER IS INDICATED ON PLANS. REFER TO AUTOMATIC LIGHTING RELAY CONTROL DETAIL.
7. ROOM BASED LIGHTING CONTROLLER TO BE LOCATED IN ACCESSIBLE CEILING ADJACENT TO DOOR DIRECTLY ABOVE LIGHTING CONTROL DEVICE. IF ACCESSIBLE CEILING SPACE IS NOT ACCESSIBLE, AN ACCESS HATCH SHALL BE PROVIDED.

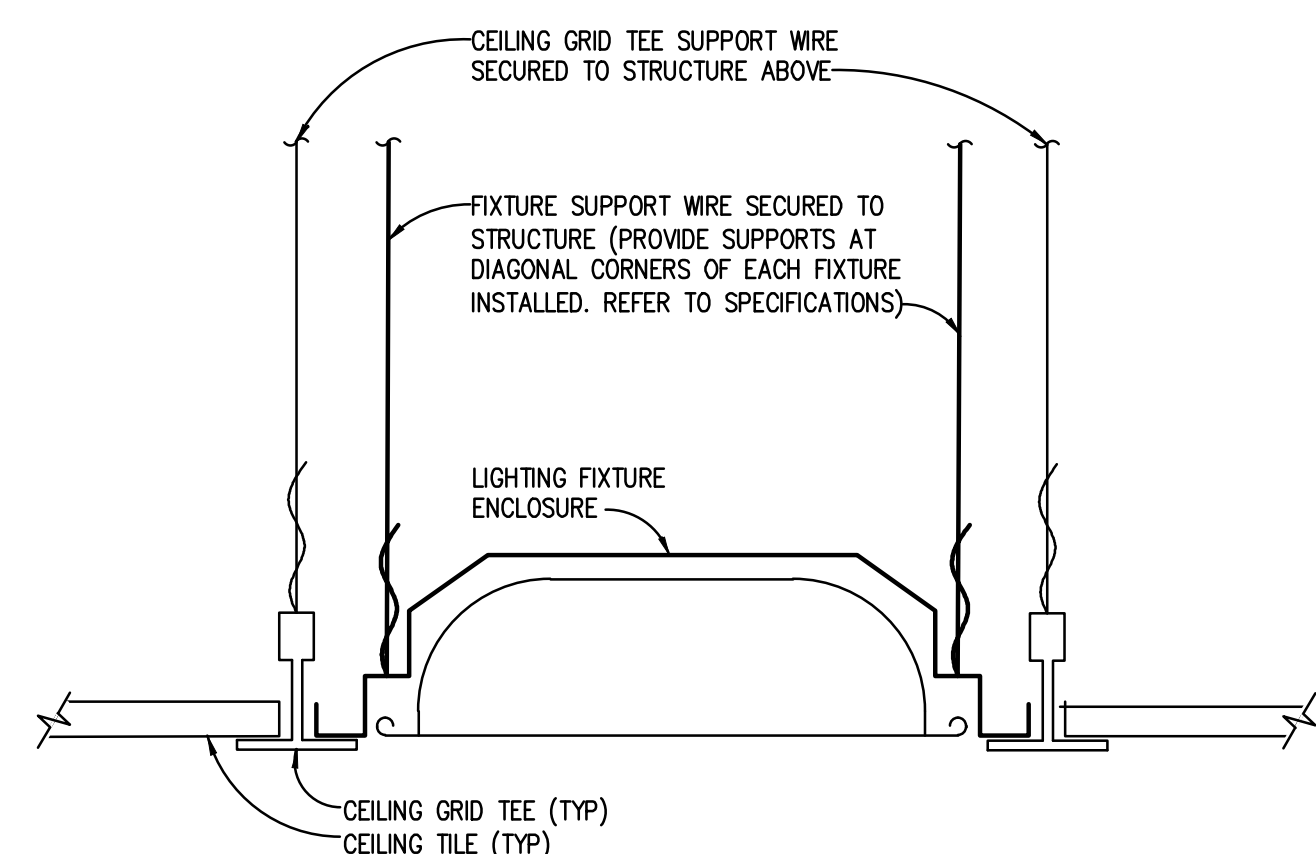

RECESSED LIGHTING FIXTURE INSTALLATION DETAIL
NO SCALE

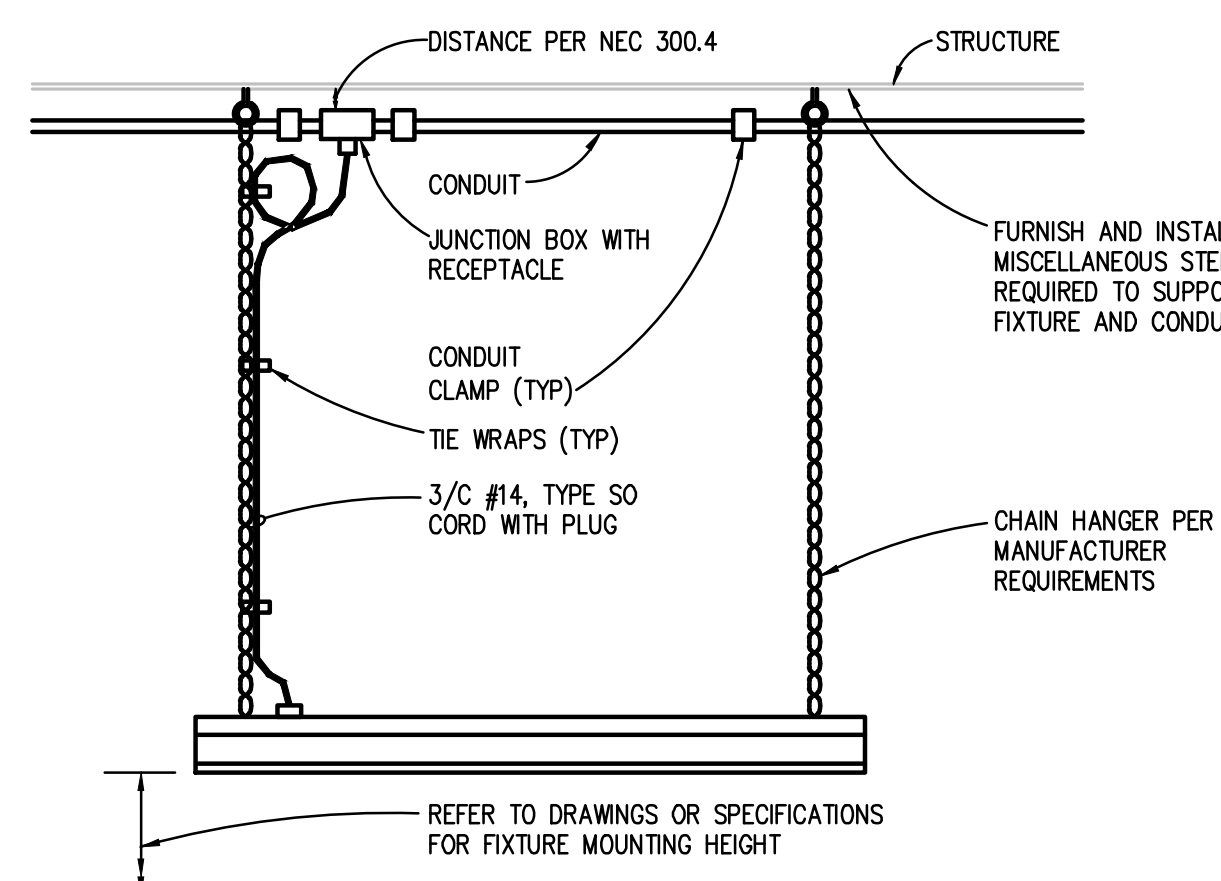


TYPICAL MOUNTING DETAIL FOR CHAIN HUNG LIGHTING FIXTURES
NO SCALE

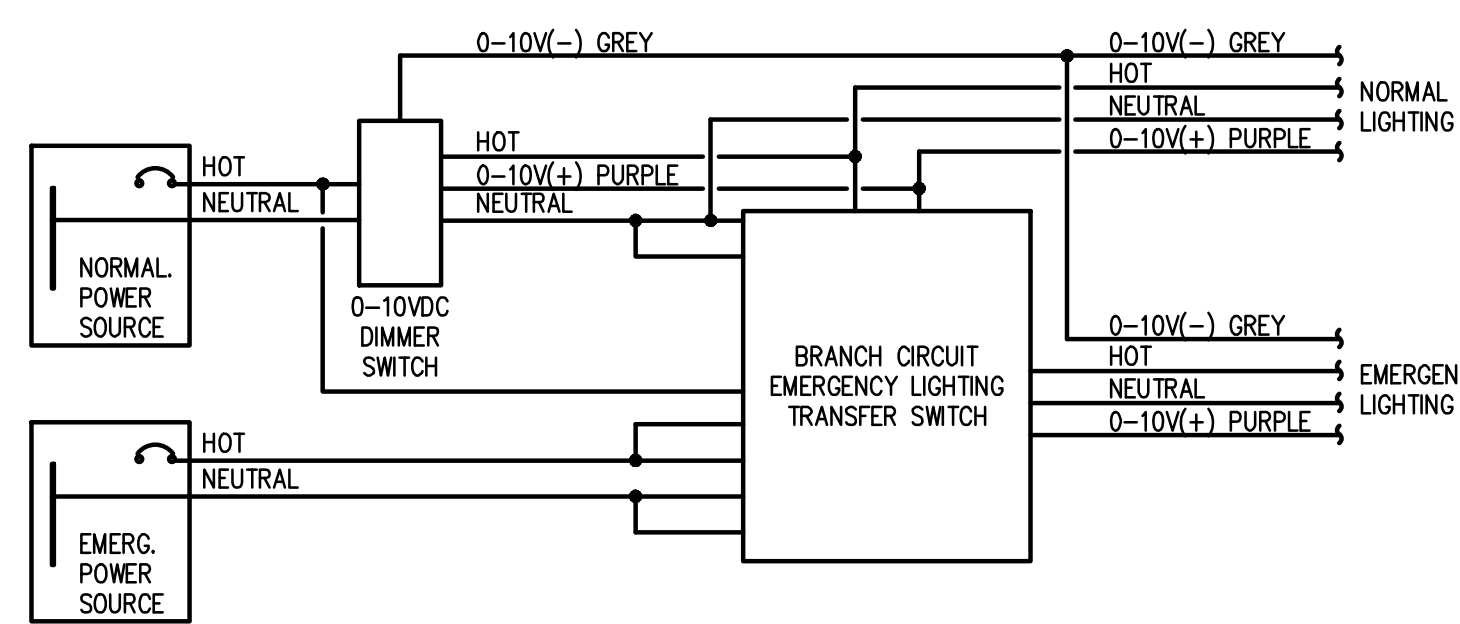

BRANCH CIRCUIT EMERGENCY LIGHTING TRANSFER SWITCH FOR 0-10V DIMMING
NO SCALE

- NOTES:
1. BASIS OF DESIGN IS LVS CONTROLS EPC-D-F-A-TS. REFER TO SPECIFICATIONS FOR APPROVED MANUFACTURERS. ADJUST WIRING AS NECESSARY FOR OTHER APPROVED MANUFACTURERS.
2. PROVIDE ONE BRANCH CIRCUIT EMERGENCY LIGHTING TRANSFER SWITCH PER SWITCHING CIRCUIT.

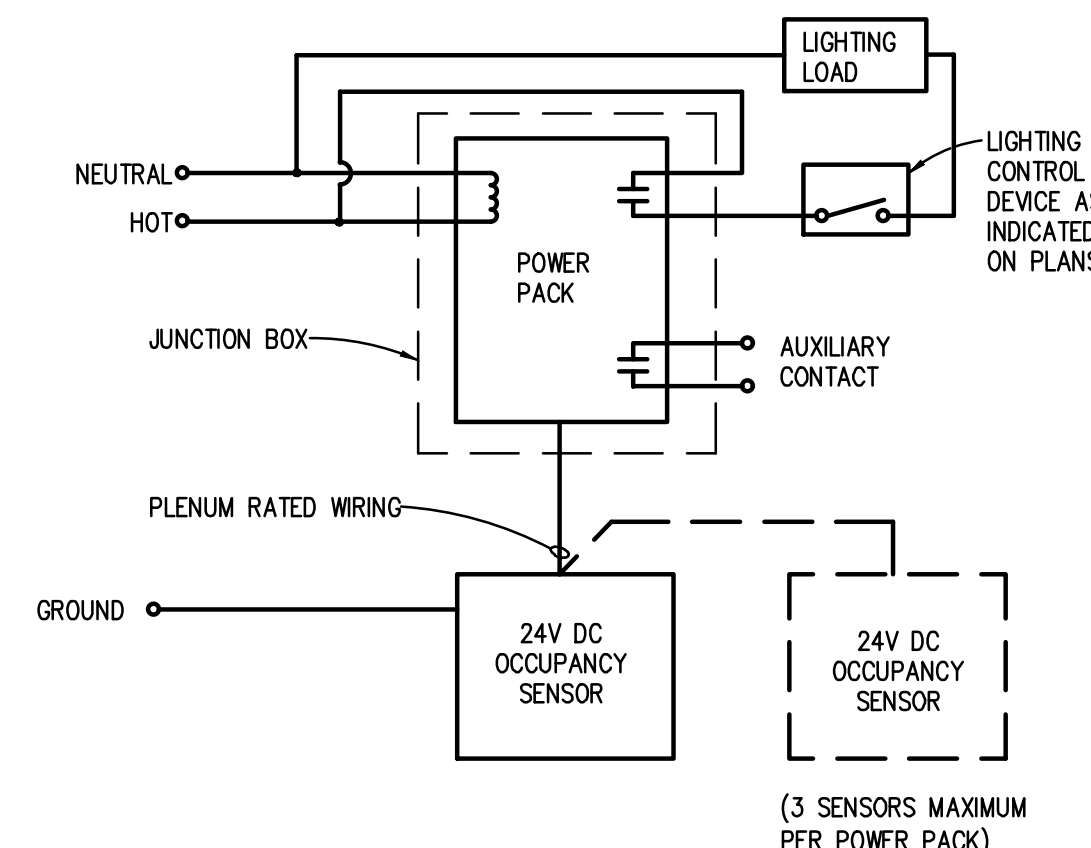

OCCUPANCY SENSOR WIRING DIAGRAM
NO SCALE


- NOTES:
1. REFER TO SPECIFICATIONS FOR ACCEPTED MANUFACTURERS.
2. PROVIDE POWER PACKS AND SLAVE PACKS AS REQUIRED FOR SWITCHING AS INDICATED ON PLAN. REVISE DETAIL AS REQUIRED BY MANUFACTURER.
3. MOUNTING LOCATION PER MANUFACTURER'S RECOMMENDATION.
4. ADJUST SENSITIVITY LEVELS PER THE OWNER REQUIREMENTS.
5. PROVIDE FACTORY SUPPORT FOR AIMING/ADJUSTING OF SENSORS.
6. PLACE CEILING MOUNTED OCCUPANCY SENSORS IN CENTER OF A FULL CEILING TILE, WHERE APPLICABLE.
7. SENSOR ADJUSTMENT: BEFORE MAKING ADJUSTMENTS, MAKE SURE ROOM FURNITURE IS INSTALLED, LIGHTING CIRCUITS ARE TURNED ON, AND THE HVAC SYSTEMS ARE IN THE ON POSITION. VAV SYSTEMS SHOULD BE SET TO THEIR HIGHEST AIRFLOW. SET THE LOGIC CONFIGURATION DIP SWITCHES TO EITHER EITHER REQUIRES MOTION DETECTION BY ONLY ONE TECHNOLOGY. SET THE TIME DELAY PER OWNERS DIRECTION.

PLAN REFERENCE	ROOM TYPE	INTERIOR LIGHTING CONTROL SCHEDULE														NOTES		
		LOCAL CONTROL			CONTROL ON / OFF	SENSOR TYPE	TURN ON LIGHTING TO %	BI-LEVEL CONTROL	DAYLIGHT			NO DETECTION PARTIAL OFF (NOTE 10) REDUCE TO (%) AT(MIN)	NO DETECTION FULL OFF (MIN)	TIME-CLOCK SCHEDULE	RECEPTACLE CONTROL		EMERGENCY LIGHTING CIRCUIT CONTROL	CONTACT FOR HVAC CONTROL
		SWITCH TYPE	SWITCH CONTROL	SCENE CONTROL					SIDE LIGHT	TOP LIGHT	MAINTAIN FC LEVEL							
A	FOOD PREPARATION AREA	LOW VOLTAGE	ON-OFF-DIM	NA	MANUAL ON / MANUAL OFF	DUAL TECHNOLOGY	FULL 100%	CONTINUOUS DM	NA	NA	NA	NA	NA	NA	NA	ALCR	NA	
B	STORAGE ROOM (≥50 SQFT AND ≤ 1000 SQFT)	LINE VOLTAGE	ON-OFF	NA	MANUAL ON / SENSOR OFF	DUAL TECHNOLOGY	FULL 100%	NA	NA	NA	NA	NA	20	NA	NA	ALCR	YES	
C	CORRIDOR (IN A HOSPITAL)	LINE VOLTAGE	ON-OFF (KEYED)	NA	SENSOR ON / SENSOR OFF	ULTRASONIC	FULL 100%	NA	NA	NA	NA	NA	20	NA	NA	ALCR	NA	NEW CORRIDOR SHALL BE CONTROLLED SIMILARLY TO EXISTING CORRIDORS
D	DINING AREA (IN CAFETERIA OR FAST FOOD DINING)	LOW VOLTAGE	ON-OFF-DIM	NA	MANUAL ON / SENSOR OFF	DUAL TECHNOLOGY	FULL 100%	CONTINUOUS DM	YES	NA	NA	NA	20	NA	NA	ALCR	YES	
E	OFFICE (ENCLOSED AND ≤ 250 SQFT)	LOW VOLTAGE	ON-OFF-DIM	NA	MANUAL ON / SENSOR OFF	DUAL TECHNOLOGY	FULL 100%	CONTINUOUS DM	NA	NA	NA	NA	20	NA	NA	NA	YES	
F	RESTROOM (ALL OTHER RESTROOMS)	LINE VOLTAGE	ON-OFF	NA	SENSOR ON / SENSOR OFF	ULTRASONIC	FULL 100%	NA	NA	NA	NA	NA	20	NA	NA	ALCR	NA	
G	ELECTRICAL/MECHANICAL ROOM	LINE VOLTAGE	ON-OFF	NA	MANUAL ON / MANUAL OFF	NA	FULL 100%	NA	NA	NA	NA	NA	NA	NA	NA	ALCR	NA	
H	STAIRWELL	LINE VOLTAGE	ON-OFF (KEYED)	NA	SENSOR ON / SENSOR OFF	ULTRASONIC	FULL 100%	NA	NA	NA	NA	NA	20	NA	NA	BCELTS	NA	
I	LOUNGE/BREAKROOM (ALL OTHER LOUNGES/BREAKROOMS)	LOW VOLTAGE	ON-OFF-DIM	NA	MANUAL ON / SENSOR OFF	DUAL TECHNOLOGY	FULL 100%	CONTINUOUS DM	NA	NA	NA	NA	20	NA	NA	NA	NA	
J	CORRIDOR (IN A HOSPITAL)	LINE VOLTAGE	ON-OFF (KEYED)	NA	SENSOR ON / SENSOR OFF	ULTRASONIC	FULL 100%	NA	NA	NA	NA	NA	20	NA	NA	BCELTS	NA	NEW CORRIDOR SHALL BE CONTROLLED SIMILARLY TO EXISTING CORRIDORS

- NOTE:
1. REFER TO PLANS FOR LOCATION OF LOCAL CONTROL.
2. REFER TO PLANS FOR SCENE CONTROL.
3. REFER TO PLANS FOR PRIMARY AND SECONDARY DAYLIGHT ZONES.
4. PROVIDE EMERGENCY LIGHTING CIRCUIT CONTROL (BCELTS OR ALCR) PER SWITCHING CIRCUIT AS REQUIRED.
5. CONTRACTOR SHALL PROVIDE FLOOR PLAN INDICATING SENSOR AND EQUIPMENT LOCATIONS OF CHOSEN CONTROL SYSTEM.

6. REFER TO LUMINAIRE SCHEDULE FOR FIXTURE CHARACTERISTICS.
7. LIGHTING SENSOR SHALL HAVE CONTACT FOR HVAC CONTROL WHEN A "YES" SELECTION IS MADE IN THE HVAC CONTROL COLUMN.
8. REFER TO TEMPERATURE CONTROL DRAWINGS AND DIAGRAMS FOR ADDITIONAL SENSOR REQUIREMENTS.
9. PROVIDE WIRING CONTROL DIAGRAM FOR APPLICABLE CONTROL SYSTEM(S).
10. PERCENTAGE LIGHT OUTPUT REDUCTION IS FOR ALL FIXTURES WITHIN THE DESIGNATED ROOM UNLESS OTHERWISE NOTED.

©Copyright 2017 by Peter Basso Associates, Inc.

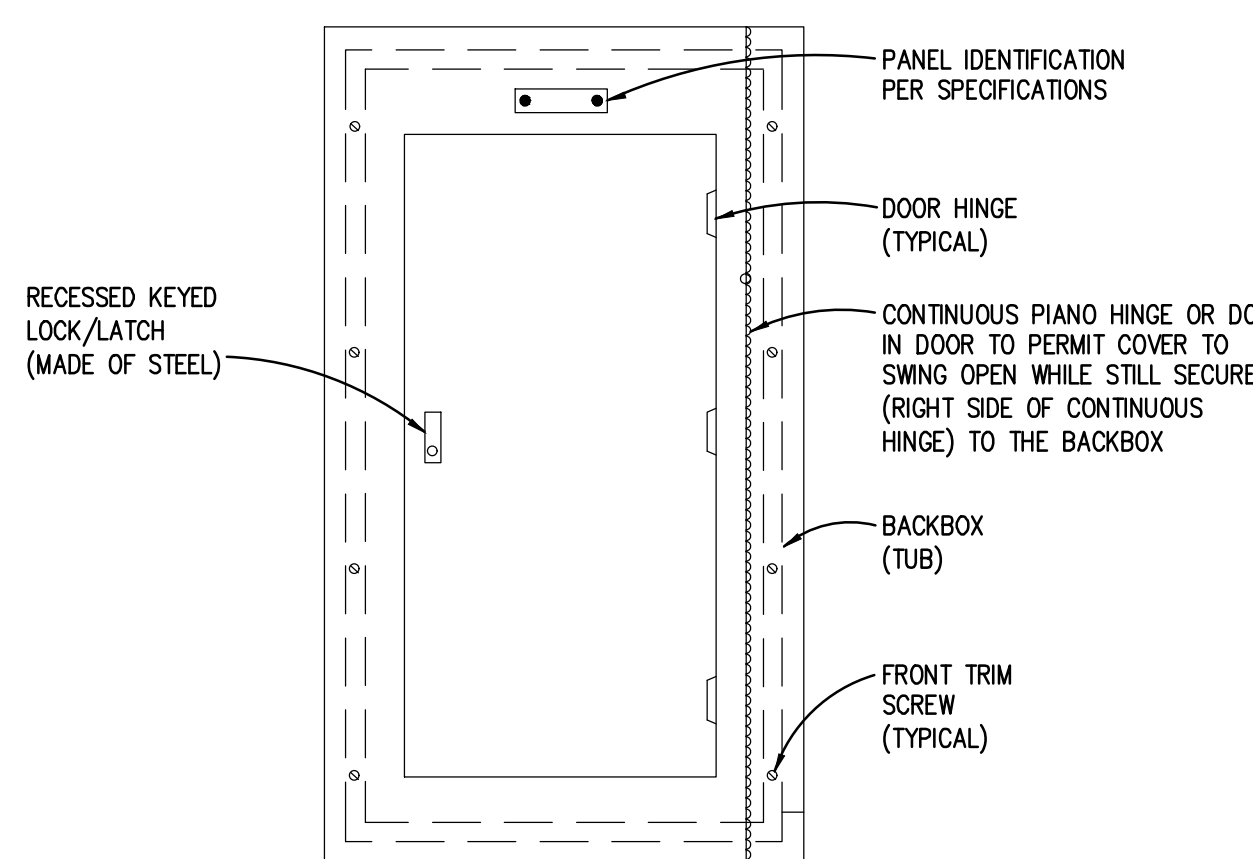

PANELBOARD FRONT COVER DETAIL
NO SCALE

1	OWNER REVIEW	08/02/23
NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, R. DIRECTOR

FILE NO.
49120167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

WTAARCH.COM

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107

COPYRIGHT © 2023

PROJECT TITLE
49120167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
SALINE, MICHIGAN

SHEET TITLE
ELECTRICAL DETAILS AND DIAGRAMS

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
AUGUST 23, 2023

E7.00


CHECKED BY
TLC

PBA

Peter Basso Associates Inc
CONSULTING ENGINEERS


5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2021094

en:\2021\2021-0402-00\CA01\2021-0402-E7-DT.dwg, E-700, 9/5/2023 4:32:36 PM, Gerard Henrich, Peter Basso Associates Inc.

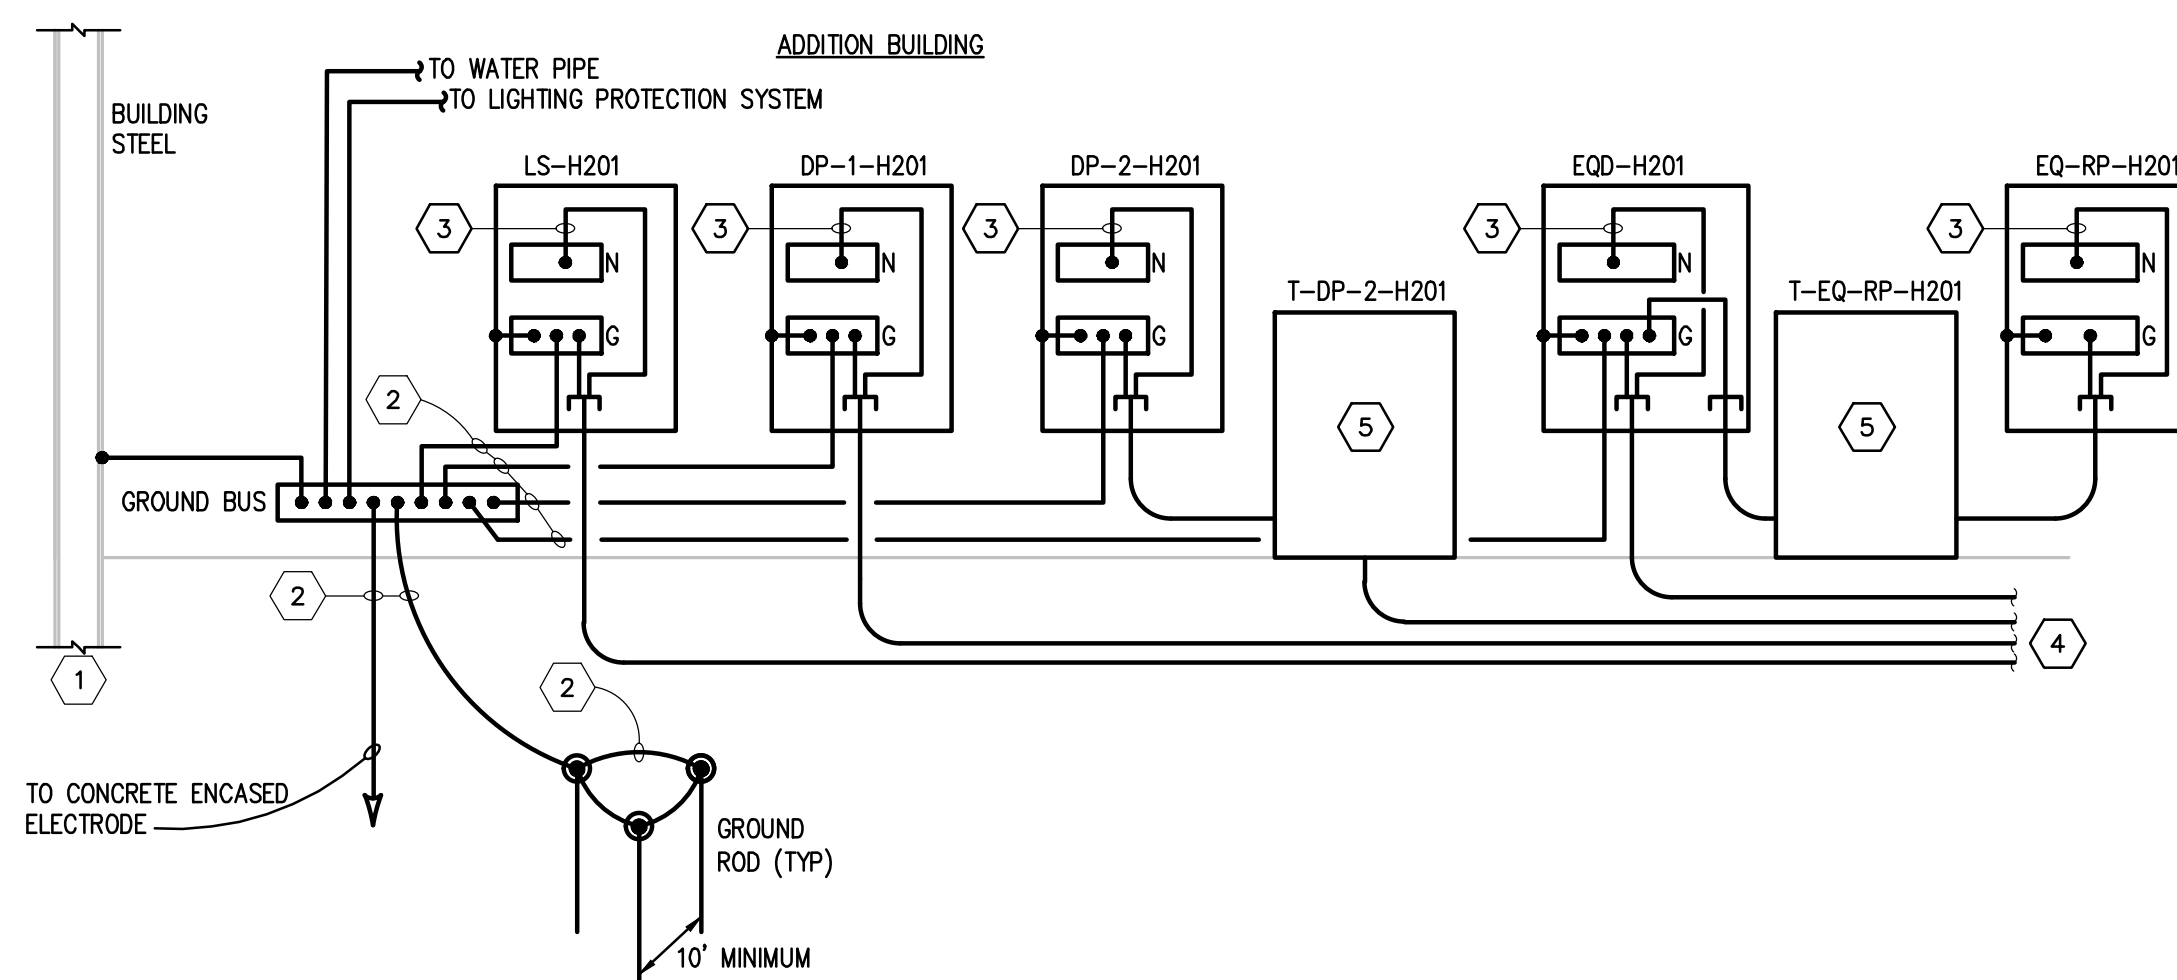


BUILDING GROUNDING
NO SCALE

- KEYED NOTES:**
- METAL IN-GROUND SUPPORT STRUCTURE IN DIRECT CONTACT WITH EARTH VERTICALLY FOR A MINIMUM OF 10FT, WHERE AVAILABLE.
 - GROUNDING ELECTRODE CONDUCTOR, #4/0 COPPER.
 - GROUNDING CONDUCTOR (NEUTRAL), SEE ONE LINE DIAGRAM.
 - PHASE CONDUCTORS, GROUNDING CONDUCTOR (NEUTRAL), AND EQUIPMENT GROUNDING CONDUCTOR IN CONDUIT TO MAIN BUILDING. SEE ONE LINE DIAGRAM.
 - REFER TO DRY TYPE DISTRIBUTION TRANSFORMER GROUNDING ARRANGEMENT.

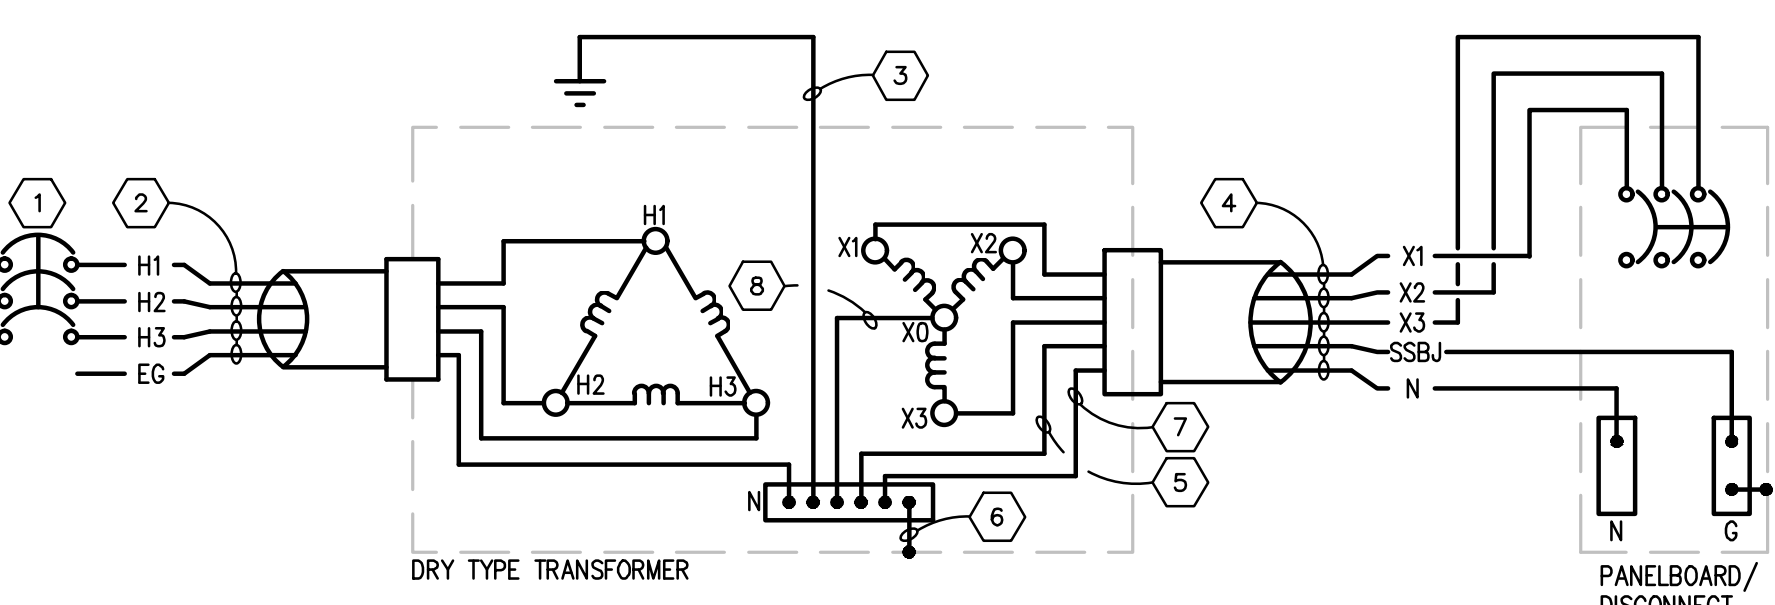


DRY TYPE DISTRIBUTION TRANSFORMER GROUNDING ARRANGEMENT
NO SCALE

- KEYED NOTES:**
- 480V, 3Ø PRIMARY CIRCUIT BREAKER BASED ON DRY TYPE DISTRIBUTION TRANSFORMER CIRCUIT SIZING SCHEDULE ON ELECTRICAL STANDARD SCHEDULE DRAWING UNLESS OTHERWISE NOTED.
 - PRIMARY FEEDER BASED ON FEEDER AND BRANCH CIRCUIT SIZING TABLE ON ELECTRICAL STANDARD SCHEDULE DRAWING UNLESS OTHERWISE NOTED.
 - GROUNDING ELECTRODE CONDUCTOR TO NEAREST GROUNDING ELECTRODE (I.E. BUILDING STEEL, METAL WATER PIPE, GROUND RING, OR GROUND BUS). SEE DRY TYPE DISTRIBUTION TRANSFORMER CIRCUIT SIZING SCHEDULE ON ELECTRICAL STANDARD SCHEDULE DRAWING FOR SIZE UNLESS OTHERWISE NOTED.
 - 208Y/120V, 3Ø, 4W SECONDARY FEEDER BASED ON DRY TYPE DISTRIBUTION TRANSFORMER CIRCUIT SIZING SCHEDULE ON ELECTRICAL STANDARD SCHEDULE DRAWING UNLESS OTHERWISE NOTED.
 - SUPPLY SIDE BONDING JUMPER.
 - SYSTEM BONDING JUMPER.
 - GROUNDING CONDUCTOR (NEUTRAL).
 - NEUTRAL CONDUCTOR PROVIDED WITH EQUIPMENT.

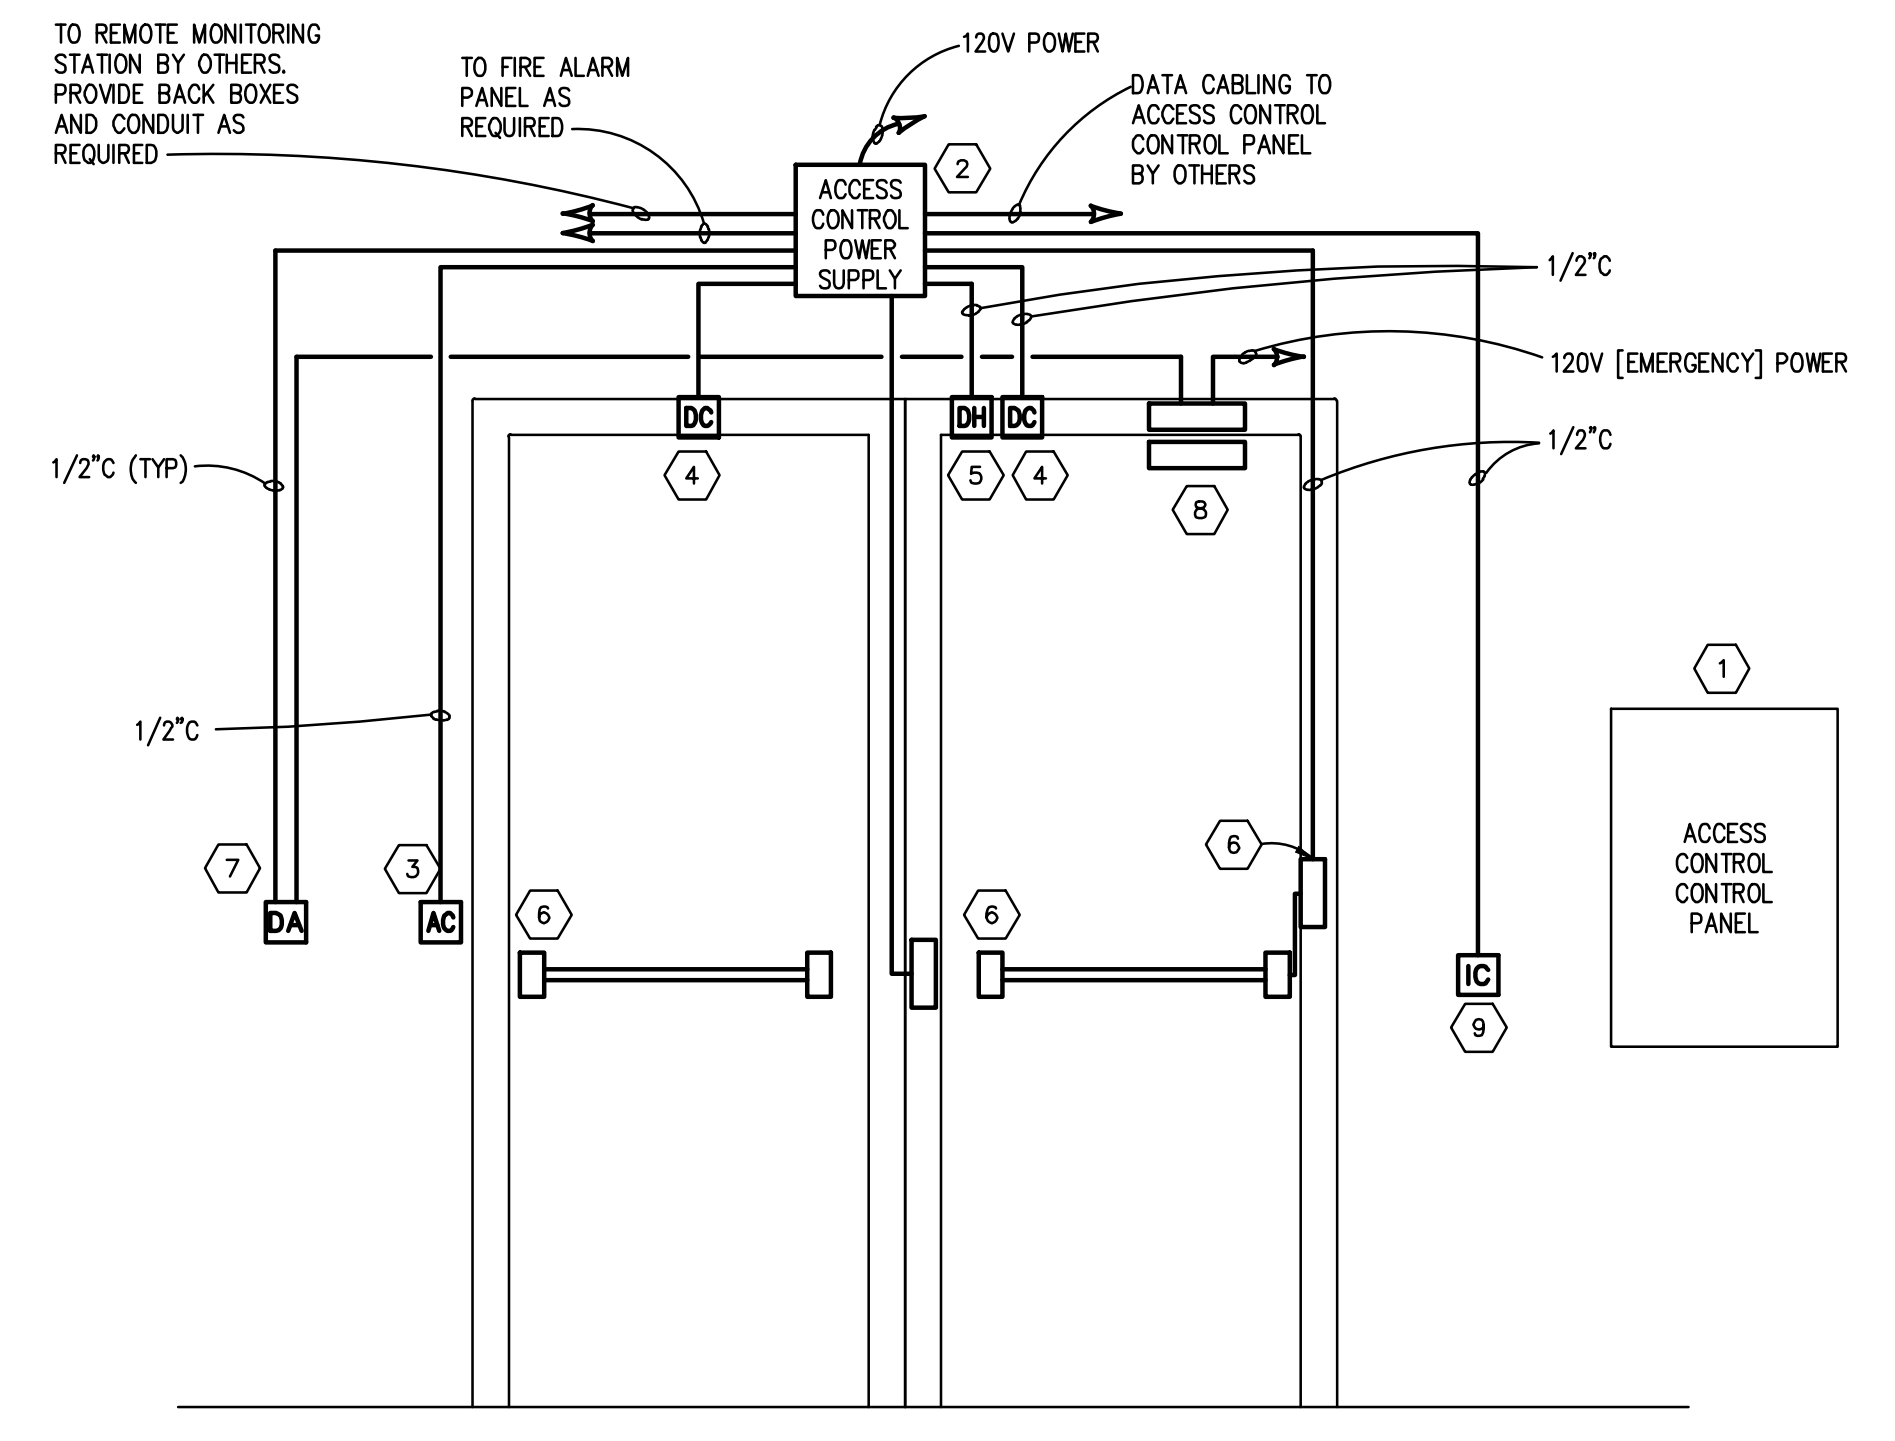


DOOR HARDWARE DOUBLE DOOR CONNECTION DIAGRAM
NO SCALE

- GENERAL NOTES:**
- REFER TO ELECTRICAL FLOOR PLANS FOR DOOR LOCATIONS.
 - PROVIDE BACK BOXES, CONDUIT, 120 VOLT WIRING AND TERMINATIONS AS REQUIRED BY MANUFACTURER. COORDINATE EXACT REQUIREMENTS AND SCOPE OF WORK WITH OWNER AND ACCESS CONTROL CONTRACTOR.
 - SOME DEVICES INDICATED MAY NOT APPLY. REFER TO DOOR HARDWARE AND DOOR SCHEDULE. COORDINATE ALL WORK WITH HARDWARE CONTRACTOR.
 - ELECTRICAL CONTRACTOR SHALL PROVIDE INTERCONNECTION WITH FIRE ALARM PANEL TO RELEASE DOORS (I.E. ELECTROMAGNETIC LOCKS) UPON AN ALARM CONDITION, AS REQUIRED.
- KEYED NOTES:**
- ACCESS CONTROL CONTROL PANEL, BY OTHERS.
 - ACCESS CONTROL POWER SUPPLY, BY OTHERS.
 - ACCESS CONTROL STATION, BY OTHERS. (EXAMPLE DEVICES: CARD READER, KEYPAD, REQUEST TO EXIT PUSH PAD, MOTION DETECTOR, ETC.)
 - DOOR MONITOR CONTACT SWITCH, BY OTHERS.
 - DOOR HOLDER, BY OTHERS. ELECTROMAGNETIC SWITCH MOUNTED ON/IN DOOR AND FRAME. [FOR DELAYED OPERATION] IN LIEU OF ELECTRIC STRIKE.
 - ELECTRIC STRIKE, PANIC HARDWARE, POWER TRANSFER, BY OTHERS.
 - DOOR OPERATOR ACTUATOR, BY OTHERS.
 - DOOR OPERATOR, BY OTHERS. (EXAMPLE DEVICES: PUSH PAD, TOUCHLESS, ETC.)
 - INTERCOM STATION, BY OTHERS.

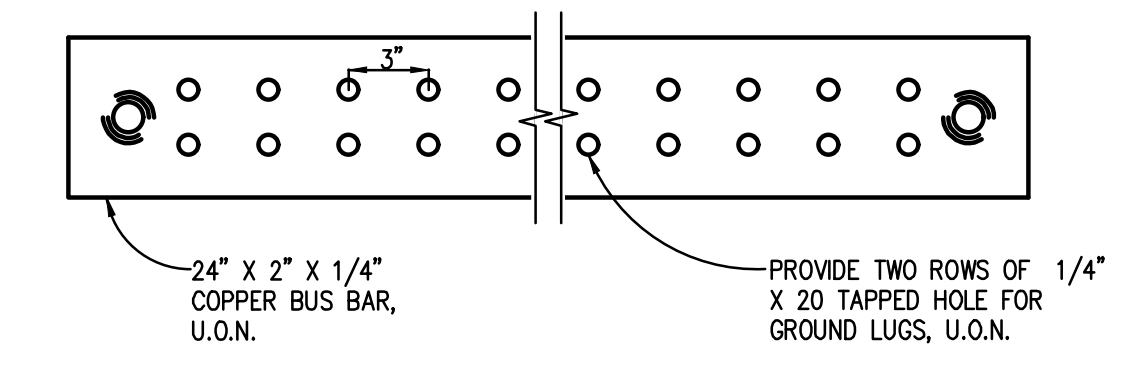


ELECTRICAL GROUND BUS DETAIL
NO SCALE

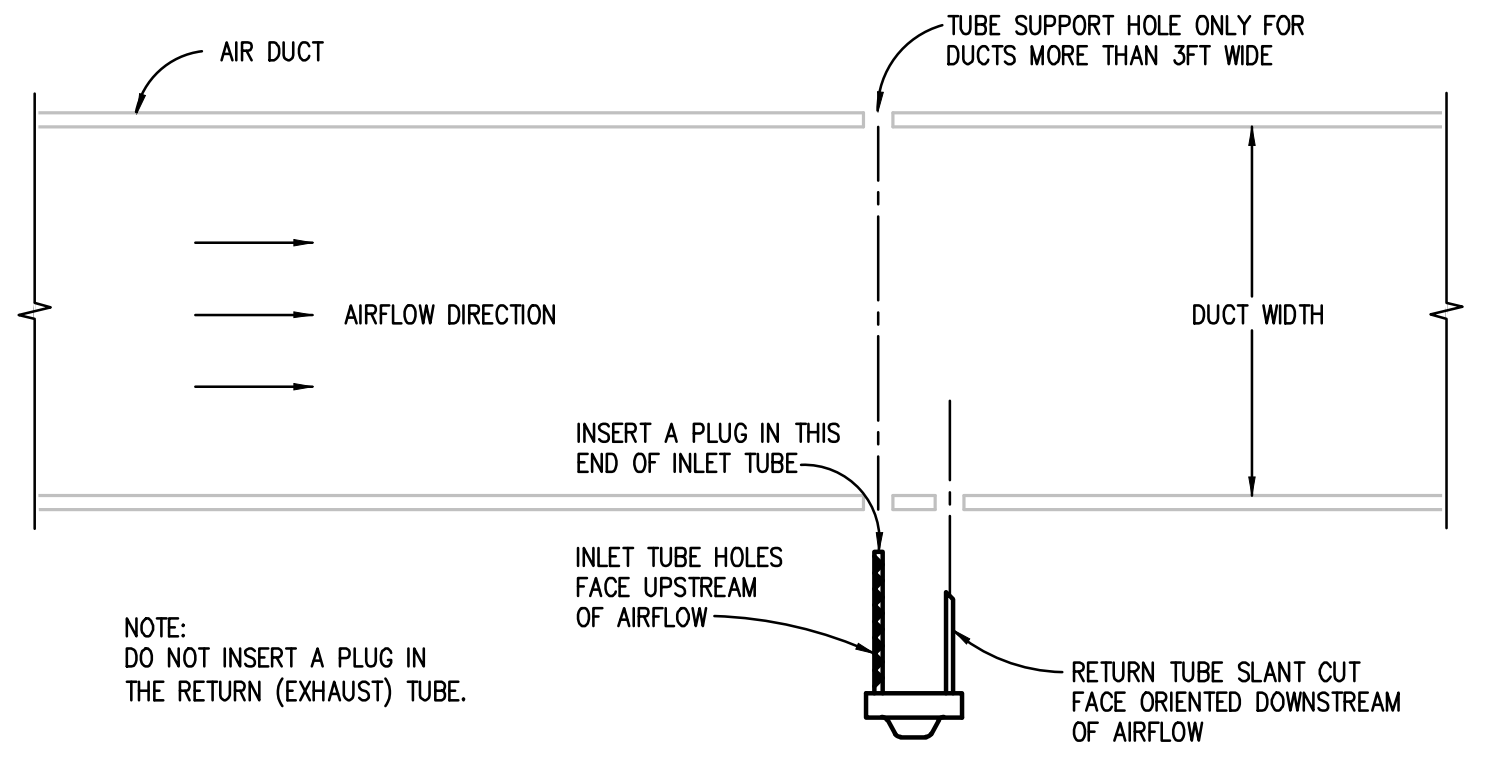


DUCT TYPE DETECTOR INSTALLATION
NO SCALE

- NOTES:**
- PROVIDE SAMPLING TUBE LENGTH AS REQUIRED FOR WIDTH OF DUCT.

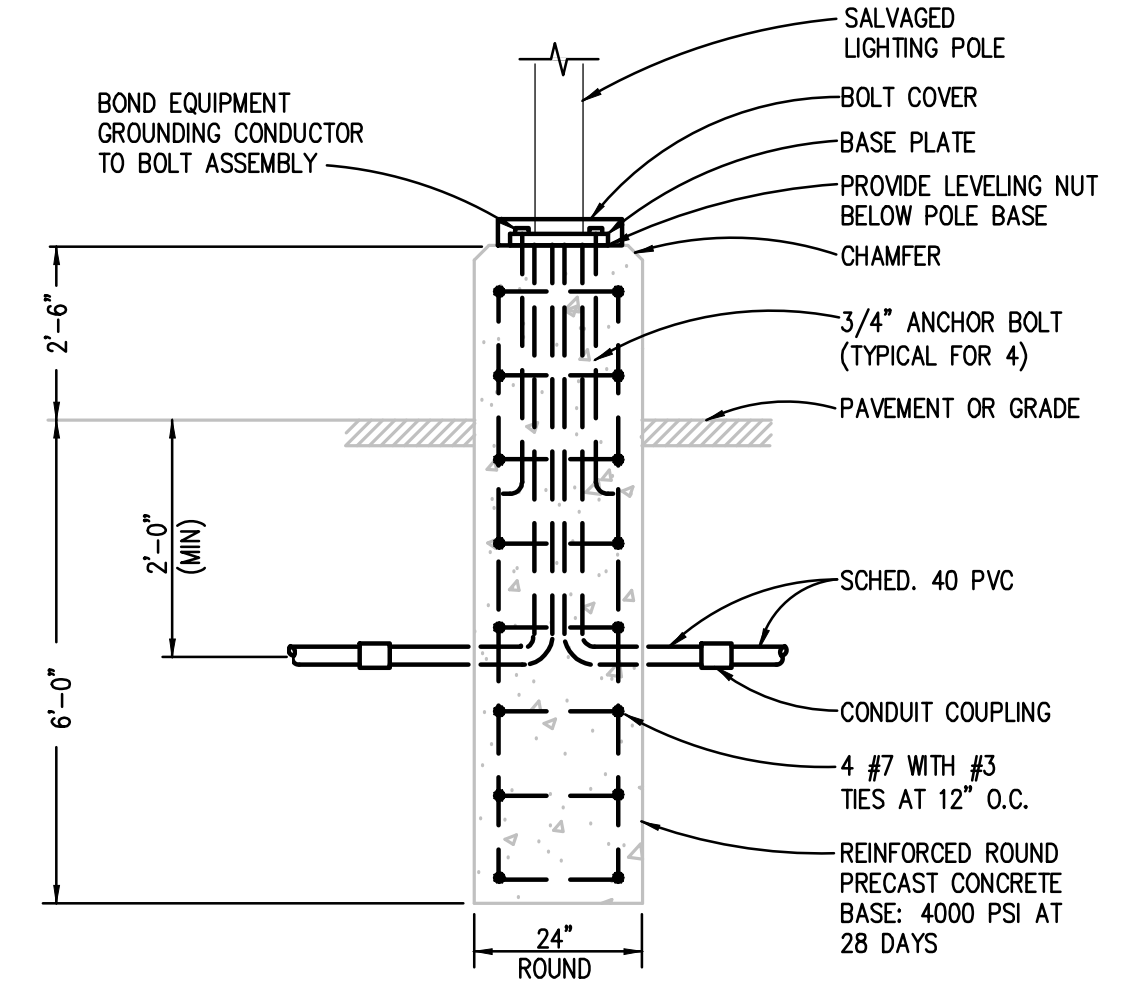

LIGHTING POLE BASE DETAIL
NO SCALE

- NOTE:**
- PROVIDE PRECAST CONCRETE BASE AS MANUFACTURED BY NORTHERN CONCRETE PIPE, INC. OR APPROVED EQUAL.
 - CONCRETE REINFORCEMENTS SHALL BE BARE, ZINC GALVANIZED, OR ELECTRICALLY CONDUCTIVE COATED STEEL. BOND ALL CONCRETE REINFORCEMENTS AND ANCHOR BOLTS TOGETHER SO THAT SYSTEM IS ELECTRICALLY CONTINUOUS.

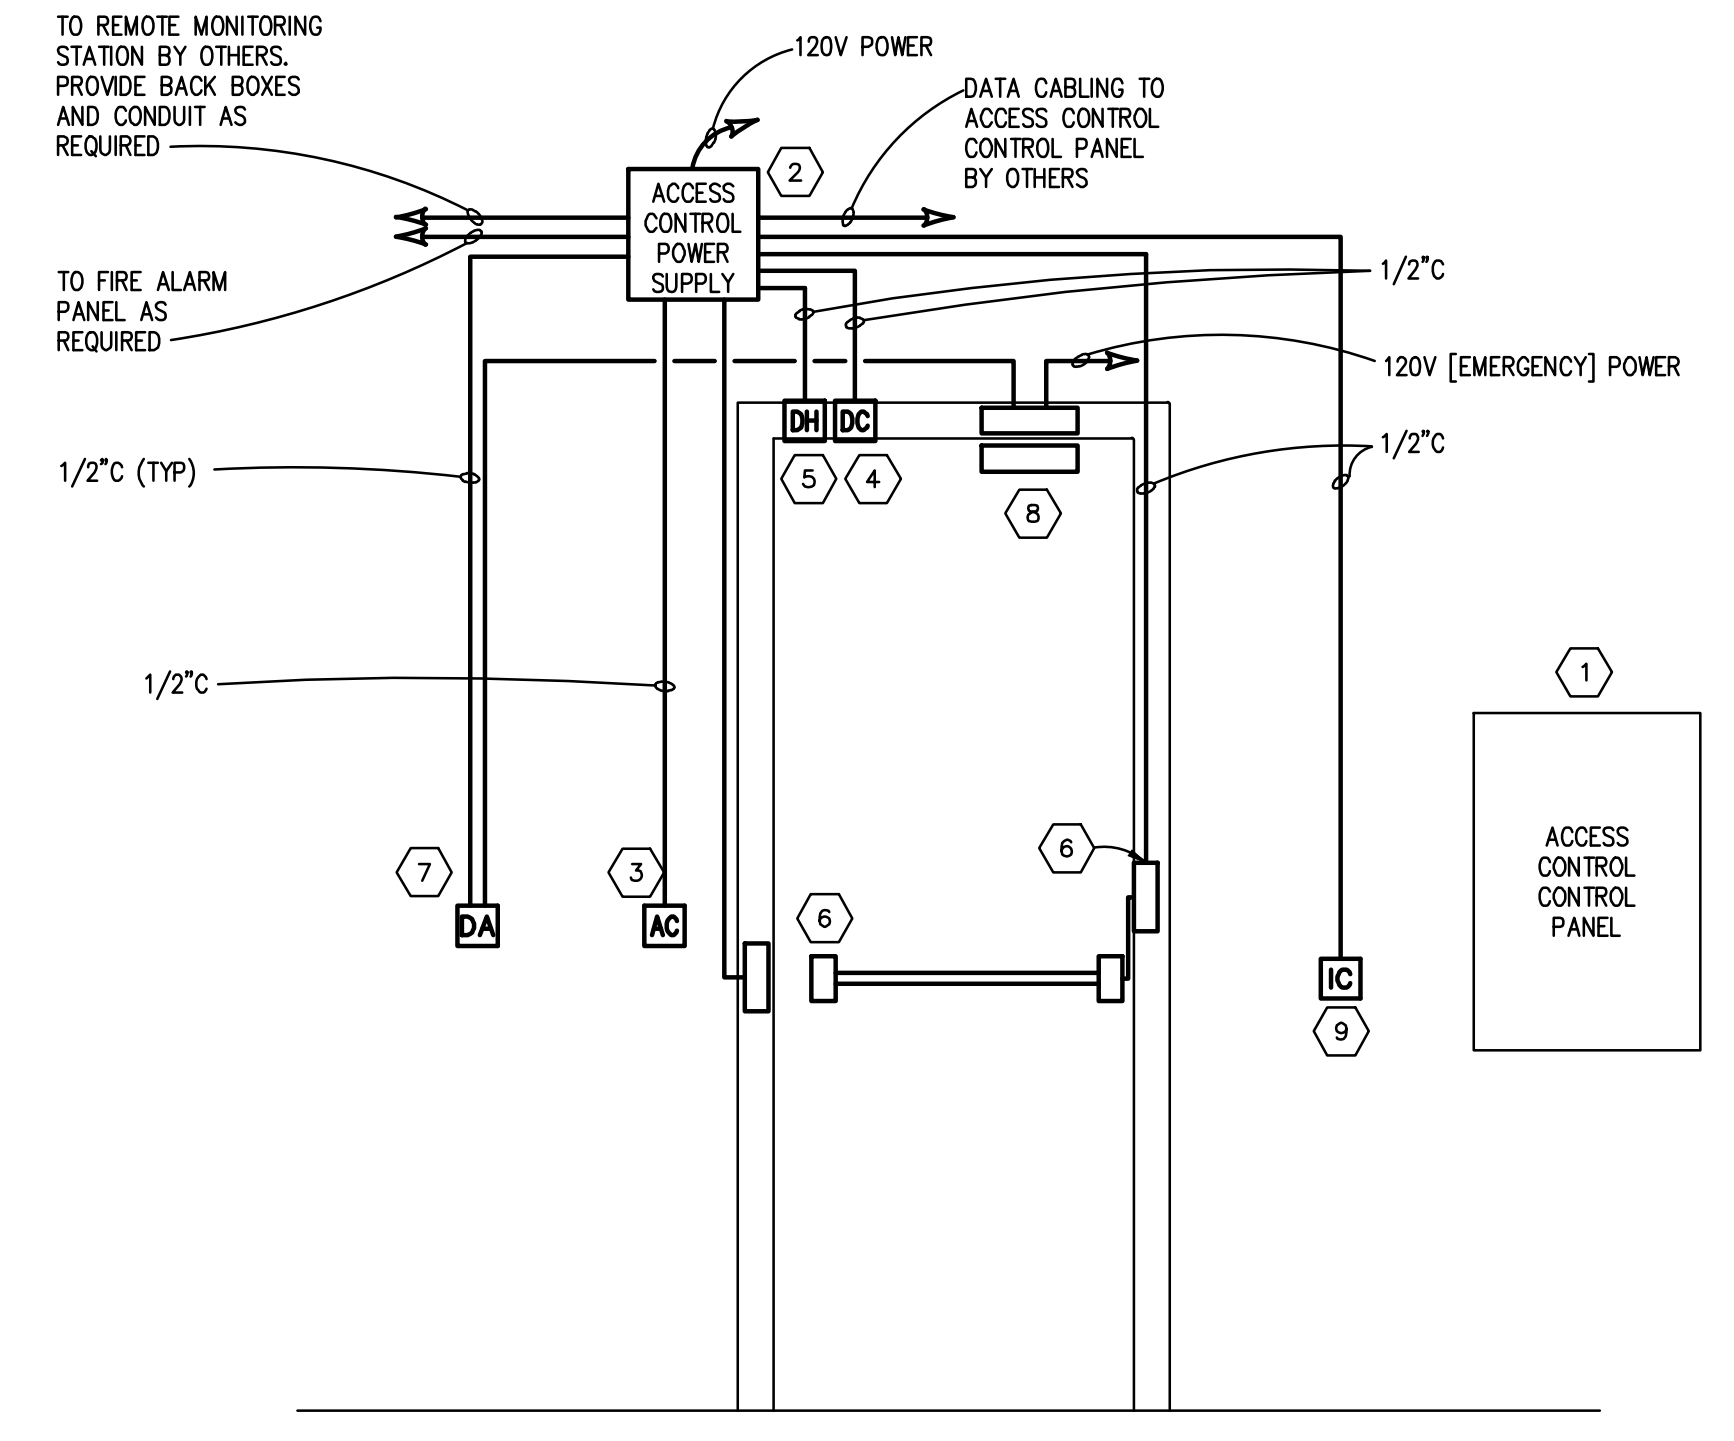


DOOR HARDWARE SINGLE DOOR CONNECTION DIAGRAM
NO SCALE

- GENERAL NOTES:**
- REFER TO ELECTRICAL FLOOR PLANS FOR DOOR LOCATIONS.
 - PROVIDE BACK BOXES, CONDUIT, 120 VOLT WIRING AND TERMINATIONS AS REQUIRED BY MANUFACTURER. COORDINATE EXACT REQUIREMENTS AND SCOPE OF WORK WITH OWNER AND ACCESS CONTROL CONTRACTOR.
 - SOME DEVICES INDICATED MAY NOT APPLY. REFER TO DOOR HARDWARE AND DOOR SCHEDULE. COORDINATE ALL WORK WITH HARDWARE CONTRACTOR.
 - ELECTRICAL CONTRACTOR SHALL PROVIDE INTERCONNECTION WITH FIRE ALARM PANEL TO RELEASE DOORS (I.E. ELECTROMAGNETIC LOCKS) UPON AN ALARM CONDITION, AS REQUIRED.
- KEYED NOTES:**
- ACCESS CONTROL CONTROL PANEL, BY OTHERS.
 - ACCESS CONTROL POWER SUPPLY, BY OTHERS.
 - ACCESS CONTROL STATION, BY OTHERS. (EXAMPLE DEVICES: CARD READER, KEYPAD, REQUEST TO EXIT PUSH PAD, MOTION DETECTOR, ETC.)
 - DOOR MONITOR CONTACT SWITCH, BY OTHERS.
 - DOOR HOLDER, BY OTHERS. ELECTROMAGNETIC SWITCH MOUNTED ON/IN DOOR AND FRAME. [FOR DELAYED OPERATION] IN LIEU OF ELECTRIC STRIKE.
 - ELECTRIC STRIKE, PANIC HARDWARE, POWER TRANSFER, BY OTHERS.
 - DOOR OPERATOR ACTUATOR, BY OTHERS.
 - DOOR OPERATOR, BY OTHERS. (EXAMPLE DEVICES: PUSH PAD, TOUCHLESS, ETC.)
 - INTERCOM STATION, BY OTHERS.


	SYSTEM OUTPUTS												
	ANNUNCIATION				NOTIFICATION				FIRE SAFETY				
INITIATION	IDENTIFY ALARM AT FACP	ANNUNCIATE SUPERVISORY SIGNAL AT FACP	ANNUNCIATE SUPERVISORY SIGNAL AT REMOTE ANNUNCIATOR(S)	ANNUNCIATE TROUBLE SIGNAL AT FACP	ANNUNCIATE TROUBLE SIGNAL AT REMOTE ANNUNCIATOR(S)	ACTIVATE ALARM SEQUENCE ON EXISTING FACP	OPERATE ALARM NOTIFICATION APPLIANCES CONTINUOUSLY	ACTIVATE VOICE/ALARM COMMUNICATION SYSTEM	TRANSMIT ALARM SIGNAL TO REMOTE ALARM RECEIVING STATION	TRANSMIT SUPERVISORY SIGNAL TO REMOTE ALARM RECEIVING STATION	TRANSMIT TROUBLE SIGNAL TO REMOTE ALARM RECEIVING STATION	TRANSMIT ALARM SIGNAL TO BUILDING AUTOMATION SYSTEM	TRANSMIT TROUBLE SIGNAL TO BUILDING AUTOMATION SYSTEM
EXTERNAL SYSTEM INPUT	EXISTING FACP FIRE ALARM CONDITION	EXISTING FACP TROUBLE CONDITION	ALARM SIGNAL FROM SUPPRESSION SYSTEM	SUPERVISORY SIGNAL FROM SUPPRESSION SYSTEM	TROUBLE SIGNAL FROM SUPPRESSION SYSTEM	FIRE EXTINGUISHING SYSTEM OPERATION	OPEN CIRCUIT, SHORT CIRCUIT, OR GROUND FAULT ON INITIATING DEVICE, SIGNALING LINE, OR NOTIFICATION APPLIANCE CIRCUIT.	OPENING, TAMPERING, OR REMOVAL OF ALARM-INITIATING DEVICES	OPENING, TAMPERING, OR REMOVAL OF SUPERVISORY SIGNAL				
STATUS													

FIRE ALARM MATRIX
NO SCALE

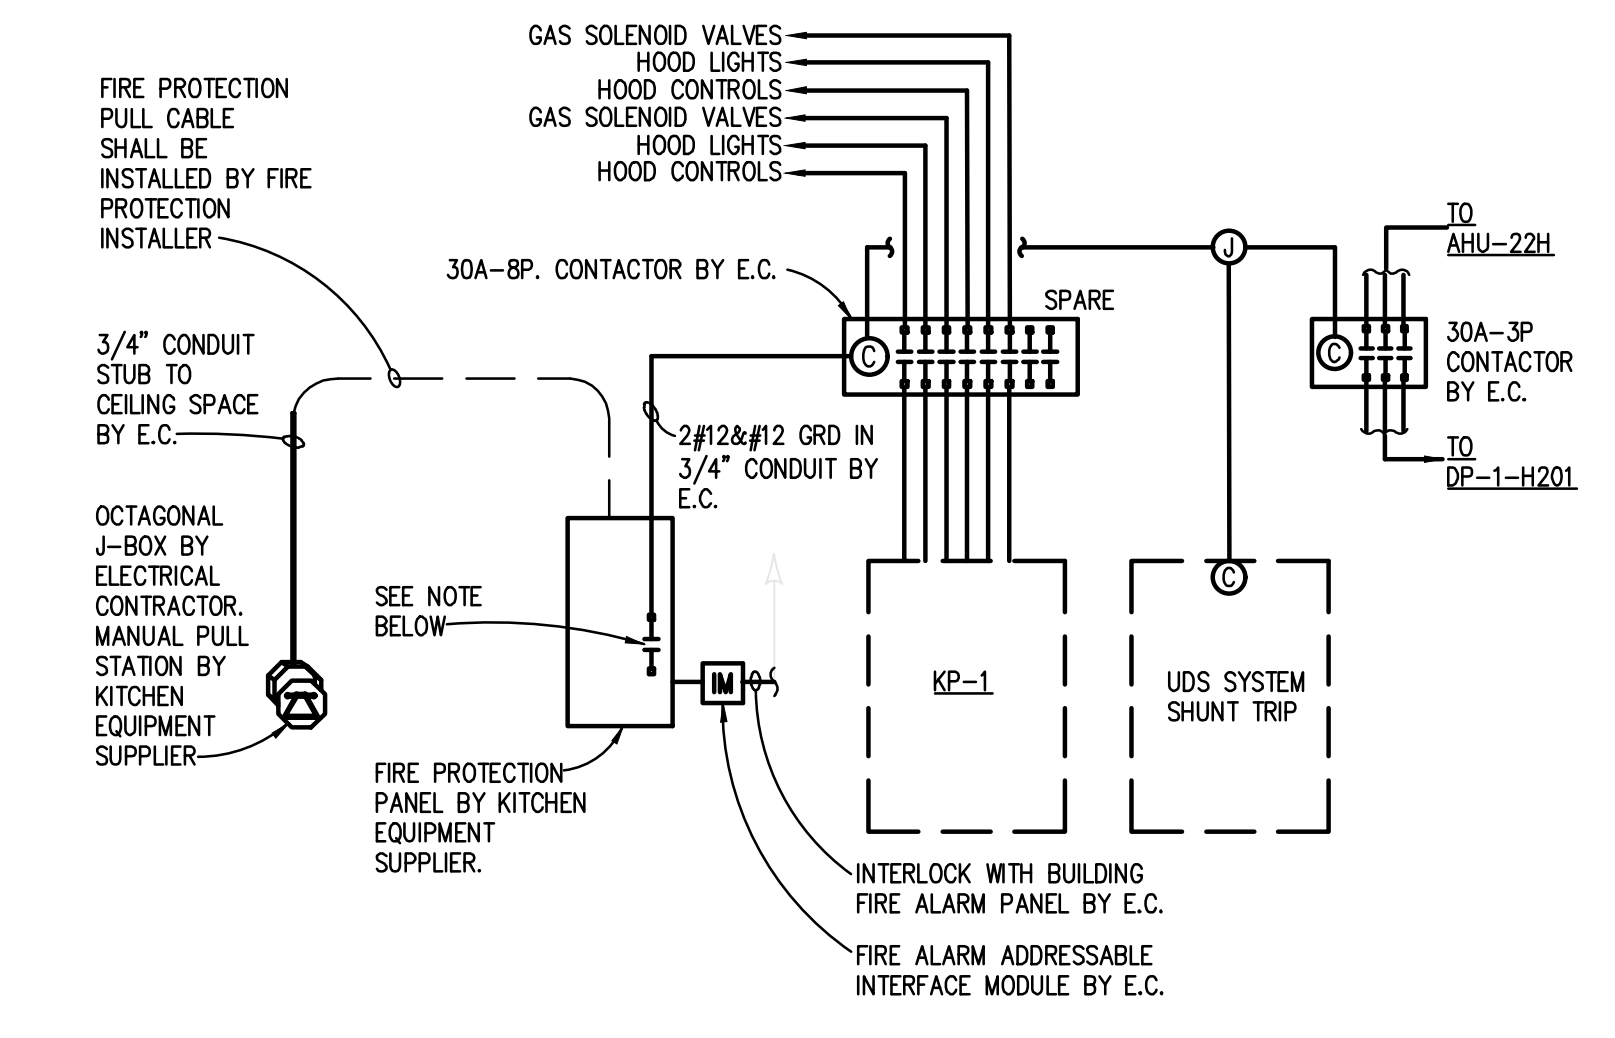

KITCHEN FIRE PROTECTION WIRING DETAIL
NO SCALE

- NOTE:**
- ELECTRICAL CONTRACTOR SHALL FIELD VERIFY VOLTAGE, AND TYPE (NORM. OPEN/CLOSED) CONTACT IN FIRE PROTECTION PANEL, AND PROVIDE CONTACTOR TO OPERATE ACCORDINGLY. EXHAUST FAN SHALL TURN ON UPON ACTIVATION OF ANSUL SYSTEM.

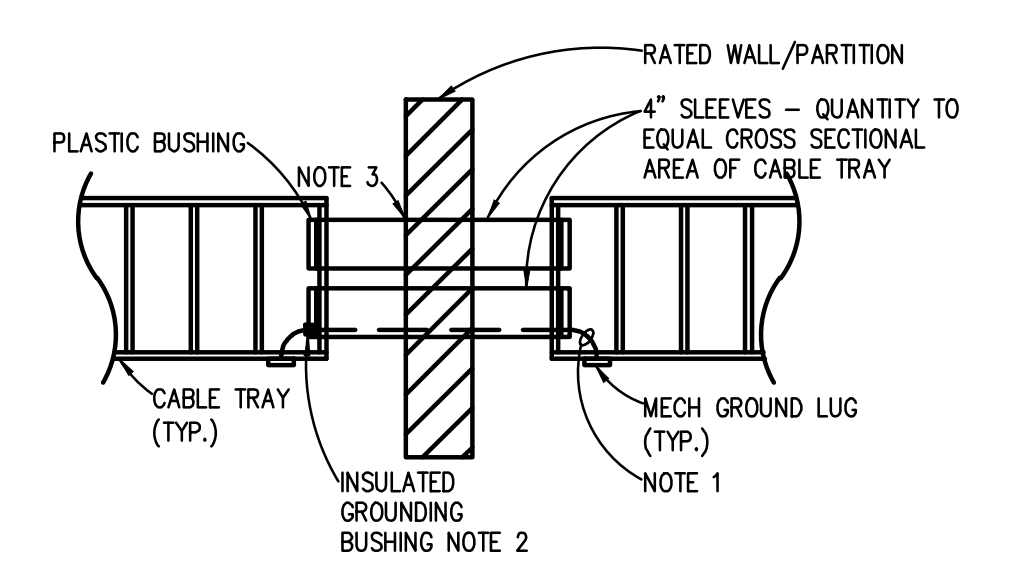

CABLE TRAY TO CONDUIT TRANSITION THROUGH RATED WALL
NO SCALE

- NOTES:**
- BOND TRAY TO CONDUIT WITH A #6 AWG COPPER GREEN INSULATED GROUND WIRE.
 - PROVIDE GROUNDING BUSHINGS ON CONDUIT SLEEVES AND BOND SLEEVES WITH #6 AWG COPPER GREEN INSULATED GROUND WIRE.
 - PROVIDE FIRE-STOPPING IN AND AROUND ALL CONDUITS MAINTAIN FIRE RATING OF PARTITION AND TO MAKE PENETRATION AIR TIGHT.


NO.	OWNER REVIEW	08/02/23
-----	--------------	----------

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

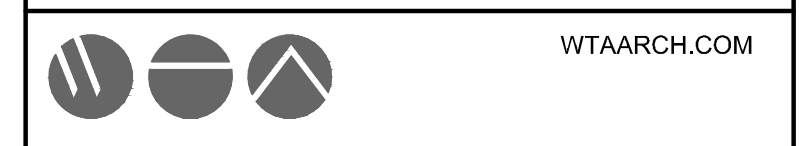

100 S. Jefferson Ave., Suite 601
Saginaw, Michigan 48607
989 752 8107

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN

SALINE, MICHIGAN

SHEET TITLE
ELECTRICAL DETAILS AND
DIAGRAMS

PROJECT NUMBER
2021094

SHEET NUMBER
E7.01

PROJECT DATE
AUGUST 23, 2023

CHECKED BY
TLC

Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA-Project No. 2021094

COMMUNICATION EQUIPMENT SCHEDULE			
MARK	DESCRIPTION	MANUFACTURER	PART NO.
A	TECHNOLOGY CABINET, MATCH EXISTING SIZE AND TYPE, WITH LOUVERED DOORS, C2 FRAME, 40 RACK UNITS, EQUIP WITH CABLE LACING BARS. EQUIP WITH TOP TO CABINET AND ADJUSTABLE CABINET FEET	HAMMOND	C2 FRAME C2RR197031BK1 W/COF-1970LKBK1 DOORS
B	POWER STRIP, RACK MOUNT	HAMMOND	15853HBB1
C	SINGLE RACK UNIT PATCH CORD ORGANIZER (PCO-1) WITH HINGED COVER.	HUBBELL	HS13C
D	PATCH PANEL-24 PORT, EQUIPPED WITH 8-PIN MODULAR JACKS TO MATCH THE CABLE COLOR AND CABLE TYPE BEING TERMINATED. PROVIDE ONE MODULAR JACK FOR EACH CABLE BEING TERMINATED. SEE SPEC AND DRAWINGS FOR COLORS, EQUIP WITH REAR CABLE ORGANIZER	HUBBELL	PANEL-HPJ24 ORGANIZER:ECMBR3

AUDIO EQUIPMENT SCHEDULE			
MARK	DESCRIPTION	MANUFACTURER	PART NO.
WA	AUDIO AMPLIFIER	QSC	SPA OR ISA SERIES
WB	AUDIO LINE LEVEL DISTRIBUTION AMPLIFIER 1 IN, 2-OUT	RDL LABS	ST-DA3
WC	VOLUME CONTROL	ATLAS	AT35

SPEAKER SCHEDULE			
MARK	DESCRIPTION	MANUFACTURER	PART NO.
Ⓢ1	PAGING SYSTEM SPEAKER FOR DROP CEILING INSTALLATION. EQUIP WITH WHITE GRILL AND MULTI TAPS. PROVIDE 1-BAR AND BACKBOX	ATLAS IED	SD72WV
Ⓢ2	PAGING SYSTEM SPEAKER, RECESSED IN DRYWALL CEILING. PROVIDE AND INSTALL BACKBOX INTO THE CEILING PRIOR TO DRYWALL. WIRE TO SPEAKERS PRIOR TO DRYWALL CEILING BEING INSTALLED.	ATLAS IED	SD72WV

CAMERA EQUIPMENT SCHEDULE						
MARK	DESCRIPTION	MANUFACTURER	PART NO.	DROP CEILING	BUILDING EXTERIOR	BUILDING EXTERIOR CORNER
CA	MULTI-HEAD CAMERA, EXTERIOR, 270 DEGREES CORNER MOUNT	BOSCH	NDM-7703		SBP-317HWW, SBP-390MMW2 SBP-300NBW	SBP-300KMW1 SBP-300NBW
CB	EXTERIOR 4K CAMERAS, ARM MOUNT ON WALL	BOSCH	NDE-8504-R			
CC	INDOOR AND OUTDOOR 360 FISHEYE SINGLE IMAGER 12 MEGAPIXEL	BOSCH	NDS-5704-F360LE	SHD-1600FPW	SBP-167HWW, SBP-300MMW1 SBP-300NBW	SBP-300KMW1 SBP-300NBW
CD	INDOOR SHORT DISTANCE CAMERA, 2MP, DROP OR HARD CEILING	BOSCH	NDE-4502-A	SHD-1408FPW		
CE	INDOOR 5 MP DROP OR HARD CEILING OR WALL	BOSCH	NDE-5503-A	SHD-1408FPW		
CF	BOSCH NVR FOR CAMERA STORAGE AND PROCESSING	BOSCH	SEE SPECS			
CG	ETHERNET SWITCH FOR CAMERA SYSTEM	CISCO	9200 SERIES			

CABLE SCHEDULE			
MARK	DESCRIPTION	MANUFACTURER	PART NO.
1	CAT-6 UTP CABLES, BLUE IN COLOR. SEE CONNECTIVITY CODES	MOHAWK	M58281
2	CAT-6 UTP CABLES, GREEN IN COLOR. SEE CONNECTIVITY CODES	MOHAWK	M58286
3	CAT-6 UTP CABLES, YELLOW IN COLOR. SEE CONNECTIVITY CODES	MOHAWK	M58283
4	CAT-6 CABLE UNDERGROUND RATED	MOHAWK	M57622
5	SHAKER FENCE CABLE	JSC	CONTRACTOR
6	STUN FENCE FEEDER WIRE FROM ENERGIZER TO FENCE	CONTRACTOR	CONTRACTOR
7	STUN FENCE CABLE ON FENCE	CONTRACTOR	CONTRACTOR

ACCESS CONTROL EQUIPMENT SCHEDULE			
MARK	DESCRIPTION	MANUFACTURER	PART NO.
XA	INTERCOM AT DOOR-INTERIOR	HARDING	ICE-320-217-000
XB	INTERCOM AT DOOR-EXTERIOR	HARDING	ICE-320-227-000
XC	PLC WITH ETHERNET INTERFACE PROCESSOR	ALLEN BRADLEY	1769-L37ERM
XD	POINT I/O ETHERNET ETHERNET ADAPTER	ALLEN BRADLEY	1769-AENTR
XE	POINT I/O OUTPUT MODULE	ALLEN BRADLEY	1769-OB32
XF	POINT I/O INPUT MODULE	ALLEN BRADLEY	1769-IO32
XG	POWER SUPPLY	EMERSON	SVL-1024100
XH	DIN RAIL MOUNTED TERMINAL STRIPS, PROVIDE AS REQUIRED FOR CABLE TYPE AND CONNECTIVITY, MOUNT IN CABINET, PROVIDE SUPPORTS AND PLASTIC FINGER DUCT FOR ROUTING CABLE	CONTRACTOR	CONTRACTOR
XI	INTERCOM BOARD FOR CONNECTION OF AUDIO ON INTERCOMS	HARDING	QCB-120-1
XJ	INTERCOM BOARD FOR CONNECTION OF PUSH BUTTON ON INTERCOMS	HARDING	QCB-120-1
XL	ETHERNET SWITCH FOR ACCESS CONTROL SYSTEM	CONTRACTOR	CONTRACTOR
XM	INTERCOM CONTROLLER IP ATTACHED	HARDING	DCC-5100-3030- S100-00IP


ACCESS CONTROL EQUIPMENT SCHEDULE			
MARK	DESCRIPTION	MANUFACTURER	PART NO.
CA	ACCESS CONTROL SYSTEM, SOFTWARE AND ASSOCIATED/REQUIRED SERVERS	STANLEY	GATEKEEPER
CB	CARD READER SERIAL TO IP DEVICE, SERVES UP TO 16 CARD READERS	MOXA	5650-16
CC	CARD READER, COMPATIBLE WITH STANLEY SYSTEM.	HID	5352AGN00
CD			
CE			
CF			
CG			
CH			

ABBREVIATIONS			
ABBREV.	DESCRIPTION	ABBREV.	DESCRIPTION
ZG	TWO-GANG BOX - PROVIDED BY EC	NIC	NOT IN CONTRACT
AC	ABOVE COUNTER - INSTALL BACKBOX SAME HEIGHT AS OTHER ELECTRICAL OUTLETS ABOVE THE COUNTER.	PBO	PROVIDED BY OTHERS
AFF	ABOVE FINISHED FLOOR	PCO-1	PATCH CORD ORGANIZER - 1 UNIT HIGH
AFG	ABOVE FINISHED GROUND	PCO-2	PATCH CORD ORGANIZER - 2 UNITS HIGH
AWG	AMERICAN WIRE GAUGE	PET	PROTECTED ENTRANCE TERMINAL
EMT	EMT TYPE CONDUIT	QTY	QUANTITY
EC	ELECTRICAL CONTRACTOR		

COMMUNICATION SYMBOL LEGEND	
SYMBOL	DESCRIPTION
①	THIS SYMBOL WITH A NUMBER INSIDE REFERS TO KEYNOTES, REFER TO NOTES ON THE SHEET OR WITHIN THE DETAIL FOR ADDITIONAL INFORMATION.
A	EQUIPMENT SCHEDULE. THIS SYMBOL WITH LETTERS INSIDE REFERS EQUIPMENT SCHEDULES, SEE DETAILS AND EQUIPMENT SCHEDULES ON TC101, TC301, TC501 AND TC701.
1	CABLE SCHEDULE. THIS SYMBOL WITH NUMBERS INSIDE REFERS EQUIPMENT SCHEDULES, SEE DETAILS AND EQUIPMENT SCHEDULES ON TC101, TC301, TC501 AND TC701.
XXXX	DATA COMMUNICATIONS OUTLET CONNECTIVITY CODE. X IS A 1 THRU 99, SEE TC1XX SHEETS FOR SPECIFIC REQUIREMENTS. XXXX NOTES THAT THE CABLE IS FOR A SPECIFIC USE.
①Z08 ①Z08	TWO SIDED DIGITAL CLOCK. SEE CONNECTIVITY CODE FOR CLOCK TYPE.
①Z08	SINGLE SIDED DIGITAL CLOCK. SEE CONNECTIVITY CODE FOR CLOCK TYPE.
—	NEW STUN FENCE. INSTALL NEW STUN FENCE WIRING AND DEVICES
—	NEW SHAKER WIRE ON FENCE. INSTALL NEW SHAKER WIRE ON THE FENCE
---	TEMPORARY FEED OF STUN FENCE FROM STUN FENCE CABINET TO EXISTING FENCE
---	EXISTING SHAKER WIRE AND STUN FENCE. REMOVE FROM FENCE

AUDIO VIDEO SYMBOL LEGEND	
SYMBOL	DESCRIPTION
XXXX	AUDIO/VIDEO COMMUNICATIONS OUTLET. REFER TO THE ASSOCIATED AV SYSTEM DETAIL FOR REQUIREMENTS. ZZ REFERS TO HEIGHT OF OUTLET, 18" UNLESS OTHER WISE NOTED.
SEE TC3XX/X	AV SYSTEM DETAIL. REFER TO THIS SHEET AND DETAIL NUMBER FOR THE REQUIREMENTS OF THE AUDIO/VIDEO SYSTEM IN THIS ROOM
ⓈZ X	SPEAKERS. SEE SPEAKER SCHEDULE ON TC301."X" REFERS TO SPEAKER TYPE. "ZZ" REFERS TO SPEAKER ZONE IF THIS IS A PAGING SPEAKER.

SECURITY SYMBOL LEGEND	
SYMBOL	DESCRIPTION
XX	ACCESS CONTROL SYMBOL. "XX" IS LETTERS. SEE DETAILS ON TC5XX SHEETS FOR EQUIPMENT, CABLING AND RACEWAY DETAILS.
XX	ACCESS CONTROL SYMBOL FOR EXISTING DEVICES. "XX" IS LETTERS. SEE DETAILS ON TC5XX SHEETS. LEAVE DEVICES AND CONNECT TO NEW SYSTEM OR LEAVE AS CONNECTED TO EXISTING SYSTEM. SEE NOTES AND DETAILS.
XXX	DOOR NUMBER
SEC.PNL	SECURITY PANEL. PROVIDE PANEL AND CONNECT AS SHOWN ON FLOORPLANS AND IN THE SPECIFICATIONS.
Ⓢ	SECURITY CAMERA. PROVIDE AND INSTALL A NEW SECURITY CAMERA. SEE DETAILS ON TC5XX SHEETS.
Ⓢ	SECURITY CAMERA WITH 180 DEGREE VIEWING. PROVIDE AND INSTALL A NEW SECURITY CAMERA. SEE DETAILS ON TC5XX SHEETS.
Ⓢ	SECURITY CAMERA WITH 360 DEGREE VIEWING, SINGLE-IMAGER. PROVIDE AND INSTALL A NEW SECURITY CAMERA. SEE DETAILS ON TC5XX SHEETS.
Ⓢ	SECURITY CAMERA WITH 270 OR 360 DEGREE VIEWING, MULTI-IMAGER. PROVIDE AND INSTALL A NEW SECURITY CAMERA. SEE DETAILS ON TC5XX SHEETS.
Ⓢ	SECURITY CAMERA. PTZ. SEE SPECIFICATIONS FOR CAMERA REQUIREMENTS AND MOUNTING.

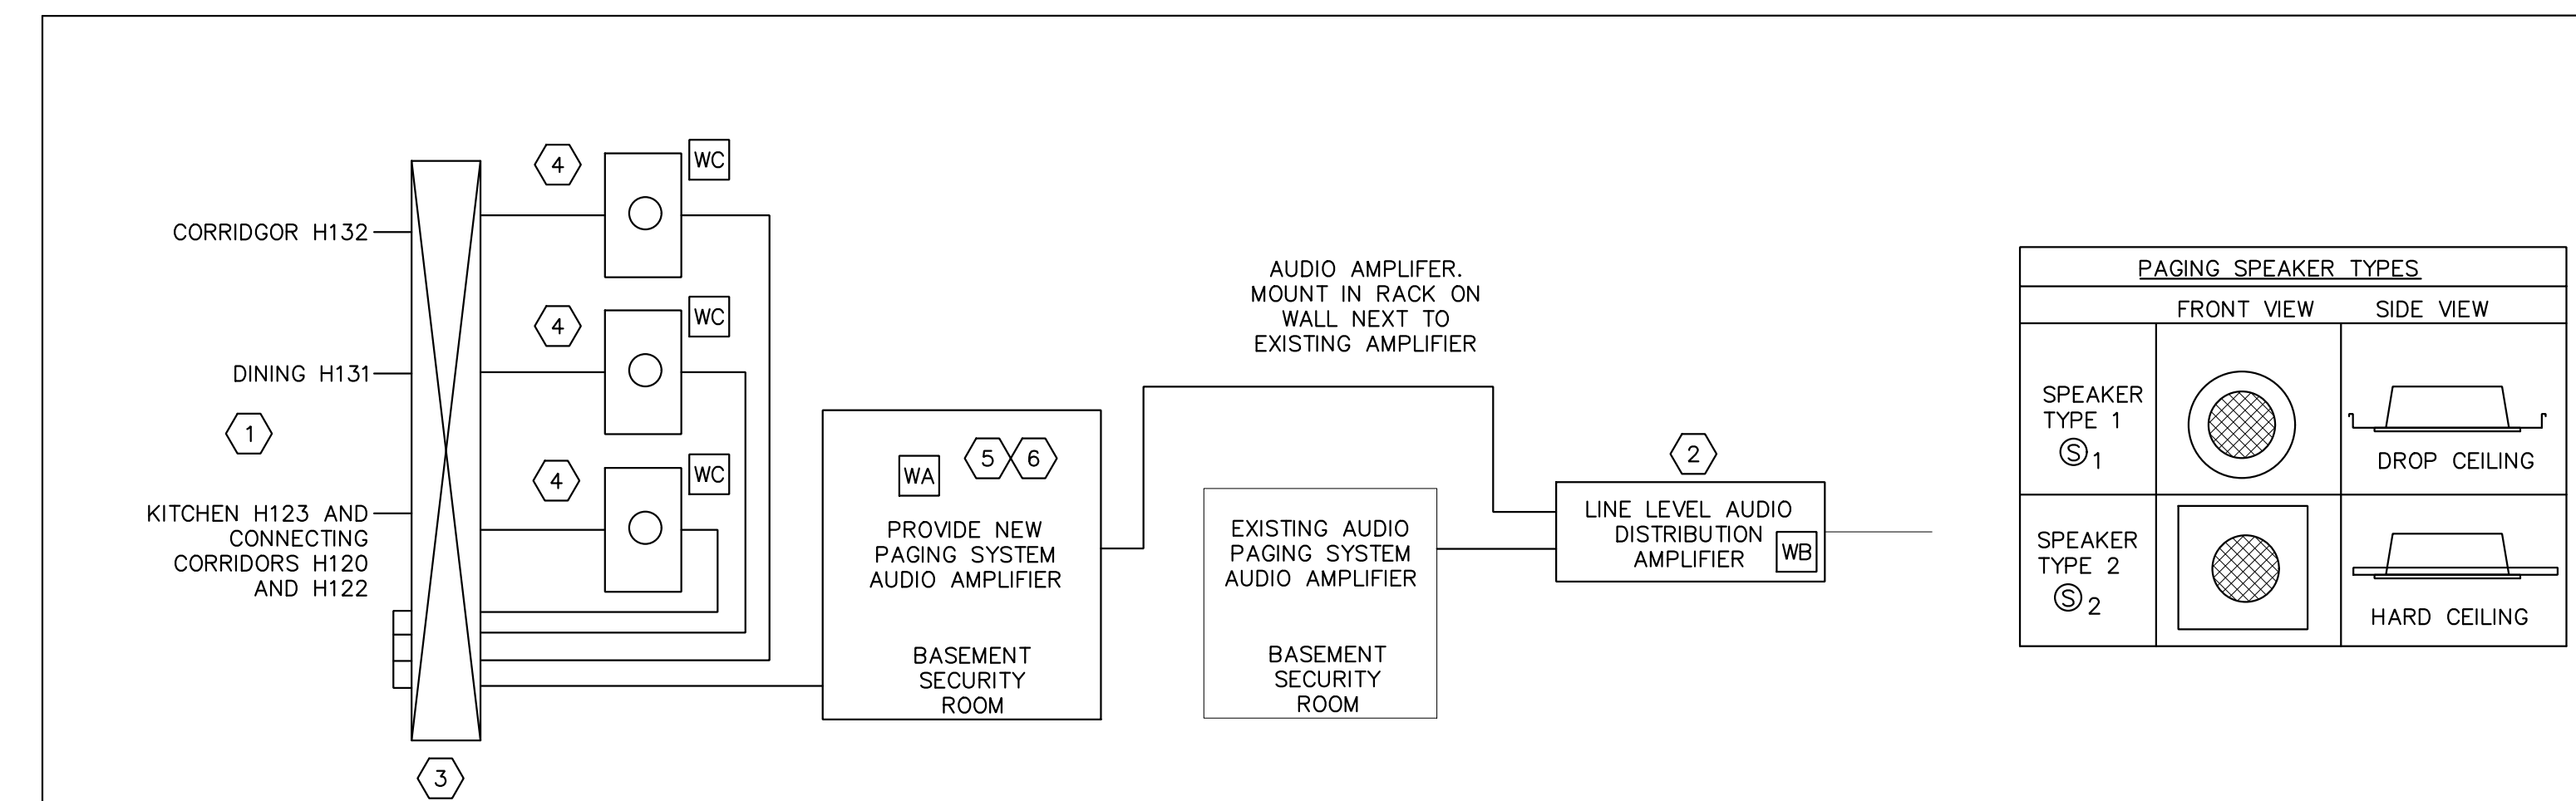

- NOTES:
- THE SITE CURRENTLY HAS AN EXISTING PAGING AUDIO SYSTEM. THIS SYSTEM SHALL BE EXPANDED TO SUPPORT NEW ZONES AND SPEAKERS IN THE KITCHEN AREA.
 - PROVIDE AN AUDIO SPLITTER AND SPLIT THE EXISTING SIGNAL PRIOR TO CONNECTION TO EXISTING AMPLIFIER.
 - THE PAGING/BELL SYSTEM SHALL BE MOUNTED IN A CABINET IN THE COMM ROOM IN THE BASEMENT.
 - CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CABLES ASSOCIATED WITH THE CONNECTIVITY OF THE PAGING SYSTEM. ALL NEW CABLES SHALL BE PLENUM RATED.
 - CONTRACTOR SHALL LABEL EACH PAGING SYSTEM SPEAKER CABLE. THE LABEL SHALL BE "ZONE XXX" WHERE XXX DESIGNATES THE EXTENSION THAT THE CABLE IS CONNECTED TO. CABLES SHALL BE LABELED AT EACH TERMINATION POINT & AT EACH INTERCONNECTION POINT.
 - PROVIDE INTERCONNECTION CABLES AS REQUIRED FOR ZONES AND POWER DISTRIBUTION TO THE SPEAKERS. CONTRACTOR SHALL VERIFY CONFIGURATION WITH ENGINEER PRIOR TO INSTALLATION.
 - INSTALL VOLUME CONTROLS FOR AUDIO LEVEL CONTROL OF ALL THREE ZONES BEING ADDED.

- KEYED NOTES:
- INSTALL CABLES FROM SPEAKERS TO THE BASEMENT SECURITY ROOM. PROVIDE ONE CABLE FOR EACH ZONE AS DEPICTED.
 - PROVIDE AND INSTALL AN AUDIO SPLITTER FOR THE SYSTEM. SPLIT EXISTING SIGNAL.
 - INSTALL TERMINAL STRIPS FOR WIRE TERMINATION. LABEL EACH WIRE AND EACH ZONE AT THE TERMINAL STRIPS.
 - INSTALL A VOLUME CONTROL IN A SINGLE-GANG BACKBOX ON THE WALL. LABEL FOR THE ZONE IT CONNECTS TO.
 - TEST SYSTEM. LISTEN AND SET AUDIO LEVEL IN EACH ZONE.
 - PROVIDE AN AMPLIFIER THAT DRIVES ALL SPEAKERS. WITH ADEQUATE AUDIO LEVEL.

1
TC101
AUDIO PAGING SYSTEM
EXPANSION DETAIL

NO. REVISION DATE



FILE NO.
491/20167.SDW

FUNDING CODE 171CODHHS7255 CONTRACT NO. Y22003

CommtechDesign
6581 BELDING RD NE STE 101
ROCKFORD, MICHIGAN 49341
WWW.COMMTECHDESIGN.COM



100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023


PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
CABLING
LEGENDS, SCHEDULES
& DETAILS

PROJECT NUMBER 2021094 SHEET NUMBER

PROJECT DATE SEPTEMBER 6, 2023 TC101

CHECKED BY BWE

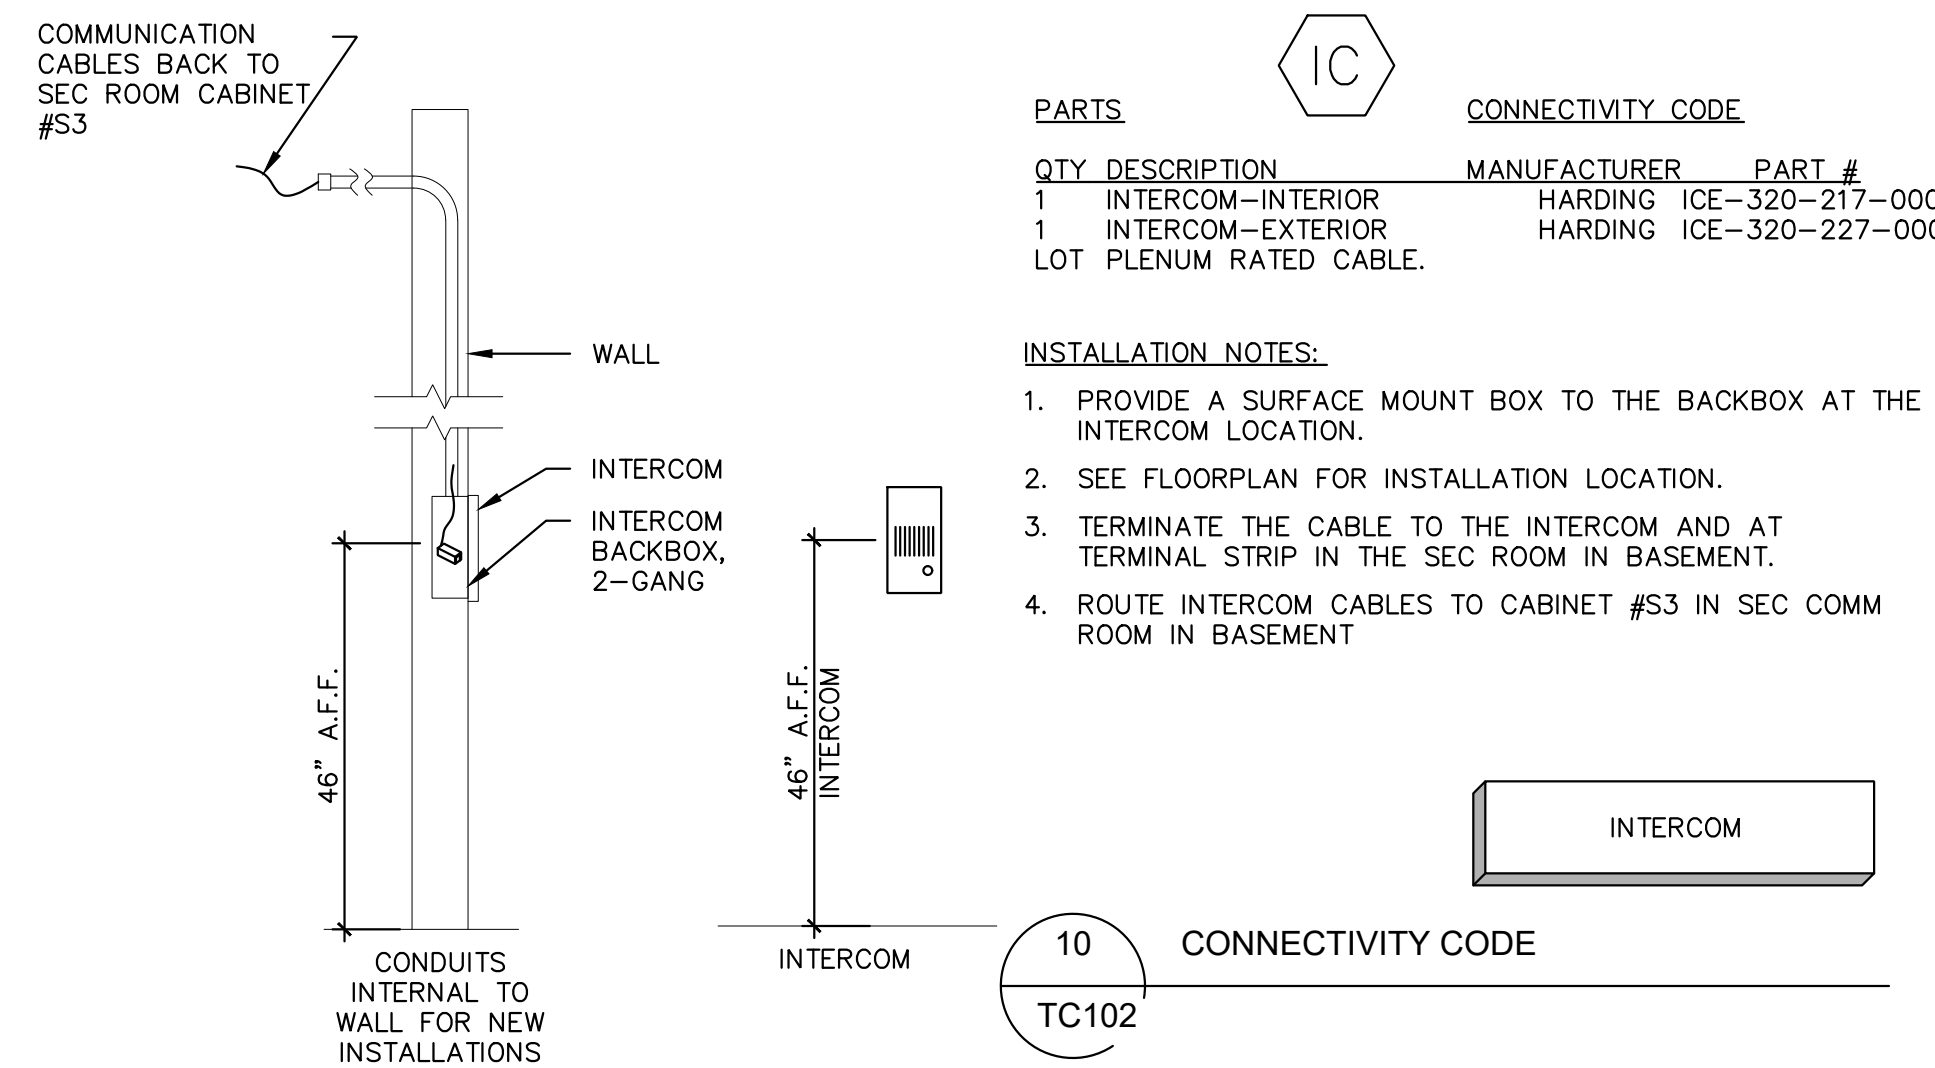


IC

QTY	DESCRIPTION	MANUFACTURER	PART #
1	INTERCOM-INTERIOR	HARDING	ICE-320-217-000
1	INTERCOM-EXTERIOR	HARDING	ICE-320-227-000
1	LOT PLENUM RATED CABLE.		

INSTALLATION NOTES:

1. PROVIDE A SURFACE MOUNT BOX TO THE BACKBOX AT THE INTERCOM LOCATION.
2. SEE FLOORPLAN FOR INSTALLATION LOCATION.
3. TERMINATE THE CABLE TO THE INTERCOM AND AT TERMINAL STRIP IN THE SEC ROOM IN BASEMENT.
4. ROUTE INTERCOM CABLES TO CABINET #53 IN SEC COMM ROOM IN BASEMENT

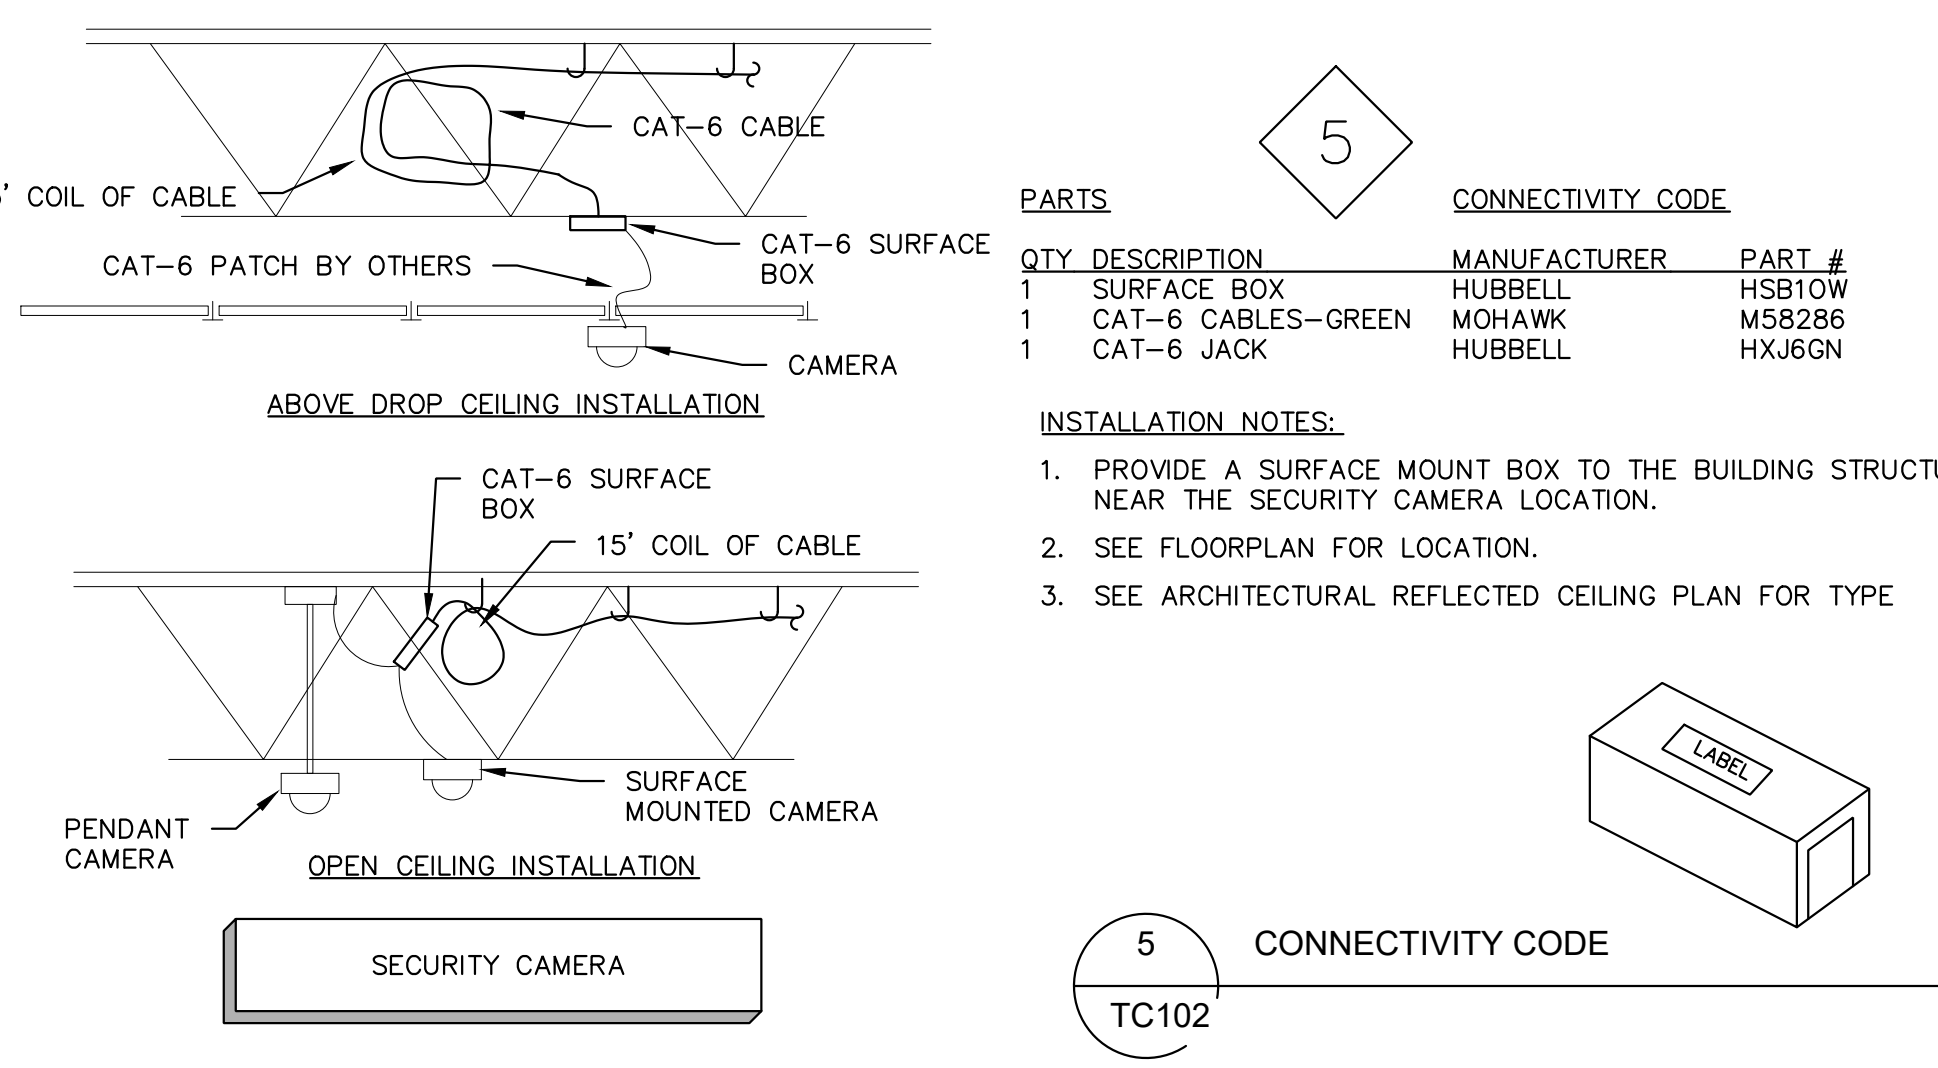

5

QTY	DESCRIPTION	MANUFACTURER	PART #
1	SURFACE BOX	HUBBELL	HSB10W
1	CAT-6 CABLES-GREEN	MOHAWK	M58286
1	CAT-6 JACK	HUBBELL	HXJ6GN

INSTALLATION NOTES:

1. PROVIDE A SURFACE MOUNT BOX TO THE BUILDING STRUCTURE NEAR THE SECURITY CAMERA LOCATION.
2. SEE FLOORPLAN FOR LOCATION.
3. SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR TYPE


INSTALLATION NOTES:

1. REFER TO THESE NOTES FOR ALL CONNECTIVITY CODES. FOR SPECIALIZED NOTES SEE THE ACTUAL CONNECTIVITY CODE.
2. ROUTE ALL USER CABLES FROM THE RACK OR CABINET, THROUGH THE CABLE TRAY IF SO PROVIDED. IF NO CABLE TRAY IS SHOWN INSTALL CABLES THROUGH "J" HOOKS. PROVIDE ALL "J" HOOKS.
3. CABLES SHALL BE SUPPORTED NO LESS THAN EVERY 5 FEET.
4. PROVIDE A SMALL LOOP OF CABLE ABOVE THE CEILING PRIOR TO INSTALLING THE CABLE INTO THE USER CONDUIT OR RACEWAY.
5. ROUTE THE CABLE THROUGH THE CONDUIT OR RACEWAY AND TO THE WALLBOX, FLOORBOX OR SURFACE MOUNT BOX. PROVIDE ENOUGH EXTRA CABLE FOR TERMINATION AND MAINTENANCE.
6. TERMINATE ALL CABLES WITH THE CORRECT CONNECTORS.
7. ALL CONNECTORS SHALL BE INSERTED INTO THE KEYSTONE PLATES AND THEN THE KEYSTONE PLATES SHALL BE INSTALLED INTO THE FACEPLATES.
8. INSTALL FACEPLATES TO THE BOXES OR DIRECTLY TO THE WALL OR FURNITURE IN THE CASE OF SURFACE MOUNT BOXES.
9. EACH CABLE SHALL HAVE A LASER-PRINTED, SELF-LAMINATING WRAP-AROUND LABEL AT EACH END. SEE DETAILS ON TC101
10. OUTLETS SHALL BE AT 18" AFF UNLESS NOTED ON THE CONNECTIVITY CODE OR PLAN DRAWINGS.
11. LABEL EACH FACEPLATE WITH A LASER-PRINTED LABEL THAT IS INSTALLED BEHIND THE CLEAR PLASTIC LABEL STRIP. WHERE NO LABEL STRIP IS PROVIDED, THE CONTRACTOR SHALL INSTALL A LASER PRINTED ADHESIVE LABEL. WHERE SPECIFICALLY NOTED, THE CONTRACTOR SHALL INSTALL ENGRAVED LAMACOID LABELS.
12. AFTER INSTALLATION, ALL CABLES SHALL BE TESTED. SEE SPECIFICATIONS FOR TESTING REQUIREMENTS.
13. FOR AUDIO AND VIDEO CONNECTIONS, THE CONTRACTOR SHALL ROUTE SIGNALS ACROSS THE CABLES FOR TESTING.
14. PROVIDE FLEXIBLE CONDUIT FROM THE WALLBOX OR FLOORBOX TO THE FURNITURE RACEWAY WHERE CABLES ARE INSTALLED IN FURNITURE.

N CONNECTIVITY CODE

MOHAWK NOTE

TC102

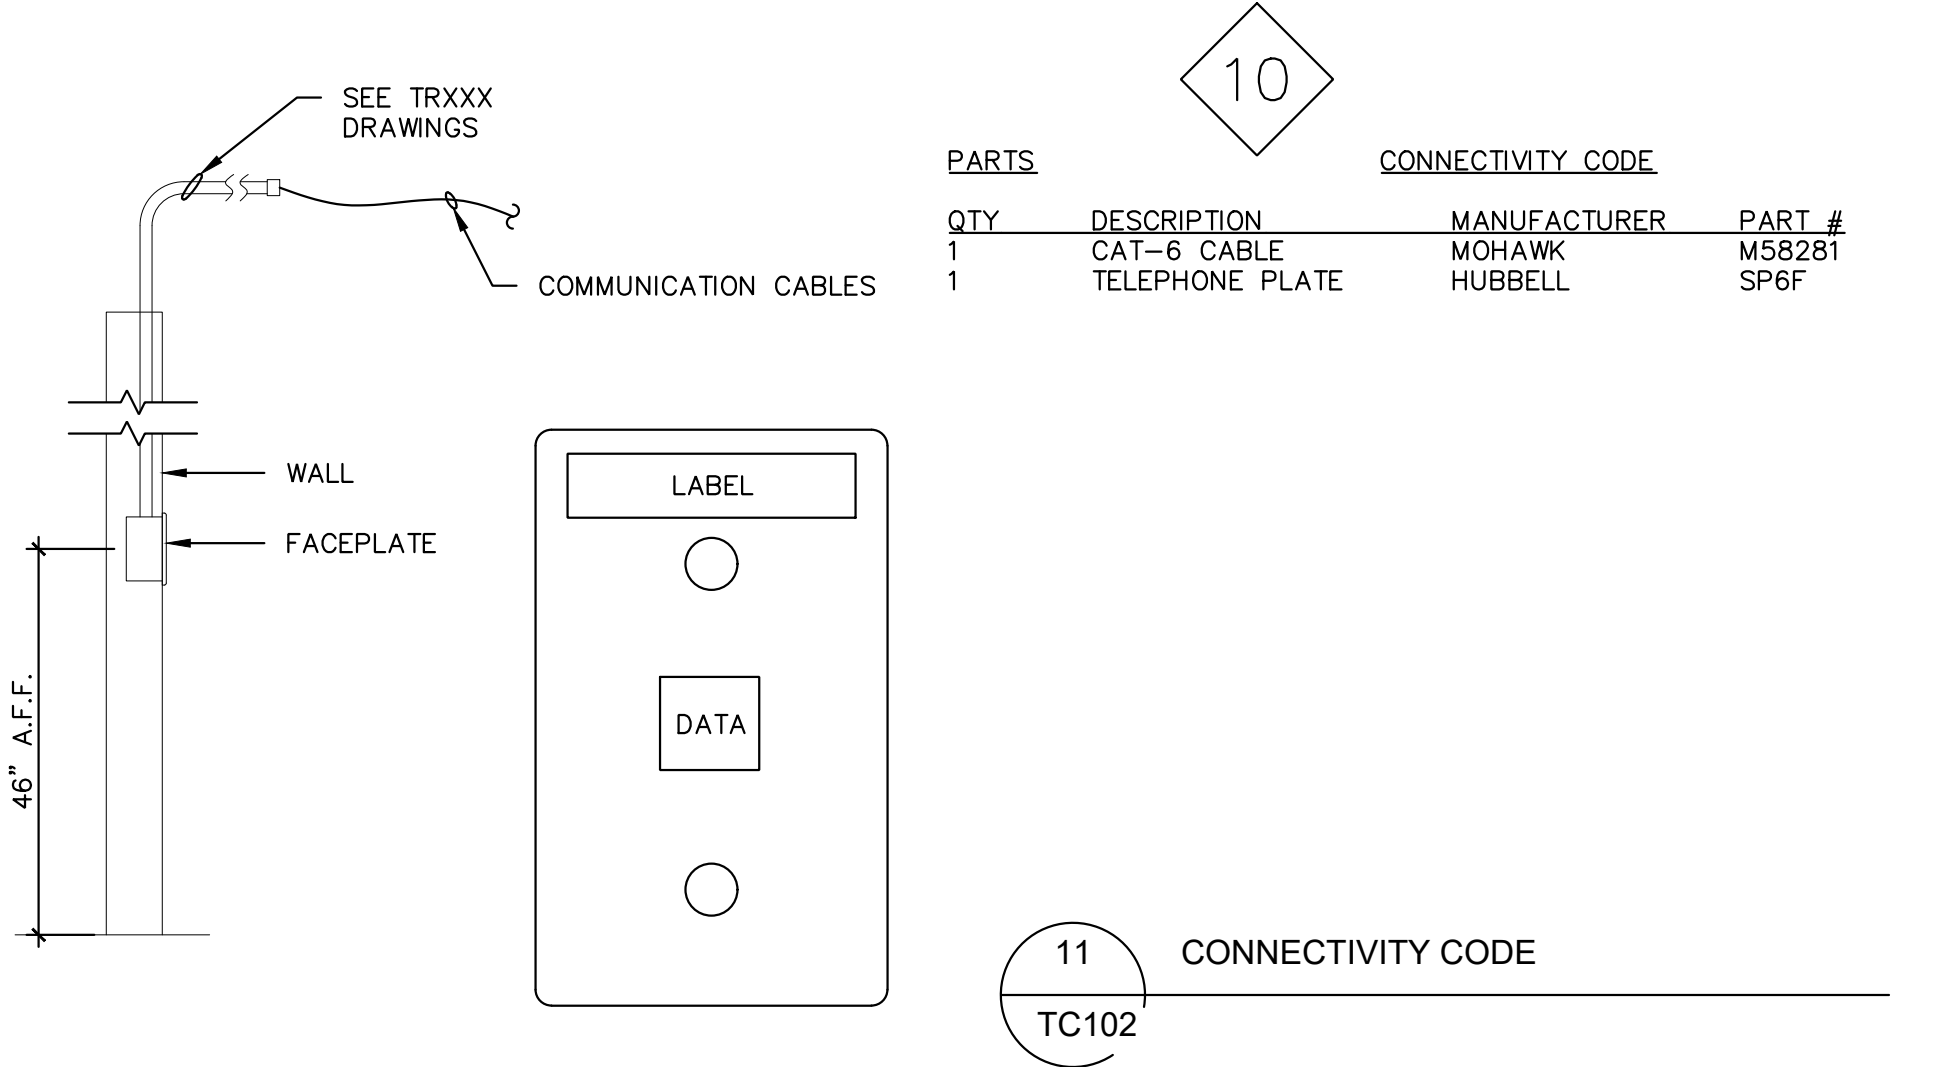


10

QTY	DESCRIPTION	MANUFACTURER	PART #
1	CAT-6 CABLE	MOHAWK	M58281
1	TELEPHONE PLATE	HUBBELL	SP6F

INSTALLATION NOTES:

1. USE ONLY SECURITY SCREWS WITH THESE PLATES.
2. WHERE NOTED THE CABLES SHALL BE INSTALLED THRU SURFACE RACEWAY.
3. LABEL THE FACEPLATE WITH A LASER PRINTED LABEL

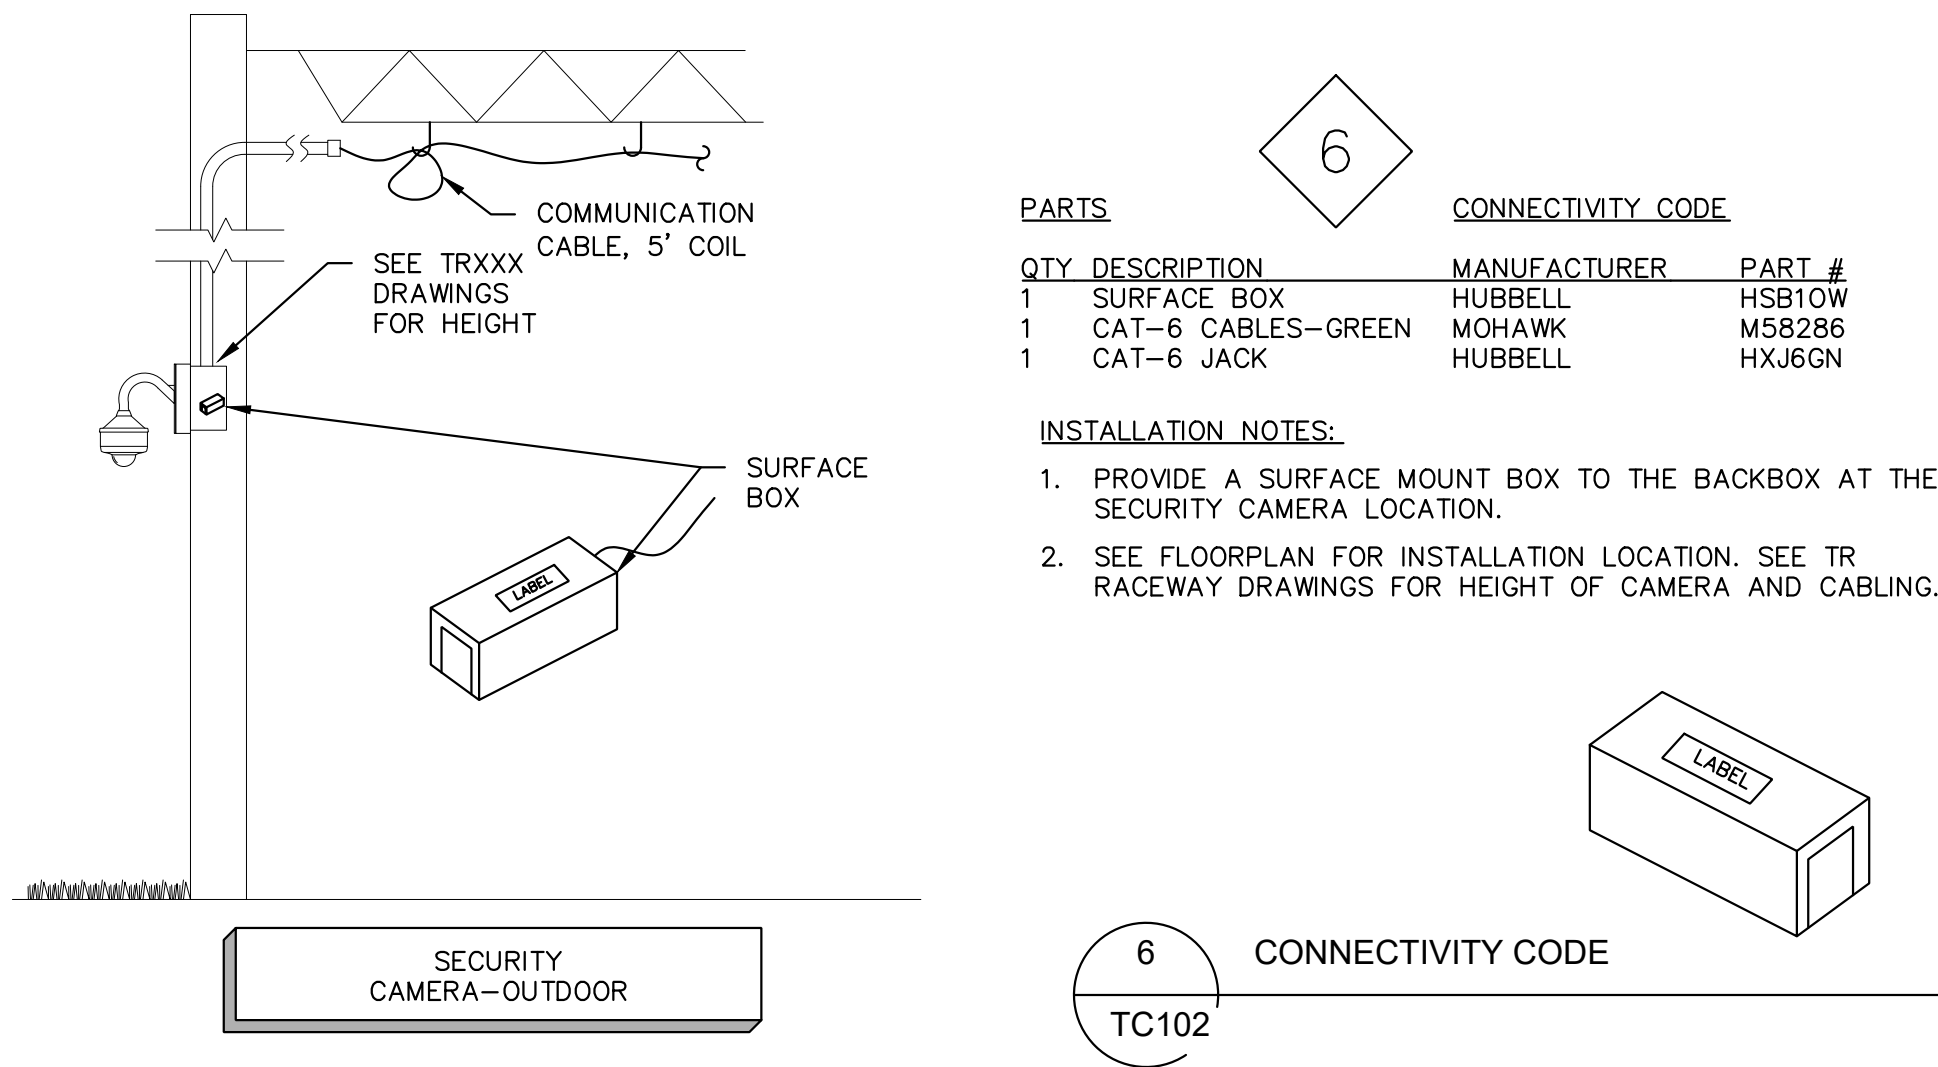


6

QTY	DESCRIPTION	MANUFACTURER	PART #
1	SURFACE BOX	HUBBELL	HSB10W
1	CAT-6 CABLES-GREEN	MOHAWK	M58286
1	CAT-6 JACK	HUBBELL	HXJ6GN

INSTALLATION NOTES:

1. PROVIDE A SURFACE MOUNT BOX TO THE BACKBOX AT THE SECURITY CAMERA LOCATION.
2. SEE FLOORPLAN FOR INSTALLATION LOCATION. SEE TR RACEWAY DRAWINGS FOR HEIGHT OF CAMERA AND CABLING.

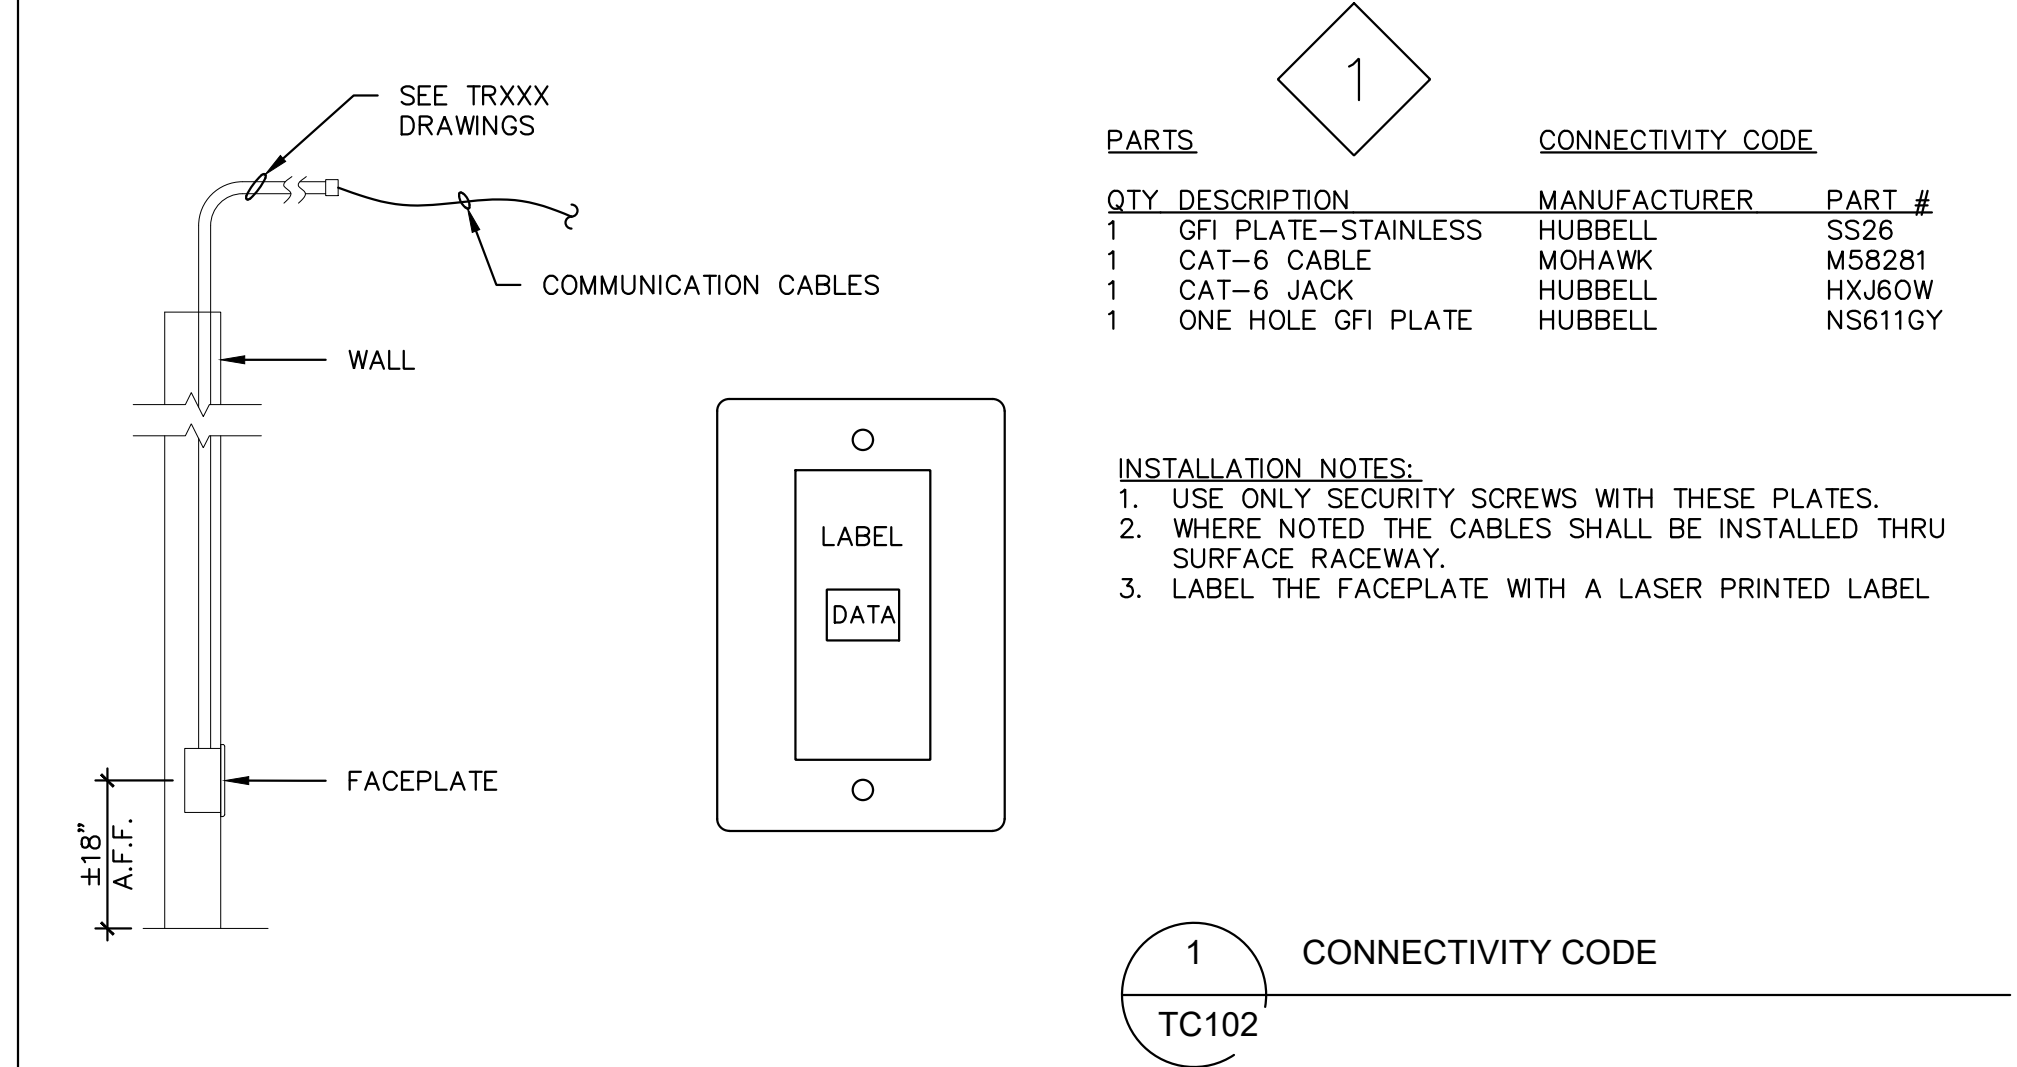


1

QTY	DESCRIPTION	MANUFACTURER	PART #
1	GFI PLATE-STAINLESS	HUBBELL	SS26
1	CAT-6 CABLE	MOHAWK	M58281
1	CAT-6 JACK	HUBBELL	HXJ6GN
1	ONE HOLE GFI PLATE	HUBBELL	NS611GY

INSTALLATION NOTES:

1. USE ONLY SECURITY SCREWS WITH THESE PLATES.
2. WHERE NOTED THE CABLES SHALL BE INSTALLED THRU SURFACE RACEWAY.
3. LABEL THE FACEPLATE WITH A LASER PRINTED LABEL




11

QTY	DESCRIPTION	MANUFACTURER	PART #
1	CAT-6 CABLE	MOHAWK	M58281
1	TELEPHONE PLATE	HUBBELL	SP6F

INSTALLATION NOTES:

1. USE ONLY SECURITY SCREWS WITH THESE PLATES.
2. WHERE NOTED THE CABLES SHALL BE INSTALLED THRU SURFACE RACEWAY.
3. LABEL THE FACEPLATE WITH A LASER PRINTED LABEL

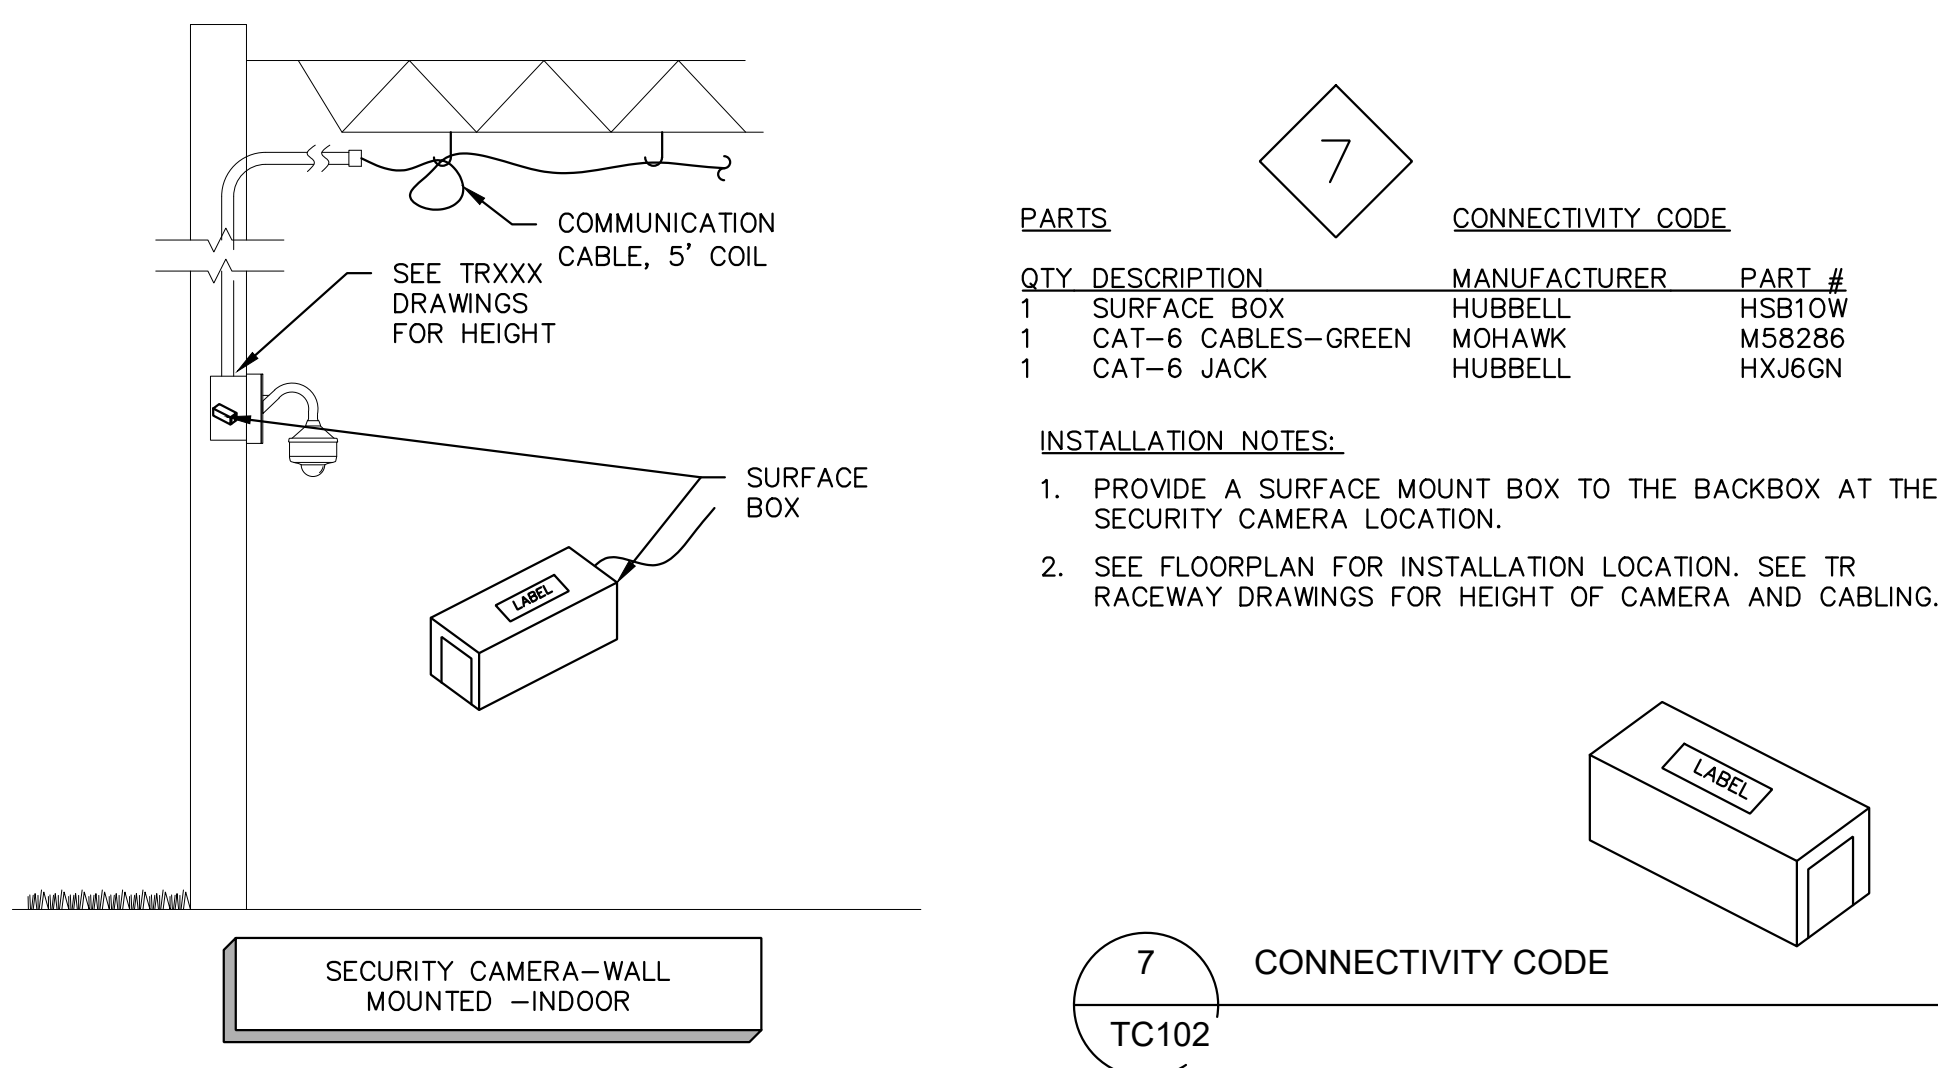


7

QTY	DESCRIPTION	MANUFACTURER	PART #
1	SURFACE BOX	HUBBELL	HSB10W
1	CAT-6 CABLES-GREEN	MOHAWK	M58286
1	CAT-6 JACK	HUBBELL	HXJ6GN

INSTALLATION NOTES:

1. PROVIDE A SURFACE MOUNT BOX TO THE BACKBOX AT THE SECURITY CAMERA LOCATION.
2. SEE FLOORPLAN FOR INSTALLATION LOCATION. SEE TR RACEWAY DRAWINGS FOR HEIGHT OF CAMERA AND CABLING.

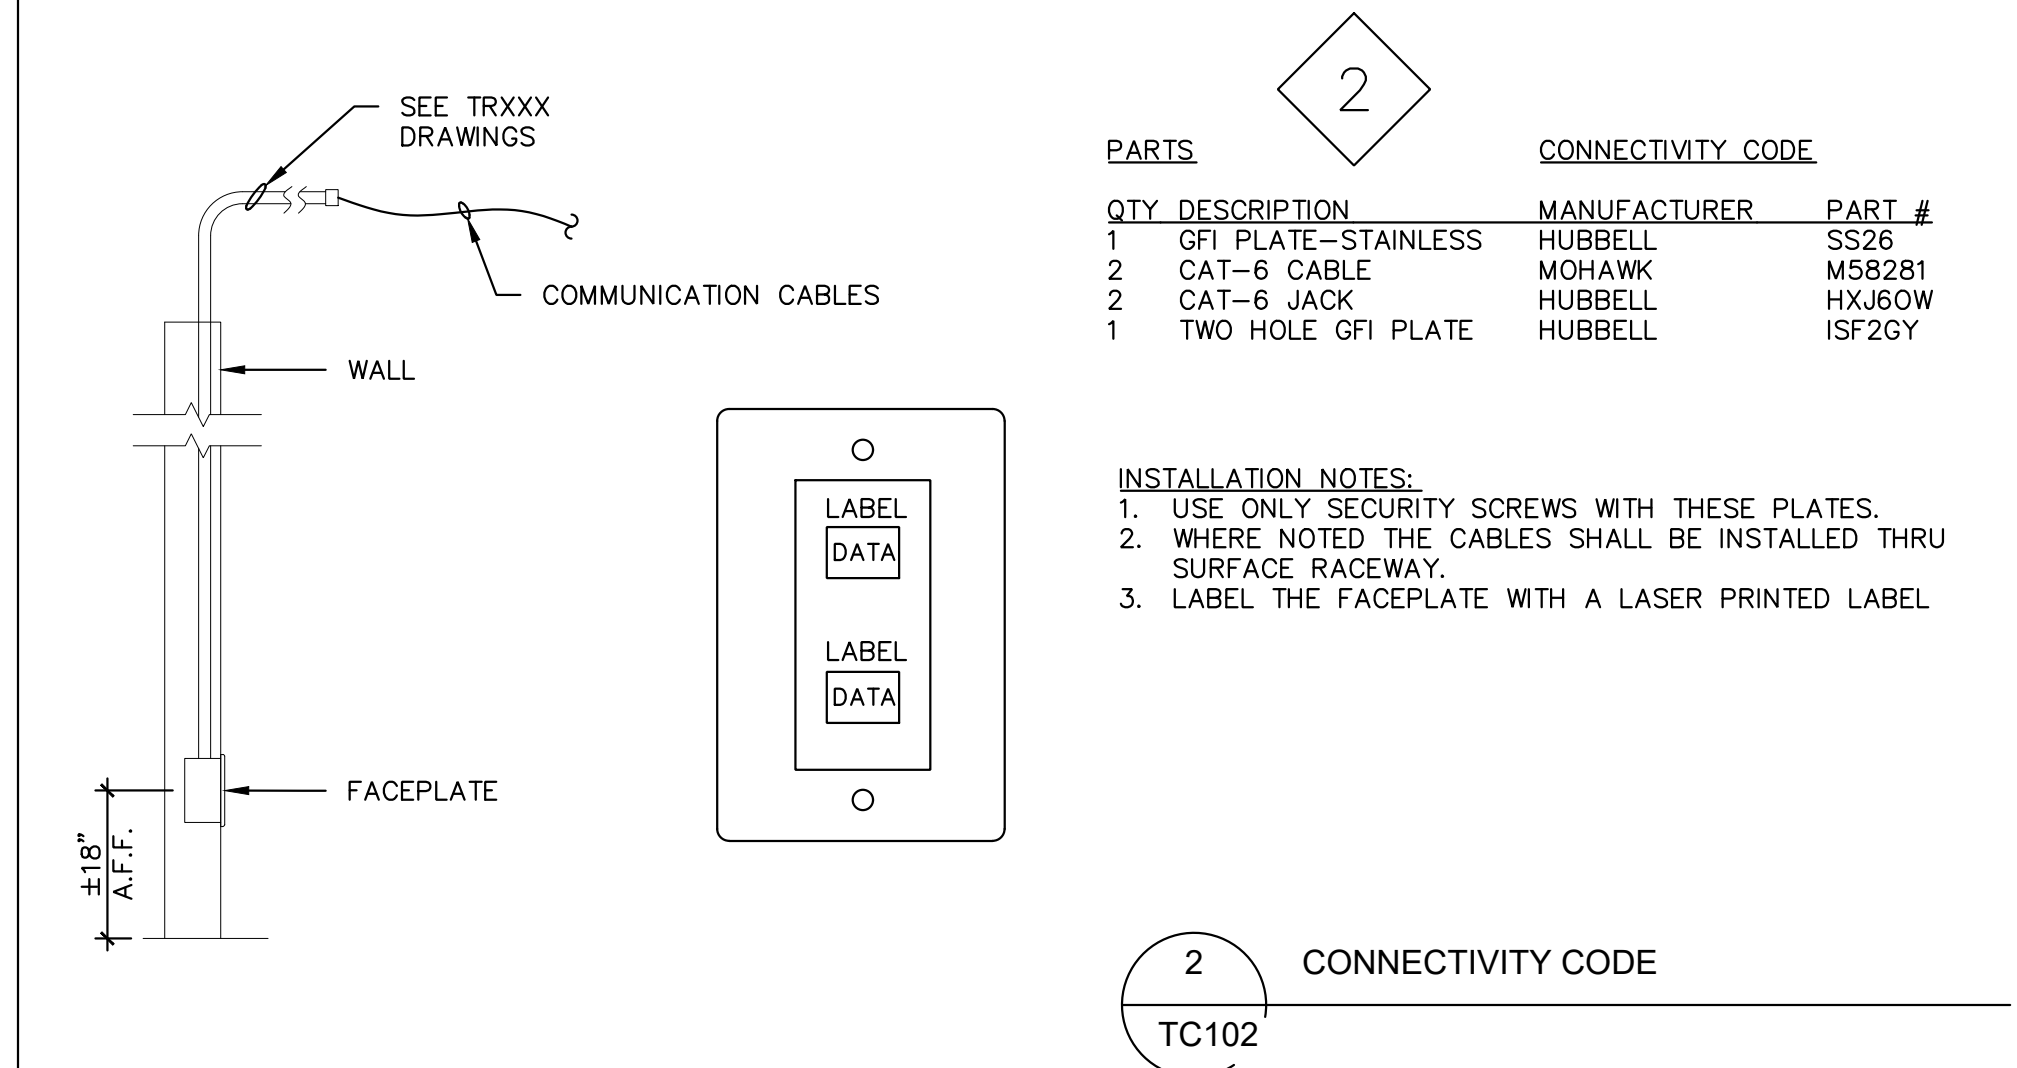


2

QTY	DESCRIPTION	MANUFACTURER	PART #
1	GFI PLATE-STAINLESS	HUBBELL	SS26
2	CAT-6 CABLE	MOHAWK	M58281
2	CAT-6 JACK	HUBBELL	HXJ6GN
1	TWO HOLE GFI PLATE	HUBBELL	ISF2GY

INSTALLATION NOTES:

1. USE ONLY SECURITY SCREWS WITH THESE PLATES.
2. WHERE NOTED THE CABLES SHALL BE INSTALLED THRU SURFACE RACEWAY.
3. LABEL THE FACEPLATE WITH A LASER PRINTED LABEL

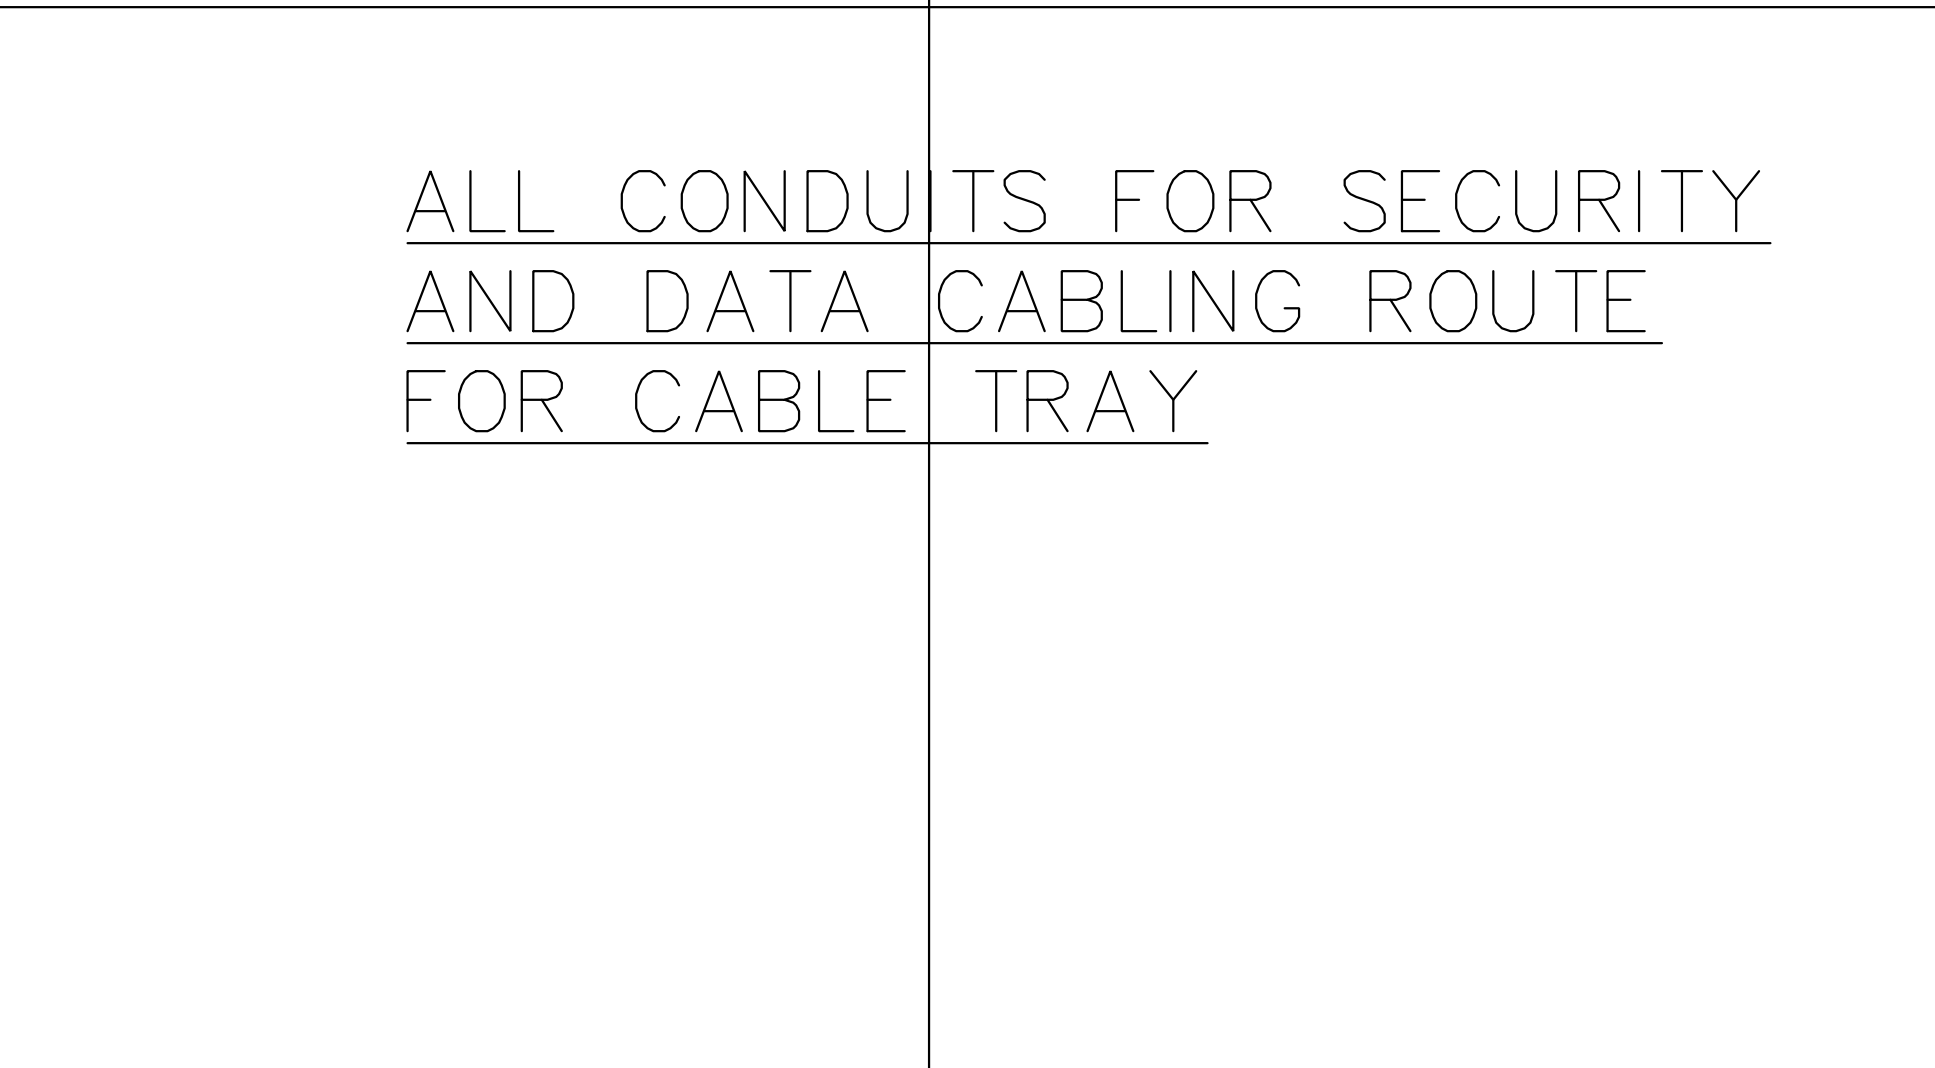


8

QTY	DESCRIPTION	MANUFACTURER	PART #
1	SURFACE BOX	HUBBELL	HSB10W
1	CAT-6 CABLES-YELLOW	MOHAWK	M58283
1	CAT-6 JACK	HUBBELL	HXJ6GN

INSTALLATION NOTES:

1. PROVIDE A SURFACE MOUNT BOX TO THE BUILDING STRUCTURE NEAR THE ACCESS POINT LOCATION.
2. SEE FLOORPLAN FOR LOCATION.
3. SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR TYPE
4. INSTALL A LASER PRINTED CABLE LABEL ON THE CEILING WHERE THE CABLE TERMINATES. THIS WILL ALLOW THE FUTURE USER TO FIND THE CABLE TO EVENTUALLY INSTALL WIRELESS ACCESS POINT.

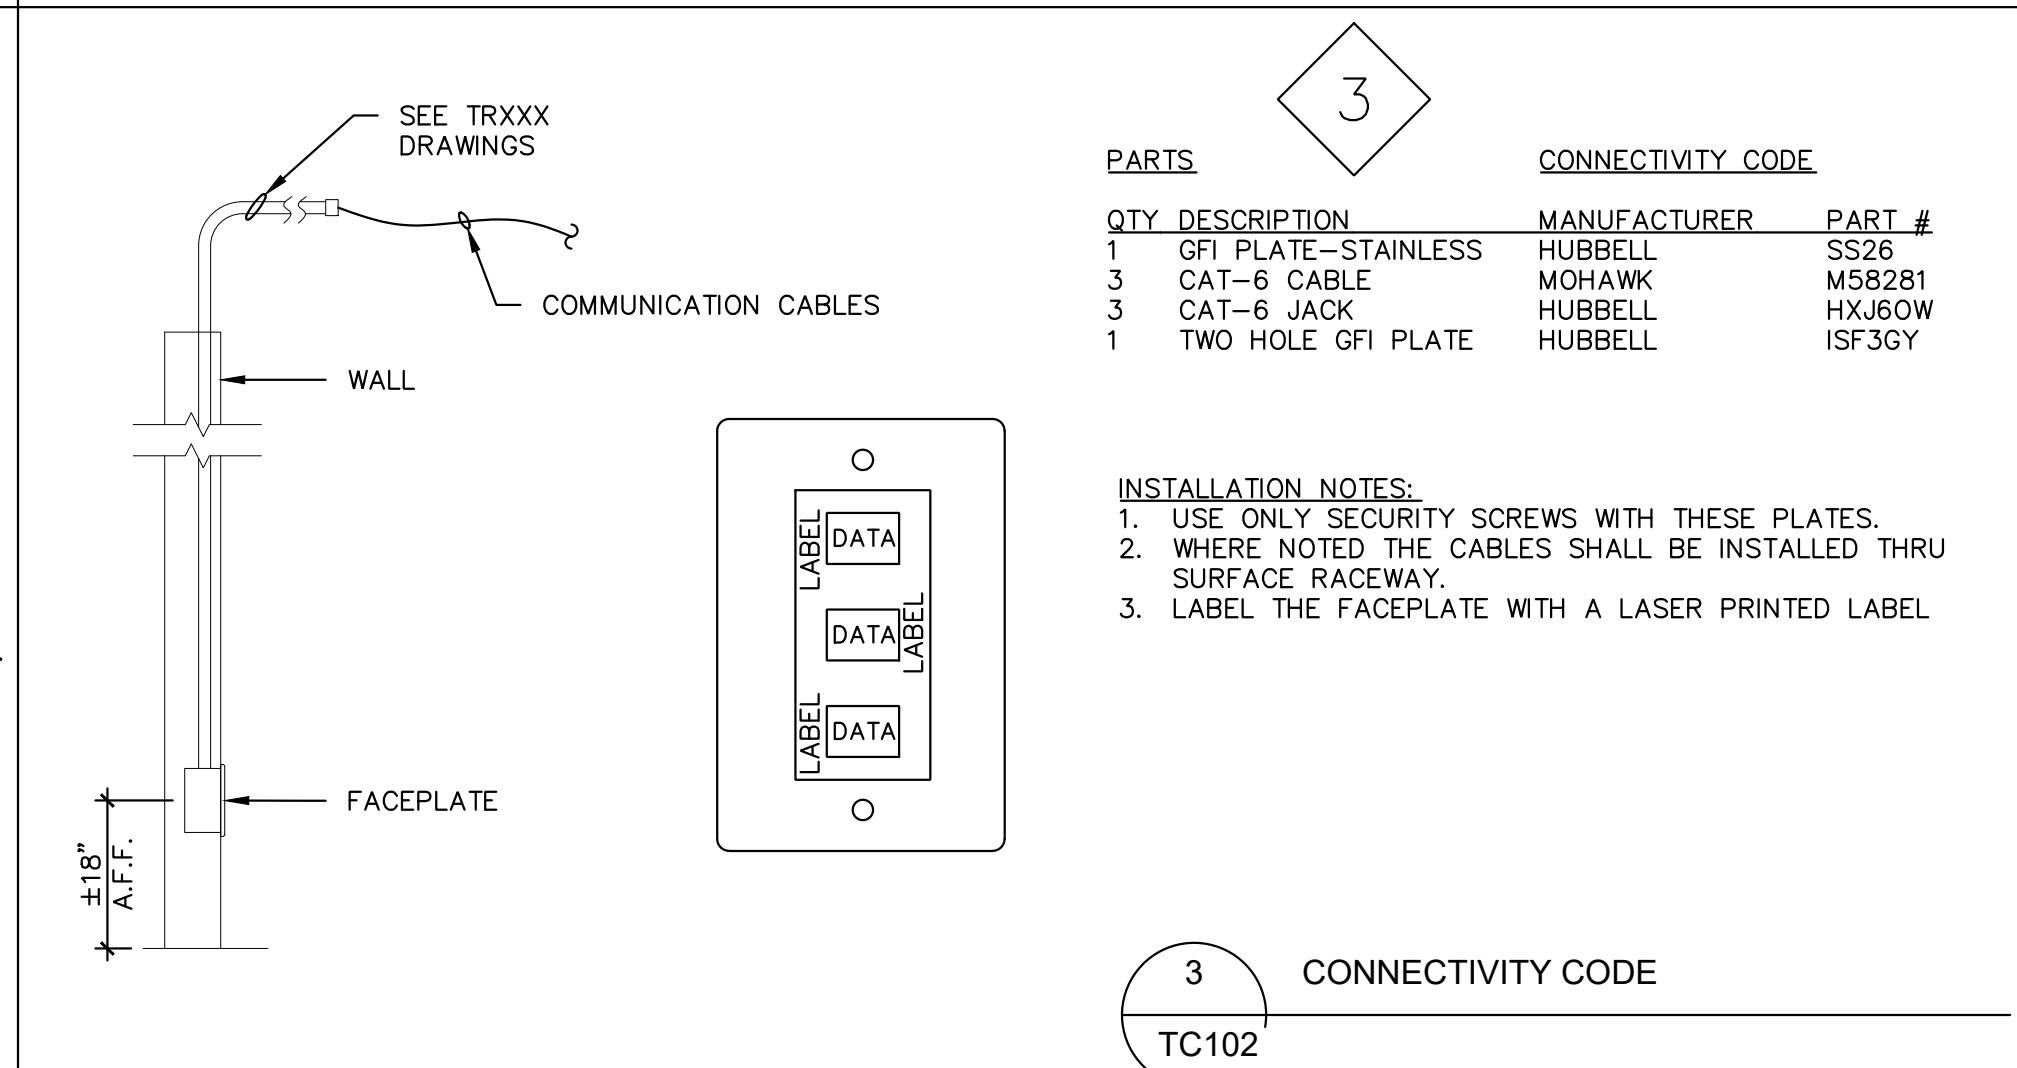


3

QTY	DESCRIPTION	MANUFACTURER	PART #
1	GFI PLATE-STAINLESS	HUBBELL	SS26
1	CAT-6 CABLE	MOHAWK	M58281
3	CAT-6 JACK	HUBBELL	HXJ6GN
1	TWO HOLE GFI PLATE	HUBBELL	ISF3GY

INSTALLATION NOTES:

1. USE ONLY SECURITY SCREWS WITH THESE PLATES.
2. WHERE NOTED THE CABLES SHALL BE INSTALLED THRU SURFACE RACEWAY.
3. LABEL THE FACEPLATE WITH A LASER PRINTED LABEL




9 RACEWAY CODE

QTY	DESCRIPTION	MANUFACTURER	PART #
1	SURFACE BOX	HUBBELL	HSB20W
1	CAT-6 CABLES	MOHAWK	M58281
1	CAT-6 JACK	HUBBELL	HXJ6GN
1	RG-6 COAX	SEE SPECS	SEE SPECS
1	F-PASS THRU	CONTRACTOR	CONTRACTOR

INSTALLATION NOTES:

1. LABEL CABLE AND SURFACE BOX WITH CABLE NUMBER
2. COIL DATA CABLE AND MOUNT SURFACE MOUNT BOX TO SIDE OF THE IN-WALL BACKBOX.

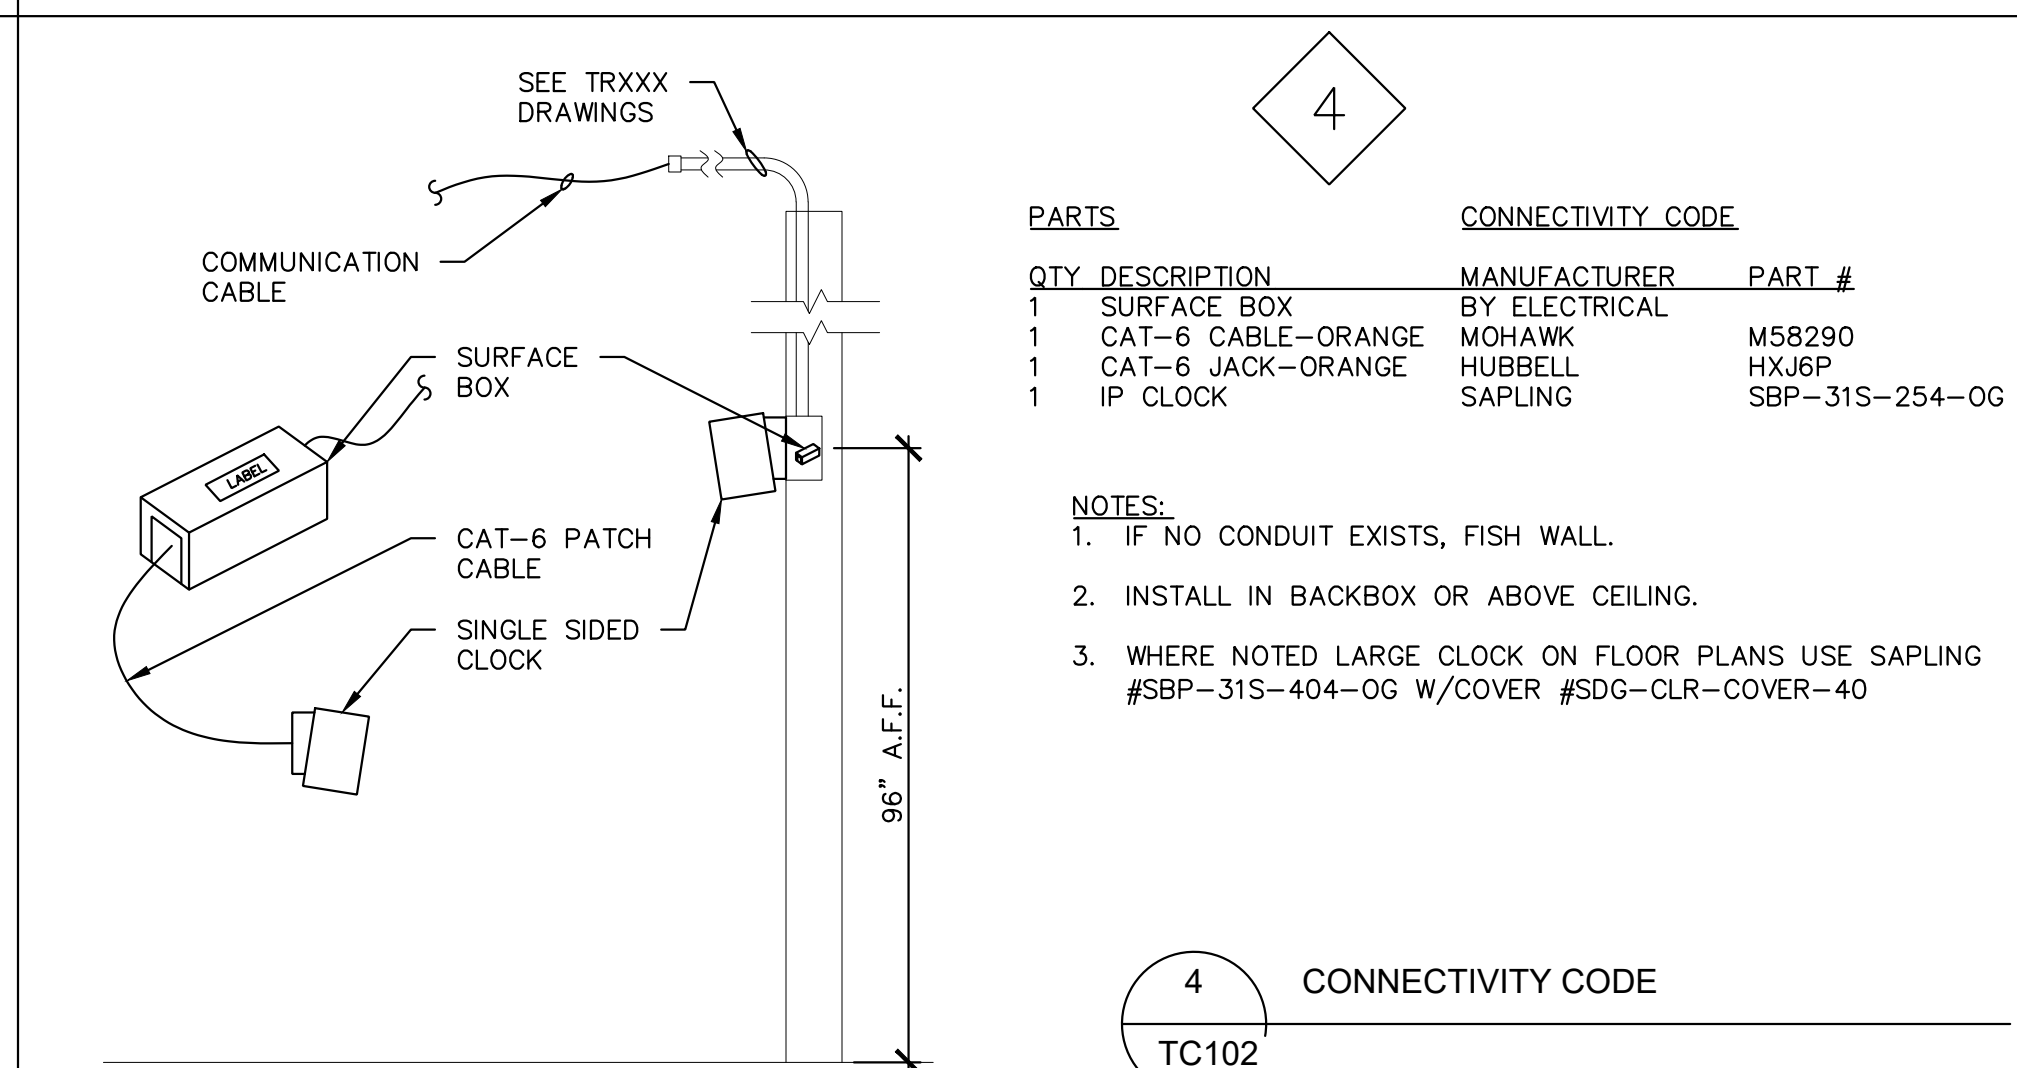

4

QTY	DESCRIPTION	MANUFACTURER	PART #
1	SURFACE BOX	BY ELECTRICAL	
1	CAT-6 CABLE-ORANGE	MOHAWK	M58290
1	CAT-6 JACK-ORANGE	HUBBELL	HXJ6P
1	IP CLOCK	SAPLING	SBP-315-254-0G

NOTES:

1. IF NO CONDUIT EXISTS, FISH WALL.
2. INSTALL IN BACKBOX OR ABOVE CEILING.
3. WHERE NOTED LARGE CLOCK ON FLOOR PLANS USE SAPLING #SBP-315-404-0G W/COVER #SDG-CLR-COVER-40

ALL CONDUITS FOR SECURITY AND DATA CABLING ROUTE FOR CABLE TRAY

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

CommtechDesign
6581 BELDING RD NE STE 101
ROCKFORD, MICHIGAN 49341
WWW.COMMTECHDESIGN.COM

WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN

SALINE, MICHIGAN

SHEET TITLE
CABLING
CONNECTIVITY
CODES

PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
SEPTEMBER 6, 2023

TC102


CHECKED BY
BWE

GENERAL NOTES:

- CABINETS SHALL BE INSTALLED DIRECTLY BESIDE EACH OTHER & MECHANICALLY TO EACH OTHER.
- CABINETS SHALL BE SECURED TO THE FLOOR WITH ANCHORS. WALL MOUNTED CABINETS SHALL BE MOUNTED TO WALL SO TOP OF RACK IS NO HIGHER THAN 7' AFF.
- ALL USER DATA CABLES SHALL ROUTE IN THE CEILING & THEN ROUTE DOWN VERTICAL CABLE LADDER TO THE RACK. AT THE RACK/CABINET, PROVIDE A "DRIP LOOP" FOR ALL THE CABLES DRIP LOOP SHALL BE A MINIMUM OF ONE FOOT.
- CONNECT ALL NEW CABINETS AND CABLE LADDER TO THE GROUND BAR AS DESCRIBED IN THE GROUNDING DETAIL & THE GROUNDING SPECIFICATIONS.

KEYED NOTES:


- ① CONTRACTOR SHALL INSTALL 12" CABLE LADDER VERTICALLY FROM TOP OF CABINET OR RACK TO THE CEILING AREA FOR ROUTING USER CABLES TO THE PANELS.
- INSTALL THE RACK WHERE SHOWN ON THE FLOORPLAN. VERIFY MATCHING PART NUMBERS TO EXISTING RACK PRIOR TO ORDERING. EQUIP THE RACK WITH ADJUSTABLE FEET

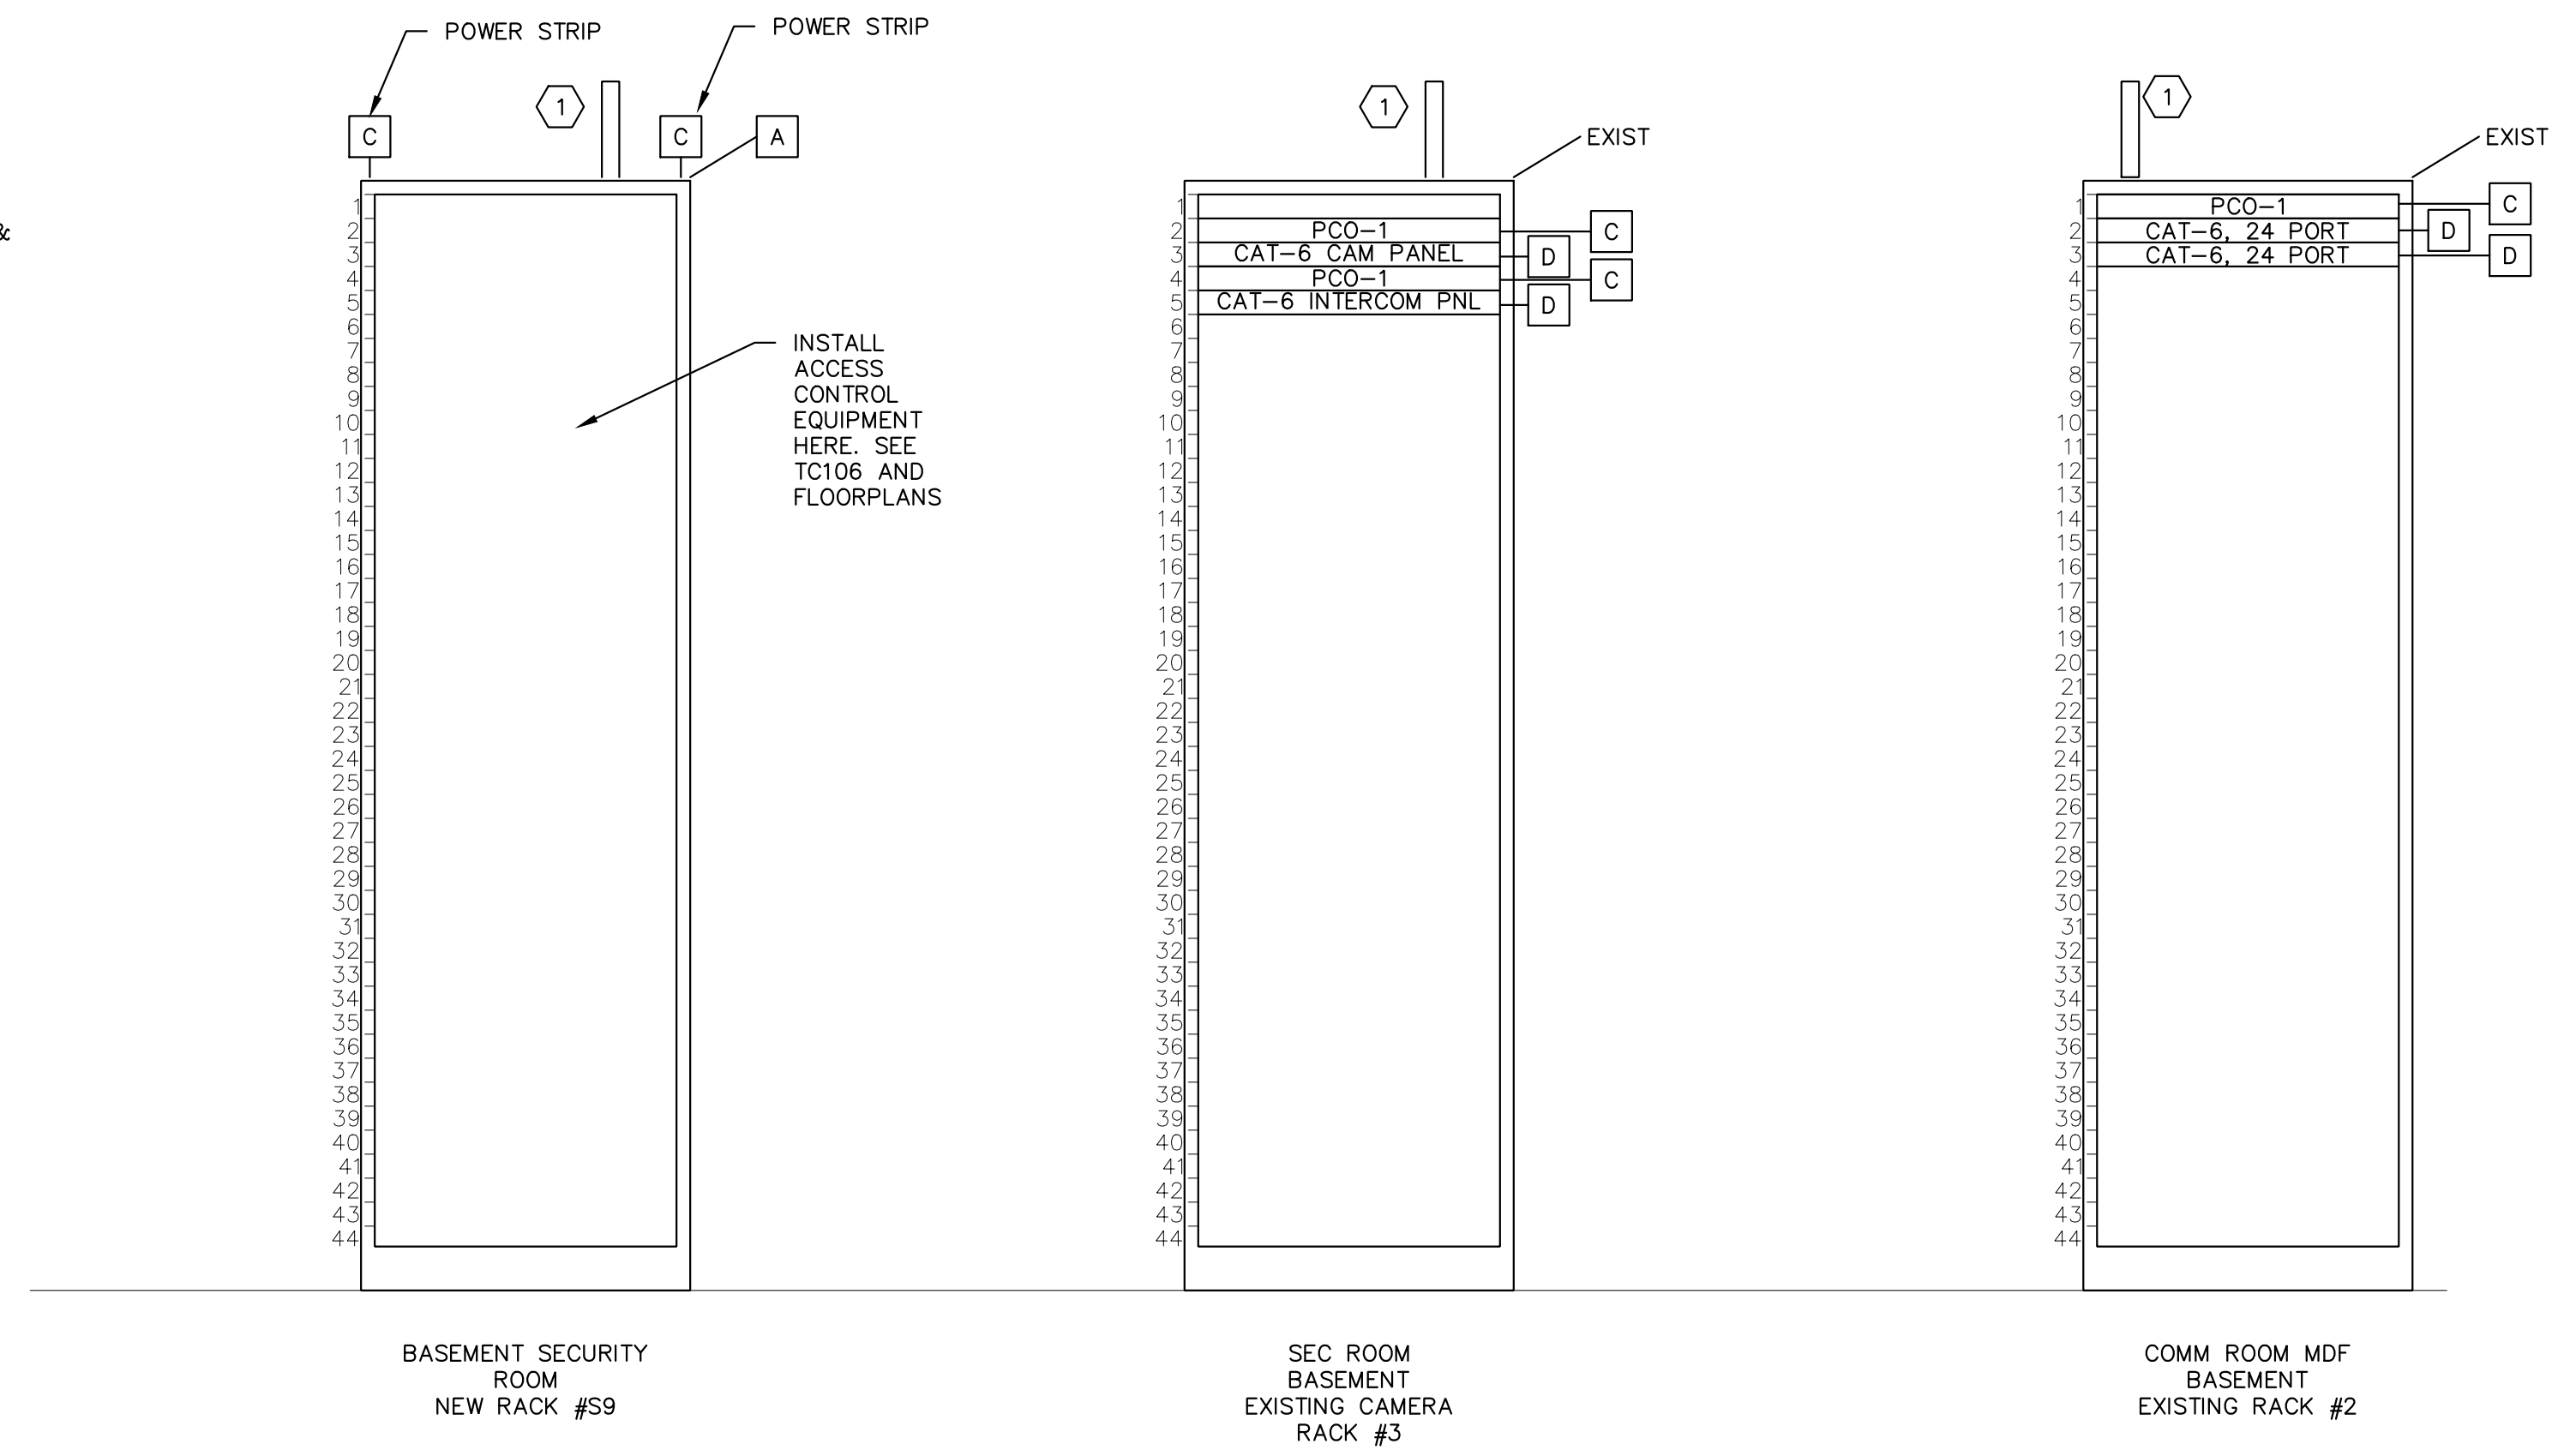

CONTRACTOR SHALL VERIFY EXISTING RACK LAYOUTS AND ADJUST ACCORDINGLY

① MDF ROOM AND SEC ROOM-BASEMENT RACK LAYOUT

TC103

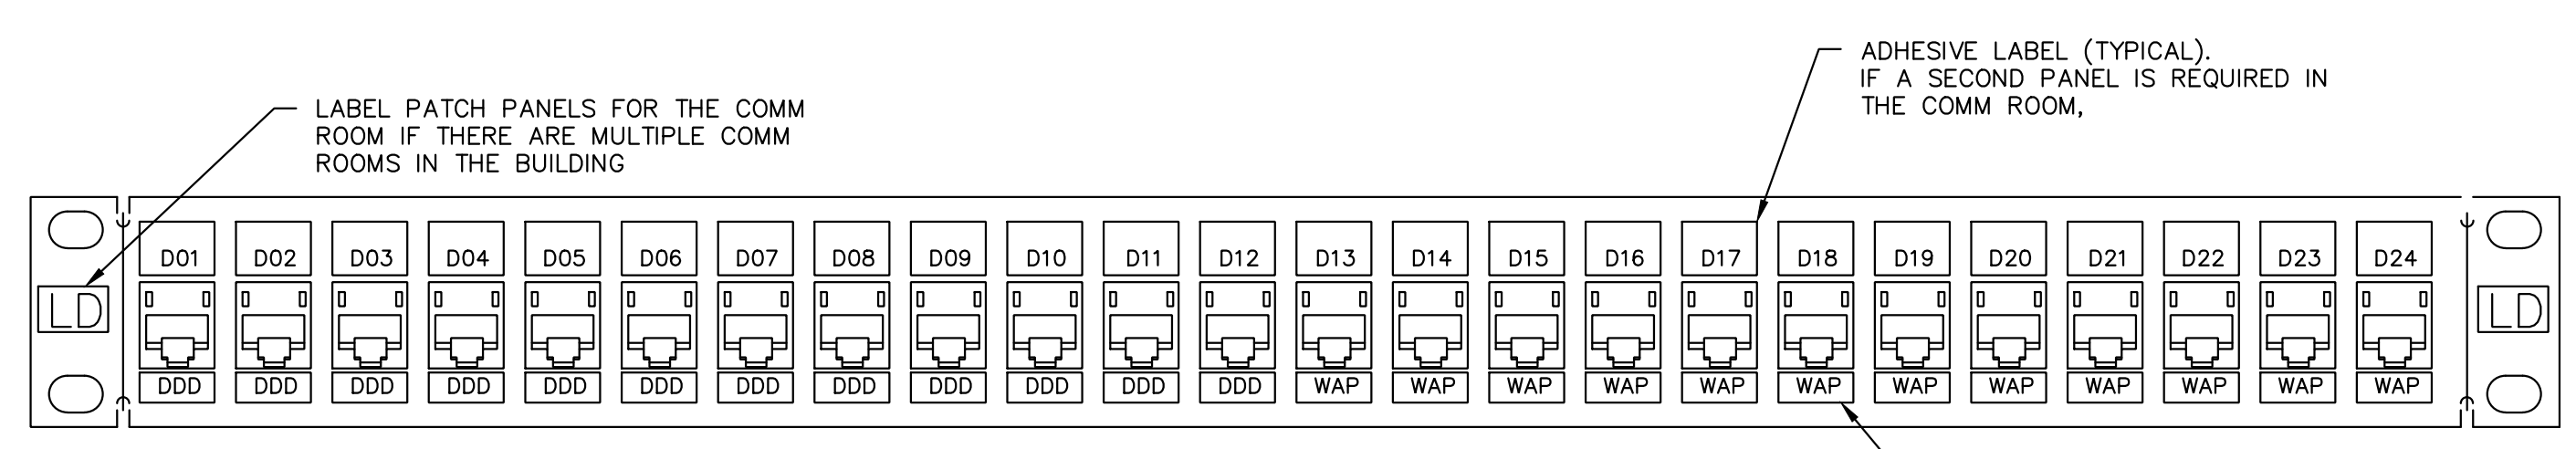

- NOTES:**
- INSTALL A LABEL TO EACH PATCH PANEL DETAILING THE COMM ROOM NUMBER AND PATCH PANEL NUMBER. LABEL EACH PANEL THAT IS FED FROM THAT COMM ROOM CONSECUTIVELY FROM 01-999
 - ALL LABELS ADDED TO THE PANEL SHALL BE LASER PRINTED AND CUT TO FIT. ALL NUMBERS SHALL EXACTLY ALIGN WITH THE LOCATION ON THE PATCH PANEL.
 - THE CABLES SHALL BE TERMINATED ON THE PATCH PANEL IN NUMERICAL ORDER. NO EXCEPTIONS.
 - ADD LABELS FOR CAMERA NUMBERS OR WAP NUMBERS DEPENDING UPON PATCH PANEL. SEE RACK LAYOUTS TO DETERMINE IF CAMERA AND WAP CABLES WILL BE ON SEPARATE OR SHARED PATCHPANELS
 - LABEL ALL PATCH PANEL PORTS EVEN IF NO CABLE IS INSTALLED
 - FILL IN EACH PATCH PANEL WITH CAT-6 MODULAR JACK EVEN IF NO CABLE IS INSTALLED TO THE JACK.

DATA CABLE LABELING A-Y-CC

LD = COMM ROOM DESIGNATION. ONLY USE THIS IF THERE ARE MULTIPLE COMM ROOMS IN THE BUILDING


DXX = DATA CABLE. 01-999. NUMBER PATCH PANELS IN EACH COMM ROOM AND THEN NUMBER CABLE AT PLATE CORRESPONDINGLY

DDD = CAMERA NUMBER. MEET WITH OWNER AND SECURITY CONTRACTOR TO OBTAIN THIS NUMBER

WAP = WAP NUMBER. MEET WITH OWNER TO OBTAIN THIS NUMBER

⑤ CAMERA OR WIRELESS PANEL LABELING

TC103

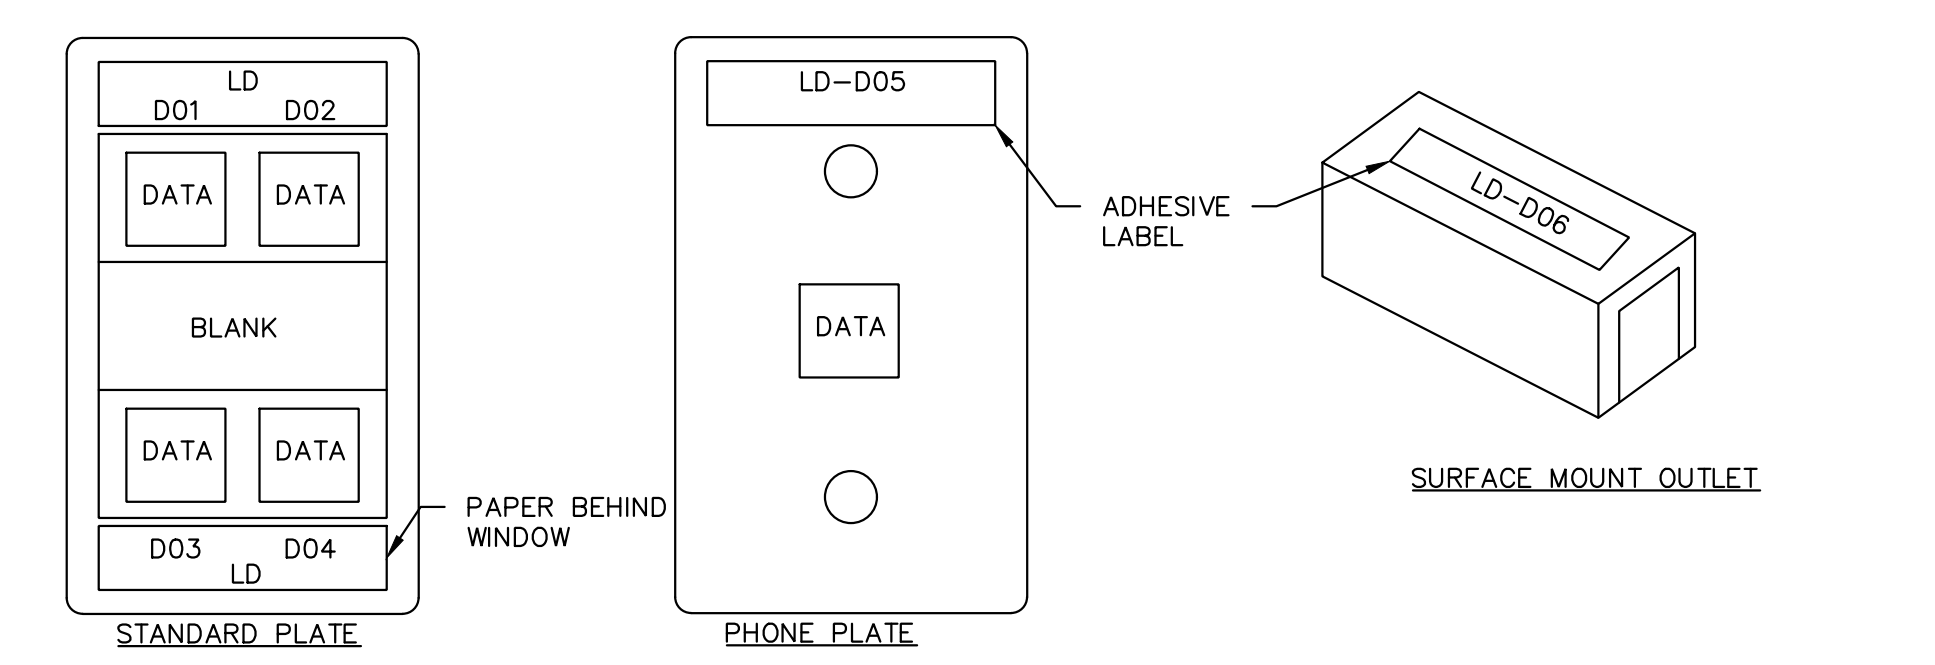

DATA CABLE LABEL:


LD = COMM ROOM DESIGNATION. ONLY USE THIS IF THERE ARE MULTIPLE COMM ROOMS IN EACH BUILDING

DXX = DATA CABLE. 01-999. NUMBER PATCH PANELS IN EACH COMM ROOM AND THEN NUMBER CABLE AT PLATE CORRESPONDINGLY

- NOTES:**
- INSTALL A PAPER LABEL BEHIND THE PLASTIC WINDOW IN STANDARD PLATES THAT ARE EQUIPPED WITH THE WINDOWS.
 - PROVIDE ADHESIVE LABELS ON WALL PHONE PLATES & SURFACE MOUNT OUTLETS & PLATES WITHOUT LABELING WINDOWS.

② TYPICAL FACEPLATE LABELING

TC103

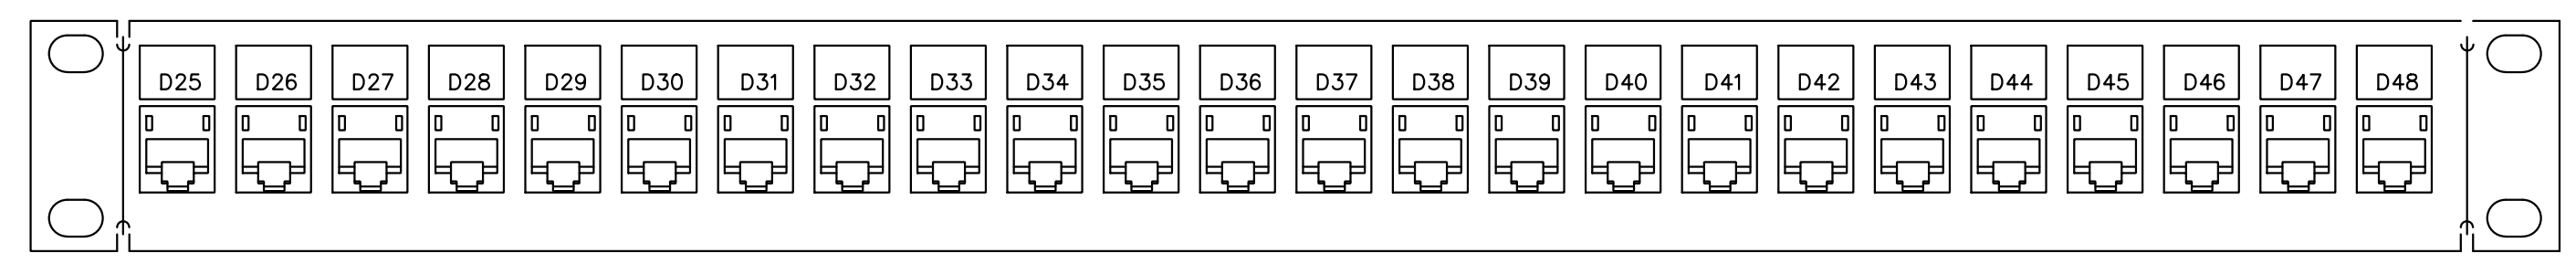

- NOTES:**
- INSTALL A LABEL TO EACH PATCH PANEL DETAILING THE COMM ROOM NUMBER AND PATCH PANEL NUMBER. LABEL EACH PANEL THAT IS FED FROM THAT COMM ROOM CONSECUTIVELY FROM 01-999
 - ALL LABELS ADDED TO THE PANEL SHALL BE LASER PRINTED AND CUT TO FIT. ALL NUMBERS SHALL EXACTLY ALIGN WITH THE LOCATION ON THE PATCH PANEL.
 - THE CONTRACTOR SHALL INSTALL A LABEL FOR EACH PORT.
 - INDIVIDUAL CABLES AT A SINGLE FACEPLATE SHALL BE LABELED IN SEQUENCE AS PER THE PATCH PANEL.
 - THE CABLES SHALL BE TERMINATED ON THE PATCH PANEL IN NUMERICAL ORDER. NO EXCEPTIONS.
 - LABEL ALL PATCH PANEL PORTS EVEN IF NO CABLE IS INSTALLED
 - FILL IN EACH PATCH PANEL WITH CAT-6 MODULAR JACK EVEN IF NO CABLE IS INSTALLED TO THE JACK.


DATA CABLE LABEL:

LD = COMM ROOM DESIGNATION. ONLY USE THIS IF THERE ARE MULTIPLE COMM ROOMS IN THE BUILDING

DXX = DATA CABLE. 01-999. NUMBER PATCH PANELS IN EACH COMM ROOM AND THEN NUMBER CABLE AT PLATE CORRESPONDINGLY

⑥ CAT-6 DATA PANEL LABELING

TC103

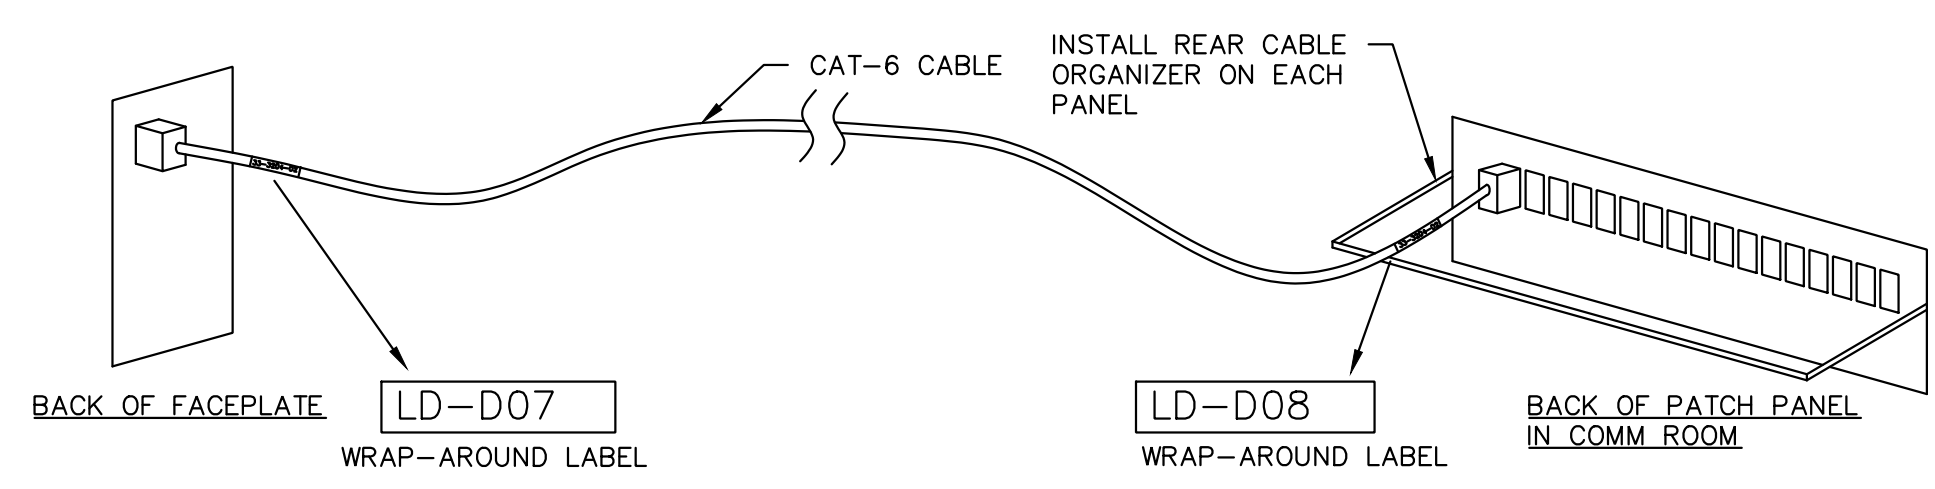

- NOTES:**
- INSTALL A WRAP-AROUND LABEL AT EACH END OF EACH CABLE.
 - WRAP-AROUND LABELS SHALL BE LASER-PRINTED AND SHALL BE SELF-LAMINATING.


DATA CABLE LABEL:

LD = COMM ROOM DESIGNATION. ONLY USE THIS IF THERE ARE MULTIPLE COMM ROOMS IN EACH BUILDING

DXX = DATA CABLE. 01-999. NUMBER PATCH PANELS IN EACH COMM ROOM AND THEN NUMBER CABLE AT PLATE CORRESPONDINGLY

③ TYPICAL CABLE LABELING AT FACEPLATE & PATCH PANEL


TC103

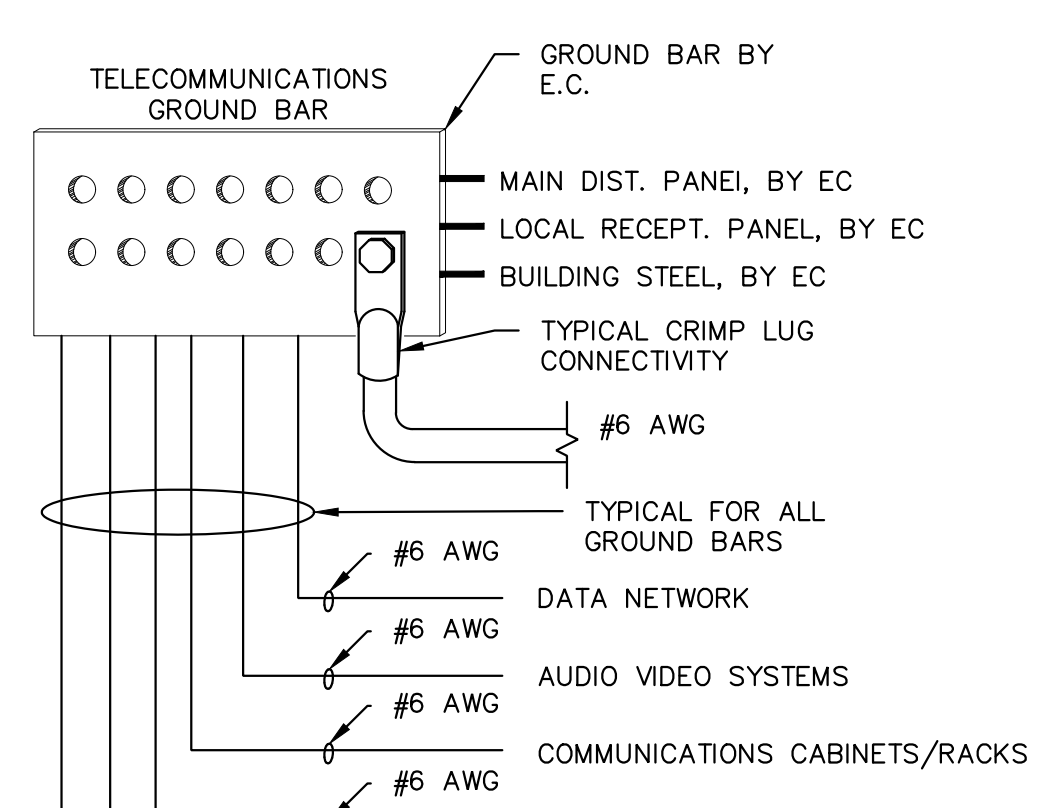

- GROUNDING NOTES:**
- CONNECTIONS TO ALL NEW COMMUNICATIONS EQUIPMENT & PANELS.
 - CONNECT GROUND BAR TO ALL ITEMS SHOWN & AS DIRECTED IN THE GROUNDING SPECIFICATIONS.
 - ALL GROUND CONNECTIONS SHALL BE MADE WITH CRIMP LUGS ONLY. THIS APPLIES TO ALL CONNECTIONS TO THE GROUND BAR & THE CONNECTIONS TO THE ASSOCIATED EQUIPMENT.
 - GROUND CONNECTIONS SHALL BE MADE WITH A MINIMUM OF #6 AWG CABLE.
 - ALL CONNECTIONS TO THE GROUND BAR SHALL BE MADE WITH PHOSPHOR BRONZE BOLTS & NUTS.
 - ALL GROUND WIRES SHALL HAVE GREEN INSULATION UNLESS INSTALLED IN A PLENUM AREA. GROUND CABLES THAT MUST BE INSTALLED IN A PLENUM AREA SHALL BE BARE COPPER WIRE WITH GREEN TAPE AT ENDS.

⑦ COMMUNICATIONS GROUNDING DETAIL

TC103

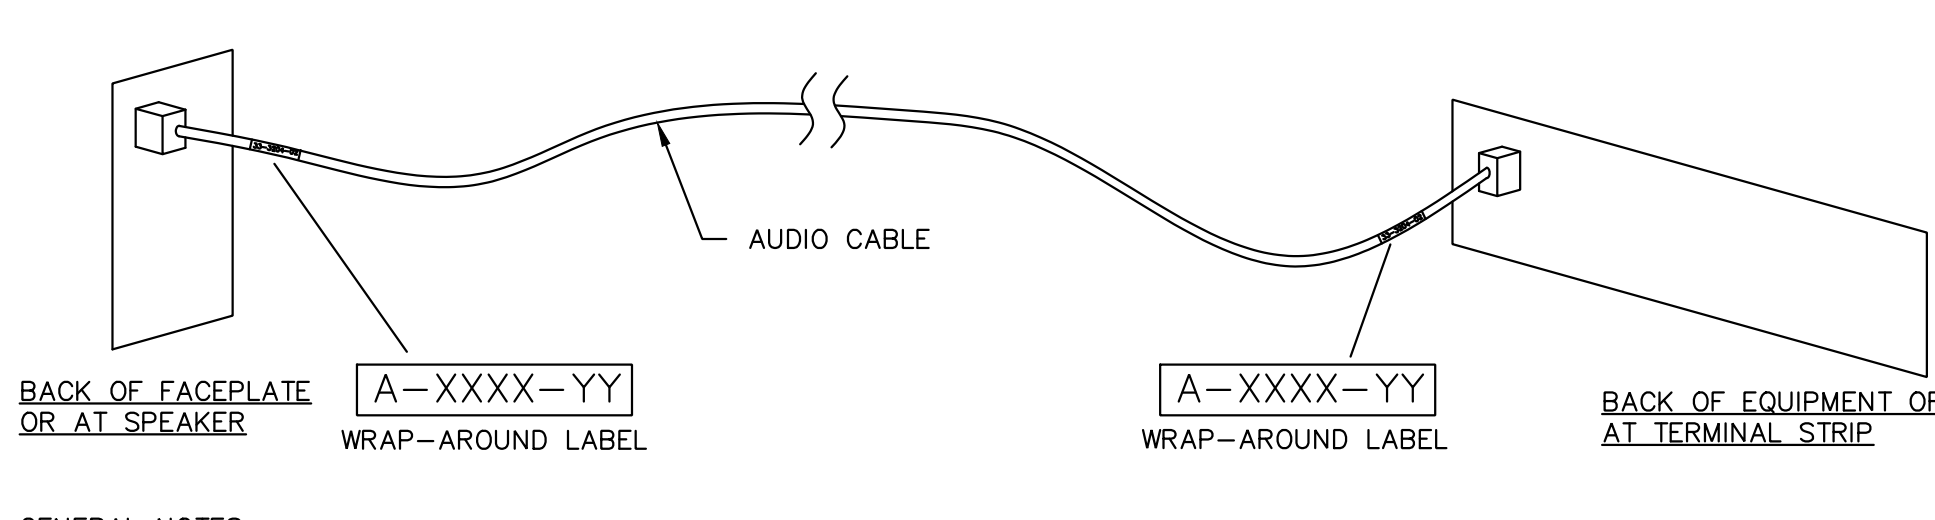

- GENERAL NOTES:**
- INSTALL A WRAP-AROUND LABEL AT EACH END OF EACH CABLE.
 - WRAP-AROUND LABELS SHALL BE LASER-PRINTED AND SHALL BE SELF-LAMINATING.

A = AUDIO/VIDEO CABINET
 XXXX = SPK FOR SPEAKER LINE
 XXXX = LINE FOR LINE LEVEL
 XXXX = MIC FOR MICROPHONE
 XXXX = CTRL FOR CONTROL LINE
 YY = AUDIO ZONE FOR SPEAKER
 YY = FACEPLATE NUMBER FOR LINE AND MIC

④ TYPICAL CABLE LABELING FOR AUDIO CABLES

TC103

NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

CommtechDesign
 6581 BELDING RD NE STE 101
 ROCKFORD, MICHIGAN 49341
 WWW.COMMTECHDESIGN.COM





WTA ARCHITECTS
 100 S. Jefferson Ave. Suite 601
 Saginaw, Michigan 48607
 989 752 8107
 COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN


SALINE, MICHIGAN

CABLING RACK LAYOUTS & DETAILS

PROJECT NUMBER 2021094	SHEET NUMBER TC103
PROJECT DATE SEPTEMBER 6, 2023	
CHECKED BY BWE	

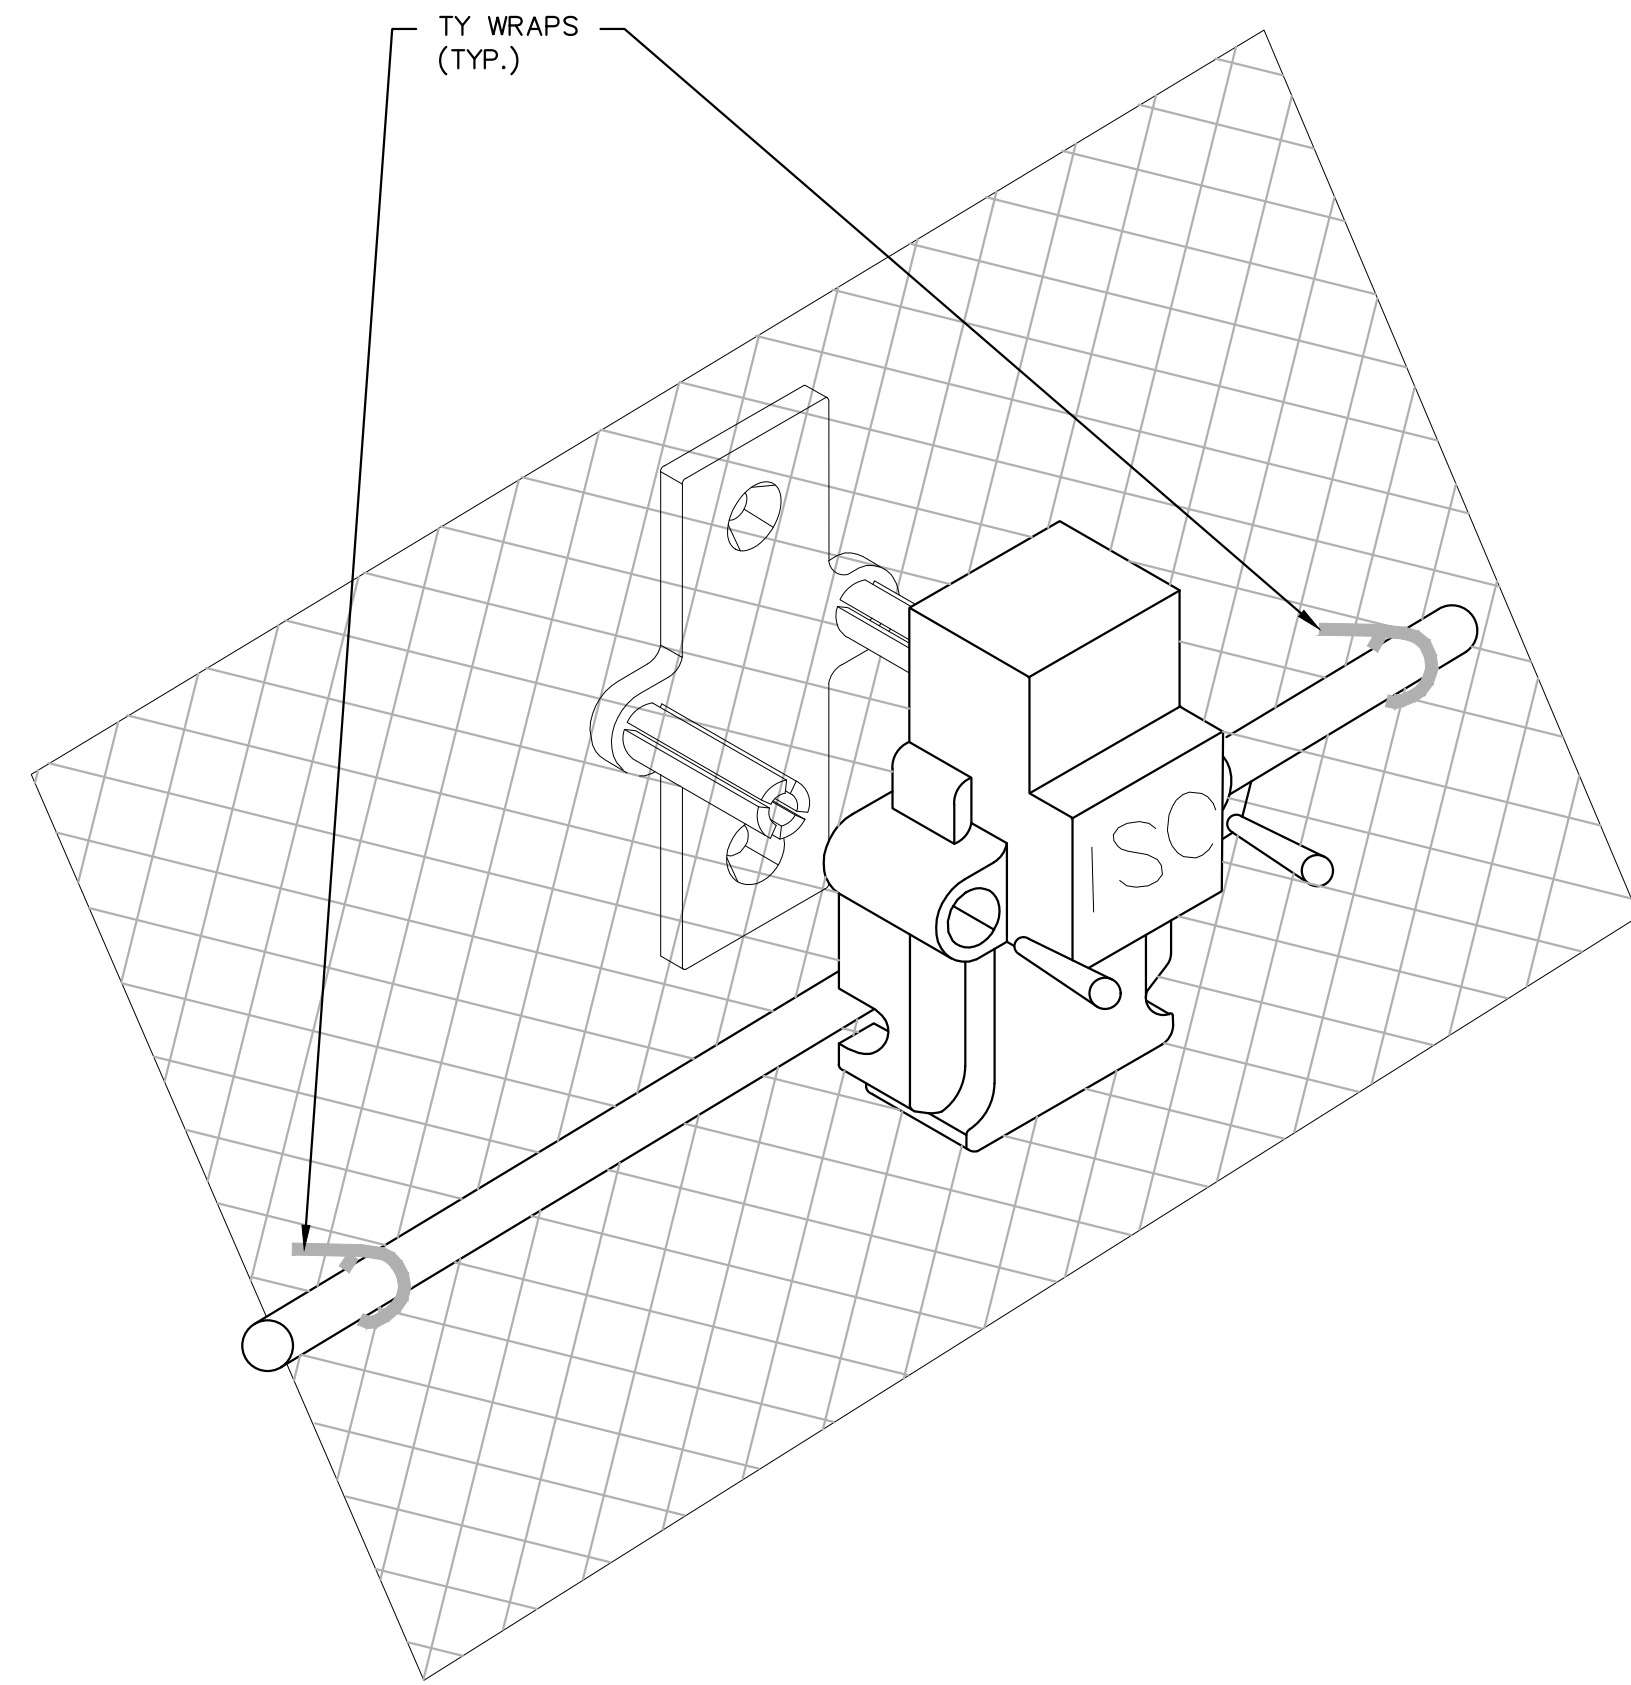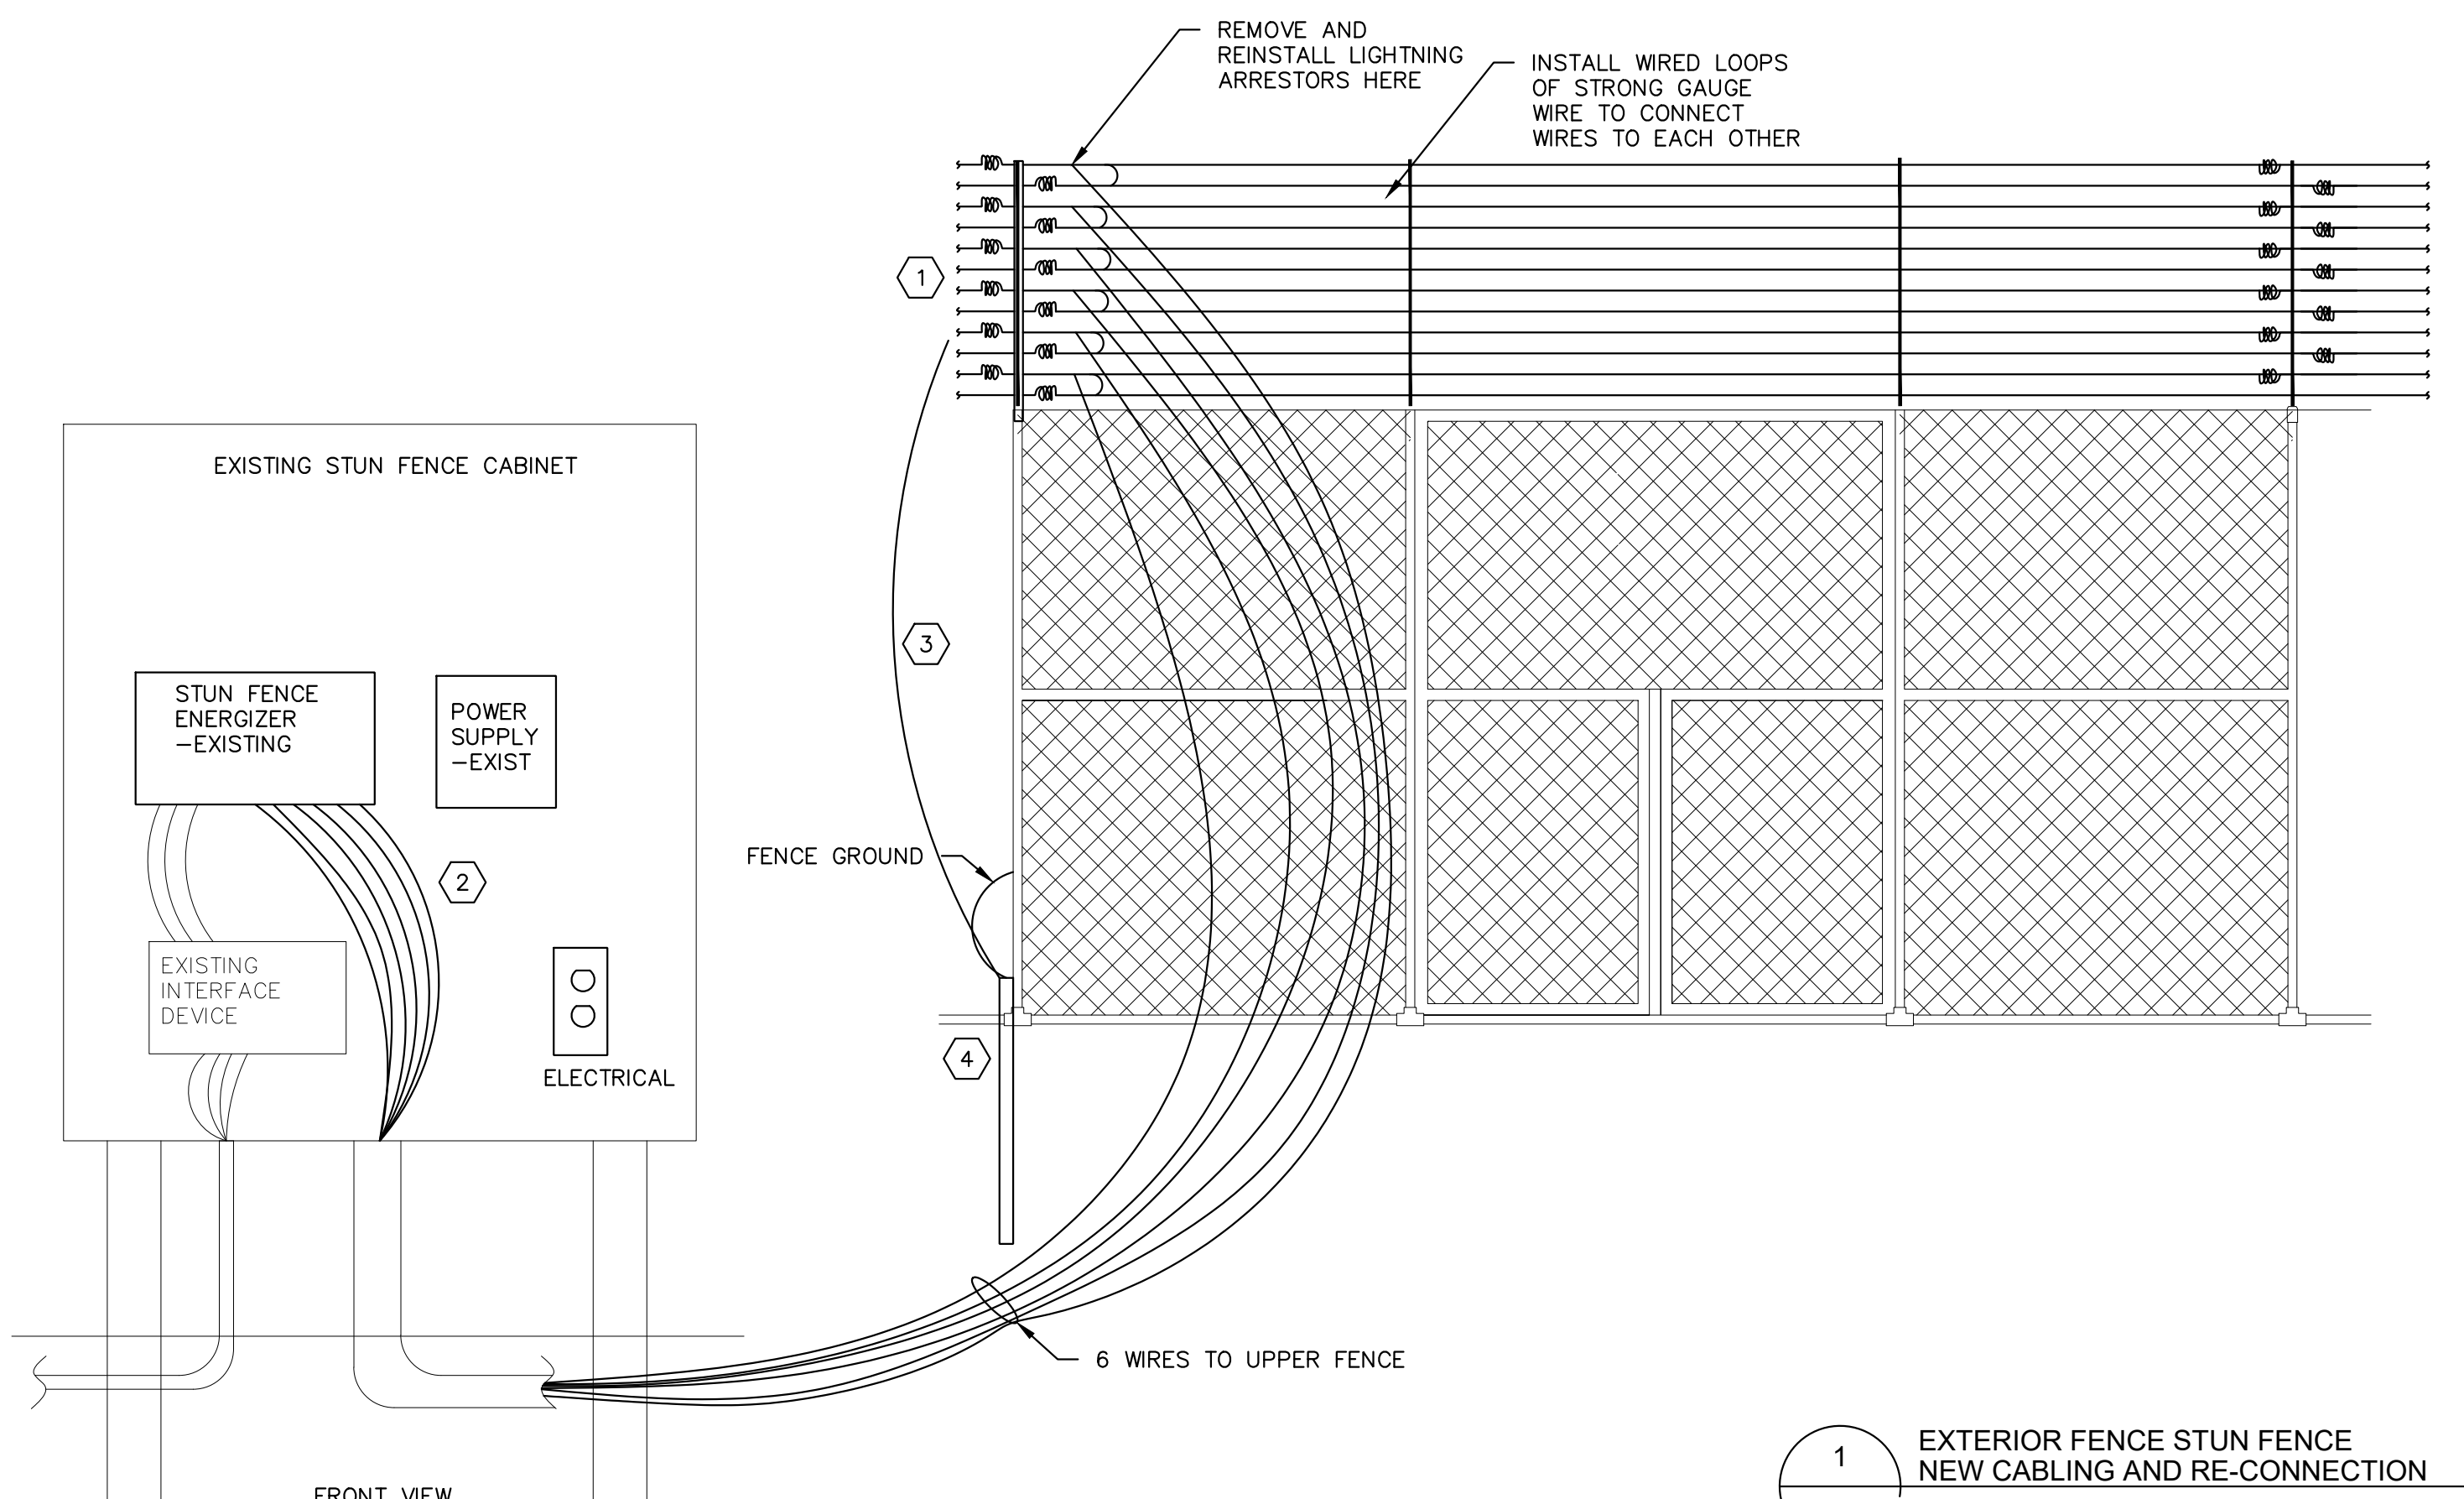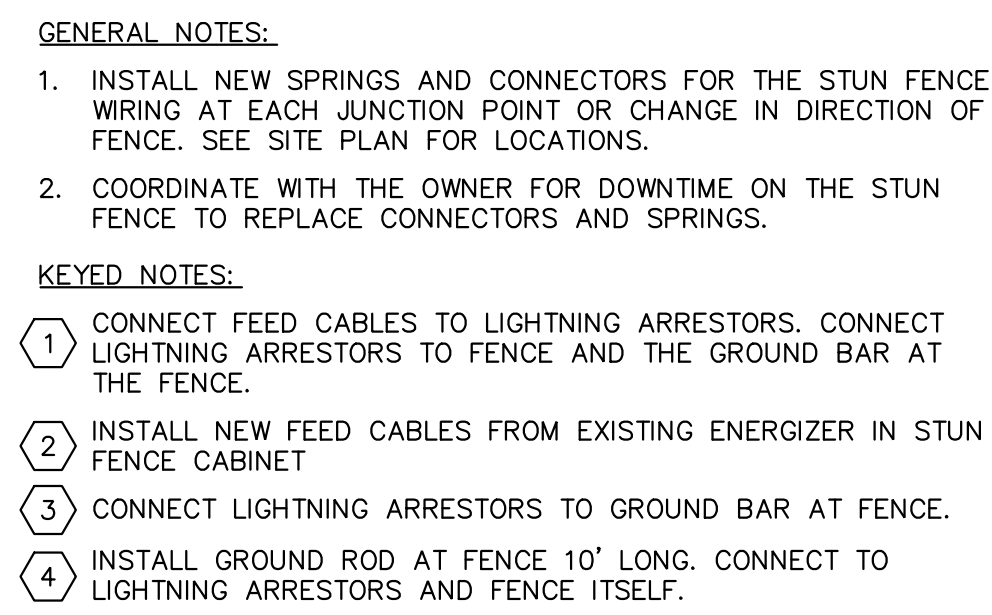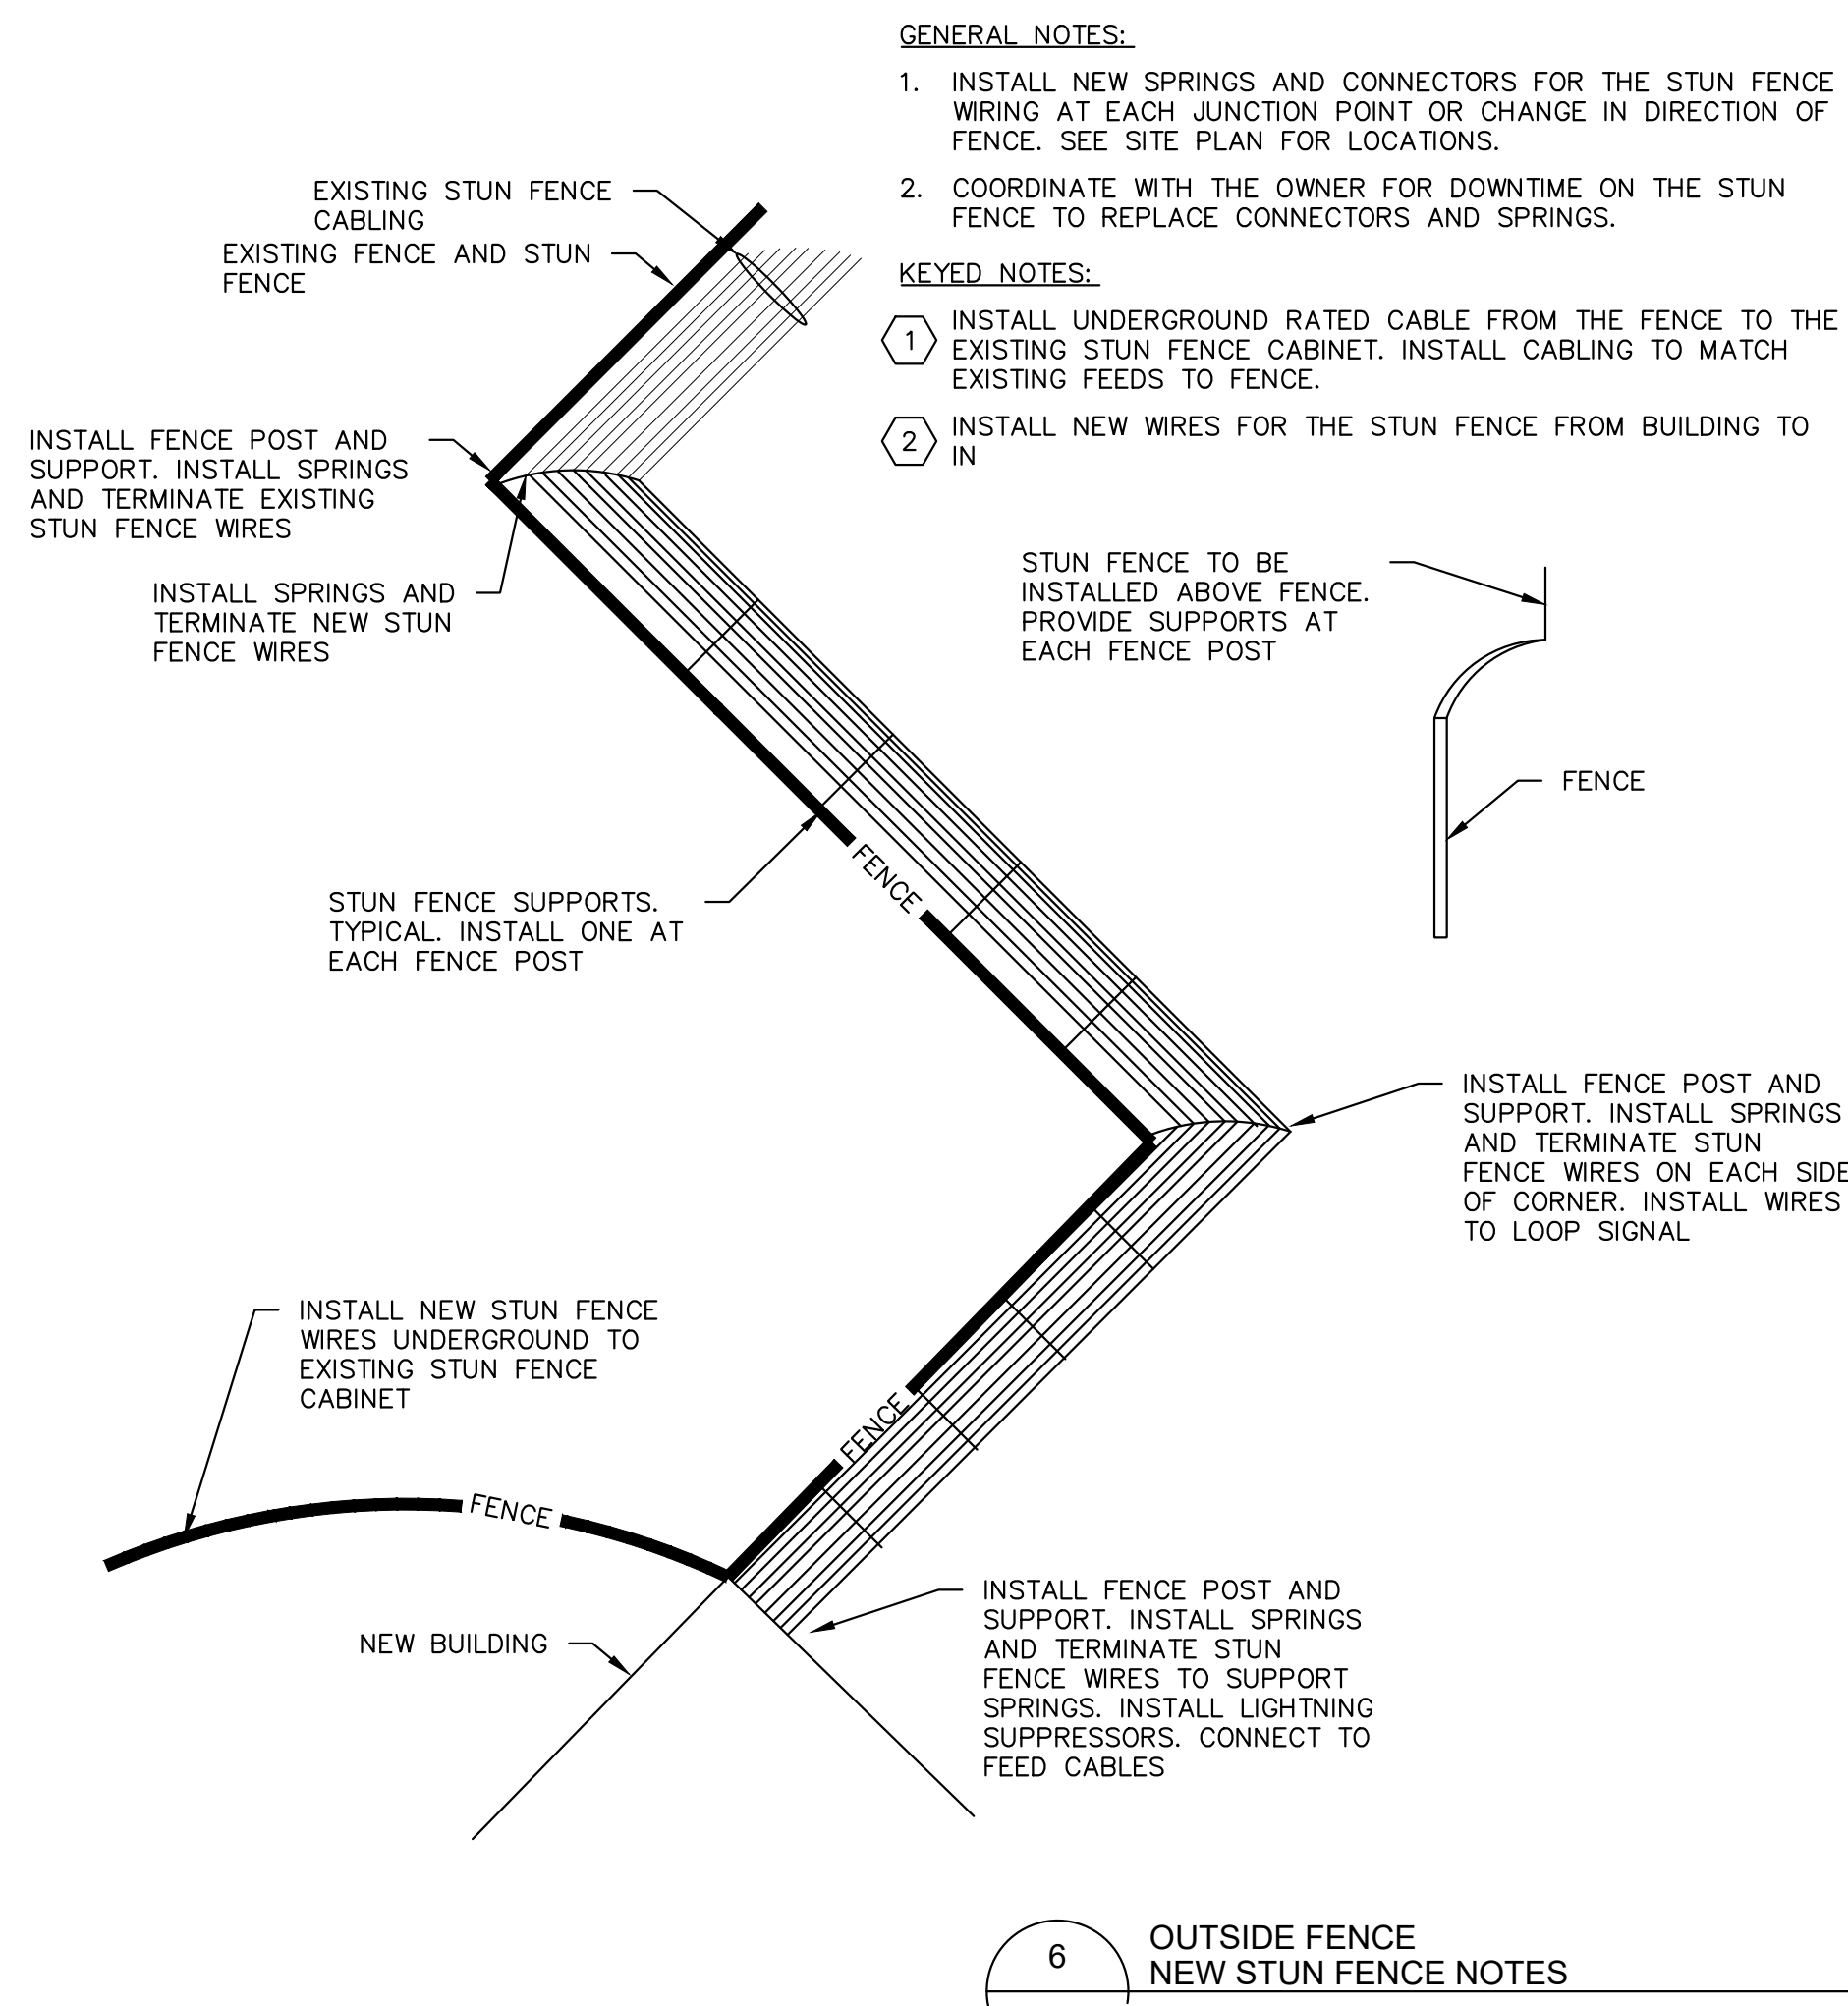


4 OUTSIDE FENCE TYPICAL ISC SENSOR MOUNTING DETAIL
TC104

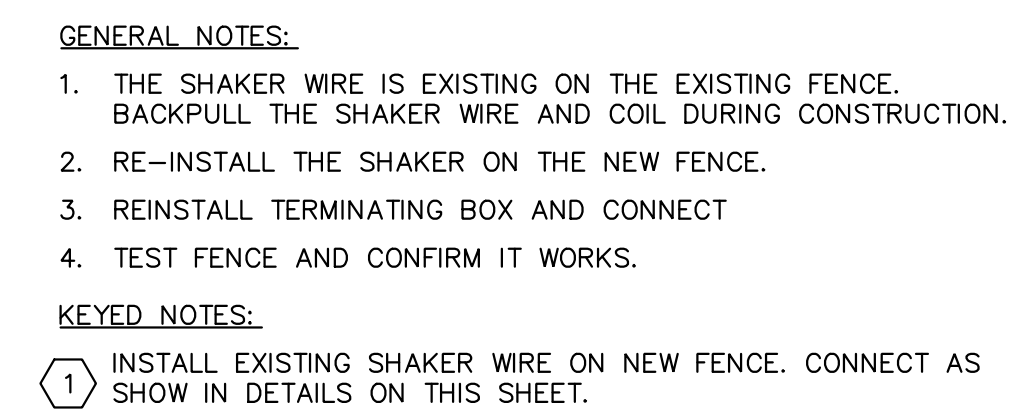


2 OUTSIDE FENCE TYPICAL SENSOR CABLE DETAIL
TC104

NOTE:

1. TIE SENSOR COIL TO THE FENCE AND OTHER WIRES.

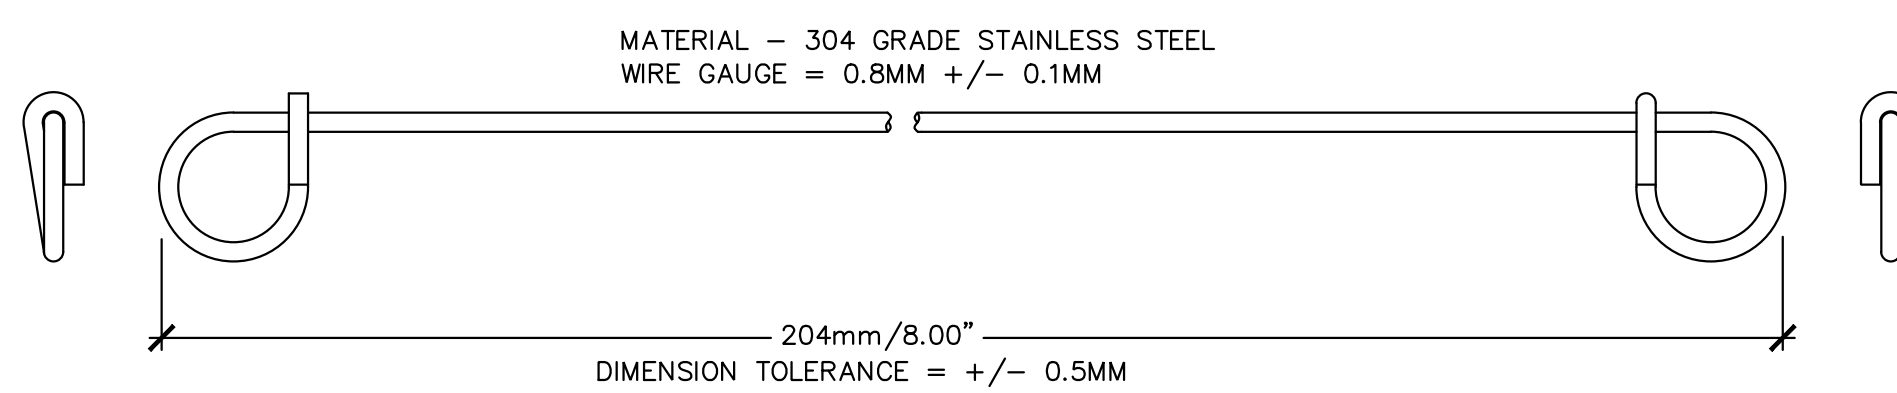

5 STAINLESS STEEL (SST) WIRE TIE DETAIL
TC104

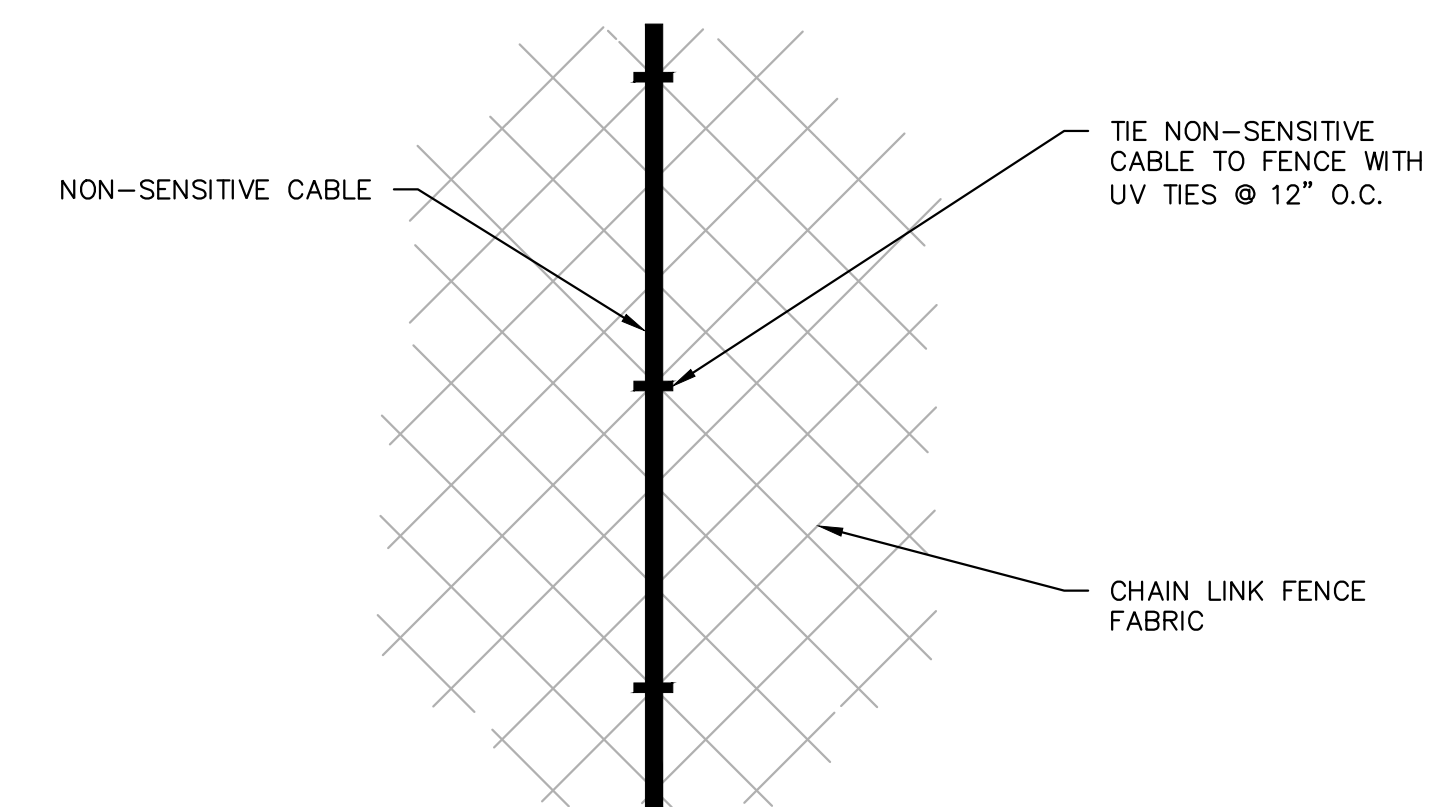

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

CommtechDesign
6581 BELDING RD NE STE 101
ROCKFORD, MICHIGAN 49341
WWW.COMMTECHDESIGN.COM

WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN






SHEET TITLE
FENCE DETECTION
DETAILS

PROJECT NUMBER
2021094

SHEET NUMBER
TC104

PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
BWE

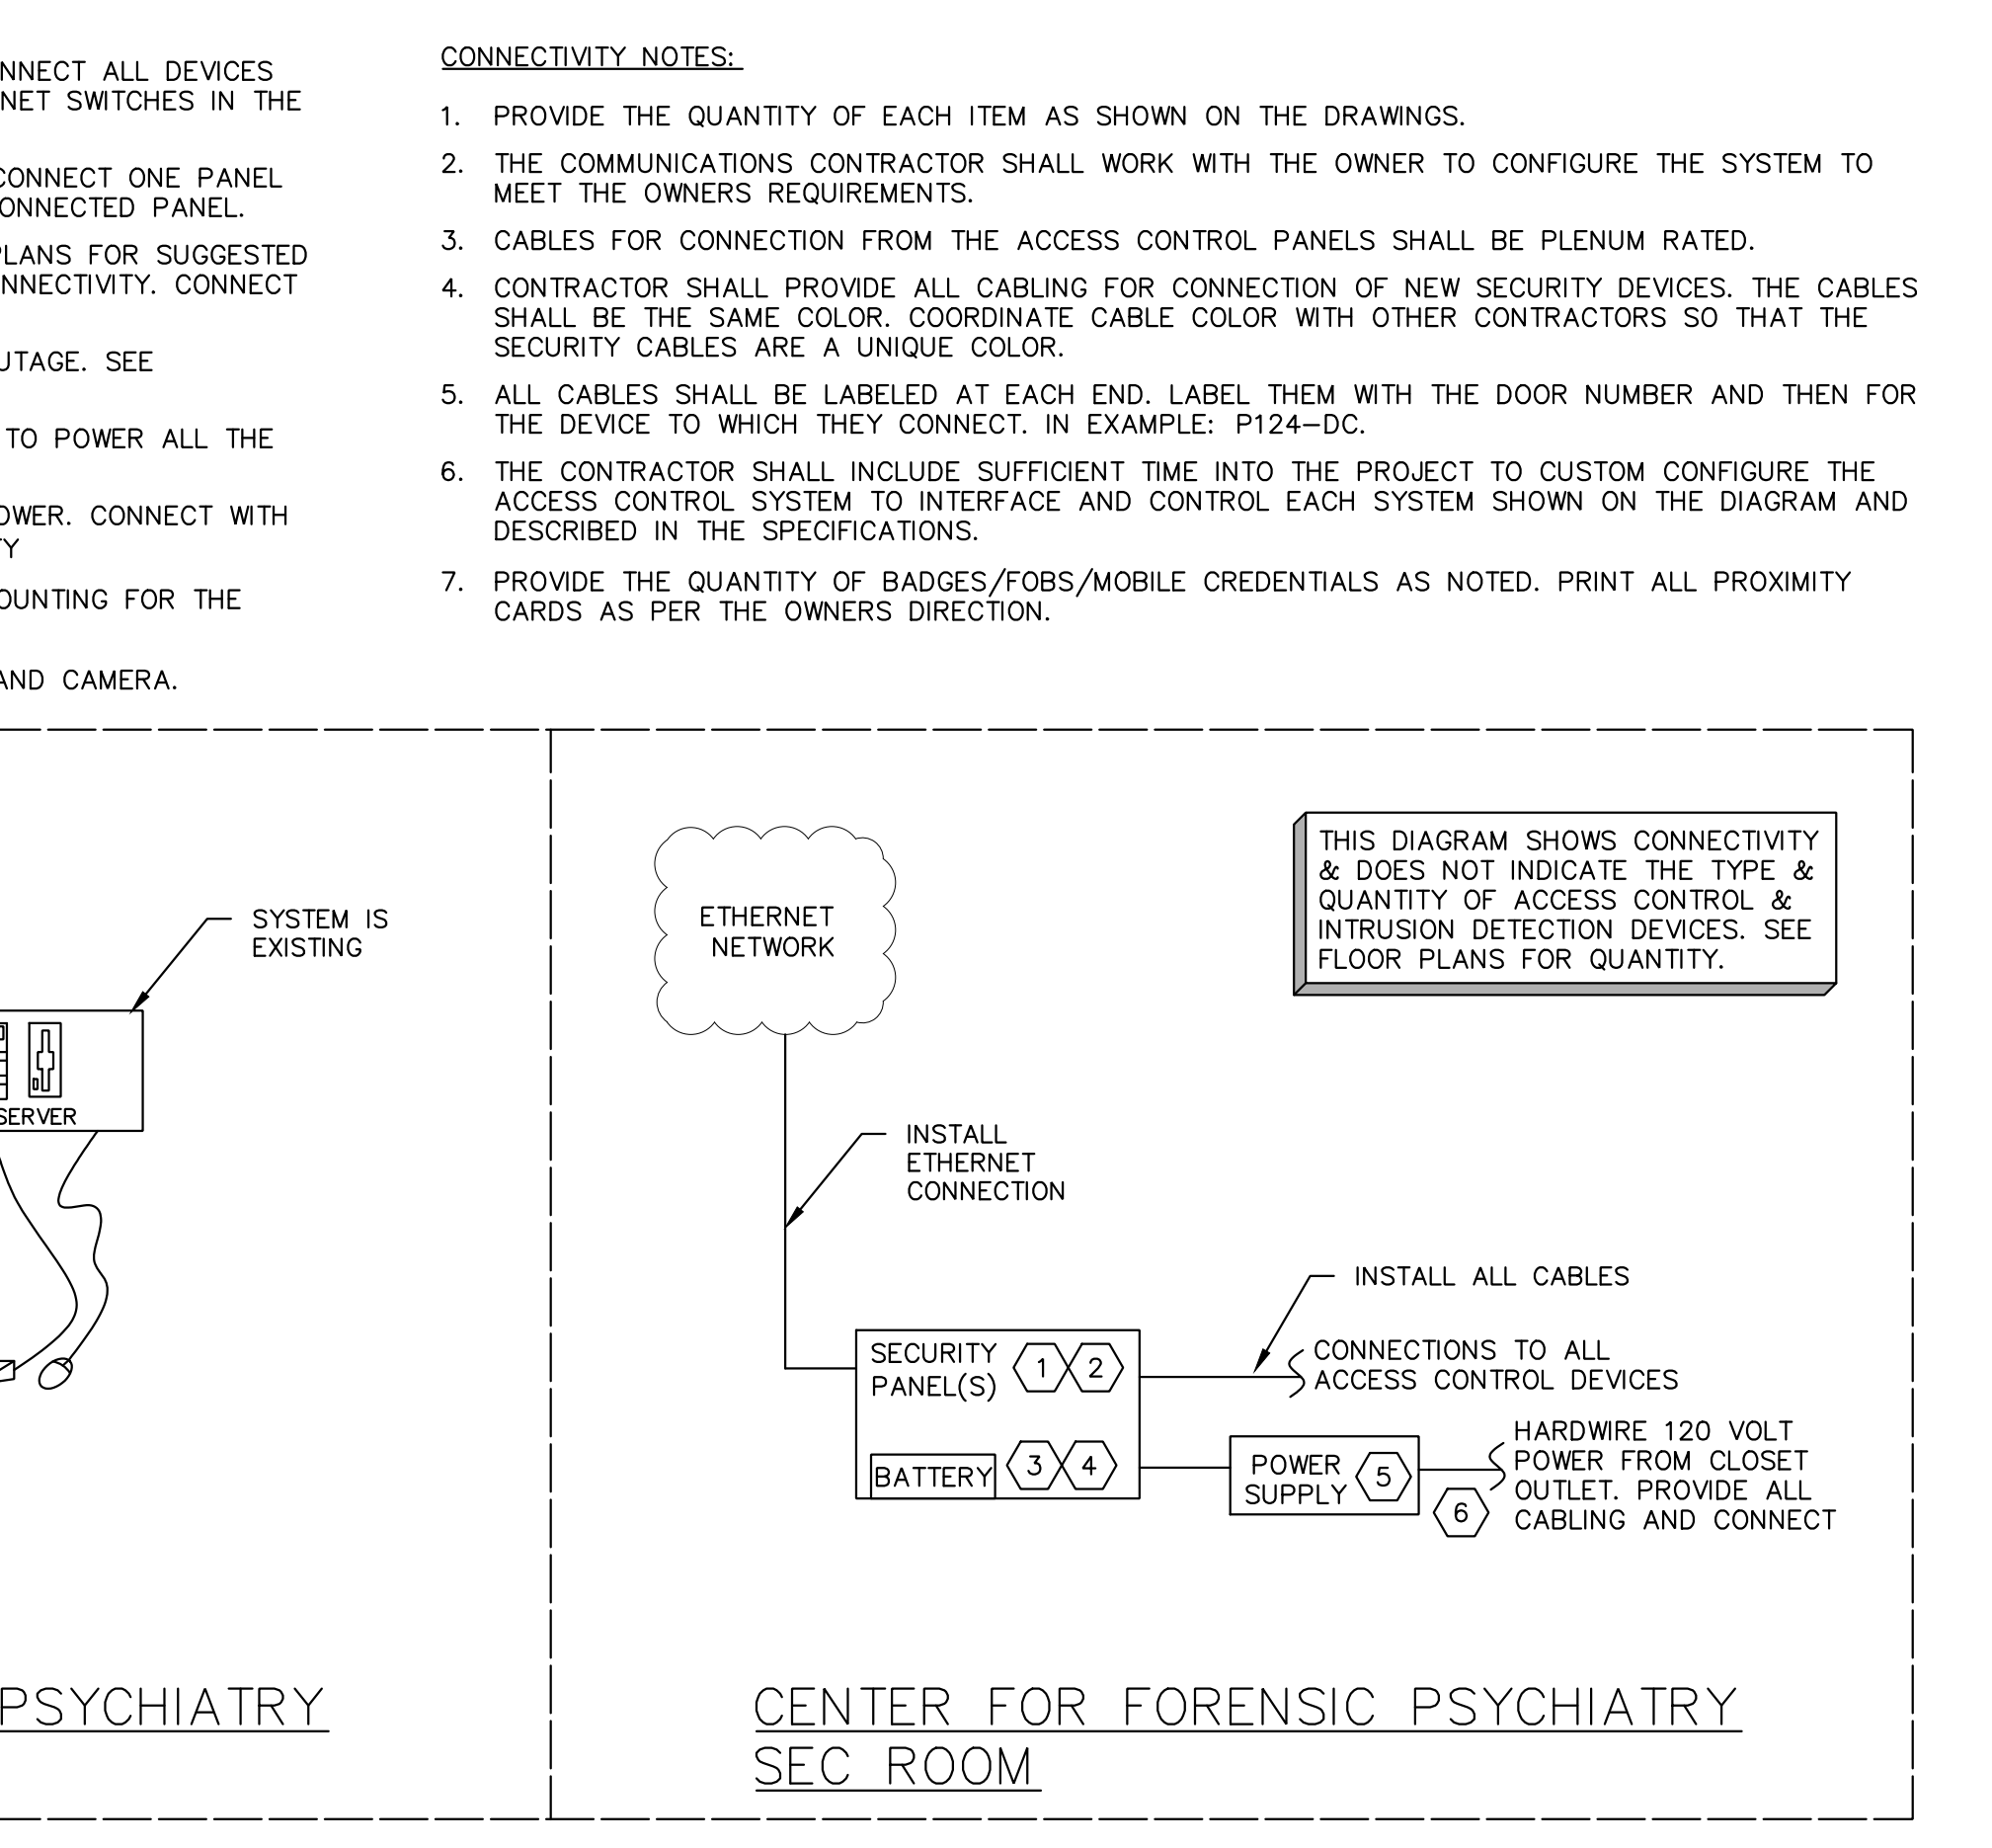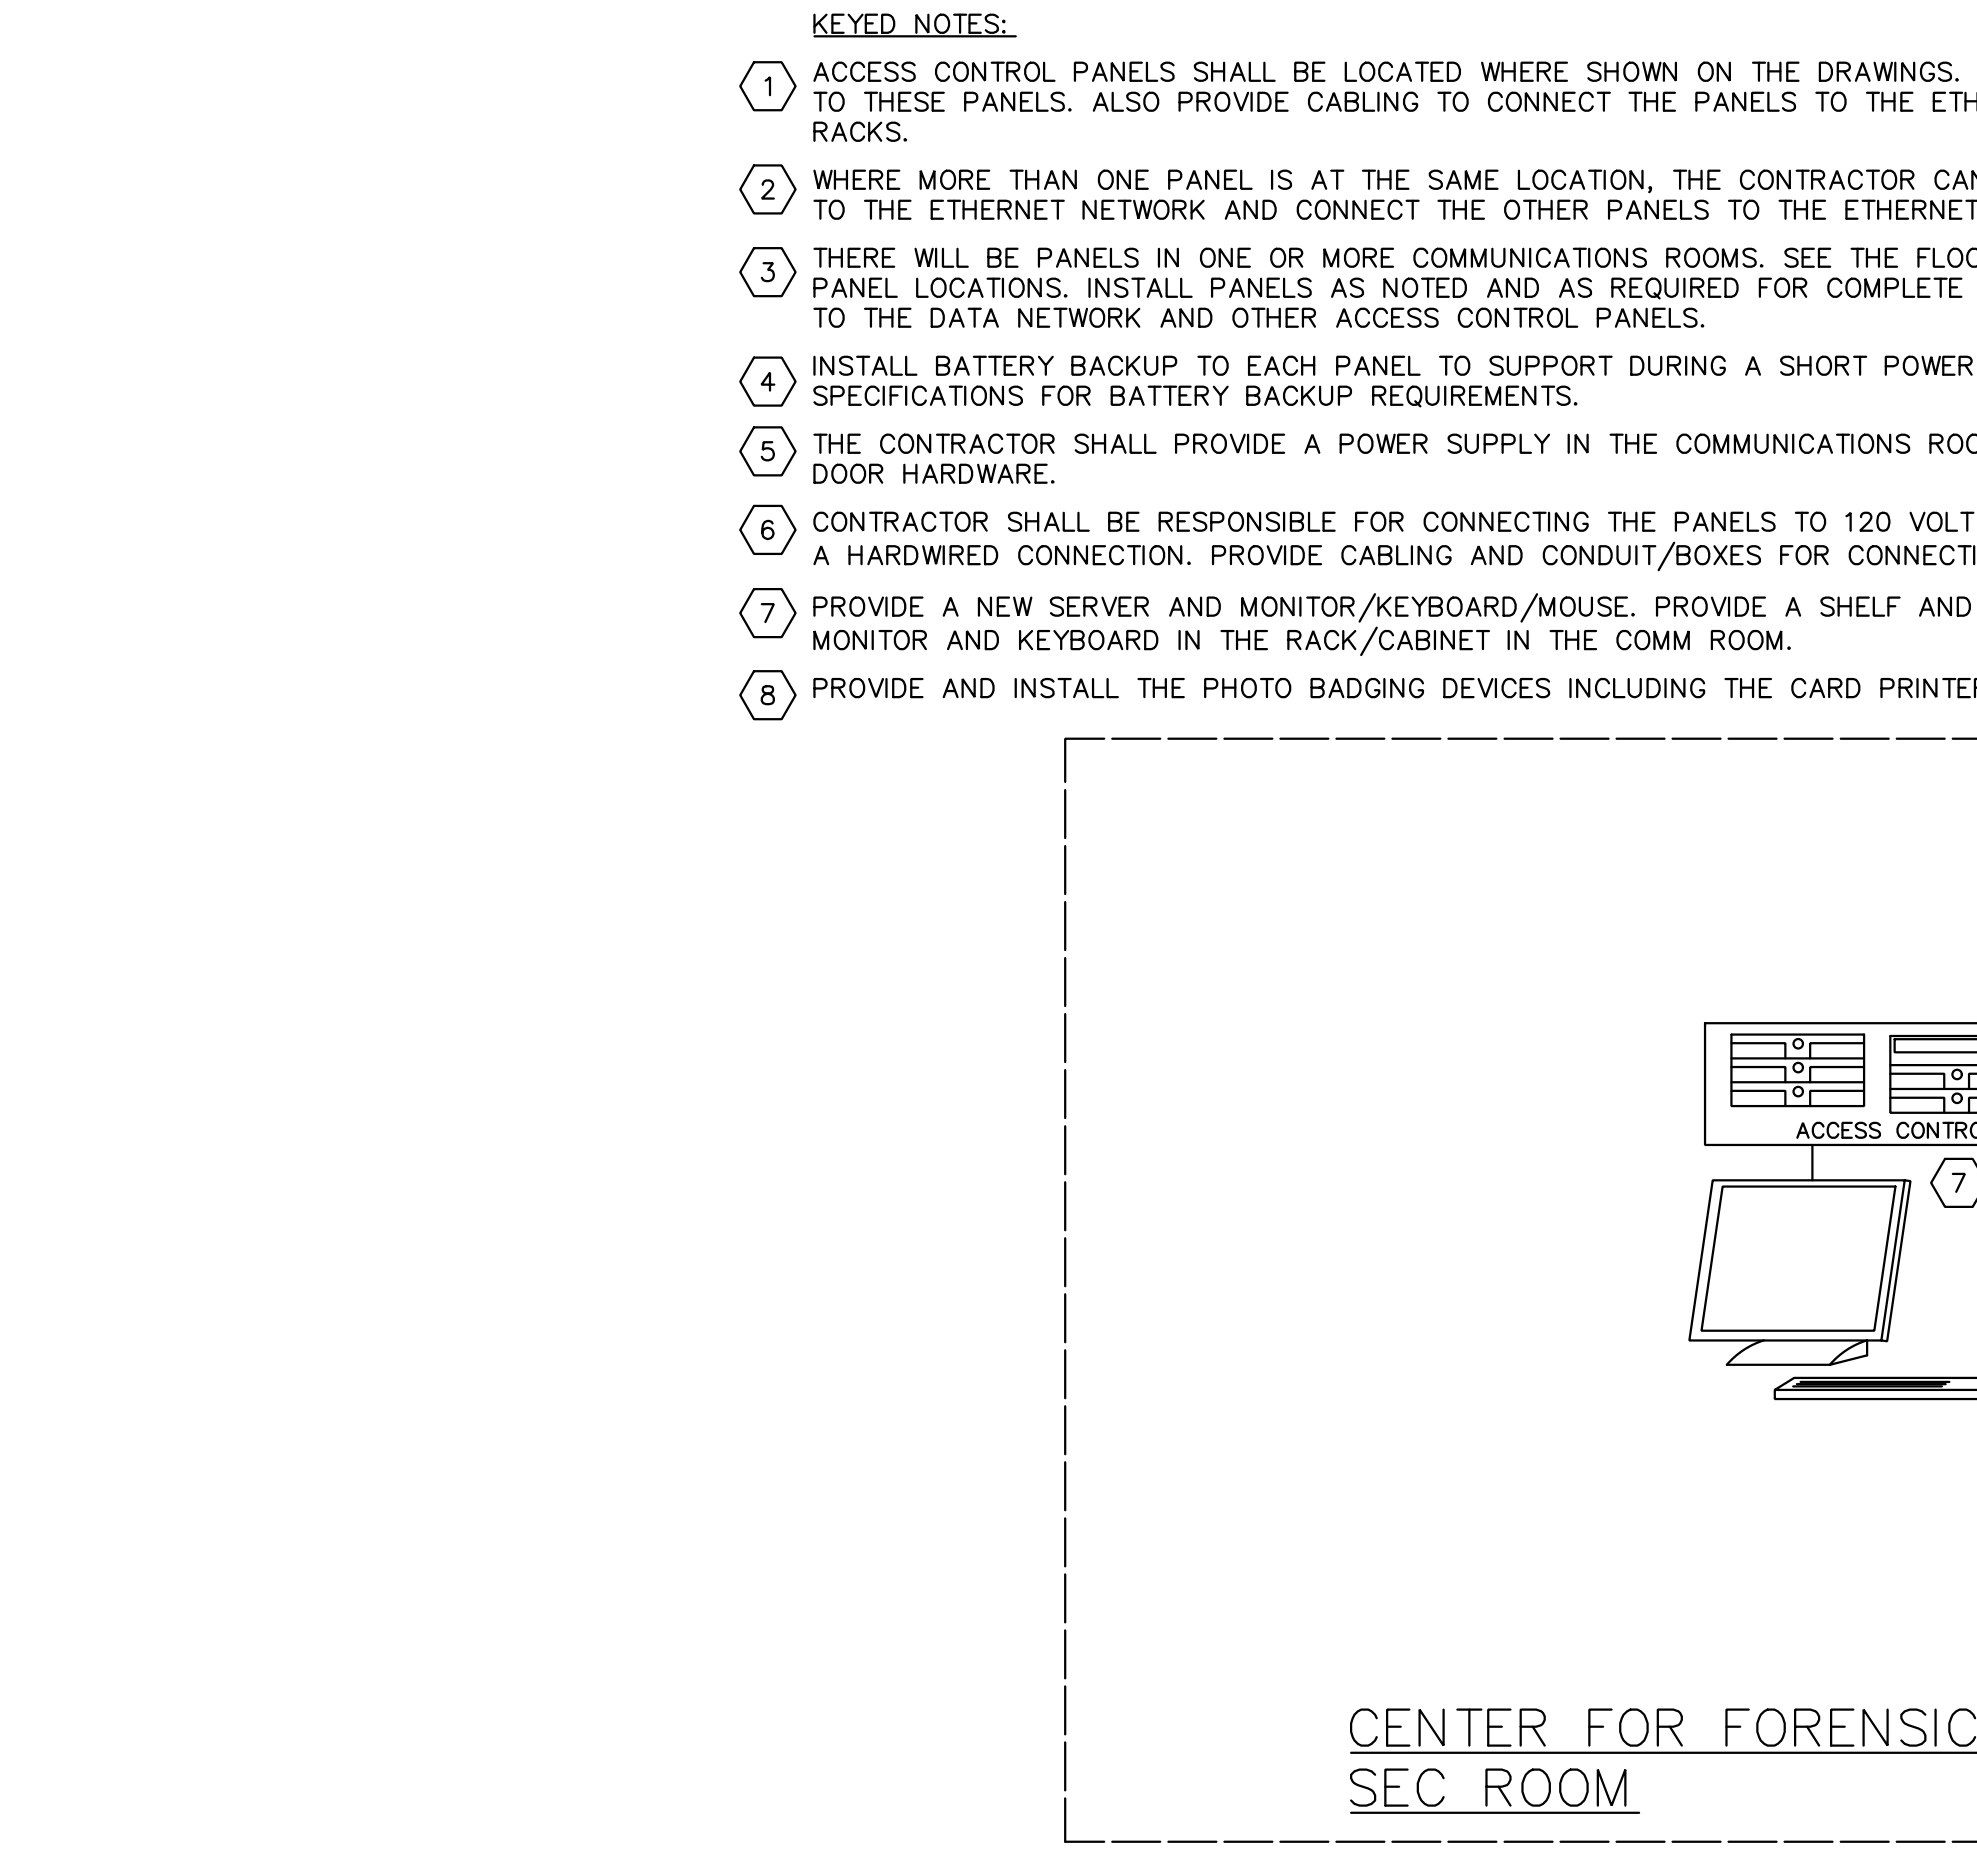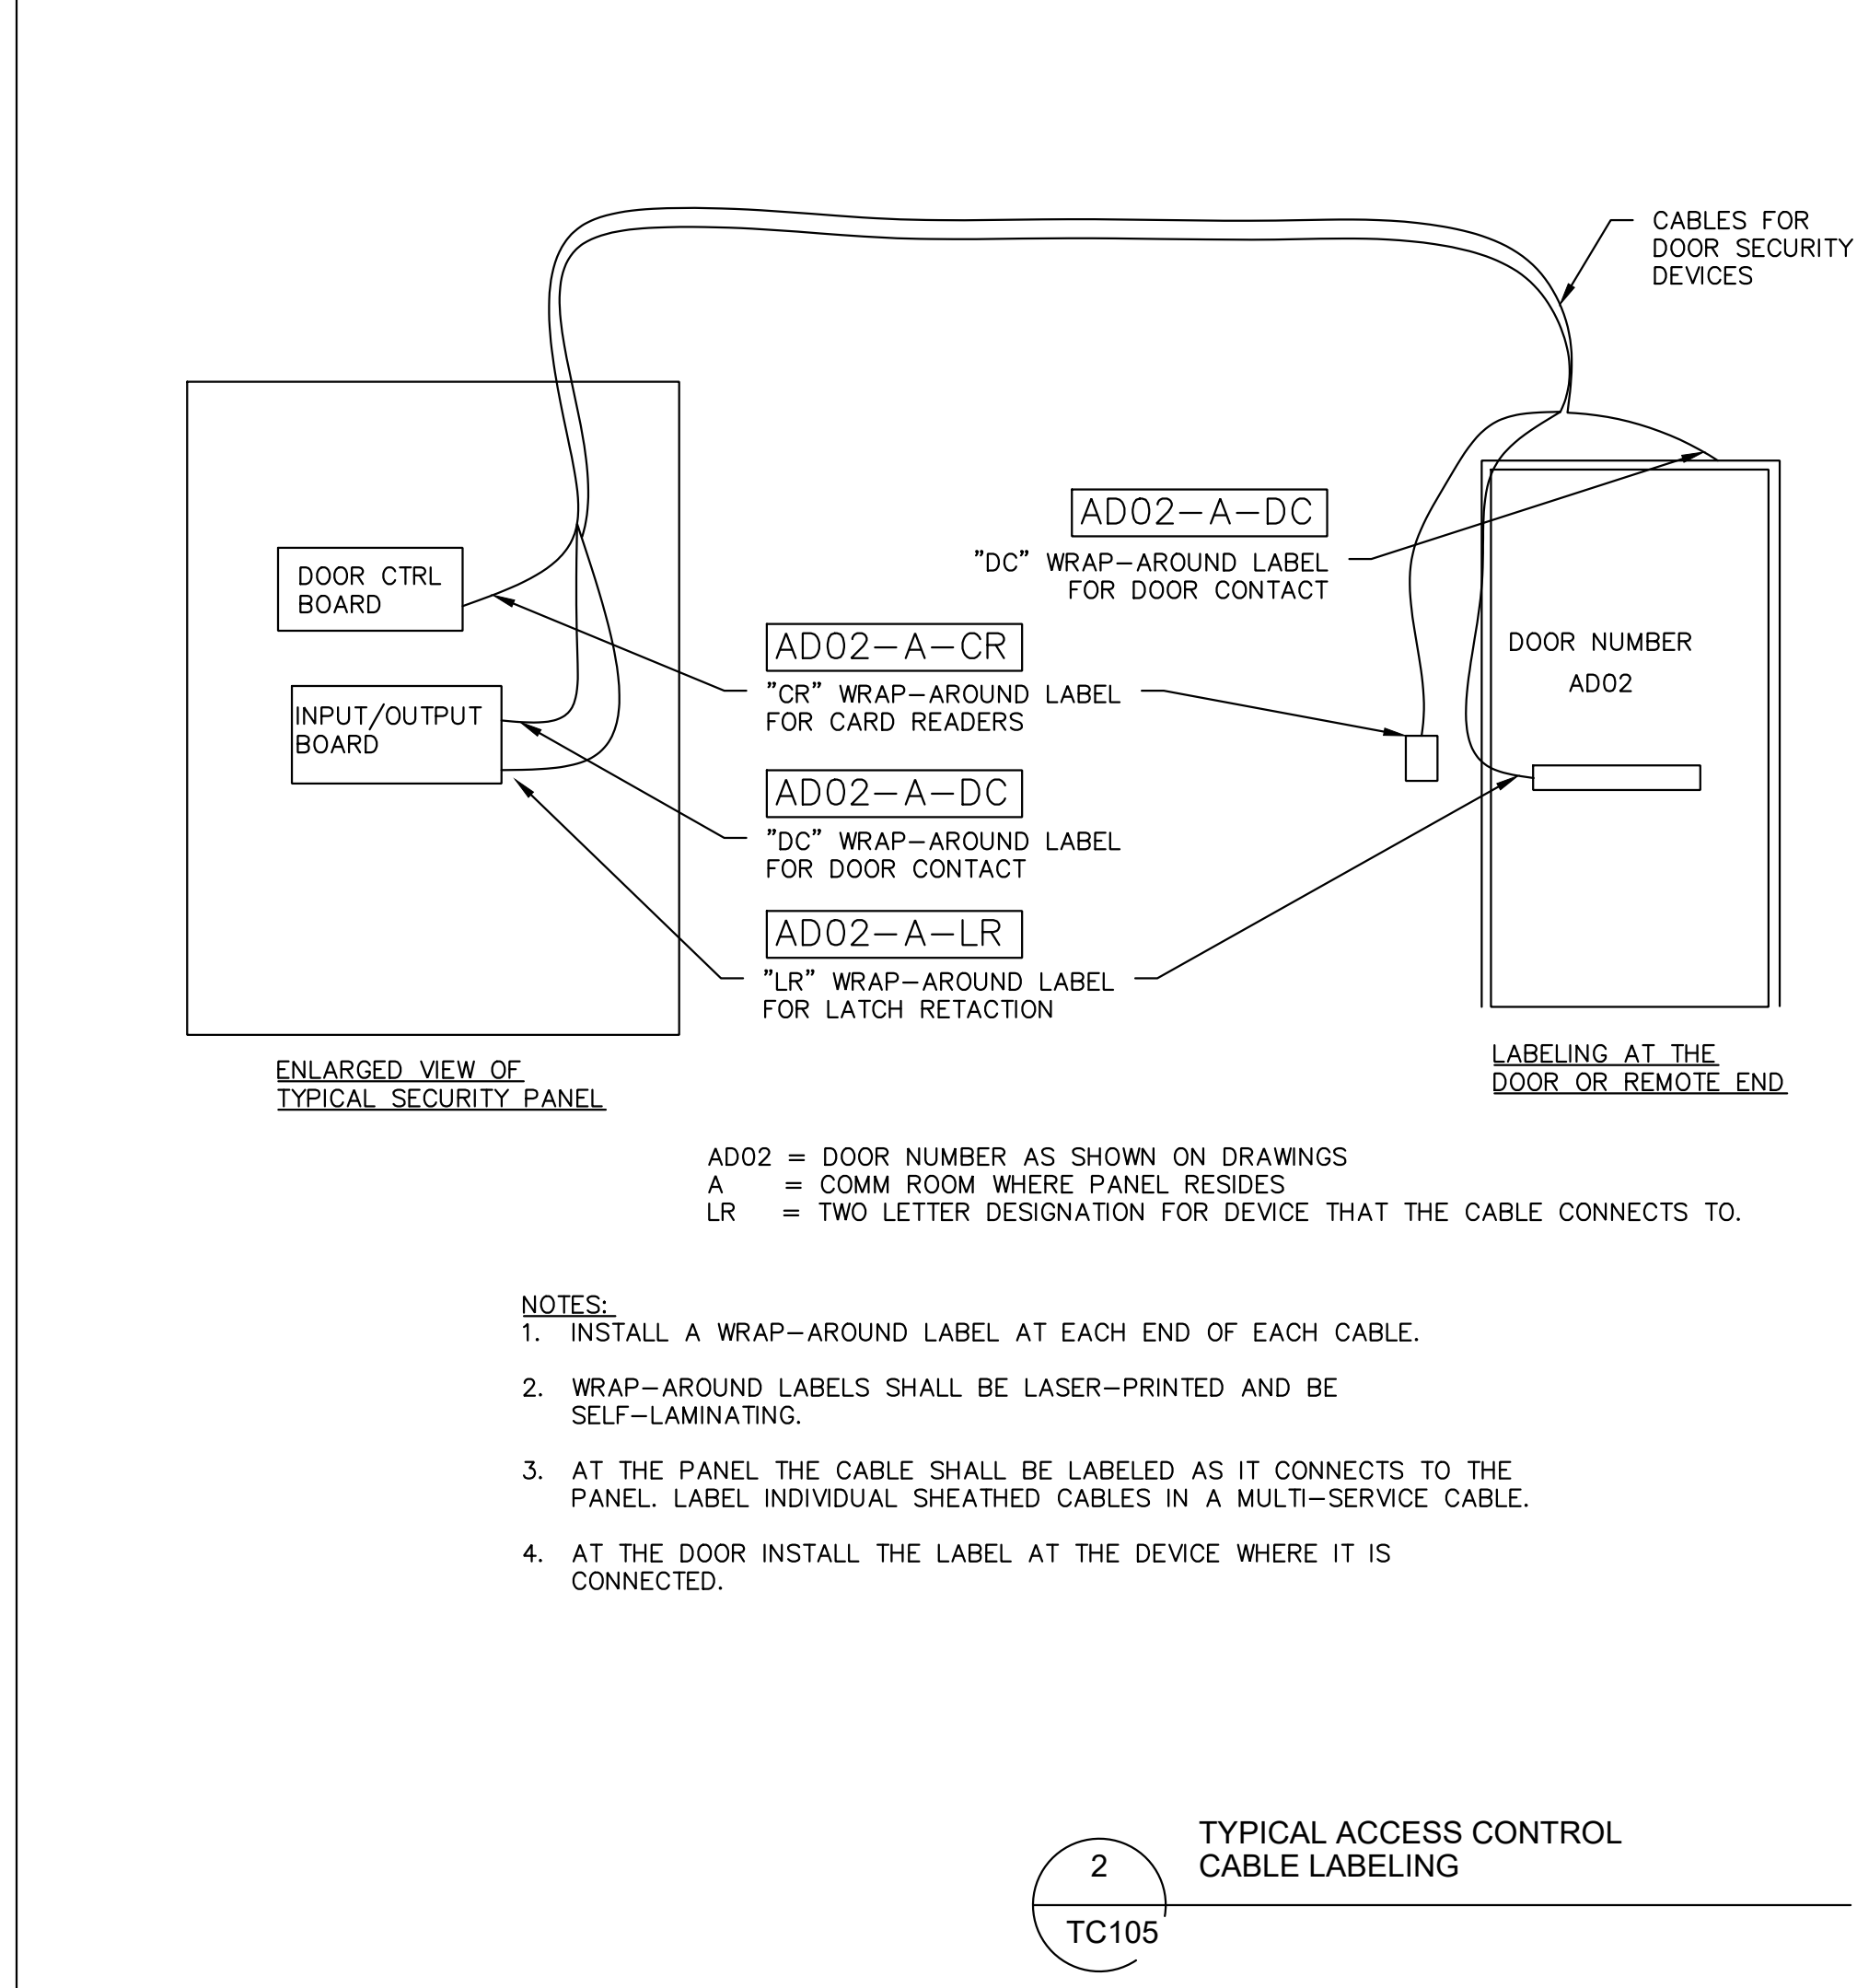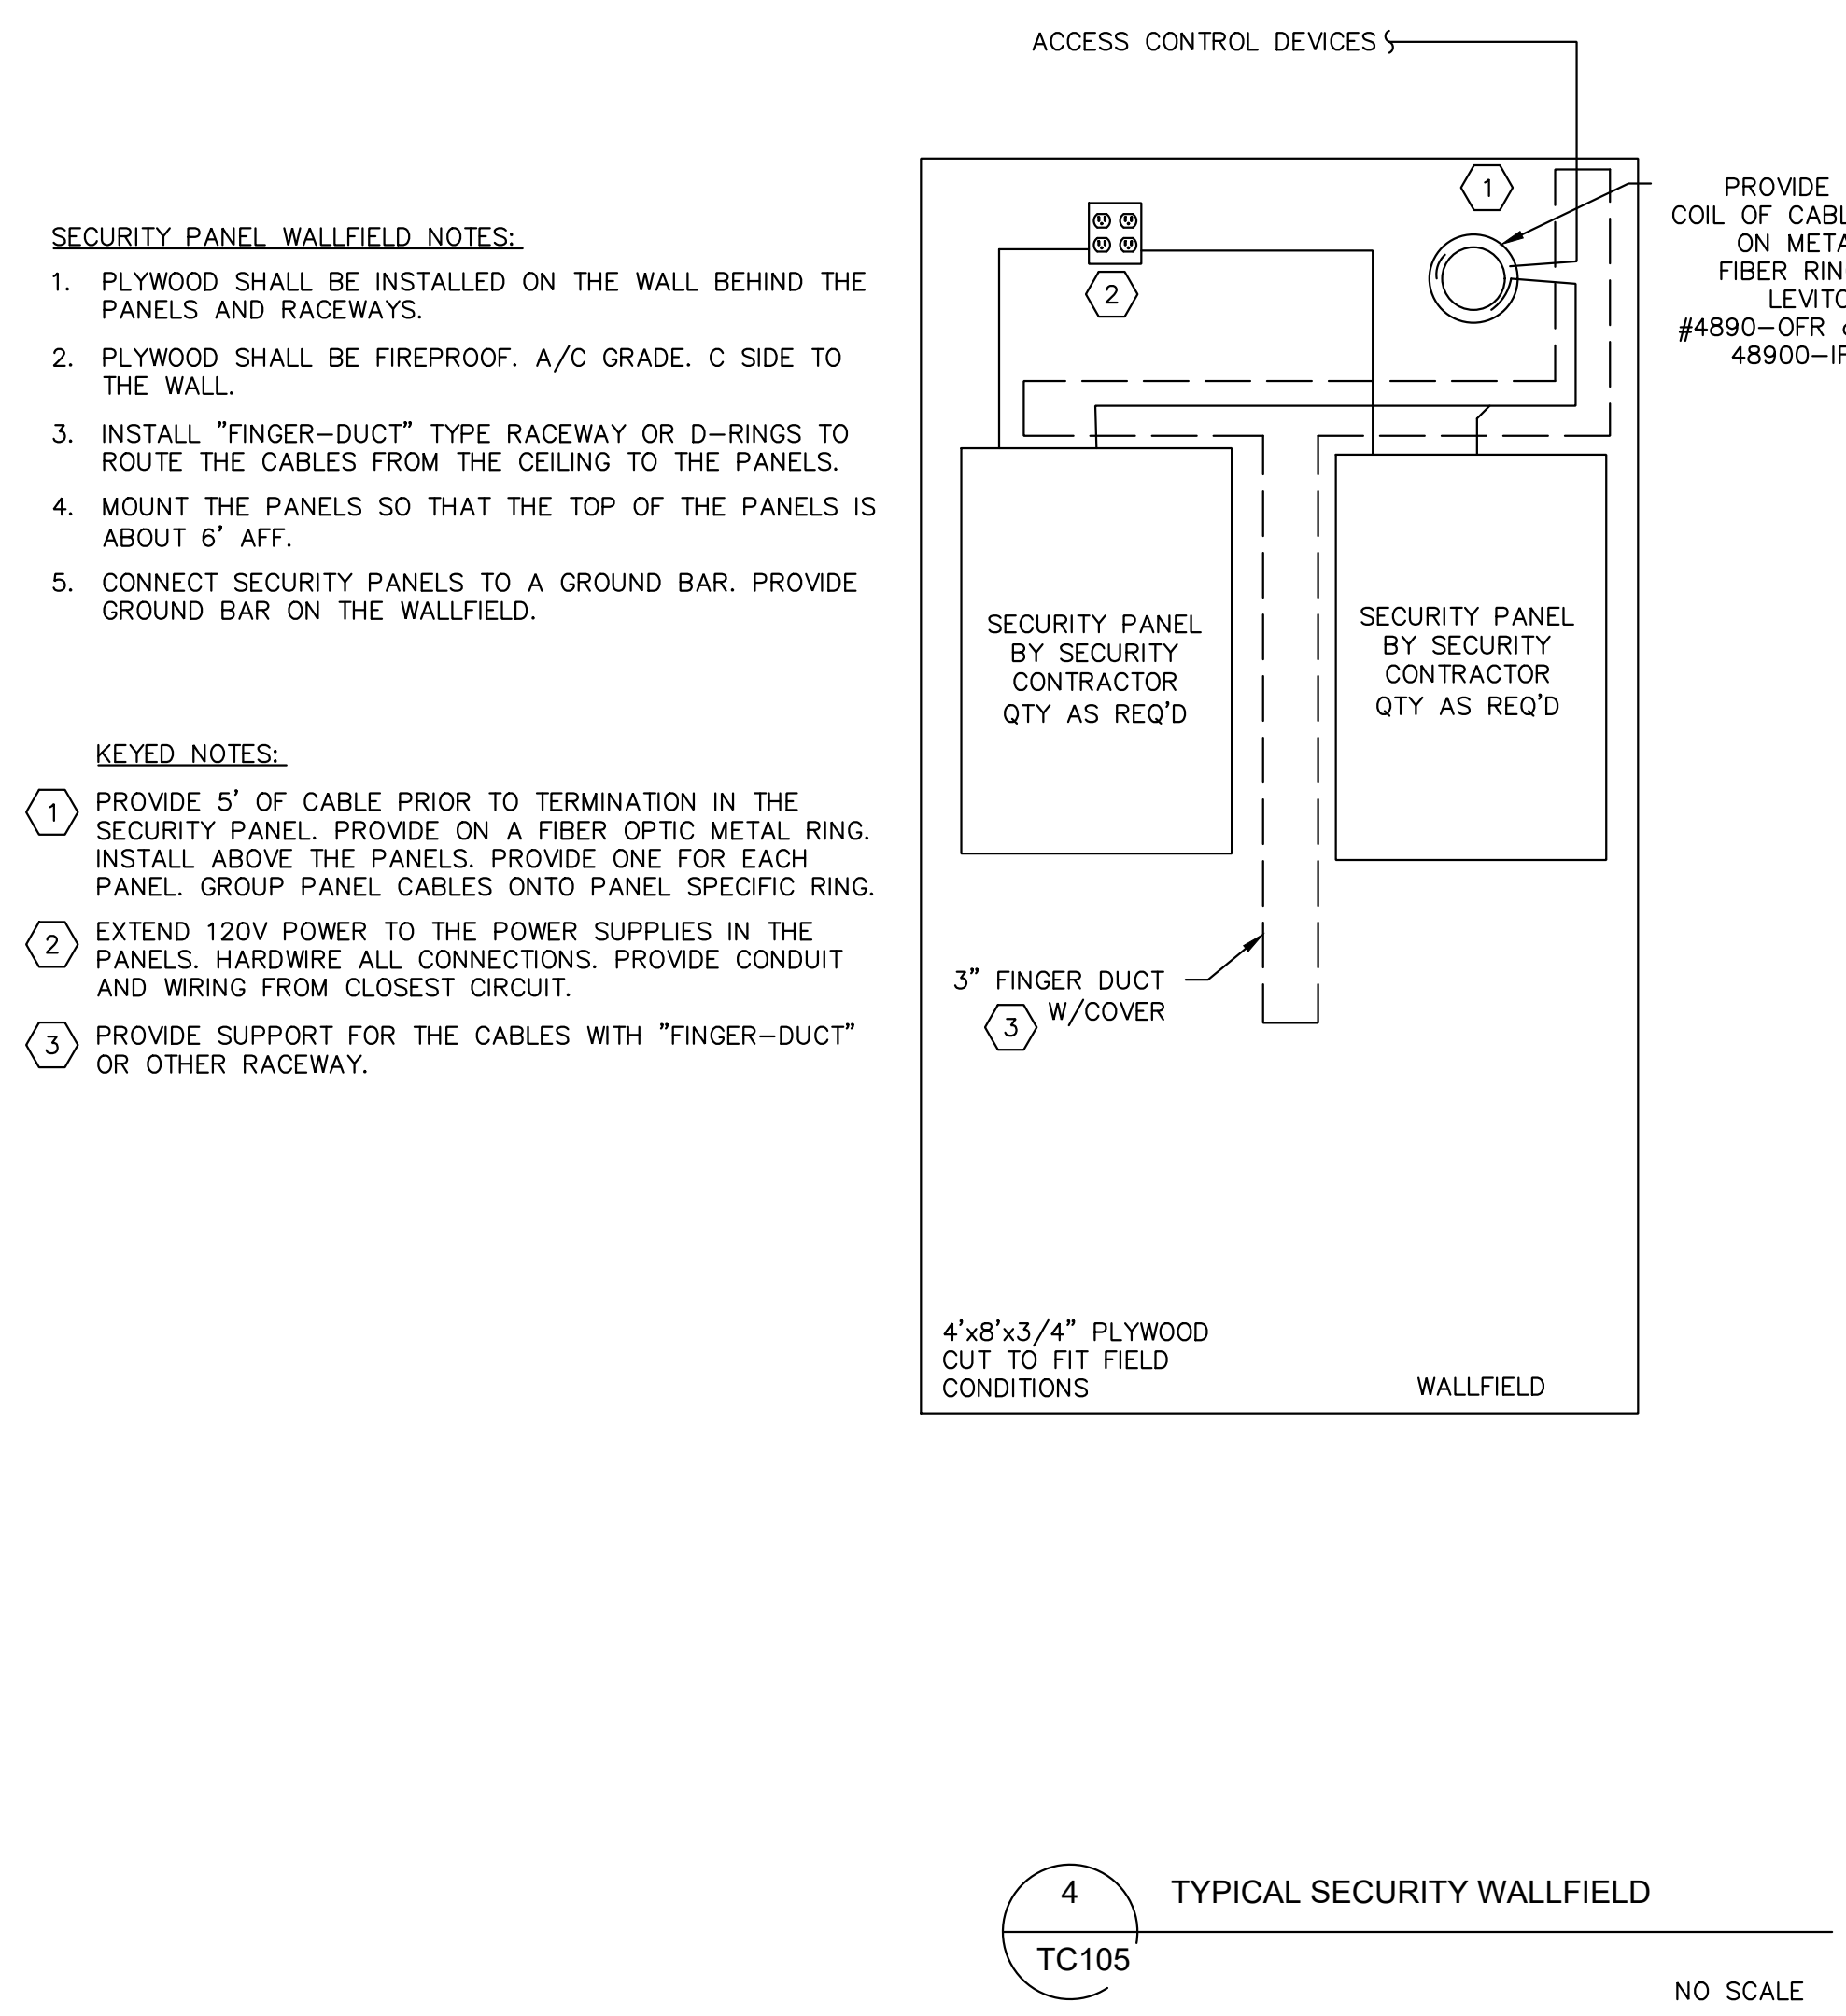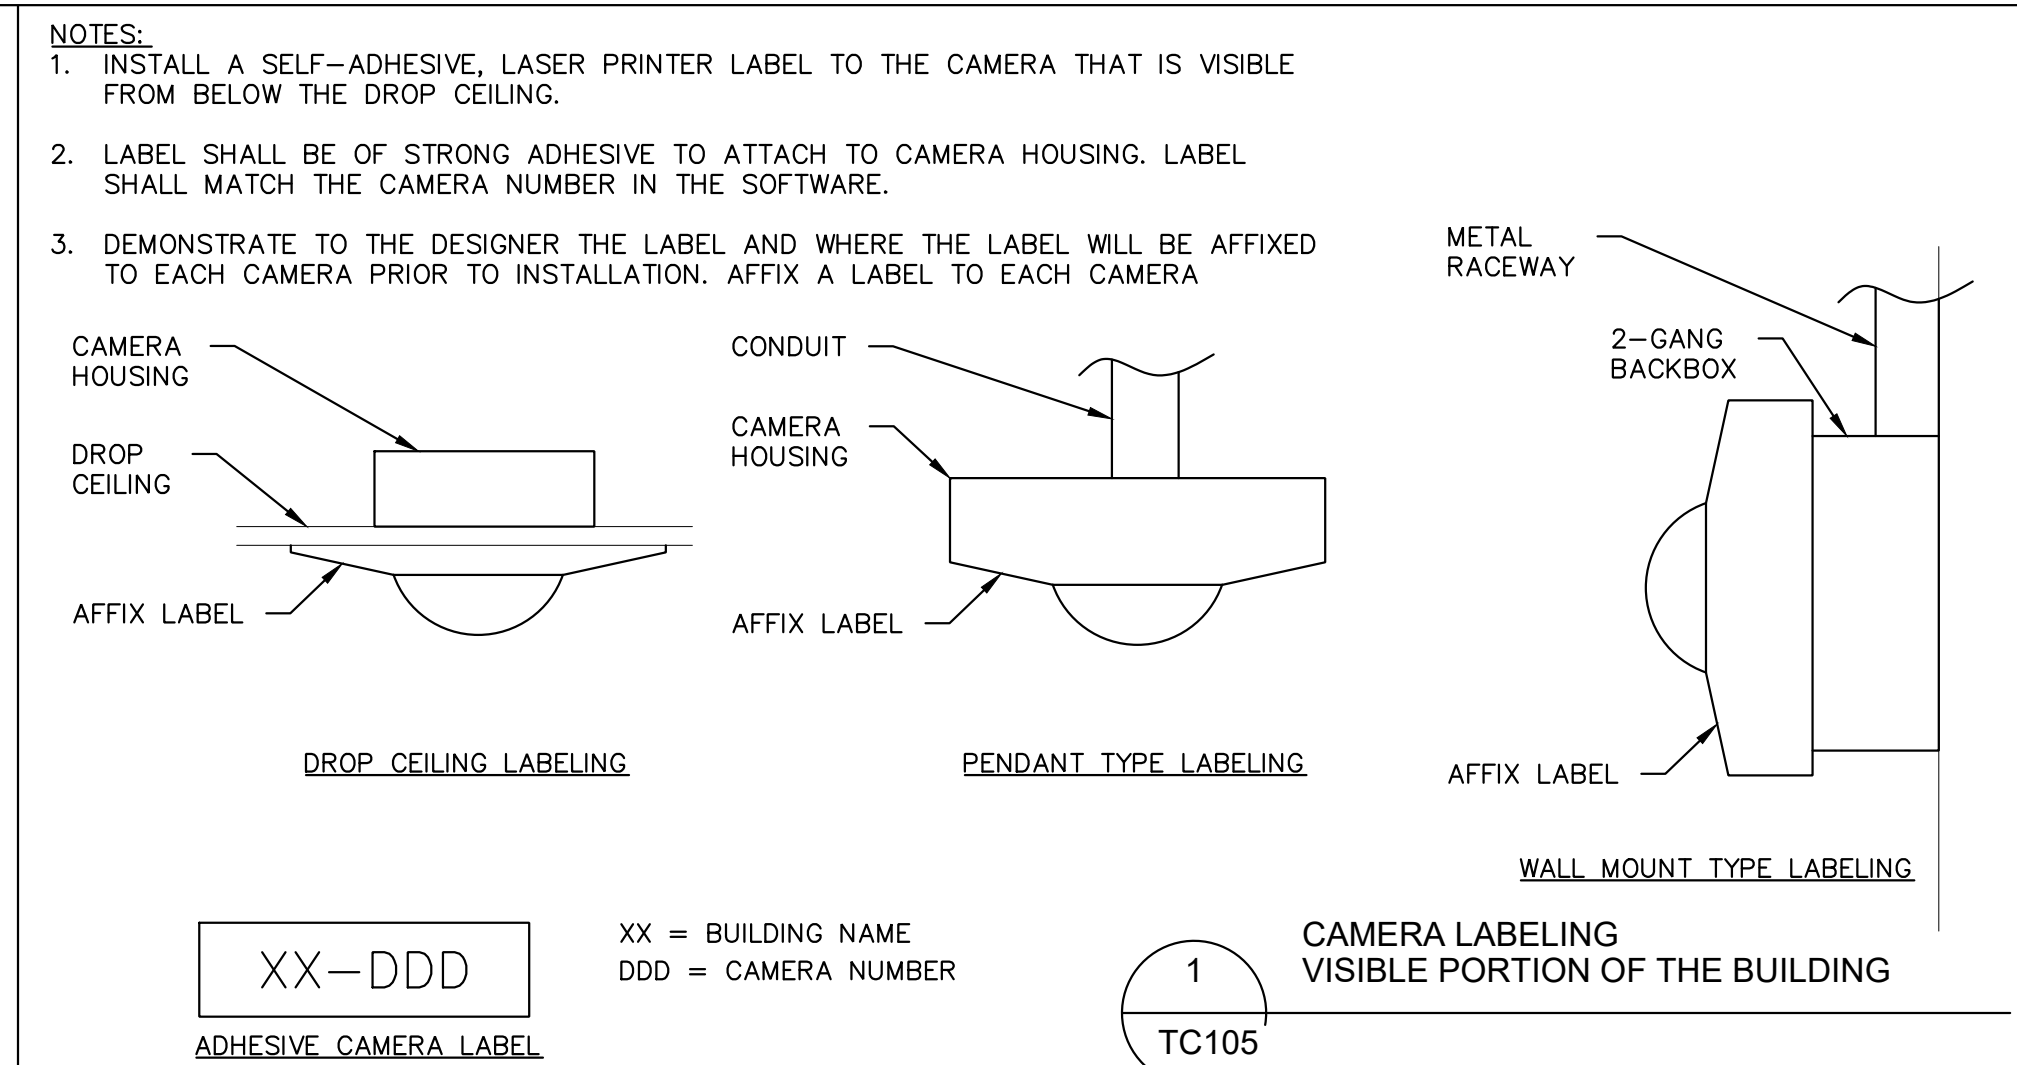



NO.	REVISION	DATE



FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

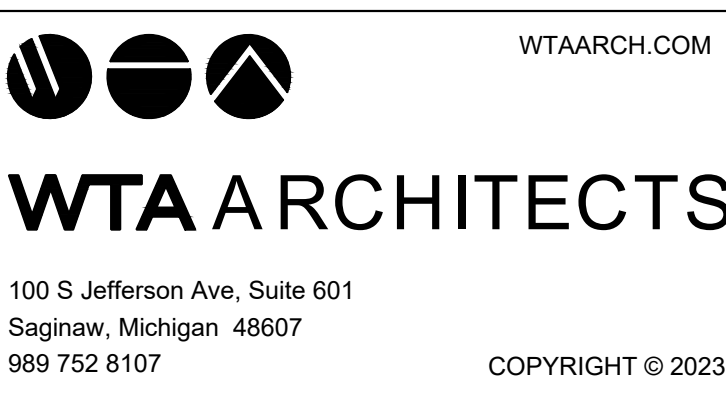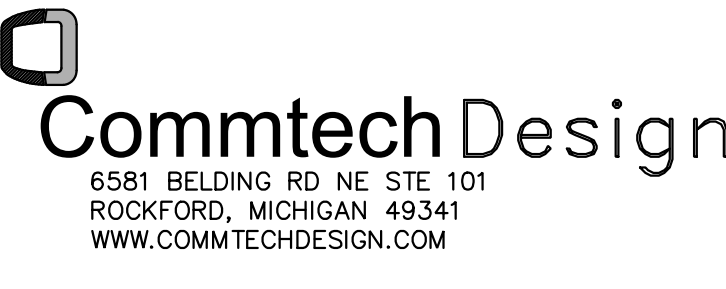

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN

SALINE, MICHIGAN

SHEET TITLE
ACCESS CONTROL DETAILS



PROJECT NUMBER
2021094

SHEET NUMBER

PROJECT DATE
SEPTEMBER 6, 2023

TC105

CHECKED BY
BWE

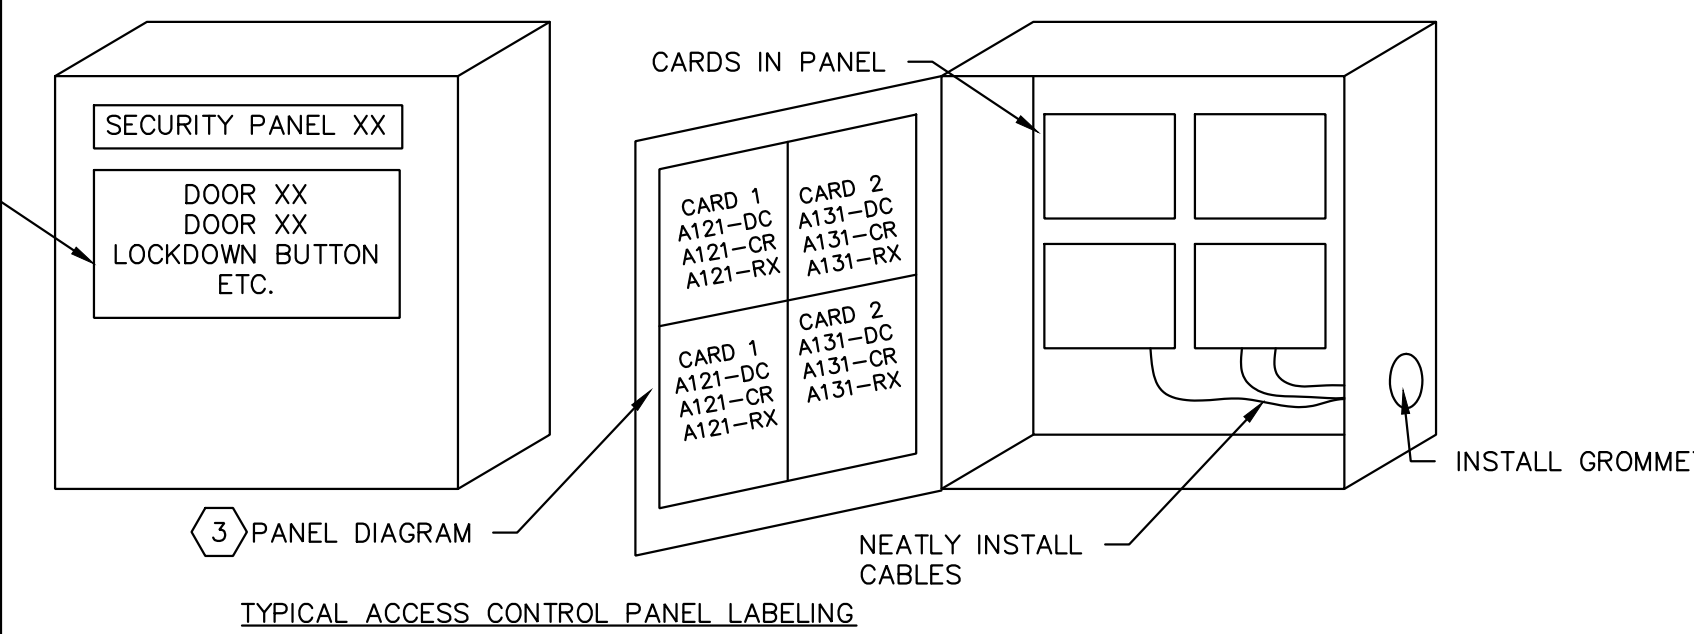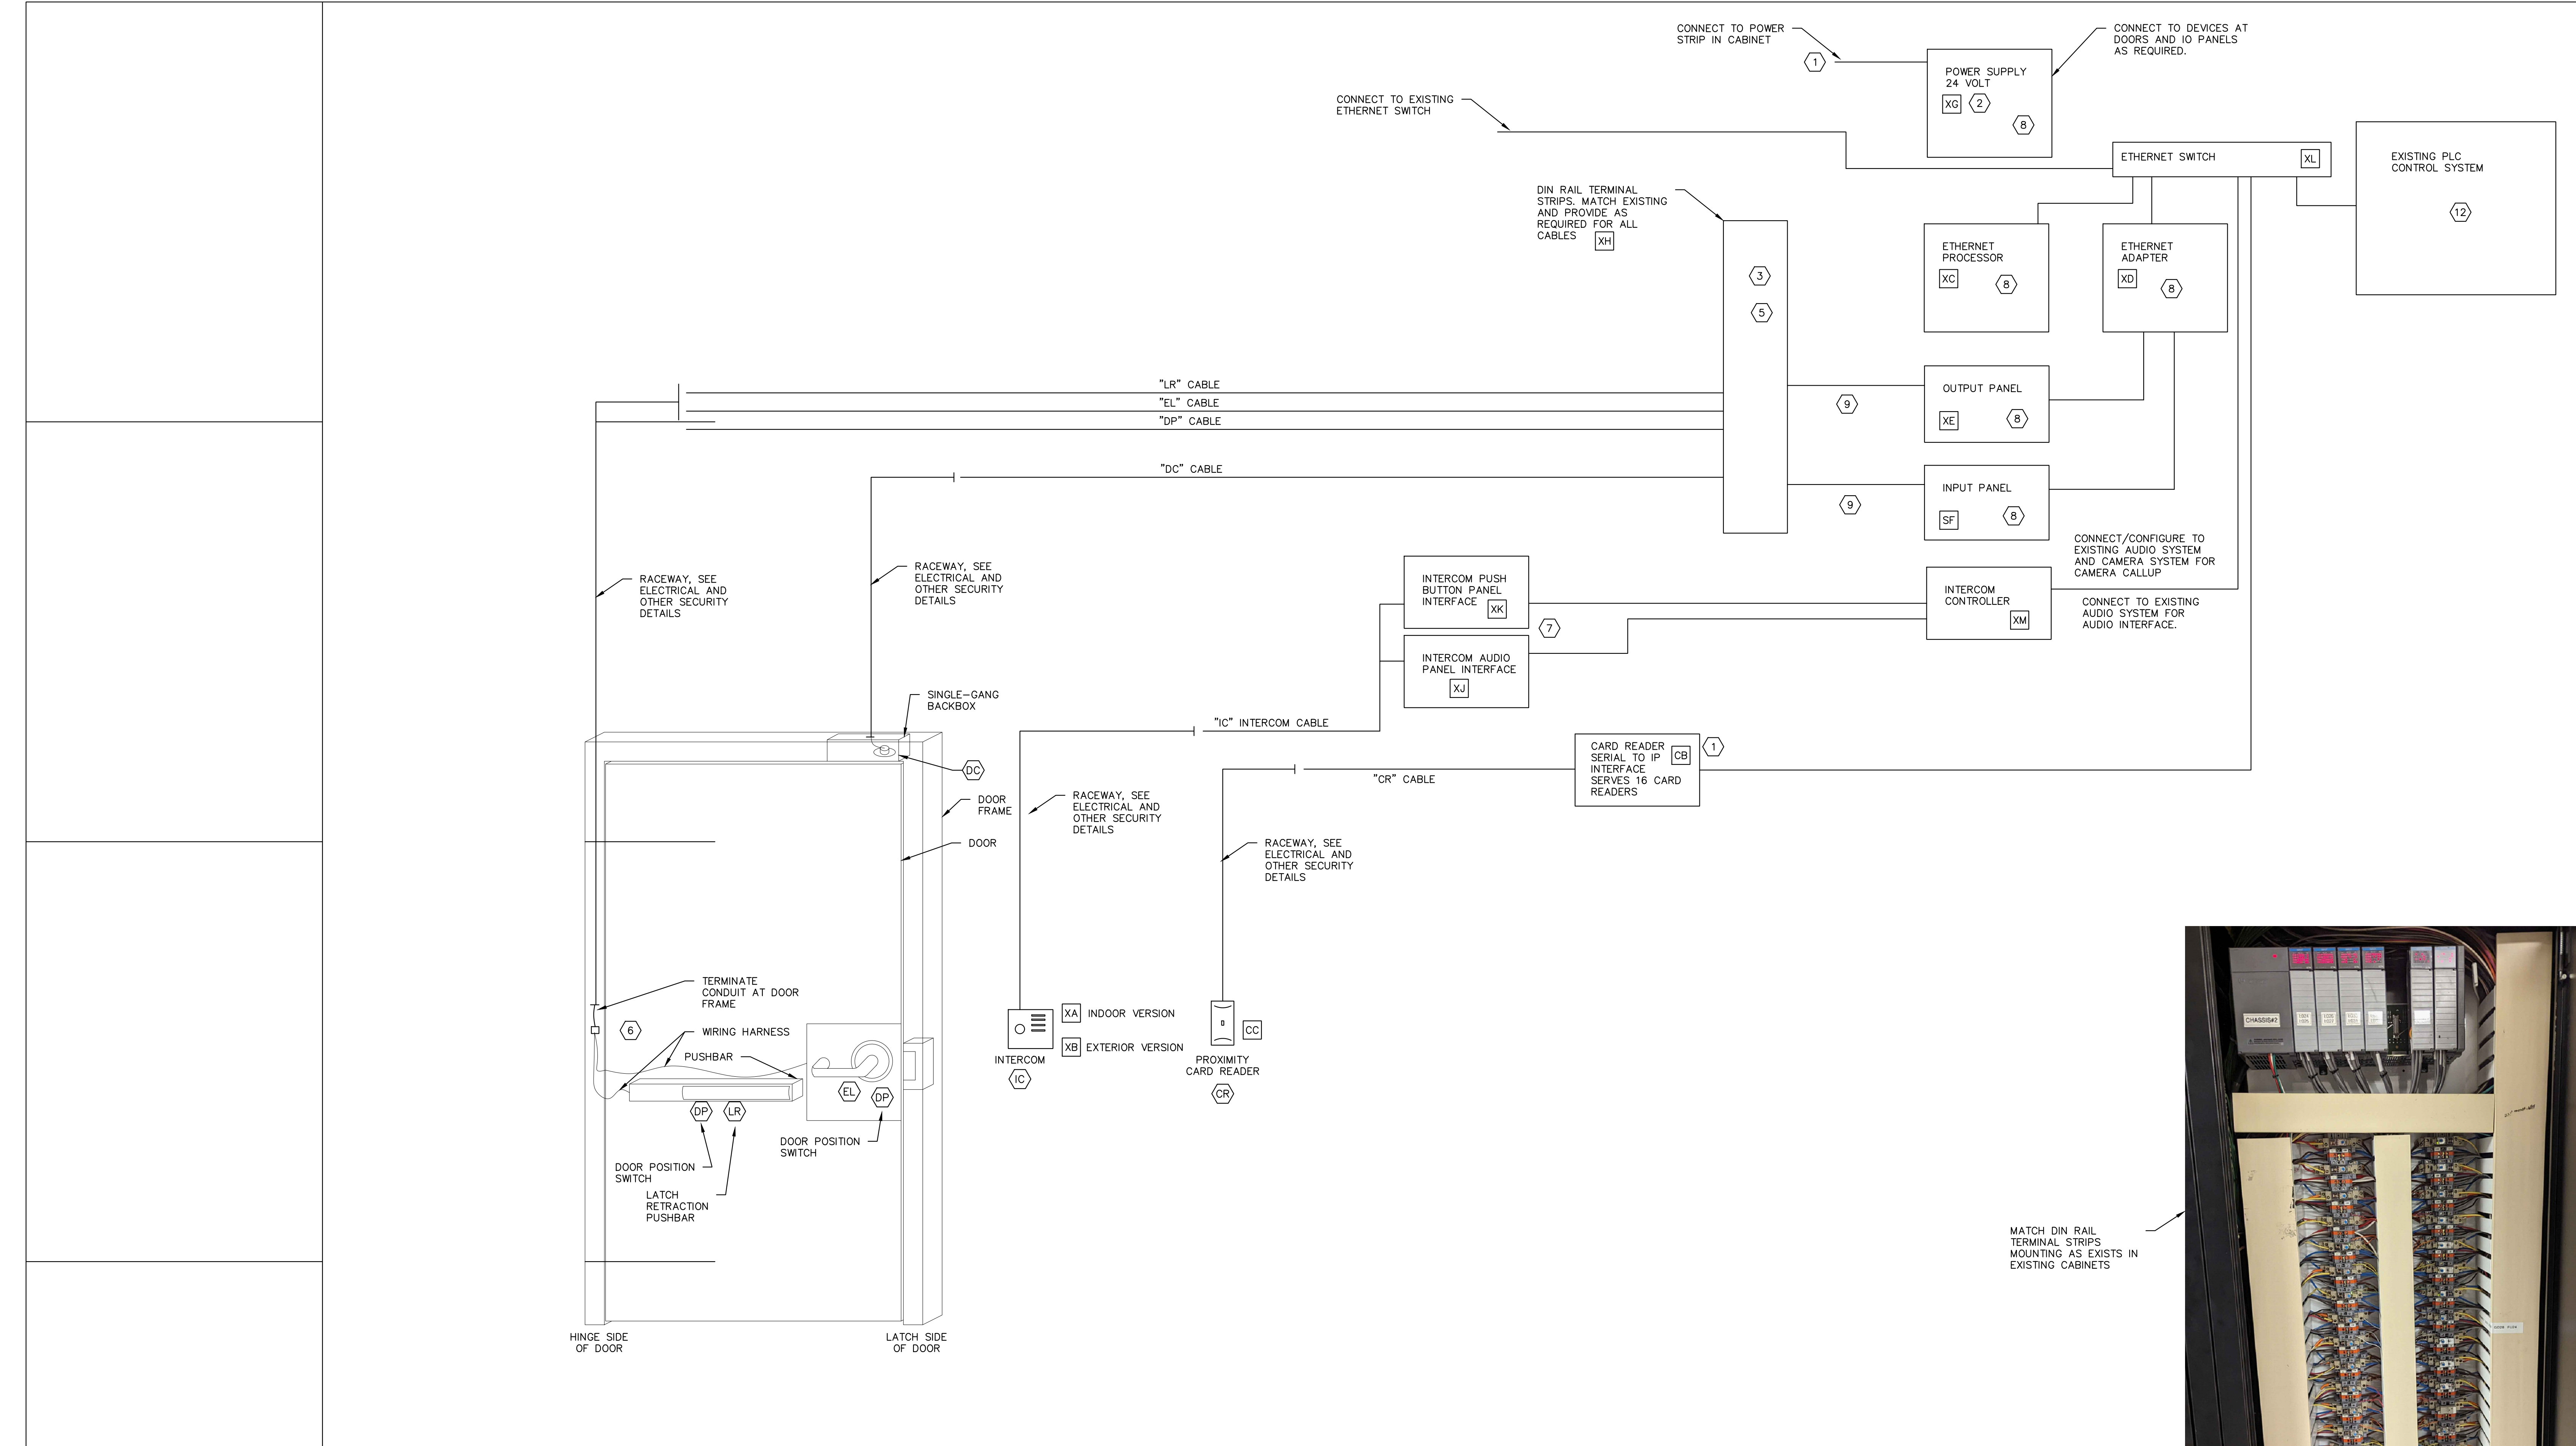

ACCESS CONTROL READER DETAILS

- (CR) CARD READER - INSTALL TO THE BACKBOX OR IN THE DOOR FRAME. COORDINATE IN FIELD PRIOR TO ORDERING. WIRE TO SECURITY SYSTEM

ACCESS CONTROL LOCK DETAILS

- (EL) ELECTRIFIED LATCH - DEVICE IS IN THE DOOR, PROVIDED BY DOOR CONTRACTOR. WIRE THROUGH THE DOOR, THROUGH THE HINGE AND TO THE SECURITY PANEL
- (LR) LATCH RETRACTION DEVICE - THIS DEVICE IS AN ELECTRONIC PUSHBAR ON THE SECURE SIDE OF THE DOOR. WIRE FROM THIS DEVICE, THROUGH THE DOOR HINGE TO THE POWER SUPPLY IN THE COMMUNICATIONS ROOM. PROVIDE POWER SUPPLY

ACCESS CONTROL AT DOOR DETAILS

- (RX) REQUEST TO EXIT IN LOCK - THIS IS A SWITCH THAT IS PROVIDED WITH THE DOOR LOCKING DEVICE. WIRE TO SECURITY PANEL TO SHUNT DOOR CONTACT WHEN EXITING BLDG.
- (DC) DOOR CONTACT - MOUNT ABOVE THE DOOR. WIRE TO SECURITY SYSTEM/INTRUSION DETECTION SYSTEM TO TRIGGER AN ALARM
- (DP) DOOR POSITION SWITCH: PROVIDED AS PART OF THE DOOR HARDWARE. IDENTIFIES THE POSITION OF A DOOR LOCK OR DOOR LATCH. WIRE BACK TO SECURITY SYSTEM.

INTERCOM / ASST. OPENER DETAILS

- (IC) INTERCOM - INSTALL TO THE BOX OR SURFACE MOUNT TO THE WALL. WIRE TO THE SECURITY SYSTEM VIA CABLES

KEYED ACCESS CONTROL NOTES:

- INSTALL SERIAL TO IP DEVICE IN PLC CABINETS. CONNECT TO CARD READERS AND ETHERNET SWITCH
- PROVIDE A POWER SUPPLY TO SUPPORT THE SECURITY PANELS AND ALL END USER DEVICES SUCH AS LOCKS, STROBES, REQUEST TO EXIT DEVICES, ALARMS ETC.
- AFIX A CUSTOM SHEET OF PAPER INSIDE THE PANEL DOOR THAT SHOWS WHAT DOORS OR DEVICES ARE CONNECTED TO EACH PANEL. LAMINATE OR INSTALL IN A PLASTIC SLEEVE.
- CUT HOLE IN PANEL TO SUPPORT CABLE INSTALLATION. INSTALL A NYLON OR PLASTIC GROMMET IN THE PANEL.
- CONNECT ALL CABLES AND DEVICES TO THE CONTROLLERS/BOARDS WITHIN THE PANEL THAT IS REQUIRED FOR CONNECTIVITY AND SYSTEM OPERATION. PROVIDE A COIL OF 5' OF CABLE ABOVE THE PANEL ON THE WALL.
- FOR AN EL OR LR DEVICE THE DOOR HARDWARE SUPPLIER WILL PROVIDE A WIRING HARNESS FROM THE LOCK THROUGH THE HINGE AND INTO THE DOOR FRAME. SECURITY CONTRACTOR TO WIRE FROM PANEL OR POWER SUPPLY TO THE WIRING HARNESS.
- MEET WITH THE OWNER TO DETERMINE WHICH INTERCOMS SHALL CALL UP WHICH CAMERAS. INTEGRATE BOTH SYSTEMS. PROVIDE ALL SOFTWARE AND CONFIGURATION REQUIRED.
- PROVIDE THE QUANTITY AND CONNECTIVITY OF THESE DEVICES AS REQUIRED OF ALL DEVICES SHOWN ON THE FLOORPLANS. CONNECT TO THE EXISTING ACCESS CONTROL SYSTEM (WONDERWARE OR LATEST VERSION) TO THESE NEW DEVICES TO MAKE THE SYSTEM WORK AS ONE SYSTEM. ANY UPDATES TO THE MAIN EXISTING SYSTEM ARE OUTSIDE THE SCOPE OF THIS PROJECT.
- PROVIDE INTERCONNECTIONS AND QUANTITY AS REQUIRED FOR SYSTEM CONNECTIVITY
- PROVIDE CONNECTIVITY FROM THE ACCESS CONTROL SYSTEM PANEL TO THE PLC SYSTEM TO TRIGGER DOORS TO BE CONTROLLED. PROVIDE EQUIPMENT AND SOFTWARE TO INTEGRATE OWNERS EXISTING ID CARDS AND CARD READERS INTO THE NEW SPACE
- MOUNT ACCESS CONTROL PANEL ON THE WALL OF THE BASEMENT SECURITY ROOM. ROUTE CABLING TO PLC CABINET AND CARD READERS FOR CONNECTIVITY AND INTEGRATION
- INTEGRATE ALL NEW EQUIPMENT AND DOORS AND CONTROLS TO THE EXISTING SYSTEM TO PROVIDE A SINGLE, COHESIVE INTERFACE AND DATABASE FOR THE EXISTING SYSTEM.

GENERAL NOTES:

- SEE OTHER DETAILS FOR RACEWAY REQUIREMENTS FOR ALL CABLING AND DEVICES. REFER TO THE PLAN DRAWINGS FOR THE SPECIFIC FIELD DEVICE AND WHERE IT IS TO BE INSTALLED.
- ALL SECURITY DEVICES SHALL BE WIRED DIRECTLY BACK TO THE SECURITY SYSTEM (ACCESS CONTROL) PANELS OR PLC PANELS. LOCATE PANELS ON THE WALLS OF COMMUNICATIONS ROOMS OR AS SHOWN ON THE FLOOR PLANS. SEE OTHER DETAILS FOR MOUNTING AND RACEWAY REQUIREMENTS FOR CABLING.
- PROVIDE ALL SECURITY CABLES AND ALL SECURITY PANELS REQUIRED FOR CONNECTIVITY OF THE SYSTEM. SHALL BE PLENUM RATED IN PLENUM AREAS.
- LABEL THE OUTSIDE OF THE PANEL FOR THE DOORS AND DEVICES THAT ARE CONNECTED INSIDE THE PANEL. PROVIDE A PANEL DIAGRAM INSIDE THE PANEL THAT SHOWS THE CARDS AND WHAT IS CONNECTED TO EACH PORT ON THE CARDS.
- THE PLC BASED SYSTEM FOR ACCESS CONTROL IS STANLEY GATEKEEPER SYSTEM. EXPAND THIS EXISTING SYSTEM TO SUPPORT THE NEW DOORS AND CARD READERS. PROVIDE AND APPLY ANY ADDITIONAL LICENSING REQUIRED.

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

CommtechDesign
6581 BELDING RD NE STE 101
ROCKFORD, MICHIGAN 49341
WWW.COMMTECHDESIGN.COM

WTA ARCHITECTS
100 S. Jefferson Ave. Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN





SHEET TITLE
**SECURITY ACCESS
CONTROL DETAILS**

PROJECT NUMBER
2021094

PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
BWE



SHEET NUMBER
TC106

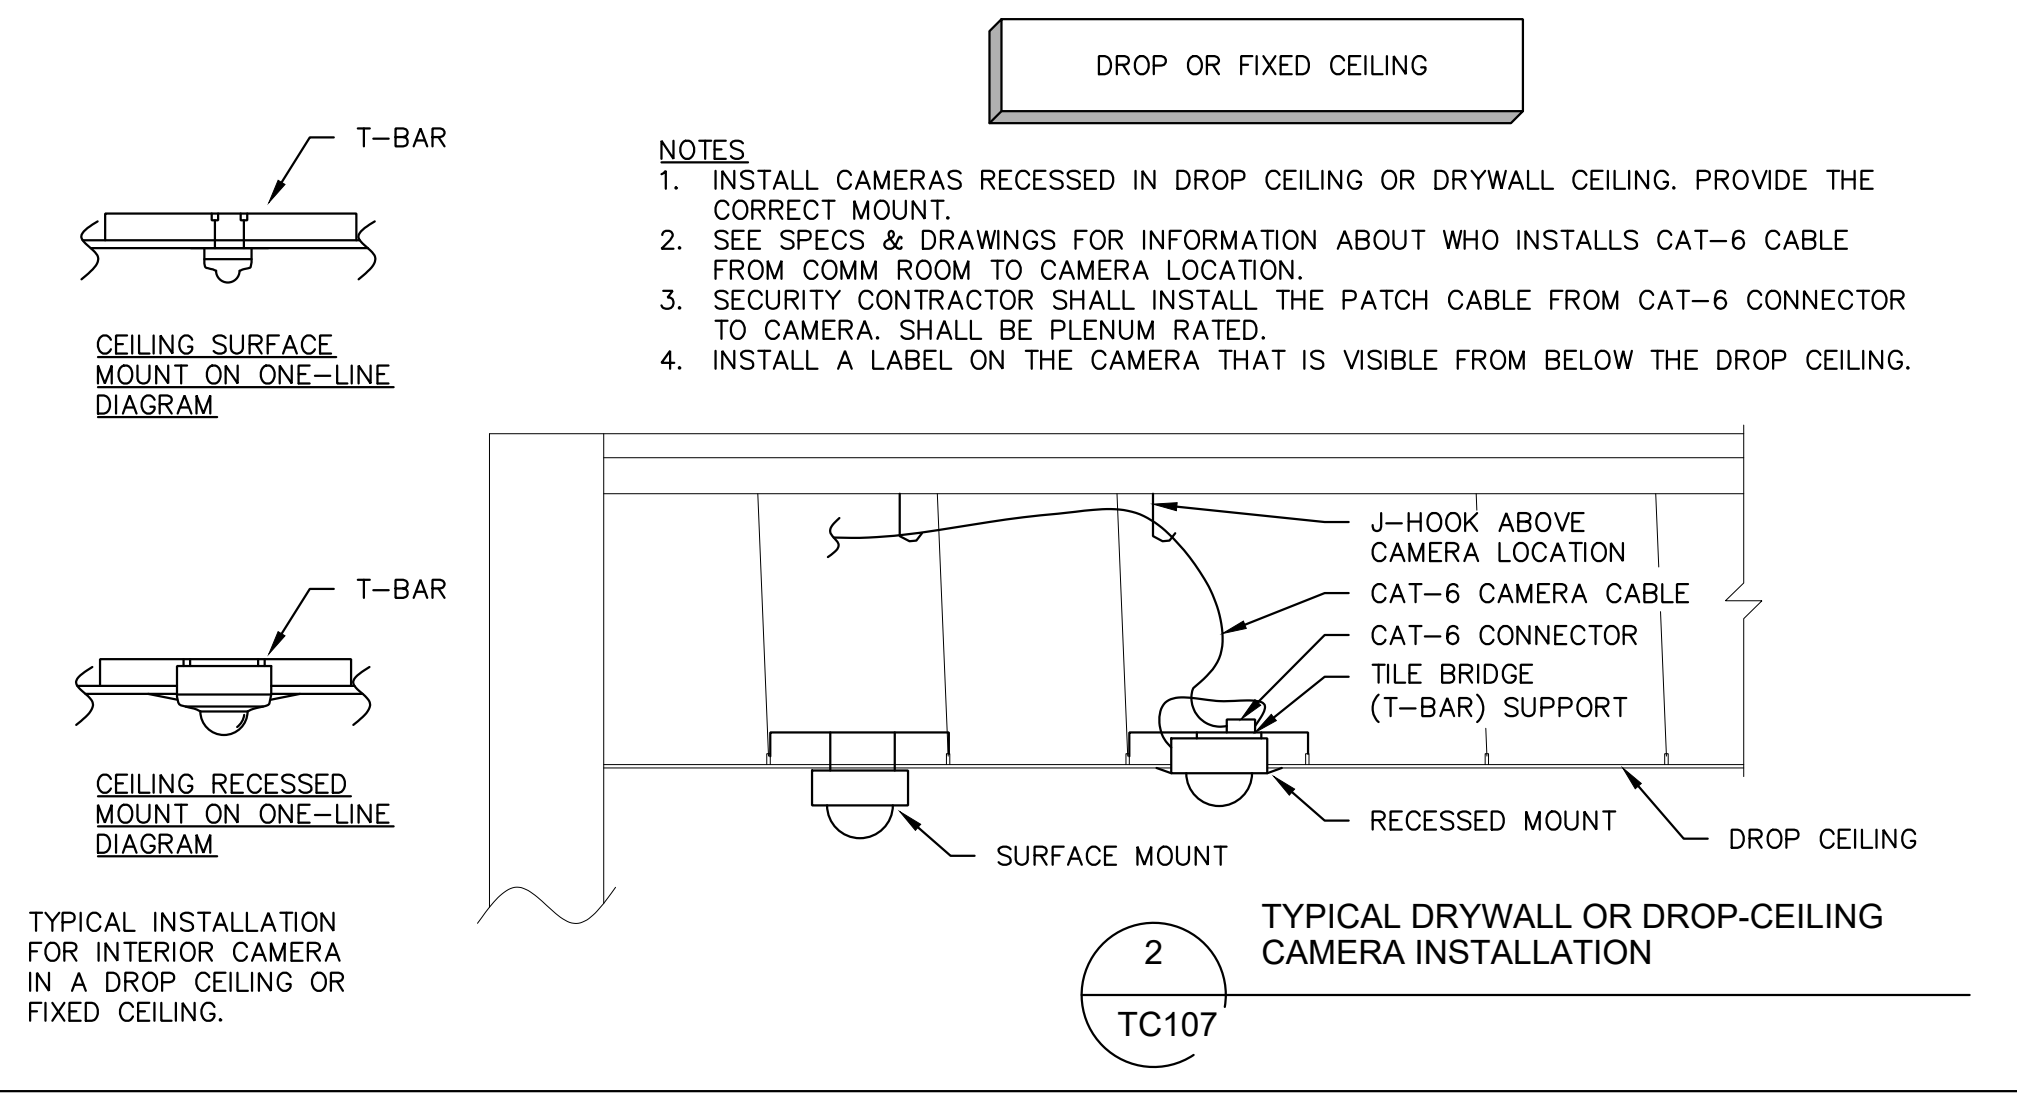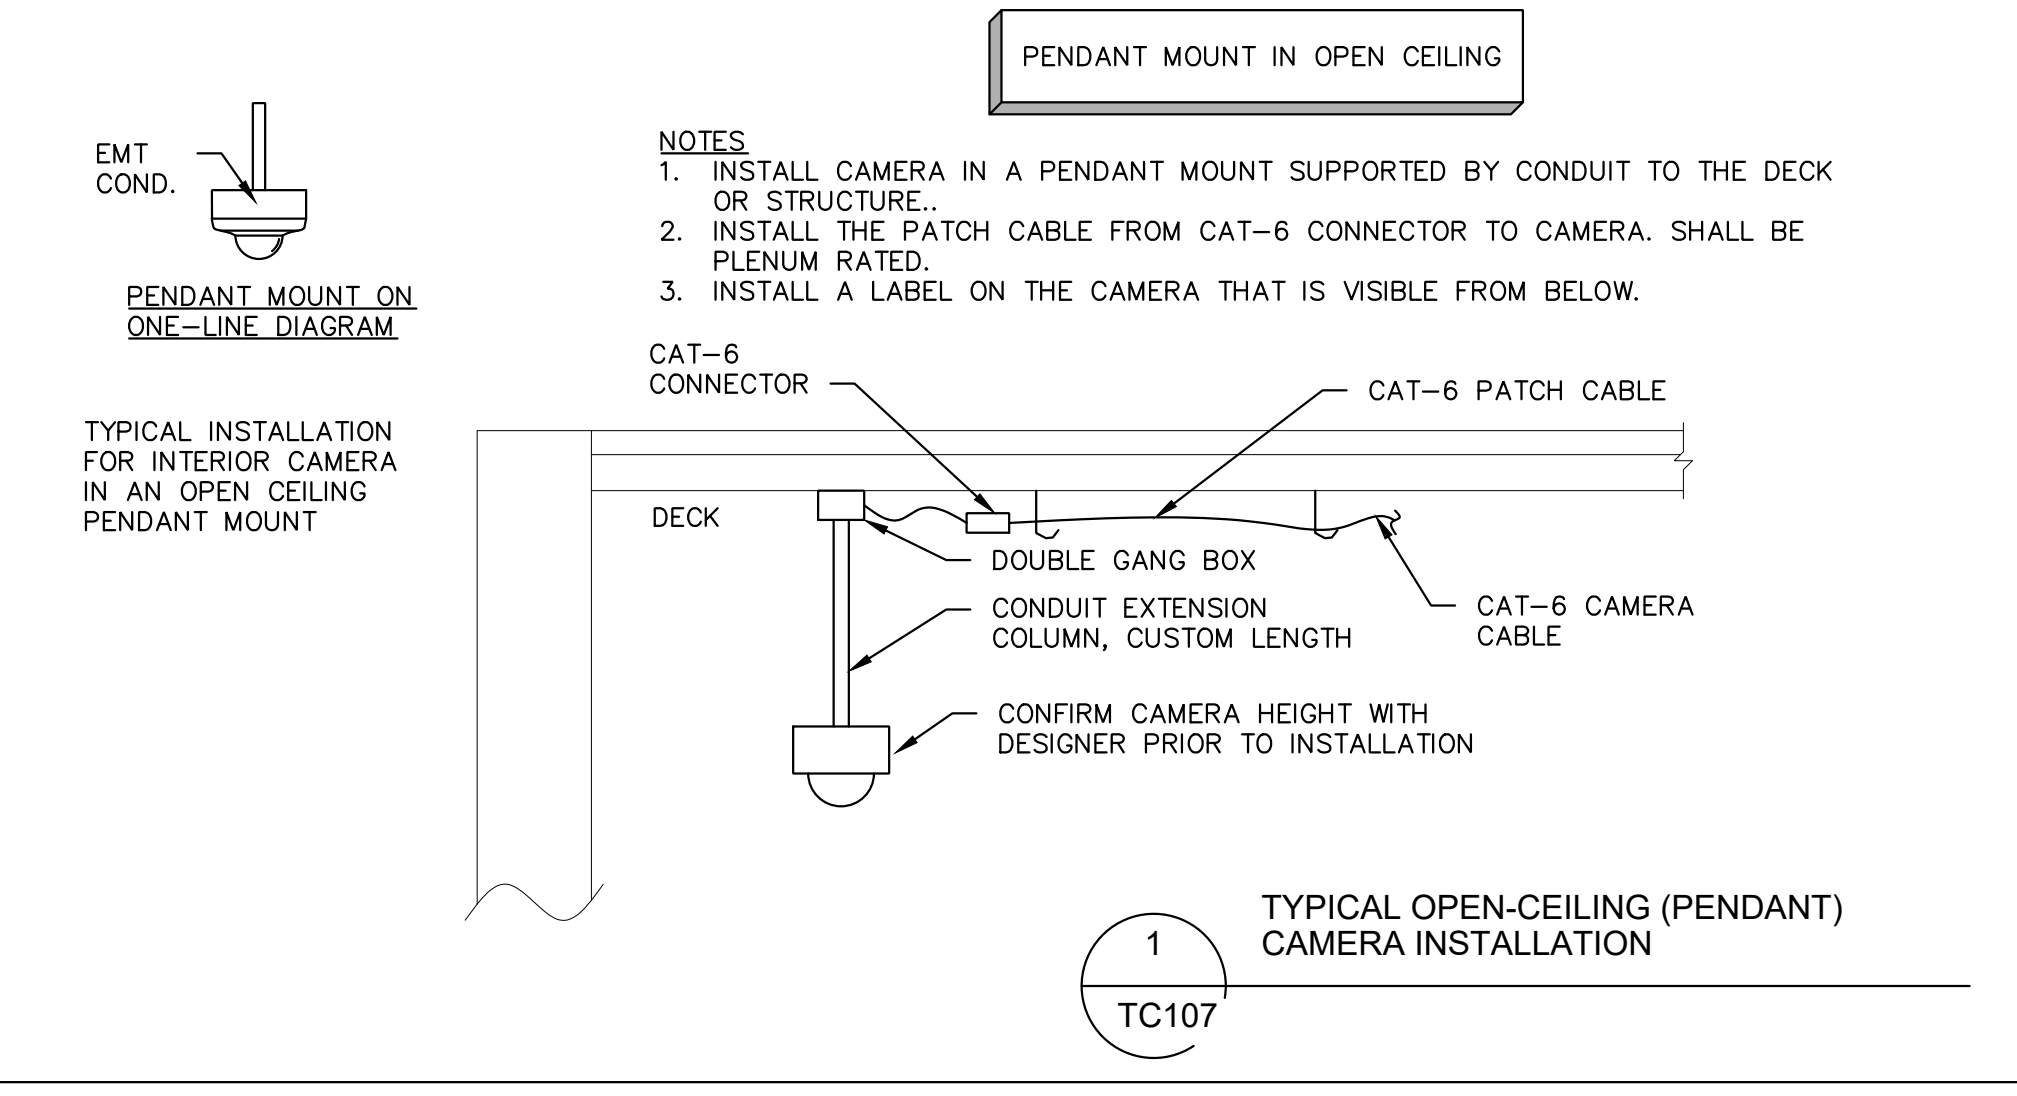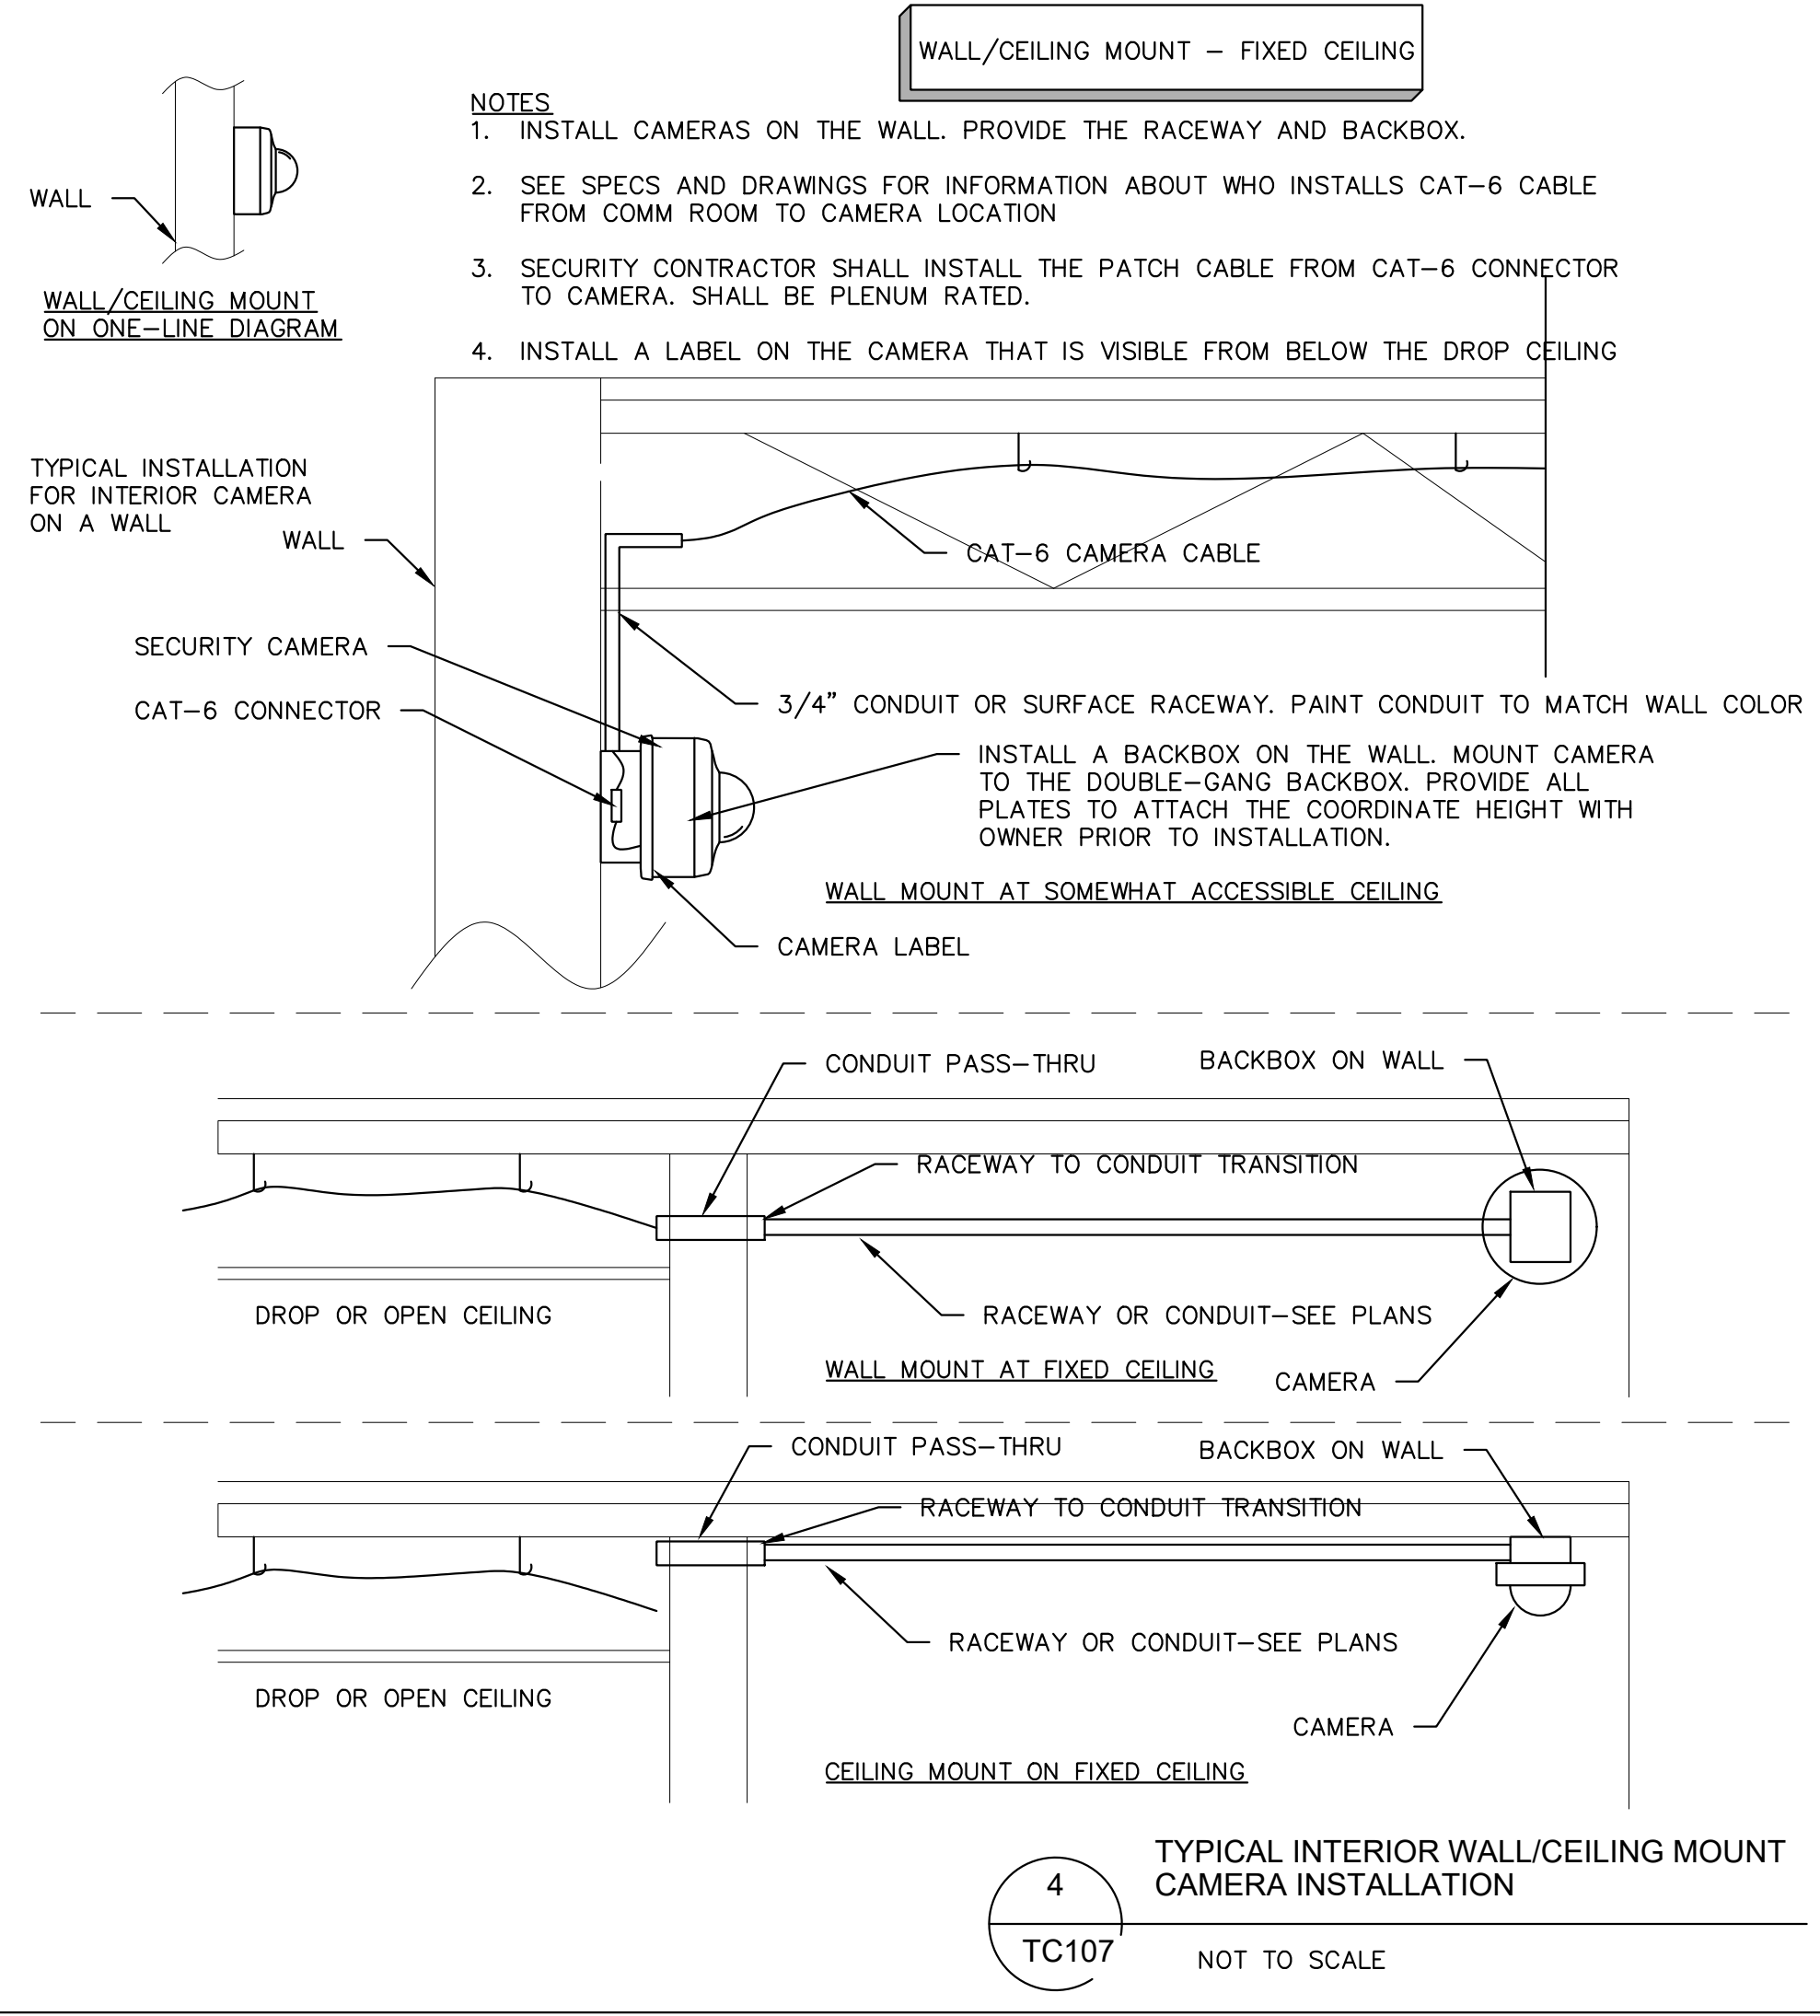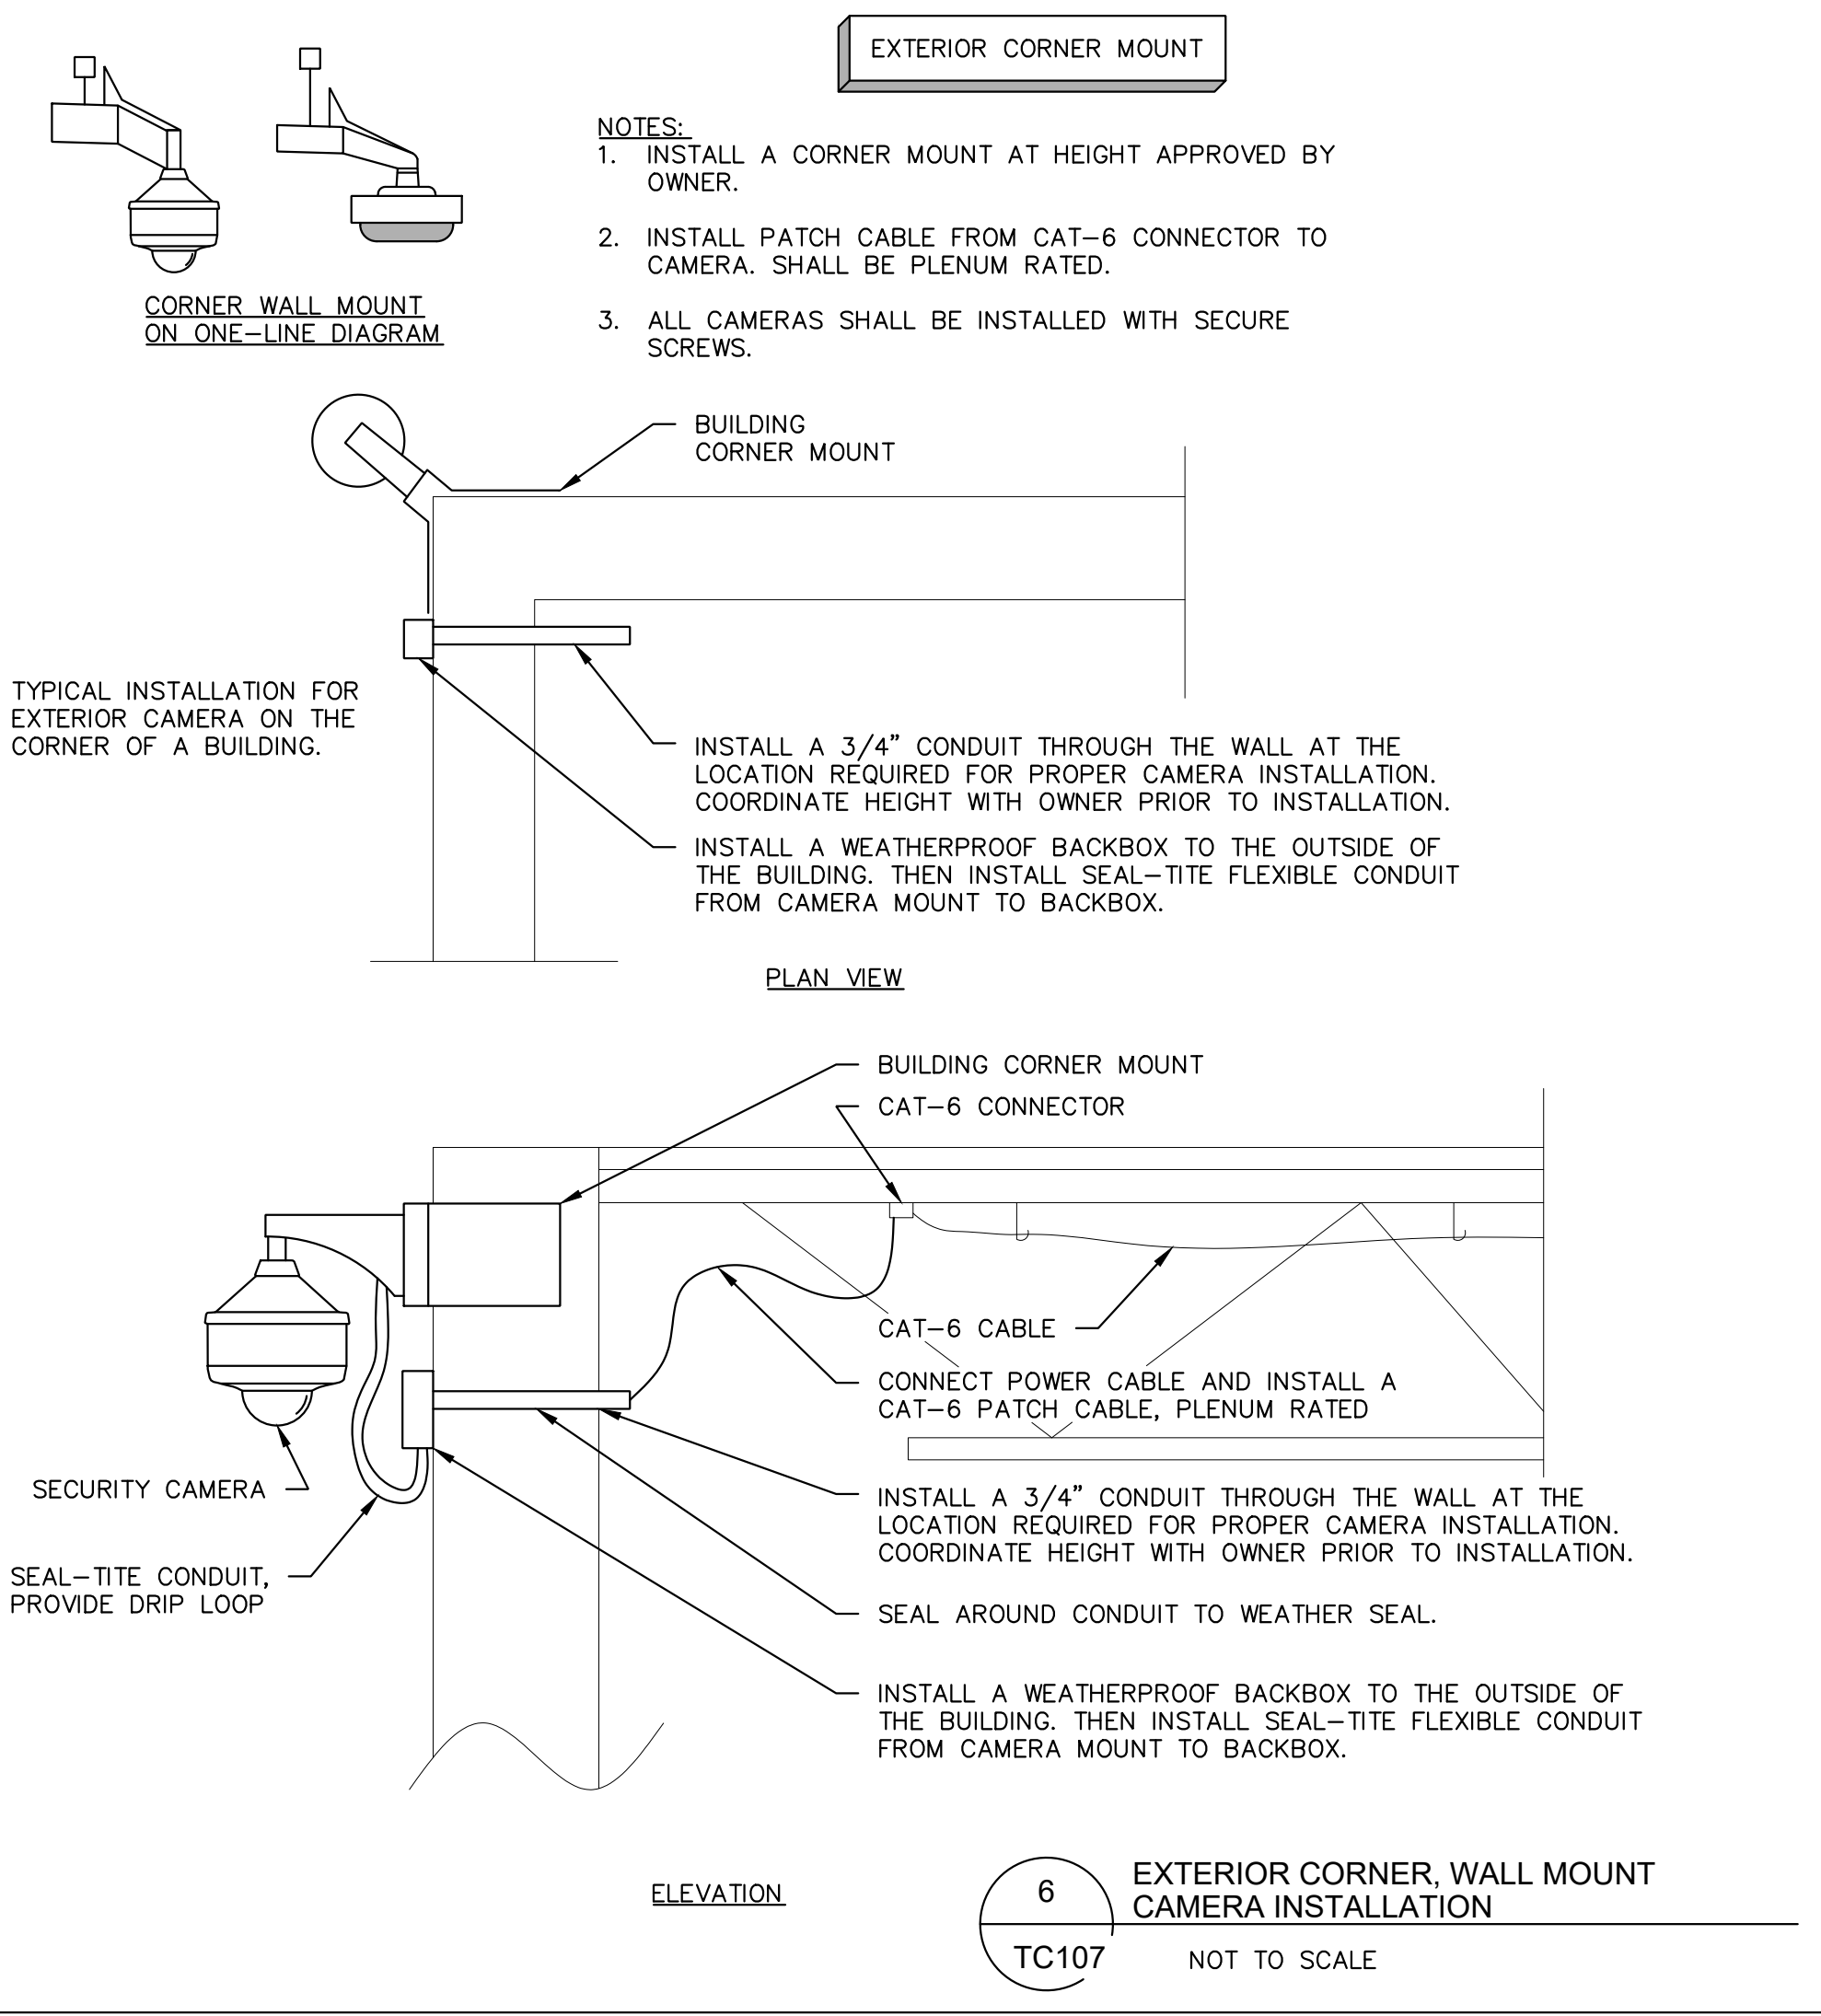

- GENERAL VIDEO SECURITY NOTES:**
- CONTRACTOR SHALL PROVIDE ALL PATCH CABLES AT THE CAMERA AND AT THE COMM ROOM. MATCH COLOR OF CAMERA CABLE. 12" LONG AT SWITCH. 10' AT THE CAMERA.
 - THE CAMERA CABLES SHALL TRANSPORT ALL VIDEO SIGNALS & CONTROL SIGNALS & POWER SIGNALS.
 - CONTRACTOR SHALL PROVIDE THE CORRECT CAMERA MOUNT BASED ON CAMERA LOCATION AND STRUCTURE AVAILABLE. PROVIDE RECESSED CAMERA MOUNTS IN DROP CEILINGS. REVIEW PLANS AND SITE PRIOR TO ORDERING.
 - CAMERAS IN DROP CEILINGS SHALL BE RECESSED MOUNT. PROVIDE BACKPLATE OR T-BAR FOR SUPPORT FROM GRID, NOT JUST THE TILE.
 - CONTRACTOR SHALL MEET WITH THE OWNER AND DETAIL ALL THE CAPABILITIES OF THE SYSTEM. THE CONFIGURATION OF THE RECORDER AND CAMERAS SHALL BE BASED ON THESE MEETINGS WITH THE OWNER. TAKE NOTES DURING THE MEETINGS. SUBMIT WITH AS-BUILTS.
 - WHERE THE CAMERA IS NOT INSTALLED INTO A DROP CEILING THE CONTRACTOR SHALL PROVIDE A MOUNT AND HOUSING. PROVIDE WEATHERPROOF MOUNTS ON EXTERIOR CAMERAS.
 - EXTERIOR CAMERAS SHALL BE RATED FOR OUTDOOR INSTALLATION AND SHALL PROVIDE THEIR OWN HEAT.
 - CONTRACTOR SHALL PROVIDE THE CORRECT LENS TO EACH CAMERA BASED ON THE INSTALLED LOCATION AND THE OWNERS REQUIREMENTS FOR THE FIELD OF VIEW. WORK WITH THE OWNER DURING INSTALLATION.

- ALL CAMERAS SHALL CONNECT TO THE IP NETWORK SWITCH IN THE COMMUNICATIONS ROOM. CONTRACTOR SHALL WORK WITH THE OWNER ON CONFIGURATION OF THE ETHERNET SWITCH.
- CONTRACTOR SHALL MEET WITH THE OWNER AND DETAIL ALL THE CAPABILITIES OF THE SYSTEM. THE CONFIGURATION OF THE RECORDER AND CAMERAS SHALL BE BASED ON THESE MEETINGS WITH THE OWNER. TAKE NOTES DURING THE MEETINGS. SUBMIT WITH AS-BUILTS.
- PROVIDE A NEW NETWORK VIDEO RECORDER TO SUPPORT THESE NEW CAMERAS. EXISTING NVR UTILIZE THE BOSCH VIDEO SECURITY SYSTEM.
- INTEGRATE THE EXISTING CAMERAS WITH THE ACCESS CONTROL SYSTEM SO THAT AN INTERCOM CALL BRINGS UP THE CORRESPONDING CAMERA AT THE CENTRAL CONTROL STATION.
- NETWORK VIDEO SECURITY RECORDED SHALL STORE VIDEO FOR 30 DAYS. CONNECT TO THE NETWORK AND CONFIGURE ALL CAMERAS ON THE SERVER. NAME AS PER THE OWNERS STANDARDS.
- INSTALL NVR IN THE BASMENT SECURITY ROOM.

- KEYED VIDEO SECURITY NOTES:**
- PROVIDE ALL PATCH CABLES REQUIRED FOR CONNECTION OF ALL CAMERAS AT THE CAMERA AND AT THE NETWORK SWITCH. ALL PATCH CABLES SHALL BE MATCH CABLE COLOR.
 - LABEL THE CAT-6 PATCH PANEL WITH THE CAMERA NUMBER THE CABLE CONNECTS TO. SHALL BE LASER PRINTED. SEE SPECS.
 - SEE SPECIFICATIONS AND BID SCOPES TO DETERMINE WHICH CONTRACTOR IS TO INSTALL AND TERMINATE THE CAT-6 CABLES USED FOR SECURITY CAMERAS.
 - THE SERVER WILL BE LOCATED IN THE BASEMENT SECURITY ROOM. CONTRACTOR SHALL LOAD ALL SOFTWARE REQUIRED TO RECORD AND MANAGE ALL NEW CAMERAS. PROVIDE THE QUANTITY OF SERVERS AND STORAGE AS REQUIRED TO RECORD AND VIEW ALL CAMERAS AS PER THE SPECIFICATIONS.
 - THE SECURITY CONTRACTOR SHALL MEET WITH THE OWNER TO CONFIRM ALL NETWORK SPECIFICATION REQUIREMENTS FOR A VLAN OR OTHER QUALITY OF SERVICE SETTINGS FOR THE CAMERA SYSTEM. PROVIDE AND INSTALL ETHERNET SWITCH.
 - PROVIDE AN SFP MODULE FOR 10 GIGABIT CONNECTIVITY VIA FIBER CABLE INTO THE ETHERNET SWITCH.
 - CONFIGURE THE EXISTING CAMERA SYSTEM TO SUPPORT CAMERA CALL UP THRU CONNECTION TO THE AUDIO INTERCOM SYSTEM. PROVIDE ALL EQUIPMENT AND CONFIGURATION REQUIRED. WHEN AN INTERCOM IS PUSHED THE CAMERA ASSOCIATED WITH THAT CAMERA SHALL POP-UP ON THE OPERATOR CONSOLE.

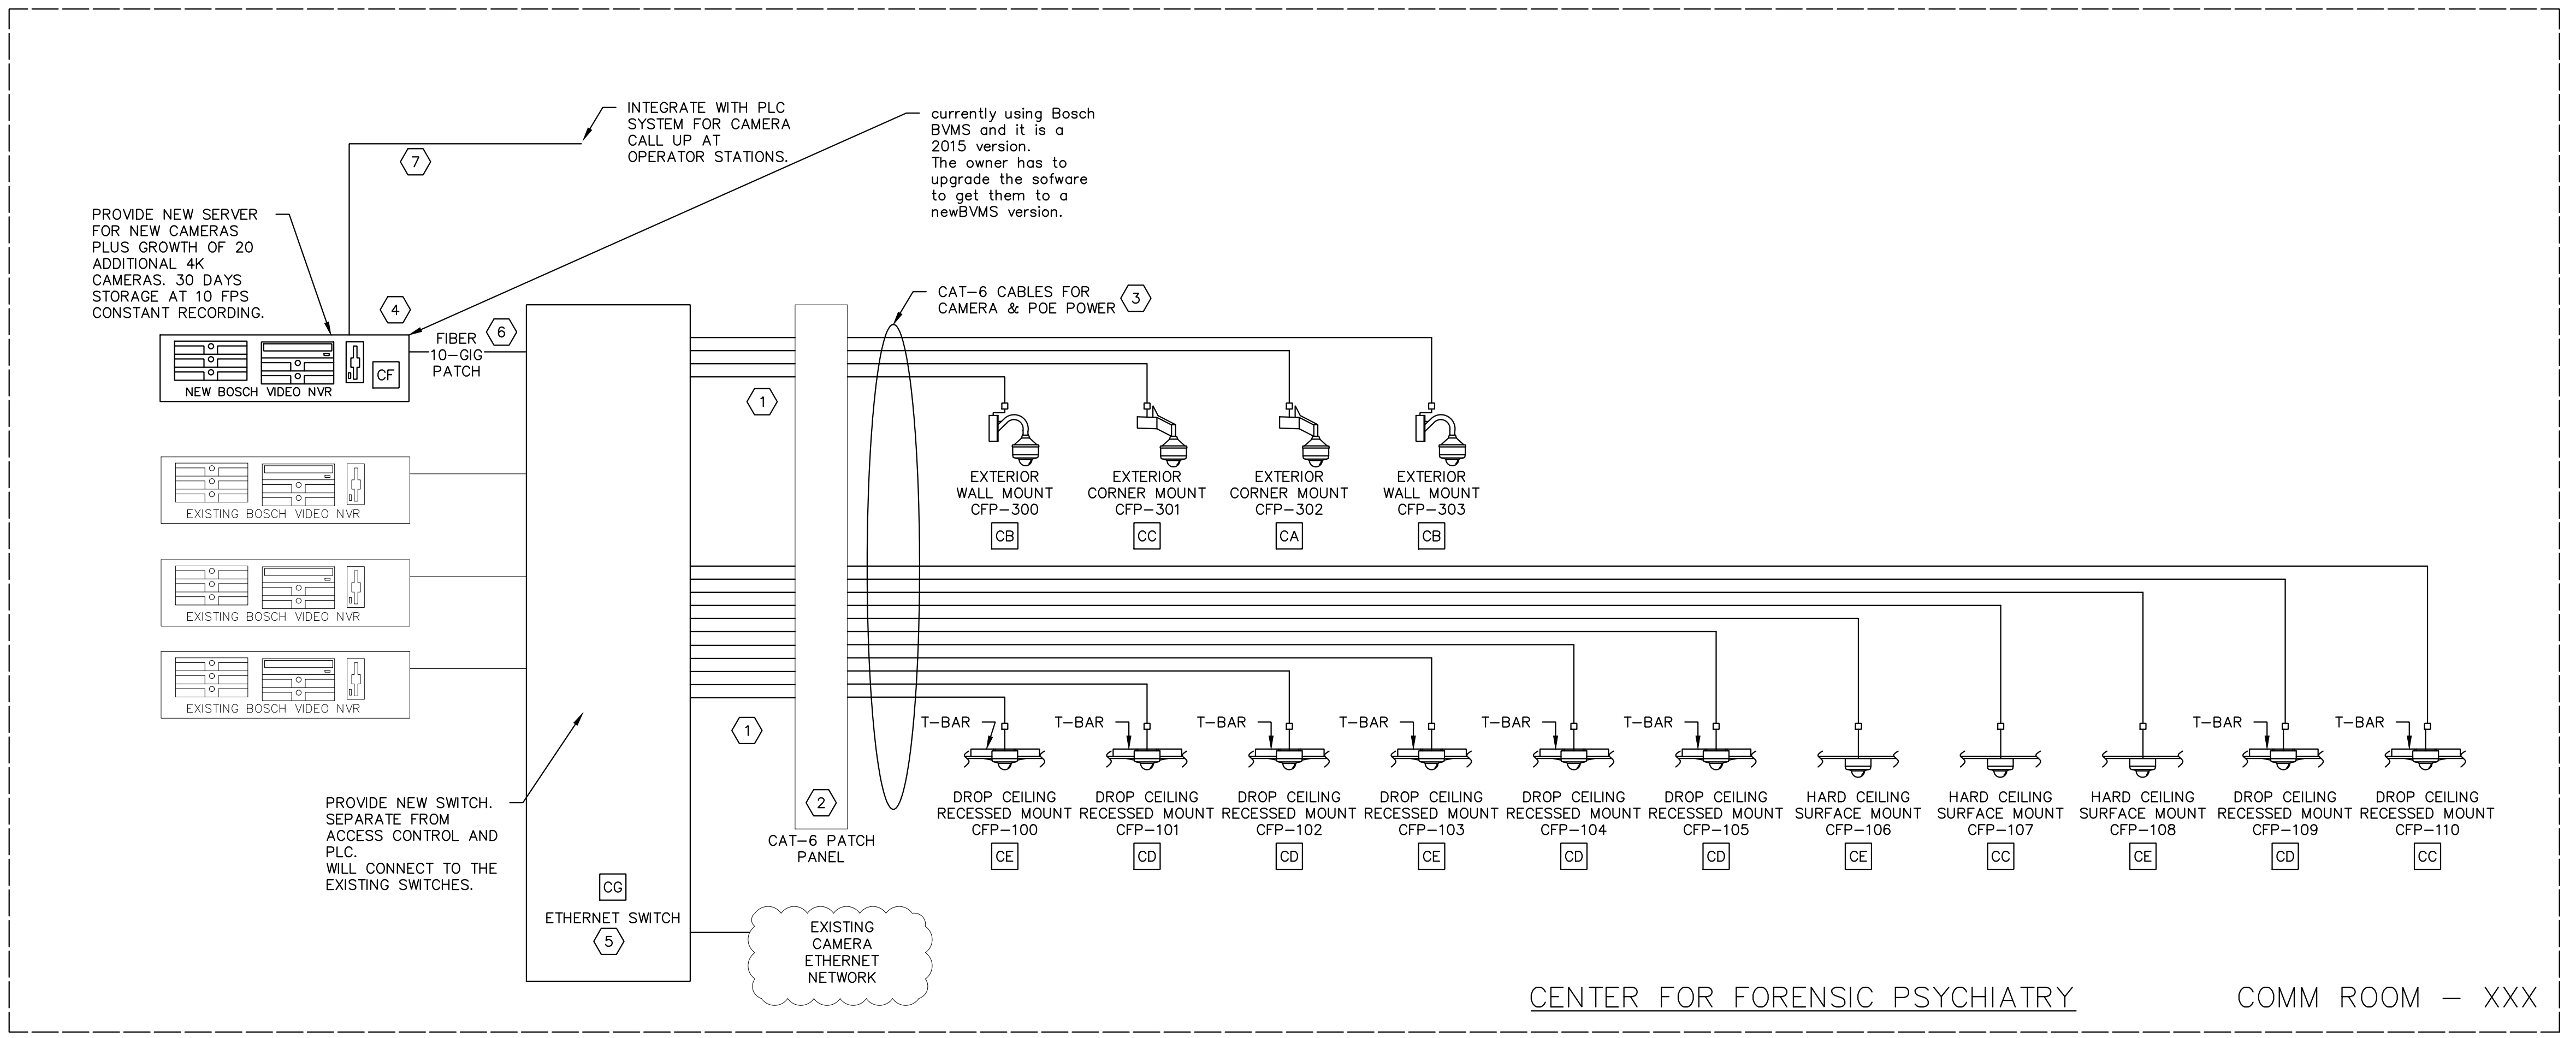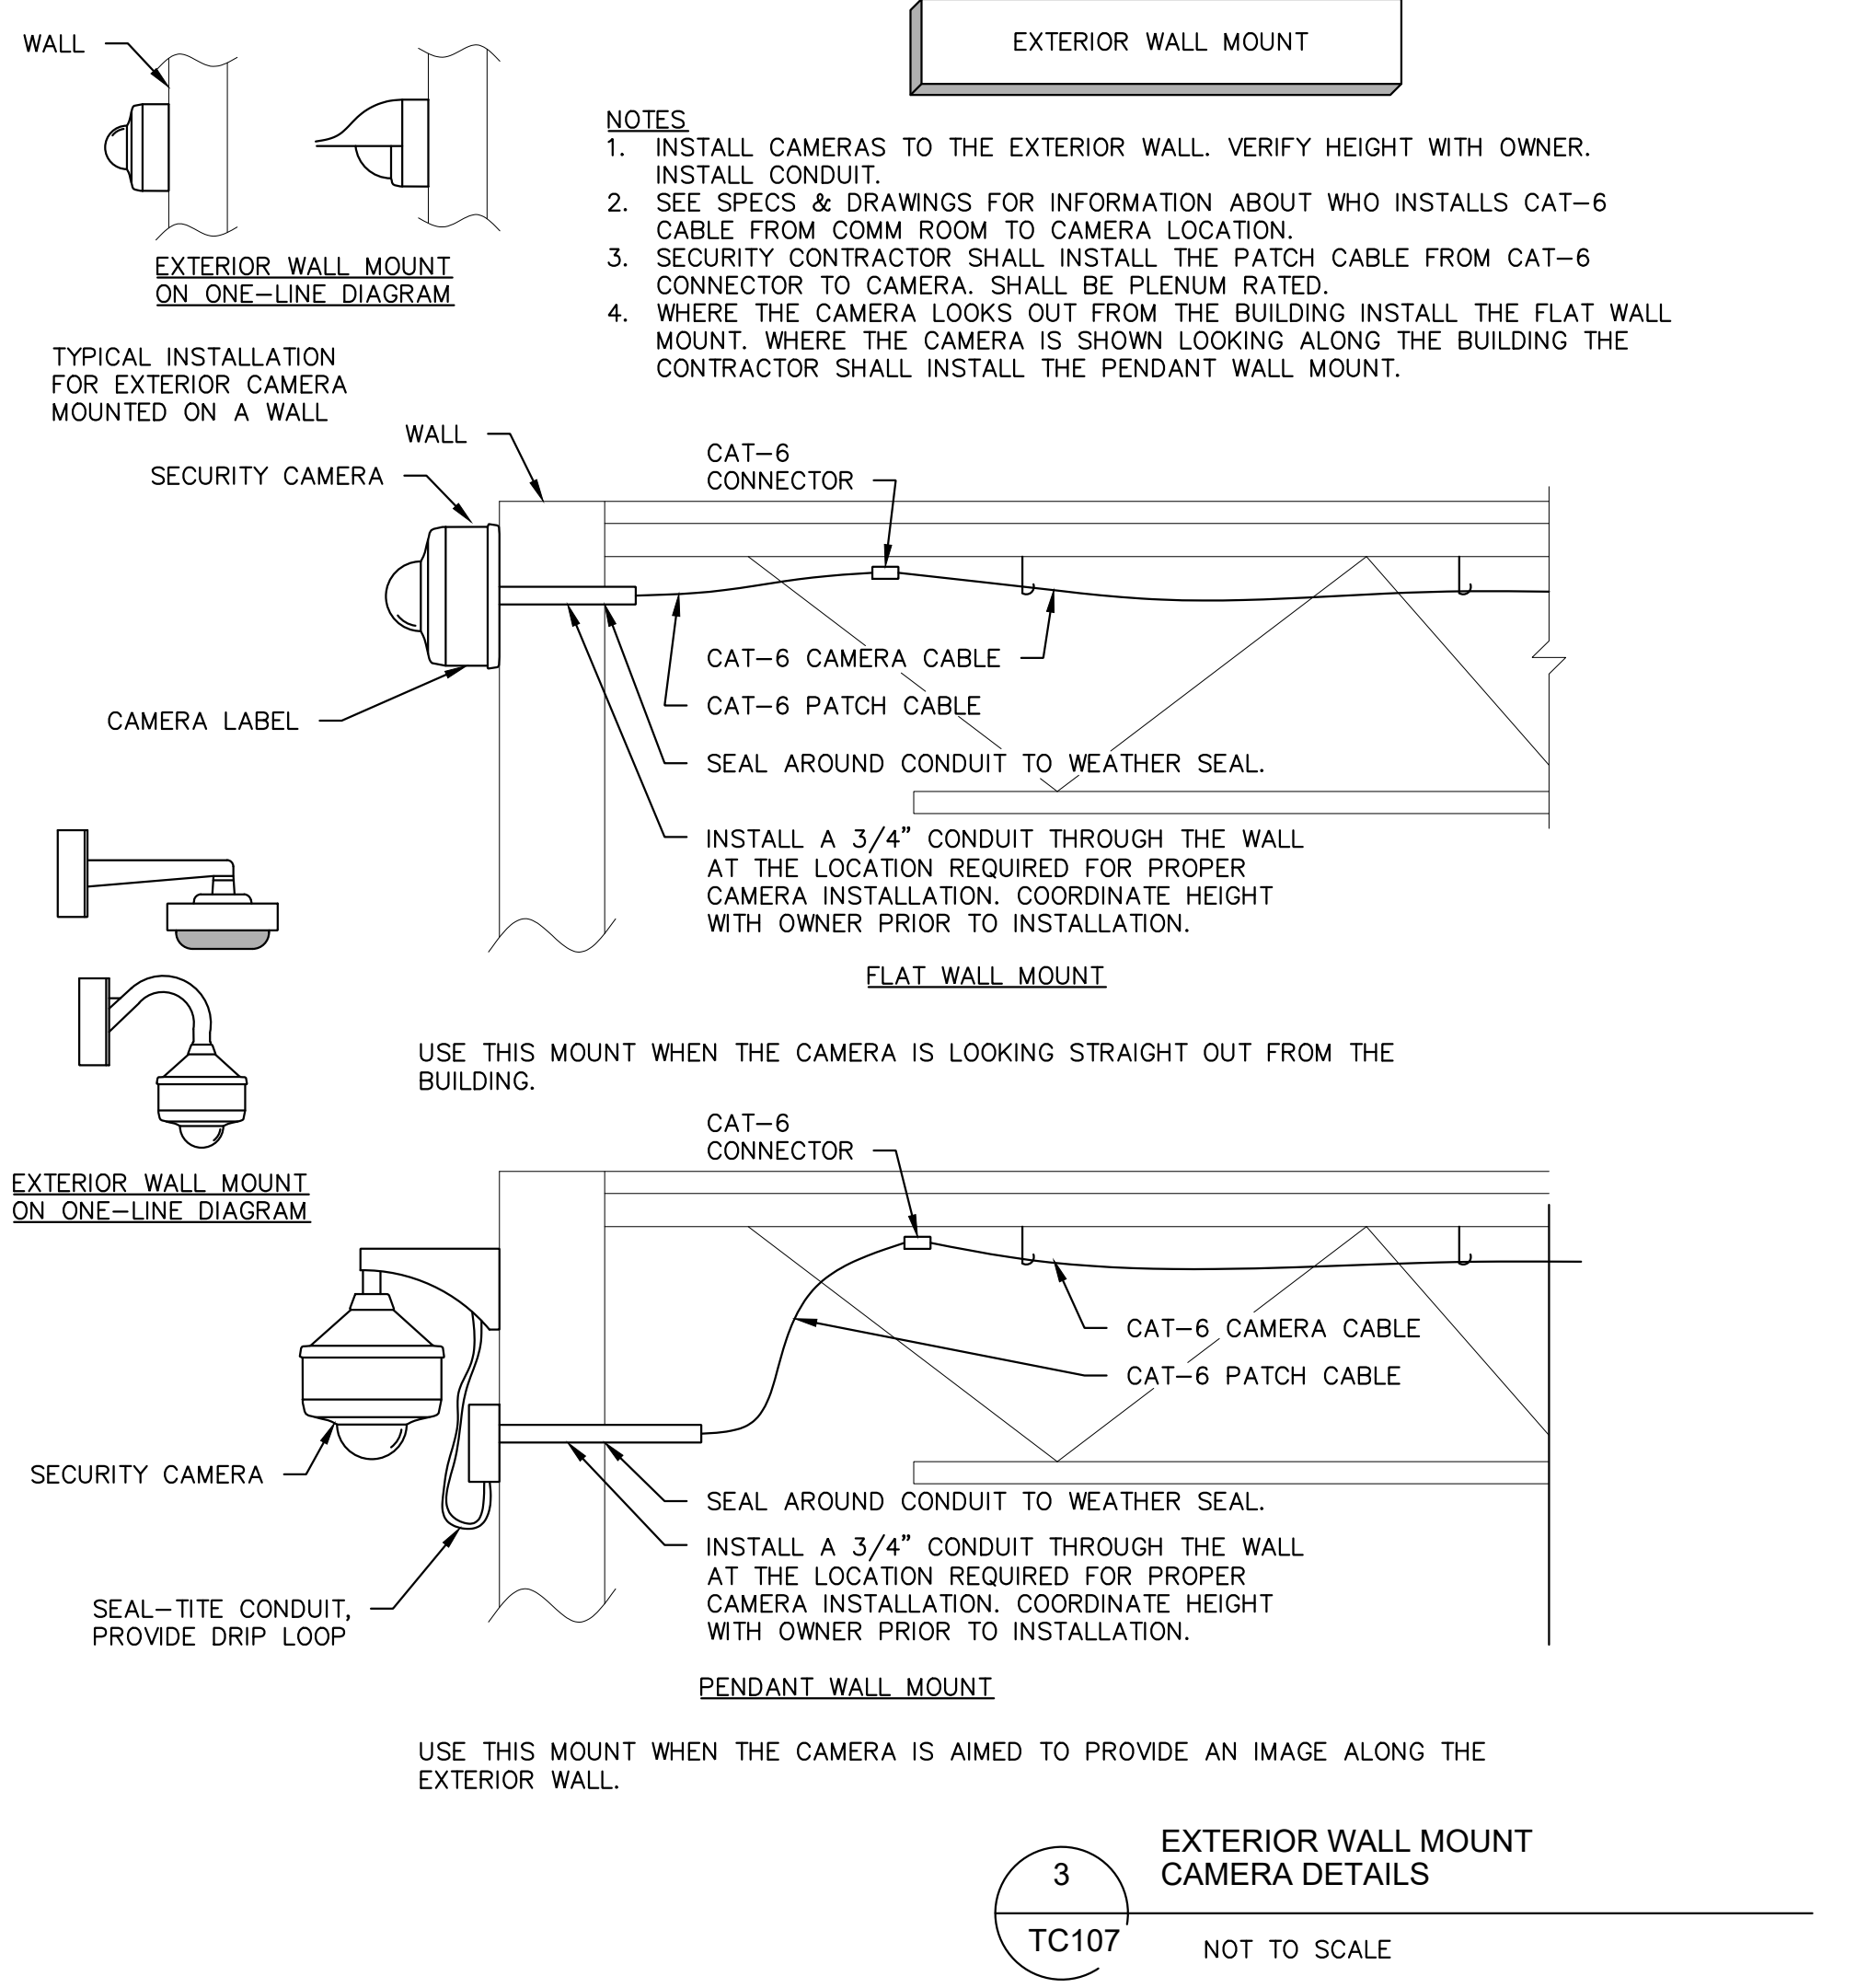

NO.	REVISION	DATE

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM LACH, RA, DIRECTOR

FILE NO.
491/20167.SDW

FUNDING CODE
171CODHHS7255

CONTRACT NO.
Y22003

CommtechDesign
6581 BELDING RD NE STE 101
ROCKFORD, MICHIGAN 49341
WWW.COMMTECHDESIGN.COM

WTA ARCHITECTS
100 S. Jefferson Ave, Suite 601
Saginaw, Michigan 48607
989 752 8107
COPYRIGHT © 2023

PROJECT TITLE
491/20167.SDW - PHASE 500:
CENTER FOR FORENSIC
PSYCHIATRY - CREATE
KITCHEN
SALINE, MICHIGAN

SHEET TITLE
VIDEO SECURITY
SYSTEM DETAILS

PROJECT NUMBER
2021094

PROJECT DATE
SEPTEMBER 6, 2023

CHECKED BY
BWE

SHEET NUMBER
TC107



GENERAL TECH NOTES

1. SECURITY CONTRACTOR SHALL INSTALL ANY CONDUITS & PASS-THRU'S REQUIRED FOR ROUTING CABLES AROUND THE BUILDING IN ADDITION TO THOSE SHOWN.
2. CONTRACTOR SHALL COMPLETE A WALK-THRU PRIOR TO CONSTRUCTION & SHALL VERIFY ALL RACEWAYS & PATHWAYS.
3. ALL CABLES SHALL BE SUPPORTED ABOVE THE DROP CEILING BY J-HOOKS. HOOKS SHALL BE LOCATED NO LESS THAN EVERY 5 FEET.
4. WHERE A CAMERA IS MARKED AS SURFACE MOUNTED ON THE ONE-LINE, THAT CAMERA MAY BE MOUNTED TO THE CEILING OR WALL. PROVIDE A BACKBOX & RACEWAY.

KEYED TECH NOTES

1. BACKPULL EXISTING SHAKER WIRE TO JUNCTION POINT OF NEW AN EXISTING FENCE. DURING CONSTRUCTION, CONFIGURE THE SHAKER WIRE SYSTEM TO END AN NEW EXISTING FENCE JUNCTION LOCATION.
2. REMOVE THE EXISTING STUN FENCE FROM TOP OF EXISTING FENCE.
3. ROUTE NEW STUN FENCE WIRES THRU UNDERGROUND CONDUITS THAT ARE SHOWN ON ELECTRICAL SITE PLAN.
4. MOUNT CAMERA AT 12' AFG
5. MOUNT CAMERA AT 15' AFG
6. TEMPORARILY INSTALL CABLES FROM STUN FENCE CABINET TO EXISTING FENCE TO MAINTAIN STUN FENCE DURING CONSTRUCTION. INSTALL FLEXIBLE CONDUIT AND ATTACH TO THE BUILDING. INSTALL HIGH ENOUGH TO AVOID VEHICLES AND NEW CONSTRUCTION

EXISTING FENCE WITH SHAKER WIRE AND STUN FENCE

JUNCTION POINT OF EXISTING FENCE TO NEW FENCE

BACKPULL AND RE-INSTALL EXISTING SHAKER WIRE SEE TC104/2

NEW FENCE TO BE EQUIPPED WITH SHAKER AND STUN FENCE. SEE SHEET TC104

END OF FENCE AS IT CONNECTS TO BUILDING

1 EXISTING STUN FENCE AND SHAKER WIRE ON EXISTING FENCE

INSTALL NEW STUN FENCE CONDUCTOR. CABLE THRU UNDERGROUND CONDUITS. SEE ELECTRICAL SITE PLAN FOR ROUTING OF CONDUITS

EXISTING STUN FENCE CABINET TO REMAIN. SEE SHEET TC104

GFP-300

GFP-301

GFP-302

GFP-303

NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACHI, RA, DIRECTOR

FILE NO.
 491/20167.SDW

FUNDING CODE CONTRACT NO.
 171CODHHS7255 Y22003

CommtechDesign
 6581 BELDING RD NE STE 101
 ROCKFORD, MICHIGAN 49341
 WWW.COMMTECHDESIGN.COM

WTAARCH.COM
WTA ARCHITECTS
 100 S. Jefferson Ave, Suite 601
 Saginaw, Michigan 48607
 989 752 8107 COPYRIGHT © 2023


PROJECT TITLE
 491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
 PSYCHIATRY - CREATE
 KITCHEN**
 SALINE, MICHIGAN


SHEET TITLE
**TECHNOLOGY SITE
 PLAN**

PROJECT NUMBER SHEET NUMBER
 2021094 TC200

PROJECT DATE
 SEPTEMBER 6, 2023

CHECKED BY
 BWE

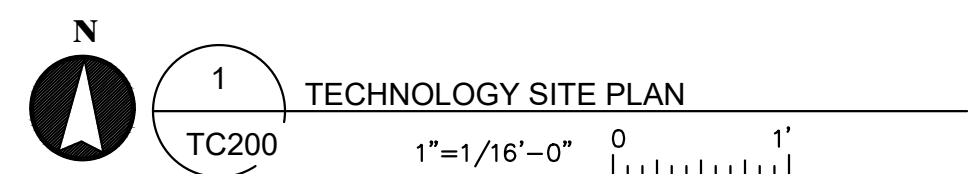

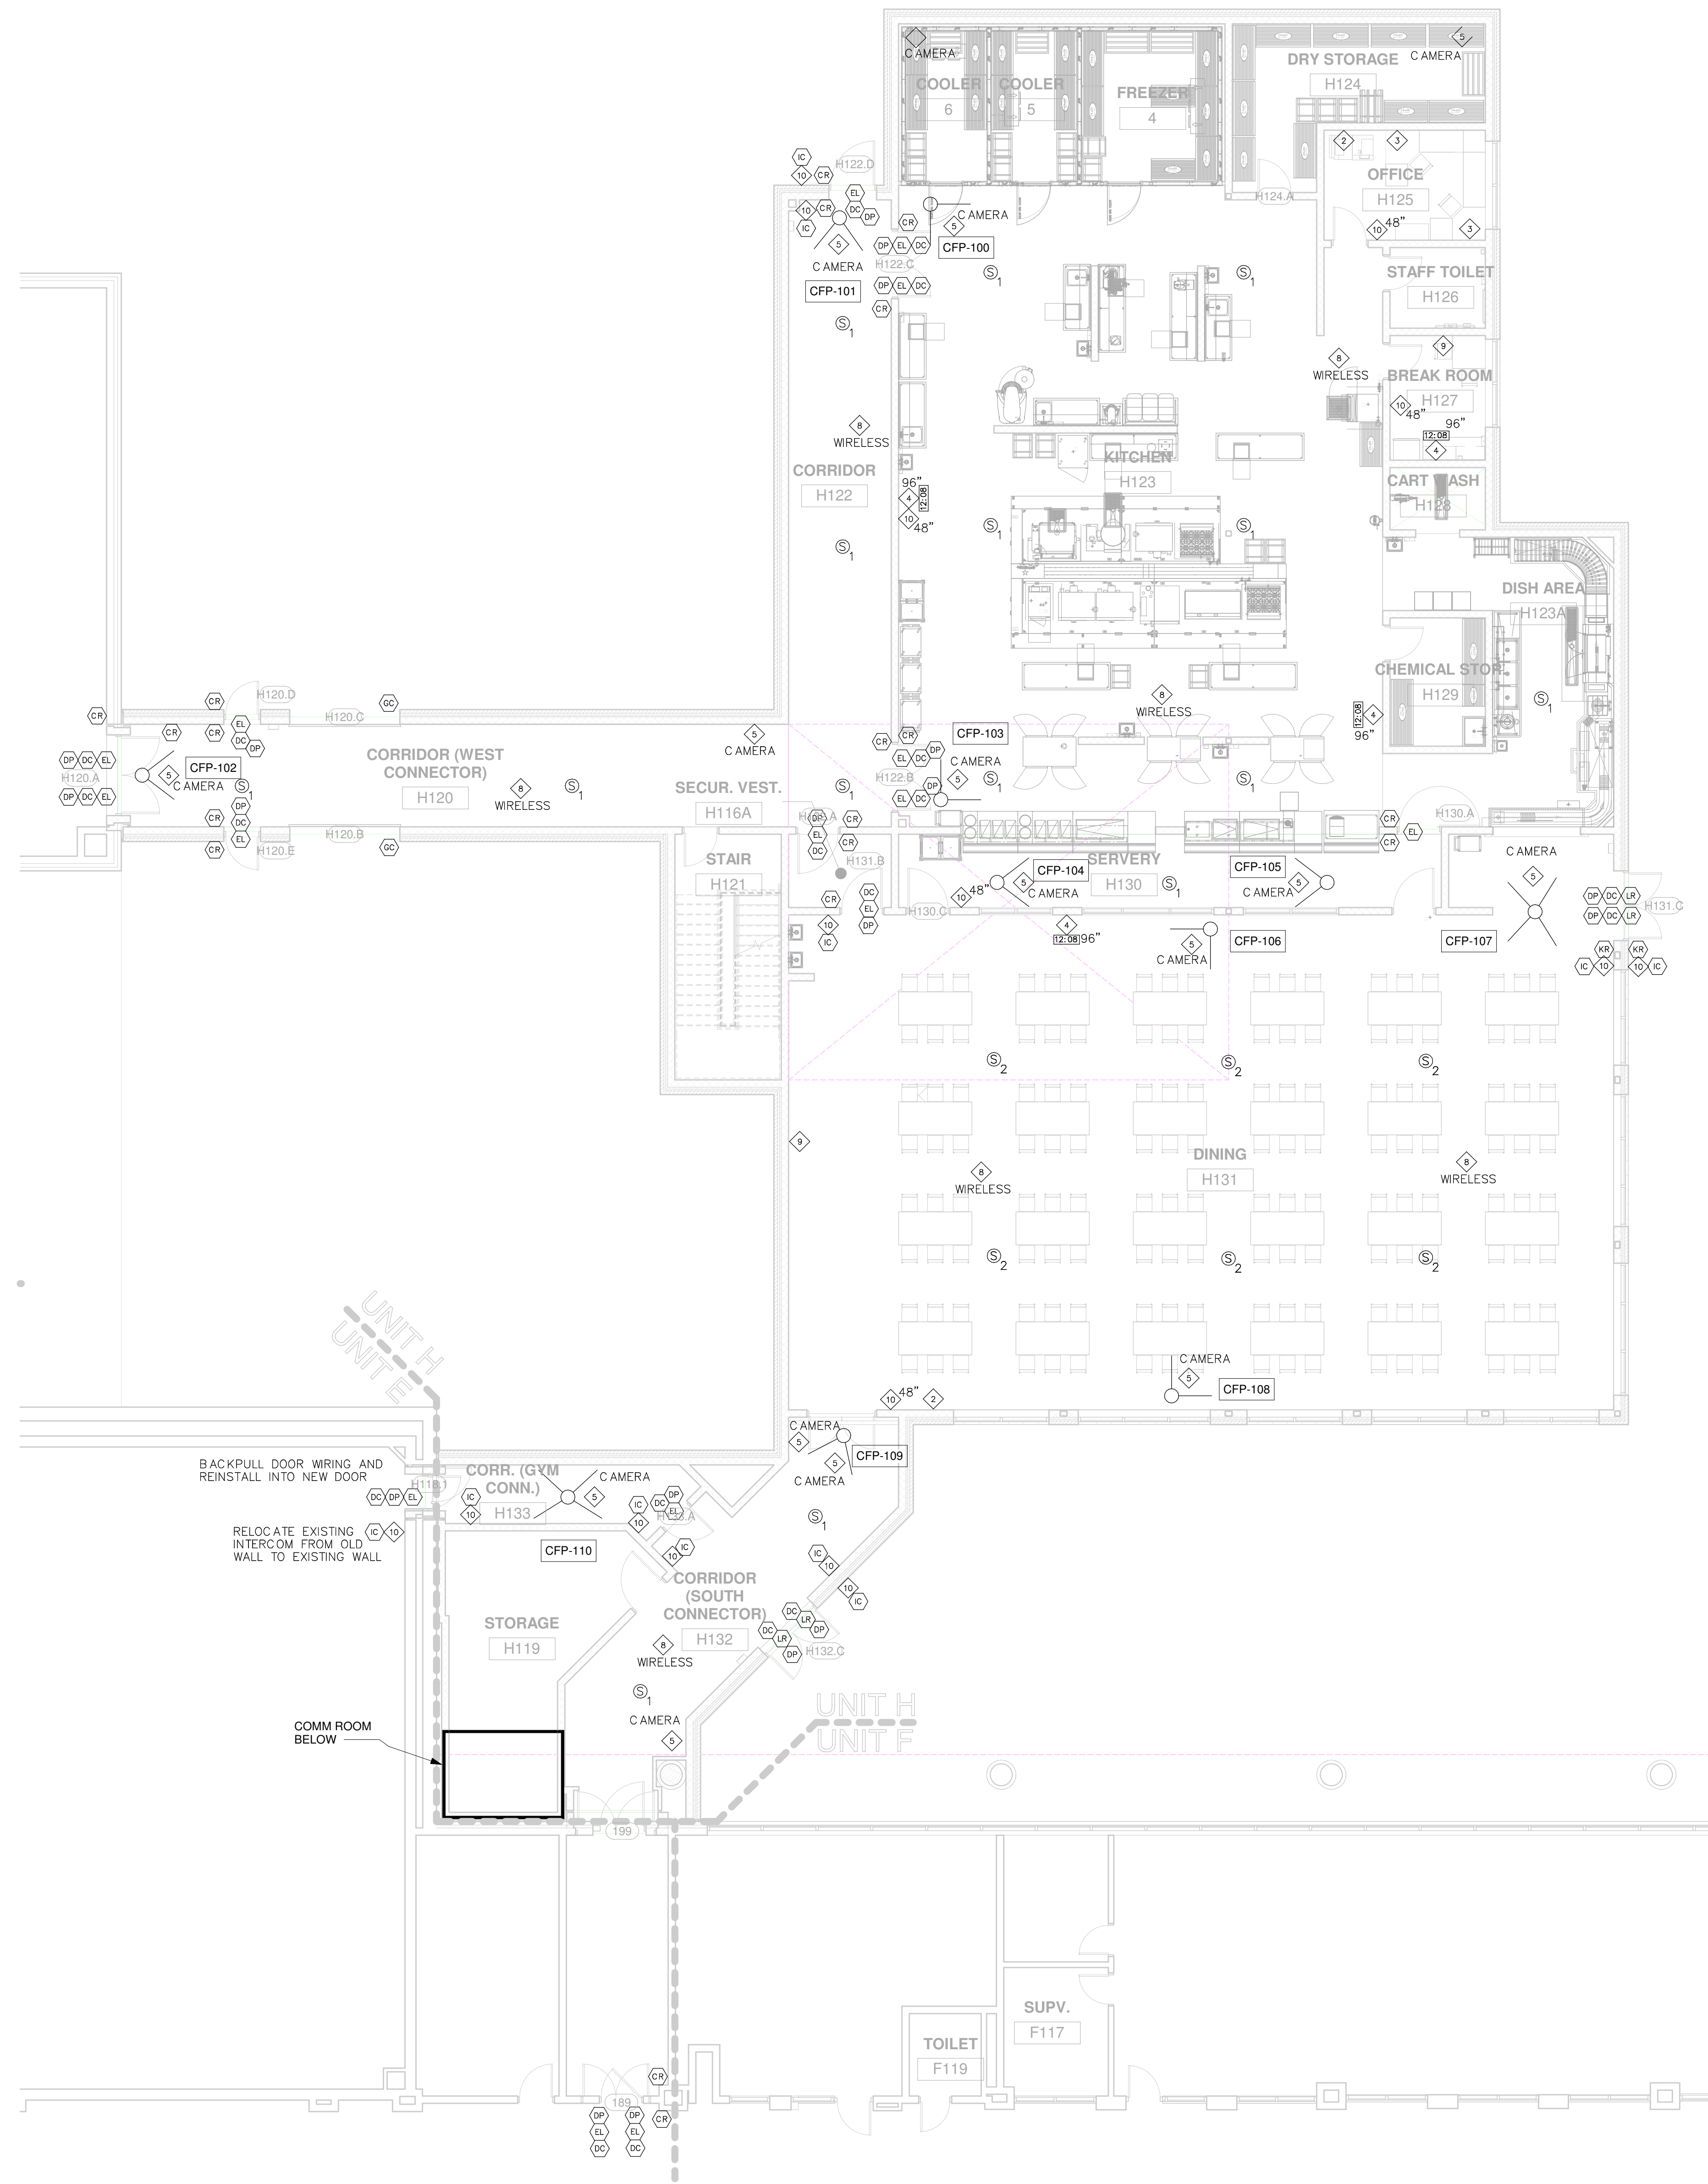

GENERAL TECH NOTES

- SECURITY CONTRACTOR SHALL INSTALL ANY CONDUITS & PASS-THRU'S REQUIRED FOR ROUTING CABLES AROUND THE BUILDING IN ADDITION TO THOSE SHOWN.
- CONTRACTOR SHALL COMPLETE A WALK-THRU PRIOR TO CONSTRUCTION & SHALL VERIFY ALL RACEWAYS & PATHWAYS.
- ALL CABLES SHALL BE SUPPORTED ABOVE THE DROP CEILING BY J-HOOKS. HOOKS SHALL BE LOCATED NO LESS THAN EVERY 5 FEET.
- WHERE A CAMERA IS MARKED AS SURFACE MOUNTED ON THE ONE-LINE, THAT CAMERA MAY BE MOUNTED TO THE CEILING OR WALL. PROVIDE A BACKBOX & RACEWAY.

KEYED TECH NOTES

- BACKPULL EXISTING SHAKER WIRE TO JUNCTION POINT OF NEW AN EXISTING FENCE. DURING CONSTRUCTION, CONFIGURE THE SHAKER WIRE SYSTEM TO END AN NEW EXISTING FENCE JUNCTION LOCATION.
- REMOVE THE EXISTING STUN FENCE FROM TOP OF EXISTING FENCE.
- ROUTE NEW STUN FENCE WIRES THRU UNDERGROUND CONDUITS THAT ARE SHOWN ON ELECTRICAL SITE PLAN.
- MOUNT CAMERA AT 12' AFG
- MOUNT CAMERA AT 15' AFG
- TEMPORARILY INSTALL CABLES FROM STUN FENCE CABINET TO EXISTING FENCE TO MAINTAIN STUN FENCE DURING CONSTRUCTION. INSTALL FLEXIBLE CONDUIT AND ATTACH TO THE BUILDING. INSTALL HIGH ENOUGH TO AVOID VEHICLES AND NEW CONSTRUCTION


NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, R.A. DIRECTOR

FILE NO.
 491/20167.SDW

FUNDING CODE
 171CODHS7255

CONTRACT NO.
 Y22003

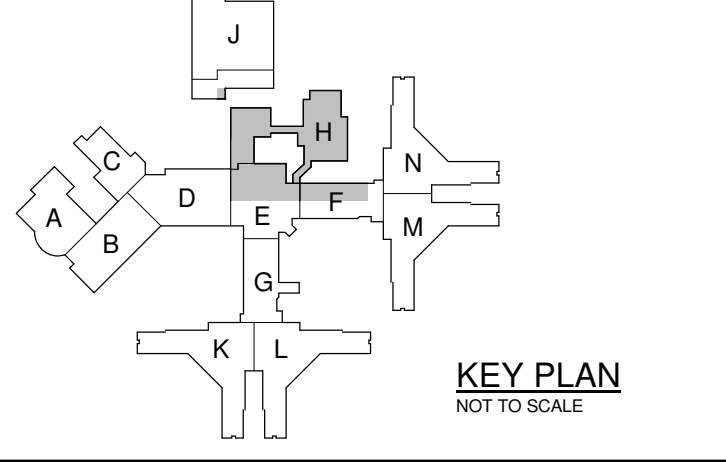

WTA ARCHITECTS

100 S. Jefferson Ave., Suite 601
 Saginaw, Michigan 48607
 989 752 8107

PROJECT TITLE
 491/20167.SDW - PHASE 500:

CENTER FOR FORENSIC PSYCHIATRY - CREATE KITCHEN
 SALINE, MICHIGAN


SHEET TITLE
FIRST FLOOR TECHNOLOGY PLAN

PROJECT NUMBER
2021094

PROJECT DATE
 SEPTEMBER 6, 2023

CHECKED BY
 BWE

SHEET NUMBER
TC201

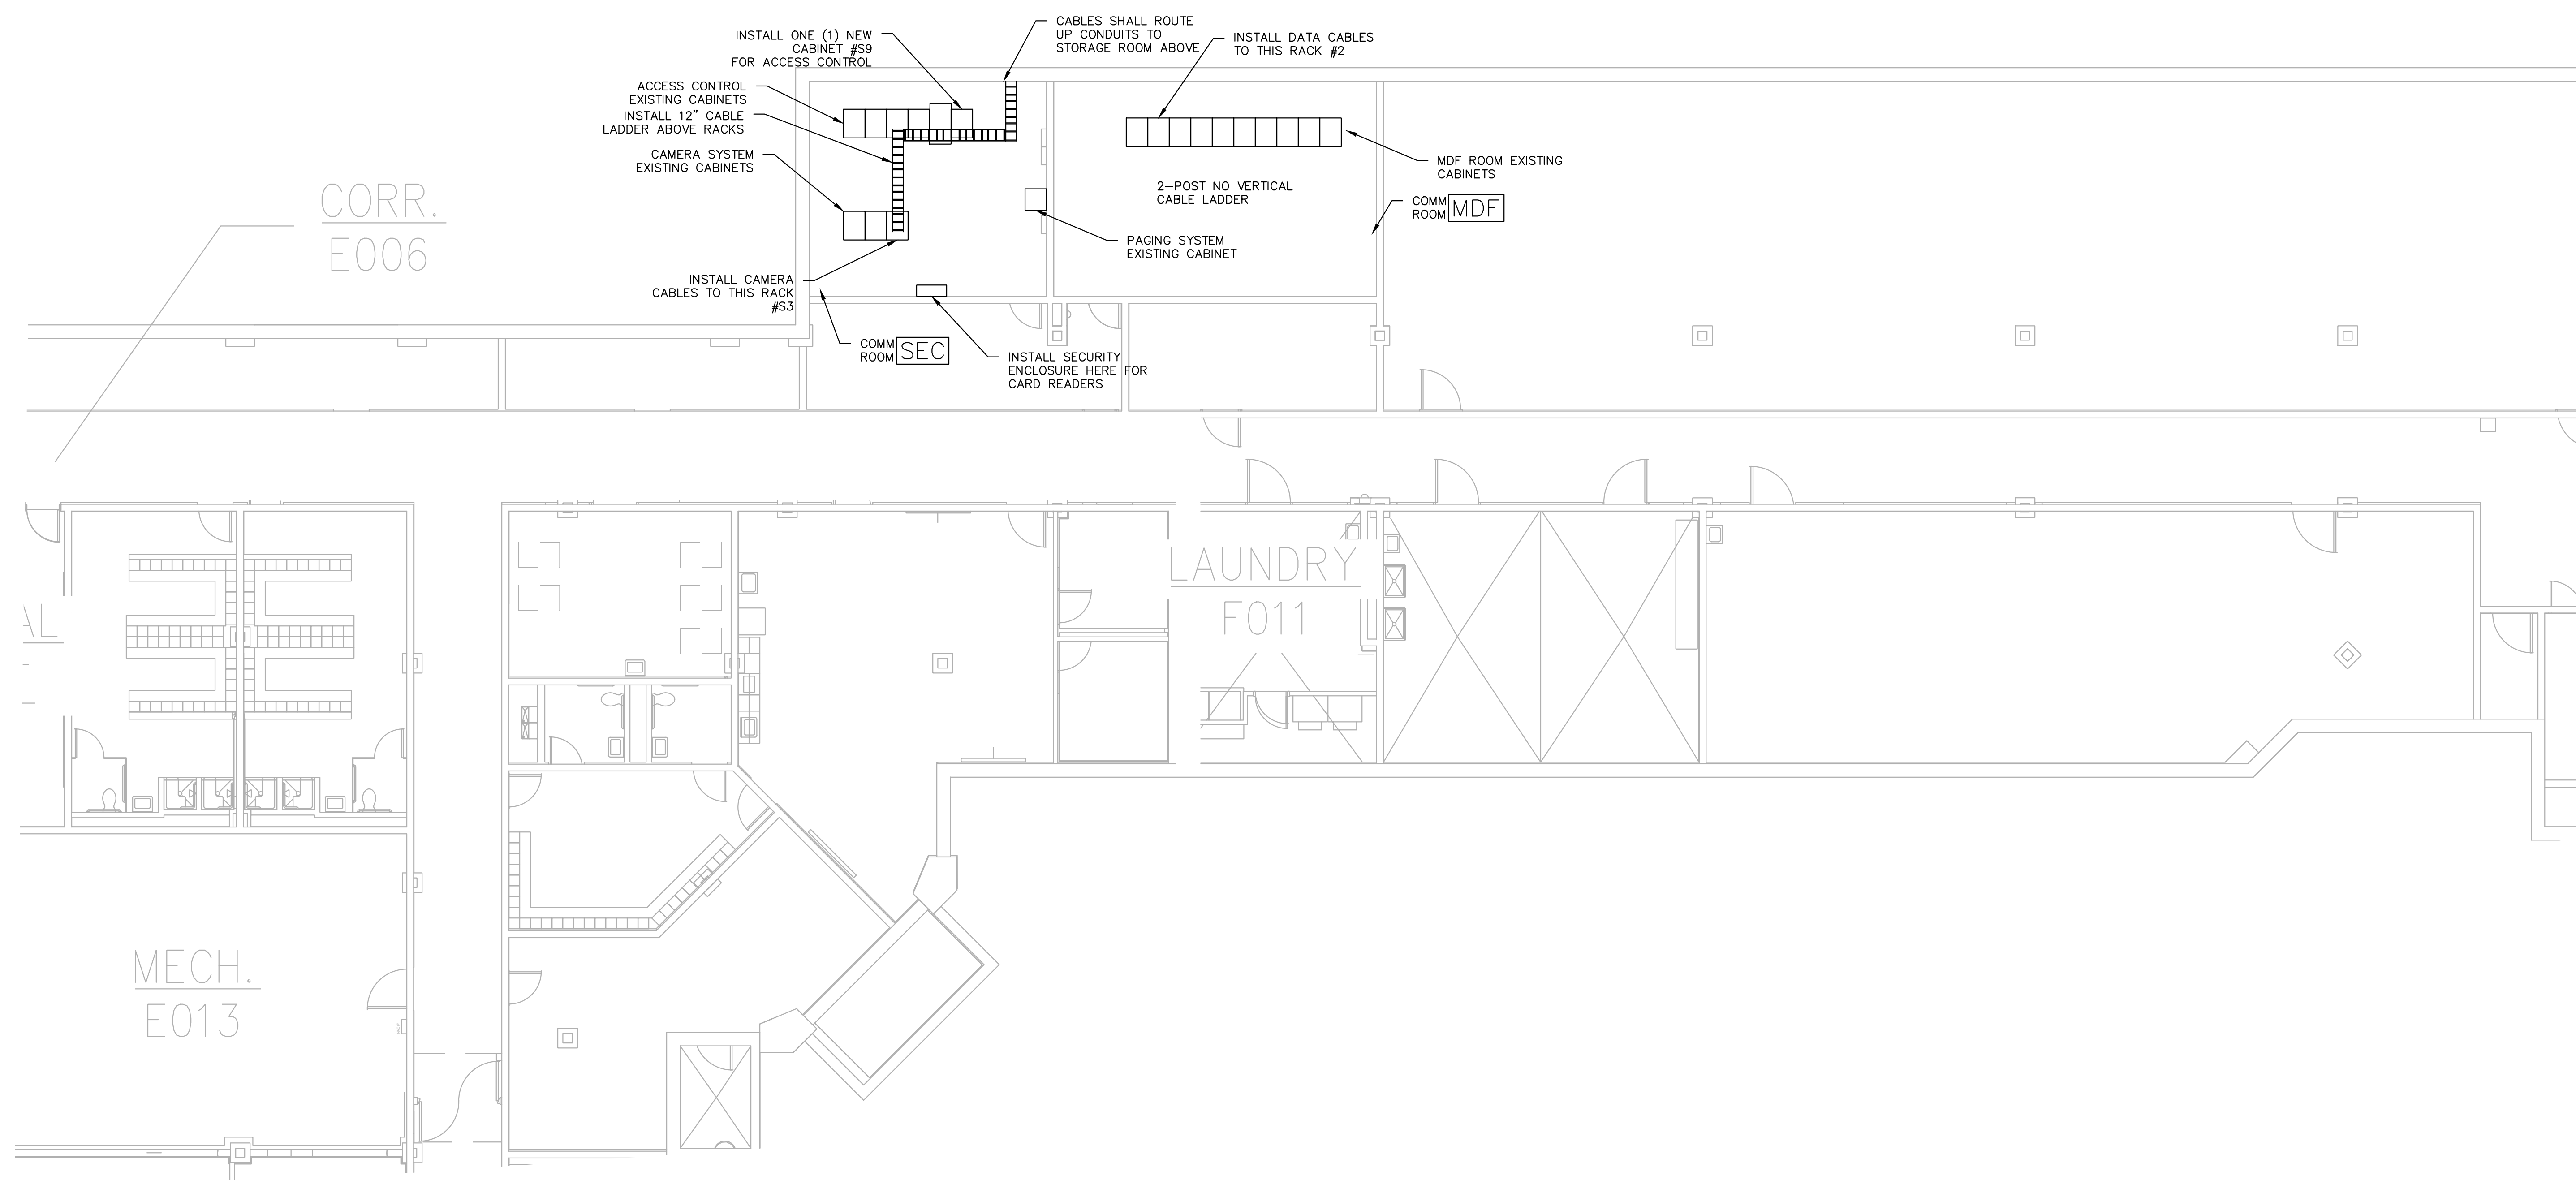

GENERAL TECH NOTES

1. SECURITY CONTRACTOR SHALL INSTALL ANY CONDUITS & PASS-THRU'S REQUIRED FOR ROUTING CABLES AROUND THE BUILDING IN ADDITION TO THOSE SHOWN.
2. CONTRACTOR SHALL COMPLETE A WALK-THRU PRIOR TO CONSTRUCTION & SHALL VERIFY ALL RACEWAYS & PATHWAYS.
3. ALL CABLES SHALL BE SUPPORTED ABOVE THE DROP CEILING BY J-HOOKS. HOOKS SHALL BE LOCATED NO LESS THAN EVERY 5 FEET.
4. WHERE A CAMERA IS MARKED AS SURFACE MOUNTED ON THE ONE-LINE, THAT CAMERA MAY BE MOUNTED TO THE CEILING OR WALL. PROVIDE A BACKBOX & RACEWAY.

KEYED TECH NOTES

1. BACKPULL EXISTING SHAKER WIRE TO JUNCTION POINT OF NEW AN EXISTING FENCE. DURING CONSTRUCTION, CONFIGURE THE SHAKER WIRE SYSTEM TO END AN NEW EXISTING FENCE JUNCTION LOCATION.
2. REMOVE THE EXISTING STUN FENCE FROM TOP OF EXISTING FENCE.
3. ROUTE NEW STUN FENCE WIRES THRU UNDERGROUND CONDUITS THAT ARE SHOWN ON ELECTRICAL SITE PLAN.
4. MOUNT CAMERA AT 12' AFG
5. MOUNT CAMERA AT 15' AFG
6. TEMPORARILY INSTALL CABLES FROM STUN FENCE CABINET TO EXISTING FENCE TO MAINTAIN STUN FENCE DURING CONSTRUCTION. INSTALL FLEXIBLE CONDUIT AND ATTACH TO THE BUILDING. INSTALL HIGH ENOUGH TO AVOID VEHICLES AND NEW CONSTRUCTION

NO.	REVISION	DATE

STATE OF MICHIGAN
 DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
 FACILITIES AND BUSINESS SERVICES ADMINISTRATION
 DESIGN AND CONSTRUCTION DIVISION
 ADAM LACH, RA, DIRECTOR

FILE NO.
 491/20167.SDW

FUNDING CODE CONTRACT NO.
 171CODHHS7255 Y22003

CommtechDesign
 6581 BELDING RD NE STE 101
 ROCKFORD, MICHIGAN 49341
 WWW.COMMTECHDESIGN.COM

WTAARCH.COM
WTA ARCHITECTS
 100 S. Jefferson Ave, Suite 601
 Saginaw, Michigan 48607
 989 752 8107 COPYRIGHT © 2023

PROJECT TITLE
 491/20167.SDW - PHASE 500:
**CENTER FOR FORENSIC
 PSYCHIATRY - CREATE
 KITCHEN**
 SALINE, MICHIGAN

SHEET TITLE
**BASEMENT
 TECHNOLOGY PLAN
 AREA 100**

PROJECT NUMBER 2021094	SHEET NUMBER TC201A
PROJECT DATE SEPTEMBER 6, 2023	
CHECKED BY BWE	

