

RENOVATE ARMORY, JACKSON (WEST) ARMORY

2700 W ARGYLE ST., JACKSON, MI

100% SUBMITTAL

DMVA PROJECT NO.: 2622825007
DTMB: FILE/INDEX NO.: 511/21336.CAK

ARCHITECTURAL & STRUCTURAL ENGINEERING:
SIDOCK GROUP, INC.
45650 GRAND RIVER AVE., NOVI, MI 48374,
(248) 349-4500

CIVIL ENGINEERING & LANDSCAPE
ARCHITECTURE: NOWAK & FRAUS ENGINEERS
46777 WOODWARD AVE., PONTIAC, MI 48342,
(248) 332-7931

MECHANICAL ENGINEERING: MATRIX
CONSULTING ENGINEERS, INC. 544 CHERBOURG
DRIVE, LANSING, MI 48917, (517) 487-2511

ELECTRICAL ENGINEERING: MATRIX
CONSULTING ENGINEERS, INC. 544 CHERBOURG
DRIVE, LANSING, MI 48917, (517) 487-2511

CODE INFORMATION

BUILDING CODE: 2021 MICHIGAN BUILDING CODE
2021 MICHIGAN REHAB CODE
FOR EXISTING BUILDINGS

CONSTRUCTION CLASSIFICATION: II-B (FULLY SPRINLERED)

OCCUPANCY GROUP: MIXED OCCUPANCY, SEPARATED:
A-2 (ASSEMBLY),
A-3 (ASSEMBLY),
B (BUSINESS),
S-1 (MODERATE-HAZARD STORAGE)
S-2 (LOW-HAZARD STORAGE),

PROJECT INFORMATION

BUILDING DATA
GROSS BUILDING AREA:
MAIN LEVEL
EXISTING 36,409 S.F.
NEW 1,550 S.F.
SUBTOTAL 37,959 S.F.

LOWER LEVEL
EXISTING 6,537 S.F.
NEW 8,496 S.F.
SUBTOTAL 15,033 S.F.

TOTAL 52,992 S.F.

BUILDING HEIGHT
ALLOWABLE: MAX (PER MBC TABLE 504.3, 504.4)
A-3 OCC. GROUP: 75'-0" / 3-STORY

EXISTING: 29'-2" / 2-STORY

ADDITION: 25'-6" / 2-STORY

SHEET INDEX


Sheet Number	Sheet Name
GENERAL	
CS-001	COVER SHEET
CS-002	CODE ANALYSIS
CS-003	CODE ANALYSIS
CS-004	ABBREVIATIONS, DRAWING LEGEND
CIVIL	
C-1	TOPOGRAPHIC SURVEY
C-2	DEMOLITION PLAN
C-3	IMPROVEMENT PLAN
C-4	STORMWATER MANAGEMENT PLAN
C-5	STORMWATER & DETENTION CALCULATIONS
C-6	STORM PROFILES
C-7	NOTES AND DETAILS
C-8	NOTES AND DETAILS
ARCHITECTURAL	
A-001	MOUNTING HEIGHTS AND CONTROLS
A-002	SIGNAGE STANDARDS
A-003	SIGNAGE LOWER FLOOR PLAN - PART C
A-004	SIGNAGE MAIN FLOOR PLAN - PART A
A-005	SIGNAGE MAIN FLOOR PLAN - PART B
A-006	SIGNAGE MAIN FLOOR PLAN - PART C
AD100	LOWER LEVEL DEMOLITION PLAN
AD101	MAIN LEVEL DEMOLITION PLAN
AD109	NOT USED - ROOF PLAN DEMOLITION
AD401	DEMOLITION WALL SECTIONS
AD801	REFLECTED CEILING PLAN DEMOLITION
A-100	OVERALL LOWER LEVEL PLAN
A-100.C	LOWER LEVEL PLAN - PART C
A-101	OVERALL MAIN LEVEL FLOOR PLAN
A-101.A	MAIN LEVEL FLOOR PLAN - PART A
A-101.B	MAIN LEVEL FLOOR PLAN - PART B
A-101.C	MAIN LEVEL FLOOR PLAN - PART C
A-109	OVERALL ROOF PLAN
A-110	ROOF DETAILS
A-201	EXTERIOR ELEVATIONS
A-301	BUILDING SECTIONS
A-302	BUILDING SECTIONS
A-401	WALL SECTIONS
A-402	WALL SECTIONS
A-403	WALL SECTIONS
A-491	SECTION DETAILS
A-492	SECTION DETAILS
A-501	ENLARGED FLOOR PLANS
A-502	ENLARGED FLOOR PLANS
A-601	INTERIOR ELEVATIONS
A-602	INTERIOR ELEVATIONS
A-621	INTERIOR DETAILS/SECTIONS
A-622	INTERIOR DETAILS
A-623	INTERIOR DETAILS/SECTIONS
A-701	ROOM FINISH SCHEDULE
A-711	DOOR SCHEDULE
A-712	DOOR DETAILS
A-713	DOOR DETAILS
A-721	WALL TYPES AND ASSEMBLIES
A-722	WALL TYPES AND ASSEMBLIES
A-800	OVERALL LOWER LEVEL REFLECTED CEILING PLAN
A-800.C	LOWER LEVEL REFLECTED CEILING PLAN - PART C
A-801	OVERALL MAIN LEVEL REFLECTED CEILING PLAN
A-801.A	MAIN LEVEL REFLECTED CEILING PLAN - PART A
A-801.B	MAIN LEVEL REFLECTED CEILING PLAN - PART B
A-801.C	MAIN LEVEL REFLECTED CEILING PLAN - PART C
A-810	CEILING DETAILS

SHEET INDEX

Sheet Number	Sheet Name
STRUCTURAL	
S-001	STRUCTURAL NOTES
S-002	STRUCTURAL NOTES AND INSPECTION SCHEDULE
S-111	OVERALL FLOOR PLAN
S-112	NEW ADDITION FRAMING & FOUNDATION PLANS - LOWER LEVEL
S-113	ENLARGED FRAMING & FOUNDATION PLANS
S-114	ENLARGED FRAMING PLAN - PART A
S-801	STRUCTURAL DETAILS
S-802	STRUCTURAL DETAILS
S-803	STRUCTURAL DETAILS
S-804	STRUCTURAL DETAILS
PLUMBING	
P-100	PLUMBING SYMBOLS, NOTES, AND ABBREVIATIONS
P-300	BELOW FLOOR PLAN - PLUMBING DEMOLITION
P-301	BELOW FLOOR ENLARGED PLANS - PLUMBING DEMOLITION
P-302	FIRST FLOOR PLAN - PLUMBING DEMOLITION
P-303	FIRST FLOOR ENLARGED PLANS - PLUMBING DEMOLITION
P-304	ROOF PLAN - PLUMBING DEMOLITION
P-400	BELOW FLOOR PLAN - PLUMBING NEW
P-401	BELOW FLOOR ENLARGED PLANS - PLUMBING NEW
P-402	FIRST FLOOR PLAN - PLUMBING NEW
P-403	FIRST FLOOR ENLARGED PLANS - PLUMBING NEW
P-404	ROOF PLAN - PLUMBING NEW
P-405	FLOOR PLAN - PLUMBING NEW
P-800	PLUMBING DETAILS
P-900	PLUMBING SCHEDULES
MECHANICAL	
M-100	MECHANICAL SYMBOLS, NOTES, AND ABBREVIATIONS
M-300	NORTH WING - LOWER LEVEL FLOOR PLAN - MECHANICAL DEMOLITION
M-301	NORTH WING - FIRST FLOOR PLAN - MECHANICAL DEMOLITION
M-302	EAST WING - FIRST FLOOR PLAN - MECHANICAL DEMOLITION
M-303	WEST WING - FIRST FLOOR PLAN - MECHANICAL DEMOLITION
M-304	NORTH WING - ROOF PLAN - MECHANICAL DEMOLITION
M-305	EAST WING - ROOF PLAN - MECHANICAL DEMOLITION
M-306	WEST WING - ROOF PLAN - MECHANICAL DEMOLITION
M-307	EAST WING - FIRST FLOOR PLAN - PIPING DEMOLITION
M-308	FIRST FLOOR PLAN - ENLARGED MECHANICAL ROOM - MECHANICAL DEMOLITION
M-400	NORTH WING - LOWER LEVEL FLOOR PLAN - MECHANICAL NEW
M-401	NORTH WING - FIRST FLOOR PLAN - MECHANICAL NEW
M-402	EAST WING - FIRST FLOOR PLAN - MECHANICAL NEW
M-403	WEST WING - FIRST FLOOR PLAN - MECHANICAL NEW
M-404	WEST WING - ROOF PLAN - MECHANICAL NEW
M-405	NORTH WING - ROOF PLAN - MECHANICAL NEW
M-406	FIRST FLOOR PLAN - ENLARGED MECHANICAL ROOM - MECHANICAL NEW
M-600	NORTH WING - LOWER LEVEL FLOOR PLAN - PIPING NEW
M-601	NORTH WING - FIRST FLOOR PLAN - PIPING NEW
M-602	EAST WING - FIRST FLOOR PLAN - PIPING NEW
M-603	WEST WING - FIRST FLOOR PLAN - PIPING NEW
M-800	MECHANICAL DETAILS
M-801	MECHANICAL DETAILS
M-802	MECHANICAL DETAILS
M-803	MECHANICAL DETAILS
M-804	MECHANICAL DETAILS
M-805	MECHANICAL DETAILS
M-806	MECHANICAL DETAILS

SHEET INDEX

Sheet Number	Sheet Name
M-807	MECHANICAL DETAILS
M-808	MECHANICAL DETAILS
M-809	MECHANICAL DETAILS
M-810	MECHANICAL DETAILS
M-811	MECHANICAL DETAILS
M-812	MECHANICAL DETAILS
M-813	MECHANICAL DETAILS
M-814	MECHANICAL DETAILS
M-815	MECHANICAL DETAILS
M-816	MECHANICAL DETAILS
M-817	MECHANICAL DETAILS
M-818	MECHANICAL DETAILS
M-819	MECHANICAL DETAILS
M-820	MECHANICAL DETAILS
M-821	MECHANICAL DETAILS
M-900	MECHANICAL SCHEDULES
M-901	MECHANICAL SCHEDULES
ELECTRICAL	
E-100	ELECTRICAL COVER SHEET
E-200	SITE PLAN - DEMO
E-201	SITE LIGHTING - NEW
E-300	LOWER LEVEL FLOOR PLAN - LIGHTING DEMO
E-301	LOWER LEVEL FLOOR PLAN - POWER DEMO
E-302	MAIN LEVEL FLOOR PLAN-EAST - LIGHTING DEMO
E-303	MAIN LEVEL FLOOR PLAN - WEST - LIGHTING DEMO
E-304	MAIN LEVEL FLOOR PLAN - NORTH - LIGHTING DEMO
E-305	MAIN LEVEL FLOOR PLAN - EAST - POWER DEMO
E-306	MAIN LEVEL FLOOR PLAN - WEST - POWER DEMO
E-307	MAIN LEVEL FLOOR PLAN - NORTH - POWER DEMO
E-308	ROOF PLAN - EAST - ELECTRICAL DEMO
E-309	ROOF PLAN - WEST - ELECTRICAL DEMO
E-310	ROOF PLAN - NORTH - ELECTRICAL DEMO
E-400	LOWER LEVEL FLOOR PLAN - LIGHTING NEW
E-401	MAIN LEVEL FLOOR PLAN - EAST - LIGHTING NEW
E-402	MAIN LEVEL FLOOR PLAN - WEST - LIGHTING NEW
E-403	MAIN LEVEL FLOOR PLAN - NORTH - LIGHTING NEW
E-500	LOWER LEVEL FLOOR PLAN - POWER NEW
E-501	MAIN LEVEL FLOOR PLAN - EAST - POWER NEW
E-502	MAIN LEVEL FLOOR PLAN - WEST - POWER NEW
E-503	MAIN LEVEL FLOOR PLAN - NORTH - POWER NEW
E-504	ROOF PLAN - EAST - POWER NEW
E-505	ROOF PLAN - WEST - POWER NEW
E-506	ROOF PLAN - NORTH - POWER NEW
E-507	LOWER LEVEL FLOOR PLAN - FIRE ALARM
E-508	MAIN LEVEL FLOOR PLAN - FIRE ALARM
E-509	ROOF PLAN - FIRE ALARM
E-600	ELECTRICAL RISER DIAGRAM - EXISTING
E-601	ELECTRICAL RISER DIAGRAM - NEW
E-700	ELECTRICAL ENLARGED VIEWS
E-800	ELECTRICAL DETAILS
E-801	ELECTRICAL DETAILS
E-802	ELECTRICAL DETAILS
E-900	ELECTRICAL SCHEDULES
E-901	ELECTRICAL SCHEDULES
E-902	ELECTRICAL SCHEDULES
E-903	ELECTRICAL SCHEDULES

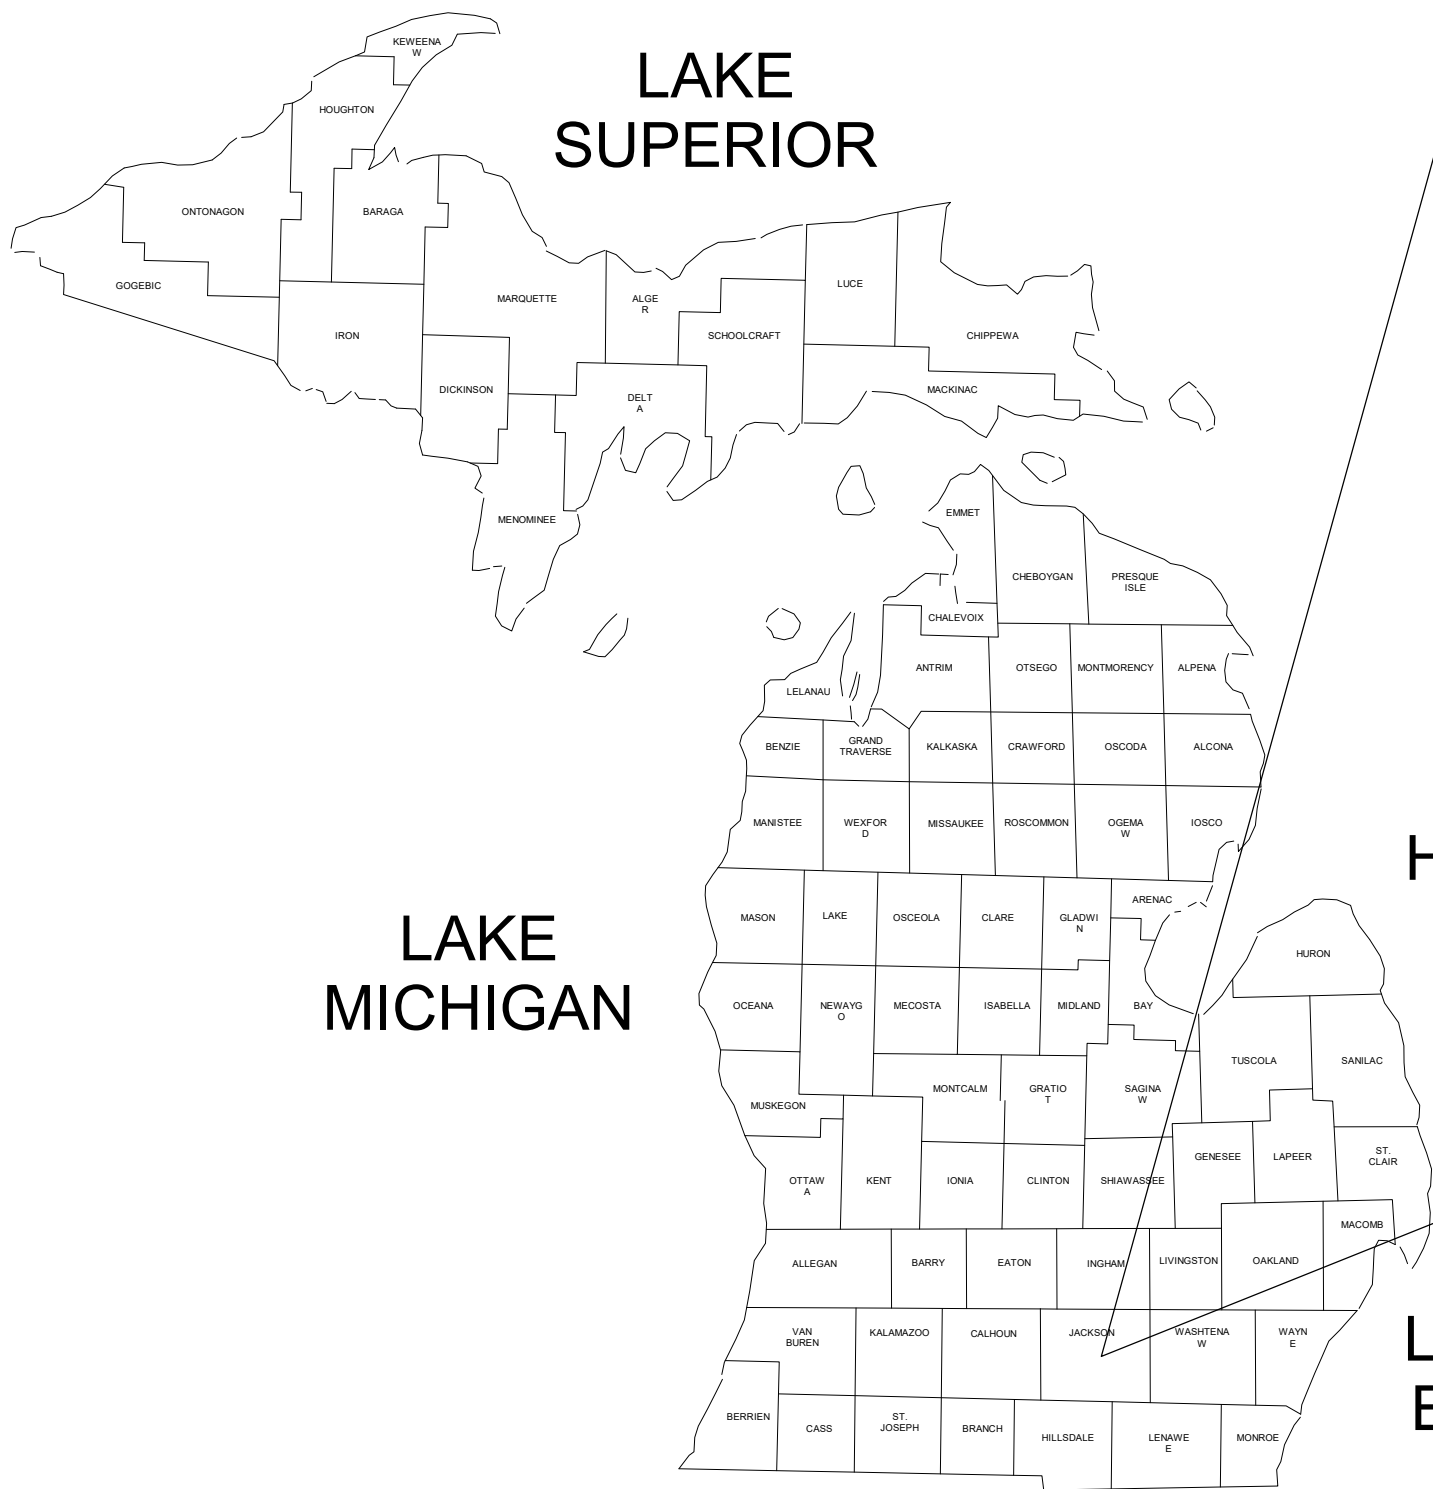

LOCATION MAP
W. ARGYLE ST., JACKSON MI.



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS



FOR SITE OWNED UTILITIES




THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF
SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED,
COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR
WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025


RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES MANAGEMENT
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, P.E., DIRECTOR

SHEET TITLE: COVER SHEET
SHEET: CS-001
ISSUED FOR: PRELIMINARY
DATE: 01/15/26
PROJECT NO: 2622825007
DMVA: 2622825007
FILE NO/INDEX CODE: 511/21336.CAK
DESIGNED: HL
DRAWN: HL
CHECKED: TM
APPROVED: RMR

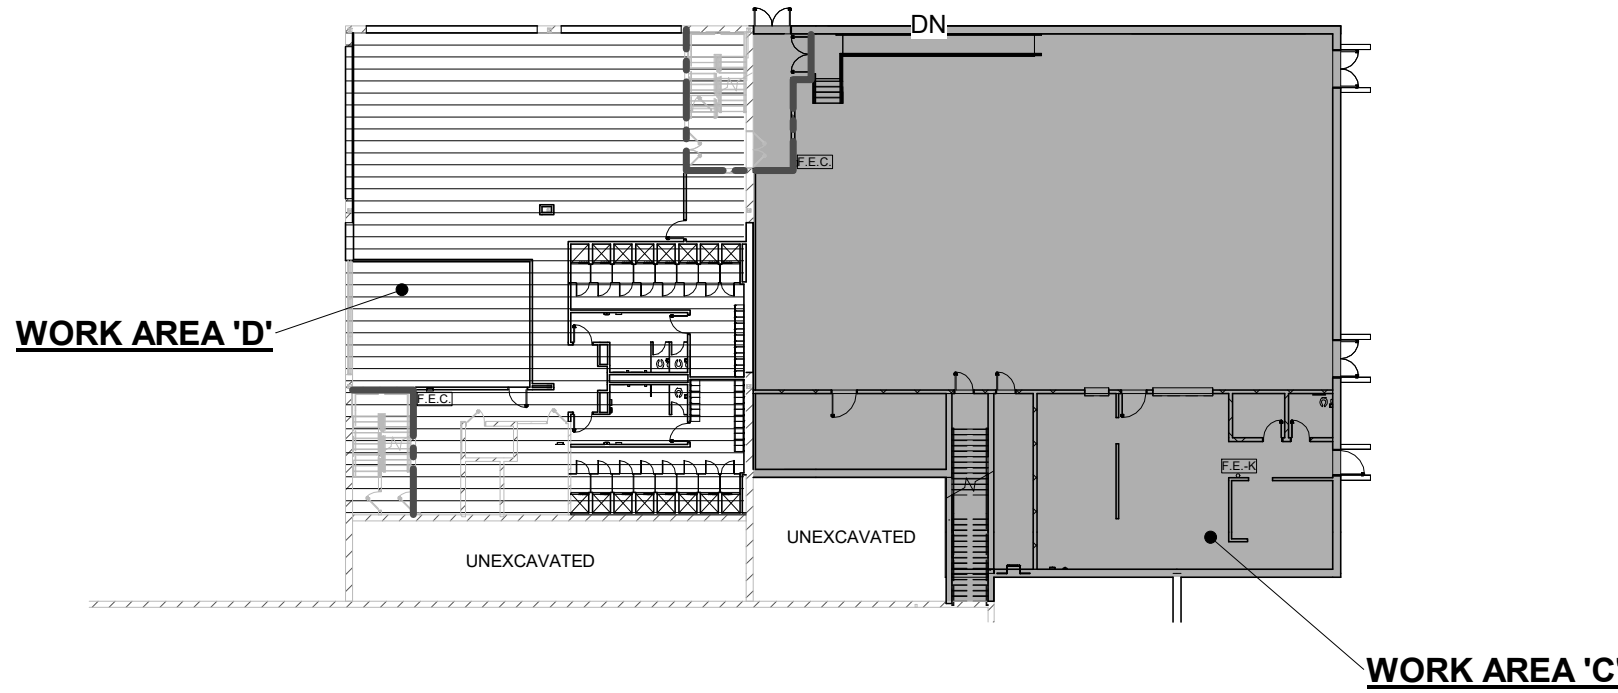

1
CS-002
1/32" = 1'-0"

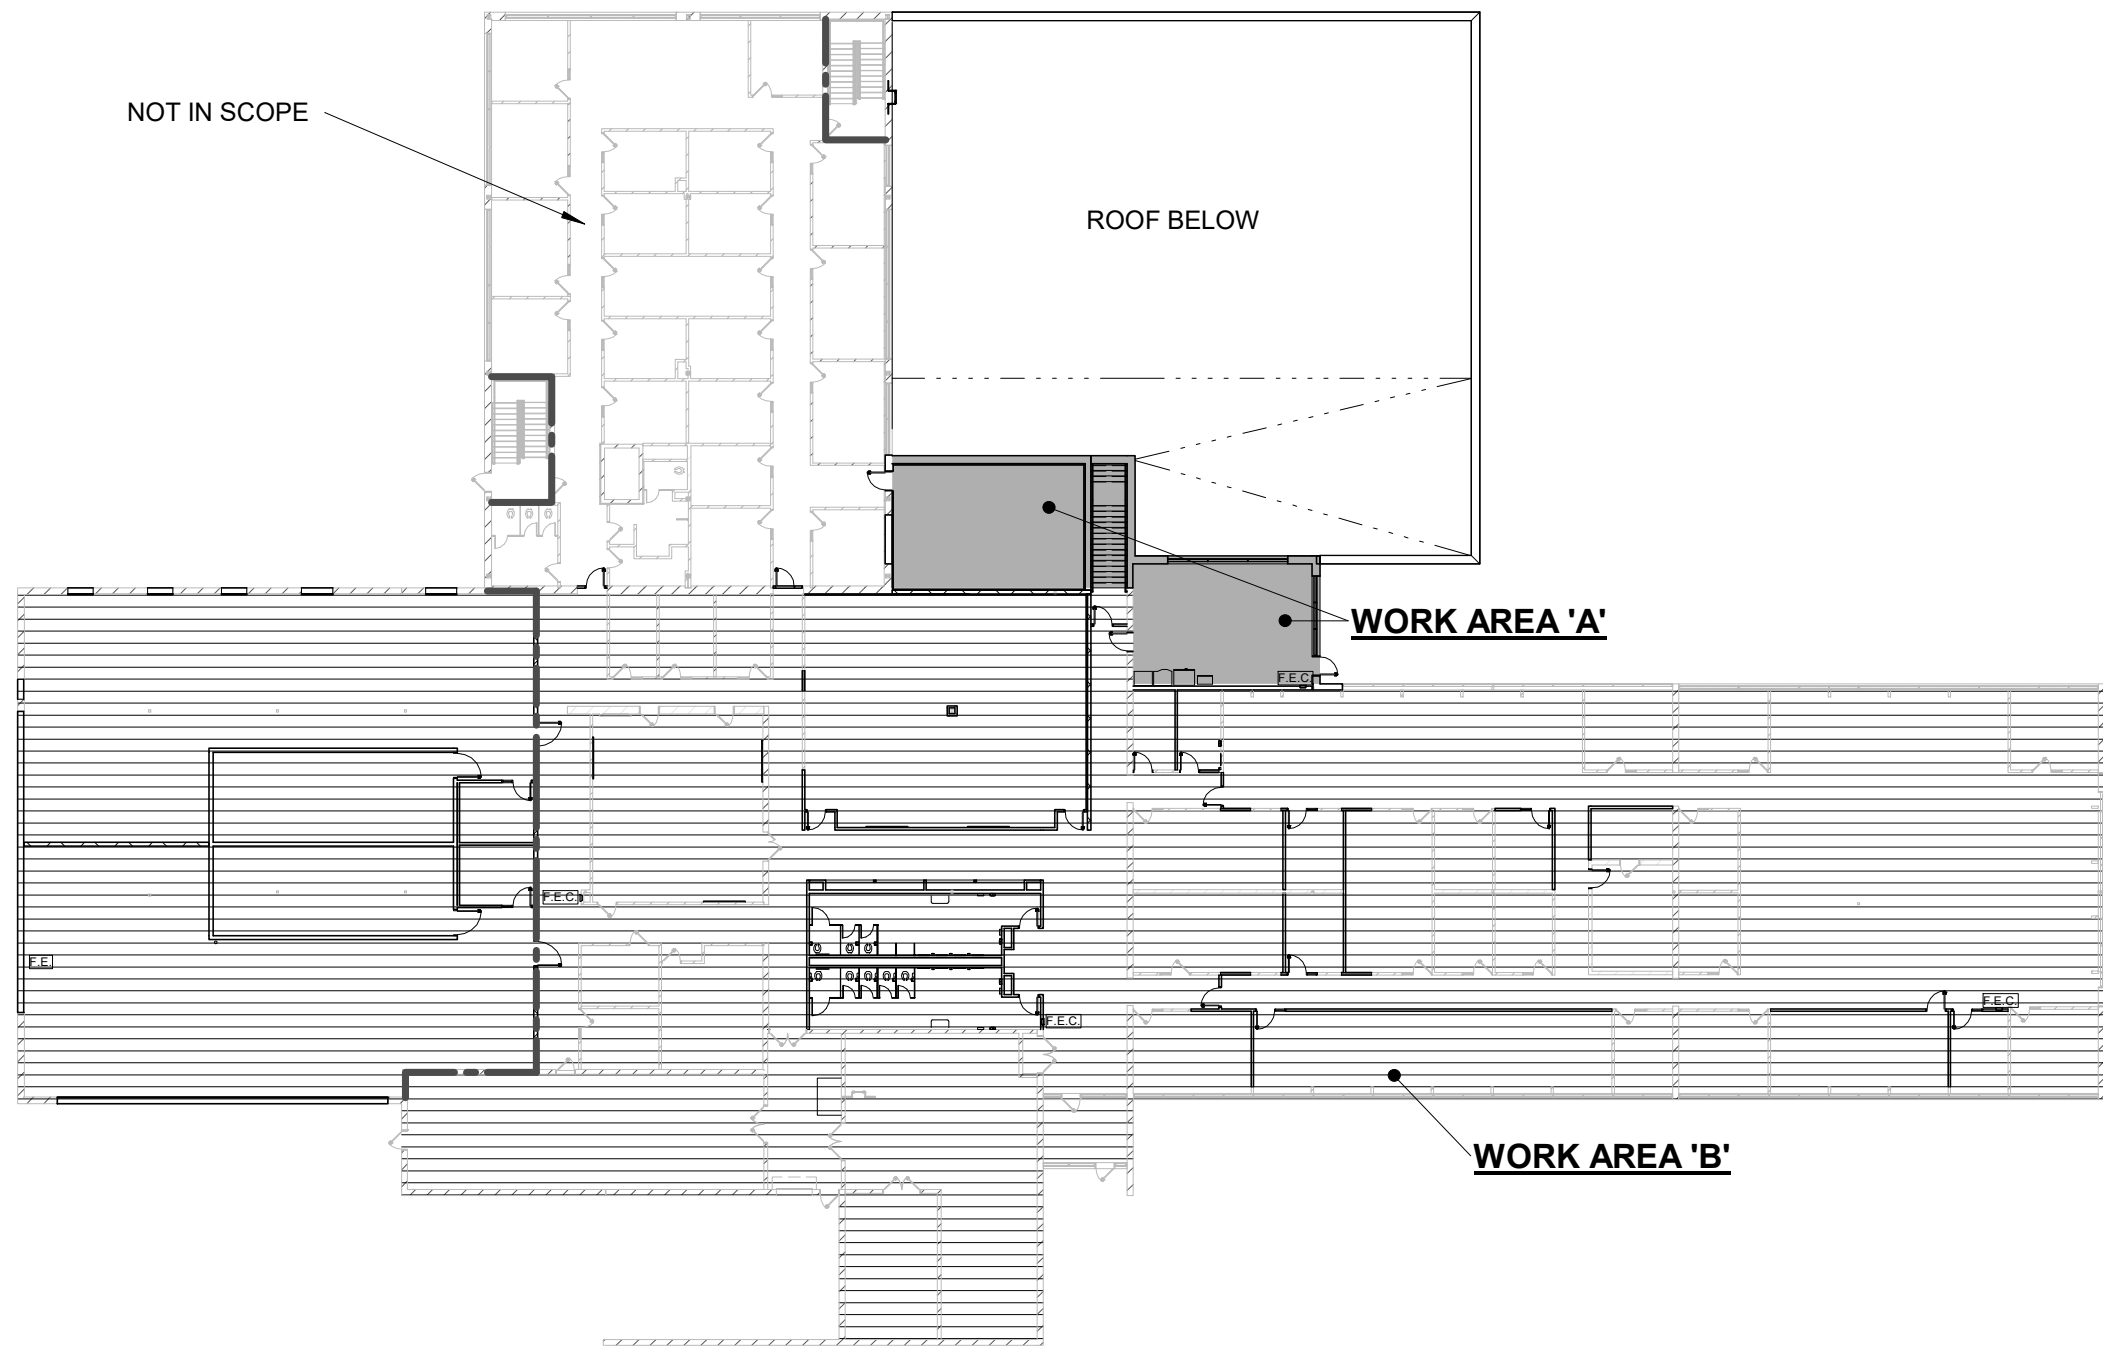

2
CS-002
1/32" = 1'-0"

HEIGHT AND AREA REQUIREMENTS

FRONTAGE: TOTAL PERIMETER = 1,194 FT. OPEN PERIMETER = 1,194 FT. MINIMUM WIDTH OPEN SPACE = 30 FT. FRONTAGE INCREASE FACTOR FROM TABLE 506.3.3 = 0.75	MBC ALLOWABLE HEIGHT AND AREA: PERMITTED TYPES OF CONSTRUCTION = IIB OCC. GROUPS= MIXED OCC. SEPARATED; A-3,B,S-2,S-1 MAX. ALLOWABLE BUILDING HEIGHT = (MBC 2021 TABLES 504.3, 504.4) A-3= 75'-0" / 3 STORIES B= 75'-0" / 4 STORIES S-2= 75'-0" / 4 STORIES MAX. ALLOWABLE BUILDING HEIGHT = (PER ZONING ORDINANCE) N/A, STATE OF MICHIGAN JURISDICTION ACTUAL BUILDING HEIGHT= 2 STORIES / 25'-6" +/- TO ROOF MID. HT. ALLOWABLE BUILDING AREA= (MBC 2021 508.4.2) IN EACH STORY, THE BUILDING AREA SHALL BE SUCH THAT THE SUM OF THE RATIOS OF THE ACTUAL BUILDING AREA OF EACH SEPARATED OCCUPANCY DIVIDED BY THE ALLOWABLE BUILDING AREA OF EACH SEPARATED OCCUPANCY SHALL NOT EXCEED 1. ACTUAL BUILDING AREA= LOWER LEVEL = 15,033 SF MAIN LEVEL = 37,959 SF SEE RATIOS BELOW. BOTH LEVELS ACCEPTABLE
ALLOWABLE AREA DETERMINATION PER MBC SEC. 506.2.2 AND 508.4.2: (MIXED-OCC., TWO-STORY BLDG) EQ. 5-3: Aa= At + (NS x If) ASSEMBLY (A-2 AND A-3) TABULAR AREA: ALLOWABLE AREA: ACTUAL AREA: At= 28,500 Aa= 28,500 + (9,500 x 0.75) MAIN LEVEL: N/A (ACCESSORY INCLUDED IN MAIN OCC SF) NS= 9,500 Aa= 35,625 If= 0.75 STORAGE (S-1) TABULAR AREA: ALLOWABLE AREA: ACTUAL AREA: At= 52,500 Aa= 52,500 + (17,500 x 0.75) LOWER LEVEL: N/A (ACCESSORY INCLUDED IN MAIN OCC SF) NS= 17,500 Aa= 65,625 If= 0.75 LOWER LEVEL ALLOWABLE AREA: 15,033 (ACTUAL) + 35,625 (ALLOWABLE) = 0.42 ≤ 1.0K MAIN LEVEL ALLOWABLE AREA: (29,738 (ACTUAL) + 86,250 (ALLOWABLE)) + (1,443 (ACTUAL) + 65,625 (ALLOWABLE)) + (6,778 (ACTUAL) + 97,500 (ALLOWABLE)) = 0.344 + 0.021 + 0.069 = 0.434 ≤ 1.0K	BUSINESS (B) TABULAR AREA: ALLOWABLE AREA: ACTUAL AREA: At= 69,000 Aa= 69,000 + (23,000 x 0.75) LOWER LEVEL: N/A (ACCESSORY INCLUDED IN MAIN OCC SF) NS= 23,000 Aa= 86,250 If= 0.75 STORAGE (S-2) TABULAR AREA: ALLOWABLE AREA: ACTUAL AREA: At= 78,000 Aa= 78,000 + (26,000 x 0.75) LOWER LEVEL: N/A NS= 26,000 Aa= 97,500 If= 0.75 MAIN LEVEL: 29,738 SF
Aa= ALLOWABLE AREA At= TABULAR ALLOWABLE AREA FACTOR (NS, S1 OR S13R VALUE AS APPLICABLE) IN ACCORDANCE W/ TABLE 506.2 NS= TABULAR ALLOWABLE AREA FACTOR IN ACCORDANCE WITH TABLE 506.2 FOR NON-SPRINKLERED BUILDING (REGARDLESS OF WHETHER THE BUILDING IS SPRINKLERED) If= AREA FACTOR INCREASE DUE TO FRONTAGE (PERCENT) AS CALCULATED IN ACCORDANCE W/ SECTION 506.3 (PERCENT PER SECTION 506.2) Sa= ACTUAL NUMBER OF BUILDING STORIES ABOVE GRADE PLANE, NOT TO EXCEED THREE. FOR BUILDINGS EQUIPPED THROUGHOUT W/ AN AUTOMATIC SPRINKLER SYSTEM INSTALLED IN ACCORDANCE W/ SECTION 803.3.1.2, USE THE ACTUAL NUMBER OF BUILDING STORIES ABOVE GRADE PLANE, NOT TO EXCEED FOUR.	F= BUILDING PERIMETER THAT FRONTS ON A PUBLIC WAY OR OPEN SPACE HAVING 20 FT. MINIMUM DISTANCE P= PERIMETER OF ENTIRE BUILDING (IN FEET). W= (WIDTH: WEIGHTED AVERAGE) CALCULATED OF PUBLIC WAY OR OPEN SPACE (IN FEET, PER SECTION 506.3) Ln= LENGTH OF A PORTION OF THE EXTERIOR PERIMETER WALL wn= WIDTH (≥120 FT) OF A PUBLIC WAY OR OPEN SPACE ASSOCIATED W/ THAT PORTION OF THE EXTERIOR PERIMETER WALL

MRCEB BUILDING RENOVATION SUMMARY

CLASSIFICATION OF WORK: ALTERATION LEVEL 2, ALTERATION LEVEL 3 PLUS ADDITION. SCOPE OF WORK INCLUDES RECONFIGURING OF SPACES IN EXISTING MAIN LEVEL AND LOWER LEVEL, UPDATING EXISTING FINISHES AND M.E.P. SYSTEMS AS NECESSITATED BY RECONFIGURATION, MAIN LEVEL ADDITION AND LOWER LEVEL ADDITION.						
MAIN LEVEL	WORK AREA	BUILDING AREA	RECONFIGURED AREA S.F.	ADDITION AREA S.F.	WORK AREA EXCEEDS 50% OF BLDG.	CLASSIFICATION OF WORK
LOWER LEVEL	A	52,992	N/A	1,550	N/A	ADDITION
	B	52,992	29,881	N/A	YES	ALTERATION LEVEL 3
	C	52,992	N/A	8,496	N/A	ADDITION
	D	52,992	5,616	N/A	NO	ALTERATION LEVEL 2

MBC/MRCEB CODE ANALYSIS LEGEND

----	DENOTES FIRE BARRIER- 1 HOUR FIRE BARRIER- EXTEND RATED ASSEMBLY TO THE UNDERSIDE OF THE STRUCT. DECK U.N.O., FIRE STOP ALL JOINTS AND PENETRATIONS- REFER TO SECTIONS
"X-X"	DENOTES TRAVEL DISTANCE
[Pattern]	A-2 OCC. GROUP
[Pattern]	A-3 OCC. GROUP
[Pattern]	B OCC. GROUP
[Pattern]	S-1 OCC. GROUP
[Pattern]	S-2 OCC. GROUP
[Pattern]	DENOTES OPEN PERIMETER
[Pattern]	DENOTES WORK AREA


CODE DATA

JURISDICTION: TOWNSHIP CITY COUNTY STATE	BLACKMAN TWP. JACKSON, MI JACKSON MICHIGAN (MDLARA)
BUILDING CODE:	MICHIGAN BUILDING CODE - 2021 MICHIGAN REHAB CODE FOR EXISTING BUILDINGS - 2021
MBC CONSTRUCTION TYPE:	IIB
OCC. GROUP:	MIXED-OCCUPANCY, NON-SEPARATED; A-3 (ASSEMBLY), B (BUSINESS), S-2 (LOW-HAZARD STORAGE)
USE:	TRAINING/WEAPONS MAINTENANCE FACILITY FOR MILITARY PURPOSES
RISK CATEGORY:	II (NOT ESSENTIAL)
PLUMBING CODE:	MICHIGAN PLUMBING CODE - 2021
MECHANICAL CODE:	MICHIGAN MECHANICAL CODE - 2021
ELECTRICAL CODE:	MICHIGAN ELECTRICAL CODE - 2023, INCORPORATING THE 2023 NEC W/ MICHIGAN PART 8 RULES
FIRE CODE:	INTERNATIONAL FIRE CODE- 2021
ENERGY CODE:	CZ5A (CLIMATE ZONE 5A) ASHRAE STANDARD 90.1-2019 W/ 2021 MICHIGAN ENERGY CODE
FIRE SUPPRESSION:	FULLY SPRINKLED (NFPA 13 - 2019)
FIRE ALARM:	NFPA 72 - 2019
FIRE EXTINGUISHERS:	NFPA 10 - 2018
ACCESSIBILITY:	N/A PER MBC. SEC. 1103.2.15 - PROVIDED PER OWNER REQUEST, IN COMPLIANCE W/ 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN AND ICC A117.1-2017
SPACES WITH ONE EXIT/EXIT ACCESS: (MBC. TABLE 1006.2.1)	MAX. OCC. LOAD MAX. COMM. PATH OF EGRESS/EXIT ACCESS TRAVEL DIST. (SINGLE EXIT) OF SPACE A (OCC.) ≤49 MAX. 75 FT. (SPRINKLERED) B,S (OCC.) ≤29 MAX. 100 FT. (SPRINKLERED)
MIN. NUMBER OF EXITS (STORY): (MBC TABLE 1006.3.3)	3 PER STORY 501-1000 OCC.
MAX. EXIT ACCESS TRAVEL DIST.: (MBC TABLE 1017.2)	A-S-1 OCC. GROUPS (SPRINKLERED)= 250 FT. B OCC. GROUP (SPRINKLERED)= 300 FT.
DEAD END CORRIDOR: (MRCEB SECTION 804.7)	35 FT. (A USE- SPRINKLERED)
CORRIDOR WIDTH (MBC):	OCC. LOAD < 50= 36 INCHES ALL OTHER = 44 INCHES
REQUIRED EXIT WIDTH (STAIRS / OTHER): (MBC SECTION 1011 OR PER MIN. PER 1005.3.1 AND 1009)	
STAIRS=	44 INCHES MIN, PER OCC. LOAD (2 INCH PER OCC. FULLY SPRINK.)
OTHER=	PER OCC. LOAD CALCULATIONS (1.5 INCH PER OCC. FULLY SPRINK.)

FIRE RESISTANCE RATING REQUIREMENTS


MBC CONSTRUCTION TYPE - IIB	
BUILDING ELEMENT	FIRE RATINGS (MBC TABLE 601/602)
PRIMARY STRUCTURAL FRAME	0 HOUR
BEARING WALLS:	
EXTERIOR	0 HOUR
INTERIOR	0 HOUR
NON-BEARING WALLS AND PARTITIONS:	
EXTERIOR (A,B,S-2 OCC. GROUPS)	X < 5 (1 HOUR), 5 < X < 10 (1 HOUR), 10 < X < 30 (0 HOUR), X > 30 (0 HOUR)
INTERIOR	0 HOUR
FLOOR CONSTRUCTION AND SECONDARY MEMBERS	0 HOUR
ROOF CONSTRUCTION AND SECONDARY MEMBERS	0 HOUR
INCIDENTAL USES	FIRE RATING REQUIREMENTS
FURNACE ROOM W/ ANY PIECE OF EQUIP. OVER 400,000 BTU/HR INPUT	ONE HOUR* (MBC TABLE 509.1)
ROOMS W/ BOILERS WHERE LARGEST PIECE OF EQUIP. IS OVER 15 PSI AND 10 HP	ONE HOUR* (MBC TABLE 509.1)
WALL REQUIREMENTS	FIRE RATING REQUIREMENTS
CORRIDOR WALLS (FIRE PARTITION)	> 30 OCC. = 1 HOUR* (PER MBC TABLE 1020.2)
OCCUPANCY SEPARATION (FIRE BARRIER)	ONE HOUR BETWEEN B AND S-2 (PER MBC 508.4)
	ZERO HOUR BETWEEN B AND S-1 (PER MBC 508.4)
	ZERO HOUR BETWEEN ACCESSORY AND MAIN OCCUPANCY (PER MBC 508.2.4)
FIRE BARRIERS (OTHER)	(PER MBC SEC. 707.3)
SHAFT ENCLOSURES (FIRE BARRIER)	ONE HOUR (PER MBC SEC. 713.4)
SHAFT ENCLOSURE (HORIZONTAL ASSEMBLY)	ONE HOUR (PER MBC SEC. 711.2.4.6 AND 713.4)
* ZERO HOUR WHEN AUTOMATIC SPRINKLER SYSTEM IS PROVIDED.	

ARCHITECTURAL DRAWING ABBREVIATIONS									
ABV. ABOVE	DPR. DAMPER	H.C. HOLLOW CORE	P.C.F. POUNDS PER CUBIC FOOT	VIN. VINYL SHEET					
A.F.F. ABOVE FINISHED FLOOR	D.L. DAMP PROOFING	H.M. HOLLOW METAL	P.L.F. POUNDS PER LINEAR FOOT	VCT. VINYL TILE FLOORING					
A.S.C. ABOVE SUSPENDED CEILING	D.M. DEMO	H.K. HOOK	P.S.F. POUNDS PER SQUARE FOOT						
ACC. ACCESS	D.M.T. DEMOUNTABLE	H.B. HOSE BIB	P.S.I. POUNDS PER SQUARE INCH						
ACFL. ACCESS FLOOR	DET. DETAIL	HY. HYDRANT		W. WEST, WIDTH OR WALLCOVERING					
ACP. ACCESS PANEL	DIV. DIVISION			WB. WALL BORDER					
ACPL. ACOUSTICAL PLASTER	D.O. DOOR OPENING			W/ WITH					
A.C.T./A ACOUSTICAL CEILING TILE	D.J. DOOR JAMB			W/O WITHOUT					
AT (SP) ACOUSTICAL CEILING (W/ SPRAYED PLASTIC FINISH)	DBL. DOUBLE			WC. WATER CLOSET					
AT (TG) ACOUSTICAL CEILING (W/ REGULAR EDGE)	DBLA. DOUBLE ACTION			WD. WOOD					
ACP. ACRYLIC PLASTIC	DBLH. DOUBLE HUNG			WH. WATER HEATER					
ADDN. ADDITION	DTA. DOVE-TAIL ANCHOR			WM. WATER MAIN					
ADDNL. ADDITIONAL	DTS. DOVE-TAIL ANCHOR SET			WP. WALLCOVERING PROTECTIVE					
AF. ACCESS FLOORING	DWL. DOWEL (S)			(RIGID PVC SHEET)					
ADH. ADHESIVE	DN. DOWN			WATER PROOF (ING)					
ADJ. ADJACENT	DS. DOWNSPOUT			WS. WATER SERVICE					
ADJT. ADJUSTABLE	DR. DRAIN			WR. WEATHER RESISTANT					
AGG. AGGREGATE	DRB. DRAIN BOARD			WSF. WELDED SEAM SHEET FLOORING					
ADO. AUTOMATIC DOOR OPERATOR	DWR. DRAWER			WIN. WINDOW					
AC. AIR CONDITIONING	DWG. DRAWING			W.W.F./ W.W.R. WELDED WIRE FABRIC/					
A.C.U. AIR CONDITIONING UNIT	D.F. DRINKING FOUNTAIN			W.W.M. WELDED WIRE REINFORCEMENT.					
A.H.U. AIR HANDLING UNIT	D.W. DUMB WAITER			YRD. YARD (S)					
ALT. ALTERNATE	D. DRAIN	J.C. JANITOR CLOSET	REFR. REFRIGERATOR	XS. EXTRA STRONG					
AL. ALUMINUM	DRB. DRAIN BOARD	J.T. JOINT	REGISTER						
A.B. ANCHOR BOLT	DWR. DRAWER	J.F. JOINT FILLER	REINF. REINFORCE (D), (ING)						
ANC. ANCHOR, ANCHORAGE	DWG. DRAWING	J.S.T. JOIST	RC.P. REINFORCED CONCRETE						
ANOD. ANODIZED	D.F. DRINKING FOUNTAIN	J.B. JOIST BEARING	REM. REMOVE (ABLE)						
APT. APARTMENT	D.W. DUMB WAITER		RAF. RESILIENT ATHLETIC FLOORING						
APPROX. APPROXIMATE	E. EAST	K.C.P. KEENE'S CEMENT PLASTER	RB. RESILIENT BASE (RUBBER, VINYL)						
ARCH. ARCHITECT (URAL)	EA. EACH	K.P. KICKPLATE	RSF. RESILIENT SHEET FLOORING						
A.D. AREA DRAIN	E.F. EACH FACE	KIT. KITCHEN	RF. RAISED RUBBER FLOORING						
ASB. ASBESTOS	E.FTR. EXISTING FINISH TO REMAIN	KS. KITCHEN SINK	RET. RETURN						
ASPH. ASPHALT	E.W. EACH WAY	KO. KNOCKOUT	RA. RETURN AIR						
A.T. ASPHALT TILE	ELEC. ELECTRIC (AL)		RVS. REVERSE (SIDE)						
@. AT	EMCH. ELECTRO-MECHANICAL CLOSER-HOLDER		REF. REFERENCE						
A.C.M. ASBESTOS CONTAINING MATERIAL	E.P. ELECTRICAL PANEL		REQ'D. REQUIRED						
AUTO. AUTOMATIC	EWC. ELECTRIC WATER COOLER	LB. POUND	REV. REVISION (S), REVISED						
AWF. ACOUSTICAL WALL FABRIC (TACKABLE)	ELEV. ELEVATOR	LBS. POUNDS	R.H. RIGHT HAND						
AWP. ACOUSTICAL WALL PANEL	EL. ELEVATION	LBL. LABEL	R.O.W. RIGHT OF WAY						
B/B. BACK TO BACK	EMB. EMBEDMENT	LAD. LADDER	RVT. RIVET						
B/C. BACK OF CURB OR BOTTOM CHORD	ENC. ENCLOSE (URE)	L.B. LAG BOLTS	RC. ROOF CONDUCTOR						
B.O.C. BACK OF CURB	E.S. END SECTION	LAM. LAMINATE (D)	RD. ROOF DRAIN OR						
B.P. BACK PLASTER (ED)	EPY. EPOXY (COATINGS)	LM. LATEX MASTIC FLOORING	ROLLING DOOR						
BP. BP BRICK PAVERS (UNIT PAVERS)	EQ. EQUAL	LDRY. LAUNDRY	RFH. ROOF HATCH						
BALC. BALCONY	EQUIP. EQUIPMENT	LAV. LAVATORY	RFG. ROOFING						
BSMT. BASEMENT	ERF. EPOXY RESINOUS FLOORING	L.H. LEFT HAND	RM. ROOM						
B. BATHROOM	ESC. ESCALATOR	L.T. LIGHT	R.O. ROUGH OPENING						
B.F. BARRIER FREE	EMER. EMERGENCY	LC. LIGHT CONTROL							
BRG. BEARING	EST. ESTIMATE	LW. LIGHTWEIGHT	S. SOUTH						
BPL. BEARING PLATE	EXCA. EXCAVATE	LWC. LIGHTWEIGHT CONCRETE	SGFL. SAFETY GLASS						
BUT. BUTT JOINT	EXH. EXHAUST	LMS. LIMESTONE	SA. SELF-ADHERED						
BR. BED ROOM	EXIST. EXISTING	LTL. LINTEL	SAN. FM. SANITARY FORCE MAIN						
BR. BEDROOM	EXMP. EXPANDED METAL PLATE	LL. LIVE LOAD	SND. SANITARY NAPKIN DISPENSER						
BR. BR BRICK (UNIT MASONRY)	EXP. EXPANSION	LR. LIVING ROOM	SNR. SANITARY NAPKIN RECEPTACLE						
BM. BENCHMARK OR BEAM	E.B. EXPANSION BOLT	L.G. LONG	SCH. SCHEDULE (D)						
BEL. BELOW	E.J. EXPANSION JOINT	L.L.H. LONG LEG HORIZONTAL	SCN. SCREEN						
BVL. BEVELED	EXP. EXPOSED	L.L.V. LONG LEG VERTICAL	SNT. SAILANT						
BIT. BITUMINOUS	E.C. EXPOSED CONCRETE	LVR. LOUVER	STG. SEATING						
BLK. BLOCK	EXT. EXTERIOR	L.H. LOUVER HEADER	SEC. SECTION						
BLKG. BLOCKING	EXS. EXTRA STRONG	L.J. LOUVER JAMB	SEC. SERVICE SINK						
BD. BOARD	EXTR. EXTRUDE (R)	L.S. LOUVER SILL	SHTH. SHEATHING						
B.S. BOTH SIDES		L.P. LOW POINT OR LIGHT POLE	SHT. SHEET						
B.W. BOTH WAYS	F.O.W. FACE OF WALL	M. MATCH	SG. SHEET GLASS						
BOT. BOTTOM	FB. FACE BRICK	MACH. MACHINE	SH. SHELF OR SHELVEING						
B/ BOTTOM OF	F.O.C. FACE OF CONCRETE	MHO. MAGNETIC HOLD-OPEN (WALL OR FLR. MTD)	S & P. SHELF AND POLE						
B.O.D. BOTTOM OF DECK	F.O.F. FACE OF FINISH	MH. MANHOLE	SHO. SHORE (D), (ING)						
B.O.F. BOTTOM OF FOOTING	F.O.M. FACE OF MASONRY	MFG. MANUFACTURER	SHWR. SHOWER						
B.O.P. BOTTOM OF PIPE	F.O.S. FACE OF STUD	MT. MARBLE THRESHOLD	SKL. SIMILAR						
B.O.W. BOTTOM OF WALL	FF. FACE TO FACE OR FINISHED FLOOR	MAS. MASONRY	SKL. SKYLIGHT						
BLVD. BOULEVARD	F.F. FACTORY FINISH	M.O. MASONRY OPENING	SL. SLEEVE						
BRCG. BRACING	FF. FROST FREE	MATL./ MAT	SD. SOAP DISPENSER						
BRKT. BRACKET	F/G. FINISHED GRADE	MAX. MAXIMUM	SC. SOLID CORE						
BC. BRICK	F.S. FAR SIDE	MECH. MECHANIC (AL)	SP. SOUNDPROOF						
BRZ. BRONZE	FAS. FASTEN (ER)	M.C. MEDICINE CABINET	SAB. SOUND ATTENUATION BATT						
BLDG. BUILDING	FT. FEET	MC. MULT-COLOR COATING	SPC. SPACER						
B.L. BUILDING LINE	FN. FENCE	MEZZ. MEZZANINE	SPK. SPEAKER						
B.U.R. BUILT UP ROOFING	FBD. FIBERBOARD	MIN. MINIMUM	SPL. SPECIAL						
BLKHD. BULKHEAD	FRP. FIBERGLAS REINFORCED PANEL(S)	MIR. MIRROR	SC. HIGH BUILD GLAZED						
BB. BULLETIN BOARD	FIN. FINISH	MISC. MISCELLANEOUS	COATING (SPECIAL COATING)						
CAB. CABINET	FFL. FINISHED FLOOR LINE	MOD. MODULAR	SF. SPECIAL FACED						
CAD. CADMIUM OR CAD	FA. FIRE ALARM	MLD. MOLDING OR MOULDING	SPEC. SPECIFICATION (S)						
CLK. CALK (ING) OR CAULK (ING)	FBRK. FIRE BRICK	MR. MOP RECEPTOR	SQ. SQUARE						
CP. CARPET (WITHOUT CUSHION BROADLOOM)	F.E. FIRE EXTINGUISHER (BRACKET)	MT. MOUNT (ED), (ING)	SQ. SQUARE FEET / FOOT						
CPT. CARPET TILE	F.E.C. FIRE EXTINGUISHER (CABINET)	MTL. METAL	STAG. STAGGERED						
CSMT. CASEMENT	F.H. FIRE HYDRANT	MOV. MOVEABLE	ST. STAIN						
C.I. CAST IRON	FHC. FIRE HOSE CABINET	MULL. MULLION	ST. STAINLESS STEEL						
C.I.P.C. CAST IN PLACE CONCRETE	FHS. FIRE HOSE STATION	N. NORTH	STD. STANDARD						
C.S. CAST STONE	F.M. FIRE MAIN	N.S. NEAR SIDE	STA. STATION						
C.B. CATCH BASIN	F.P. FIRE PROOF OR FIRE PLACE	NOM. NOMINAL	STL. STEEL						
CLG. CEILING	FRC. FIRE RESISTANT COATING	NMT. NON-METALLIC	STO. STORAGE						
CHT. CEILING HEIGHT	FRG. FIRE RETARDANT	NF. NATURAL FINISH	STO. STORM DRAIN						
CEM. CEMENT	FIXT. FIXTURE	N.I.C. NOT IN CONTRACT	STW. STORM SEWER						
CPPL. CEMENT PLASTER (PORTLAND)	F.L. FLOOR (ING)	N.T.S. NOT TO SCALE	STRU. STRUCTURAL						
C/C. CENTER TO CENTER	FLC.O. FLOOR CLOAKOUT	NO. NUMBER	SCT. STRUCTURAL CLAY TILE						
C. CENTER LINE	FHMS. FLATHEAD MACHINE SCREW	O/O. OUT TO OUT	ST. STONE (CAST)						
C.P. CENTER POINT	FHWS. FLATHEAD WOOD SCREW	O.C. ON CENTER	SUS. SUSPEND (ED)						
CM. CENTIMETER (S)	FLR. FLOOR (ING)	OPG. OPENING	SURF. SURFACE						
CER. CERAMIC	FLC.O. FLOOR CLOAKOUT	OPR. OPPOSITE	SYM. SYMMETRY (ICAL)						
C.T. CT CERAMIC TILE (FLOOR, BASE, AND WALL)	F.D. FLOOR DRAIN	O.D. OUTSIDE DIAMETER	SYN. SYNTHETIC						
C.M.T. CERAMIC MOSAIC TILE	FPL. FLOOR PLATE	OHMS. OVAL HEAD MACHINE SCREW	SYS. SYSTEM						
CERT. CERTIFIED	FLUR. FLUORESCENT	OHWS. OVAL HEAD WOOD SCREW	T. TREAD						
CHBD. CHALK BOARD	FJT. FLUSH JOINT	OA. OVERALL	TI. TOP OF						
CHAM. CHAMFER	FTG. FOOTING	OH. OVERHEAD	TOF. TOP OF CURB OR						
CR. CHROMIUM	FRG. OVERHEAD	OFD. OVERHEAD DOOR	TOP CHORD						
CR. CIRCLE	FND. FOUNDATION	OFOI. OWNER FURNISHED/							
CIRC. CIRCUMFERENCE	FRMG. FRAME (ED) (ING)	OFOI. OWNER INSTALLED	T/P. TOP OF PAVEMENT						
CL. CLASS	FRZR. FREEZE (ER)	OFCI. OWNER FURNISHED/	T/W. TOP OF WALK						
CLR. CLEAR (ANCE)	FRS. FRESH AIR		T/S. TOP OF SLAB						
C.O. CLEAN OUT	FS. FULL SIZE	CFCI. CONTRACTOR INSTALLED	T/STL. TOP OF STEEL						
CLR. CLEAR	F.T. FULLY TEMPERED		TACK BOARD						
CLS. CLOSURE	F.B.O. FURNISHED BY OTHERS		TKS. TACK STRIP						
COL. COLUMN	F.B.O. FURR (ED) (ING)	PT. / P. PAINT (EXTERIOR, INTERIOR, TRANSPARENT FINISHES)	TEL. TELEPHONE						
COMB. COMBINATION	FUT. FUTURE		TV. TELEVISION						
COMP. COMPACTED		PNL. PANEL	TEMPGL. TEMPERED GLASS						
COMPT. COMPARTMENT	G. GUTTER ELEVATION	PTR. PAPER TOWEL RECEPTOR	TEMP. TEMPORARY						
COMPO. COMPOSITION (COMPOSITE)	GA. GAGE	PARL. PARALLEL	TC. TERRA COTTA						
COMP. COMPRESS (ED) (ION) (IBLE)	GALV. GALVANIZE (D)	PK. PARKING	TZ. TERRAZZO						
CONC. CONCRETE	GST. GLAZED STRUCTURAL PANEL	PBD. PARTICLE BOARD	TT. TERRAZZO TILE (PLASTIC MATRIX)						
CONN. CONNECTION	GL. GLASS (GLAZING)	PTN. PARTITION	THK. THICK (NESS)						
CONST. CONSTRUCTION	G.F.R.C. GLASS FIBER REINF. CONC.	PV. PAVE (D), (ING)	THED. THRESHED (ED)						
C.J. CONTROL JOINT	G.B. GRAB BAR	PVMT. PAVEMENT	THRESH. THRESHOLD						
C.R. CONTINUOUS OR CONTINUATION	GD. GRADE OR GRADING	PD. PEDESTAL	TOP OF CONCRETE						
CONTR. CONTRACT (OR)	GRN. GRANITE	PC. PRECAST (ARCHITECTURAL)	T.O.F. TOP OF FOOTING						
C.L.L. CONTRACT LIMIT LINE	GRAT. GRATING	PRECAST CONCRETE PANEL(S)	T.O.P. TOP OF PIER OR PIPE						
CMU. CONCRETE MASONRY UNIT	GVL. GRAVEL	PEN. PENETRATION	T.O.S. TOP OF STEEL						
CNJ. CONSTRUCTION JOINT	G.F. GROUND FACE	PERF. PERFORATE (D)	T.O.W. TOP OF WALL						
COORD. COORDINATE (ION)	GRT. GROUT	PERIM. PERIMETER	TOL. TOLERANCE						
CPC. COPPER	GYP. BD. GYPSUM WALLBOARD SYSTEMS	PCP. PORTLAND CEMENT PLASTER	T&G. TONGUE AND GROOVE						
C.G. CORNER GUARD	GPL. GYPSUM PLASTER LATH	PFW. POLYPROPYLENE FABRIC WALLCOVERING	TB. TOWEL BAR						
CORID. CORRIDOR	H. HIGH	PLAS./ PL. PLASTER	TRANSOM						
CORR. CORRUGATED	H.R. HANDRAIL	PLAM. PLASTIC LAMINATE	TRENCH DRAIN						
CMP. CORRUGATED METAL PIPE	HDW./ HW. HARDWARE SET (FINISH OR BUILDERS & HARDWARE)	PLATE	TYP. TYPICAL						
CPPP. CORRUGATED PERFORATED PLASTIC PIPE		PLATE GLASS	U.O. UNLESS NOTED OTHERWISE						
CTR. COUNTER	HJT. HEAD JOINT	PLBG. PLUMBING	U.P. UTILITY POLE						
CFL. COUNTER FLASHING	HDR. HEADER	PWD. PLYWOOD	U/S. UNDERSIDE						
C.S. COUNTER SINK	HTG. HEATING	PT. POINT OR POINT TANGENT							
CTSK. COUNTERSUNK	HVAC. HEATING / VENTILATING / AIR CONDITIONING	P.C. POINT OF CURVATURE	VB. VAPOR BARRIER						
CRS. COURSE (S)		POL. POLISH (ED)	VP. VENEER PLASTER						
CRG. CROSS GRAIN	HT. HEIGHT	POL. POLYURETHANE	VERT. VERTICAL						
CTYD. COURTYARD	H.P. HIGH POINT	P.V. POST INDICATOR VALVE	V.I.F. VERIFY IN FIELD						
CTY. CUBIC FOOT	H.S.B. HIGH STRENGTH BOLT	PTC. POST TENSION CONCRETE							
CYD. CUBIC YARD									

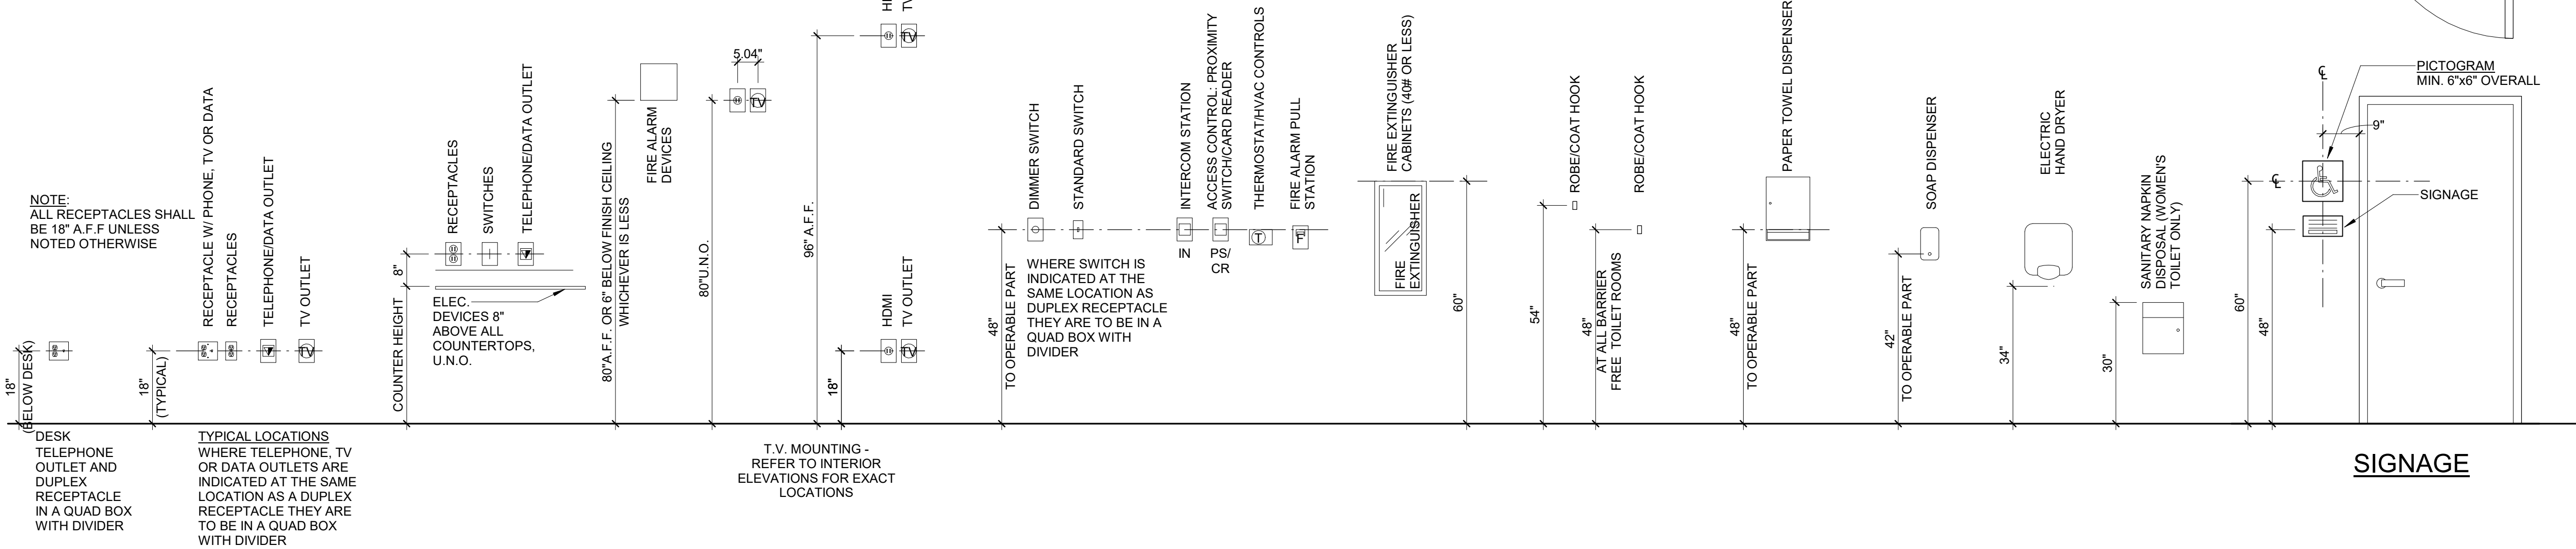


ACCESSORY MOUNTING HEIGHTS

SCALE: 1/2"=1'-0"

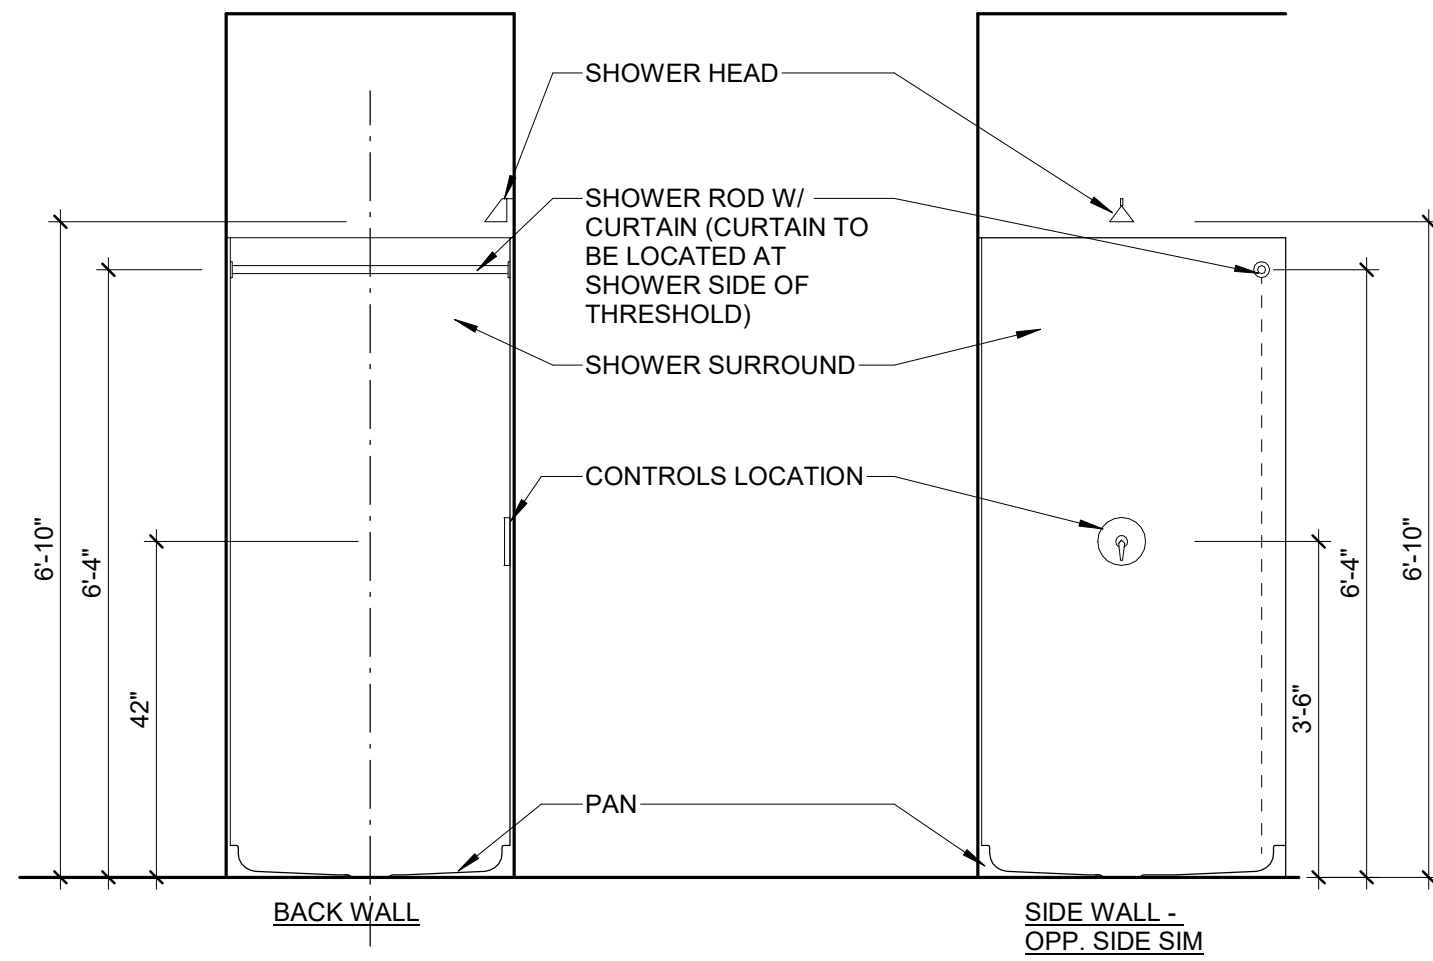


SHOWER ENCLOSURE


NOTE: REFER TO INTERIOR ELEVATIONS FOR SHOWER PAN/SURROUND TYPE

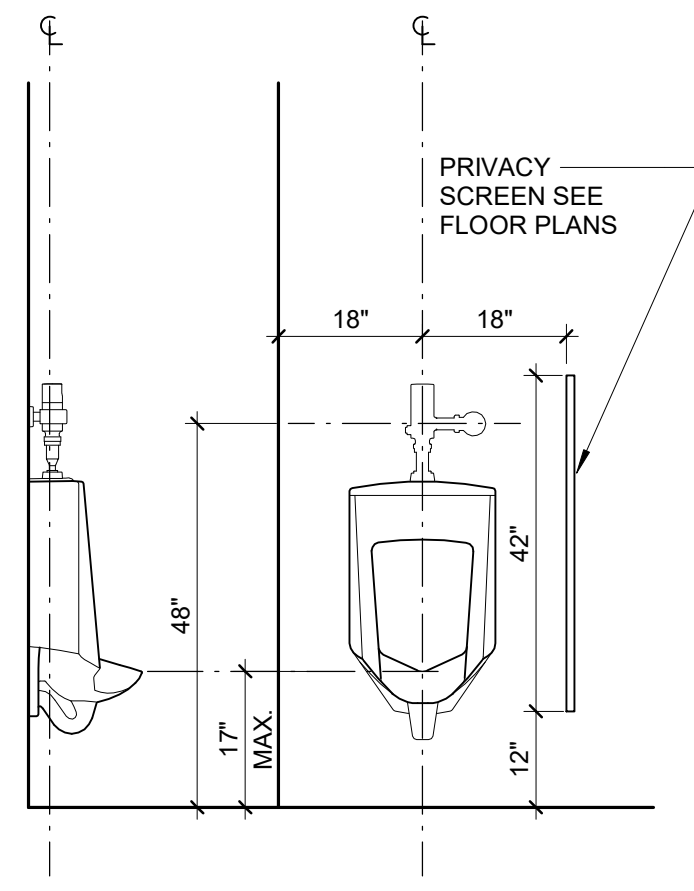

URINAL

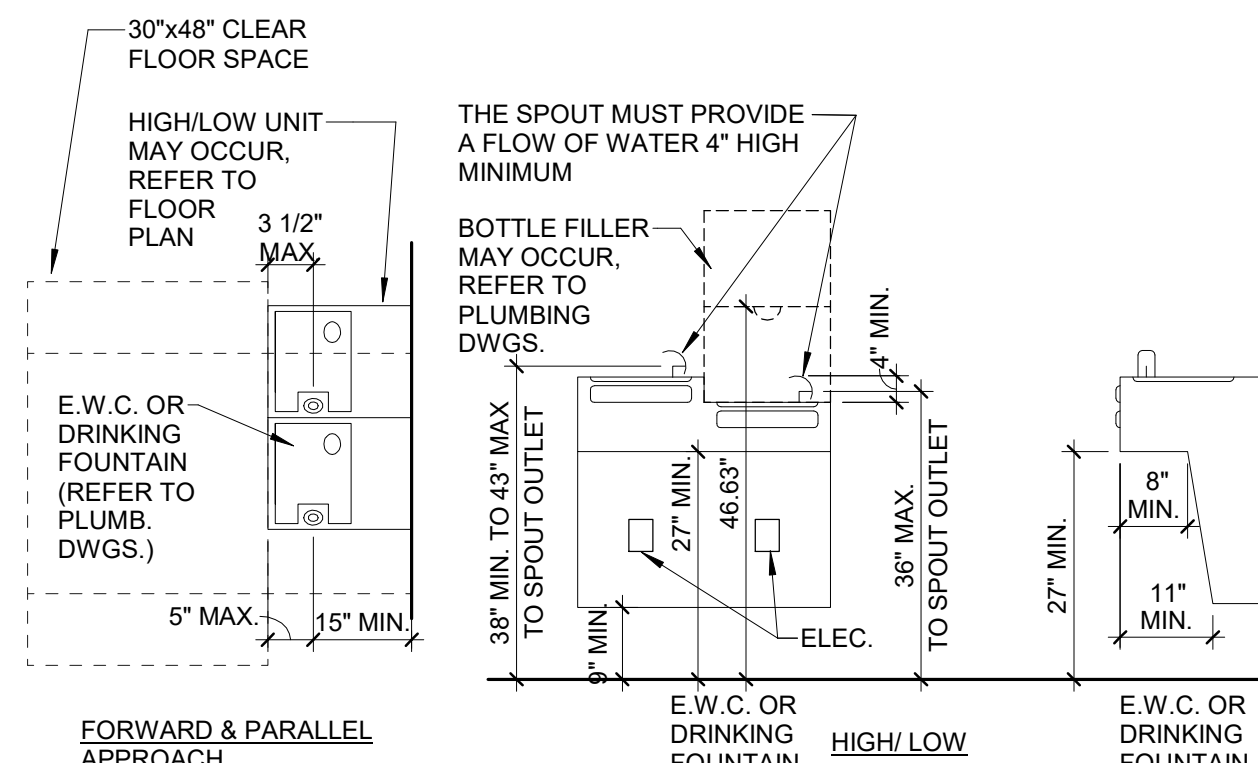


DRINKING FOUNTAINS/ E.W.C.

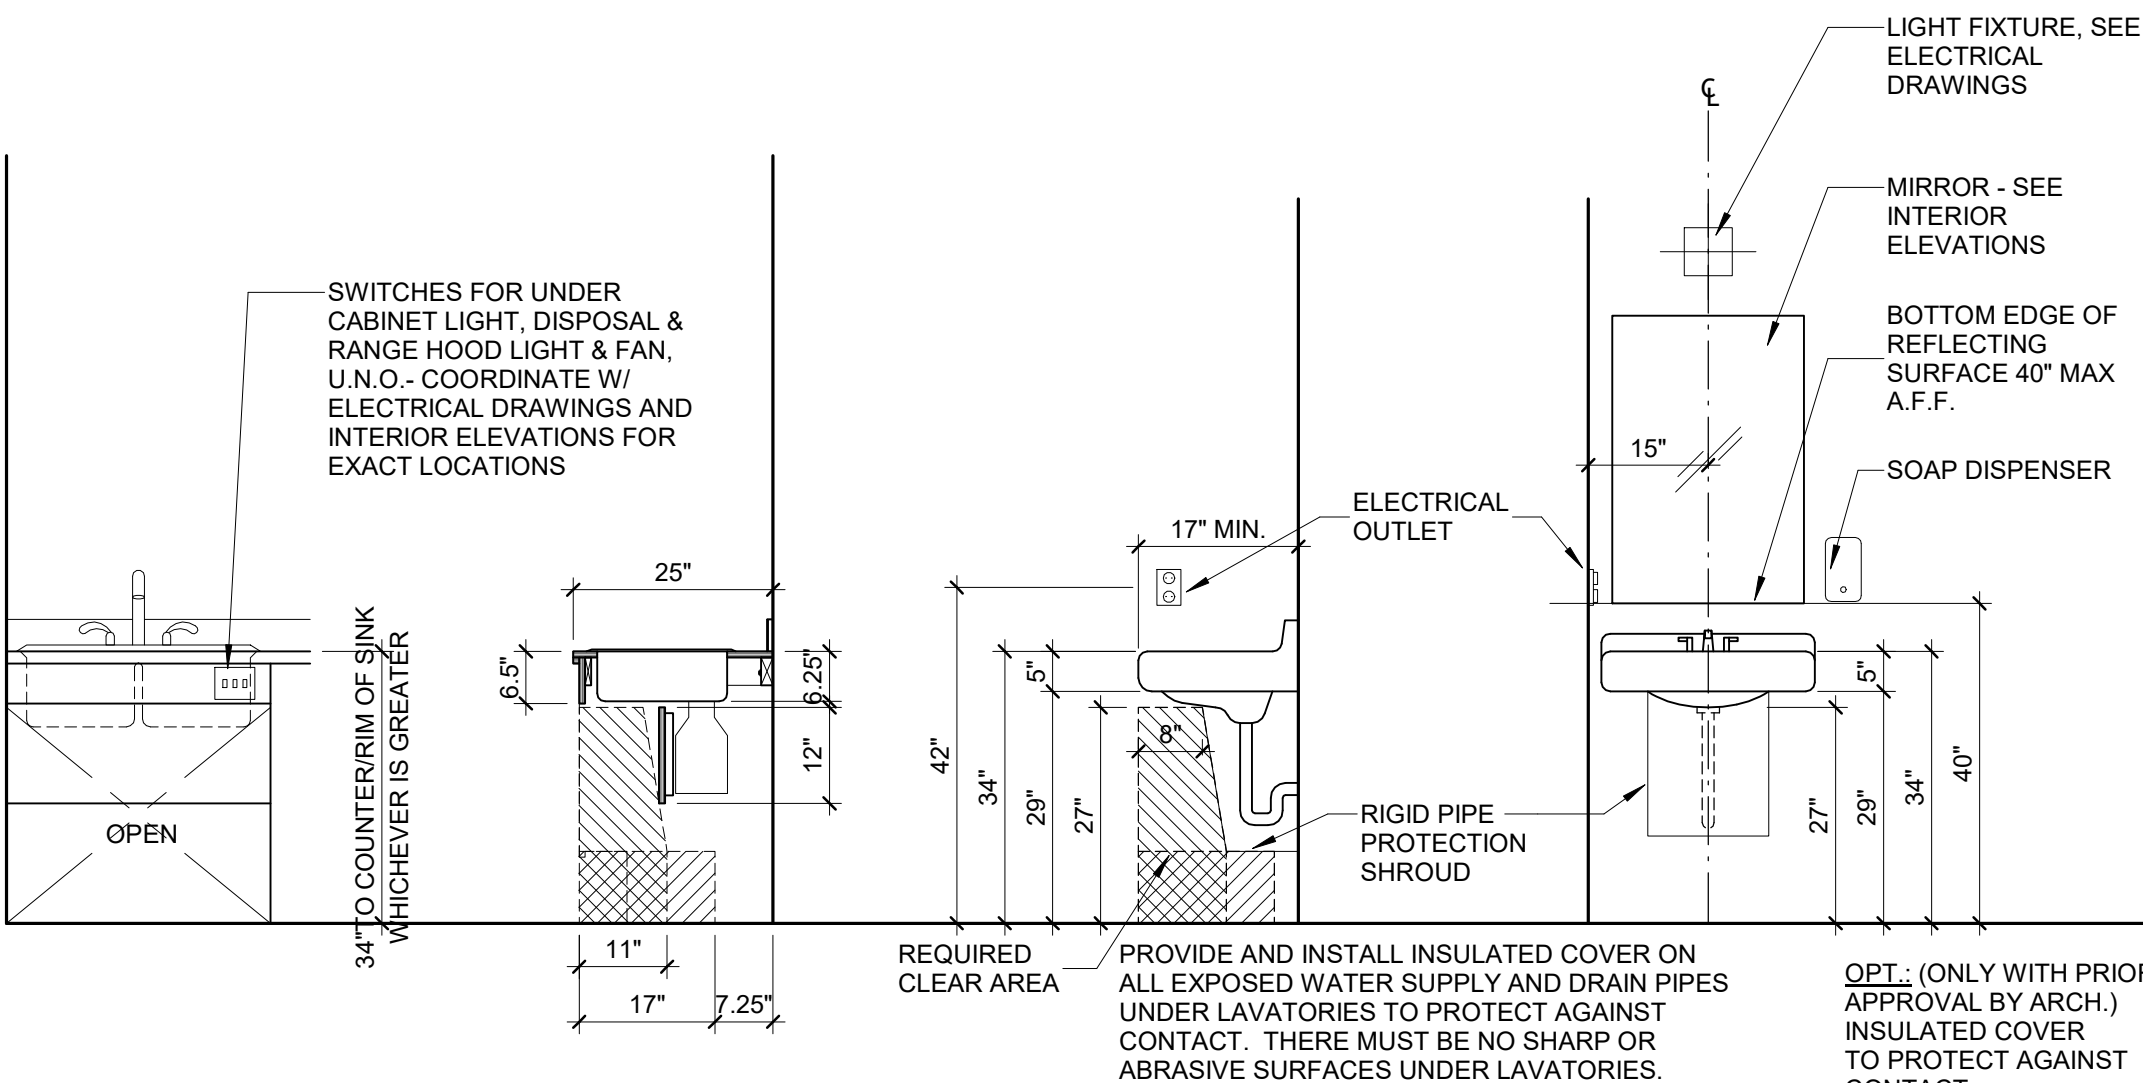


KITCHEN SINK


WALL MOUNTED LAVATORY

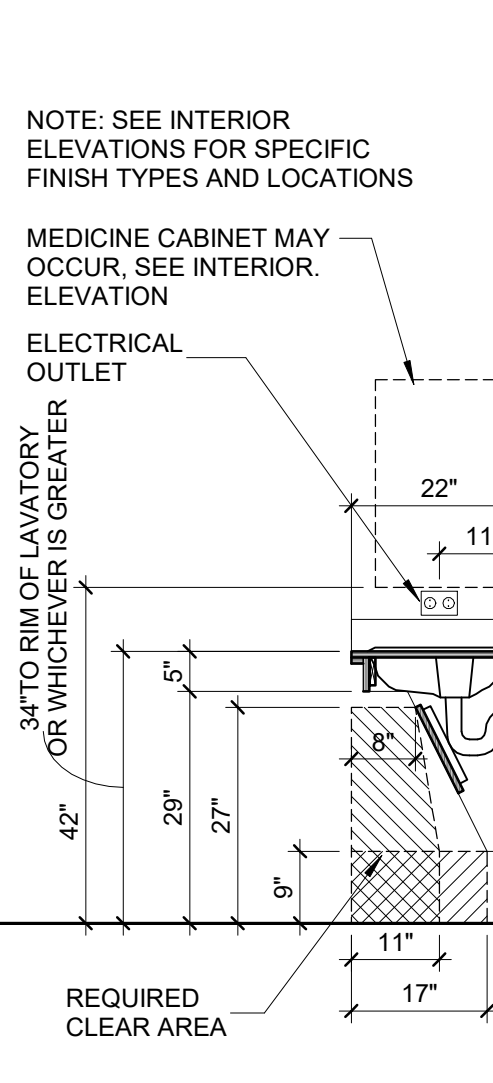

COUNTERTOP MOUNTED LAV.

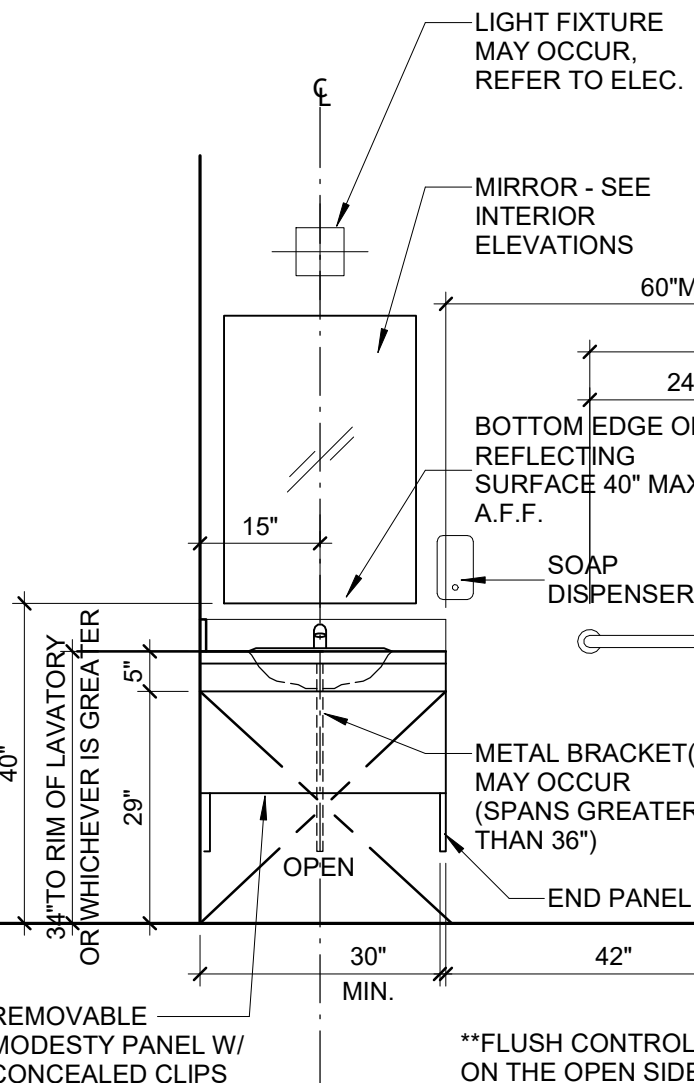

WATER CLOSETS

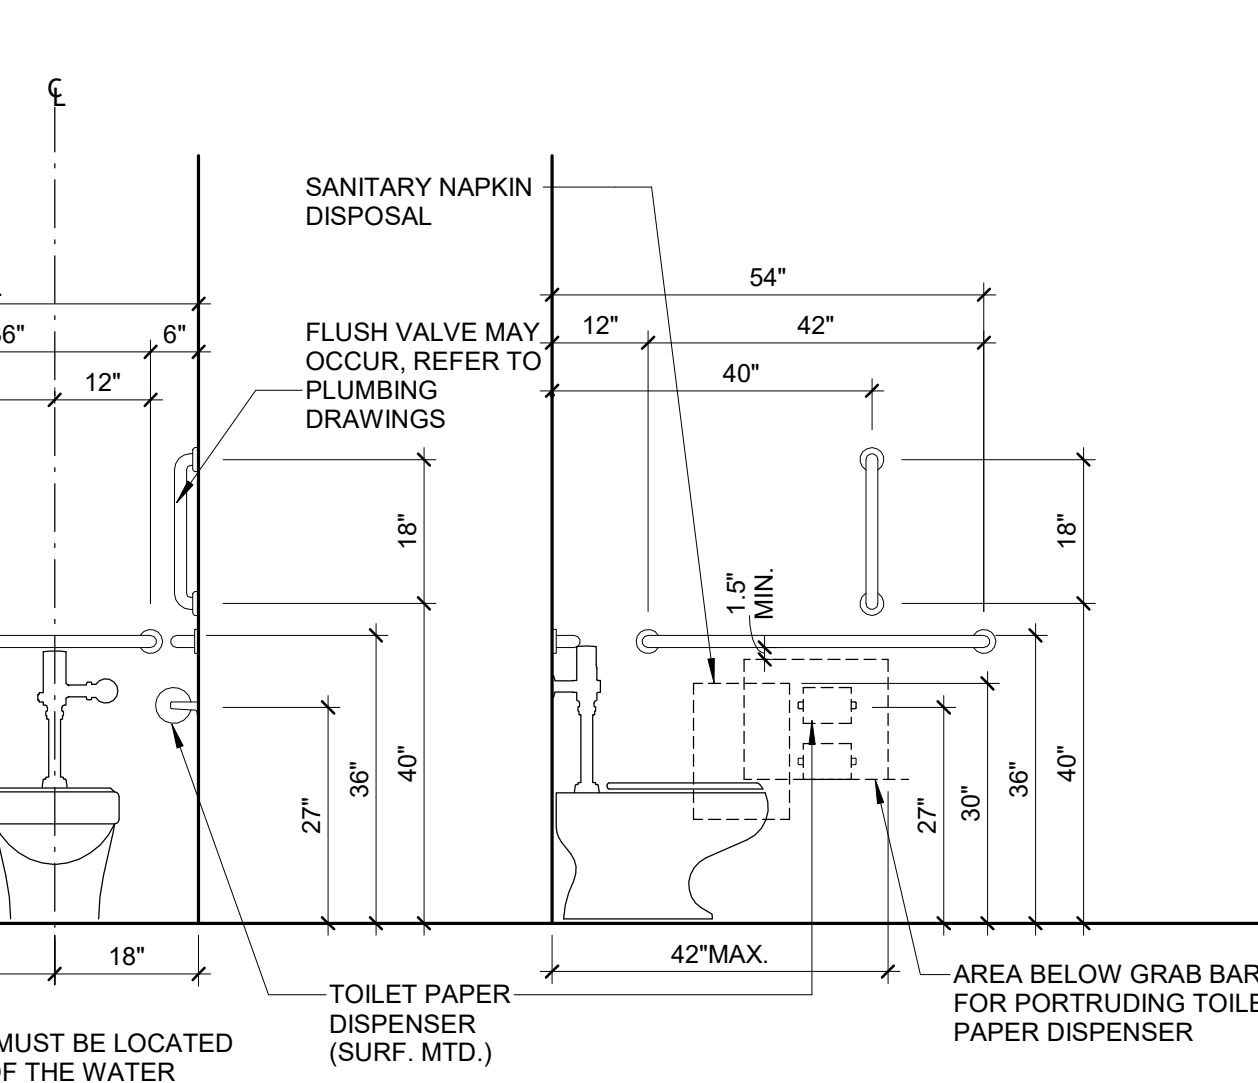

GENERAL NOTES FOR LOCATION OF DEVICES

1. WHEN MOUNTING MULTIPLE DEVICES FROM DIFFERENT TRADES IN THE SAME LOCATION (SUCH AS LIGHTING SWITCHES, LOW VOLTAGE, THERMOSTATS, ETC), THEIR ARRANGEMENT MUST BE IN ACCORDANCE WITH THE FOLLOWING:
 - 1.1. LOCATE DEVICES AS SHOWN ON THE ARCHITECTURAL PLANS, ELEVATIONS OR SECTIONS.
 - 1.2. WHEN SHOWN ON MECHANICAL OR ELECTRICAL DRAWINGS, DEVICES MUST BE UNIFORMLY AND SYMMETRICALLY MOUNTED. VERTICALLY ALIGN DEVICES MOUNTED AT HEIGHTS INDICATED, UNLESS SEPARATED HORIZONTALLY BY A MINIMUM OF 24".
 - 1.3. DEVICES INSTALLED IN MASONRY OR SURFACES TO RECEIVE WOOD PANELS, WALL COVERING OR SIMILAR MATERIALS MUST BE FLUSH WITH THE FINAL SURFACE MATERIAL.
 - 1.4. IF THE CONTRACTOR HAS ANY DOUBTS REGARDING THE LOCATION OF DEVICES, THE CONTRACTOR MUST CONSULT WITH THE ARCHITECT PRIOR TO ROUGHING-IN.
 - 1.5. AT MULTIPLE SWITCHES, GANG W/ SINGLE COVER PLATE.
2. DEVIATIONS FROM THE ABOVE INSTRUCTIONS WITHOUT PRIOR APPROVAL BY THE ARCHITECT MUST BE CORRECTED BY THE INSTALLING CONTRACTOR. ANY COST, INCLUDING CUTTING & PATCHING, ENTAILED IN THE REMOVAL, RELOCATION, AND REINSTALLATION OF ANY DEVICES WILL BE THE RESPONSIBILITY OF THAT CONTRACTOR.

STANDARD AND BARRIER FREE MOUNTING HEIGHTS

SCALE: 1/2"=1'-0"

NOTE: REFER TO INTERIOR ELEVATIONS FOR SPECIFIC FINISH TYPES AND LOCATIONS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS



FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

SHEET TITLE: MOUNTING HEIGHTS AND CONTROLS

IDENTIFICATION NO: PROJECT NO: 25510.A

ISSUED FOR: PRELIMINARY CONSTRUCTION FINAL RECORD

DATE: 01/15/26

DESIGNED BY: HL
DRAWN BY: HL
CHECKED BY: TM
APPROVED BY: RMR

RENOVATE ARMORY, JACKSON (WEST) ARMORY

DEPARTMENT OF MILITARY AND VETERANS AFFAIRS


2700 W ARGYLE ST., JACKSON, MI

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES MANAGEMENT
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR



SIGN NO.	LOCATION ROOM NO.	LOCATION ROOM FUNCTION	SIGN TYPE	SIGN ROOM #	SIGN MESSAGE	MOUNTING DETAIL	DIRECTION
1	010	DRILL HALL	G	-	EXIT	1	
2	010	DRILL HALL	G	-	EXIT	1	
3	013	KITCHEN	G	-	EXIT	1	
4	013	KITCHEN	C	-	BATHROOM	1	
5	013	KITCHEN	A	013A	-	1	
6	010	DRILL HALL	B	013	KITCHEN	1	
7	010	DRILL HALL	A	012	-	1	
8	010	DRILL HALL	L	-	STAIR C	1	
9	STAIR C	STAIR C	B	010	DRILL HALL	1	
10	010	DRILL HALL	G	011	TABLE/CHAIR STORAGE	1	
11A	014	CORRIDOR	G	-	EXIT	5	
11B	014	CORRIDOR	B	010	DRILL HALL	1	
12	014	CORRIDOR	H	-	#-# = 015-022	1	
13	STAIR B	STAIR B	A	-	-	5	
14	STAIR B	STAIR B	H	-	#-# = 014-010	1	
15	STAIR B	STAIR B	H	-	#-# = 015-022	5	
16	015	P.E.S.	L	-	STAIR B	1	
17	015	P.E.S.	A	016	-	1	
18	020	CORRIDOR	B	015	P.E.S.	1	
19	020	CORRIDOR	E1	-	WOMEN	5	
20	010	WOMEN'S BATHROOM	B	018A	LOCKERS/SHOWERS	1	
21	020	CORRIDOR	D1	-	MEN	5	
22	019	MEN'S BATHROOM	B	019A	LOCKERS/SHOWERS	1	
23	020	CORRIDOR	B	021	MECHANICAL ROOM	1	
24	020	CORRIDOR	B	017	PHYSICAL TRAINING	1	
25	020	CORRIDOR	B	022	MECHANICAL ROOM	1	
26	020	CORRIDOR	B	-	ELEVATOR	1	
27	020	CORRIDOR	L	-	STAIR A	1	
28	STAIR A	STAIR A	A	-	-	1	
29	EXTERIOR	FIRE DEPT. CONNECTION	NFPA	-	F.D.C.	-	
30	EXTERIOR	ENTRANCE	K	-	X = A	-	
31	100	VESTIBULE	G	-	EXIT	5	
32	101	LOBBY	E	102	-	1	
33	101	LOBBY	E	-	WOMEN'S	1	
34	101	LOBBY	H	-	#-# = 107-134	1	
35	101	LOBBY	D	-	MEN'S	5	
36	101	LOBBY	A	105	-	3	
37	101	LOBBY	H	-	#-# = 138-181	4	
38	101A	CORRIDOR	A	105	-	3	
39	177	CORRIDOR	A	141A	-	1	
40	177	CORRIDOR	H	-	#-# = 142-169	4	
41	177	CORRIDOR	H	-	#-# = 170-181	4	
42	180	CORRIDOR	B	181	MECHANICAL ROOM	1	
43	181	MECH. ROOM	B	181A	ELECTRICAL ROOM	1	
44	180	CORRIDOR	G	-	EXIT	5	
45	180	CORRIDOR	A	179	-	1	
46	178	CORRIDOR	B	179	D.L.C.	1	
47	178	CORRIDOR	A	141A	-	1	
48	178	CORRIDOR	A	177	-	1	
49	174	CORRIDOR	A	176	-	1	
50	174	CORRIDOR	A	179	-	1	
51	174	CORRIDOR	A	175	-	1	
51A	175	SUPPLY ROOM	A	175A	-	1	
52	174	CORRIDOR	A	174	-	1	
52A	173	SUPPLY ROOM	A	173A	-	1	
53	174	CORRIDOR	H	-	#-# = 171-145	1	
54	176	CORRIDOR	A	144	-	1	
55	176	CORRIDOR	A	141C	-	1	
56	176	CORRIDOR	A	143	-	1	
57	176	CORRIDOR	A	141B	-	1	
58	176	CORRIDOR	A	142	-	1	
59	177	CORRIDOR	H	-	#-# = 145-171	1	
60	101	LOBBY	L	-	STAIR C	4	
61	101	LOBBY	H	-	#-# = DRILL HALL	1	
62	101	LOBBY	B	106	BREAK ROOM	1	
63	101	LOBBY	H	-	#-# = 136-109	1	

SIGN NO.	LOCATION ROOM NO.	LOCATION ROOM FUNCTION	SIGN TYPE	SIGN ROOM #	SIGN MESSAGE	MOUNTING DETAIL	DIRECTION
64	120	CORRIDOR	A	108	-	1	
65	120	CORRIDOR	A	107	-	1	
66	120	CORRIDOR	A	110	-	1	
67	120	CORRIDOR	A	109	-	1	
68	120	CORRIDOR	A	111	-	1	
69	120	CORRIDOR	A	113	-	1	
70	120	CORRIDOR	A	115	-	1	
71	121	CORRIDOR	A	117	-	1	
72	121	CORRIDOR	A	117	-	1	
73	117	SIPR	A	117A	-	1	
74	120	CORRIDOR	A	112	-	1	
75	120	CORRIDOR	A	119	-	1	
76	123	OFFICE	A	114	-	1	
77	123	OFFICE	A	122	-	1	
78	123	OFFICE	A	124	-	1	
79	123	OFFICE	A	126	-	1	
80	123	OFFICE	G	-	EXIT	5	
81	123	OFFICE	G	-	EXIT	5	
82	123	OFFICE	A	125	-	1	
83	123	OFFICE	A	127	-	1	
84	137	CORRIDOR	A	128	-	1	
85	137	CORRIDOR	A	129	-	1	
86	121	CORRIDOR	H	-	#-# = 119-107	3	
87	137	CORRIDOR	A	130	-	1	
88	137	CORRIDOR	A	132	-	1	
89	137	CORRIDOR	A	111	-	1	
90	137	CORRIDOR	A	134	-	1	
91	137	CORRIDOR	B	133	LACTATION ROOM	1	
92	137	CORRIDOR	A	136	-	1	
93	137	CORRIDOR	B	135	JANITOR CLOSET	3	
94	106	BREAK ROOM	G	-	EXIT	5	
95	168	CORRIDOR	A	146	-	1	
96	168	CORRIDOR	A	145	-	1	
97	168	CORRIDOR	A	148	-	1	
98	168	CORRIDOR	A	147	-	1	
99	168	CORRIDOR	A	149	-	1	
100	168	CORRIDOR	A	150	-	1	
101	168	CORRIDOR	A	151	-	1	
102	168	CORRIDOR	A	153	-	1	
103	168	CORRIDOR	A	152	-	1	
104	168	CORRIDOR	A	155	-	1	
105	168	CORRIDOR	A	154	-	1	
106	168	CORRIDOR	A	157	-	1	
107	168	CORRIDOR	L	-	STAIR B	4	
108	168	CORRIDOR	H	-	#-# = DRILL HALL	4	
109	168	CORRIDOR	A	156	-	1	
110	172	CORRIDOR	A	158	-	1	
111	172	CORRIDOR	A	159	-	1	
112	172	CORRIDOR	A	160	-	1	
113	172	CORRIDOR	A	161	-	1	
114	172	CORRIDOR	A	162	-	1	
115	172	CORRIDOR	A	163	-	1	
116	172	CORRIDOR	A	164	-	1	
117	172	CORRIDOR	A	165	-	1	
118	172	CORRIDOR	B	167	-	1	
119	172	CORRIDOR	B	-	ELEVATOR	1	
120	172	CORRIDOR	L	-	STAIR A	1	
121	STAIR A	STAIR A	G	-	EXIT	5	
122	172	CORRIDOR	D1	-	MEN'S	1	
123	172	CORRIDOR	E1	-	WOMEN'S	1	
124	172	CORRIDOR	A	171	-	1	
125	EXTERIOR	DRILL HALL EXTERIOR	K	-	X = B	-	

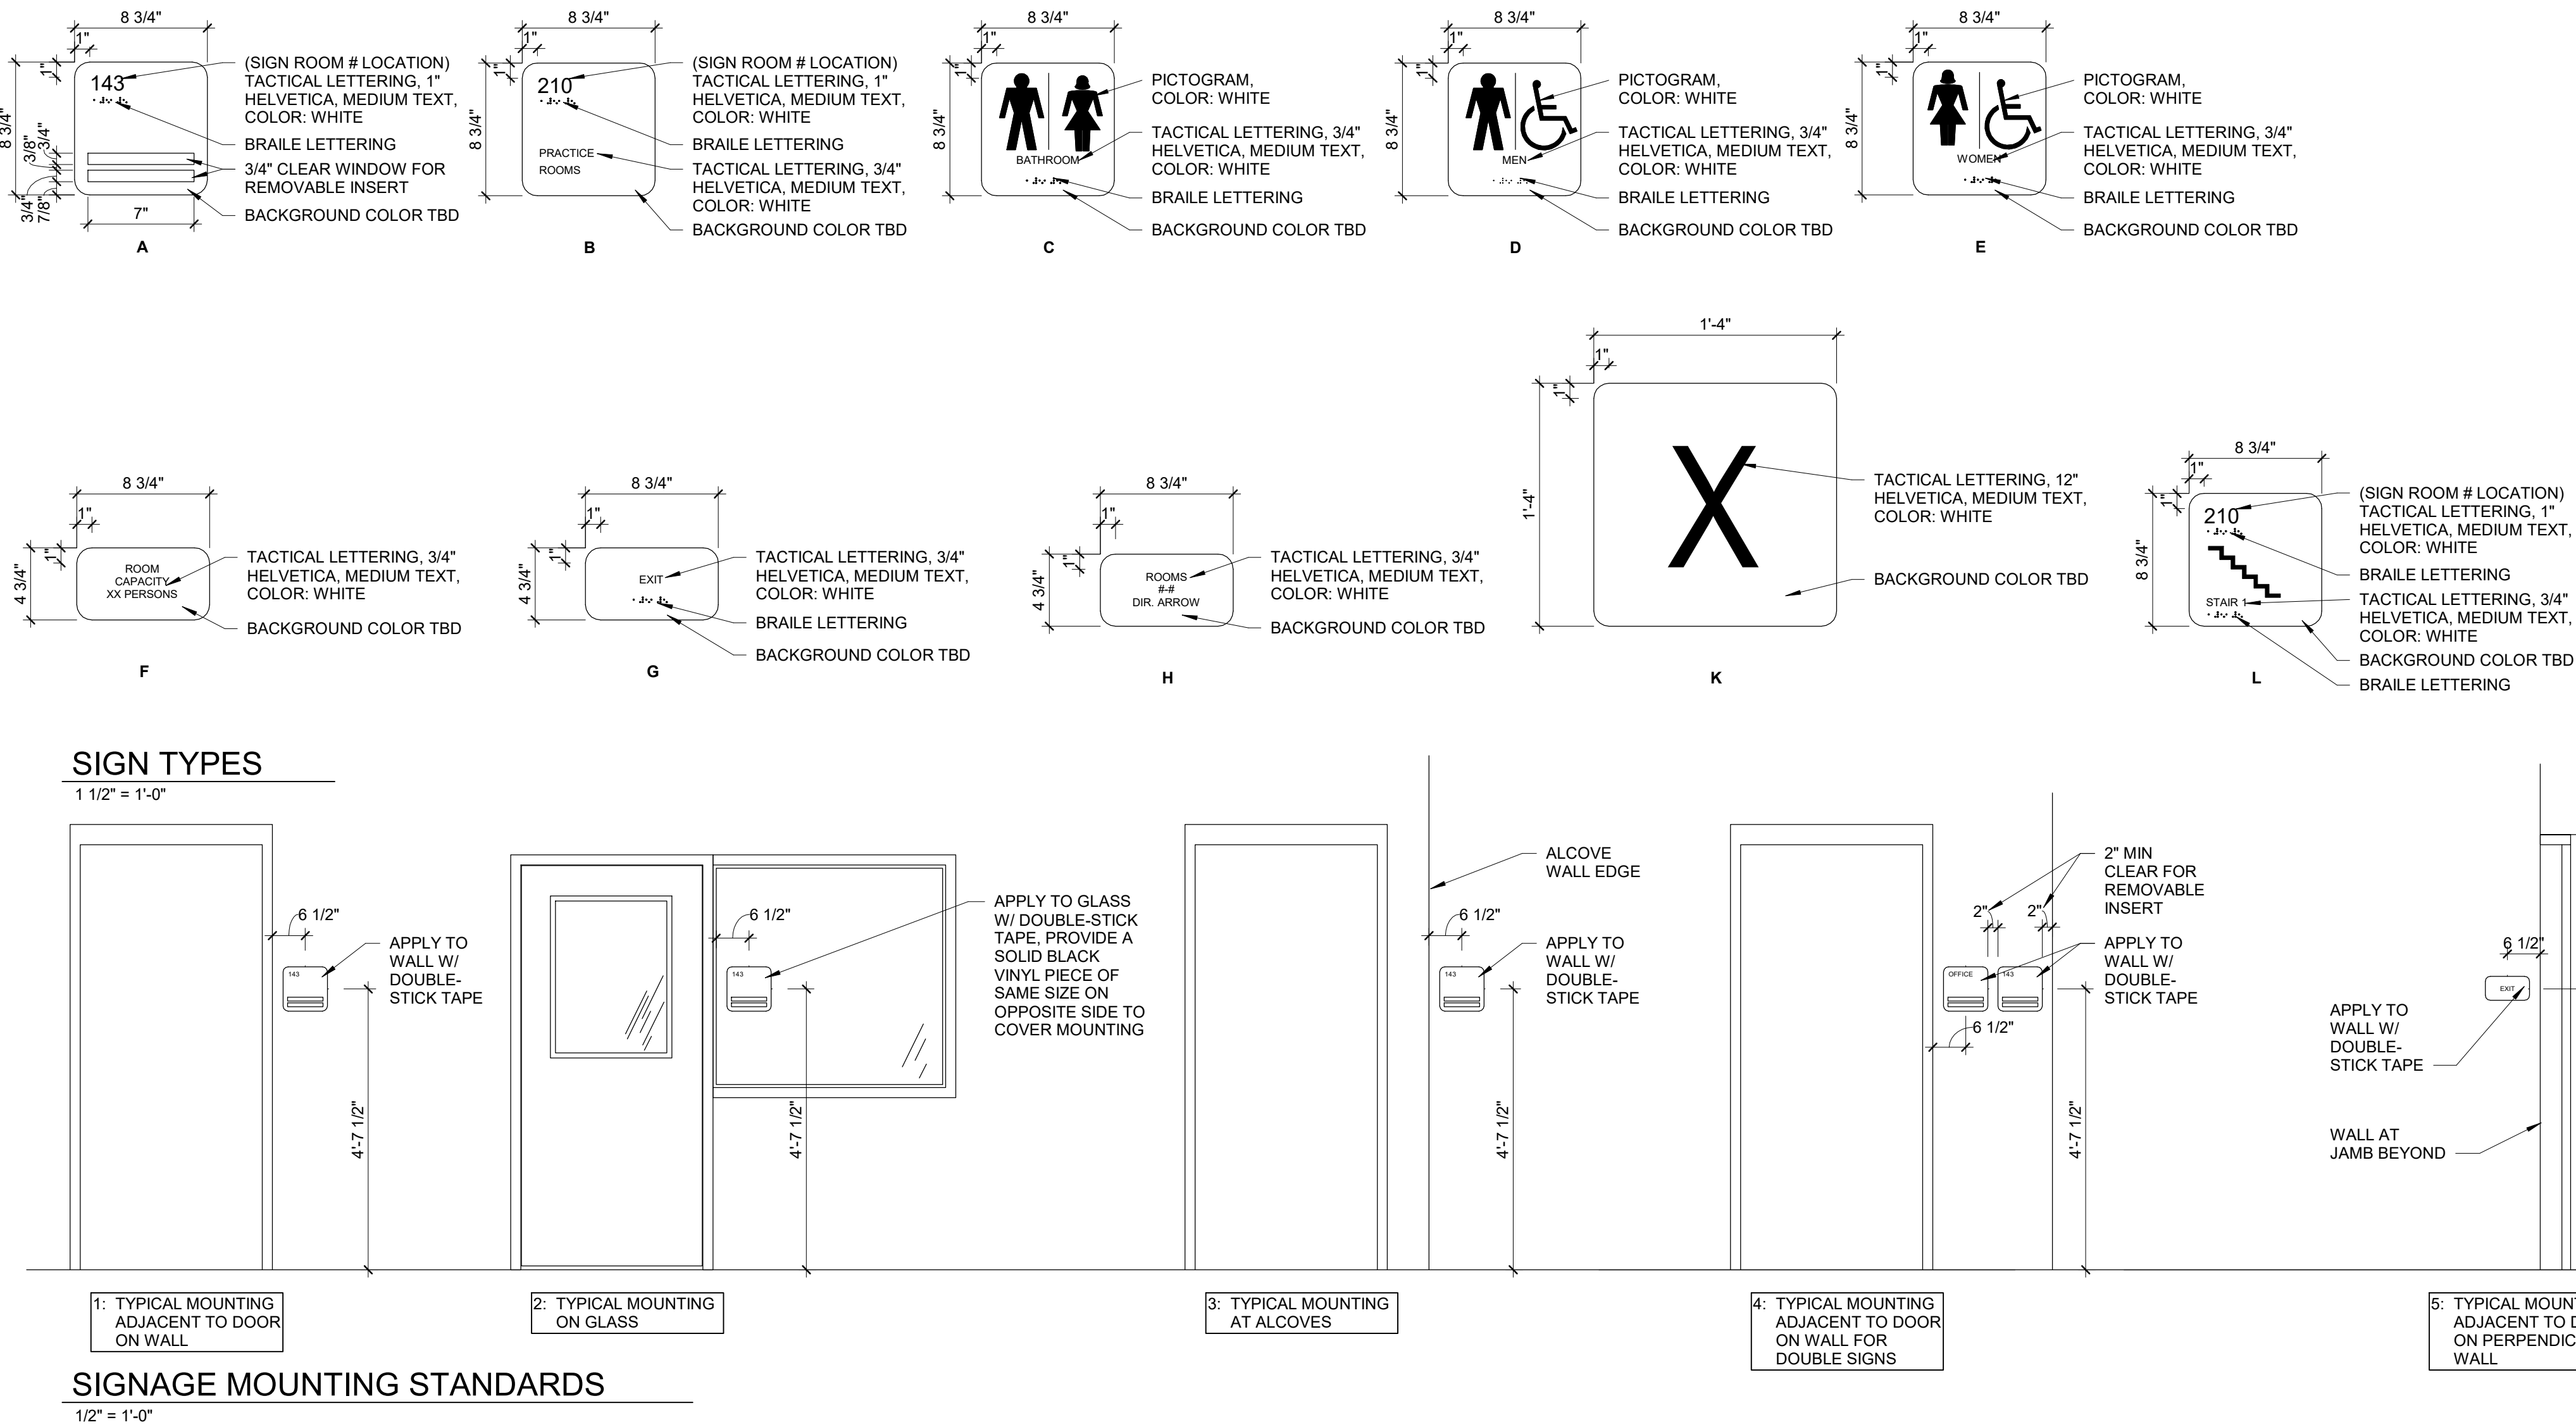

SIGNAGE AND CONTROLS

ALL ROOMS/SPACES TO RECEIVE SIGNAGE U.N.O., REFER TO PROJECT SPECIFICATION FOR TYPE/STYLE.

SIGNAGE MUST BE MOUNTED ON THE WALL ADJACENT TO LATCH SIDE OF DOOR. WHERE THERE IS NO WALL SPACE TO THE LATCH SIDE OF THE DOOR, SIGNAGE MUST BE PLACED ON THE NEAREST ADJACENT WALL. MOUNTING HEIGHT MUST BE 60" A.F.F. TO THE CENTERLINE OF SIGN.

SIGNS CONTAINING TACTILE CHARACTERS MUST HAVE AN 18" MIN. BY 18" MIN. CLEAR FLOOR SPACE, CENTERED ON THE SIGN, BEYOND THE ARC OF ANY DOOR SWING BETWEEN THE CLOSED POSITION AND A 45 DEGREE OPEN POSITION.

TACTILE EXIT SIGNS: A TACTILE SIGN STATING "EXIT" AND COMPLYING WITH ICC/ANSI A117.1 CHAPTER 7 MUST BE PROVIDED ADJACENT TO EACH DOOR TO AN EGRESS STAIRWAY, AN EXIT PASSAGEWAY AND THE EXIT DISCHARGE.

ACCESSIBLE SIGNAGE: ALL REQUIRED ACCESSIBLE ELEMENTS MUST BE IDENTIFIED BY THE INTERNATIONAL SYMBOL OF ACCESSIBILITY AT THE FOLLOWING LOCATIONS:

1. ACCESSIBLE PARKING SPACES
2. ACCESSIBLE PASSENGER LOADING ZONES
3. ACCESSIBLE ROOMS WHERE MULTIPLE SINGLE-USED TOILET OR BATHING ROOMS ARE CLUSTERED AT A SINGLE LOCATION
4. ACCESSIBLE ENTRANCES WHERE NOT ALL ENTRANCES ARE ACCESSIBLE
5. ACCESSIBLE CHECK-OUT AISLES WHERE NOT ALL AISLES ARE ACCESSIBLE
6. FAMILY OR ASSISTED-USE TOILET AND BATHING ROOMS
7. ACCESSIBLE DRESSING, FITTING AND LOCKER ROOMS WHERE NOT ALL SUCH ROOMS ARE ACCESSIBLE
8. ACCESSIBLE AREAS OF REFUGE
9. EXTERIOR AREAS FOR ASSISTED RESCUE
10. IN RECREATIONAL FACILITIES, LOCKERS THAT ARE REQUIRED TO BE ACCESSIBLE.

A TACTILE SIGN MUST BE PROVIDED AT ALL LOCATIONS WHERE PICTORIAL SIGNAGE IS USED TO LABEL PERMANENT ROOMS OR SPACES (I.E. RESTROOMS), COMPLYING WITH ICC/ANSI A117.1 CHAPTER 7 AND MUST BE PROVIDED ADJACENT TO EACH DOOR.

ELEVATOR LANDING DIRECTIONAL SIGNAGE: PROVIDE AND INSTALL SIGNAGE INDICATING THE LOCATION OF OTHER MEANS OF EGRESS AND WHICH ARE ACCESSIBLE MEANS OF EGRESS.

ACCESSIBLE SIGNAGE: ALL REQUIRED ACCESSIBLE ELEMENTS MUST BE IDENTIFIED BY THE INTERNATIONAL SYMBOL OF ACCESSIBILITY AT THE FOLLOWING LOCATIONS:

1. ACCESSIBLE PARKING SPACES
2. ACCESSIBLE PASSENGER LOADING ZONES
3. FAMILY OR ASSISTED-USE TOILET AND BATHING ROOMS
4. ACCESSIBLE ENTRANCES WHERE NOT ALL ENTRANCES ARE ACCESSIBLE
5. ACCESSIBLE DRESSING, FITTING, AND LOCKER ROOMS WHERE NOT ALL SUCH ROOMS ARE ACCESSIBLE
6. ACCESSIBLE AREAS OF REFUGE
7. EXTERIOR AREAS FOR ASSISTED RESCUE
8. IN RECREATIONAL FACILITIES, LOCKERS THAT ARE REQUIRED TO BE ACCESSIBLE.

FIRE RESISTANCE RATING SIGNAGE: FIRE FIRE WALLS, FIRE BARRIERS, FIRE PARTITIONS, SMOKE BARRIERS AND SMOKE PARTITIONS OR ANY OTHER WALL REQUIRED TO HAVE PROTECTED OPENINGS OR PENETRATIONS MUST BE EFFECTIVELY AND PERMANENTLY IDENTIFIED WITH SIGNS OR STENCILING. SUCH IDENTIFICATION SHALL:

1. BE LOCATED IN ACCESSIBLE CONCEALED FLOOR, FLOOR/CEILING OR ATTIC SPACES.
 2. BE LOCATED WITHIN 15 FEET OF THE END OF EACH WALL AND AT INTERVALS NOT EXCEEDING 30 FEET MEASURED HORIZONTALLY ALONG THE WALL OR PARTITION; AND
 3. INCLUDE LETTERING NOT LESS THAN 3 INCHES IN HEIGHT WITH A MINIMUM 3/8 INCH STROKE IN A CONTRASTING COLOR INCORPORATING THE SUGGESTED WORDING "FIRE AND/OR SMOKE BARRIER - PROTECT ALL OPENINGS" OR SIMILAR WORDING. PROTECTED OPENING SIGNAGE REQUIRED ONLY WHERE OPENING PROTECTION IS REQUIRED.
- A. PROTECTED OPENING SIGNAGE REQUIRED ONLY WHERE OPENING PROTECTION IS REQUIRED PER MMC.
- B. SMOKE BARRIER SIGNAGE ONLY REQUIRED WHEN WALL IS DESIGNATED "SMOKE BARRIER"

EQUIPMENT ROOM IDENTIFICATION (MBC SECTION 014.2): FIRE PROTECTION EQUIPMENT SHALL BE IDENTIFIED IN AN APPROVED MANNER. ROOMS CONTAINING CONTROLS FOR AIR-CONDITIONING SYSTEMS, SPRINKLER RISERS AND VALVES OR OTHER FIRE DETECTION, SUPPRESSION OR CONTROL ELEMENTS SHALL BE IDENTIFIED FOR USE OF THE FIRE DEPARTMENT. APPROVED SIGNS REQUIRED TO IDENTIFY FIRE PROTECTION EQUIPMENT AND EQUIPMENT LOCATION SHALL BE CONSTRUCTED OF DURABLE MATERIALS, PERMANENTLY INSTALLED AND READILY VISIBLE.





Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

MISSDIG811

FOR SITE OWNED UTILITIES


72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821

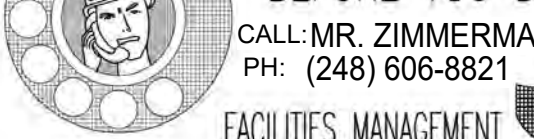

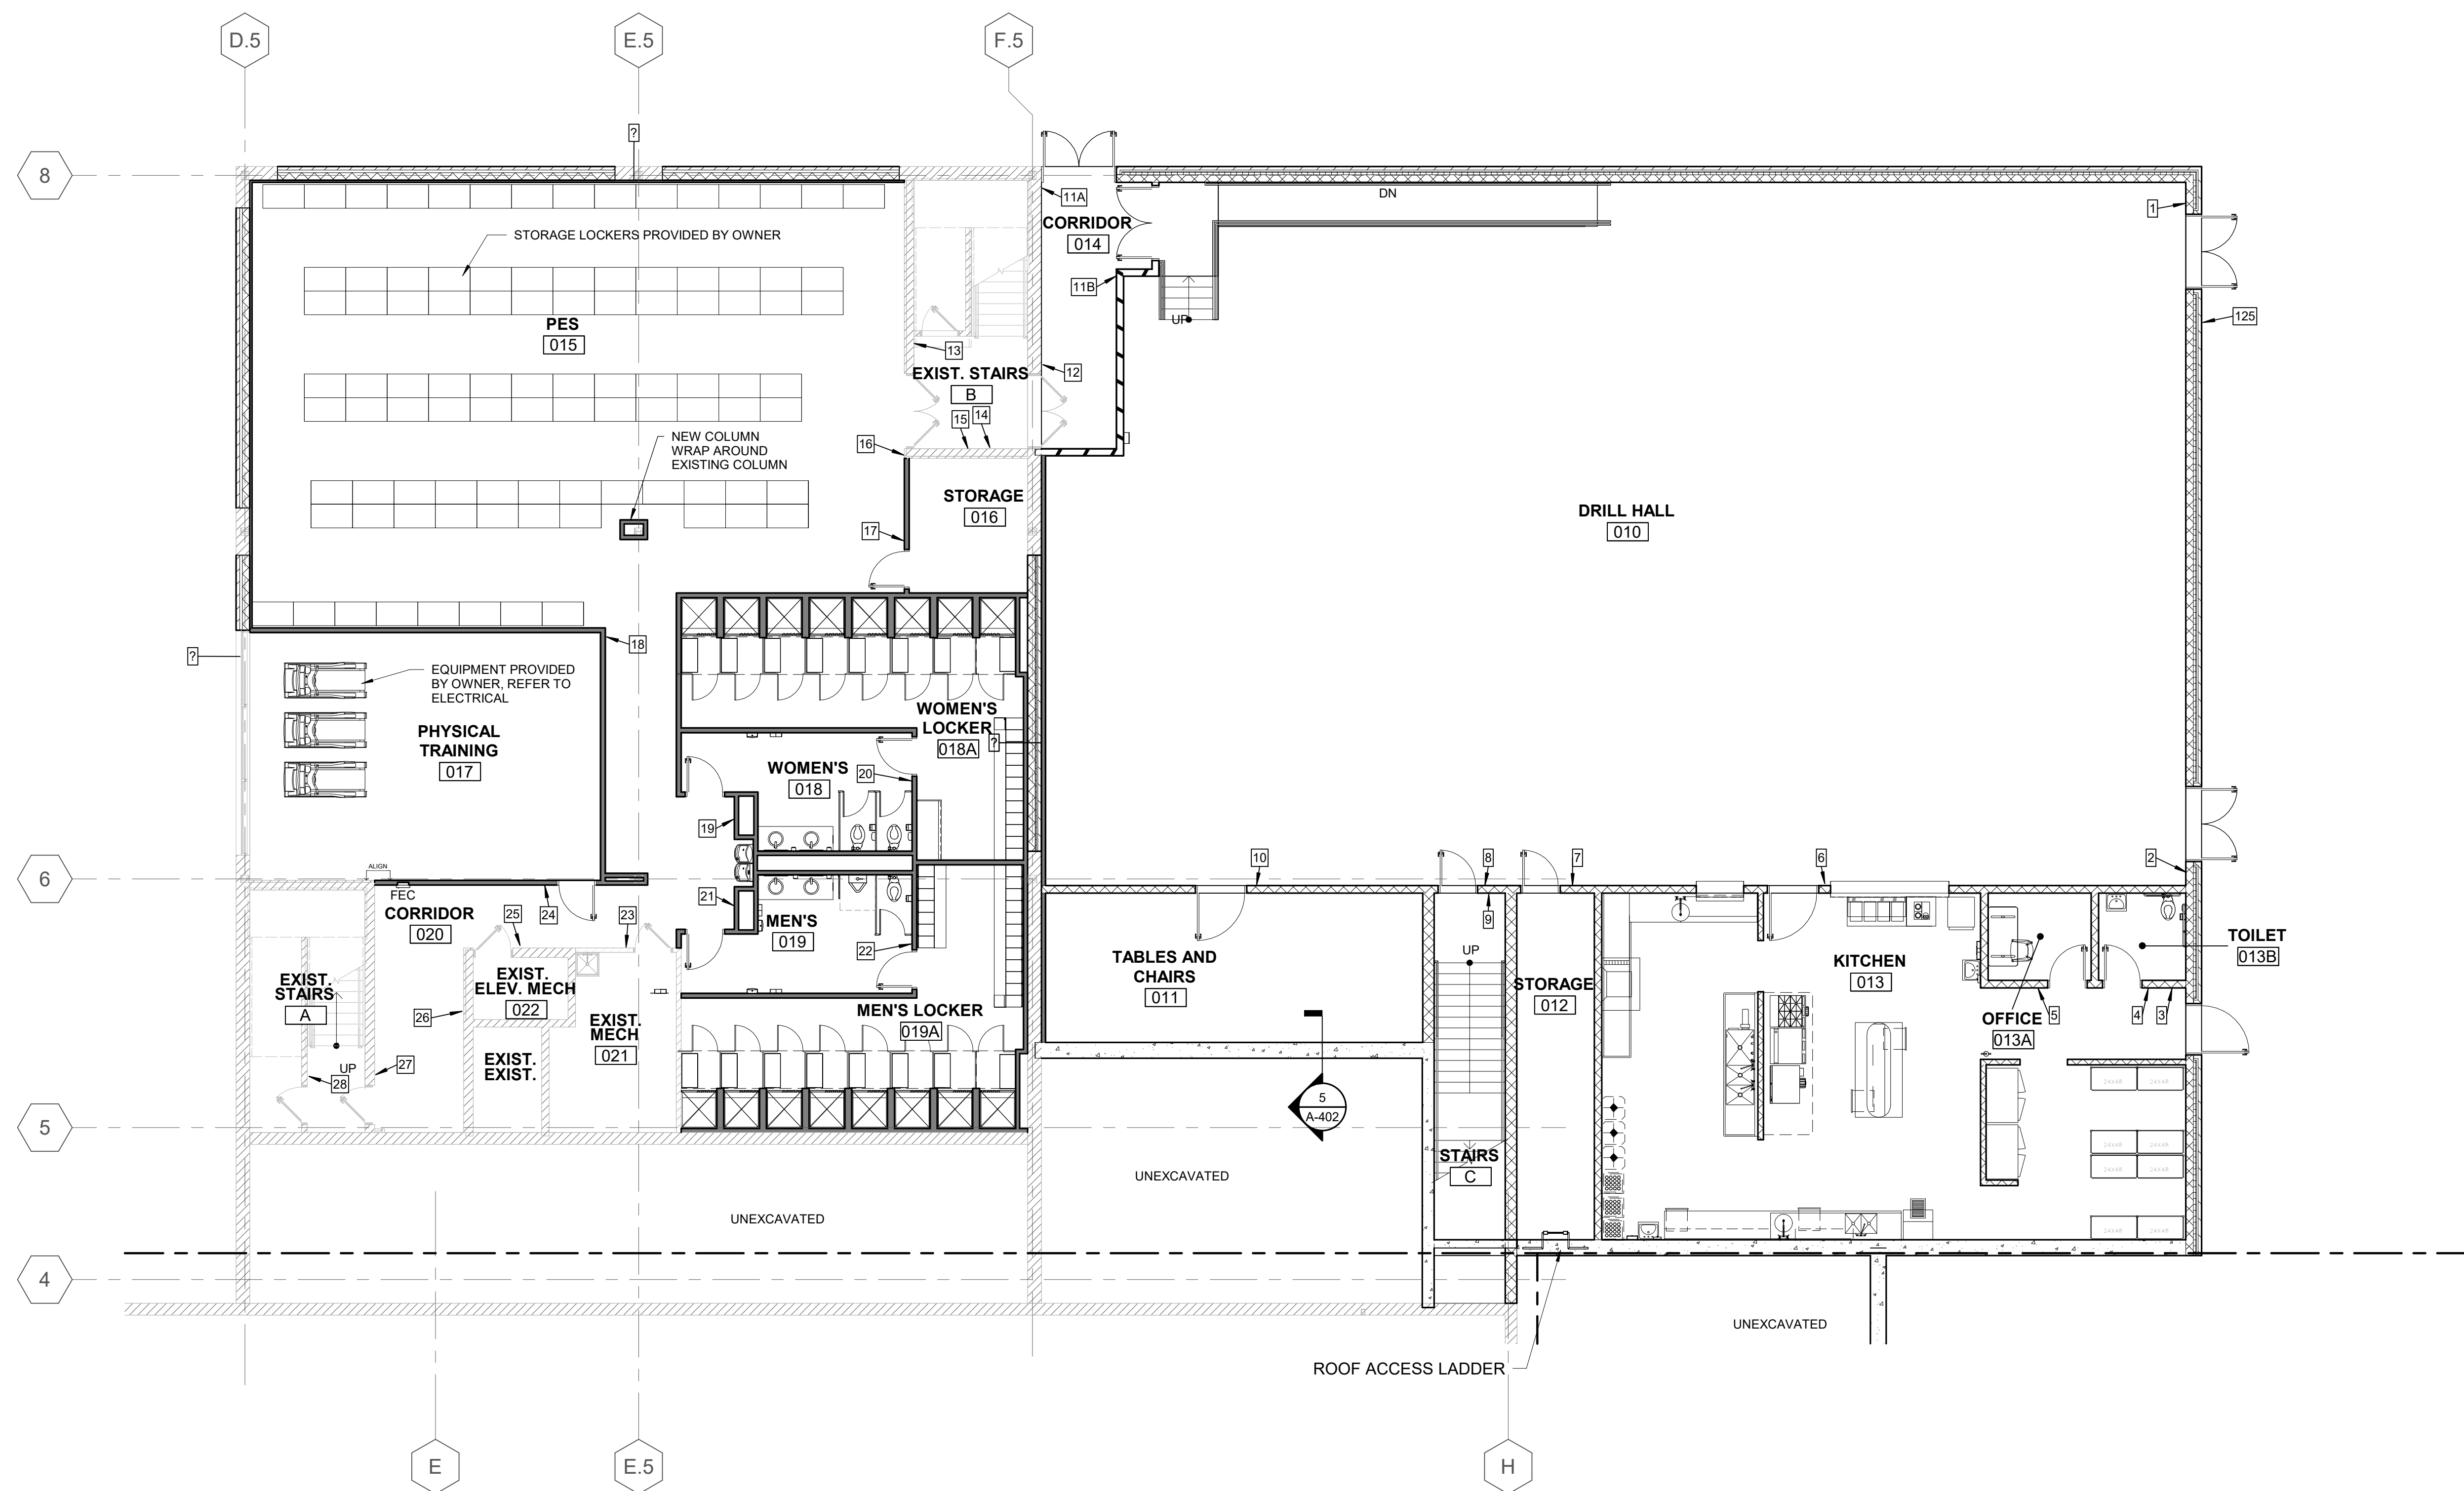

1
A-003
1/8" = 1'-0"

LOWER LEVEL FLOOR PLAN - PART C

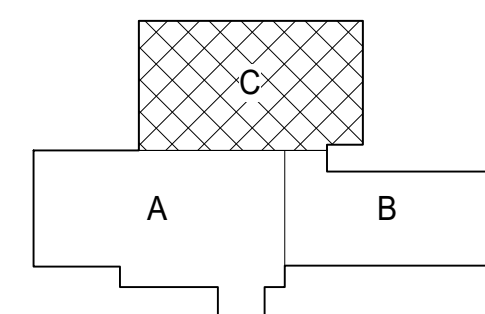

MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

SHEET TITLE: SIGNAGE LOWER FLOOR PLAN - PART C

DESIGNED	HL	DATE
DRAWN	HL	01/15/26
CHECKED	TM	
APPROVED	RMR	

ISSUED FOR:	IDENTIFICATION NO:	SHEET
PRELIMINARY	PROJECT NO: 25510.A	A-003
CONSTRUCTION	DMWA - 362282507	
FINAL RECORD	FILE NO. INDEX CODE:	

A-003


RENOVATE ARMORY, JACKSON (WEST) ARMORY

DEPARTMENT OF MILITARY AND VETERANS AFFAIRS


2700 W ARGYLE ST., JACKSON, MI

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES MANAGEMENT
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, P.E., DIRECTOR



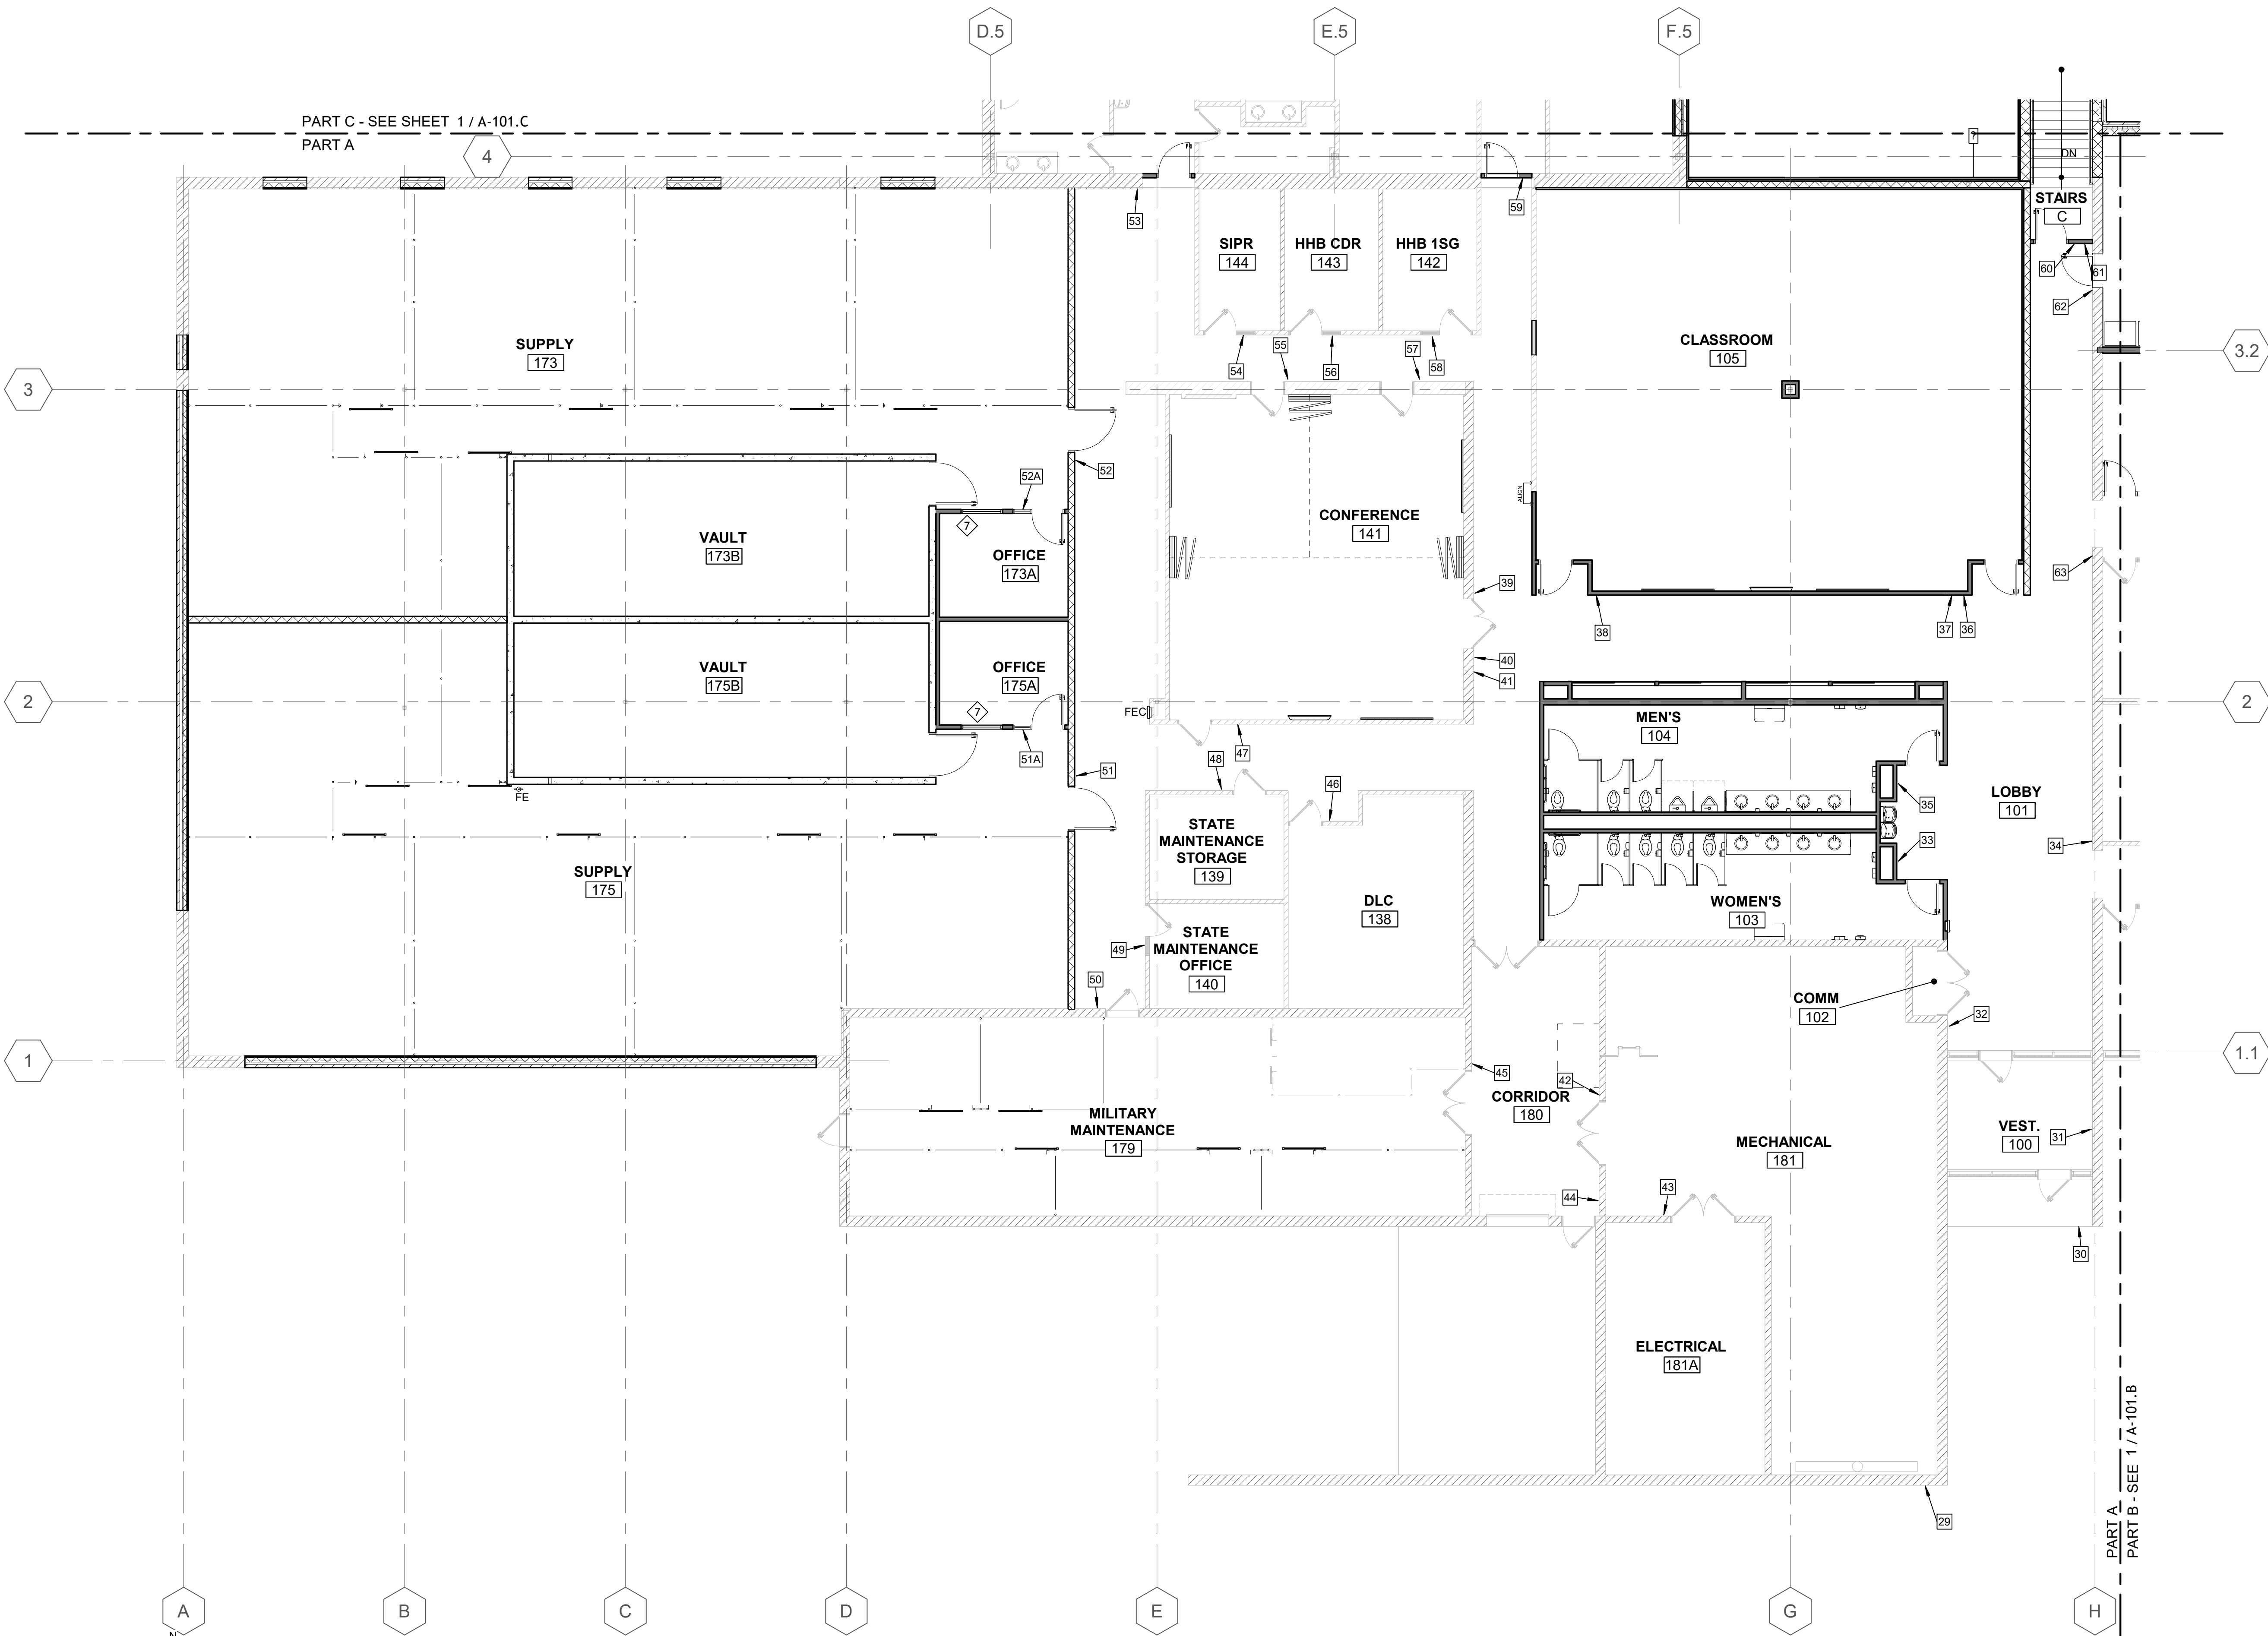

MAIN LEVEL FLOOR PLAN - PART A
1/8" = 1'-0"

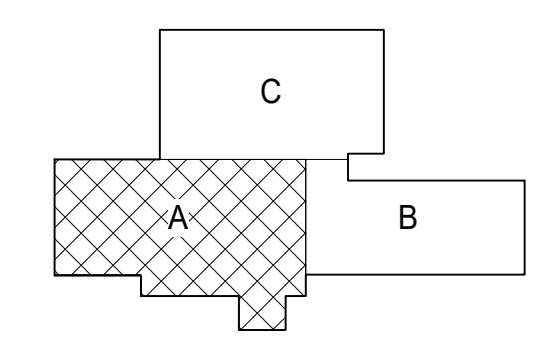

MISSDIG811

FOR SITE OWNED UTILITIES


72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

BTMB
Technology, Management & Budget


Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF
SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED,
COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR
WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

STATE OF MICHIGAN DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET FACILITIES AND BUSINESS SERVICES ADMINISTRATION DESIGN AND CONSTRUCTION DIVISION ADAM P. LARCH, R.A., DIRECTOR							
RENOVATE ARMORY, JACKSON (WEST) ARMORY DEPARTMENT OF MILITARY AND VETERANS AFFAIRS 2700 W ARGYLE ST., JACKSON, MI							
SHEET TITLE: SIGNAGE MAIN FLOOR PLAN - PART A							
SHEET		IDENTIFICATION NO:		ISSUED FOR:		DATE	
A-004		PROJECT NO: 25510.A		PRELIMINARY		01/15/26	
		DIVA: 262285007		CONSTRUCTION		☒	
		FILE NO/INDEX CODE:		FINAL RECORD		☐	
		517/25039.CAK					
				DESIGNED		HL	
				DRAWN		TM	
				CHECKED		HL	
				APPROVED		RMR	

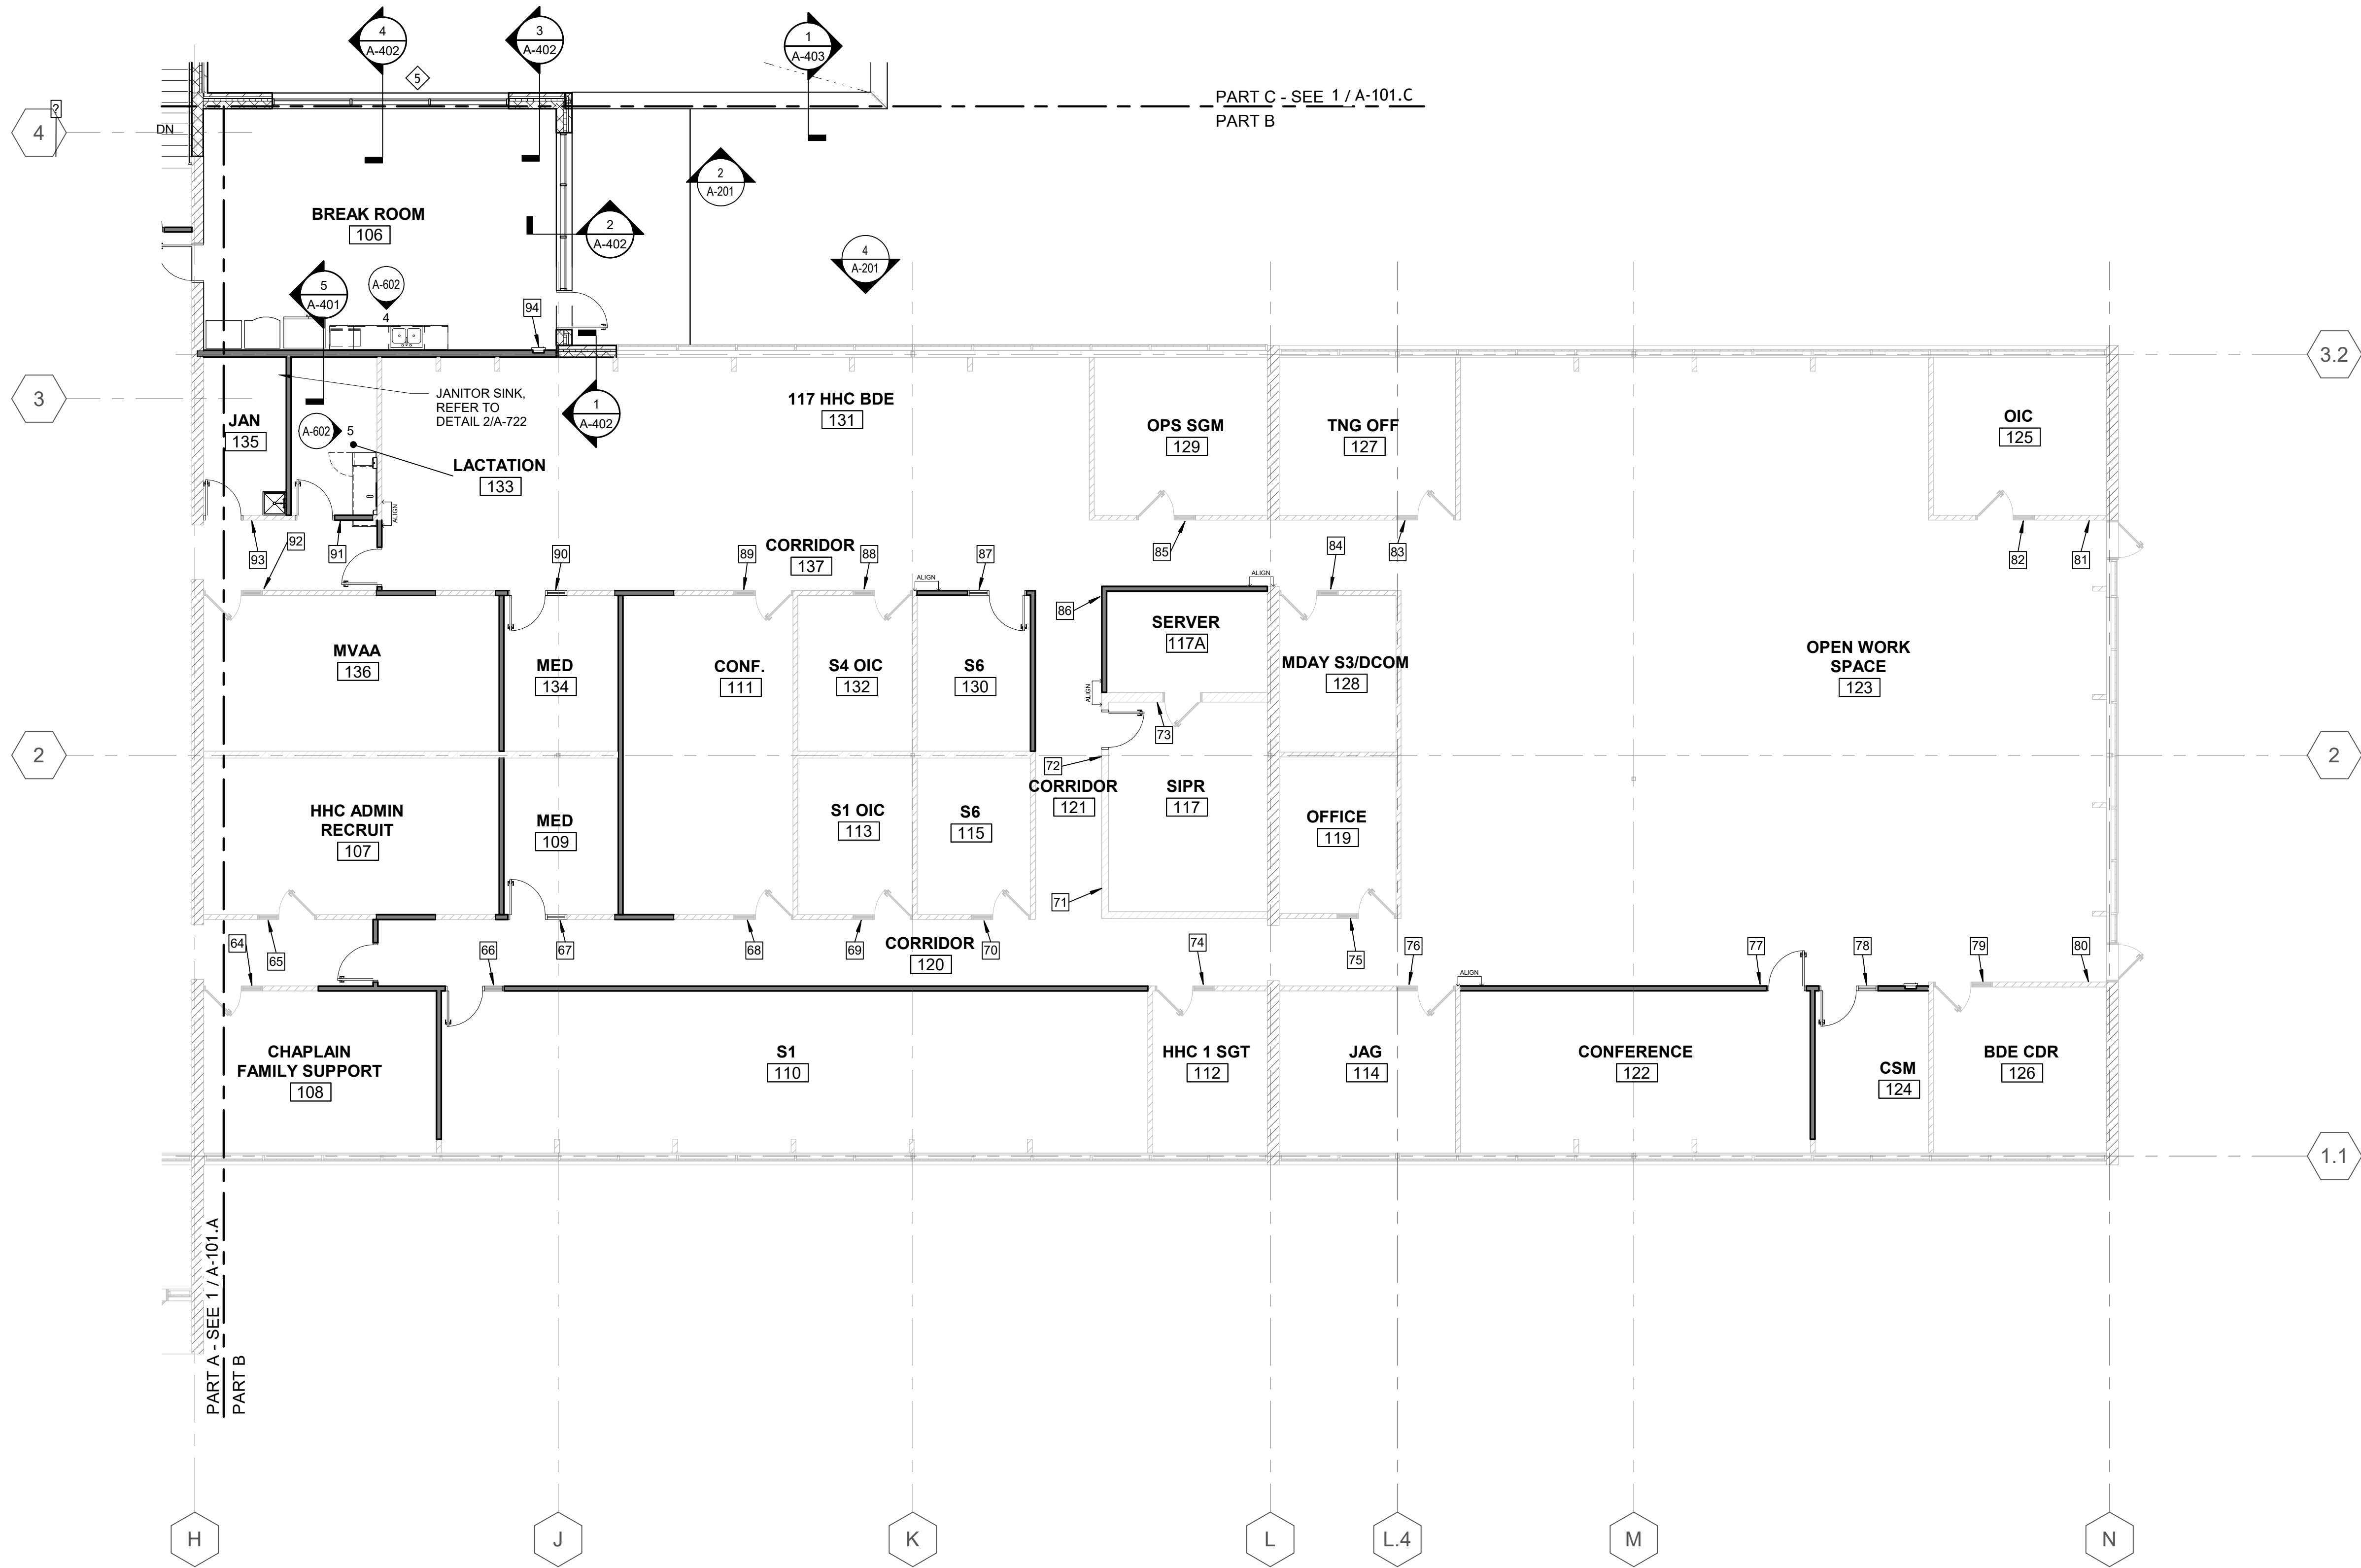

MAIN LEVEL FLOOR PLAN - PART B
1/8" = 1'-0"

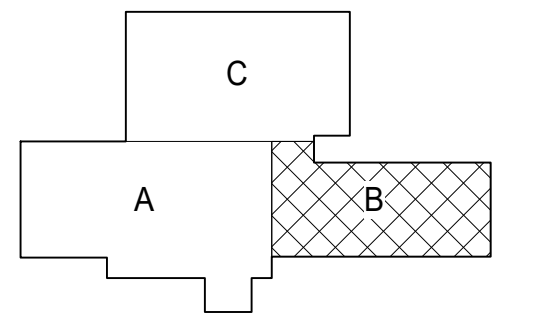



MISSDIG811

FOR SITE OWNED UTILITIES




Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

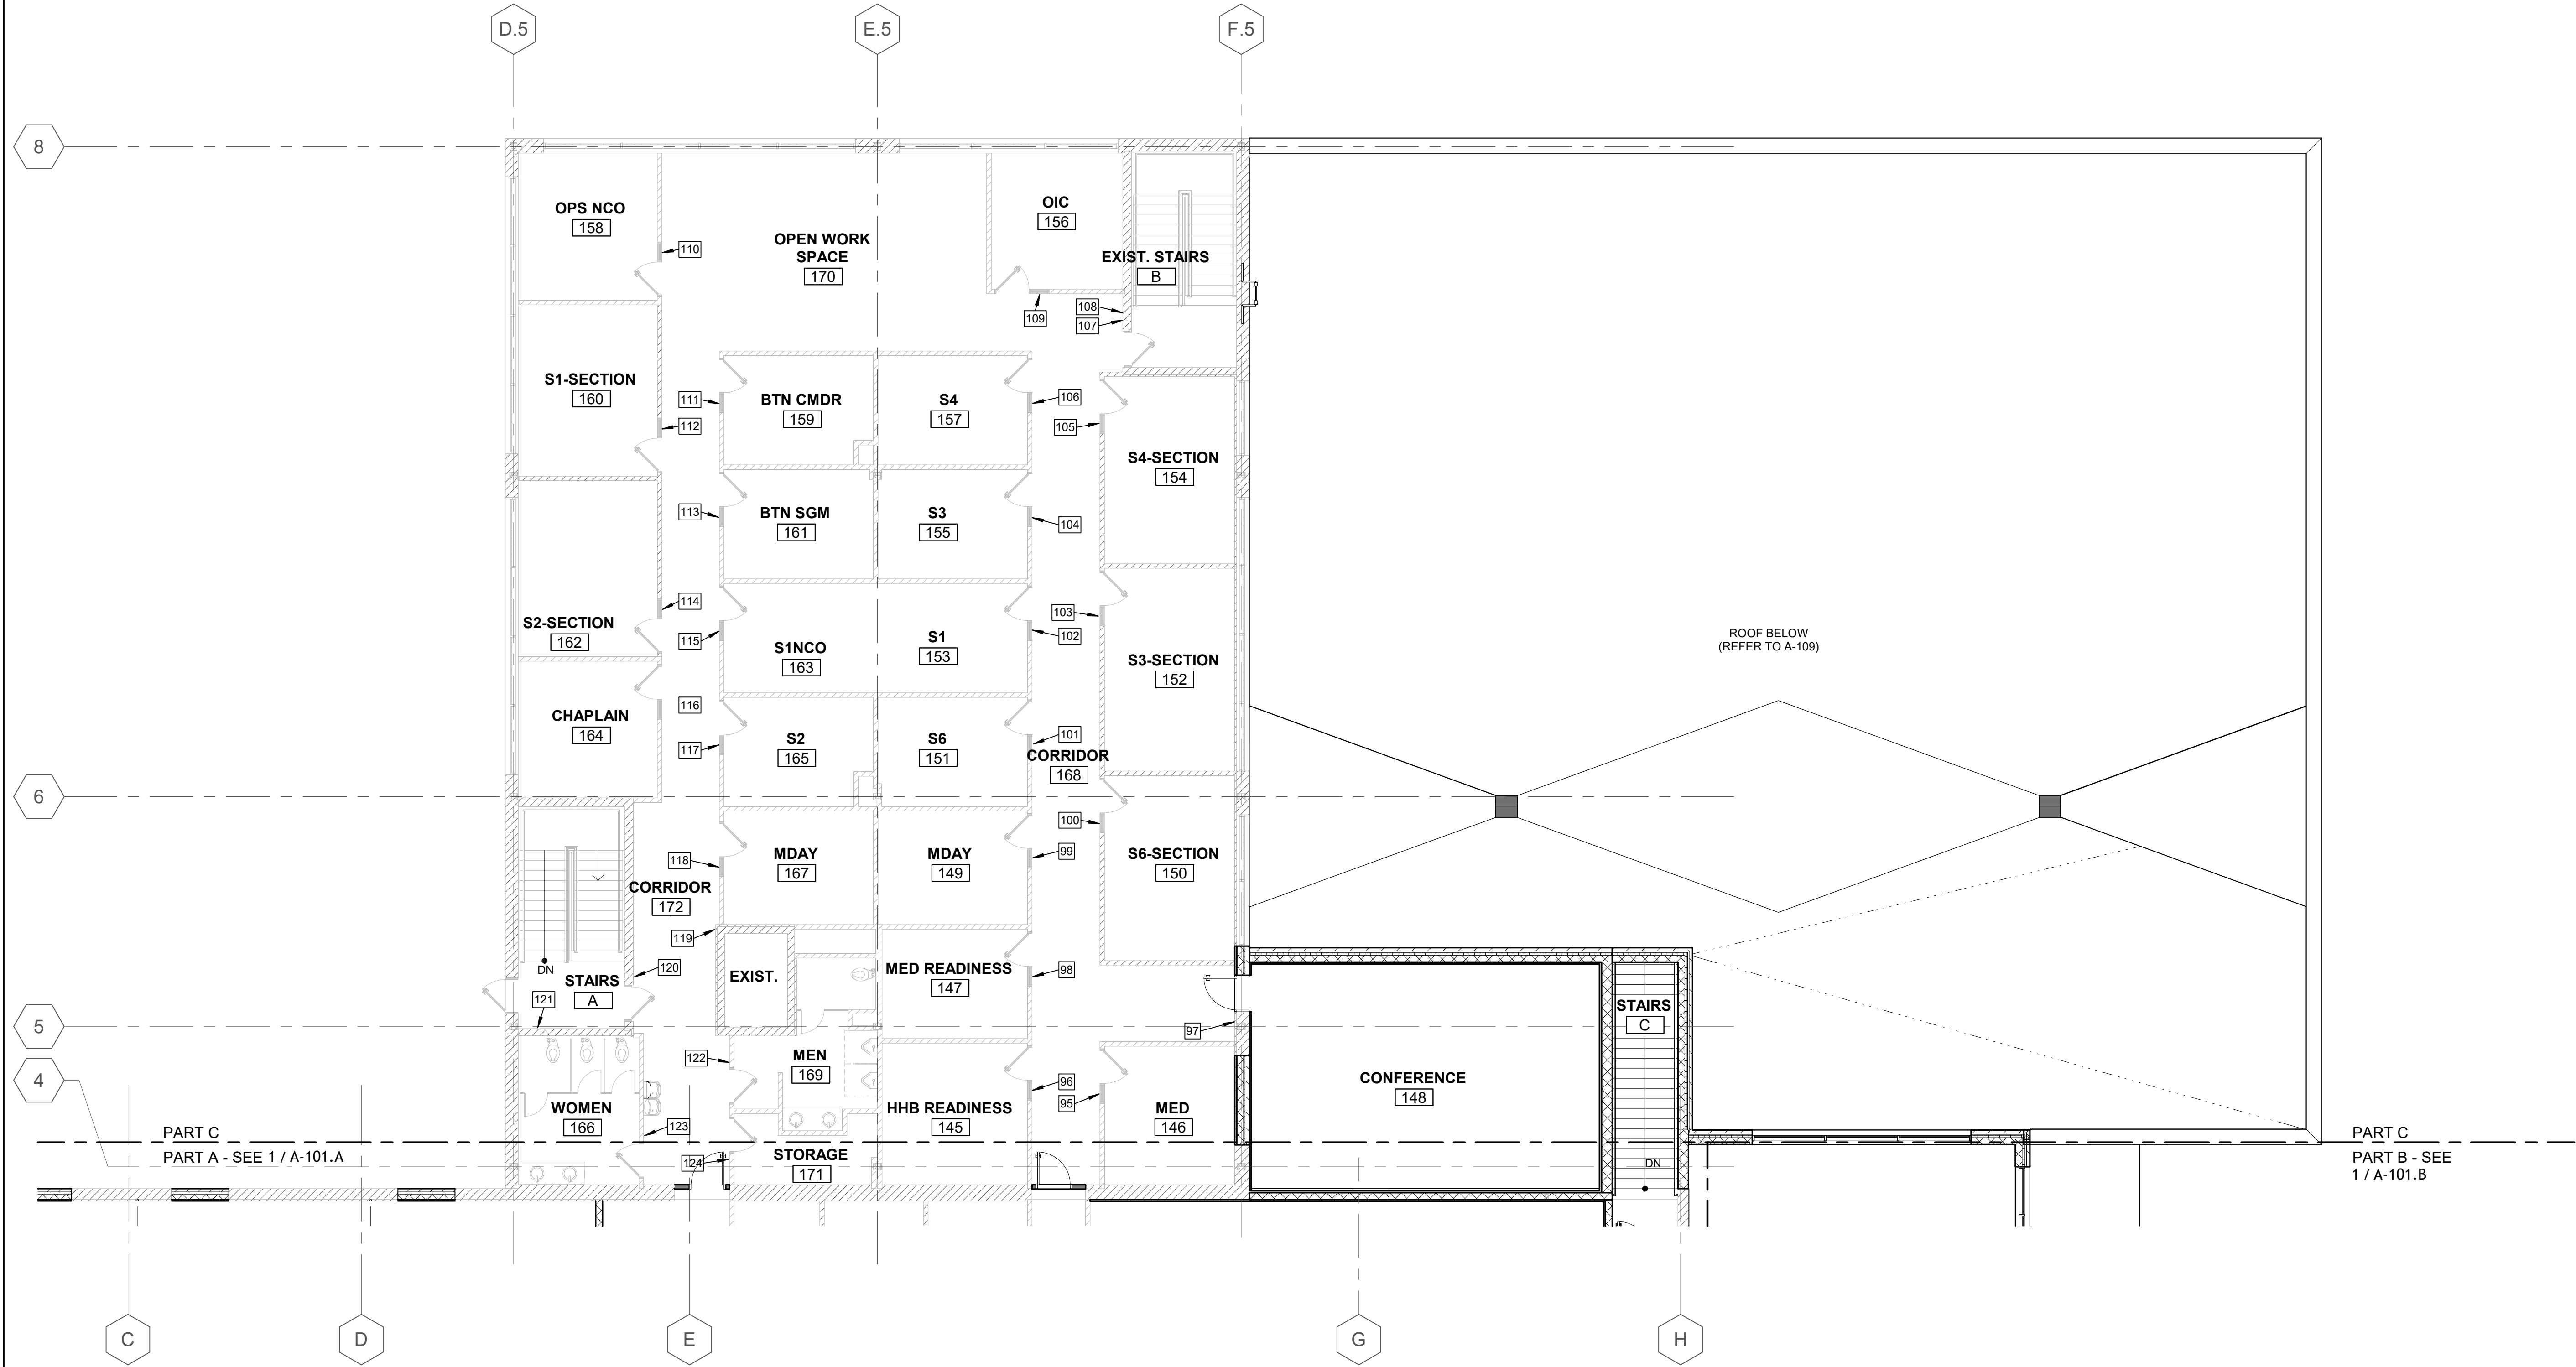


MAIN LEVEL FLOOR PLAN - PART C

1/8" = 1'-0"

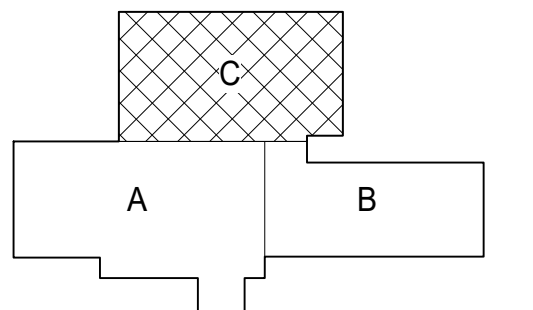

MISSDIG811

FOR SITE OWNED UTILITIES

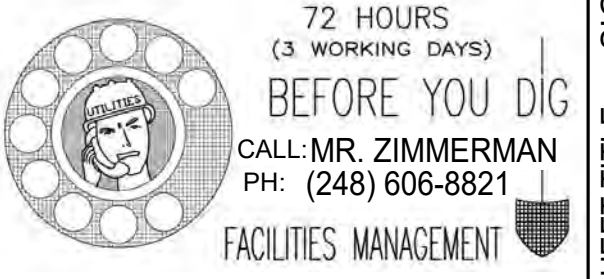

Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

STATE OF MICHIGAN
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, P.E., DIRECTOR



RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

SHEET	IDENTIFICATION NO:	ISSUED FOR:	DATE	DESIGNED
A-006	PROJECT NO: 25510.A	PRELIMINARY	☐	DRAWN
	DWVA: 2522925007	CONSTRUCTION	☒	CHECKED
	FILE NO./INDEX CODE:	FINAL RECORD	☐	TM
	511/25035.CAK			RMR
				APPROVED

A-006

DEMOLITION NOTES:

1. REMOVE ALL MATERIALS AND DEBRIS CREATED DURING THE DEMOLITION AND/OR CONSTRUCTION PROCESS AND DISPOSE OFF SITE IN A SAFE AND LEGAL MANNER.
2. PROVIDE TEMPORARY PROTECTION AND WEATHER SEAL FOR INTERIOR DURING CONSTRUCTION PROCESS. TEMPORARY CONSTRUCTION MUST BE WATER TIGHT TO PREVENT ANY DAMAGE OR VANDALISM TO EXISTING INTERIOR SPACE.
3. PROVIDE DUST MATS AT ALL CONSTRUCTION AREA ENTRANCE AND EXIT LOCATIONS.
4. PERFORM ALL DEMOLITION WORK REQUIRED ON THE EXISTING BUILDING AS CALLED FOR ON THE DRAWINGS AND/OR AS REQUIRED TO ACCOMMODATE THE WORK.
5. CAP, PATCH AND REPAIR ALL HOLES AND SURFACES IN WALLS, FLOORS AND CEILINGS WHERE ARCHITECTURAL, STRUCTURAL, MECHANICAL AND/OR ELECTRICAL ITEMS ARE REMOVED AS A RESULT OF THE DEMOLITION OPERATIONS.
6. ALL EXISTING CONCRETE SLAB ON GRADE AND/OR CONCRETE TOPPING TO REMAIN IS TO BE PATCHED, REPAIRED, AND/OR FILLED TO MATCH EXISTING, PREPARE TO RECEIVE NEW FINISH.
7. CARRY OUT ALL DEMOLITION WORK IN CLOSE COORDINATION AND COOPERATION WITH STRUCTURAL TRADES FOR PROPER SEQUENCING OF THE WORK TO ASSURE THE COMPLETE SAFETY AND STRUCTURAL INTEGRITY OF THE BUILDING AND ITS ELEMENTS AT ALL TIMES. PROVIDE TEMPORARY COLUMNS, JACKS, BEAMS, ETC., WHERE REQUIRED FOR SUPPORT OF EXISTING ELEMENTS OF CONSTRUCTION TO REMAIN IN SAFE, COMPETENT MANNER, IN CONFORMANCE WITH ALL LAWS, CODES ORDINANCES, RULES AND REGULATIONS BEARING ON THE WORK.

8. DEMOLITION OF ALL PORTIONS OF THE STRUCTURE TO BE REMOVED SHALL BE DONE WITH UTMOST CARE, USING TOOLS AND METHODS SUBJECT TO OWNER'S APPROVAL. ALL POSSIBLE CARE SHALL BE TAKEN TO AVOID DAMAGING, SHOCK OR VIBRATION TO PORTIONS OF EXISTING STRUCTURE TO REMAIN.
9. THE CONTRACTOR SHALL VERIFY THE EXISTENCE, LOCATION AND ELEVATION OF EXISTING SEWERS, DRAINS, ETC. IN DEMOLITION AREAS BEFORE PROCEEDING WITH THE WORK. ALL DISCREPANCIES SHALL BE DOCUMENTED AND REPORTED TO THE ARCHITECT.
10. SAWCUT & REMOVE EXISTING CONCRETE SLAB FOR PLACEMENT OF PLUMBING WORK, FOUNDATIONS, STRUCTURAL STEEL, NECESSARY CAPPING OF EXISTING LINES AND FOUNDATION WORK, ETC. COORDINATE WITH STRUCTURAL ENGINEER AND ARCHITECT.
11. SAWCUT AND REMOVE EXISTING MASONRY AS REQUIRED AT EXISTING WALL OPENINGS TO ACCOMMODATE NEW DOORS/ WINDOWS.
12. REMOVE AND RELOCATE MECHANICAL AND ELECTRICAL ITEMS, INCLUDING PIPING, FIXTURES, EQUIPMENT, DUCTWORK, WIRING DEVICES, PANELS AND ACCESSORIES AS REQUIRED. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR MECHANICAL AND ELECTRICAL DEMOLITION.
13. ALL EXISTING CONSTRUCTION TO REMAIN U.N.O.
14. ALL EXISTING MATERIALS INDICATED TO REMAIN SHALL BE REPAIRED TO MATCH EXISTING. MATERIALS BEYOND REPAIR SHALL BE REPLACED TO MATCH EXISTING.
15. PATCH AND PREPARE ALL DEMOLITION AREAS FOR NEW FINISHES. REFER TO ARCHITECTURAL DRAWINGS.

16. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR SPECIFIC TRADE RELATED DEMOLITION WORK.
17. REFER TO CIVIL DRAWINGS FOR SITE DEMOLITION INFORMATION.
18. REFER TO STRUCTURAL DRAWINGS FOR STRUCTURAL DEMOLITION INFORMATION AND SHORING OF EXISTING STRUCTURE.
19. REFER TO SECTION 24119 - DEMOLITION, IN THE SPECIFICATION FOR FURTHER INFORMATION PRIOR TO THE START OF DEMOLITION.
20. REMOVE ALL FURNISHING ATTACHED TO WALLS INCLUDING, BUT NOT LIMITED TO, WHITEBOARDS, BULLETIN BOARDS, PROJECTOR SCREENS, FIRE EXTINGUISHERS & FIRE EXTINGUISHER CABINETS, ETC. IN THE AREAS OF WORK.
21. REFER TO SECTION 017419 - CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL FOR FURTHER INFORMATION PRIOR TO START OF DEMOLITION.
22. SAWCUT & REMOVE PORTION OF EXISTING CONCRETE SLAB FOR INSTALLATION OF NEW VAULT FLOOR

DEMOLITION WALL LEGEND:

EXISTING WALL AND/OR CONSTRUCTION TO REMAIN	
EXISTING DOOR AND FRAME ASSEMBLY TO REMAIN	
EXISTING WINDOW, STOREFRONT (EXACT TYPE MAY VARY) TO REMAIN	
REMOVE EXISTING WALL AND/OR CONSTRUCTION	
REMOVE EXISTING CONSTRUCTION	
REMOVE EXISTING DOOR AND FRAME ASSEMBLY	
REMOVE EXISTING WINDOW, STOREFRONT/ BORROWED LITE (EXACT TYPE MAY VARY)	
**NOTE: WALL LEGEND SHOWN FOR GRAPHICAL REFERENCE ONLY. REFER TO WALL TYPES AND SECTIONS FOR ADDITIONAL DETAILS AND INFORMATION.	

EXISTING NOTES:



1. CONTRACTOR MUST VISIT THE SITE AND FAMILIARIZE HIMSELF WITH ALL EXISTING CONDITIONS. VERIFY MEASUREMENTS WITH CORRESPONDING CONSTRUCTION OR EXISTING CONDITIONS PRIOR TO PROCEEDING WITH THE WORK, AND NOTIFY THE ARCHITECT IMMEDIATELY OF SIGNIFICANT DISCREPANCIES.
2. VERIFY ALL CONDITIONS COVERING OR AFFECTING THE STRUCTURAL WORK; OBTAIN AND VERIFY ALL DIMENSIONS AND ELEVATIONS TO ENSURE THE PROPER STRENGTH, FIT AND LOCATION OF THE STRUCTURAL WORK. REPORT TO THE ARCHITECT ANY AND ALL CONDITIONS WHICH MAY INTERFERE WITH OR OTHERWISE AFFECT OR PREVENT THE PROPER EXECUTION AND COMPLETION OF THE NEW WORK. ALL DISCREPANCIES SHALL BE FULLY RESOLVED PRIOR TO COMMENCING WORK.
3. EXISTING CONSTRUCTION NOT UNDERGOING ALTERATION IS TO REMAIN UNDISTURBED, WHERE SUCH CONSTRUCTION IS DISTURBED AS A RESULT OF THE OPERATIONS OF THIS CONTRACT, IT MUST BE REPAIRED OR REPLACED BY THE CONTRACTOR AS REQUIRED AND TO THE SATISFACTION OF THE ARCHITECT.
4. WHERE THE EXISTING CONSTRUCTION IS TO BE ALTERED, OR OTHERWISE DISTURBED, PROVIDE TEMPORARY AND/OR PERMANENT BRACING AND SHORING AS MAY BE REQUIRED BEFORE AND DURING OPERATIONS AND UNTIL THE WORK IS SAFELY COMPLETED AND NO LONGER NEEDS SAME.
5. EACH CONTRACTOR SHALL PROVIDE ALL THE NECESSARY SUPPORT, BRACING, SHORING, ETC. (TEMPORARY AND/OR PERMANENT) OF BOTH NEW AND EXISTING CONSTRUCTION AS REQUIRED FOR THE SAFE INSTALLATION OF THE NEW CONSTRUCTION AND EQUIPMENT.
6. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS FULLY COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURE AND SEQUENCE, AND TO ENSURE THE SAFETY OF THE BUILDING AND ITS COMPONENT PARTS DURING ERECTION. THIS INCLUDES THE ADDITION OF TEMPORARY BRACING, GUYS OR TIE-DOWNS IF NECESSARY.
7. THE CONTRACTOR IS RESPONSIBLE FOR MEANS, METHODS, SEQUENCES, AND PROCEDURES OF CONSTRUCTION.
8. PROVIDE FIRE WATCH DURING FIELD CUTTING AND WELDING OPERATIONS, MEETING THE OWNER'S REQUIREMENTS.
9. ALL EXISTING STRUCTURAL MEMBERS TO REMAIN, U.N.O.

CONTINUED USE OF FACILITIES:

1. EACH CONTRACTOR SHALL AT ALL TIMES MAINTAIN A CLEAN AND SAFE PASSAGEWAY FOR THE OWNER'S OPERATION AND PERSONNEL IN EXISTING AREAS AND MAINTAIN CLEARANCES ADJACENT TO AND IN CONNECTION WITH THE WORK PERFORMED.
2. EACH CONTRACTOR SHALL EFFECTIVELY CONFINE DUST, DIRT AND NOISE TO THE ACTUAL CONSTRUCTION AREA AS APPROVED BY THE GENERAL CONTRACTOR IN ACCORDANCE WITH STATE OF MICHIGAN REGULATIONS.
3. WORK SHALL, IF REQUIRED, BE CONSTRUCTED IN PHASES TO ACCOMMODATE THE OWNER'S USE OF THE PREMISES DURING THE CONSTRUCTION PERIOD AND FOR INSTALLATION OF HIS EQUIPMENT. COORDINATE THE CONSTRUCTION SCHEDULE WITH THE GENERAL CONTRACTOR AND OWNER'S REPRESENTATIVE.
4. DURING THE CONTRACTOR'S PERFORMANCE OF THE WORK OF THIS CONTRACT, THE OWNER'S WILL CONTINUE TO OCCUPY THE EXISTING BUILDING. INTERRUPTION OF BUILDING ACCESS AND FACILITIES BY THE CONTRACTOR WILL NOT BE PERMITTED; TO WHATEVER EXTENT SUCH INTERRUPTIONS MIGHT INTERFERE WITH OWNER'S OCCUPANCY. LIMIT CONSTRUCTION OPERATIONS TO THOSE METHODS AND PROCEDURES WHICH WILL NOT ADVERSELY AND UNDULY EFFECT THE WORKING ENVIRONMENT OF OWNER'S OCCUPIED SPACES, INCLUDING NOISE, DUST, ODORS, AIR POLLUTION, AMBIENT DISCOMFORT, POOR LIGHTING, HAZARDS AND OTHER UNDESIRABLE EFFECTS AND CONDITIONS. COORDINATE AND SCHEDULE ALL WORK IN EXISTING BUILDING WITH OWNER AND GENERAL CONTRACTOR.

DEMOLITION KEY NOTES

- 1 REMOVE WALL CONSTRUCTION, INCLUDING GYPSUM BOARD AND STUD FRAMING, IN ITS ENTIRETY
- 2 REMOVE FURRING ON EXISTING CONCRETE WALL TO REMAIN, INCLUDING GYPSUM BOARD AND STUD FRAMING.
- 3 REMOVE PORTION OF WALL AS REQUIRED FOR NEW OPENING
- 4 REMOVE DOOR, FRAME, AND ASSOCIATED HARDWARE -SAVE FOR REINSTALLATION
- 5 REMOVE DOOR, FRAME, AND ASSOCIATED HARDWARE
- 6 REMOVE STOREFRONT SYSTEM AND WINDOW SILLS IN ITS ENTIRETY
- 7 REMOVE PORTION OF STOREFRONT SYSTEM AS REQUIRED FOR NEW OPENING
- 8 REMOVE PLUMBING FIXTURES -SEE PLUMBING DRAWINGS FOR DETAILS
- 9 REMOVE TOILET ACCESSORIES AND PARTITIONS
- 10 REMOVE COUNTERTOP AND CASE WORK IN ITS ENTIRETY
- 11 REMOVE RAISED FLOOR AND FRAMING
- 12 REMOVE FLOOR FINISH AND WALL BASE, PREP SURFACES FOR NEW FINISHES
- 13 REMOVE PORTION OF WALL COVERING AS OUTLINED ON THE DRAWINGS
- 14 REMOVE & REPLACE DAMAGED PORTION (APPROX. LOCATION) OF EXISTING STOREFRONT GLAZING - VERIFY EXTENT IN FIELD
- 15 SAWCUT & REMOVE PORTION OF EXIST. CONC. SLAB FOR INSTALLATION OF NEW VAULT FLOOR. REFER TO STRUCTURAL AND PLUMBING DRAWINGS FOR LOCATION AND EXTENT
- 16 REMOVE ROOF SCREEN AND REPAIR ROOF WITH SIMILAR CONSTRUCTION AS REQUIRED

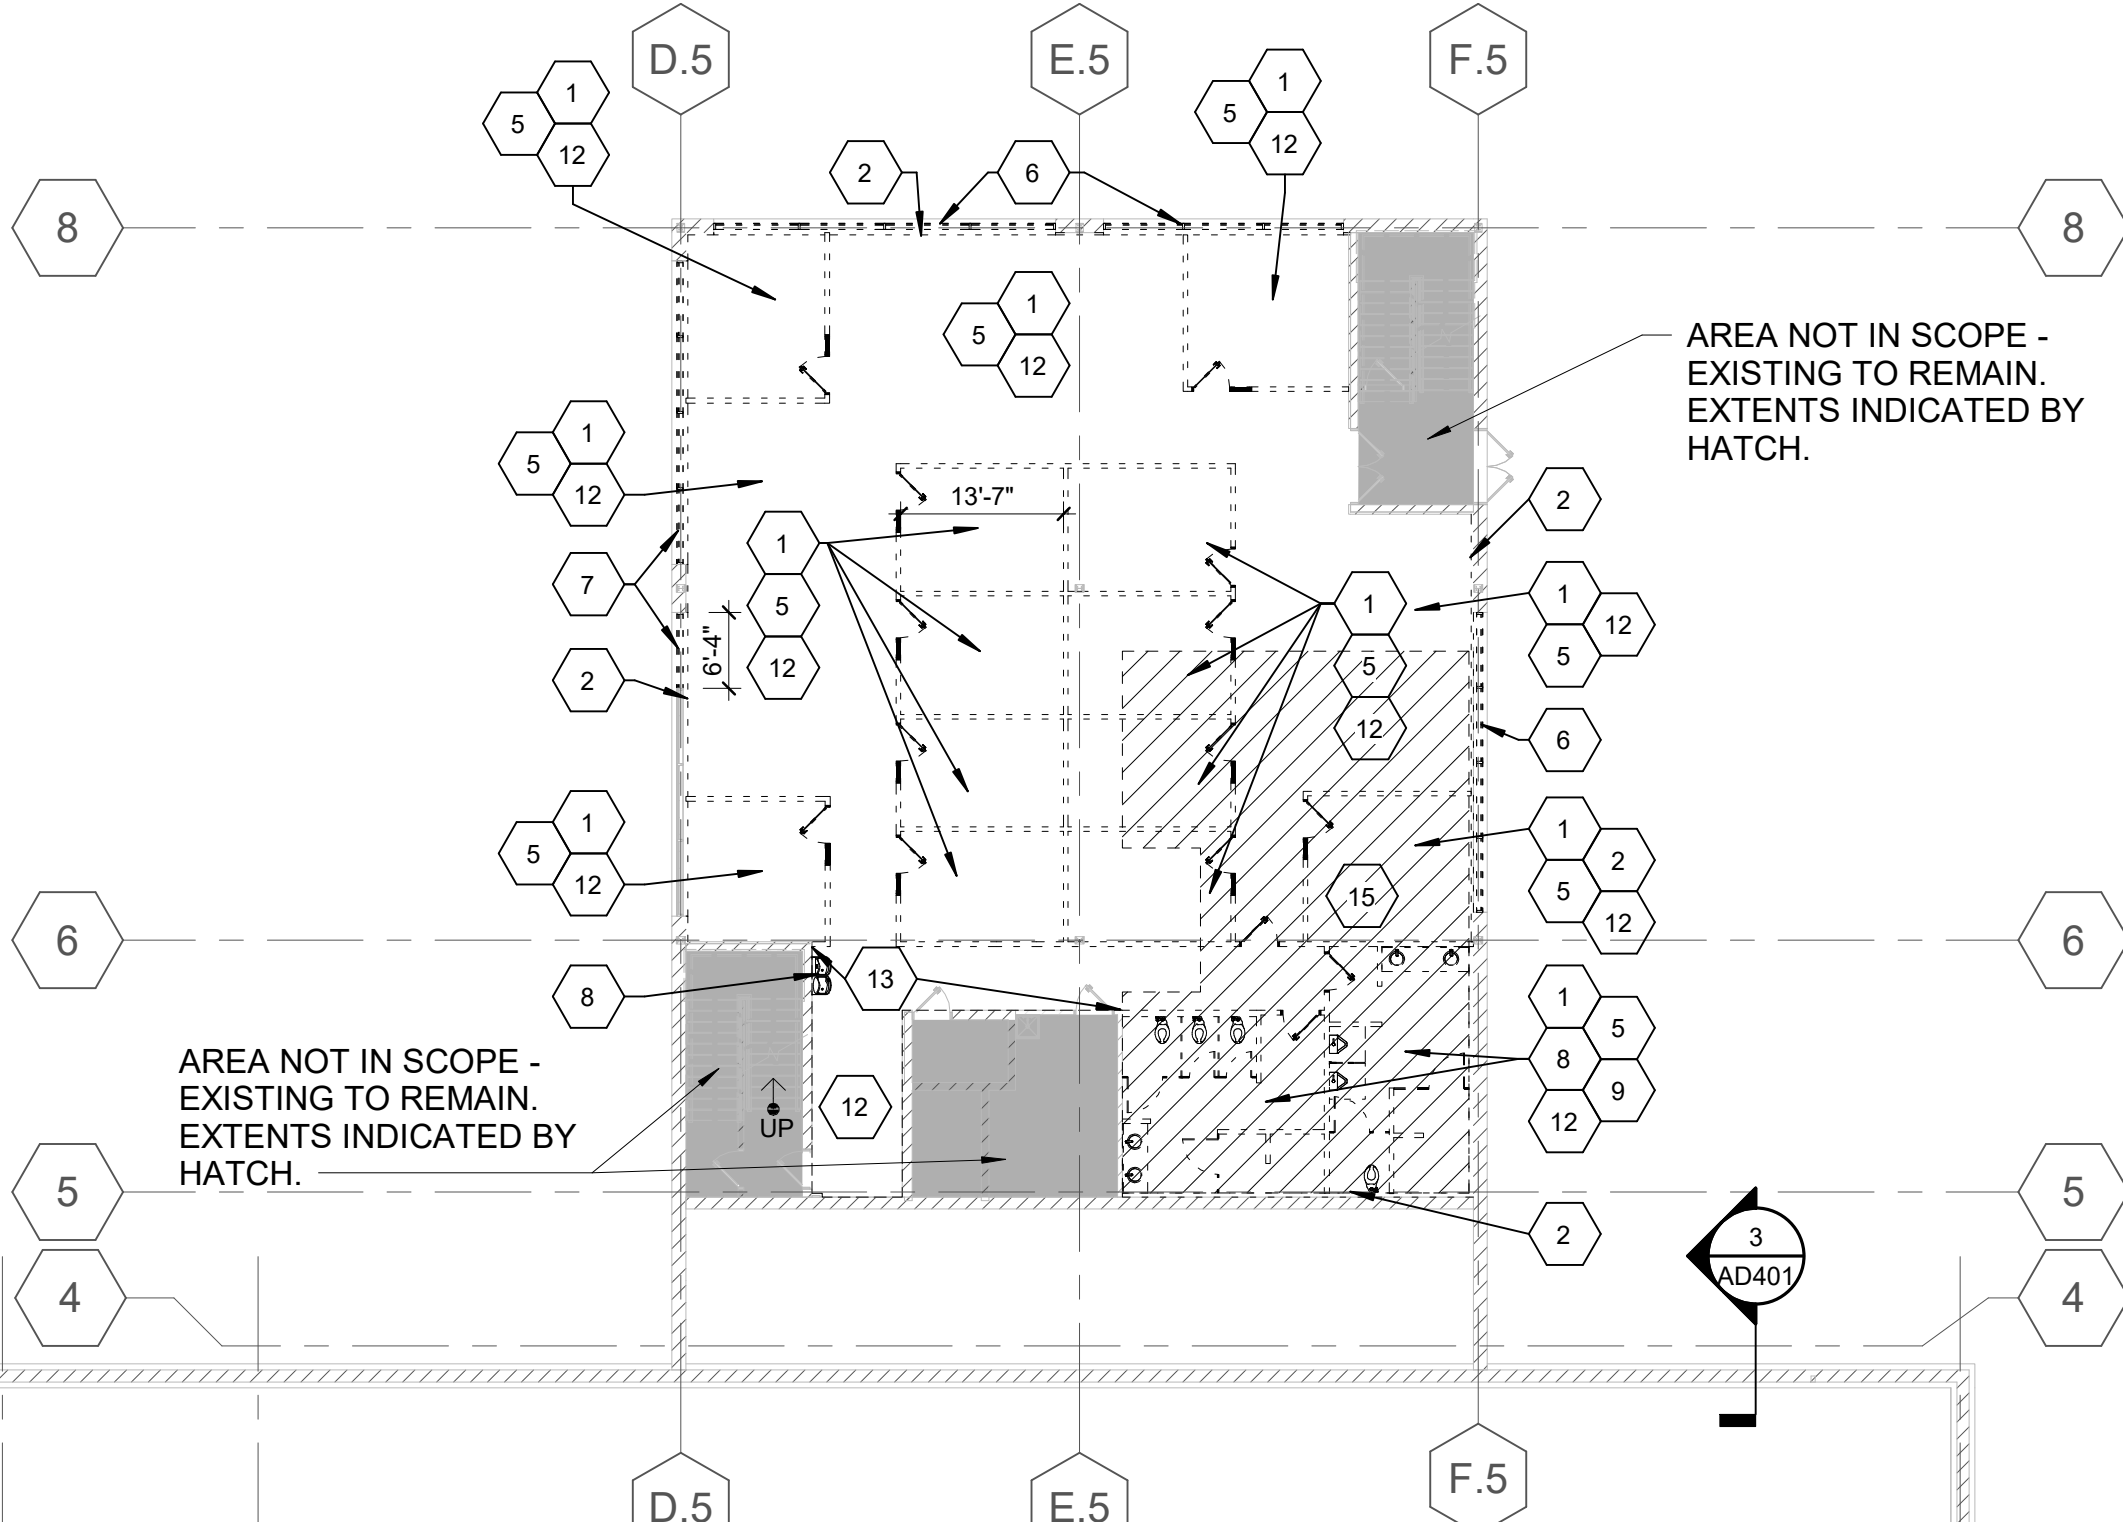

LOWER LEVEL DEMOLITION PLAN

1/16" = 1'-0"

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS



FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

SHEET TITLE: LOWER LEVEL DEMOLITION PLAN

SHEET NO: 1

IDENTIFICATION NO: 25510.A

PROJECT NO: 25510.A

DATE: 01/15/26

ISSUED FOR: PRELIMINARY CONSTRUCTION FINAL RECORD

DESIGNED

DRAWN

CHECKED

APPROVED

NCIL

NCIL

TM

RMR

RENOVATE ARMORY, JACKSON (WEST) ARMORY

DEPARTMENT OF MILITARY AND VETERANS AFFAIRS

2700 W ARGYLE ST., JACKSON, MI

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES MANAGEMENT DIVISION
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR



DEMOLITION NOTES:

1. REMOVE ALL MATERIALS AND DEBRIS CREATED DURING THE DEMOLITION AND/OR CONSTRUCTION PROCESS AND DISPOSE OFF SITE IN A SAFE AND LEGAL MANNER.
2. PROVIDE TEMPORARY PROTECTION AND WEATHER SEAL FOR INTERIOR DURING CONSTRUCTION PROCESS. TEMPORARY CONSTRUCTION MUST BE WATER TIGHT TO PREVENT ANY DAMAGE OR VANDALISM TO EXISTING INTERIOR SPACE.
3. PROVIDE DUST MATS AT ALL CONSTRUCTION AREA ENTRANCE AND EXIT LOCATIONS.
4. PERFORM ALL DEMOLITION WORK REQUIRED ON THE EXISTING BUILDING AS CALLED FOR ON THE DRAWINGS AND/OR AS REQUIRED TO ACCOMMODATE THE WORK.
5. CAP, PATCH AND REPAIR ALL HOLES AND SURFACES IN WALLS, FLOORS AND CEILINGS WHERE ARCHITECTURAL, STRUCTURAL, MECHANICAL AND/OR ELECTRICAL ITEMS ARE REMOVED AS A RESULT OF THE DEMOLITION OPERATIONS.
6. ALL EXISTING CONCRETE SLAB ON GRADE AND/OR CONCRETE TOPPING TO REMAIN IS TO BE PATCHED, REPAIRED, AND/OR FILLED TO MATCH EXISTING, PREPARE TO RECEIVE NEW FINISH.
7. CARRY OUT ALL DEMOLITION WORK IN CLOSE COORDINATION AND COOPERATION WITH STRUCTURAL TRADES FOR PROPER SEQUENCING OF THE WORK TO ASSURE THE COMPLETE SAFETY AND STRUCTURAL INTEGRITY OF THE BUILDING AND ITS ELEMENTS AT ALL TIMES. PROVIDE TEMPORARY COLUMNS, JACKS, BEAMS, ETC., WHERE REQUIRED FOR SUPPORT OF EXISTING ELEMENTS OF CONSTRUCTION TO REMAIN IN SAFE, COMPETENT MANNER, IN CONFORMANCE WITH ALL LAWS, CODES ORDINANCES, RULES AND REGULATIONS BEARING ON THE WORK.
8. DEMOLITION OF ALL PORTIONS OF THE STRUCTURE TO BE REMOVED SHALL BE DONE WITH UTMOST CARE, USING TOOLS AND METHODS SUBJECT TO OWNER'S APPROVAL. ALL POSSIBLE CARE SHALL BE TAKEN TO AVOID DAMAGING, SHOCK OR VIBRATION TO PORTIONS OF EXISTING STRUCTURE TO REMAIN.
9. THE CONTRACTOR SHALL VERIFY THE EXISTENCE, LOCATION AND ELEVATION OF EXISTING SEWERS, DRAINS, ETC. IN DEMOLITION AREAS BEFORE PROCEEDING WITH THE WORK. ALL DISCREPANCIES SHALL BE DOCUMENTED AND REPORTED TO THE ARCHITECT.
10. SAWCUT & REMOVE EXISTING CONCRETE SLAB FOR PLACEMENT OF PLUMBING WORK, FOUNDATIONS, STRUCTURAL STEEL, NECESSARY CAPPING OF EXISTING LINES AND FOUNDATION WORK, ETC. COORDINATE WITH STRUCTURAL ENGINEER AND ARCHITECT.
11. SAWCUT AND REMOVE EXISTING MASONRY AS REQUIRED AT EXISTING WALL OPENINGS TO ACCOMMODATE NEW DOORS/ WINDOWS.
12. REMOVE AND RELOCATE MECHANICAL AND ELECTRICAL ITEMS, INCLUDING PIPING, FIXTURES, EQUIPMENT, DUCTWORK, WIRING DEVICES, PANELS AND ACCESSORIES AS REQUIRED. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR MECHANICAL AND ELECTRICAL DEMOLITION.
13. ALL EXISTING CONSTRUCTION TO REMAIN U.N.O.
14. ALL EXISTING MATERIALS INDICATED TO REMAIN SHALL BE REPAIRED TO MATCH EXISTING. MATERIALS BEYOND REPAIR SHALL BE REPLACED TO MATCH EXISTING.
15. PATCH AND PREPARE ALL DEMOLITION AREAS FOR NEW FINISHES, REFER TO ARCHITECTURAL DRAWINGS.
16. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR SPECIFIC TRADE RELATED DEMOLITION WORK.
17. REFER TO CIVIL DRAWINGS FOR SITE DEMOLITION INFORMATION.
18. REFER TO STRUCTURAL DRAWINGS FOR STRUCTURAL DEMOLITION INFORMATION AND SHORING OF EXISTING STRUCTURE.
19. REFER TO SECTION 24119 - DEMOLITION, IN THE SPECIFICATION FOR FURTHER INFORMATION PRIOR TO THE START OF DEMOLITION.
20. REMOVE ALL FURNISHING ATTACHED TO WALLS INCLUDING, BUT NOT LIMITED TO, WHITEBOARDS, BULLETIN BOARDS, PROJECTOR SCREENS, FIRE EXTINGUISHERS & FIRE EXTINGUISHER CABINETS, ETC. IN THE AREAS OF WORK.
21. REFER TO SECTION 017419 - CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL FOR FURTHER INFORMATION PRIOR TO START OF DEMOLITION.
22. SAWCUT & REMOVE PORTION OF EXISTING CONCRETE SLAB FOR INSTALLATION OF NEW VAULT FLOOR

DEMOLITION KEY NOTES

- 1 REMOVE WALL CONSTRUCTION, INCLUDING GYPSUM BOARD AND STUD FRAMING, IN ITS ENTIRETY
- 2 REMOVE FURRING ON EXISTING CONCRETE WALL TO REMAIN, INCLUDING GYPSUM BOARD AND STUD FRAMING.
- 3 REMOVE PORTION OF WALL AS REQUIRED FOR NEW OPENING
- 4 REMOVE DOOR, FRAME, AND ASSOCIATED HARDWARE -SAVE FOR REINSTALLATION
- 5 REMOVE DOOR, FRAME, AND ASSOCIATED HARDWARE
- 6 REMOVE STOREFRONT SYSTEM AND WINDOW SILLS IN ITS ENTIRETY
- 7 REMOVE PORTION OF STOREFRONT SYSTEM AS REQUIRED FOR NEW OPENING
- 8 REMOVE PLUMBING FIXTURES -SEE PLUMBING DRAWINGS FOR DETAILS
- 9 REMOVE TOILET ACCESSORIES AND PARTITIONS
- 10 REMOVE COUNTERTOP AND CASE WORK IN ITS ENTIRETY
- 11 REMOVE RAISED FLOOR AND FRAMING
- 12 REMOVE FLOOR FINISH AND WALL BASE, PREP SURFACES FOR NEW FINISHES
- 13 REMOVE PORTION OF WALL COVERING AS OUTLINED ON THE DRAWINGS
- 14 REMOVE & REPLACE DAMAGED PORTION (APPROX. LOCATION) OF EXISTING STOREFRONT GLAZING - VERIFY EXTENT IN FIELD
- 15 SAWCUT & REMOVE PORTION OF EXIST. CONC. SLAB FOR INSTALLATION OF NEW VAULT FLOOR, REFER TO STRUCTURAL AND PLUMBING DRAWINGS FOR LOCATION AND EXTENT
- 16 REMOVE ROOF SCREEN AND REPAIR ROOF WITH SIMILAR CONSTRUCTION AS REQUIRED

DEMOLITION WALL LEGEND:

EXISTING WALL AND/OR CONSTRUCTION TO REMAIN

EXISTING DOOR AND FRAME ASSEMBLY TO REMAIN

EXISTING WINDOW, STOREFRONT (EXACT TYPE MAY VARY) TO REMAIN

REMOVE EXISTING WALL AND/OR CONSTRUCTION

REMOVE EXISTING CONSTRUCTION



REMOVE EXISTING DOOR AND FRAME ASSEMBLY

REMOVE EXISTING WINDOW, STOREFRONT/ BORROWED LITE (EXACT TYPE MAY VARY)

****NOTE: WALL LEGEND SHOWN FOR GRAPHICAL REFERENCE ONLY. REFER TO WALL TYPES AND SECTIONS FOR ADDITIONAL DETAILS AND INFORMATION.**

EXISTING NOTES:

1. CONTRACTOR MUST VISIT THE SITE AND FAMILIARIZE HIMSELF WITH ALL EXISTING CONDITIONS. VERIFY MEASUREMENTS WITH CORRESPONDING CONSTRUCTION OR EXISTING CONDITIONS PRIOR TO PROCEEDING WITH THE WORK, AND NOTIFY THE ARCHITECT IMMEDIATELY OF SIGNIFICANT DISCREPANCIES.
 2. VERIFY ALL CONDITIONS COVERING OR AFFECTING THE STRUCTURAL WORK: OBTAIN AND VERIFY ALL DIMENSIONS AND ELEVATIONS TO ENSURE THE PROPER STRENGTH, FIT AND LOCATION OF THE STRUCTURAL WORK; REPORT TO THE ARCHITECT ANY AND ALL CONDITIONS WHICH MAY INTERFERE WITH OR OTHERWISE AFFECT OR PREVENT THE PROPER EXECUTION AND COMPLETION OF THE NEW WORK. ALL DISCREPANCIES SHALL BE FULLY RESOLVED PRIOR TO COMMENCING WORK.
 3. EXISTING CONSTRUCTION NOT UNDERGOING ALTERATION IS TO REMAIN UNDISTURBED, WHERE SUCH CONSTRUCTION IS DISTURBED AS A RESULT OF THE OPERATIONS OF THIS CONTRACT, IT MUST BE REPAIRED OR REPLACED BY THE CONTRACTOR AS REQUIRED AND TO THE SATISFACTION OF THE ARCHITECT.
 4. WHERE THE EXISTING CONSTRUCTION IS TO BE ALTERED, OR OTHERWISE DISTURBED, PROVIDE TEMPORARY AND/OR PERMANENT BRACING AND SHORING AS MAY BE REQUIRED BEFORE AND DURING OPERATIONS AND UNTIL THE WORK IS SAFELY COMPLETED AND NO LONGER NEEDS SAME.
 5. EACH CONTRACTOR SHALL PROVIDE ALL THE NECESSARY SUPPORT, BRACING, SHORING, ETC. (TEMPORARY AND/OR PERMANENT) OF BOTH NEW AND EXISTING CONSTRUCTION AS REQUIRED FOR THE SAFE INSTALLATION OF THE NEW CONSTRUCTION AND EQUIPMENT.
 6. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS FULLY COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURE AND SEQUENCE, AND TO ENSURE THE SAFETY OF THE BUILDING AND ITS COMPONENT PARTS DURING ERECTION. THIS INCLUDES THE ADDITION OF TEMPORARY BRACING, GUYS OR TIE-DOWNS IF NECESSARY.
 7. THE CONTRACTOR IS RESPONSIBLE FOR MEANS, METHODS, SEQUENCES, AND PROCEDURES OF CONSTRUCTION.
 8. PROVIDE FIRE WATCH DURING FIELD CUTTING AND WELDING OPERATIONS, MEETING THE OWNER'S REQUIREMENTS.
 9. ALL EXISTING STRUCTURAL MEMBERS TO REMAIN, U.N.O.
- CONTINUED USE OF FACILITIES:**
1. EACH CONTRACTOR SHALL AT ALL TIMES MAINTAIN A CLEAN AND SAFE PASSAGEWAY FOR THE OWNER'S OPERATION AND PERSONNEL IN EXISTING AREAS AND MAINTAIN CLEARANCES ADJACENT TO AND IN CONNECTION WITH THE WORK PERFORMED.
 2. EACH CONTRACTOR SHALL EFFECTIVELY CONFINE DUST, DIRT AND NOISE TO THE ACTUAL CONSTRUCTION AREA AS APPROVED BY THE GENERAL CONTRACTOR IN ACCORDANCE WITH STATE OF MICHIGAN REGULATIONS.
 3. WORK SHALL, IF REQUIRED, BE CONSTRUCTED IN PHASES TO ACCOMMODATE THE OWNER'S USE OF THE PREMISES DURING THE CONSTRUCTION PERIOD AND FOR INSTALLATION OF HIS EQUIPMENT. COORDINATE THE CONSTRUCTION SCHEDULE WITH THE GENERAL CONTRACTOR AND OWNER'S REPRESENTATIVE.
 4. DURING THE CONTRACTOR'S PERFORMANCE OF THE WORK OF THIS CONTRACT, THE OWNER'S WILL CONTINUE TO OCCUPY THE EXISTING BUILDING. INTERRUPTION OF BUILDING ACCESS AND FACILITIES BY THE CONTRACTOR WILL NOT BE PERMITTED. TO WHATEVER EXTENT SUCH INTERRUPTIONS MIGHT INTERFERE WITH OWNER'S OCCUPANCY. LIMIT CONSTRUCTION OPERATIONS TO THOSE METHODS AND PROCEDURES WHICH WILL NOT ADVERSELY AND UNDULY EFFECT THE WORKING ENVIRONMENT OF OWNER'S OCCUPIED SPACES, INCLUDING NOISE, DUST, ODORS, AIR POLLUTION, AMBIENT DISCOMFORT, POOR LIGHTING, HAZARDS AND OTHER UNDESIRABLE EFFECTS AND CONDITIONS. COORDINATE AND SCHEDULE ALL WORK IN EXISTING BUILDING WITH OWNER AND GENERAL CONTRACTOR.

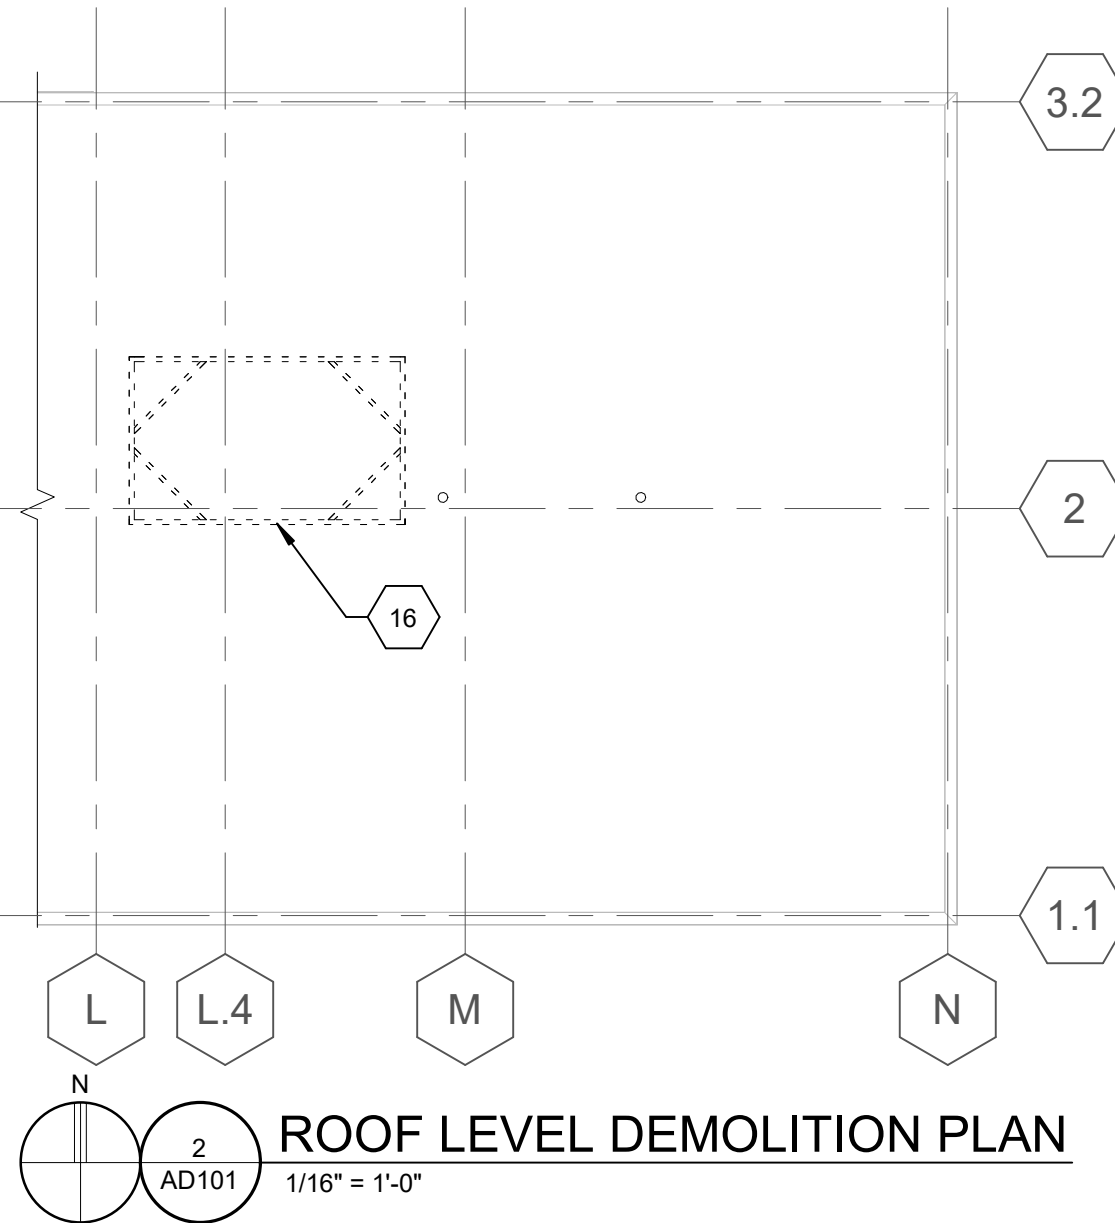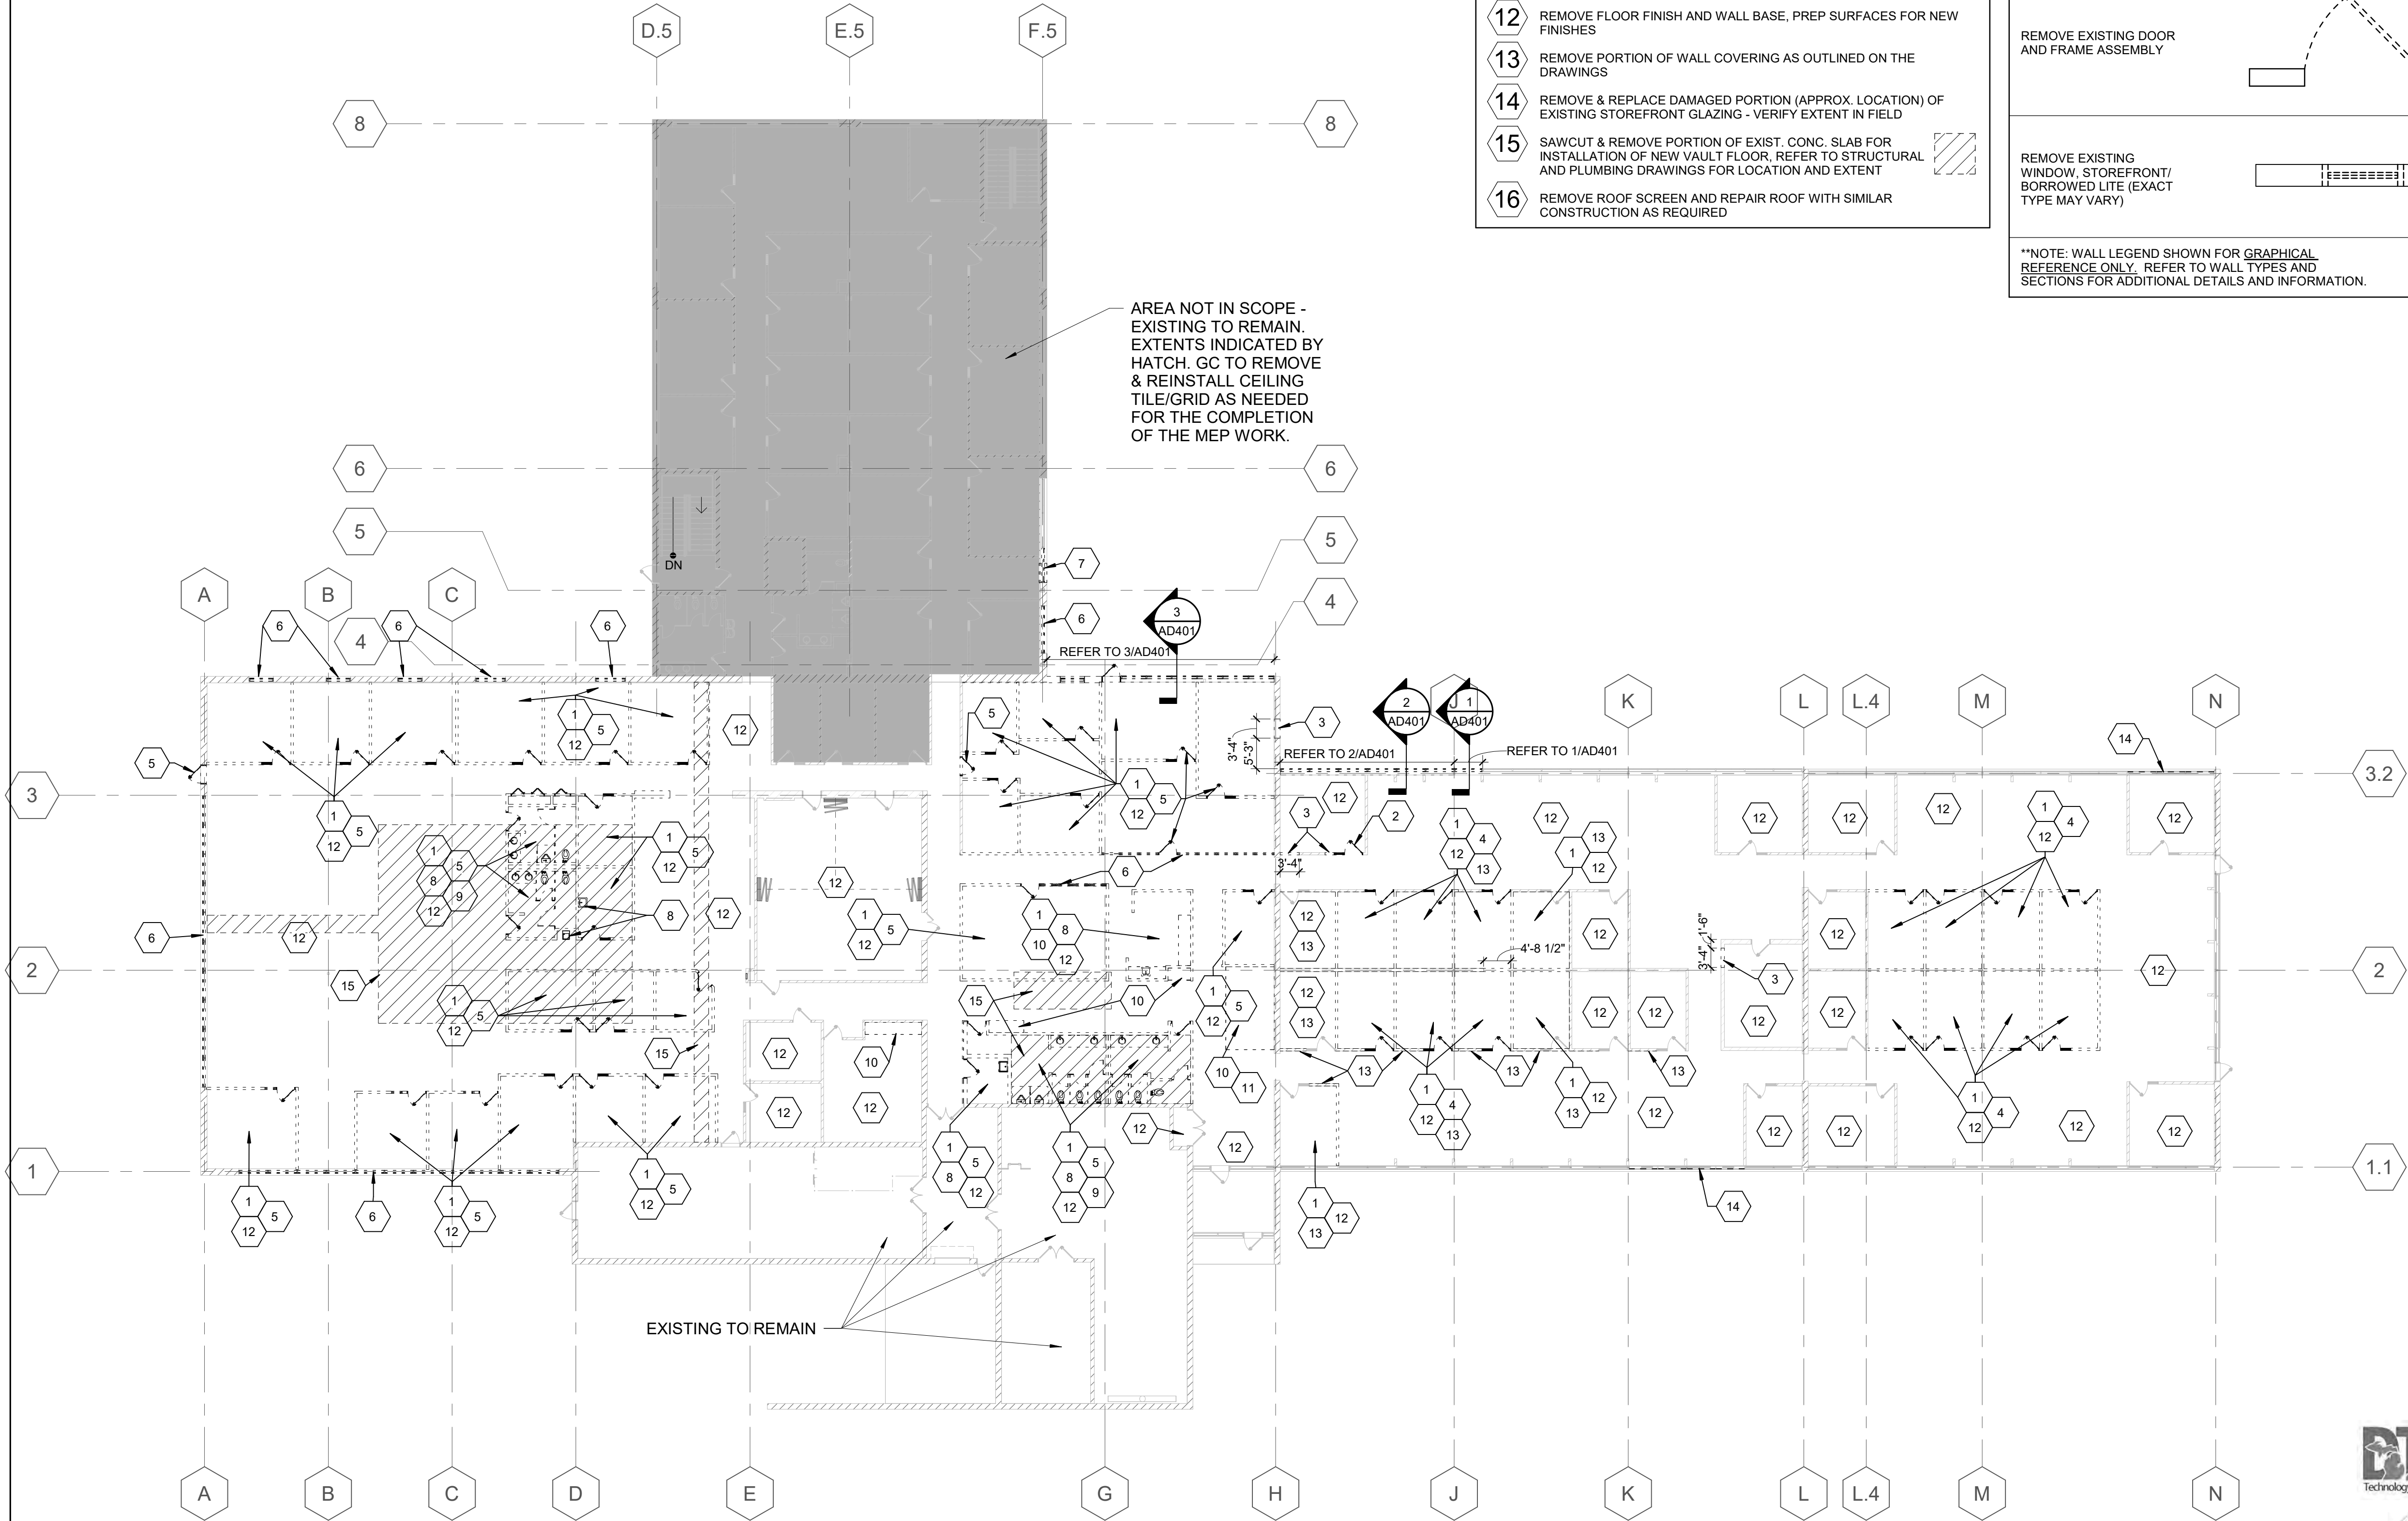

MAIN LEVEL DEMOLITION PLAN

MISSDIG811

FOR SITE OWNED UTILITIES



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS



THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES MANAGEMENT
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, P.E., ARCHITECT

SHEET TITLE: MAIN LEVEL DEMOLITION PLAN

DESIGNED	DATE	ISSUED FOR:	CONSTRUCTION	FINAL RECORD
DRAWN	01/15/26	PRELIMINARY	CONSTRUCTION	FINAL RECORD
CHECKED				
APPROVED				

AD101


DEMOLITION NOTES:

1. REMOVE ALL MATERIALS AND DEBRIS CREATED DURING THE DEMOLITION AND/OR CONSTRUCTION PROCESS AND DISPOSE OFF SITE IN A SAFE AND LEGAL MANNER.
2. PROVIDE TEMPORARY PROTECTION AND WEATHER SEAL FOR INTERIOR DURING CONSTRUCTION PROCESS. TEMPORARY CONSTRUCTION MUST BE WATER TIGHT TO PREVENT ANY DAMAGE OR VANDALISM TO EXISTING INTERIOR SPACE.
3. PROVIDE DUST MATS AT ALL CONSTRUCTION AREA ENTRANCE AND EXIT LOCATIONS.
4. PERFORM ALL DEMOLITION WORK REQUIRED ON THE EXISTING BUILDING AS CALLED FOR ON THE DRAWINGS AND/OR AS REQUIRED TO ACCOMMODATE THE WORK.
5. CAP, PATCH AND REPAIR ALL HOLES AND SURFACES IN WALLS, FLOORS AND CEILINGS WHERE ARCHITECTURAL, STRUCTURAL, MECHANICAL AND/OR ELECTRICAL ITEMS ARE REMOVED AS A RESULT OF THE DEMOLITION OPERATIONS.
6. ALL EXISTING CONCRETE SLAB ON GRADE AND/OR CONCRETE TOPPING TO REMAIN IS TO BE PATCHED, REPAIRED, AND/OR FILLED TO MATCH EXISTING, PREPARE TO RECEIVE NEW FINISH.
7. CARRY OUT ALL DEMOLITION WORK IN CLOSE COORDINATION AND COOPERATION WITH STRUCTURAL TRADES FOR PROPER SEQUENCING OF THE WORK TO ASSURE THE COMPLETE SAFETY AND STRUCTURAL INTEGRITY OF THE BUILDING AND ITS ELEMENTS AT ALL TIMES. PROVIDE TEMPORARY COLUMNS, JACKS, BEAMS, ETC., WHERE REQUIRED FOR SUPPORT OF EXISTING ELEMENTS OF CONSTRUCTION TO REMAIN IN SAFE, COMPETENT MANNER, IN CONFORMANCE WITH ALL LAWS, CODES ORDINANCES, RULES AND REGULATIONS BEARING ON THE WORK.


8. DEMOLITION OF ALL PORTIONS OF THE STRUCTURE TO BE REMOVED SHALL BE DONE WITH UTMOST CARE, USING TOOLS AND METHODS SUBJECT TO OWNER'S APPROVAL. ALL POSSIBLE CARE SHALL BE TAKEN TO AVOID DAMAGING, SHOCK OR VIBRATION TO PORTIONS OF EXISTING STRUCTURE TO REMAIN.
9. THE CONTRACTOR SHALL VERIFY THE EXISTENCE, LOCATION AND ELEVATION OF EXISTING SEWERS, DRAINS, ETC. IN DEMOLITION AREAS BEFORE PROCEEDING WITH THE WORK. ALL DISCREPANCIES SHALL BE DOCUMENTED AND REPORTED TO THE ARCHITECT.
10. SAWCUT & REMOVE EXISTING CONCRETE SLAB FOR PLACEMENT OF PLUMBING WORK, FOUNDATIONS, STRUCTURAL STEEL, NECESSARY CAPPING OF EXISTING LINES AND FOUNDATION WORK, ETC. COORDINATE WITH STRUCTURAL ENGINEER AND ARCHITECT.
11. SAWCUT AND REMOVE EXISTING MASONRY AS REQUIRED AT EXISTING WALL OPENINGS TO ACCOMMODATE NEW DOORS/ WINDOWS.
12. REMOVE AND RELOCATE MECHANICAL AND ELECTRICAL ITEMS, INCLUDING PIPING, FIXTURES, EQUIPMENT, DUCTWORK, WIRING DEVICES, PANELS AND ACCESSORIES AS REQUIRED. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR MECHANICAL AND ELECTRICAL DEMOLITION.
13. ALL EXISTING CONSTRUCTION TO REMAIN U.N.O.

14. ALL EXISTING MATERIALS INDICATED TO REMAIN SHALL BE REPAIRED TO MATCH EXISTING. MATERIALS BEYOND REPAIR SHALL BE REPLACED TO MATCH EXISTING.
15. PATCH AND PREPARE ALL DEMOLITION AREAS FOR NEW FINISHES. REFER TO ARCHITECTURAL DRAWINGS.


16. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR SPECIFIC TRADE RELATED DEMOLITION WORK.
17. REFER TO CIVIL DRAWINGS FOR SITE DEMOLITION INFORMATION.
18. REFER TO STRUCTURAL DRAWINGS FOR STRUCTURAL DEMOLITION INFORMATION AND SHORING OF EXISTING STRUCTURE.
19. REFER TO SECTION 24119 - DEMOLITION, IN THE SPECIFICATION FOR FURTHER INFORMATION PRIOR TO THE START OF DEMOLITION.
20. REMOVE ALL FURNISHING ATTACHED TO WALLS INCLUDING, BUT NOT LIMITED TO, WHITEBOARDS, BULLETIN BOARDS, PROJECTOR SCREENS, FIRE EXTINGUISHERS & FIRE EXTINGUISHER CABINETS, ETC. IN THE AREAS OF WORK.
21. REFER TO SECTION 017419 - CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL FOR FURTHER INFORMATION PRIOR TO START OF DEMOLITION.
22. SAWCUT & REMOVE PORTION OF EXISTING CONCRETE SLAB FOR INSTALLATION OF NEW VAULT FLOOR

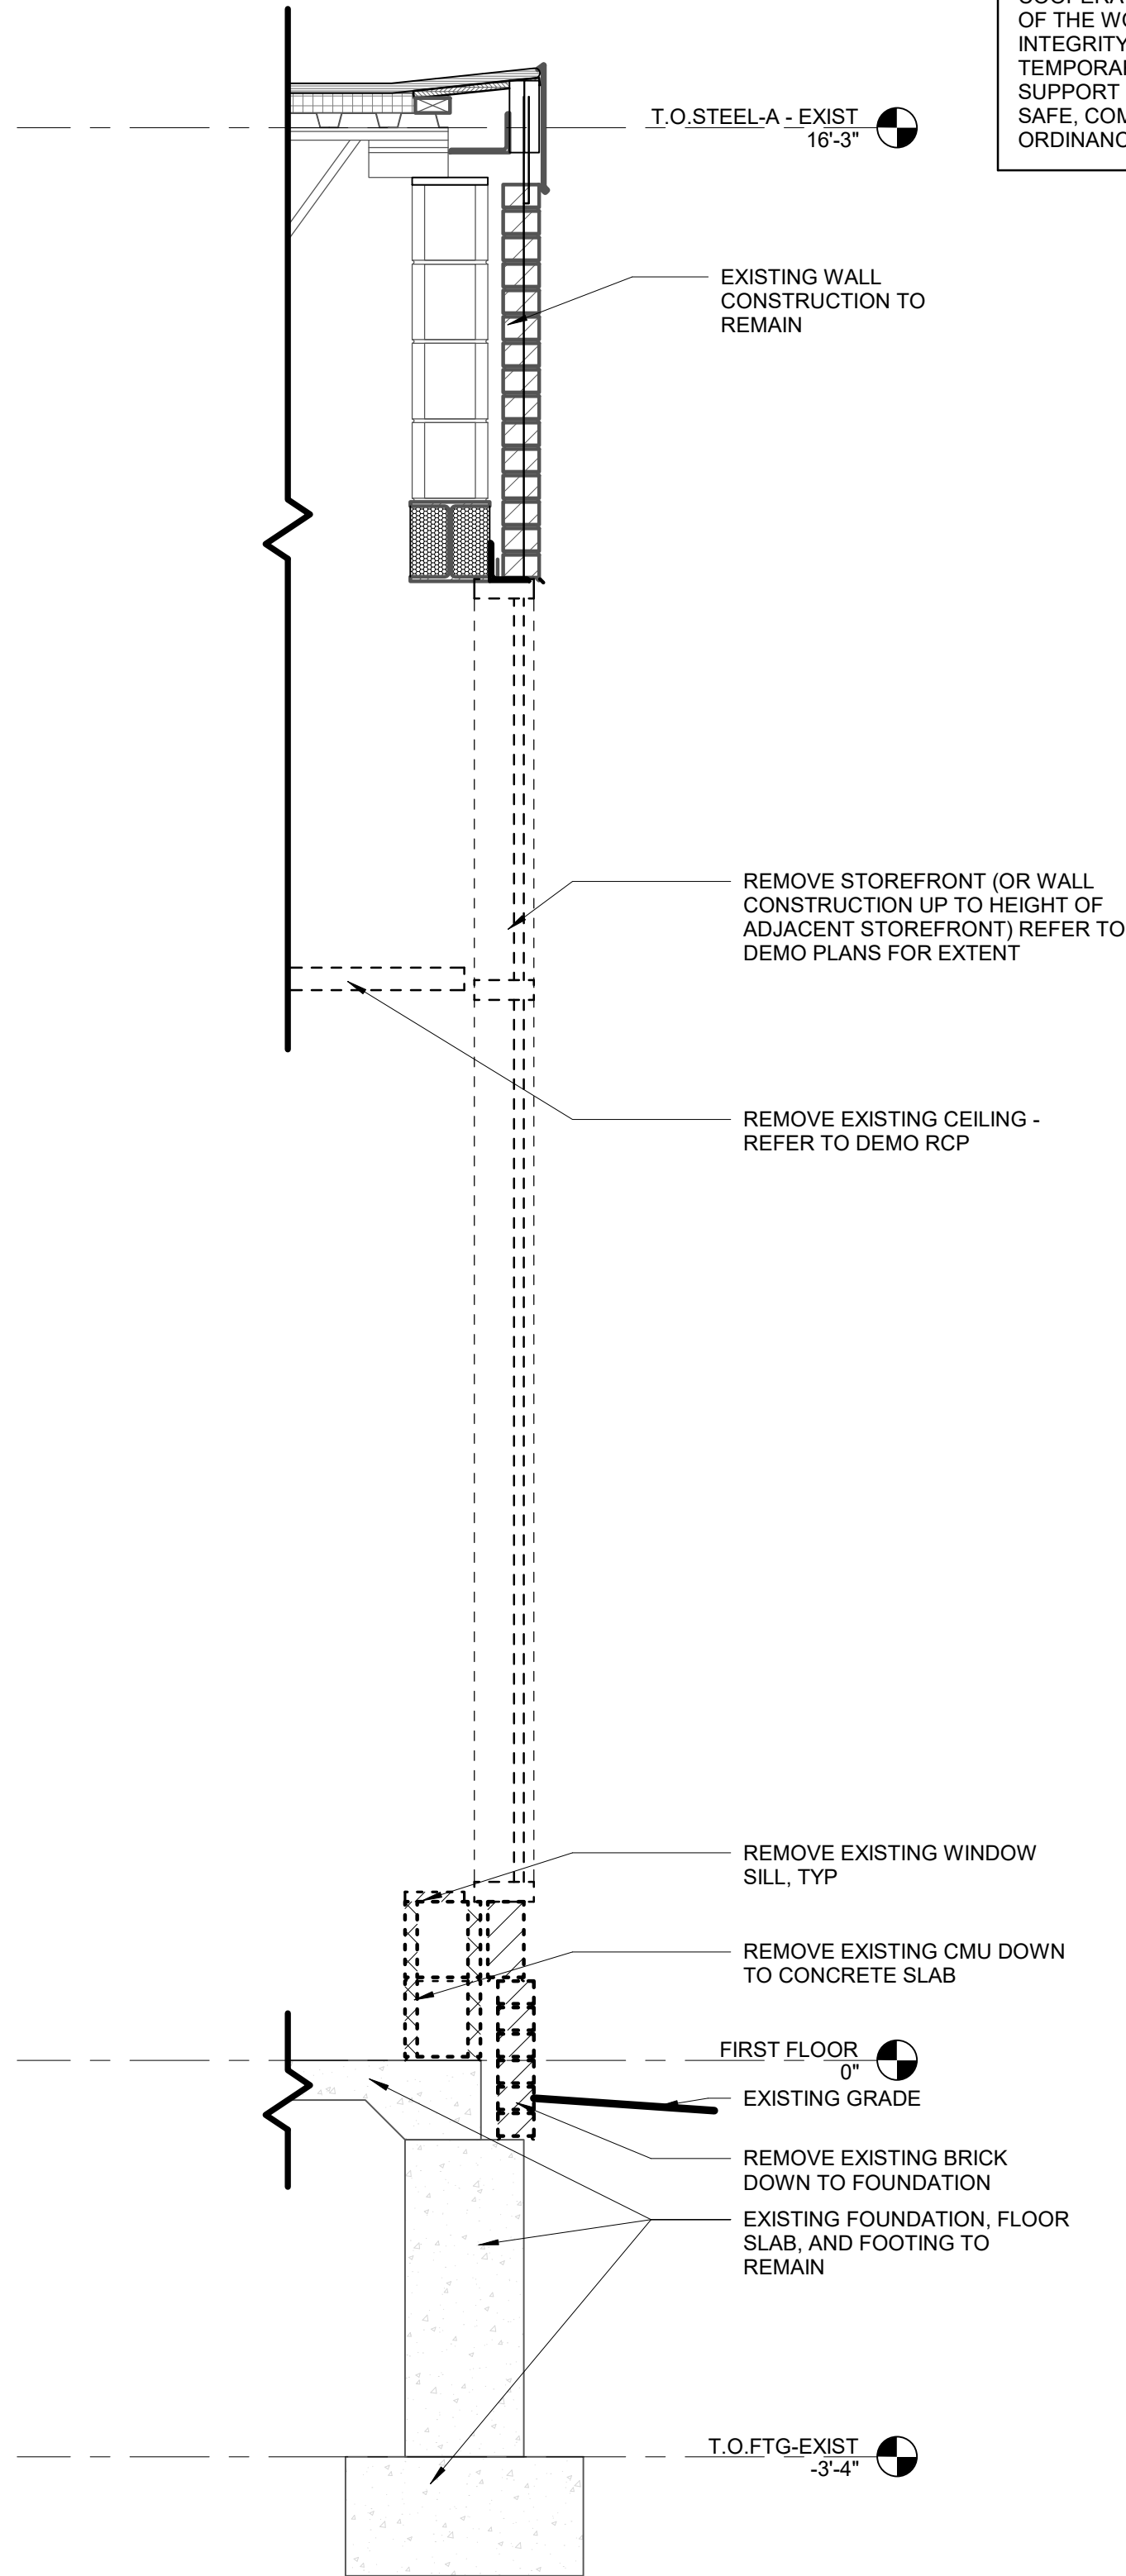

3
AD401
DEMOLITION WALL SECTION
3/4" = 1'-0"

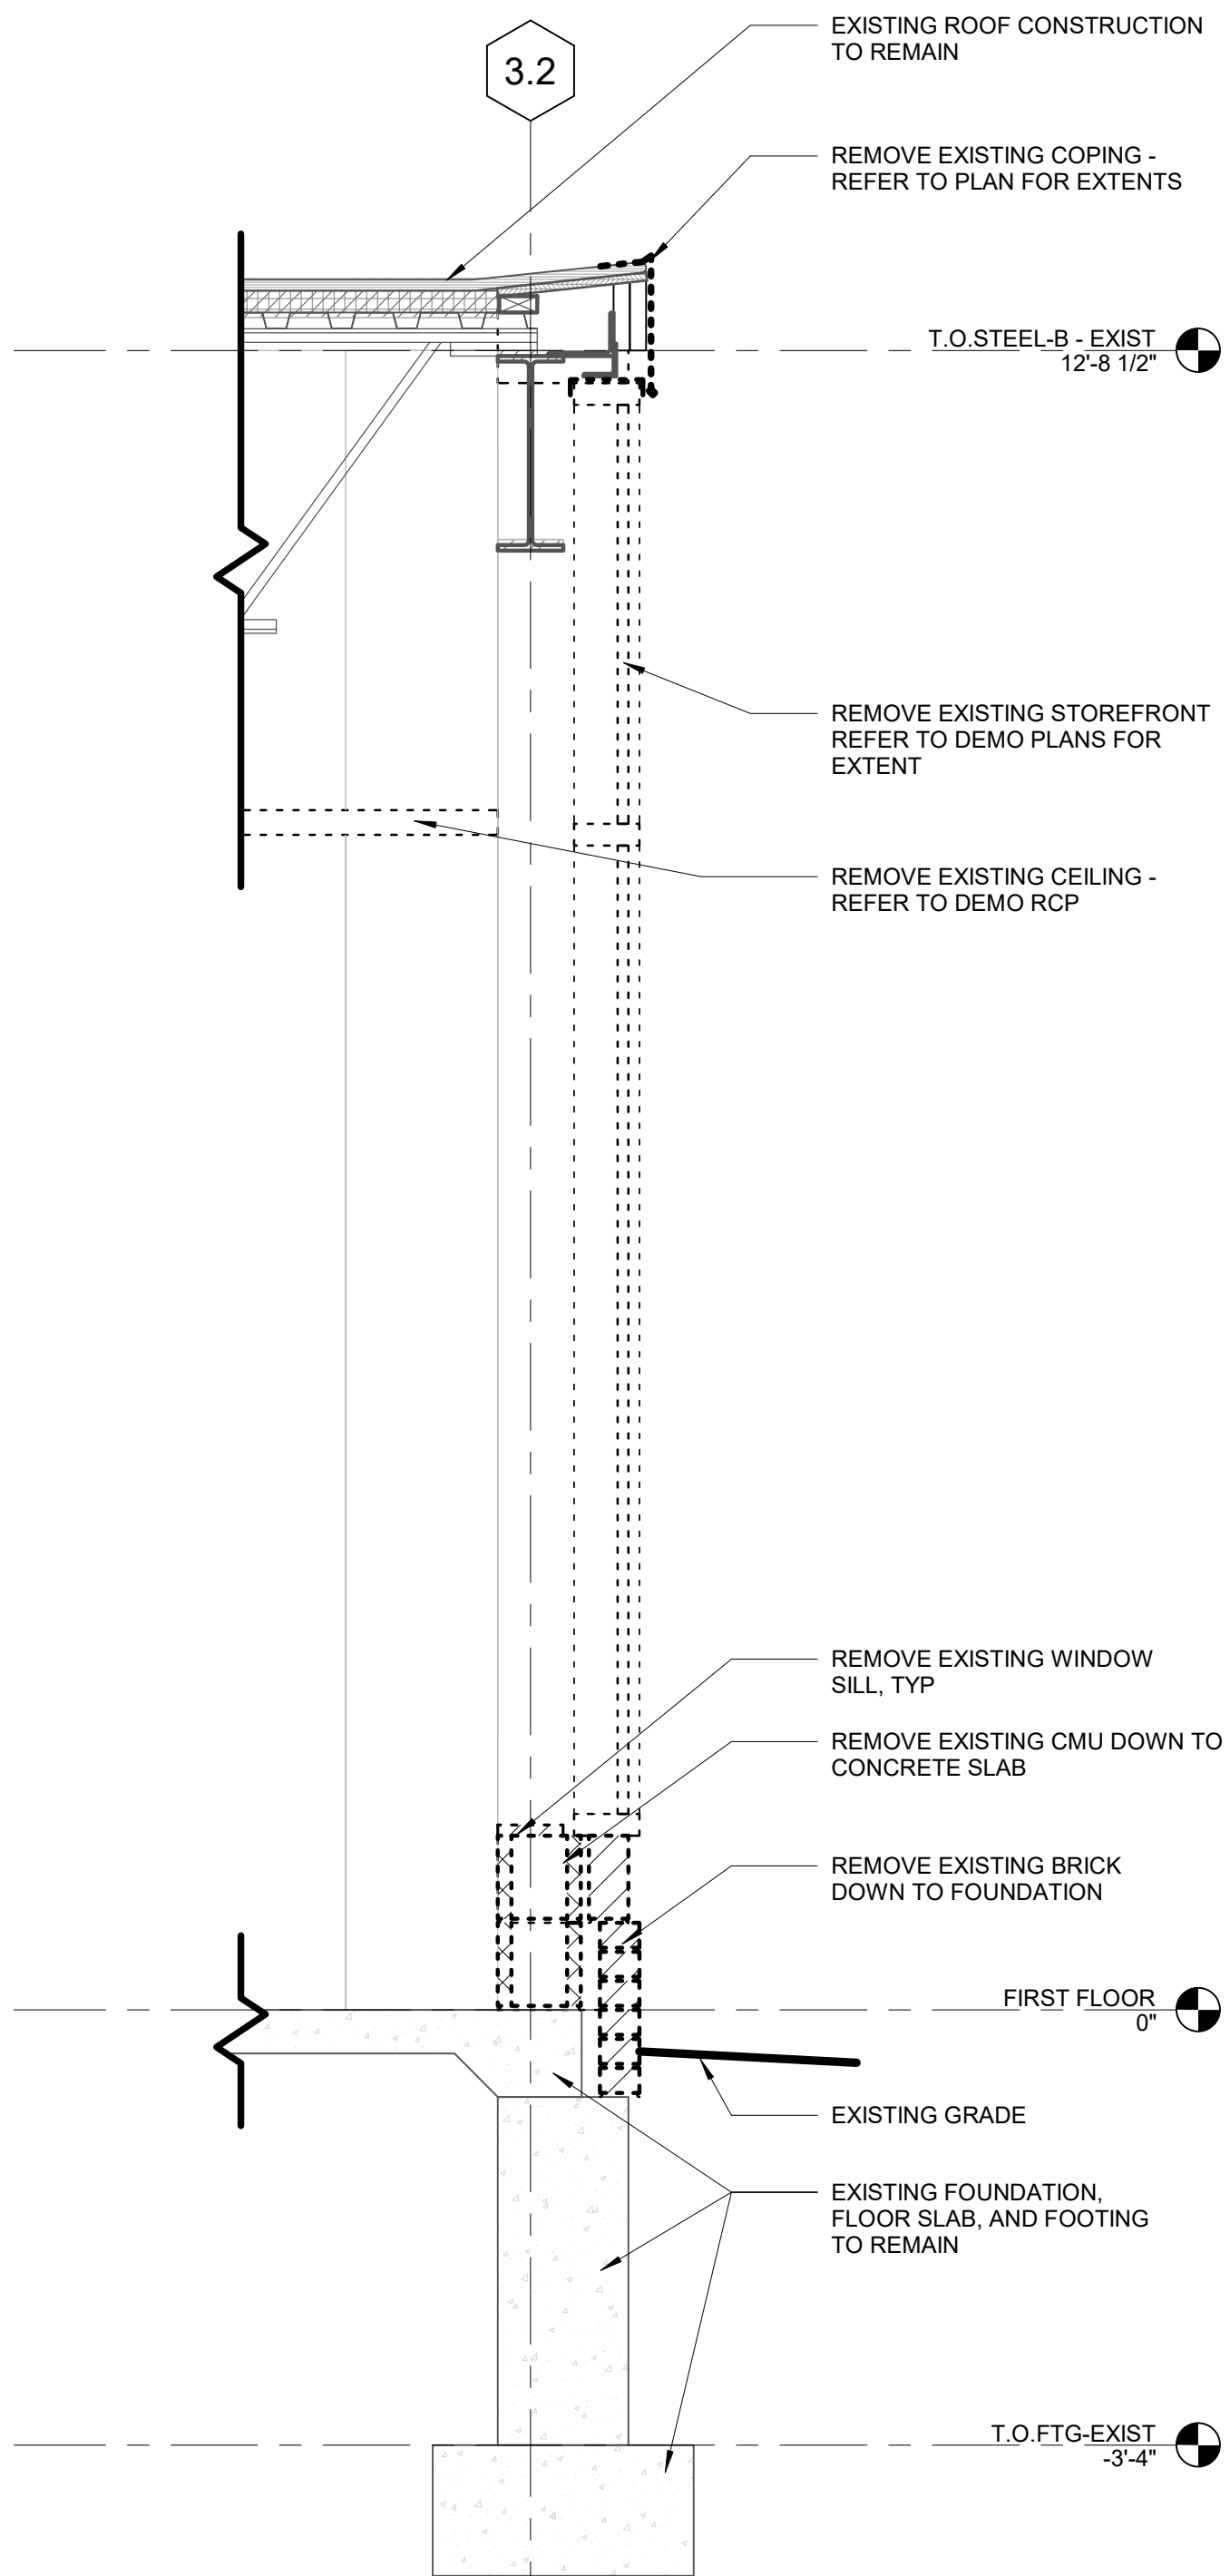

2
AD401
DEMOLITION WALL SECTION
3/4" = 1'-0"

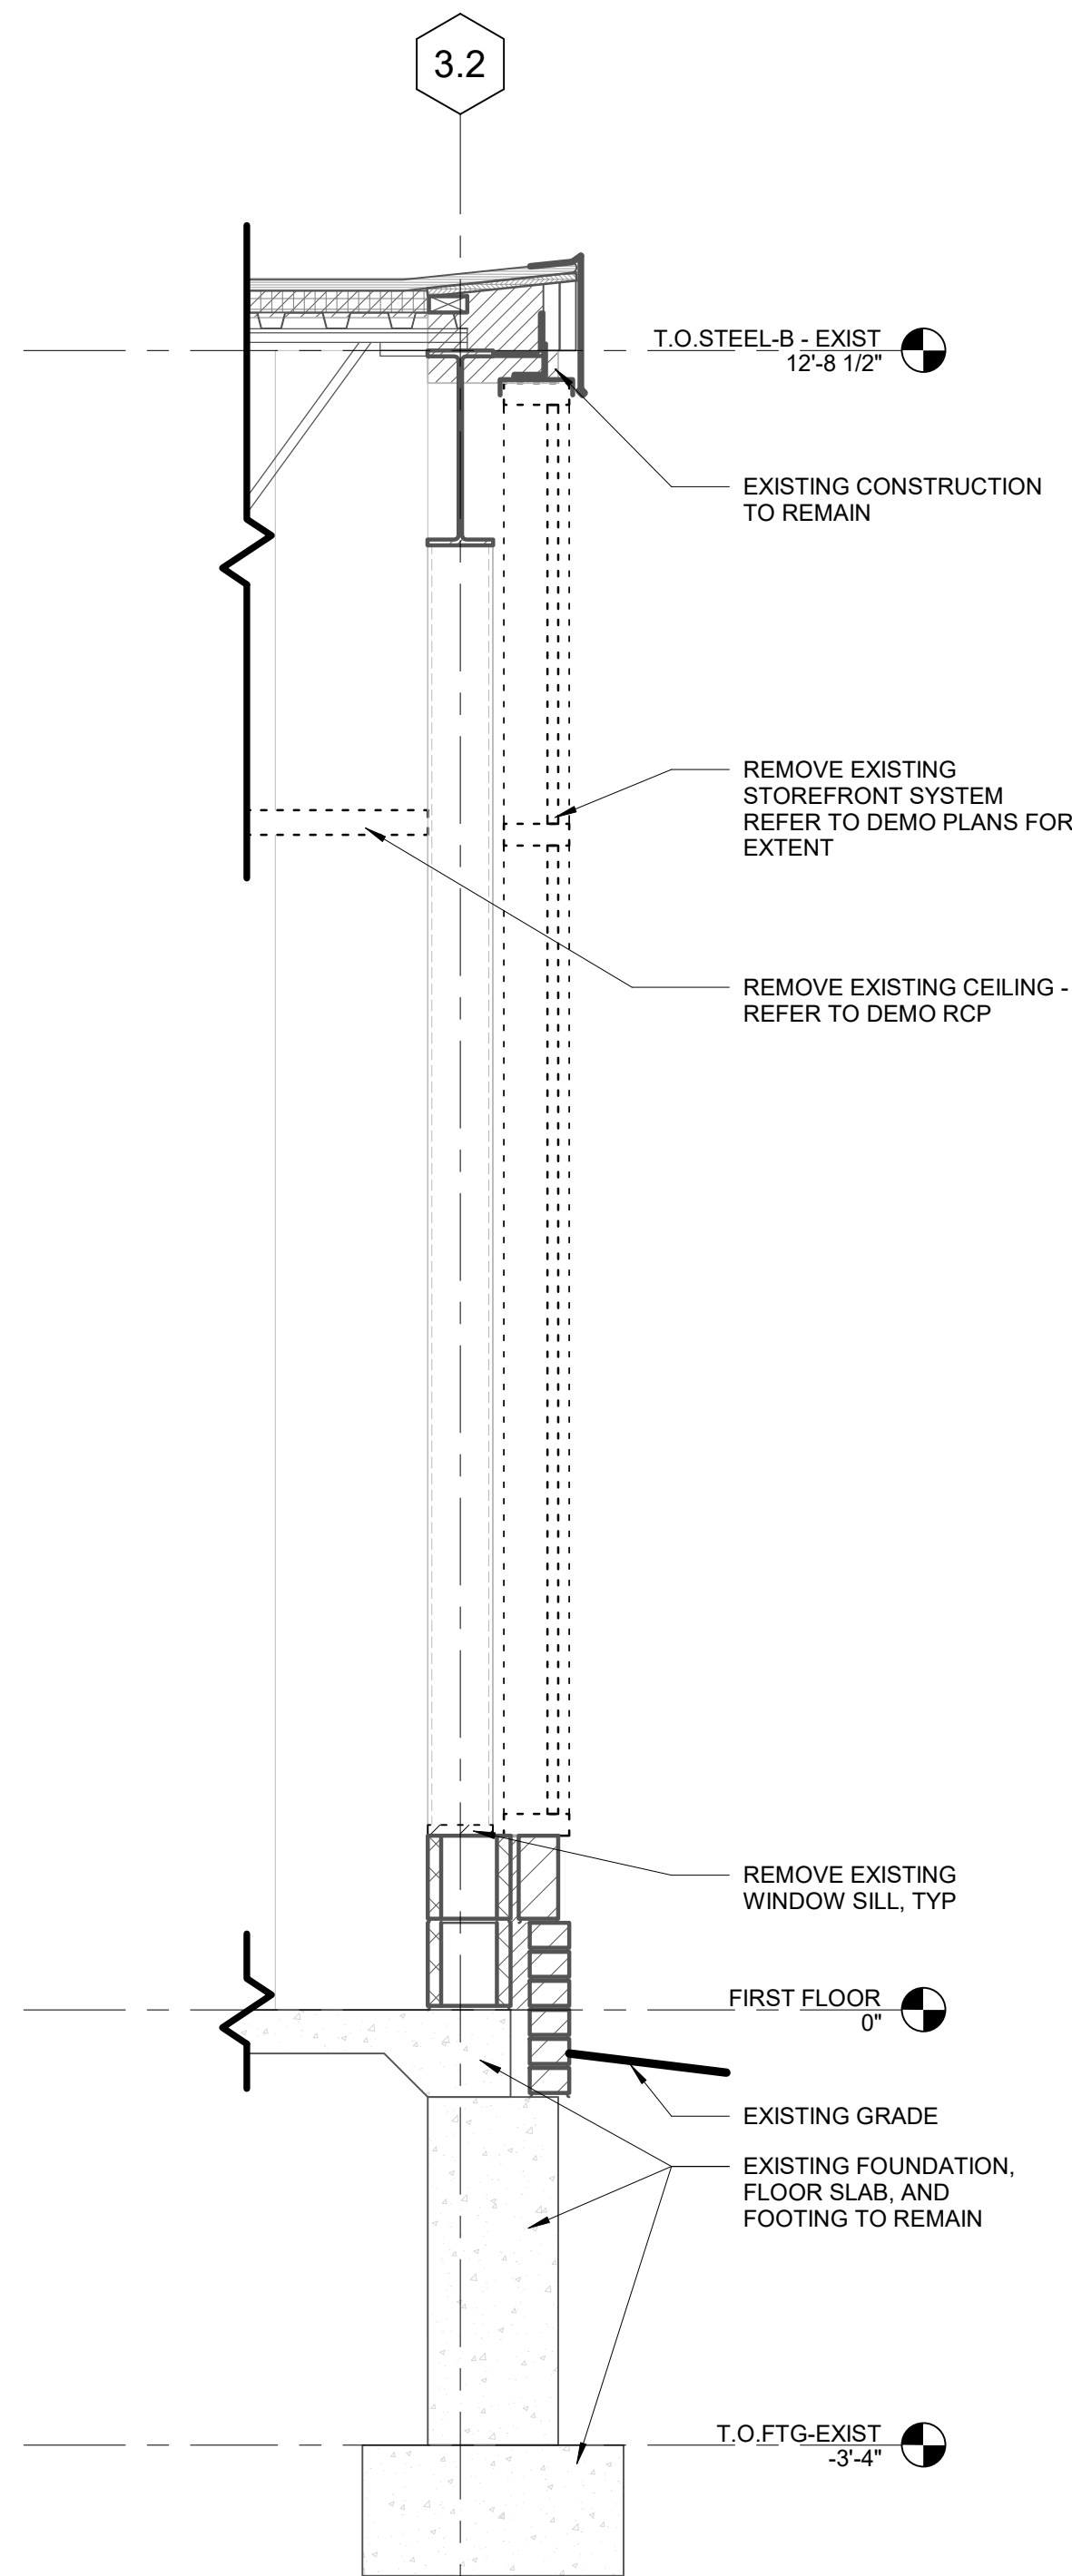

1
AD401
DEMOLITION WALL SECTION
3/4" = 1'-0"

EXISTING NOTES:

1. CONTRACTOR MUST VISIT THE SITE AND FAMILIARIZE HIMSELF WITH ALL EXISTING CONDITIONS. VERIFY MEASUREMENTS WITH CORRESPONDING CONSTRUCTION OR EXISTING CONDITIONS PRIOR TO PROCEEDING WITH THE WORK, AND NOTIFY THE ARCHITECT IMMEDIATELY OF SIGNIFICANT DISCREPANCIES.
2. VERIFY ALL CONDITIONS COVERING OR AFFECTING THE STRUCTURAL WORK; OBTAIN AND VERIFY ALL DIMENSIONS AND ELEVATIONS TO ENSURE THE PROPER STRENGTH, FIT AND LOCATION OF THE STRUCTURAL WORK; REPORT TO THE ARCHITECT ANY AND ALL CONDITIONS WHICH MAY INTERFERE WITH OR OTHERWISE AFFECT OR PREVENT THE PROPER EXECUTION AND COMPLETION OF THE NEW WORK. ALL DISCREPANCIES SHALL BE FULLY RESOLVED PRIOR TO COMMENCING WORK.
3. EXISTING CONSTRUCTION NOT UNDERGOING ALTERATION IS TO REMAIN UNDISTURBED, WHERE SUCH CONSTRUCTION IS DISTURBED AS A RESULT OF THE OPERATIONS OF THIS CONTRACT, IT MUST BE REPAIRED OR REPLACED BY THE CONTRACTOR AS REQUIRED AND TO THE SATISFACTION OF THE ARCHITECT.
4. WHERE THE EXISTING CONSTRUCTION IS TO BE ALTERED, OR OTHERWISE DISTURBED, PROVIDE TEMPORARY AND/OR PERMANENT BRACING AND SHORING AS MAY BE REQUIRED BEFORE AND DURING OPERATIONS AND UNTIL THE WORK IS SAFELY COMPLETED AND NO LONGER NEEDS SAME.
5. EACH CONTRACTOR SHALL PROVIDE ALL THE NECESSARY SUPPORT, BRACING, SHORING, ETC. (TEMPORARY AND/OR PERMANENT) OF BOTH NEW AND EXISTING CONSTRUCTION AS REQUIRED FOR THE SAFE INSTALLATION OF THE NEW CONSTRUCTION AND EQUIPMENT.
6. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS FULLY COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURE AND SEQUENCE, AND TO ENSURE THE SAFETY OF THE BUILDING AND ITS COMPONENT PARTS DURING ERECTION. THIS INCLUDES THE ADDITION OF TEMPORARY BRACING, GUYS OR TIE-DOWNS IF NECESSARY.
7. THE CONTRACTOR IS RESPONSIBLE FOR MEANS, METHODS, SEQUENCES, AND PROCEDURES OF CONSTRUCTION.
8. PROVIDE FIRE WATCH DURING FIELD CUTTING AND WELDING OPERATIONS, MEETING THE OWNER'S REQUIREMENTS.
9. ALL EXISTING STRUCTURAL MEMBERS TO REMAIN, U.N.O.

CONTINUED USE OF FACILITIES:

1. EACH CONTRACTOR SHALL AT ALL TIMES MAINTAIN A CLEAN AND SAFE PASSAGEWAY FOR THE OWNER'S OPERATION AND PERSONNEL IN EXISTING AREAS AND MAINTAIN CLEARANCES ADJACENT TO AND IN CONNECTION WITH THE WORK PERFORMED.
2. EACH CONTRACTOR SHALL EFFECTIVELY CONFINE DUST, DIRT AND NOISE TO THE ACTUAL CONSTRUCTION AREA AS APPROVED BY THE GENERAL CONTRACTOR IN ACCORDANCE WITH STATE OF MICHIGAN REGULATIONS.
3. WORK SHALL, IF REQUIRED, BE CONSTRUCTED IN PHASES TO ACCOMMODATE THE OWNER'S USE OF THE PREMISES DURING THE CONSTRUCTION PERIOD AND FOR INSTALLATION OF HIS EQUIPMENT. COORDINATE THE CONSTRUCTION SCHEDULE WITH THE GENERAL CONTRACTOR AND OWNER'S REPRESENTATIVE.
4. DURING THE PERFORMANCE OF THE WORK OF THIS CONTRACT, THE OWNER'S WILL CONTINUE TO OCCUPY THE EXISTING BUILDING. INTERRUPTION OF BUILDING ACCESS AND FACILITIES BY THE CONTRACTOR WILL NOT BE PERMITTED, TO WHATEVER EXTENT SUCH INTERRUPTIONS MIGHT INTERFERE WITH OWNER'S OCCUPANCY. LIMIT CONSTRUCTION OPERATIONS TO THOSE METHODS AND PROCEDURES WHICH WILL NOT ADVERSELY AND UNDULY EFFECT THE WORKING ENVIRONMENT OF OWNER'S OCCUPIED SPACES, INCLUDING NOISE, DUST, ODORS, AIR POLLUTION, AMBIENT DISCOMFORT, POOR LIGHTING, HAZARDS AND OTHER UNDESIRABLE EFFECTS AND CONDITIONS. COORDINATE AND SCHEDULE ALL WORK IN EXISTING BUILDING WITH OWNER AND GENERAL CONTRACTOR.



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

DEMOLITION NOTES:

1. REMOVE ALL MATERIALS AND DEBRIS CREATED DURING THE DEMOLITION AND/OR CONSTRUCTION PROCESS AND DISPOSE OFF SITE IN A SAFE AND LEGAL MANNER.

2. PROVIDE TEMPORARY PROTECTION AND WEATHER SEAL FOR INTERIOR DURING CONSTRUCTION PROCESS. TEMPORARY CONSTRUCTION MUST BE WATER TIGHT TO PREVENT ANY DAMAGE OR VANDALISM TO EXISTING INTERIOR SPACE.

3. PROVIDE DUST MATS AT ALL CONSTRUCTION AREA ENTRANCE AND EXIT LOCATIONS.

4. PERFORM ALL DEMOLITION WORK REQUIRED ON THE EXISTING BUILDING AS CALLED FOR ON THE DRAWINGS AND/OR AS REQUIRED TO ACCOMMODATE THE WORK.

5. CAP, PATCH AND REPAIR ALL HOLES AND SURFACES IN WALLS, FLOORS AND CEILINGS WHERE ARCHITECTURAL, STRUCTURAL, MECHANICAL AND/OR ELECTRICAL ITEMS ARE REMOVED AS A RESULT OF THE DEMOLITION OPERATIONS.

6. ALL EXISTING CONCRETE SLAB ON GRADE AND/OR CONCRETE TOPPING TO REMAIN IS TO BE PATCHED, REPAIRED, AND/OR FILLED TO MATCH EXISTING, PREPARE TO RECEIVE NEW FINISH.

7. CARRY OUT ALL DEMOLITION WORK IN CLOSE COORDINATION AND COOPERATION WITH STRUCTURAL TRADES FOR PROPER SEQUENCING OF THE WORK TO ASSURE THE COMPLETE SAFETY AND STRUCTURAL INTEGRITY OF THE BUILDING AND ITS ELEMENTS AT ALL TIMES. PROVIDE TEMPORARY COLUMNS, JACKS, BEAMS, ETC., WHERE REQUIRED FOR SUPPORT OF EXISTING ELEMENTS OF CONSTRUCTION TO REMAIN IN SAFE, COMPETENT MANNER, IN CONFORMANCE WITH ALL LAWS, CODES ORDINANCES, RULES AND REGULATIONS BEARING ON THE WORK.
8. DEMOLITION OF ALL PORTIONS OF THE STRUCTURE TO BE REMOVED SHALL BE DONE WITH UTMOST CARE, USING TOOLS AND METHODS SUBJECT TO OWNER'S APPROVAL. ALL POSSIBLE CARE SHALL BE TAKEN TO AVOID DAMAGING, SHOCK OR VIBRATION TO PORTIONS OF EXISTING STRUCTURE TO REMAIN.

9. THE CONTRACTOR SHALL VERIFY THE EXISTENCE, LOCATION AND ELEVATION OF EXISTING SEWERS, DRAINS, ETC. IN DEMOLITION AREAS BEFORE PROCEEDING WITH THE WORK. ALL DISCREPANCIES SHALL BE DOCUMENTED AND REPORTED TO THE ARCHITECT.

10. SAWCUT & REMOVE EXISTING CONCRETE SLAB FOR PLACEMENT OF PLUMBING WORK, FOUNDATIONS, STRUCTURAL STEEL, NECESSARY CAPPING OF EXISTING LINES AND FOUNDATION WORK, ETC. COORDINATE WITH STRUCTURAL ENGINEER AND ARCHITECT.

11. SAWCUT AND REMOVE EXISTING MASONRY AS REQUIRED AT EXISTING WALL OPENINGS TO ACCOMMODATE NEW DOORS/ WINDOWS.

12. REMOVE AND RELOCATE MECHANICAL AND ELECTRICAL ITEMS, INCLUDING PIPING, FIXTURES, EQUIPMENT, DUCTWORK, WIRING DEVICES, PANELS AND ACCESSORIES AS REQUIRED. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR MECHANICAL AND ELECTRICAL DEMOLITION.

13. ALL EXISTING CONSTRUCTION TO REMAIN U.N.O.

14. ALL EXISTING MATERIALS INDICATED TO REMAIN SHALL BE REPAIRED TO MATCH EXISTING. MATERIALS BEYOND REPAIR SHALL BE REPLACED TO MATCH EXISTING.

15. PATCH AND PREPARE ALL DEMOLITION AREAS FOR NEW FINISHES, REFER TO ARCHITECTURAL DRAWINGS.
16. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR SPECIFIC TRADE RELATED DEMOLITION WORK.

17. REFER TO CIVIL DRAWINGS FOR SITE DEMOLITION INFORMATION.

18. REFER TO STRUCTURAL DRAWINGS FOR STRUCTURAL DEMOLITION INFORMATION AND SHORING OF EXISTING STRUCTURE.

19. REFER TO SECTION 24119 - DEMOLITION, IN THE SPECIFICATION FOR FURTHER INFORMATION PRIOR TO THE START OF DEMOLITION.

20. REMOVE ALL FURNISHING ATTACHED TO WALLS INCLUDING, BUT NOT LIMITED TO, WHITEBOARDS, BULLETIN BOARDS, PROJECTOR SCREENS, FIRE EXTINGUISHERS & FIRE EXTINGUISHER CABINETS, ETC. IN THE AREAS OF WORK.

21. REFER TO SECTION 017419 - CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL FOR FURTHER INFORMATION PRIOR TO START OF DEMOLITION.

22. SAWCUT & REMOVE PORTION OF EXISTING CONCRETE SLAB FOR INSTALLATION OF NEW VAULT FLOOR

RCP DEMOLITION KEY NOTES

- 1

REMOVE EXISTING ACOUSTICAL CEILING TILES, GRID AND ALL ASSOCIATED LIGHT FIXTURES AND DIFFUSERS.
- 2

REMOVE EXISTING GYPSUM BOARD CEILING, FRAMING, AND ALL ASSOCIATED LIGHT FIXTURES AND DIFFUSERS.
- 3

REMOVE EXISTING LIGHT FIXTURES AND DIFFUSERS, EXISTING CEILING TO REMAIN.
- 4

EXISTING CEILING, LIGHT FIXTURES AND DIFFUSERS TO REMAIN.

EXISTING NOTES:

1. CONTRACTOR MUST VISIT THE SITE AND FAMILIARIZE HIMSELF WITH ALL EXISTING CONDITIONS. VERIFY MEASUREMENTS WITH CORRESPONDING CONSTRUCTION OR EXISTING CONDITIONS PRIOR TO PROCEEDING WITH THE WORK, AND NOTIFY THE ARCHITECT IMMEDIATELY OF SIGNIFICANT DISCREPANCIES.

2. VERIFY ALL CONDITIONS COVERING OR AFFECTING THE STRUCTURAL WORK; OBTAIN AND VERIFY ALL DIMENSIONS AND ELEVATIONS TO ENSURE THE PROPER STRENGTH, FIT AND LOCATION OF THE STRUCTURAL WORK; REPORT TO THE ARCHITECT ANY AND ALL CONDITIONS WHICH MAY INTERFERE WITH OR OTHERWISE AFFECT OR PREVENT THE PROPER EXECUTION AND COMPLETION OF THE NEW WORK. ALL DISCREPANCIES SHALL BE FULLY RESOLVED PRIOR TO COMMENCING WORK.

3. EXISTING CONSTRUCTION NOT UNDERGOING ALTERATION IS TO REMAIN UNDISTURBED, WHERE SUCH CONSTRUCTION IS DISTURBED AS A RESULT OF THE OPERATIONS OF THIS CONTRACT, IT MUST BE REPAIRED OR REPLACED BY THE CONTRACTOR AS REQUIRED AND TO THE SATISFACTION OF THE ARCHITECT.

4. WHERE THE EXISTING CONSTRUCTION IS TO BE ALTERED, OR OTHERWISE DISTURBED, PROVIDE TEMPORARY AND/OR PERMANENT BRACING AND SHORING AS MAY BE REQUIRED BEFORE AND DURING OPERATIONS AND UNTIL THE WORK IS SAFELY COMPLETED AND NO LONGER NEEDS SAME.

5. EACH CONTRACTOR SHALL PROVIDE ALL THE NECESSARY SUPPORT, BRACING, SHORING, ETC. (TEMPORARY AND/OR PERMANENT) OF BOTH NEW AND EXISTING CONSTRUCTION AS REQUIRED FOR THE SAFE INSTALLATION OF THE NEW CONSTRUCTION AND EQUIPMENT.

6. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS FULLY COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURE AND SEQUENCE, AND TO ENSURE THE SAFETY OF THE BUILDING AND ITS COMPONENT PARTS DURING ERECTION. THIS INCLUDES THE ADDITION OF TEMPORARY BRACING, GUYS OR TIE-DOWNS IF NECESSARY.

7. THE CONTRACTOR IS RESPONSIBLE FOR MEANS, METHODS, SEQUENCES, AND PROCEDURES OF CONSTRUCTION.

8. PROVIDE FIRE WATCH DURING FIELD CUTTING AND WELDING OPERATIONS, MEETING THE OWNER'S REQUIREMENTS.


9. ALL EXISTING STRUCTURAL MEMBERS TO REMAIN, U.N.O.
- CONTINUED USE OF FACILITIES:

1. EACH CONTRACTOR SHALL AT ALL TIMES MAINTAIN A CLEAN AND SAFE PASSAGEWAY FOR THE OWNER'S OPERATION AND PERSONNEL IN EXISTING AREAS AND MAINTAIN CLEARANCES ADJACENT TO AND IN CONNECTION WITH THE WORK PERFORMED.


2. EACH CONTRACTOR SHALL EFFECTIVELY CONFINE DUST, DIRT AND NOISE TO THE ACTUAL CONSTRUCTION AREA AS APPROVED BY THE GENERAL CONTRACTOR IN ACCORDANCE WITH STATE OF MICHIGAN REGULATIONS.

3. WORK SHALL, IF REQUIRED, BE CONSTRUCTED IN PHASES TO ACCOMMODATE THE OWNER'S USE OF THE PREMISES DURING THE CONSTRUCTION PERIOD AND FOR INSTALLATION OF HIS EQUIPMENT. COORDINATE THE CONSTRUCTION SCHEDULE WITH THE GENERAL CONTRACTOR AND OWNER'S REPRESENTATIVE.

4. DURING THE CONTRACTOR'S PERFORMANCE OF THE WORK OF THIS CONTRACT, THE OWNER'S WILL CONTINUE TO OCCUPY THE EXISTING BUILDING. INTERRUPTION OF BUILDING ACCESS AND FACILITIES BY THE CONTRACTOR WILL NOT BE PERMITTED; TO WHATEVER EXTENT SUCH INTERRUPTIONS MIGHT INTERFERE WITH OWNER'S OCCUPANCY. LIMIT CONSTRUCTION OPERATIONS TO THOSE METHODS AND PROCEDURES WHICH WILL NOT ADVERSELY AND UNDULY EFFECT THE WORKING ENVIRONMENT OF OWNER'S OCCUPIED SPACES, INCLUDING NOISE, DUST, ODORS, AIR POLLUTION, AMBIENT DISCOMFORT, POOR LIGHTING, HAZARDS AND OTHER UNDESIRABLE EFFECTS AND CONDITIONS. COORDINATE AND SCHEDULE ALL WORK IN EXISTING BUILDING WITH OWNER AND GENERAL CONTRACTOR.

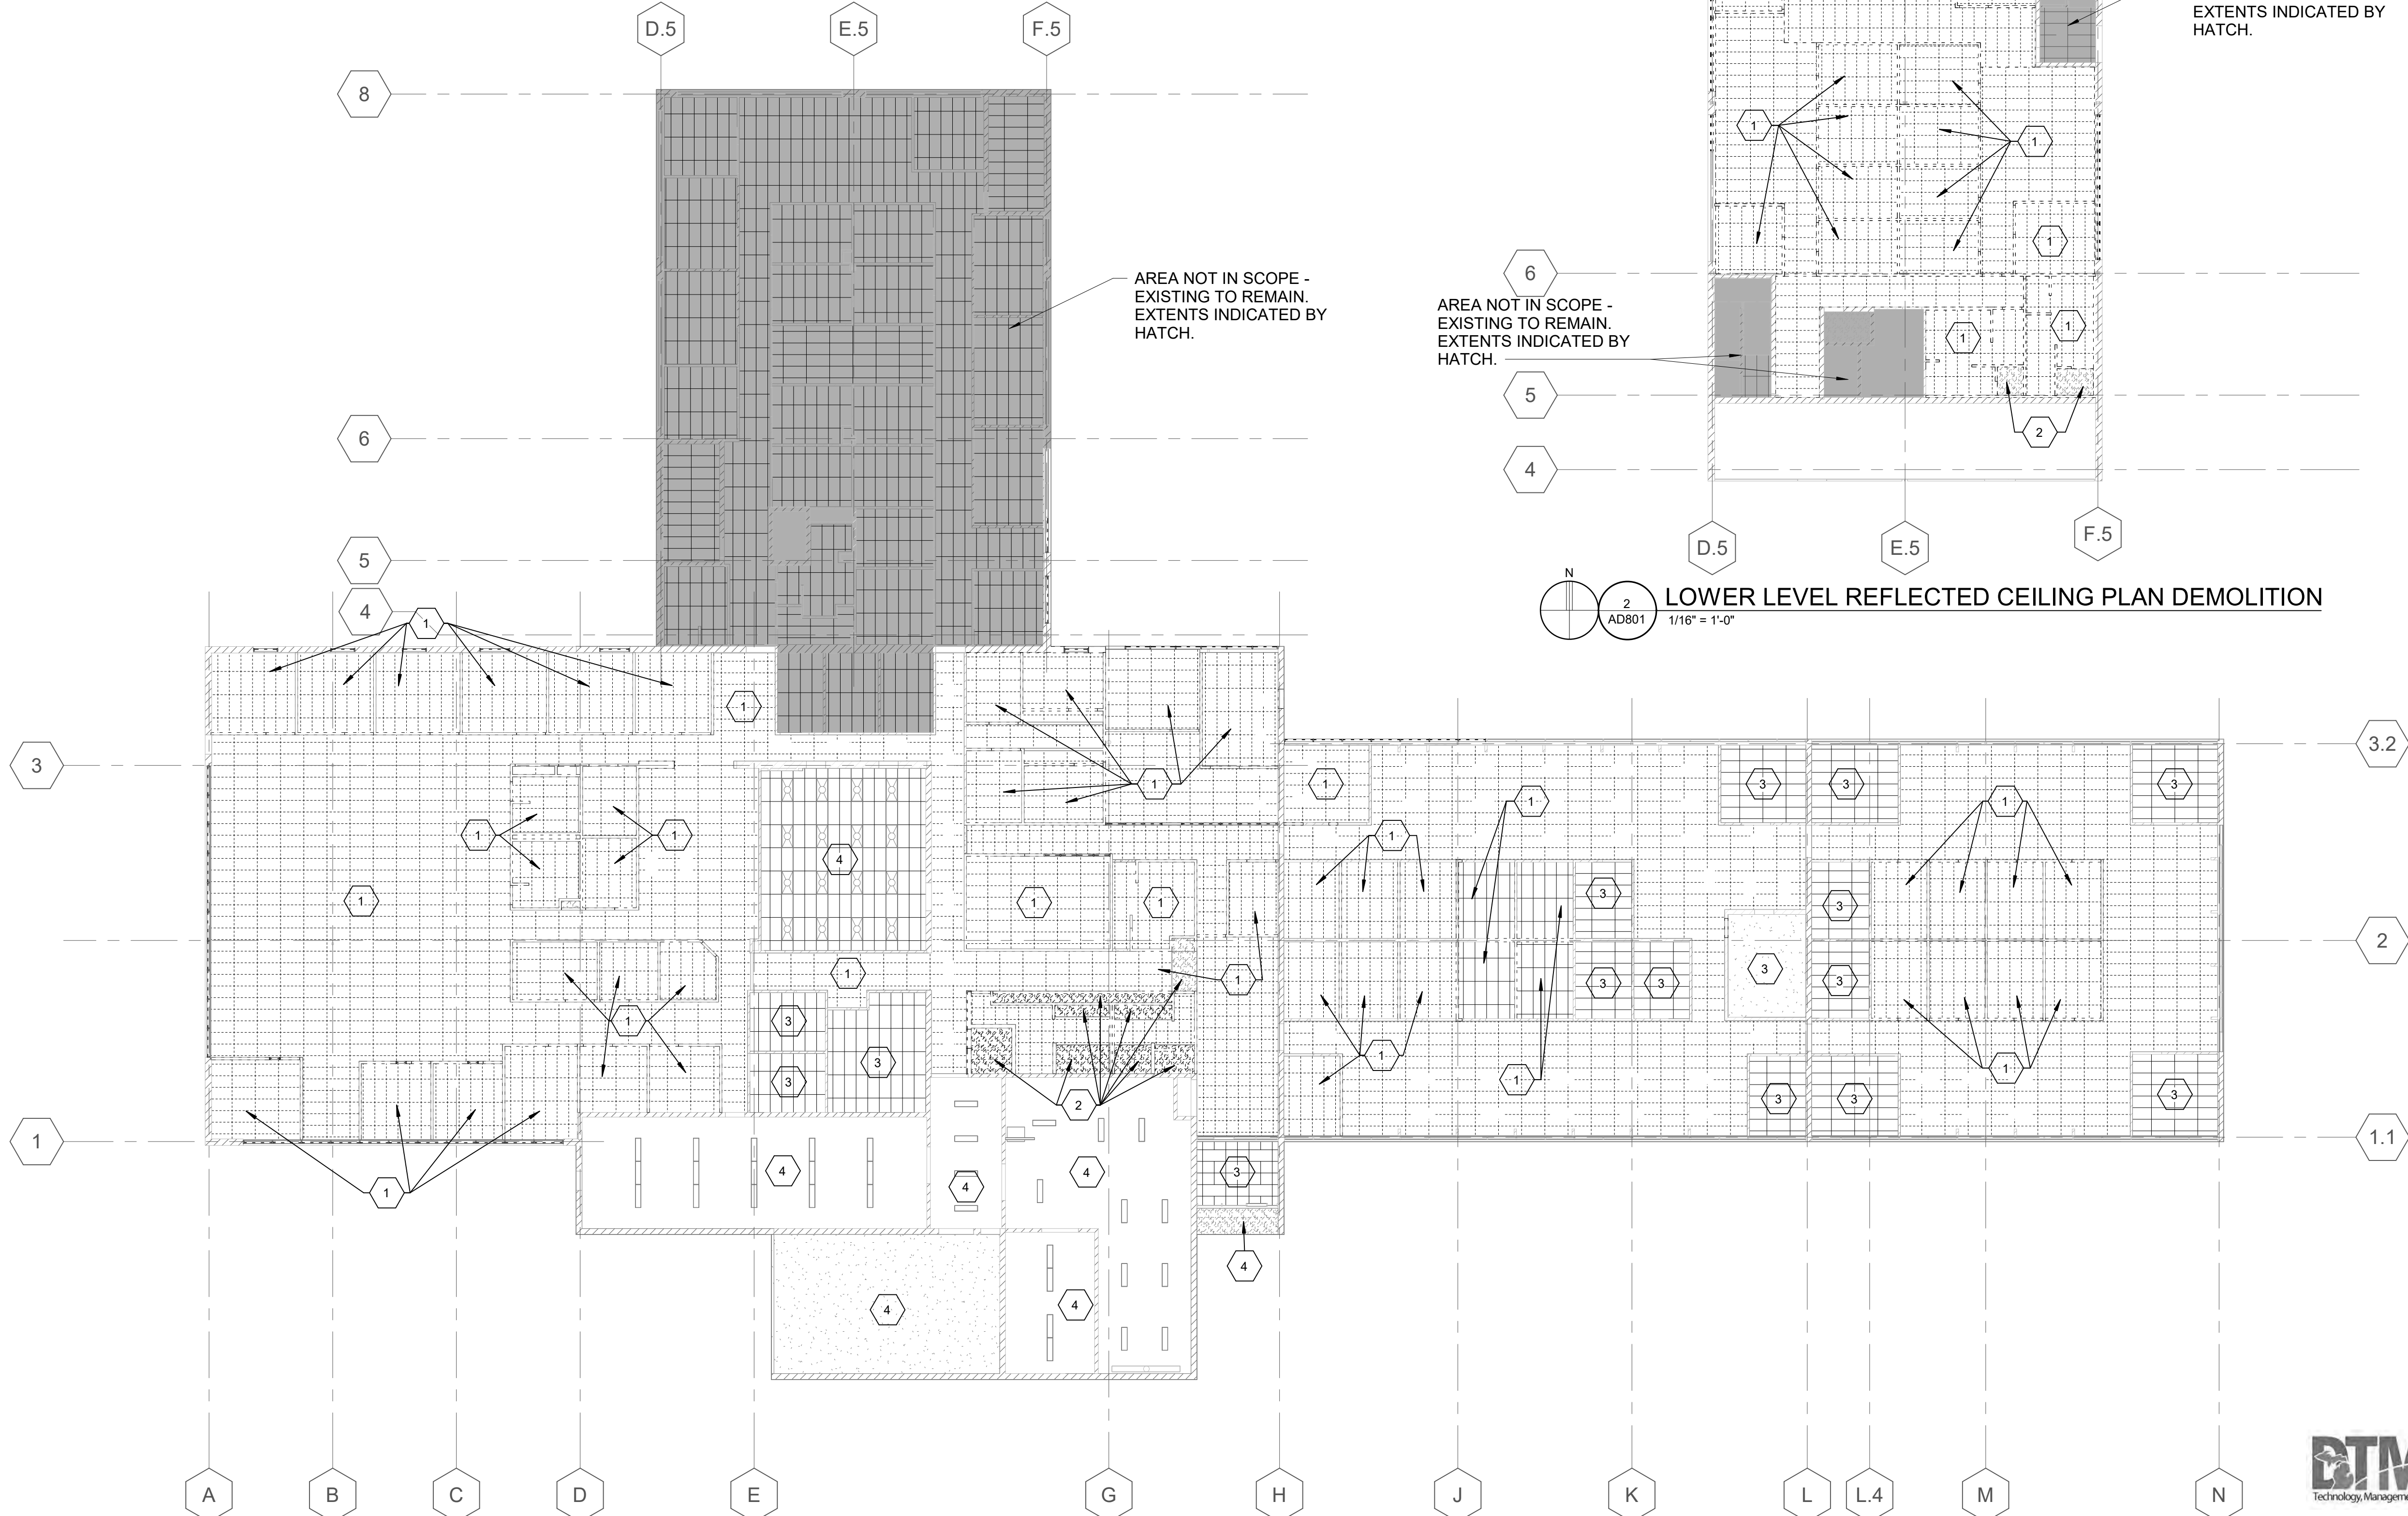

LOWER LEVEL REFLECTED CEILING PLAN DEMOLITION

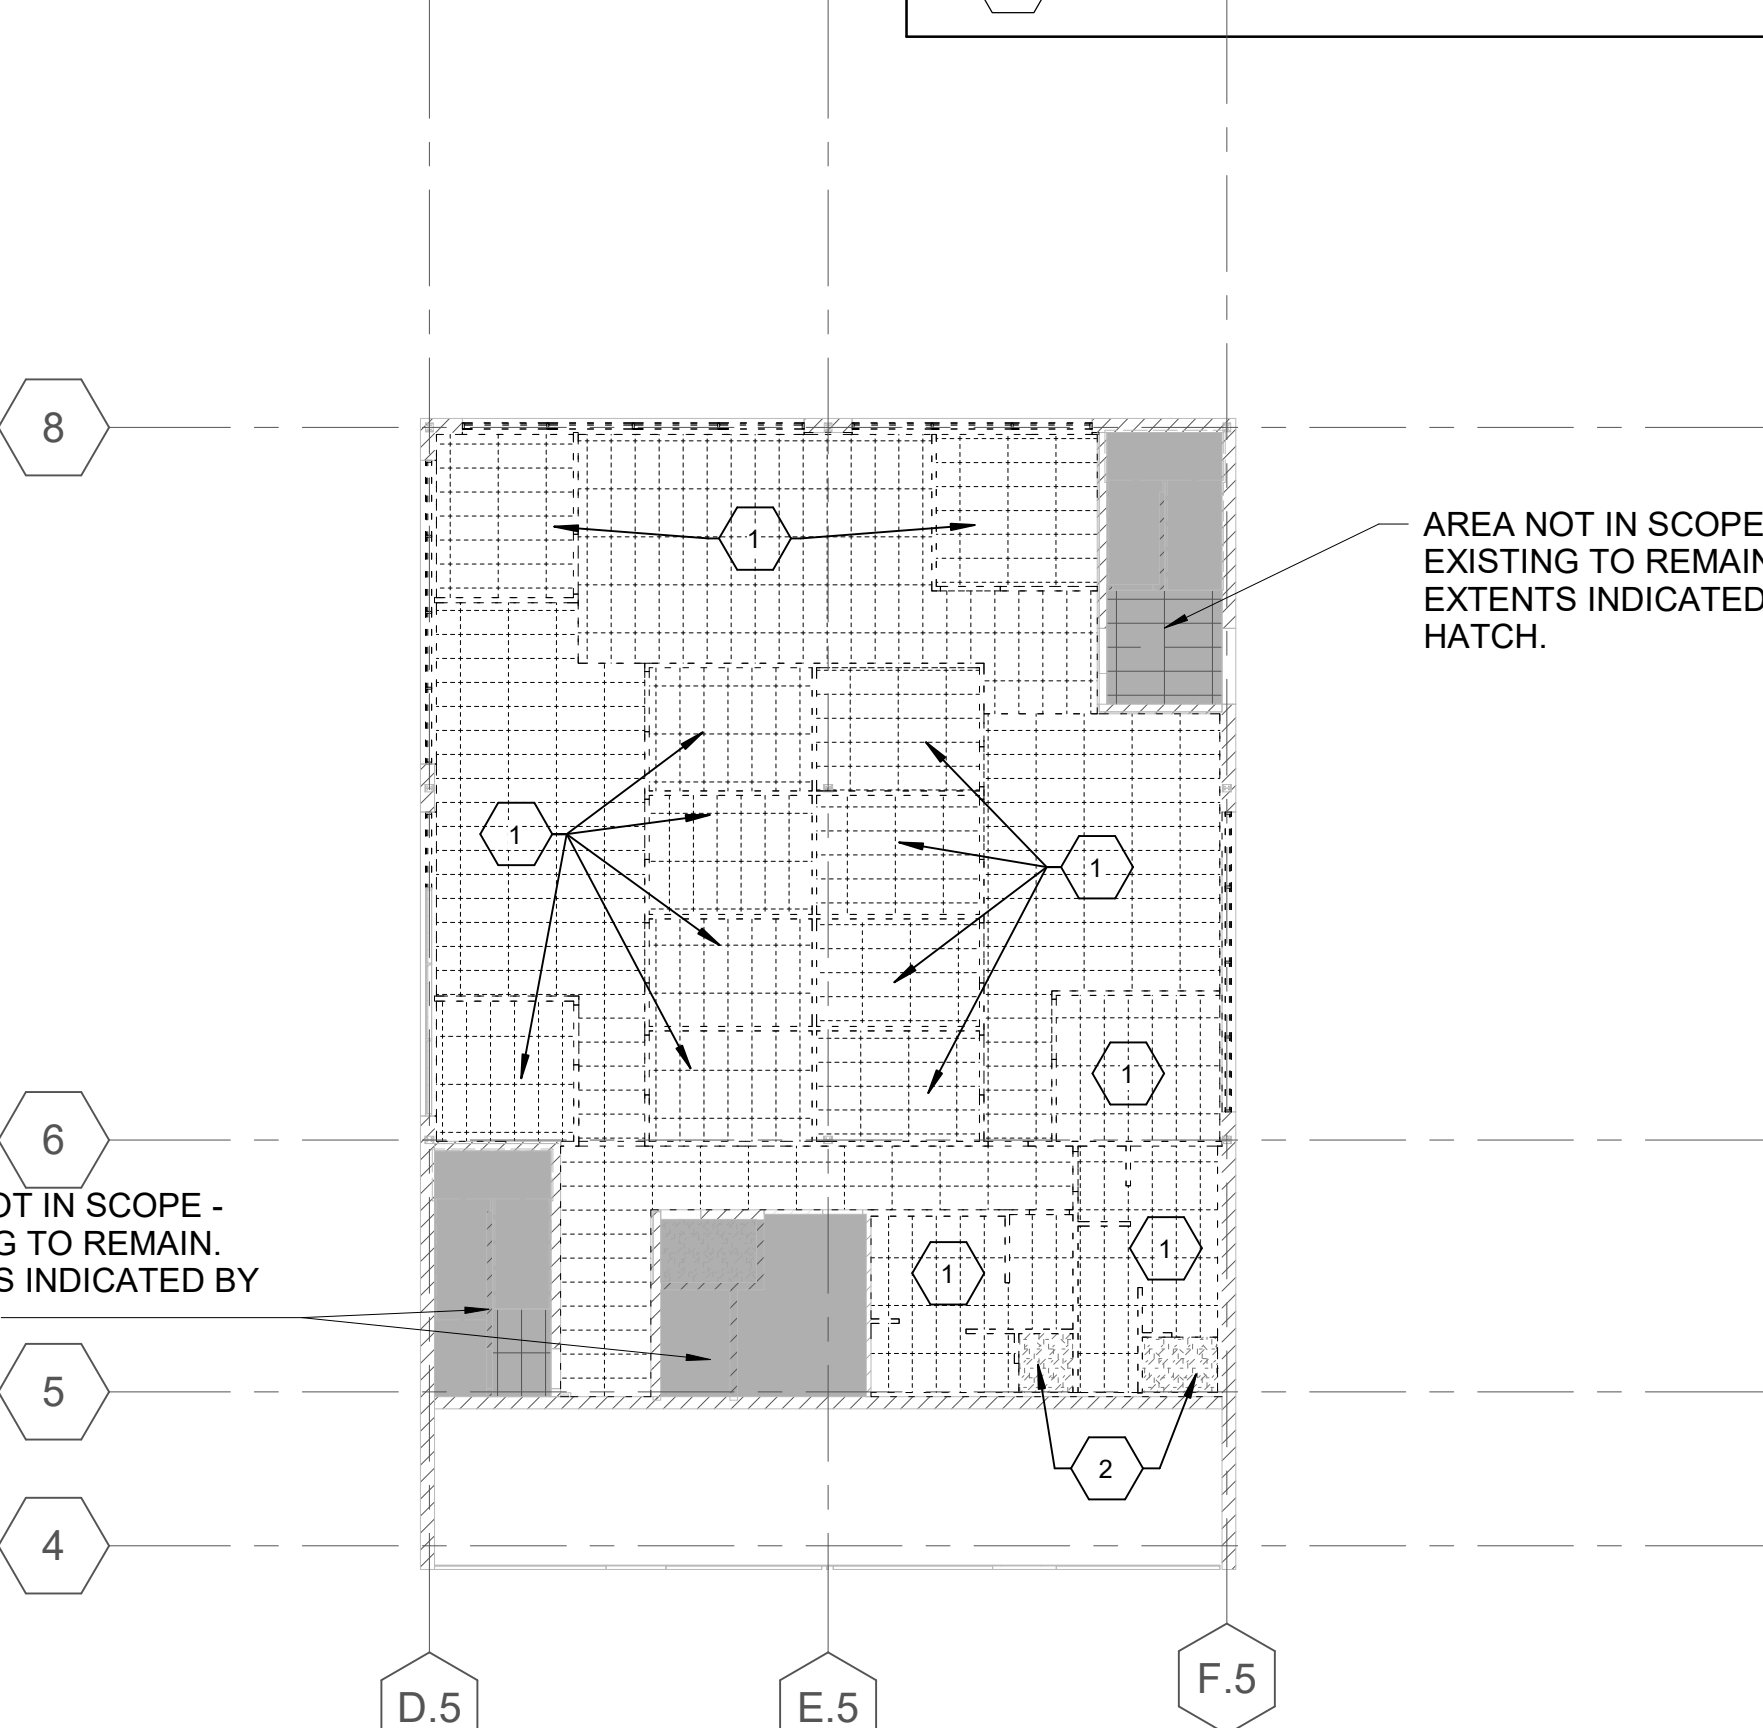

DEMO REFLECTED CEILING PLAN SYMBOLS LEGEND

SYMBOL	DESCRIPTION
	DEMO EXISTING 2'-0"x2'-0" LAY-IN CEILING SYSTEM
	DEMO EXISTING 2'-0"x4'-0" LAY-IN CEILING SYSTEM
	DEMO EXISTING GYPSUM BOARD CEILING
	EXISTING GYPSUM BOARD CEILING REMAIN
	EXISTING LAY-IN CEILING SYSTEM TO REMAIN



FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821


FACILITIES MANAGEMENT



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

DESIGNED	DATE	ISSUED FOR:	IDENTIFICATION NO:
NCHL	01/15/26	PRELIMINARY	PROJECT NO: 25510.A
DRAWN		CONSTRUCTION	DRAWN: 252285007
CHECKED		FINAL RECORD	FILE NO/INDEX CODE: 51725039.CAK
APPROVED			

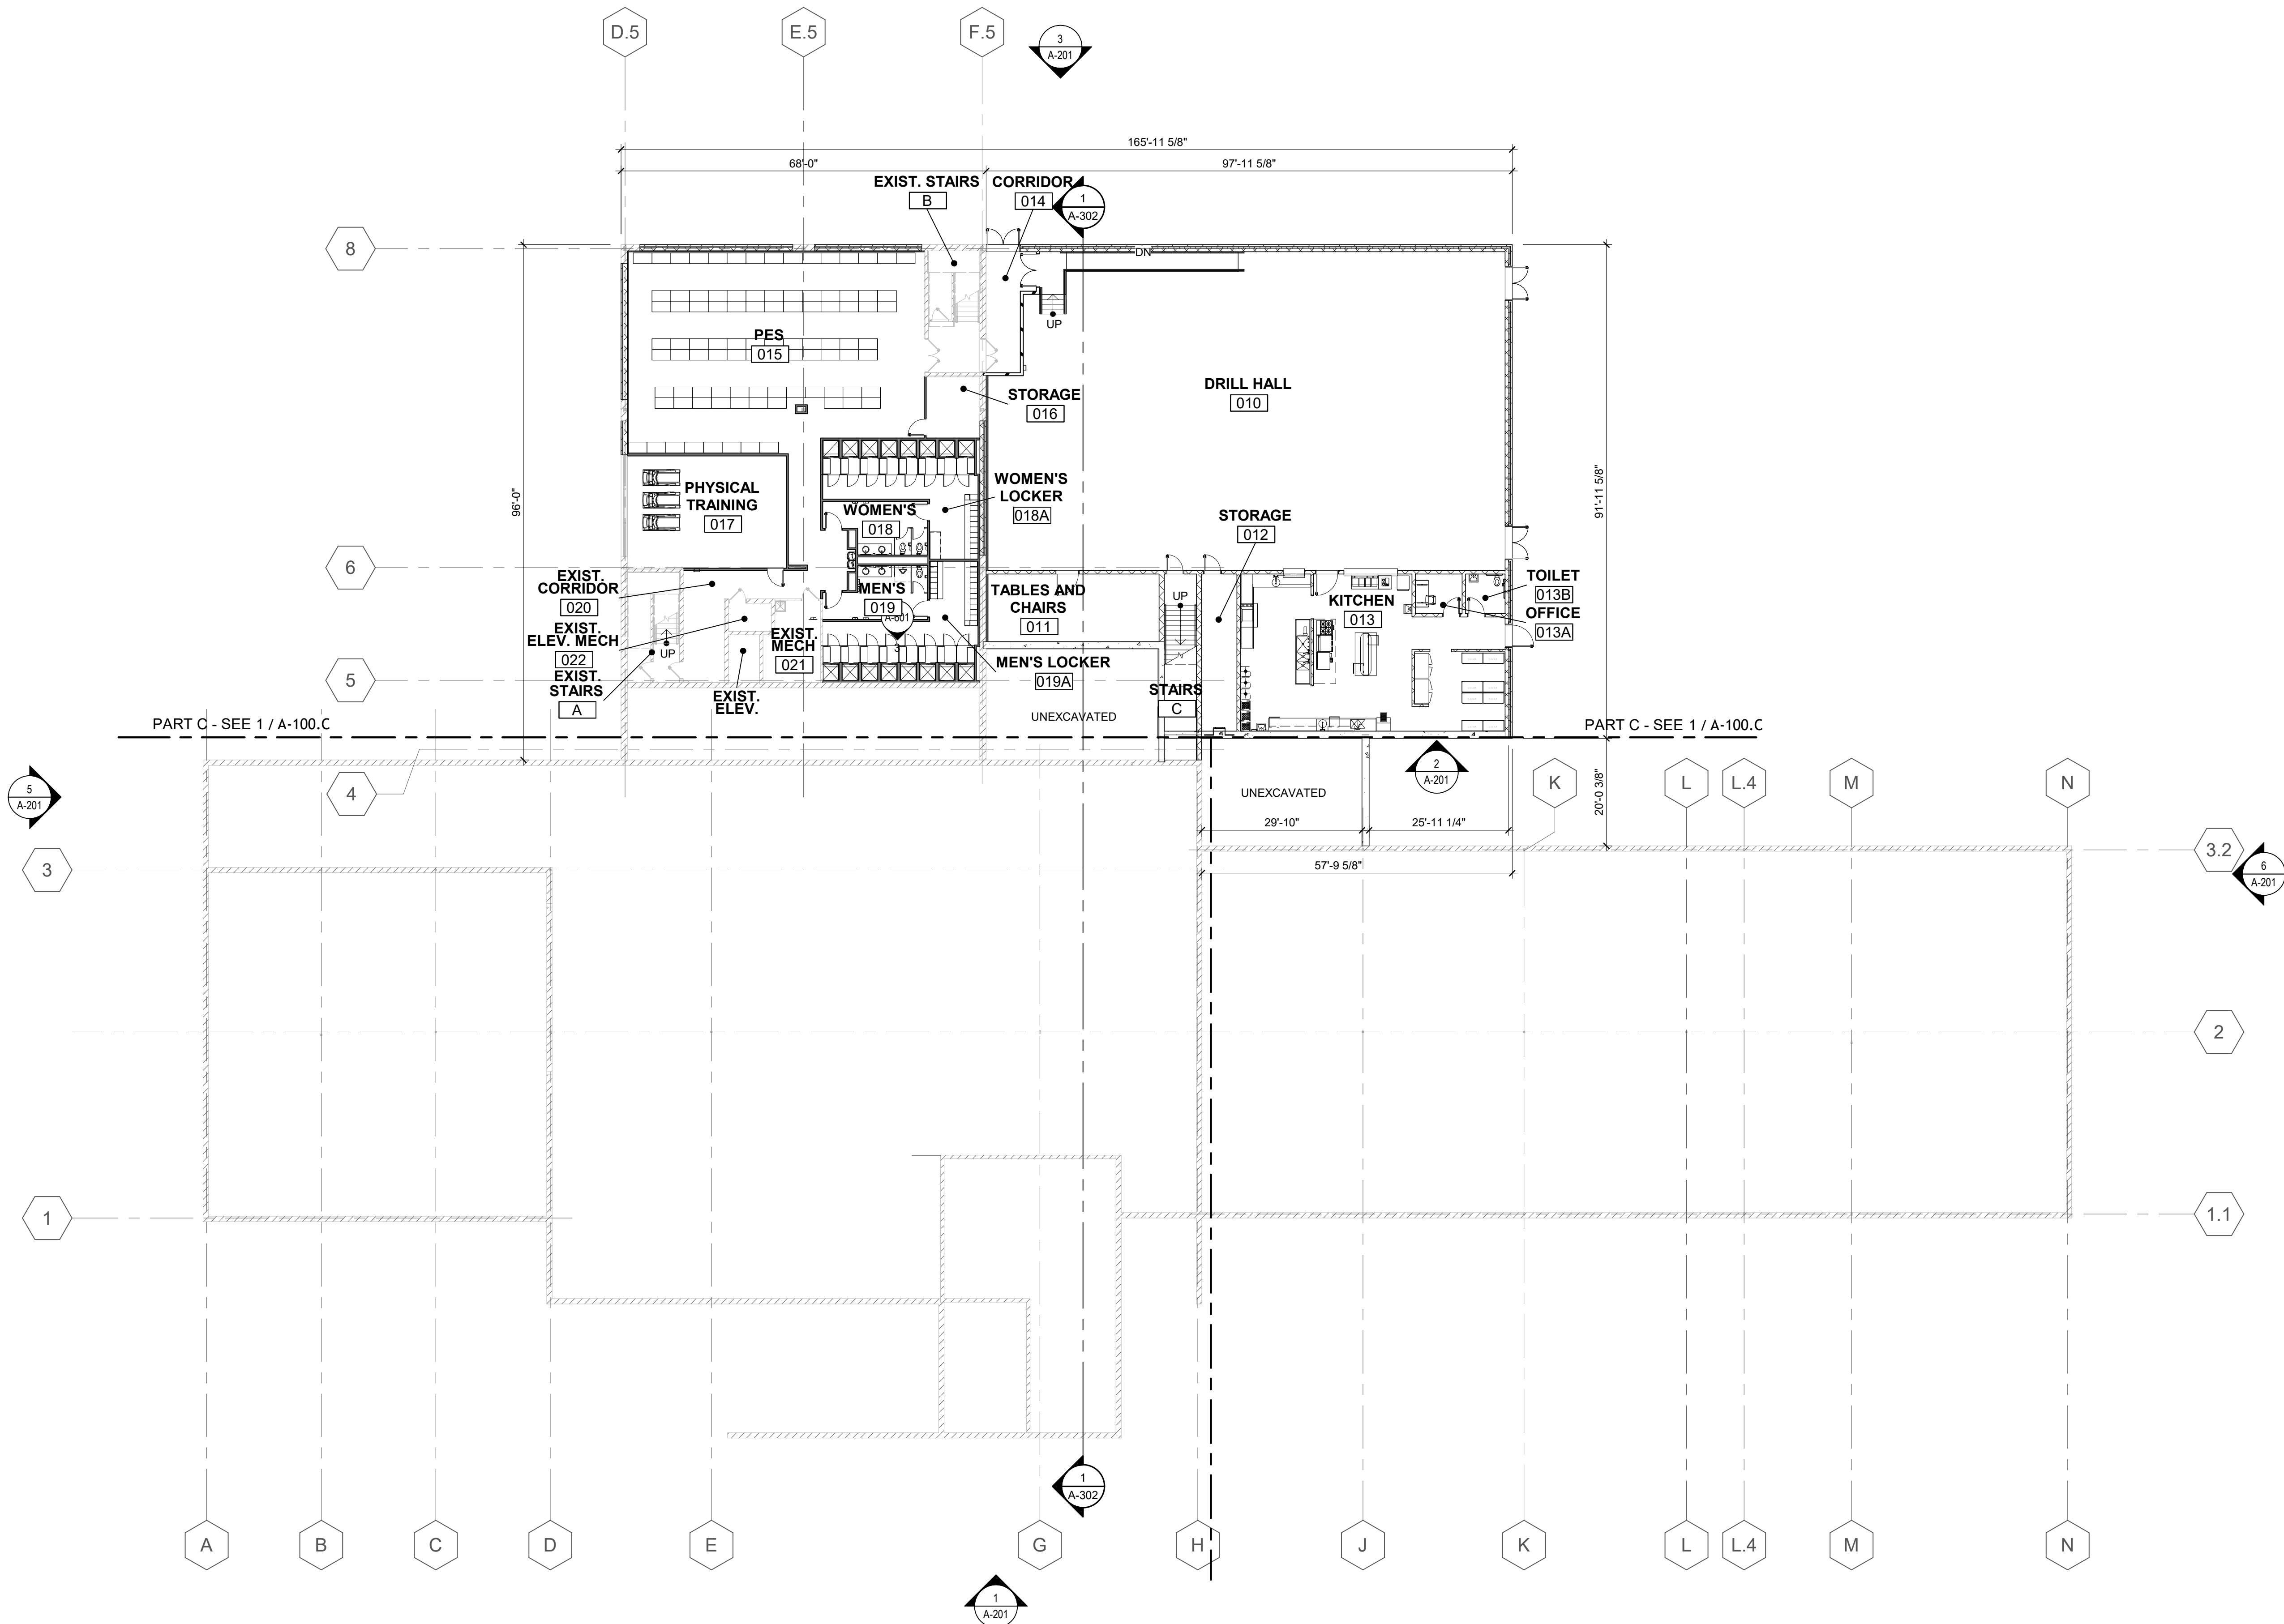

OVERALL LOWER LEVEL FLOOR PLAN
1/16" = 1'-0"


GENERAL FLOOR PLAN NOTES:

1. UTILIZE 20GA. COLD FORMED STEEL STUDS AT 16" O.C. AT ALL INTERIOR PARTITIONS, U.N.O. (18GA. WHEN HEIGHT EXCEEDS MANUF. LIMITATIONS), MAINTAIN 6" COLD FORMED STEEL STUDS AT ALL PLUMBING AND CHASE WALLS, U.N.O. (VERIFY WITH PLANS AND WALL TYPE SHEET).
2. ALL DIMENSIONS ARE TO FACE OF FINISH MATERIAL, U.N.O.
3. PROVIDE AND INSTALL SEALANT AT INTERSECTION OF ALL GYPSUM BOARD PARTITIONS AND MASONRY/CONCRETE WALLS, (BOTH SIDES OF PARTITIONS).
4. VERIFY SIZE AND LOCATION OF MECHANICAL AND ELECTRICAL EQUIPMENT, PADS, PENETRATIONS AND SUPPORTS WITH MECHANICAL AND ELECTRICAL DRAWINGS.
5. SLOPE FLOORS TO DRAINS AT 1/8" PER FOOT MINIMUM WHILE KEEPING FLOOR LEVEL AT WALL BASE CONDITION. (DO NOT EXCEED 2% SLOPE IN ANY DIRECTION). REFER TO STRUCTURAL FOR ADDITIONAL INFORMATION.
6. PROVIDE AND INSTALL A FULLY AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13, STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS, WITH APPROVED COMPONENTS, DEVICES AND EQUIPMENT TO PROVIDE COMPLETE COVERAGE OF ALL PORTIONS OF THE BUILDING. THE FIRE SUPPRESSION HEADS MUST BE QUICK RESPONSE SPRINKLER HEADS THROUGHOUT THE LIGHT HAZARD PORTIONS, AND STANDARD RESPONSE AT ALL OTHER LOCATIONS. PROVIDE HIGH TEMPERATURE RATED HEADS PER NFPA 13.
7. PLANS INDICATE MINIMUM REQUIREMENTS FOR FIRE EXTINGUISHERS, PROVIDE ADDITIONAL EXTINGUISHERS IF REQUIRED BY AUTHORITY HAVING JURISDICTION. FIRE EXTINGUISHERS TO COMPLY WITH NFPA 10.
8. COORDINATE ALL METER LOCATIONS WITH CIVIL, PLUMBING AND ELECTRICAL DRAWINGS.
9. COORDINATE TRANSFORMER PAD LOCATION WITH CIVIL AND ELECTRICAL DRAWINGS.
10. TO THE MAXIMUM EXTENT POSSIBLE, FLOOR CLEAN-OUTS ARE TO BE LOCATED IN INCONSPICUOUS LOCATIONS. ALL FLOOR CLEAN-OUTS LOCATED IN AREAS WITH FINISH FLOORING ARE TO BE FITTED WITH FINISH FLOORING INSERTS. ALL CLEAN-OUTS ARE TO BE FLUSH WITH FLOORS/WALLS.
11. WATER CLOSET WASTE LINES ARE TO BE LOCATED IN WALL CHASE, NOT IN EXTERIOR WALLS.
12. REFER TO SHEET A.700'S FOR ROOM FINISH, DOOR & WINDOW SCHEDULES.
13. SEE SHEET A.720'S FOR WALL TYPES AND RATED ASSEMBLIES.
14. SEE SHEET A.800'S FOR REFLECTED CEILING PLANS.
15. REFER TO SHEET A-001 FOR MOUNTING HEIGHTS.
16. REFER TO PROJECT SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

WALL LEGEND:

STUD INTERIOR WALL W/ GYP.BD (EXISTING TO REMAIN)	
STUD INTERIOR WALL W/ GYP.BD (W/ S.A.B.)	
STUD INTERIOR WALL FURRING W/ GYP.BD (ON MASONRY WALL)	
MASONRY WALL	
MASONRY VENEER OVER AIRSPACE AND CONTINUOUS INSULATION ON W/ WRB OVER MASONRY WALL	
CONCRETE WALL	
INSULATED METAL PANELS OVER AIRSPACE ON HAT CHANNELS OVER CMU WALL	

**NOTE: WALL LEGEND SHOWN FOR GRAPHICAL REFERENCE ONLY. REFER TO WALL TYPES AND SECTIONS FOR ADDITIONAL DETAILS AND INFORMATION.

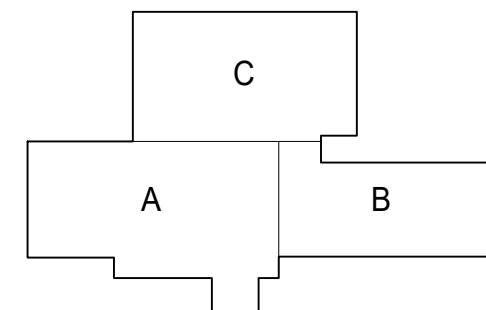

MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

STATE OF MICHIGAN
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR




RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

SHEET TITLE: OVERALL LOWER LEVEL PLAN

DESIGNED	NCHL	DATE
DRAWN	NCHL	01/15/26
CHECKED	TM	☒
APPROVED	RMR	☐

IDENTIFICATION NO:	ISSUED FOR:
PROJECT NO: 25510.A	PRELIMINARY ☐ 01/15/26
DRAWN: 252285007	CONSTRUCTION ☒
FILE NO/INDEX CODE:	FINAL RECORD ☐


A-100

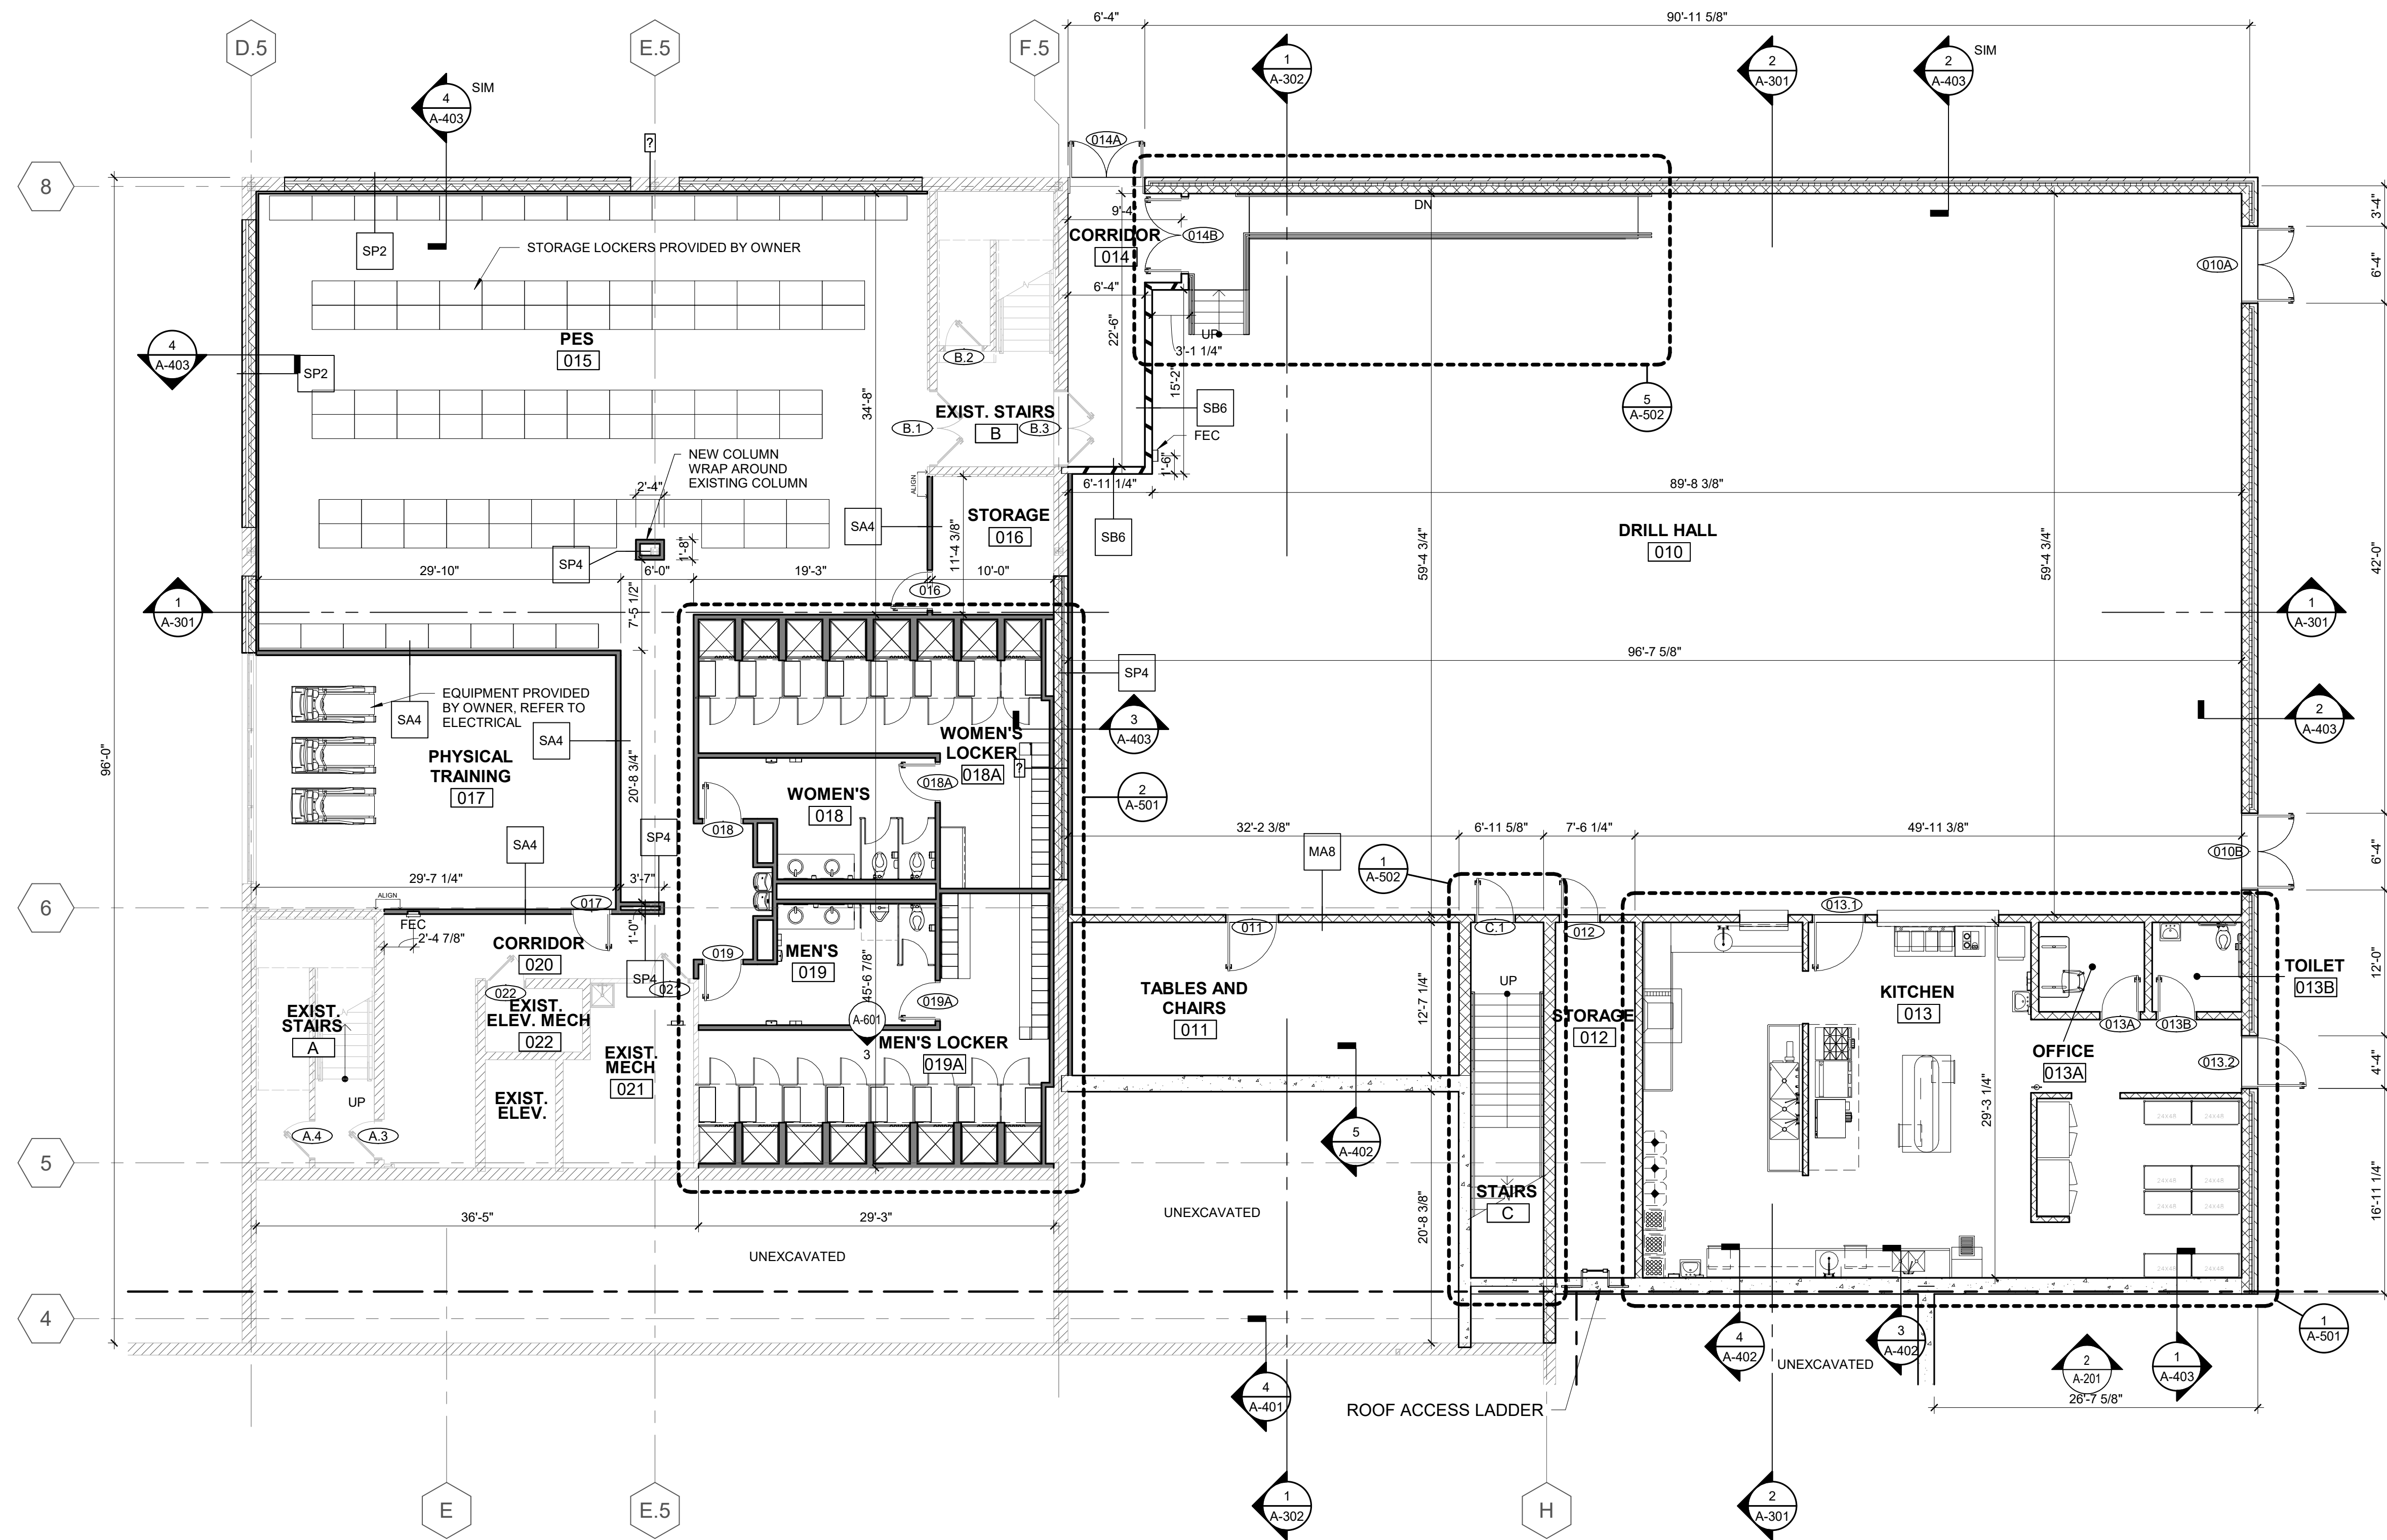

1
A-100.C
1/8" = 1'-0"

- GENERAL FLOOR PLAN NOTES:**
1. UTILIZE 20GA. COLD FORMED STEEL STUDS AT 16" O.C. AT ALL INTERIOR PARTITIONS, U.N.O. (18GA. WHEN HEIGHT EXCEEDS MANUF. LIMITATIONS). MAINTAIN 6" COLD FORMED STEEL STUDS AT ALL PLUMBING AND CHASE WALLS, U.N.O. (VERIFY WITH PLANS AND WALL TYPE SHEET).
 2. ALL DIMENSIONS ARE TO FACE OF FINISH MATERIAL, U.N.O.
 3. PROVIDE AND INSTALL SEALANT AT INTERSECTION OF ALL GYPSUM BOARD PARTITIONS AND MASONRY/CONCRETE WALLS, (BOTH SIDES OF PARTITIONS).
 4. VERIFY SIZE AND LOCATION OF MECHANICAL AND ELECTRICAL EQUIPMENT, PADS,PENETRATIONS AND SUPPORTS WITH MECHANICAL AND ELECTRICAL DRAWINGS.
 5. SLOPE FLOORS TO DRAINS AT 1/8" PER FOOT MINIMUM WHILE KEEPING FLOOR LEVEL AT WALL BASE CONDITION. (DO NOT EXCEED 2% SLOPE IN ANY DIRECTION). REFER TO STRUCTURAL FOR ADDITIONAL INFORMATION.
 6. PROVIDE AND INSTALL A FULLY AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13, STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS, WITH APPROVED COMPONENTS, DEVICES AND EQUIPMENT TO PROVIDE COMPLETE COVERAGE OF ALL PORTIONS OF THE BUILDING. THE FIRE SUPPRESSION HEADS MUST BE QUICK RESPONSE SPRINKLER HEADS THROUGHOUT THE LIGHT HAZARD PORTIONS, AND STANDARD RESPONSE AT ALL OTHER LOCATIONS. PROVIDE HIGH TEMPERATURE RATED HEADS PER NFPA 13.
 7. PLANS INDICATE MINIMUM REQUIREMENTS FOR FIRE EXTINGUISHERS. PROVIDE ADDITIONAL EXTINGUISHERS IF REQUIRED BY AUTHORITY HAVING JURISDICTION. FIRE EXTINGUISHERS TO COMPLY WITH NFPA 10.
 8. COORDINATE ALL METER LOCATIONS WITH CIVIL, PLUMBING AND ELECTRICAL DRAWINGS.
 9. COORDINATE TRANSFORMER PAD LOCATION WITH CIVIL AND ELECTRICAL DRAWINGS.
 10. TO THE MAXIMUM EXTENT POSSIBLE, FLOOR CLEAN-OUTS ARE TO BE LOCATED IN INCONSPICUOUS LOCATIONS. ALL FLOOR CLEAN-OUTS LOCATED IN AREAS WITH FINISH FLOORING ARE TO BE FITTED WITH FINISH FLOORING INSERTS. ALL CLEAN-OUTS ARE TO BE FLUSH WITH FLOORS/WALLS.
 11. WATER CLOSET WASTE LINES ARE TO BE LOCATED IN WALL CHASE, NOT IN EXTERIOR WALLS.
 12. REFER TO SHEET A.700'S FOR ROOM FINISH, DOOR & WINDOW SCHEDULES.
 13. SEE SHEET A.720'S FOR WALL TYPES AND RATED ASSEMBLIES.
 14. SEE SHEET A.800'S FOR REFLECTED CEILING PLANS.
 15. REFER TO SHEET A-001 FOR MOUNTING HEIGHTS.
 16. REFER TO PROJECT SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

WALL LEGEND:	
STUD INTERIOR WALL W/ GYP.BD (EXISTING TO REMAIN)	
STUD INTERIOR WALL W/ GYP.BD (W/ S.A.B.)	
STUD INTERIOR WALL FURRING W/ GYP.BD (ON MASONRY WALL)	
MASONRY WALL	
MASONRY VENEER OVER AIRSPACE AND CONTINUOUS INSULATION ON W/ WRB OVER MASONRY WALL	
CONCRETE WALL	
INSULATED METAL PANELS OVER AIRSPACE ON HAT CHANNELS OVER CMU WALL	
**NOTE: WALL LEGEND SHOWN FOR GRAPHICAL REFERENCE ONLY. REFER TO WALL TYPES AND SECTIONS FOR ADDITIONAL DETAILS AND INFORMATION.	

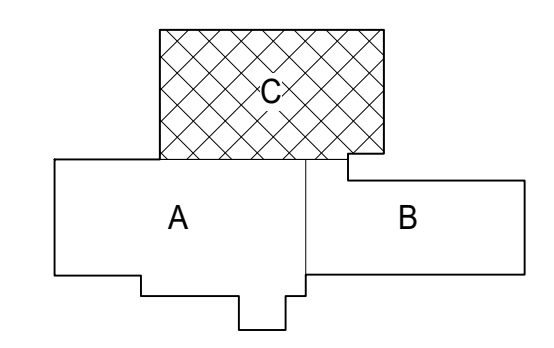

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

BTMB
Technology, Management & Budget

Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES MANAGEMENT
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR

RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI


SHEET TITLE: LOWER LEVEL PLAN - PART C

DESIGNED	HL	DATE
DRAWN <td>HLNC<td>01/15/26</td></td>	HLNC <td>01/15/26</td>	01/15/26
CHECKED <td>TM<td></td></td>	TM <td></td>	
APPROVED <td>RMR<td></td></td>	RMR <td></td>	

ISSUED FOR: PRELIMINARY [] CONSTRUCTION [X] FINAL RECORD []

IDENTIFICATION NO: PROJECT NO: 25510.A
DIVA: 25225007
FILE NO/INDEX CODE: 5172503/C&K

A-100.C

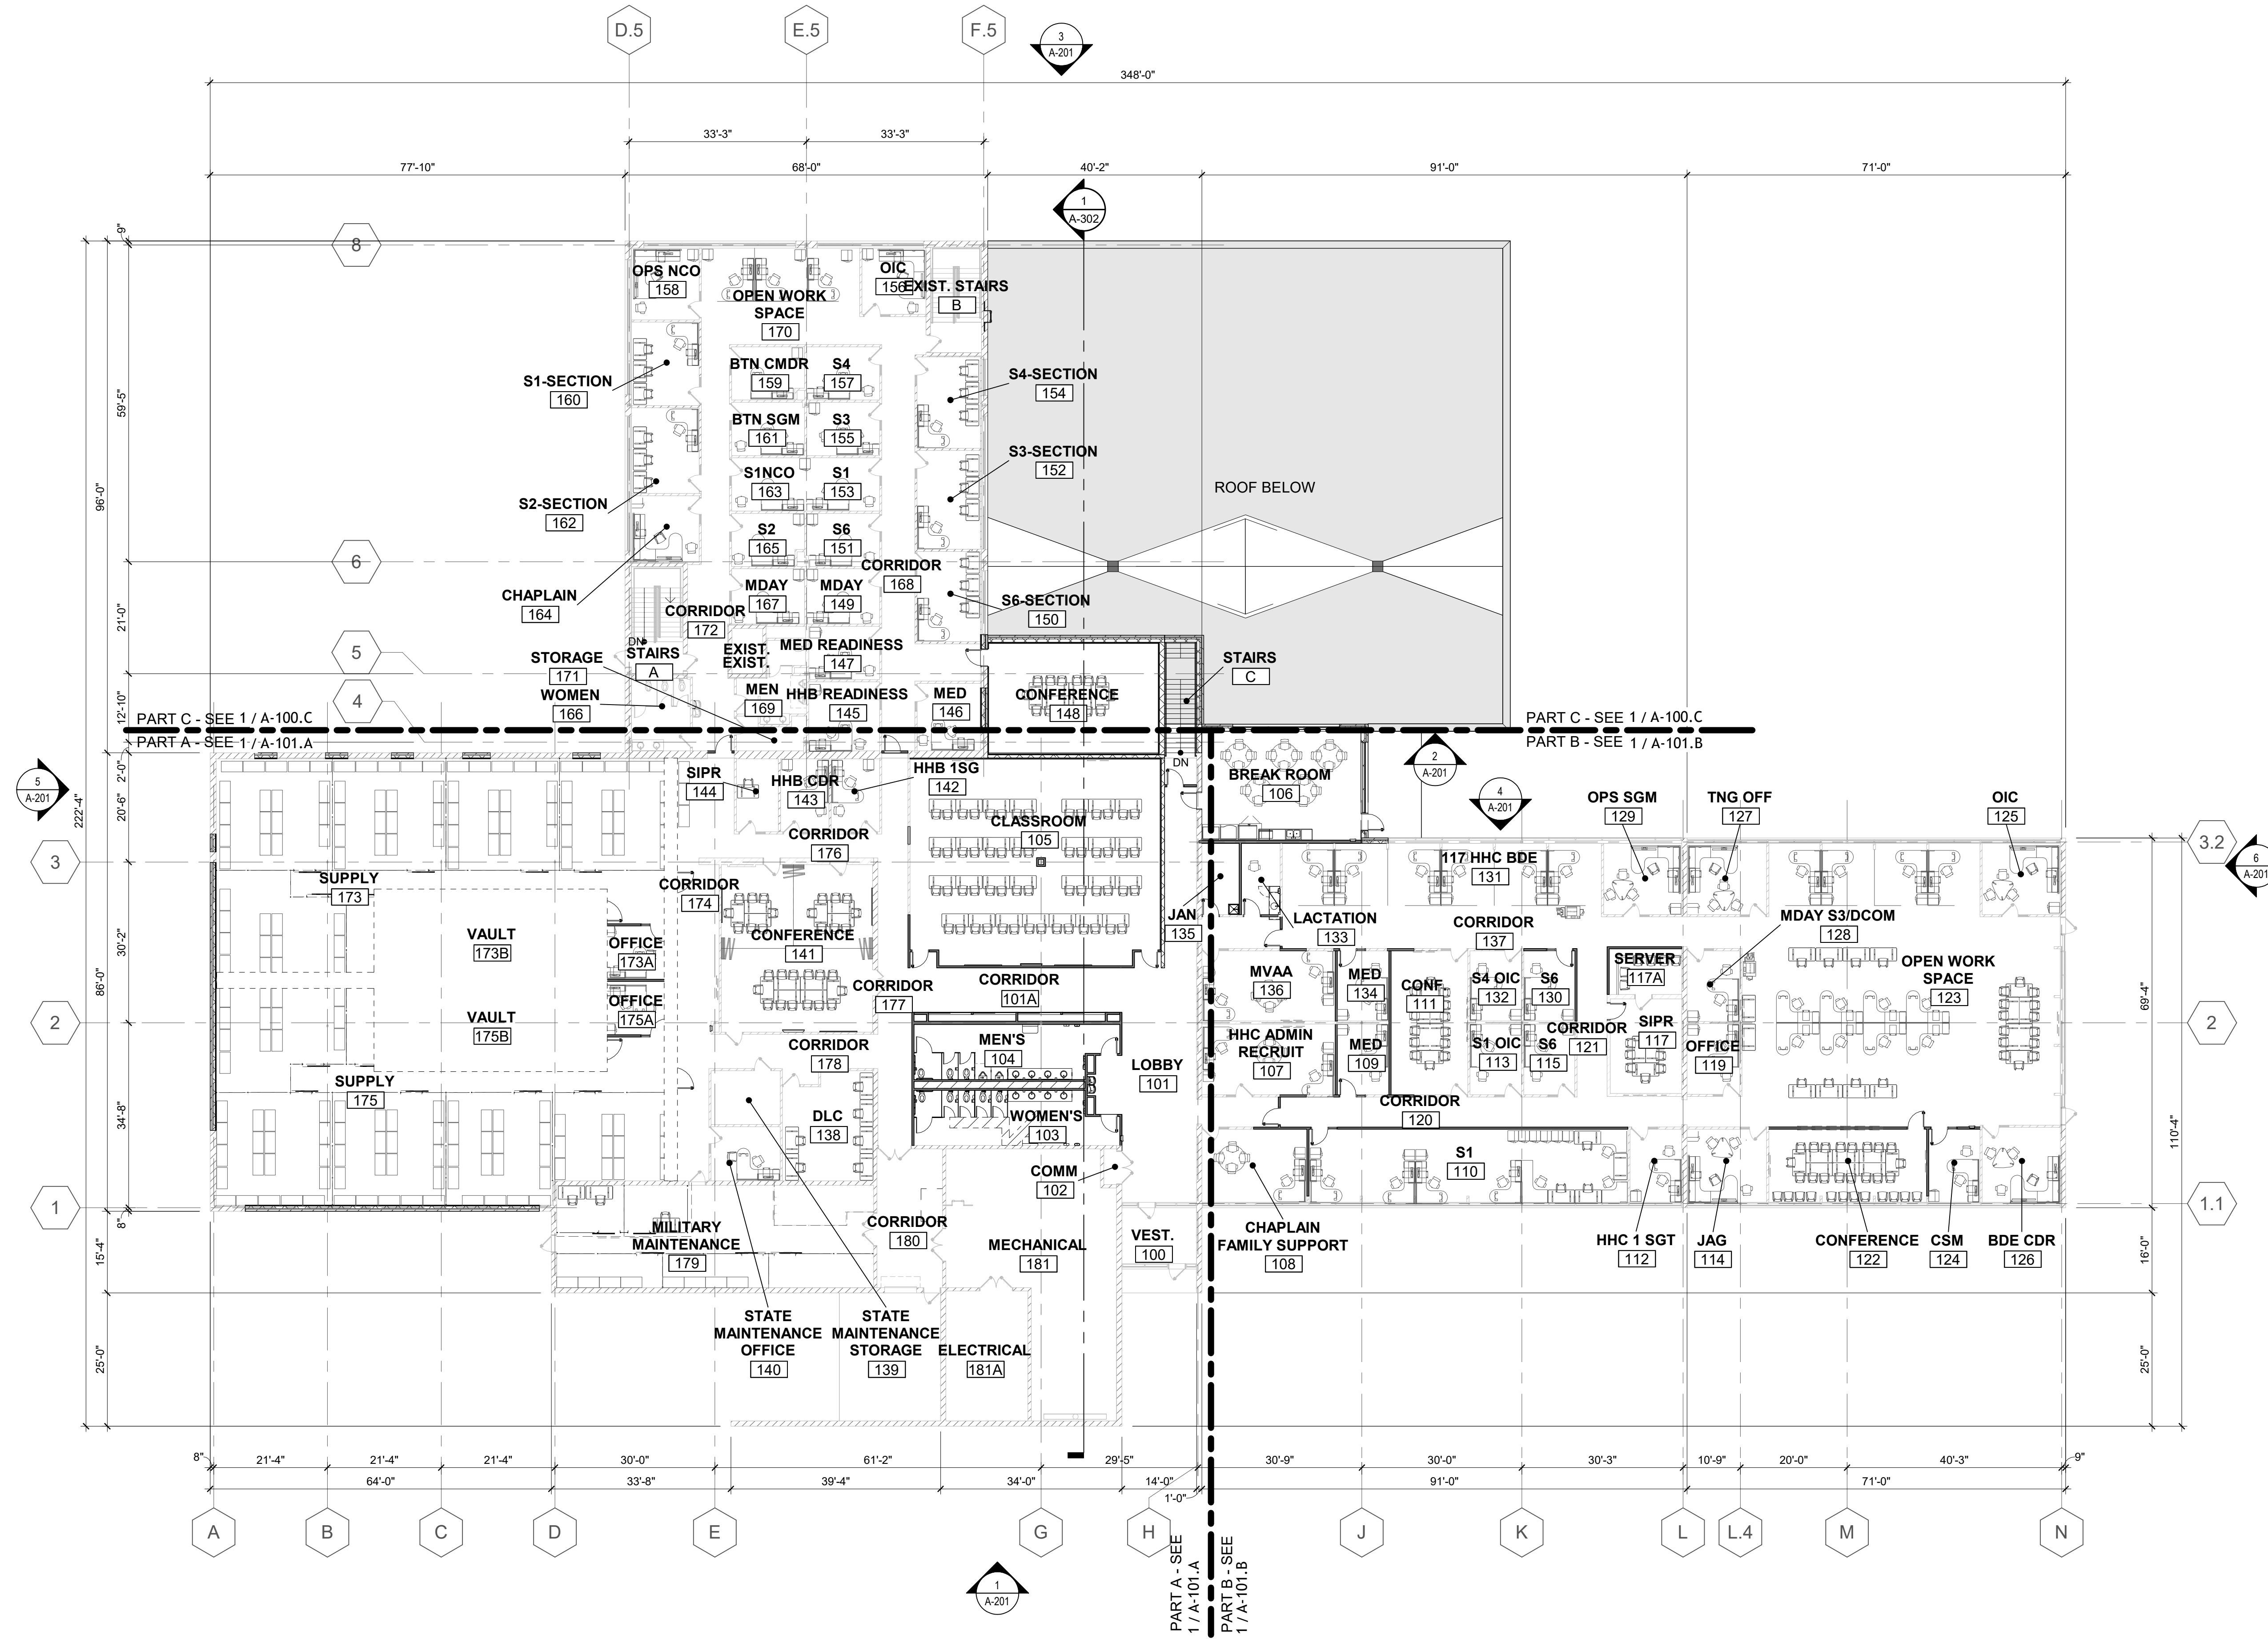


GENERAL FLOOR PLAN NOTES:

1. UTILIZE 20GA. COLD FORMED STEEL STUDS AT 16" O.C. AT ALL INTERIOR PARTITIONS, U.N.O. (18GA. WHEN HEIGHT EXCEEDS MANUF. LIMITATIONS), MAINTAIN 6" COLD FORMED STEEL STUDS AT ALL PLUMBING AND CHASE WALLS, U.N.O. (VERIFY WITH PLANS AND WALL TYPE SHEET).
2. ALL DIMENSIONS ARE TO FACE OF FINISH MATERIAL, U.N.O.
3. PROVIDE AND INSTALL SEALANT AT INTERSECTION OF ALL GYPSUM BOARD PARTITIONS AND MASONRY/CONCRETE WALLS, (BOTH SIDES OF PARTITIONS).
4. VERIFY SIZE AND LOCATION OF MECHANICAL AND ELECTRICAL EQUIPMENT, PADS, PENETRATIONS AND SUPPORTS WITH MECHANICAL AND ELECTRICAL DRAWINGS.
5. SLOPE FLOORS TO DRAINS AT 1/8" PER FOOT MINIMUM WHILE KEEPING FLOOR LEVEL AT WALL BASE CONDITION. (DO NOT EXCEED 2% SLOPE IN ANY DIRECTION). REFER TO STRUCTURAL FOR ADDITIONAL INFORMATION.
6. PROVIDE AND INSTALL A FULLY AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13, STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS, WITH APPROVED COMPONENTS, DEVICES AND EQUIPMENT TO PROVIDE COMPLETE COVERAGE OF ALL PORTIONS OF THE BUILDING. THE FIRE SUPPRESSION HEADS MUST BE QUICK RESPONSE SPRINKLER HEADS THROUGHOUT THE LIGHT HAZARD PORTIONS, AND STANDARD RESPONSE AT ALL OTHER LOCATIONS. PROVIDE HIGH TEMPERATURE RATED HEADS PER NFPA 13.
7. PLANS INDICATE MINIMUM REQUIREMENTS FOR FIRE EXTINGUISHERS, PROVIDE ADDITIONAL EXTINGUISHERS IF REQUIRED BY AUTHORITY HAVING JURISDICTION. FIRE EXTINGUISHERS TO COMPLY WITH NFPA 10.
8. COORDINATE ALL METER LOCATIONS WITH CIVIL, PLUMBING AND ELECTRICAL DRAWINGS.
9. COORDINATE TRANSFORMER PAD LOCATION WITH CIVIL AND ELECTRICAL DRAWINGS.
10. TO THE MAXIMUM EXTENT POSSIBLE, FLOOR CLEAN-OUTS ARE TO BE LOCATED IN INCONSPICUOUS LOCATIONS. ALL FLOOR CLEAN-OUTS LOCATED IN AREAS WITH FINISH FLOORING ARE TO BE FITTED WITH FINISH FLOORING INSERTS. ALL CLEAN-OUTS ARE TO BE FLUSH WITH FLOORS/WALLS.
11. WATER CLOSET WASTE LINES ARE TO BE LOCATED IN WALL CHASE, NOT IN EXTERIOR WALLS.
12. REFER TO SHEET A.700'S FOR ROOM FINISH, DOOR & WINDOW SCHEDULES.
13. SEE SHEET A.720'S FOR WALL TYPES AND RATED ASSEMBLIES.
14. SEE SHEET A.800'S FOR REFLECTED CEILING PLANS.
15. REFER TO SHEET A-001 FOR MOUNTING HEIGHTS.
16. REFER TO PROJECT SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

WALL LEGEND:

STUD INTERIOR WALL W/ GYP.BD (EXISTING TO REMAIN)	
STUD INTERIOR WALL W/ GYP.BD (W/ S.A.B.)	
STUD INTERIOR WALL FURRING W/ GYP.BD (ON MASONRY WALL)	
MASONRY WALL	
MASONRY VENEER OVER AIRSPACE AND CONTINUOUS INSULATION ON W/ WRB OVER MASONRY WALL	
CONCRETE WALL	
INSULATED METAL PANELS OVER AIRSPACE ON HAT CHANNELS OVER CMU WALL	

**NOTE: WALL LEGEND SHOWN FOR GRAPHICAL REFERENCE ONLY. REFER TO WALL TYPES AND SECTIONS FOR ADDITIONAL DETAILS AND INFORMATION.

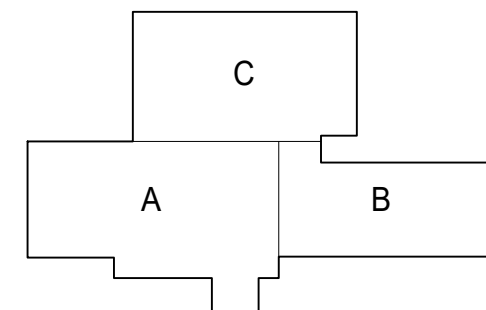

MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
PROJECT NO. 25510.A
DIVISION OF CONSTRUCTION
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, P.E., DIRECTOR


RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

SHEET TITLE: OVERALL MAIN LEVEL FLOOR PLAN

A-101	SHEET	IDENTIFICATION NO:	ISSUED FOR:	DATE	DESIGNED	NCHL
		PROJECT NO: 25510 A	PRELIMINARY	☐	DRAWN	NCHL
		DMA: 2623825007	CONSTRUCTION	☒	CHECKED	TM
		FILE NO./INDEX CODE:	FINAL RECORD		APPROVED	RMR

IDENTIFICATION NO:	ISSUED FOR:	DATE
PROJECT NO: 25510.A	PRELIMINARY	01/15/26
DRAWN: 252285007	CONSTRUCTION	
FILE NO/INDEX CODE:	FINAL RECORD	

A-101

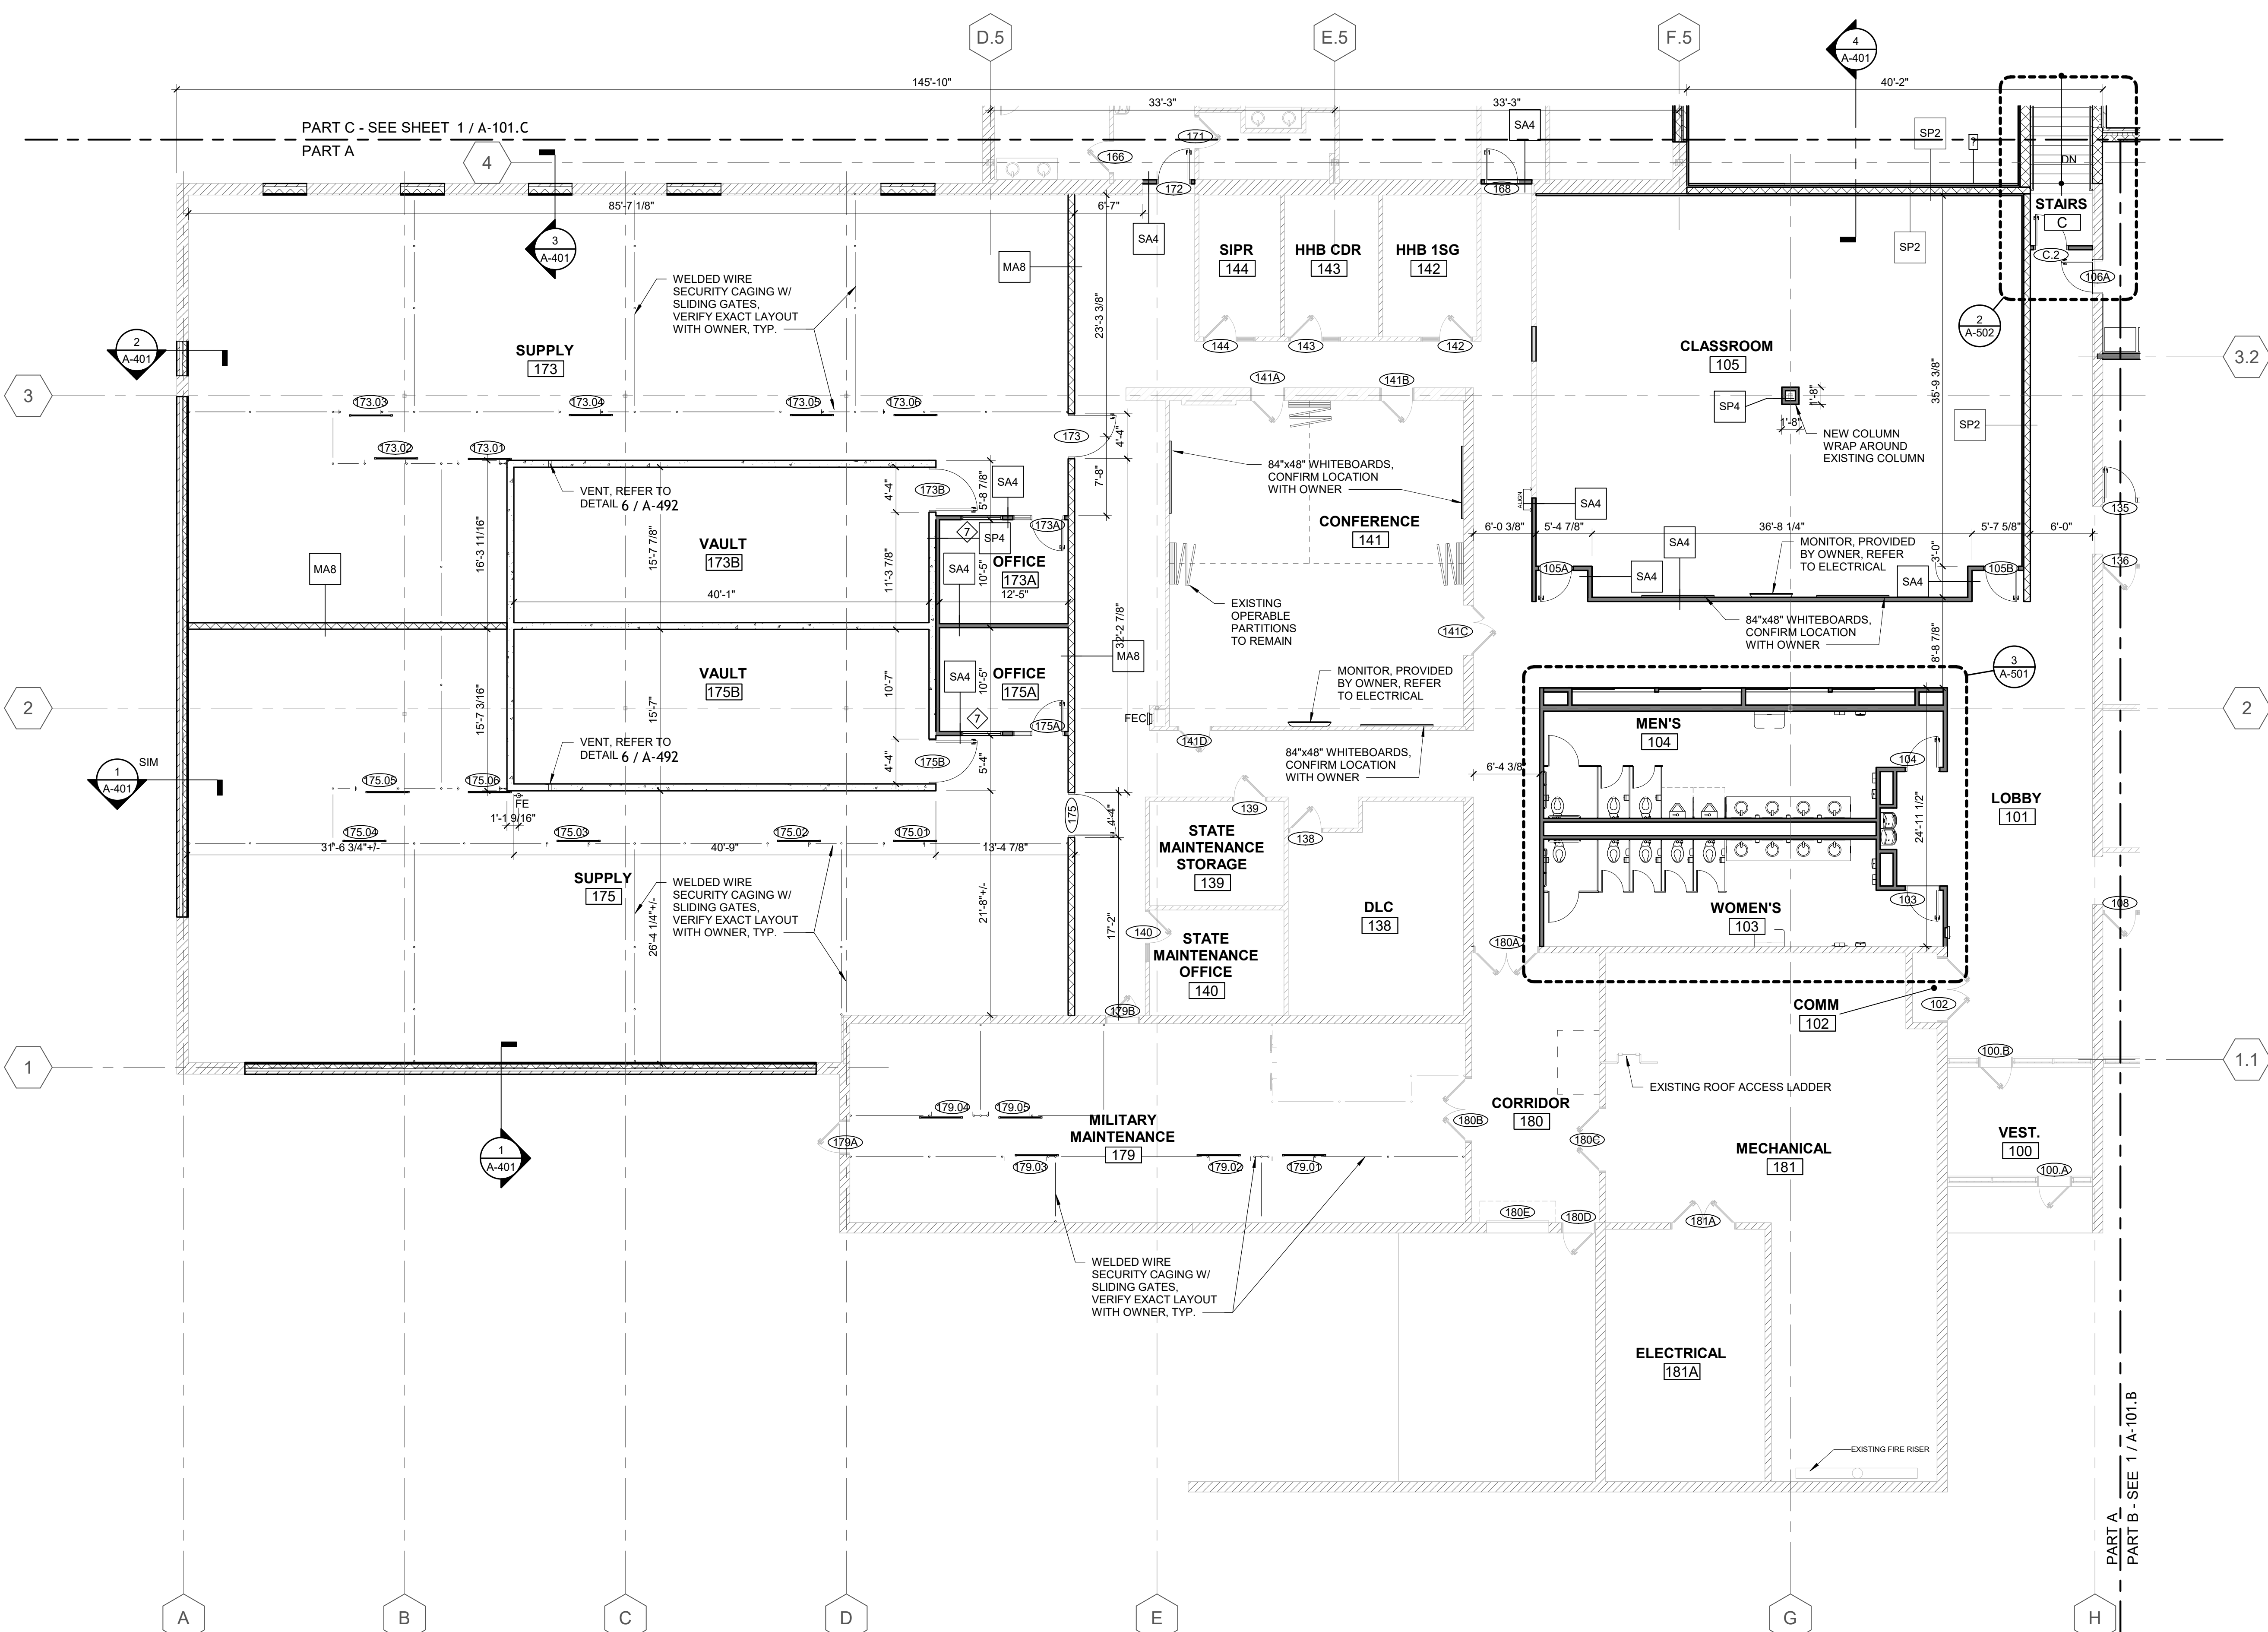


MAIN LEVEL FLOOR PLAN - PART A
1/8" = 1'-0"

- ### GENERAL FLOOR PLAN NOTES:
- UTILIZE 20GA. COLD FORMED STEEL STUDS AT 16" O.C. AT ALL INTERIOR PARTITIONS, U.N.O. (18GA. WHEN HEIGHT EXCEEDS MANUF. LIMITATIONS). MAINTAIN 6" COLD FORMED STEEL STUDS AT ALL PLUMBING AND CHASE WALLS, U.N.O. (VERIFY WITH PLANS AND WALL TYPE SHEET).
 - ALL DIMENSIONS ARE TO FACE OF FINISH MATERIAL, U.N.O.
 - PROVIDE AND INSTALL SEALANT AT INTERSECTION OF ALL GYPSUM BOARD PARTITIONS AND MASONRY/CONCRETE WALLS, (BOTH SIDES OF PARTITIONS).
 - VERIFY SIZE AND LOCATION OF MECHANICAL AND ELECTRICAL EQUIPMENT, PADS, PENETRATIONS AND SUPPORTS WITH MECHANICAL AND ELECTRICAL DRAWINGS.
 - SLOPE FLOORS TO DRAINS AT 1/8" PER FOOT MINIMUM WHILE KEEPING FLOOR LEVEL AT WALL BASE CONDITION. (DO NOT EXCEED 2% SLOPE IN ANY DIRECTION). REFER TO STRUCTURAL FOR ADDITIONAL INFORMATION.
 - PROVIDE AND INSTALL A FULLY AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13, STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS, WITH APPROVED COMPONENTS, DEVICES AND EQUIPMENT TO PROVIDE COMPLETE COVERAGE OF ALL PORTIONS OF THE BUILDING. THE FIRE SUPPRESSION SPRINKLER HEADS MUST BE QUICK RESPONSE SPRINKLER HEADS THROUGHOUT THE LIGHT HAZARD PORTIONS, AND STANDARD RESPONSE AT ALL OTHER LOCATIONS. PROVIDE HIGH TEMPERATURE RATED HEADS PER NFPA 13.
 - PLANS INDICATE MINIMUM REQUIREMENTS FOR FIRE EXTINGUISHERS. PROVIDE ADDITIONAL EXTINGUISHERS IF REQUIRED BY AUTHORITY HAVING JURISDICTION. FIRE EXTINGUISHERS TO COMPLY WITH NFPA 10.
 - COORDINATE ALL METER LOCATIONS WITH CIVIL, PLUMBING AND ELECTRICAL DRAWINGS.
 - COORDINATE TRANSFORMER PAD LOCATION WITH CIVIL AND ELECTRICAL DRAWINGS.
 - TO THE MAXIMUM EXTENT POSSIBLE, FLOOR CLEAN-OUTS ARE TO BE LOCATED IN INCONSPICUOUS LOCATIONS. ALL FLOOR CLEAN-OUTS LOCATED IN AREAS WITH FINISH FLOORING ARE TO BE FITTED WITH FINISH FLOORING INSERTS. ALL CLEAN-OUTS ARE TO BE FLUSH WITH FLOORS/WALLS.
 - WATER CLOSET WASTE LINES ARE TO BE LOCATED IN WALL CHASE, NOT IN EXTERIOR WALLS.
 - REFER TO SHEET A.700'S FOR ROOM FINISH, DOOR & WINDOW SCHEDULES.
 - SEE SHEET A.720'S FOR WALL TYPES AND RATED ASSEMBLIES.
 - SEE SHEET A.800'S FOR REFLECTED CEILING PLANS.
 - REFER TO SHEET A-001 FOR MOUNTING HEIGHTS.
 - REFER TO PROJECT SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

WALL LEGEND:

STUD INTERIOR WALL W/ GYP.BD (EXISTING TO REMAIN)	
STUD INTERIOR WALL W/ GYP.BD (W/ S.A.B.)	
STUD INTERIOR WALL FURRING W/ GYP.BD (ON MASONRY WALL)	
MASONRY WALL	
MASONRY VENEER OVER AIRSPACE AND CONTINUOUS INSULATION ON W/ WRB OVER MASONRY WALL	
CONCRETE WALL	
INSULATED METAL PANELS OVER AIRSPACE ON HAT CHANNELS OVER CMU WALL	

**NOTE: WALL LEGEND SHOWN FOR GRAPHICAL REFERENCE ONLY. REFER TO WALL TYPES AND SECTIONS FOR ADDITIONAL DETAILS AND INFORMATION.

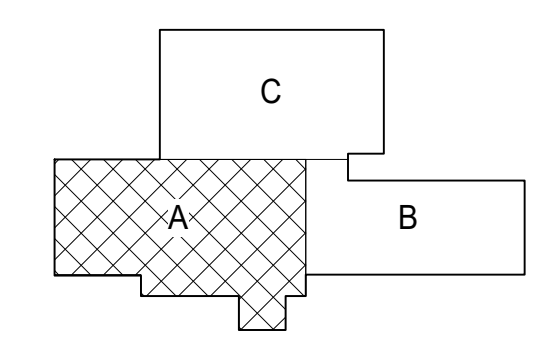

MISSDIG811

FOR SITE OWNED UTILITIES

BEFORE YOU DIG
72 HOURS (3 WORKING DAYS)
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

BTMB
Technology, Management & Budget


Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES MANAGEMENT DIVISION
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR

RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

SHEET TITLE: MAIN LEVEL FLOOR PLAN - PART A	DESIGNED: HL	DATE: 01/15/26
SHEET: A-101.A	DRAWN: HL	ISSUED FOR: PRELIMINARY
	CHECKED: TM	CONSTRUCTION: [X]
	APPROVED: RMR	FINAL RECORD: []

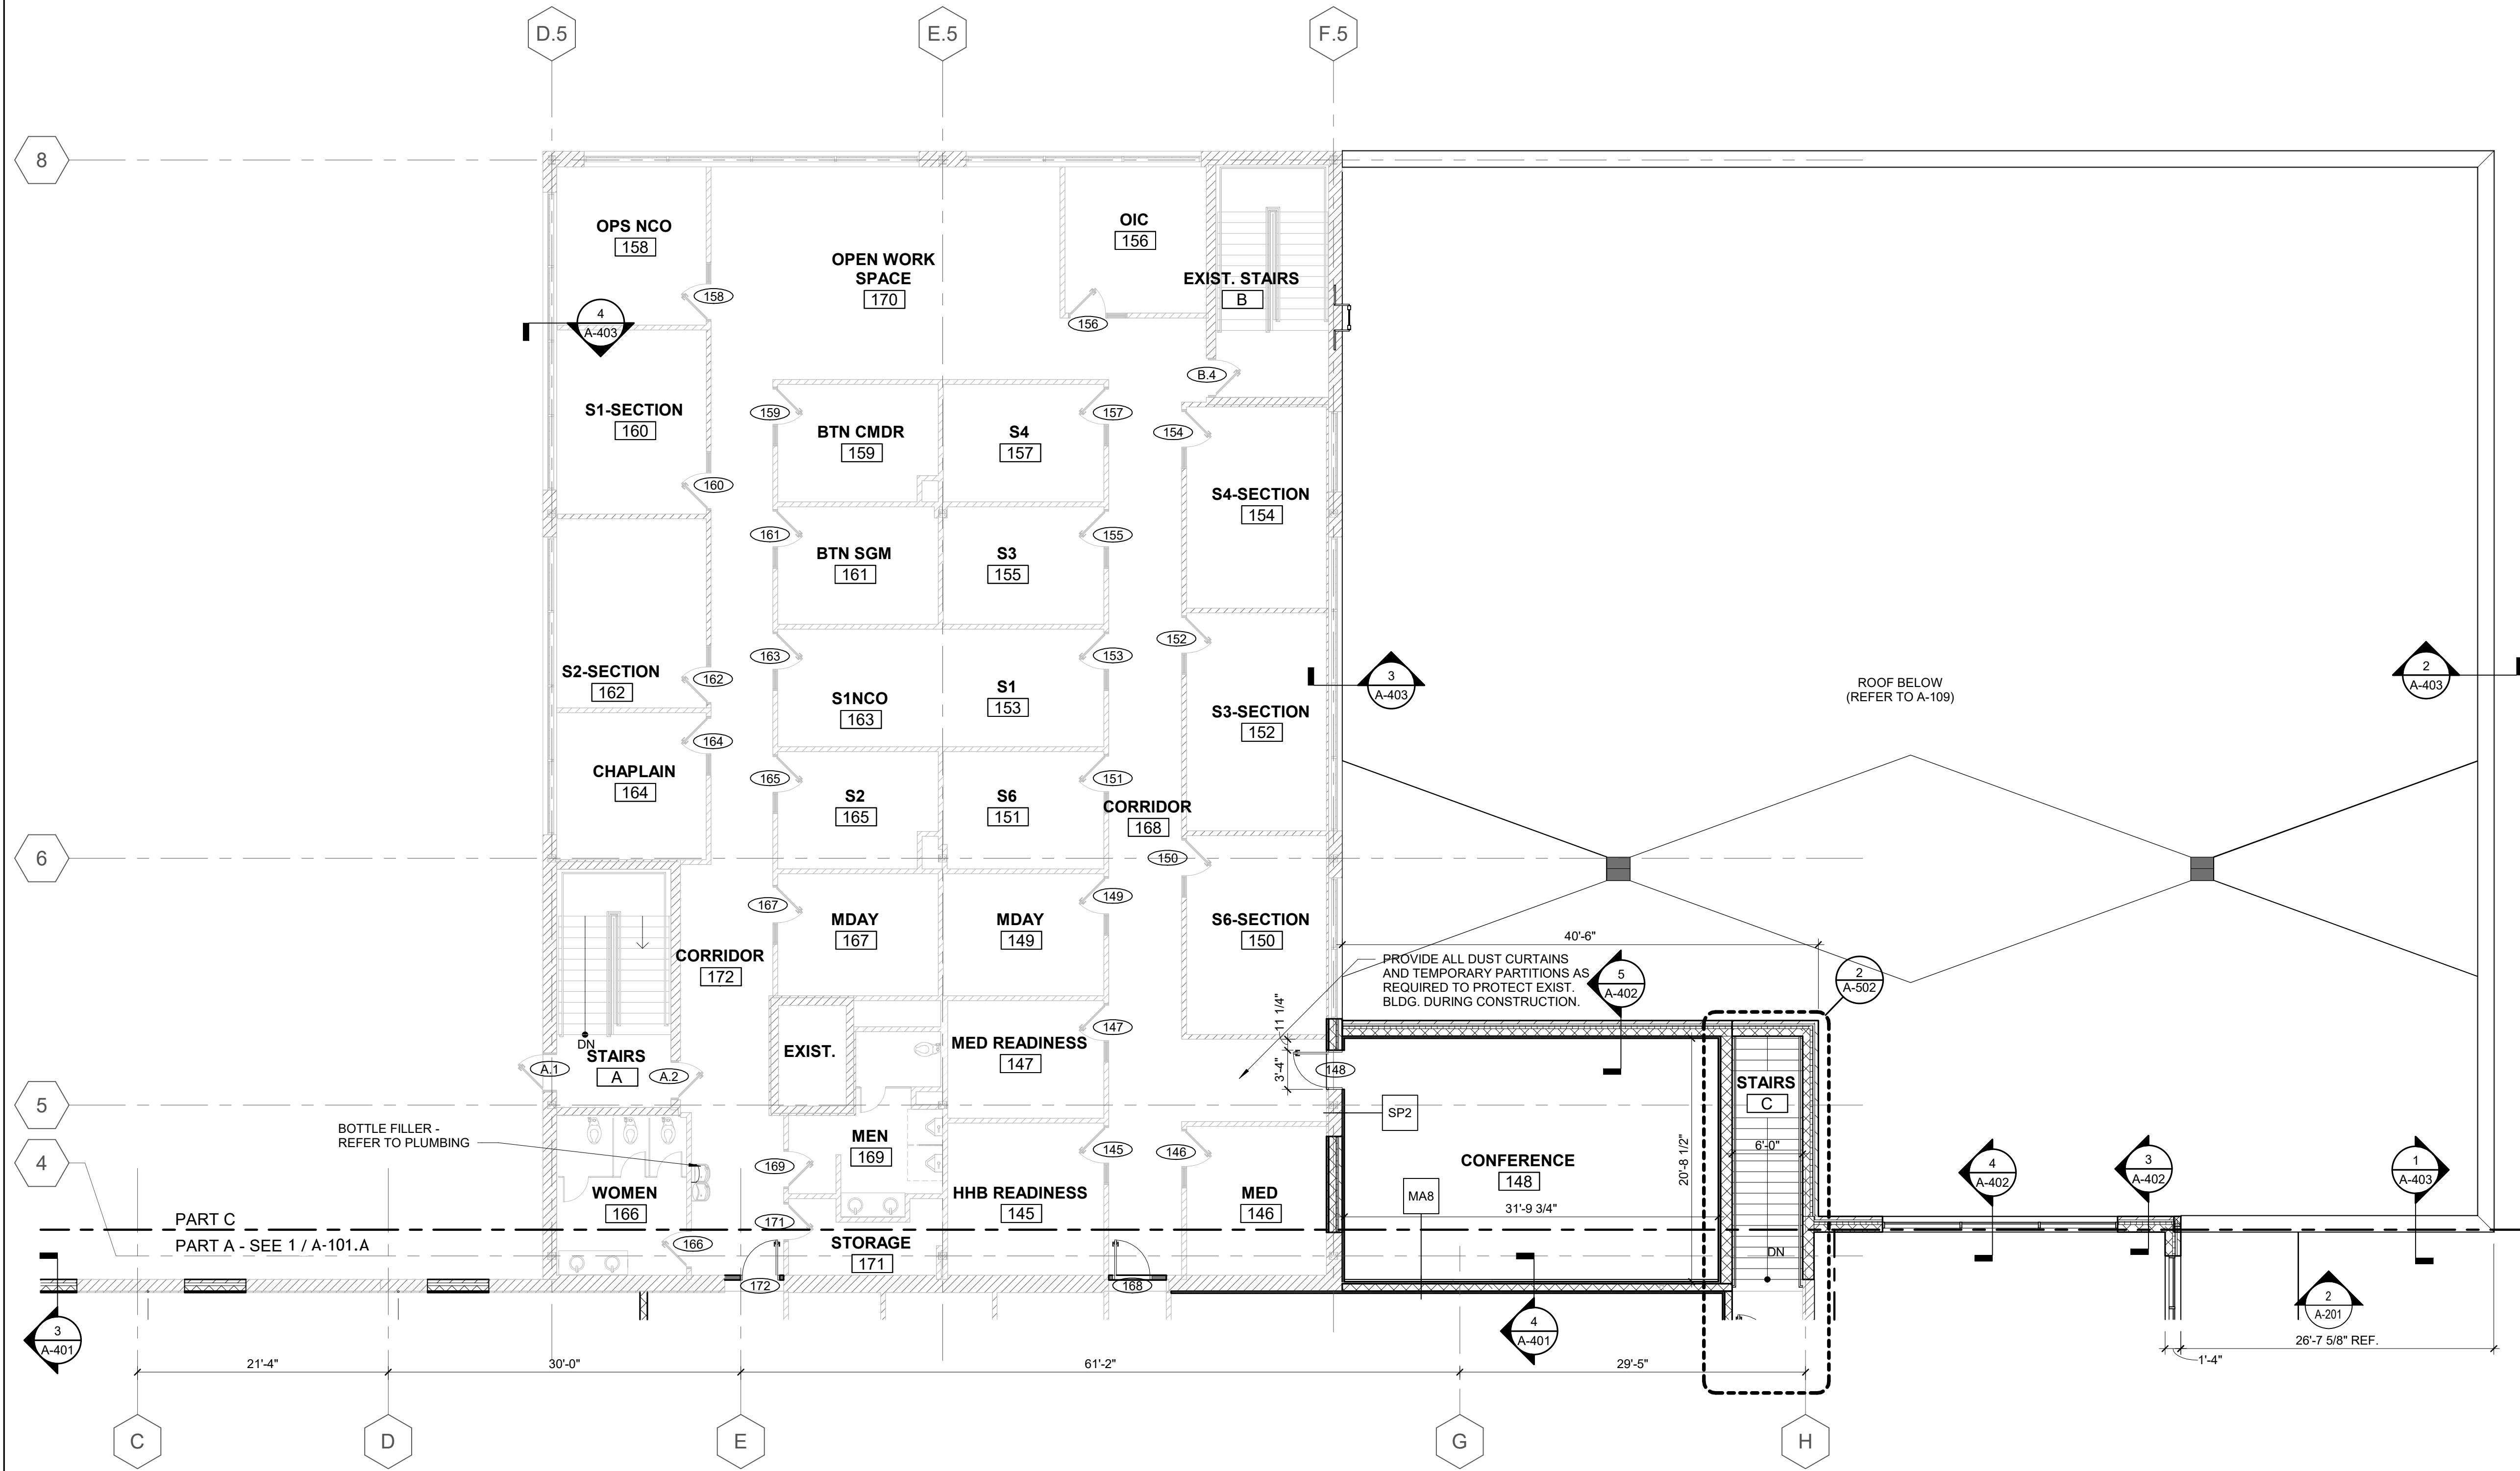

1
A-101.C
1/8" = 1'-0"


GENERAL FLOOR PLAN NOTES:

1. UTILIZE 20GA. COLD FORMED STEEL STUDS AT 16" O.C. AT ALL INTERIOR PARTITIONS, U.N.O. (18GA. WHEN HEIGHT EXCEEDS MANUF. LIMITATIONS), MAINTAIN 6" COLD FORMED STEEL STUDS AT ALL PLUMBING AND CHASE WALLS, U.N.O. (VERIFY WITH PLANS AND WALL TYPE SHEET).
2. ALL DIMENSIONS ARE TO FACE OF FINISH MATERIAL, U.N.O.
3. PROVIDE AND INSTALL SEALANT AT INTERSECTION OF ALL GYPSUM BOARD PARTITIONS AND MASONRY/CONCRETE WALLS, (BOTH SIDES OF PARTITIONS).
4. VERIFY SIZE AND LOCATION OF MECHANICAL AND ELECTRICAL EQUIPMENT, PADS, PENETRATIONS AND SUPPORTS WITH MECHANICAL AND ELECTRICAL DRAWINGS.
5. SLOPE FLOORS TO DRAINS AT 1/8" PER FOOT MINIMUM WHILE KEEPING FLOOR LEVEL AT WALL BASE CONDITION. (DO NOT EXCEED 2% SLOPE IN ANY DIRECTION). REFER TO STRUCTURAL FOR ADDITIONAL INFORMATION.
6. PROVIDE AND INSTALL A FULLY AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA 13, STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS, WITH APPROVED COMPONENTS, DEVICES AND EQUIPMENT TO PROVIDE COMPLETE COVERAGE OF ALL PORTIONS OF THE BUILDING. THE FIRE SUPPRESSION HEADS MUST BE QUICK RESPONSE SPRINKLER HEADS THROUGHOUT THE LIGHT HAZARD PORTIONS, AND STANDARD RESPONSE AT ALL OTHER LOCATIONS. PROVIDE HIGH TEMPERATURE RATED HEADS PER NFPA 13.
7. PLANS INDICATE MINIMUM REQUIREMENTS FOR FIRE EXTINGUISHERS, PROVIDE ADDITIONAL EXTINGUISHERS IF REQUIRED BY AUTHORITY HAVING JURISDICTION. FIRE EXTINGUISHERS TO COMPLY WITH NFPA 10.
8. COORDINATE ALL METER LOCATIONS WITH CIVIL, PLUMBING AND ELECTRICAL DRAWINGS.
9. COORDINATE TRANSFORMER PAD LOCATION WITH CIVIL AND ELECTRICAL DRAWINGS.
10. TO THE MAXIMUM EXTENT POSSIBLE, FLOOR CLEAN-OUTS ARE TO BE LOCATED IN INCONSPICUOUS LOCATIONS. ALL FLOOR CLEAN-OUTS LOCATED IN AREAS WITH FINISH FLOORING ARE TO BE FITTED WITH FINISH FLOORING INSERTS. ALL CLEAN-OUTS ARE TO BE FLUSH WITH FLOORS/WALLS.
11. WATER CLOSET WASTE LINES ARE TO BE LOCATED IN WALL CHASE, NOT IN EXTERIOR WALLS.
12. REFER TO SHEET A.700'S FOR ROOM FINISH, DOOR & WINDOW SCHEDULES.
13. SEE SHEET A.720'S FOR WALL TYPES AND RATED ASSEMBLIES.
14. SEE SHEET A.800'S FOR REFLECTED CEILING PLANS.
15. REFER TO SHEET A-001 FOR MOUNTING HEIGHTS.
16. REFER TO PROJECT SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

WALL LEGEND:

STUD INTERIOR WALL W/ GYP.BD (EXISTING TO REMAIN)	
STUD INTERIOR WALL W/ GYP.BD (W/ S.A.B.)	
STUD INTERIOR WALL FURRING W/ GYP.BD (ON MASONRY WALL)	
MASONRY WALL	
MASONRY VENEER OVER AIRSPACE AND CONTINUOUS INSULATION ON W/ WRB OVER MASONRY WALL	
CONCRETE WALL	
INSULATED METAL PANELS OVER AIRSPACE ON HAT CHANNELS OVER CMU WALL	

**NOTE: WALL LEGEND SHOWN FOR GRAPHICAL REFERENCE ONLY. REFER TO WALL TYPES AND SECTIONS FOR ADDITIONAL DETAILS AND INFORMATION.

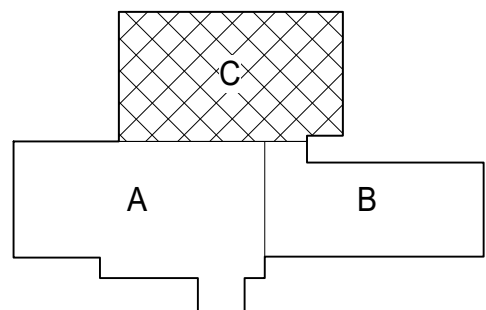

MISSDIG811

FOR SITE OWNED UTILITIES

BTMB
Technology, Management & Budget

STATE OF MICHIGAN
ARMY
NATIONAL
GUARD

Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

BEFORE YOU DIG
72 HOURS
(3 WORKING DAYS)
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES MANAGEMENT
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR

RENOVATE ARMORY, JACKSON (WEST) ARMORY

DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

DESIGNED	HL
DRAWN	HLNC
CHECKED	TM
APPROVED	RMR

SHEET TITLE: MAIN LEVEL FLOOR PLAN - PART C


SHEET NO: 25510.A

PROJECT NO: 25510.A

DRAWN BY: 252285007

FILE NO / INDEX CODE: 517/25039.CAK


A-101.C

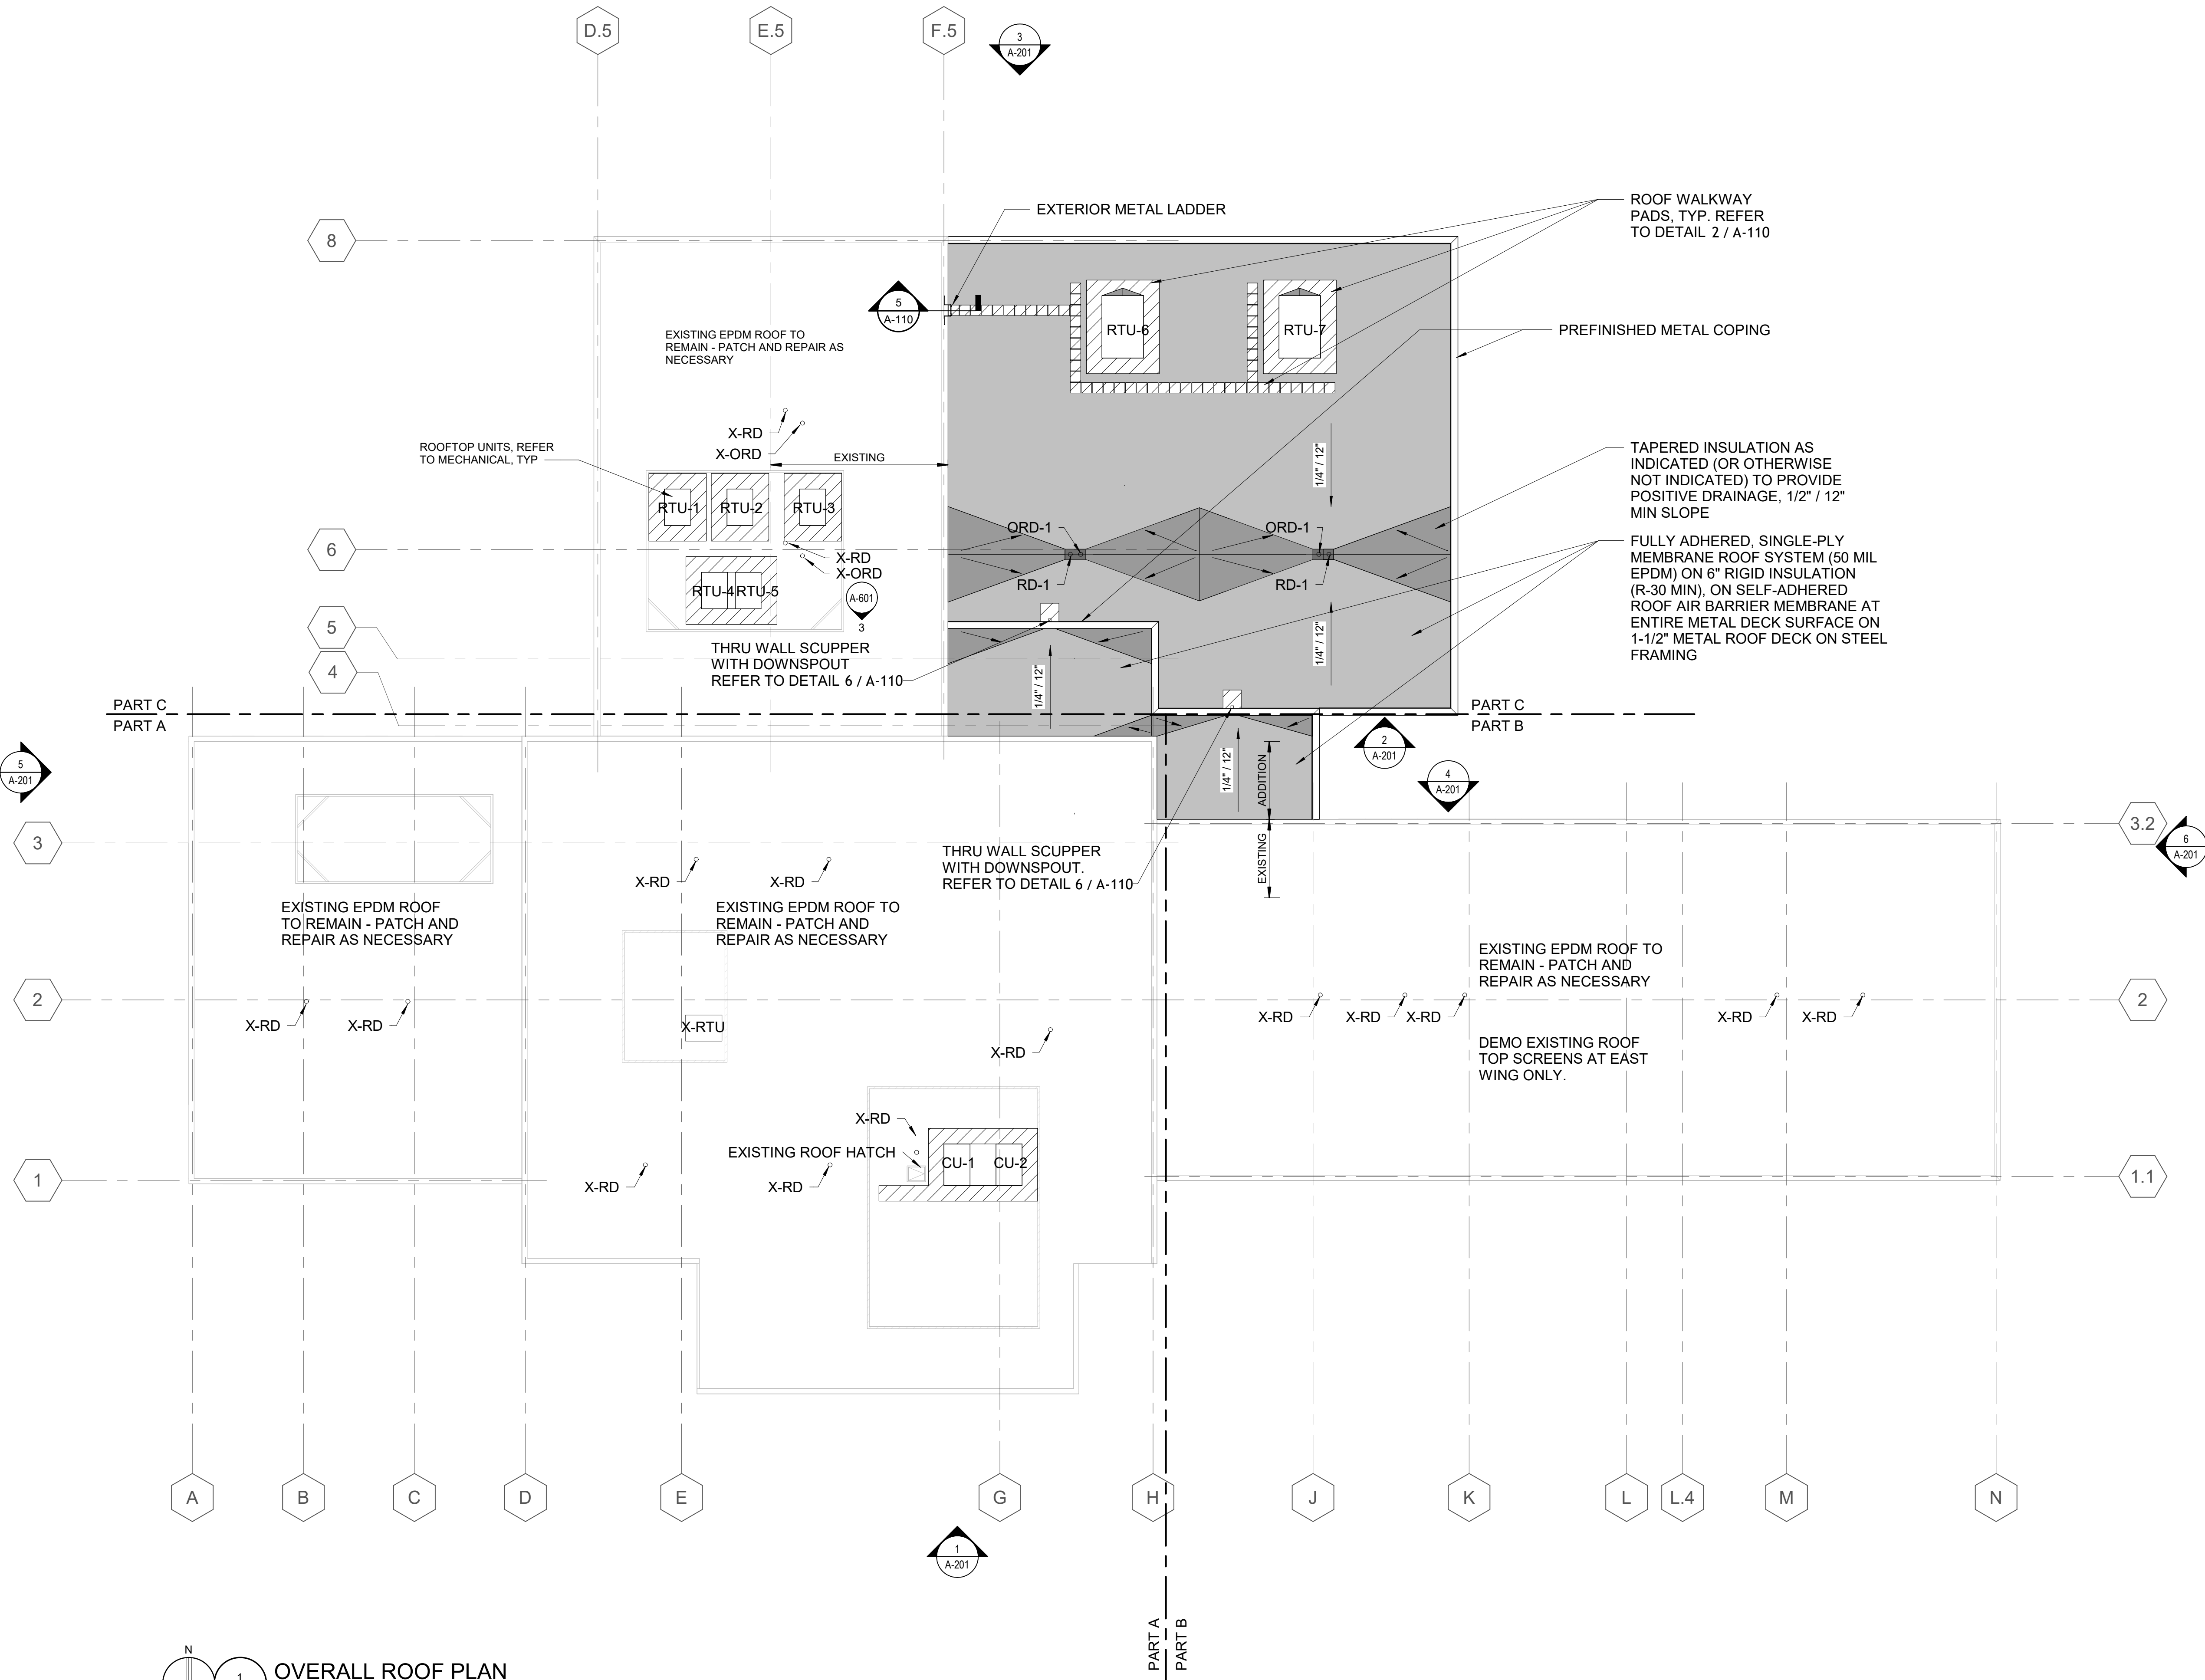

OVERALL ROOF PLAN
1 A-109
1/16" = 1'-0"

ROOF PLAN LEGEND	
	D.S. DOWNSPOUT
	ROOF WALKWAY PADS
	ROOF ACCESS HATCH
	ROOF DRAIN (R.D.) AND ROOF DRAIN OVERFLOW (R.D.O.)
	EXHAUST FAN (E.F.) - REFER TO MECHANICAL DRAWINGS
	FULLY ADHERED SINGLE-PLY MEMBRANE ROOF SYSTEM (EPDM) ON 1/4" ROOF PROTECTION ON RIGID POLYISO INSULATION (R-30 MIN)
	TAPERED ROOF INSULATION

- ROOF NOTES**
- CONTRACTOR TO COORDINATE LOCATION OF ALL EXHAUST AND INTAKE LOUVERS INCLUDING BATHROOM/TOILET ROOM EXHAUST FANS, ETC. W/MECHANICAL DRAWINGS.
 - ALL ROOFTOP PENETRATIONS INCLUDING PLUMBING VENTS, MECHANICAL CURBS, AND ARCHITECTURAL CURBS, SHALL HAVE FLASHING INSTALLED PER ROOF SYSTEM MANUFACTURER.
A. AIR BARRIER TO BE FLASHED AT ALL PENETRATIONS. ALL EXTERIOR METAL TO BE GALVANIZED, FACTORY PRIMED AND PAINTED PER THE PAINTING SCHEDULE.
 - SNOW/ICE RETENTION AT METAL ROOF AREAS INDICATED FOR GENERAL DESIGN INTENT. CONTRACTOR RESPONSIBLE FOR COORDINATION AND VERIFICATION OF LOCATION AND QUANTITY W/ROOFING MANUFACTURER.
 - PROVIDE AND INSTALL PRESERVATIVE TREATED, SOLID WOOD BLOCKING AT ALL TRANSITIONS AND EDGES TO HEIGHT OF ROOF INSULATION AT MEMBRANE ROOF LOCATIONS, U.N.O., INSTALLED PER ROOF SYSTEM MANUFACTURER.
 - ALL MEMBRANE ROOFING TO BE SLOPED AT 1/4" PER FOOT MINIMUM U.N.O.
 - SADDLES ARE REQUIRED AT ALL LOCATIONS INDICATED OR OTHERWISE NOT INDICATED (I.E. MECHANICAL UNITS, EQUIPMENT CURBS, INSIDE CORNERS AT PARAPET WALLS, ETC.) IN ORDER TO PROVIDE POSITIVE ROOF DRAINAGE. SLOPE ALL SADDLES AT 1/2" PER FOOT MINIMUM U.N.O.
 - DO NOT "BRIDGE" MEMBRANE ROOFING.
 - PROVIDE AND INSTALL A ROOF WALKWAY PAD AT THE ROOF BELOW ALL MECHANICAL UNIT CONDENSATE TERMINATIONS FOR ROOF MEMBRANE PROTECTION. CONTRACTOR TO COORDINATE EXACT LOCATION IN THE FIELD.
 - PROVIDE AND INSTALL ROOF BREATHING VENTS IN MECHANICALLY FASTENED ROOFING. CONTRACTOR TO VERIFY EXACT QUANTITY AND LAYOUT W/ ROOF MANUF.
 - ALL EXTERIOR METAL TO BE GALVANIZED, FACTORY PRIMED AND PAINTED PER THE PAINTING SCHEDULE.

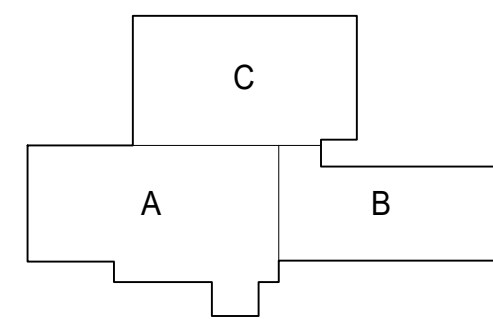

MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT




Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025


6
A-110 1 1/2" = 1'-0"

ROOF SCUPPER DETAIL

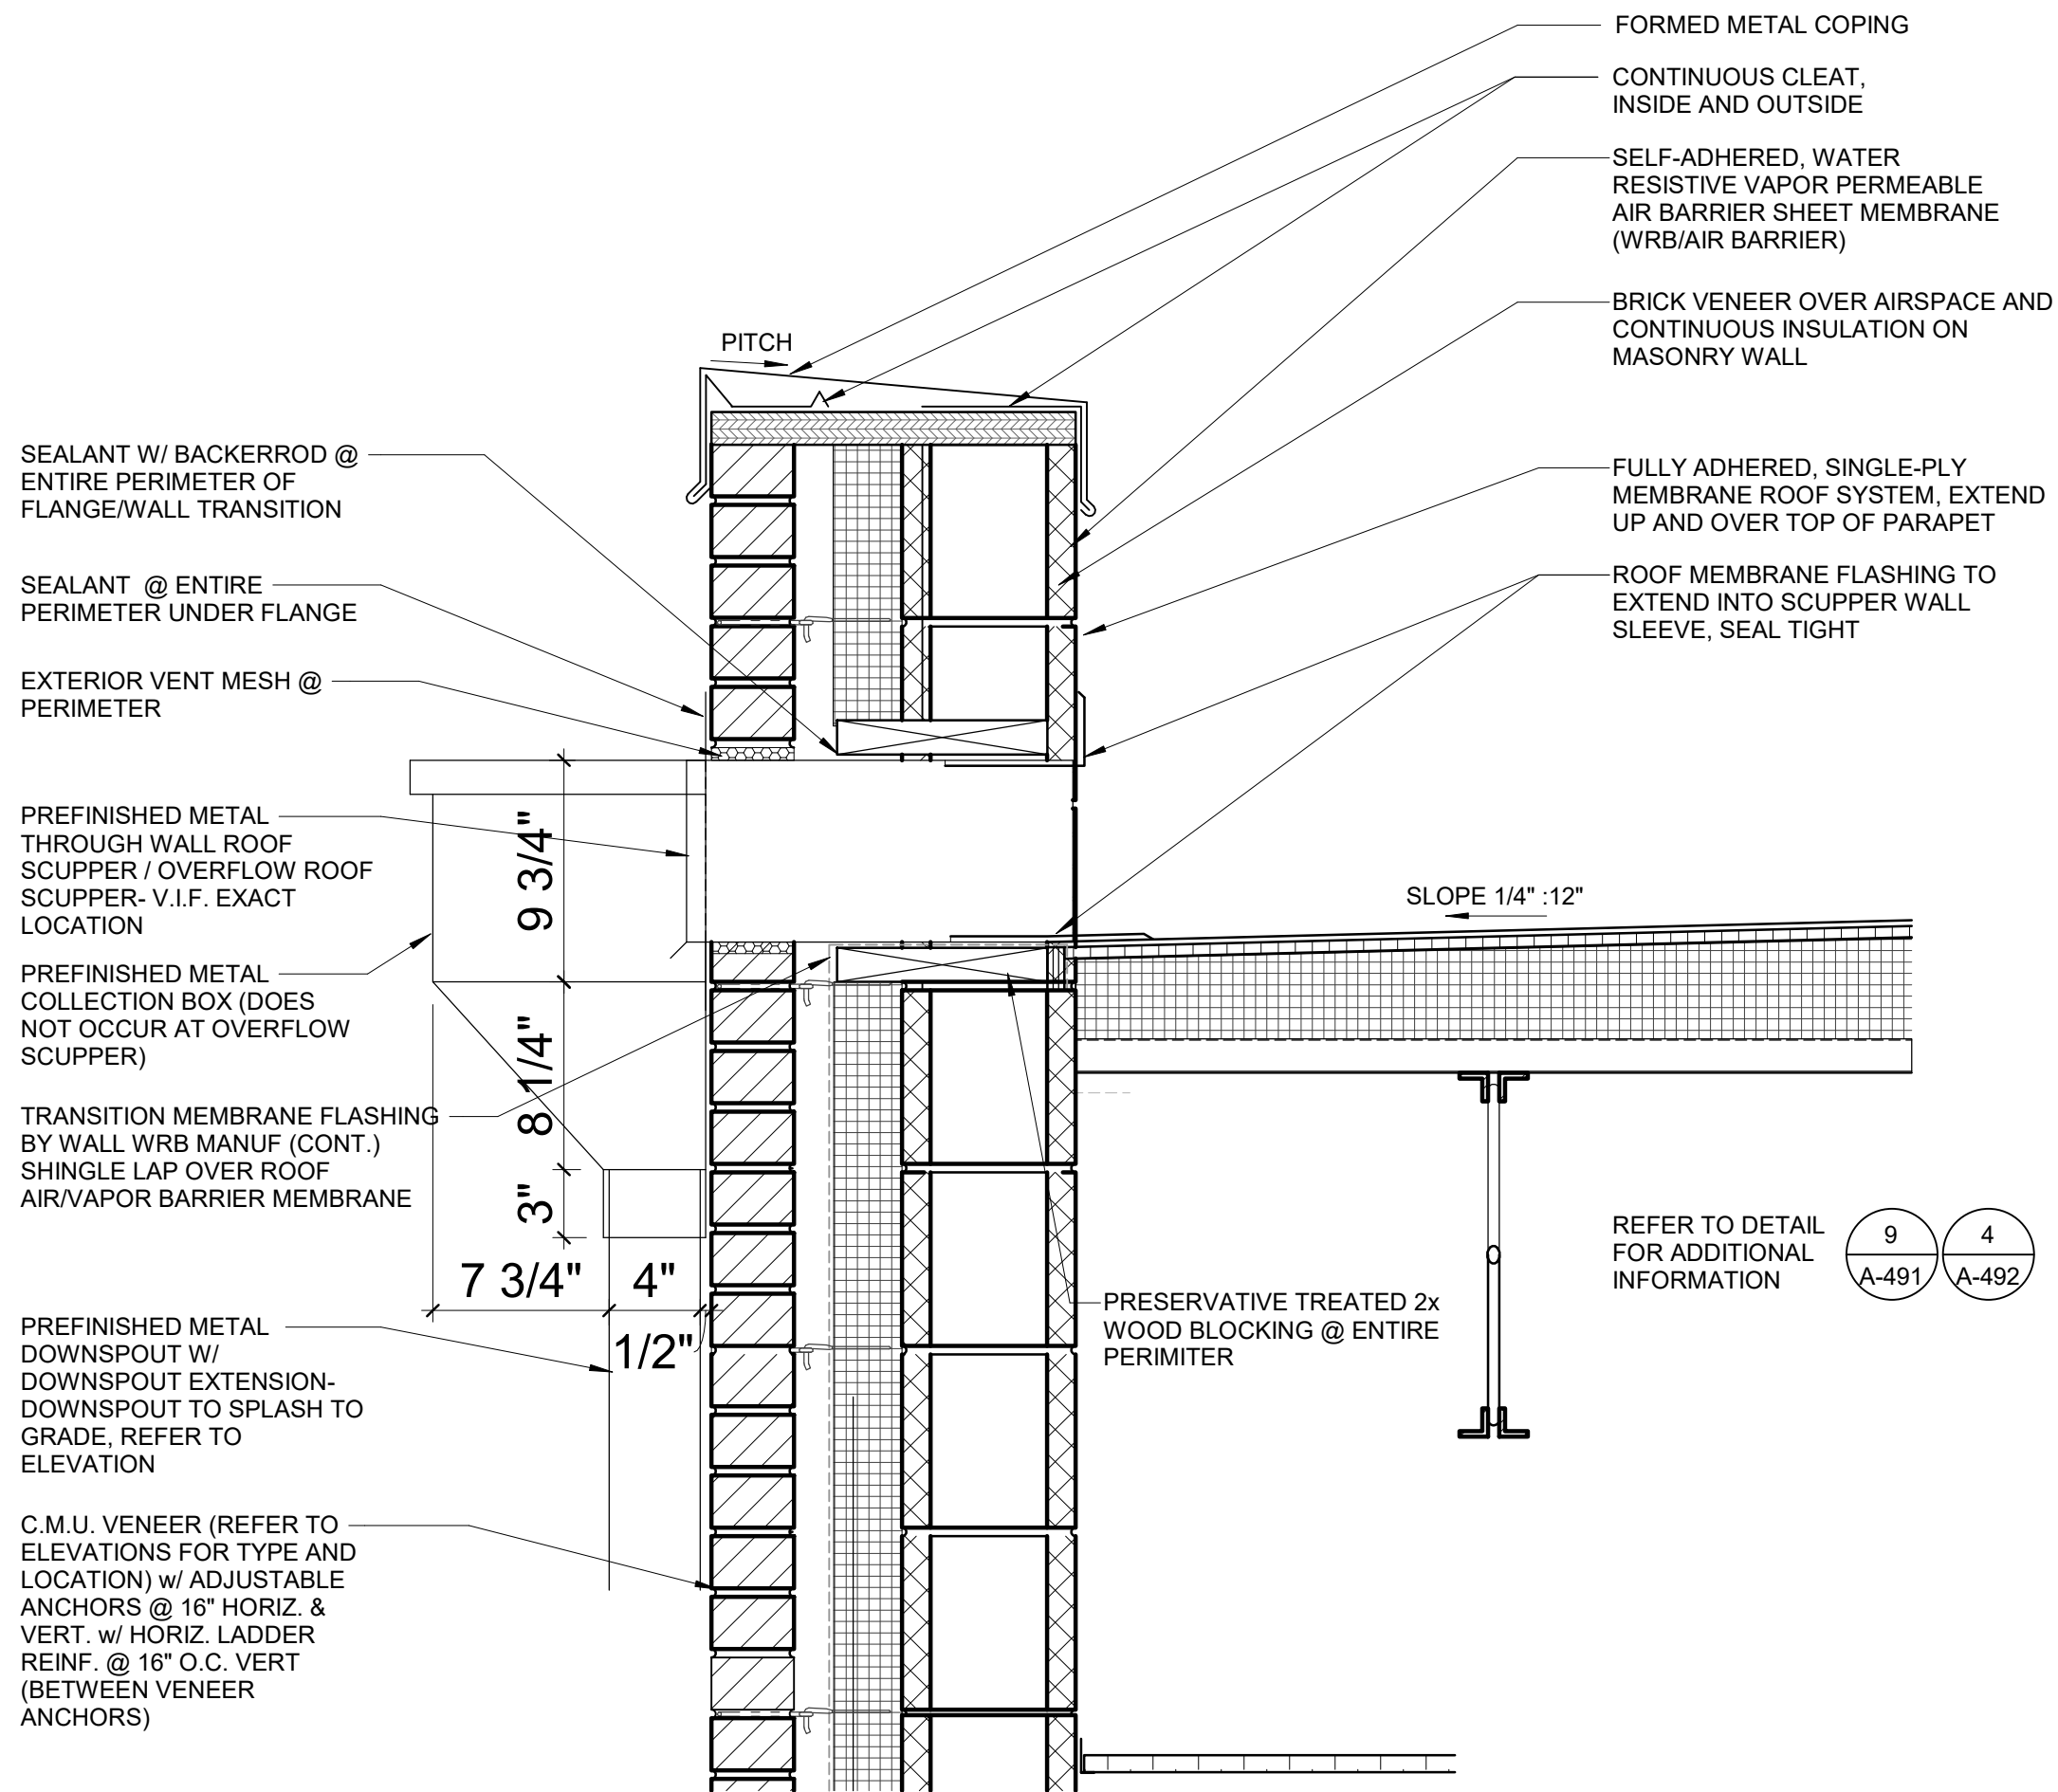


2
A-110 1 1/2" = 1'-0"

ROOF WALKWAY PAD DETAIL

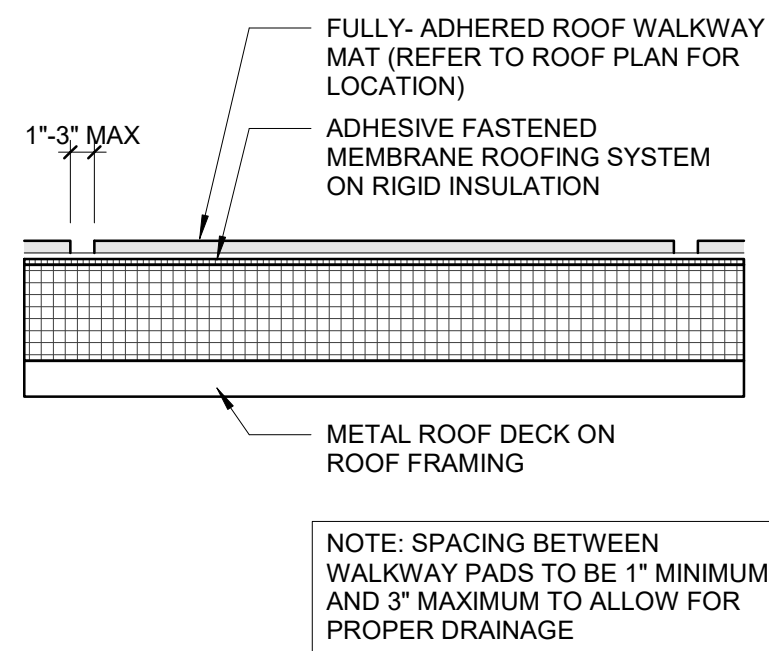


5
A-110 1/2" = 1'-0"

EXTERIOR LADDER DETAIL

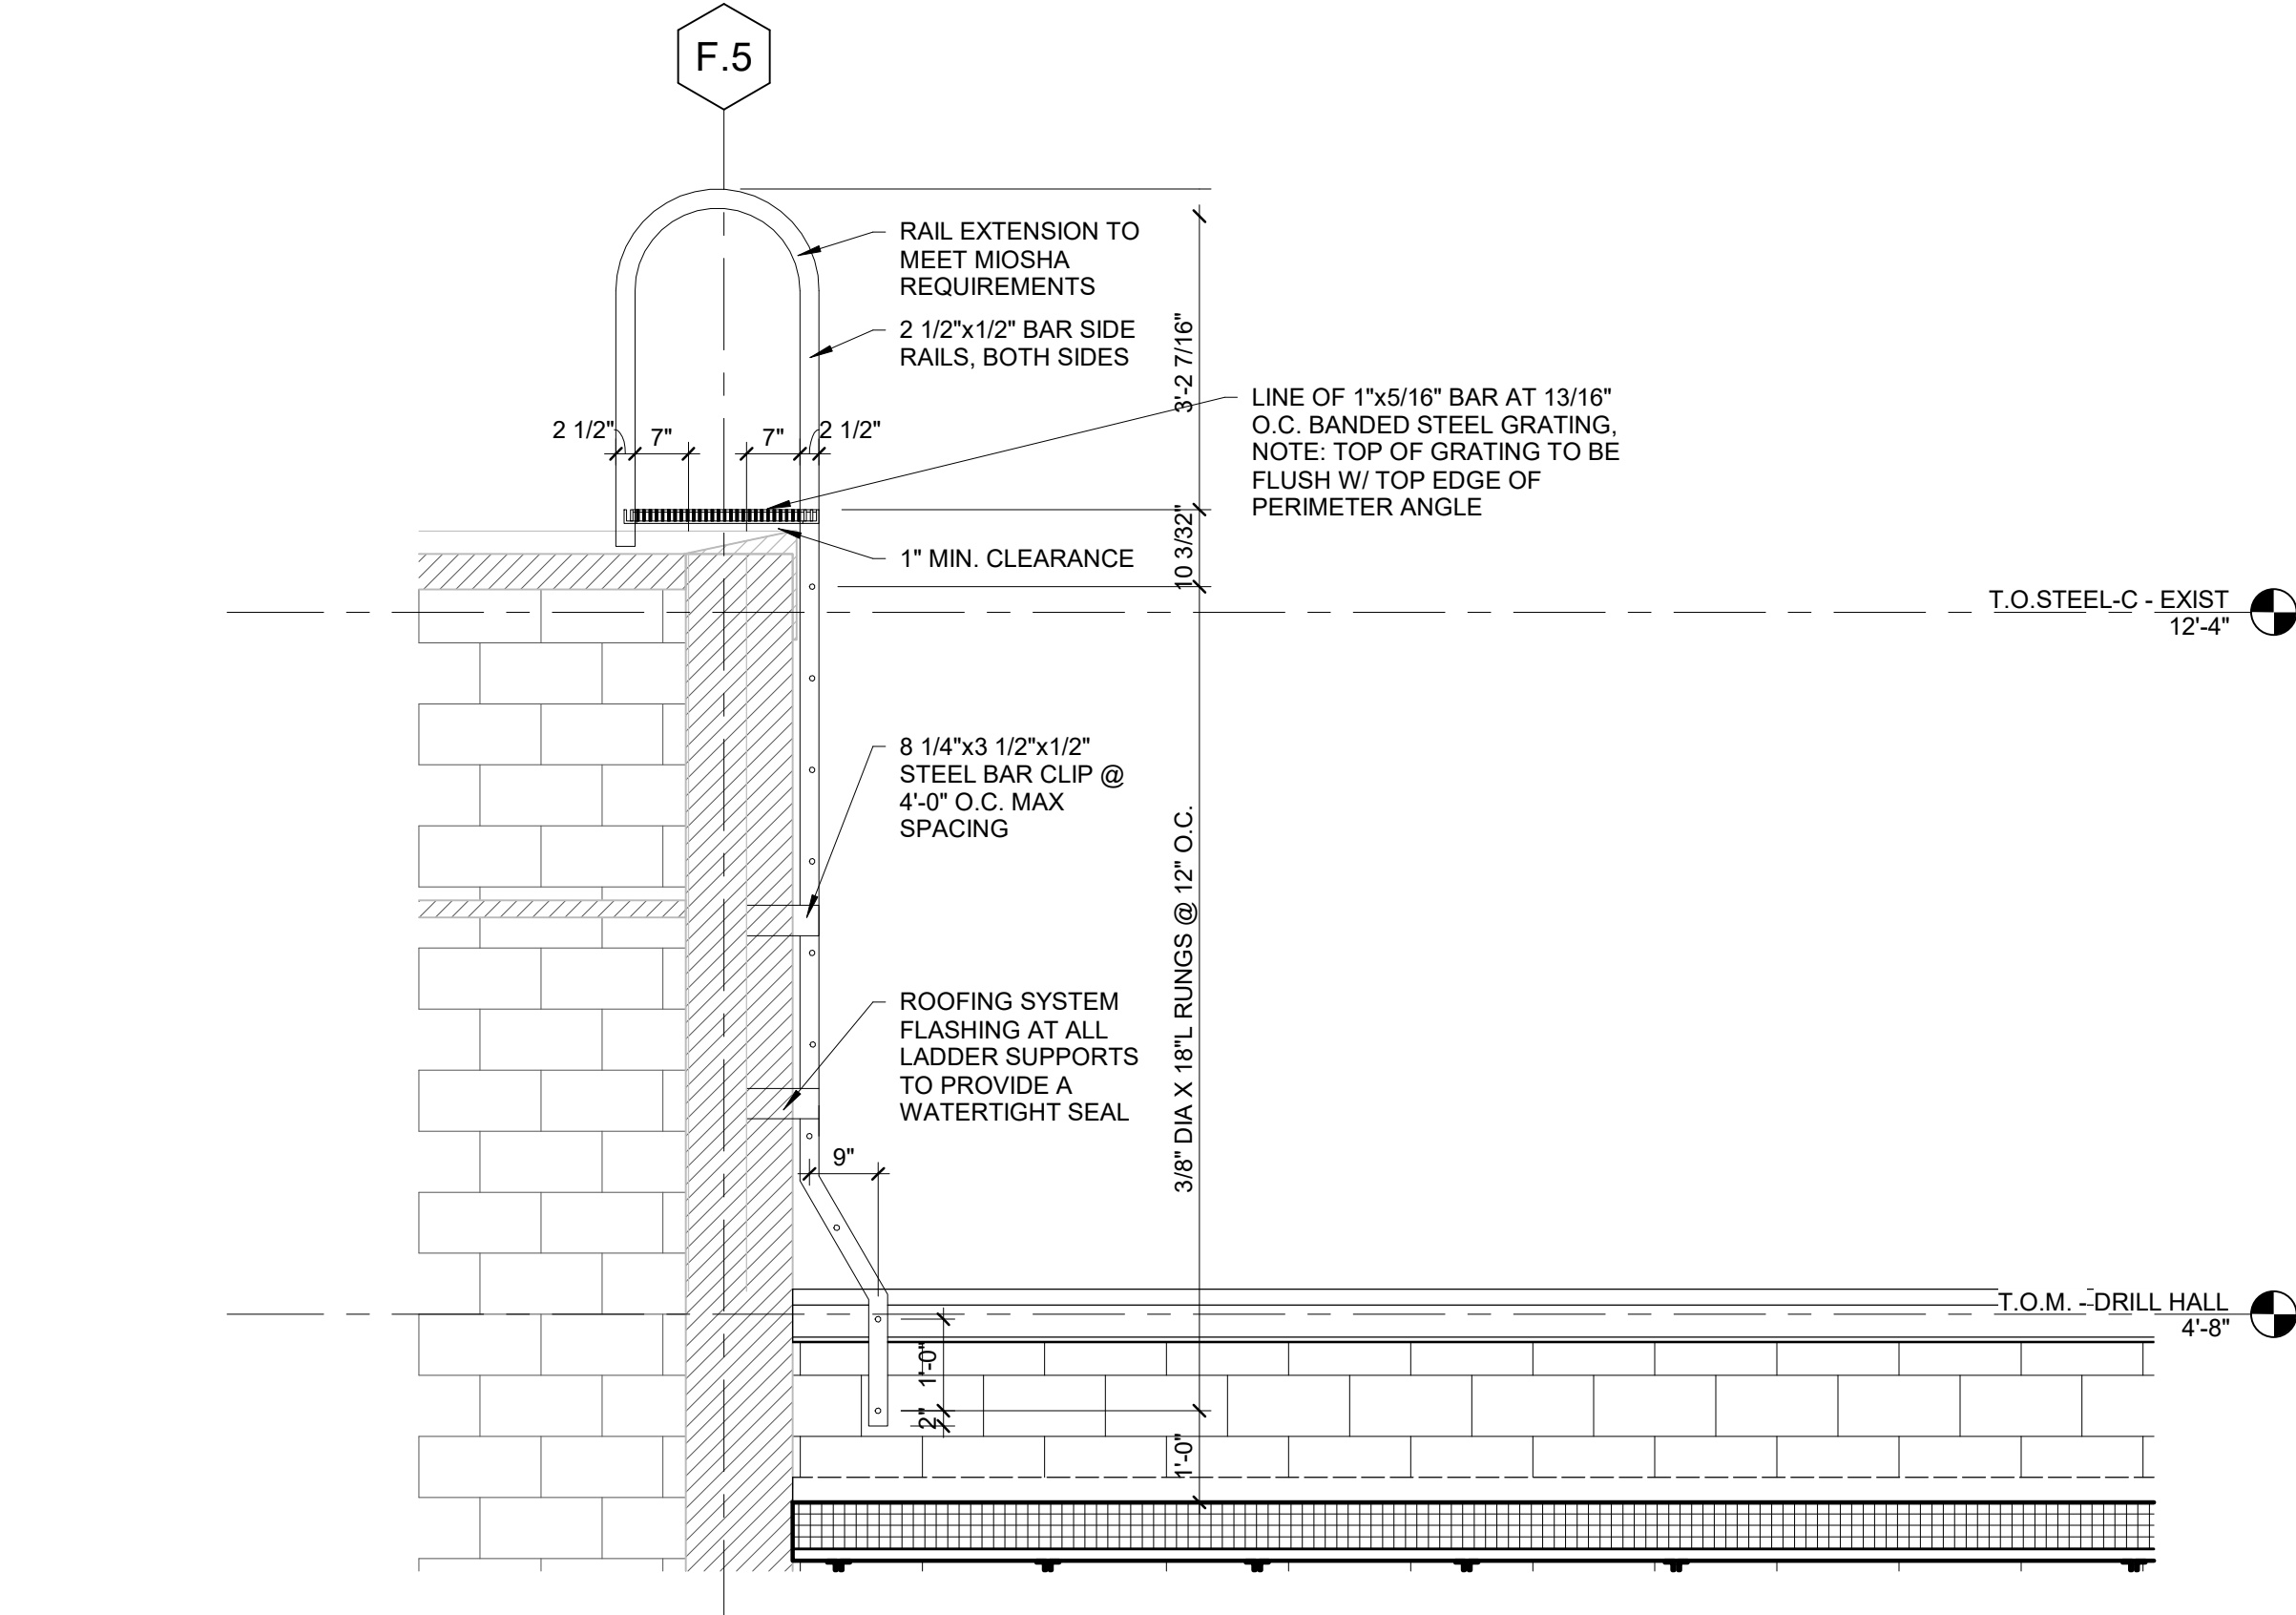


4
A-110 1 1/2" = 1'-0"

ROOF PENETRATION DETAIL

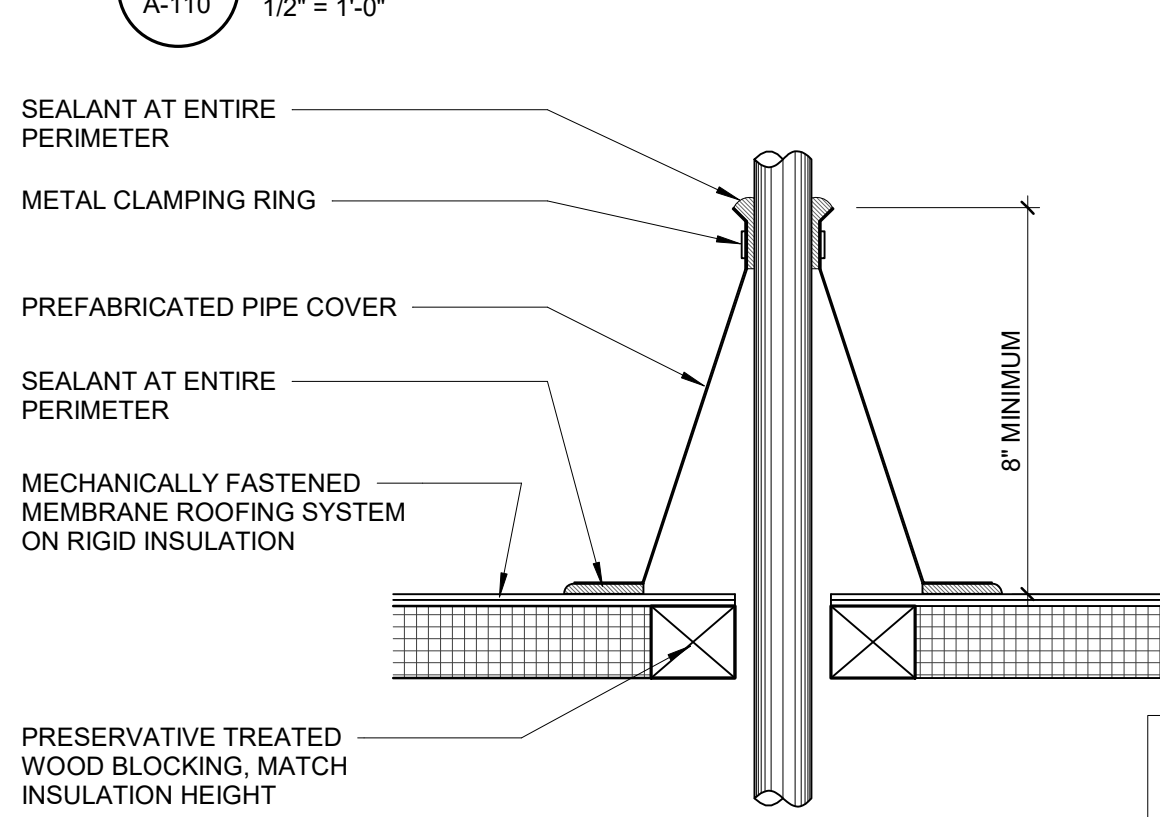

3
A-110 1 1/2" = 1'-0"

MECHANICAL PIPING HOUSING DETAIL

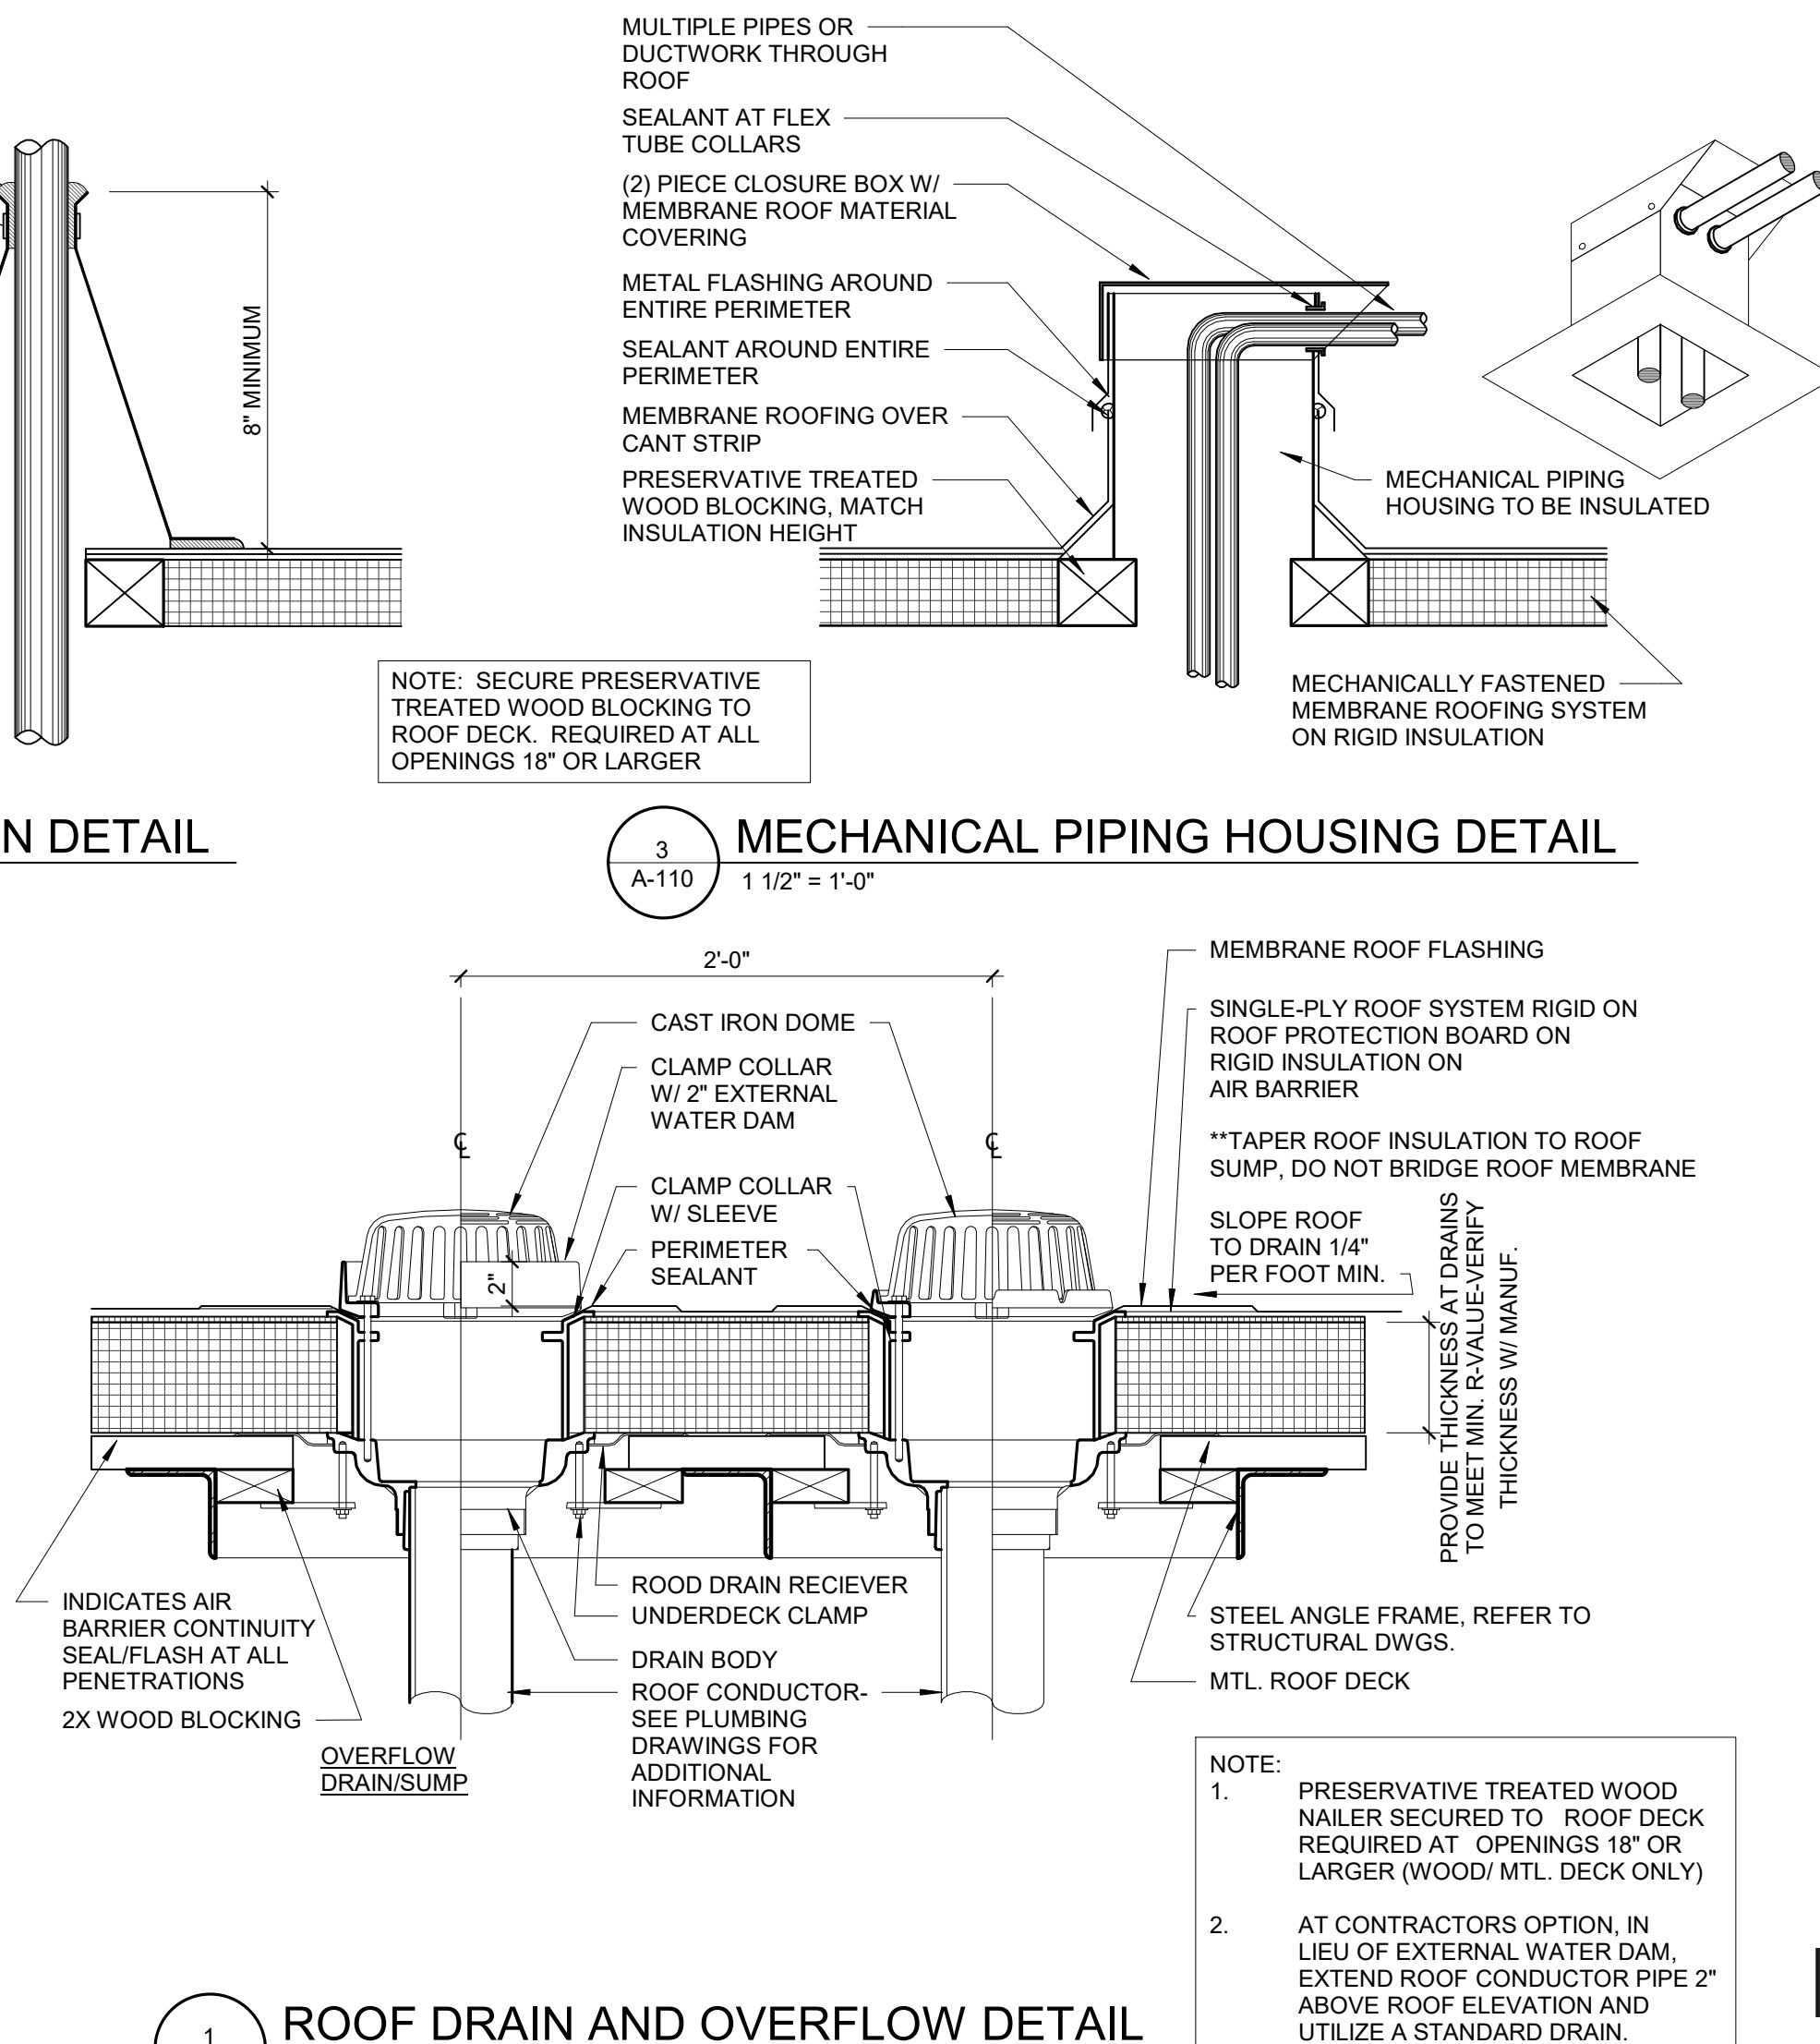

1
A-110 1 1/2" = 1'-0"

ROOF DRAIN AND OVERFLOW DETAIL

1. ALL EXTERIOR METAL TO BE GALVANIZED. ALL EXTERIOR METAL EXPOSED TO VIEW TO ALSO RECEIVE PAINTED FINISH. 2. <u>CONTINUOUS INSULATION/WRB/AIR BARRIER NOTES:</u> A. ALL EXTERIOR WALL RIGID INSULATION TO BE CONTINUOUS AND SEALED TO FUNCTION AS A COMPLETE AIR, VAPOR AND THERMAL CONTROL SYSTEM. B. AIR BARRIER TO BE CONTINUOUS AT THE EXTERIOR BUILDING ENVELOPE AND EXTEND CONTINUOUSLY ACROSS JOINTS AND ASSEMBLIES, ALL JOINTS, TRANSITIONS, TERMINATIONS, PENETRATIONS, ETC. TO BE SEALED IN A MANNER COMPATIBLE W/ CONSTRUCTION MATERIAL AND LOCATION PER ASHRAE 90.1-2013 AND MANUF. INSTALLATION REQUIREMENT. C. IN THE CASE OF SPRAY/LIQUID/TAPE APPLIED W.R.B. SYSTEMS, INSTALL IN ACCORDANCE W/ MANUF. SPECIFICATIONS. D. SEAL ALL SEAMS, JOINTS, PENETRATIONS AND REPAIR MINOR HOLES WITH MANUFACTURER APPROVED SEALING METHOD. E. SEAL OR GASKET MASONRY ANCHORS AT THE FACE OF WRB/AIR BARRIER.	4. PROVIDE WEEP HOLES W/ MEMBRANE FLASHING AND DRAINAGE MESH AT ALL MASONRY LOCATED AT GRADE @ 32" O.C. IN THE SECOND COURSE ABOVE GRADE, AND ALL MASONRY AT WINDOW AND DOOR, HEAD AND SILL LOCATIONS AT 24" O.C. PROVIDE AT ALL OTHER LOCATIONS AS INDICATED ON THE DRAWINGS. 5. PROVIDE AND INSTALL MEMBRANE FLASHING AND WEED VENTS IN EXTERIOR MASONRY WALLS AT SILL ANGLES, LEDGES AND WINDOW AND DOOR HEAD AND SILL LOCATIONS @ 24" O.C., AND ALL OTHER LOCATIONS INDICATED OR OTHERWISE REQUIRED. 6. FORM ENDS DAMS AT HORIZONTAL FLASHING TERMINATIONS TO PREVENT MOISTURE ENTRY INTO THE WALL CAVITY, WITH MANUFACTURER APPROVED SEALANT AT OVERLAPS, AT HEAD AND SILLS, TURN UP NOT LESS THAN 2" TO FORM ENDS DAMS. 7. PROVIDE PRESERVATIVE TREATED WOOD BLOCKING AT ALL WINDOW AND DOOR LOCATIONS FOR FRAME MOUNT U.N.O. 8. SEAL ALL PENETRATIONS, GAPS, SPACES, JOINTS, ETC. AT ENTIRE EXTERIOR OF BUILDING. 9. REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.
---	--

B-1 BRICK

P-1 PAINT COLOR-1

M-3 METAL COLOR-3: METAL COPING/ ROOF EDGE

M-4 METAL COLOR-4: INSULATED METAL PANEL

 ALL SEALANT JOINTS TO MATCH ADJACENT MATERIAL COLOR, U.N.O.

-COLOR TO BE DETERMINED IN FIELD.
 -SEALANT JOINTS AT PERIMETER OF STOREFRONT AND DOOR FRAMES TO MATCH FRAME COLOR.

1. DOWNSPOUT LOCATIONS INDICATED FOR DESIGN INTENT ONLY. CONTRACTOR TO VERIFY AND COORDINATE EXHAUST LOCATIONS w/ ROOF MANUFACTURER-ARCHITECT TO REVIEW ALL LOCATIONS PRIOR TO INSTALLATION.
2. DOWNSPOUT BOOT/ DOWNSPOUT ADAPTER SHALL BE PREFINISHED TO MATCH DOWNSPOUTS. NO EXPOSED STORM SEWER PIPING.
3. REFER TO DOOR & WINDOW SCHEDULES FOR ADDITIONAL INFORMATION.
4. PAINT ALL ROOFTOP MOUNTED/ WALL MOUNTED DEVICES AND PENETRATIONS TO MATCH ADJACENT ROOF MATERIAL. IF ITEMS ARE PREFINISHED, COORDINATE COLOR SELECTION w/ ARCHITECT PRIOR TO FABRICATION / ORDERING.
5. CONTRACTOR TO COORDINATE LOCATION OF ALL EXHAUST AND INTAKE LOUVERS w/ MECHANICAL DRAWINGS - ALL FRESH AIR INTAKES TO BE 4'-0" ABOVE FINISH GRADE MINIMUM AND 10'-0" MIN. FROM EXHAUST OPENINGS.
6. ALL EXPOSED EXTERIOR METAL, INCLUDING LINTELS, TO BE GALVANIZED AND PAINTED PER PAINTING SCHEDULE.
7. ALL EXTERIOR SEALANT COLORS TO MATCH MATERIAL BEING SEALED, CONTROL/ EXPANSION JOINT SEALANT TO MATCH MORTAR COLOR, MATCH FRAMES, U.N.O.
8. PAINT ALL ROOFTOP MOUNTED/ WALL MOUNTED DEVICES AND PENETRATIONS TO MATCH ADJACENT ROOF MATERIAL. IF ITEMS ARE PREFINISHED, COORDINATE COLOR SELECTION w/ ARCHITECT PRIOR TO FABRICATION / ORDERING.
9. MOVEMENT JOINTS, I.E. EXPANSION JOINTS (E.J.) IN CLAY MASONRY, CONTROL JOINTS (C.J.) IN CONCRETE MASONRY, SHALL BE INSTALLED AT ALL INSIDE CORNERS, CHANGES IN WALL HEIGHT, BETWEEN STRUCTURES, AND AT OTHER LOCATIONS PER BIA TECH NOTE 18R AND NCMA TEK 10-4/NWCA TEK NOTE DEC 2000 GUIDELINES. JOINTS INDICATED ON ELEVATIONS ARE PREFERRED LOCATIONS. CONTRACTOR TO VERIFY EXHAUST LOCATIONS w/ ARCHITECT PRIOR TO INSTALLATION.
10. SEAL ALL PENETRATIONS, GAPS, SPACES, JOINTS, ETC. AT ENTIRE EXTERIOR OF BUILDING.

(A-201) $1/16'' = 1'-0''$

(A-201) $1/16" = 1'-0"$

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A. DIRECTOR

RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS

2700 W ARGYLE ST., JACKSON, MI

SHEET TITLE: EXTERIOR ELEVATIONS

ISSUED FOR:		DATE	DESIGNED	NC/HL
PRELIMINARY	☐	01/15/26	DRAWN	NC/HL
CONSTRUCTION	☒		CHECKED	TM
FINAL RECORD	☐		APPROVED	RMR

IDENTIFICATION NO:
PROJECT NO: 25510.A
DMVA: 2622825007
FILE NO./INDEX CODE:
44395999.016

A-201

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025




MISSDIG811

FOR SITE OWNED UTILITIES


72 HOURS
(3 WORKING DAYS)
BEFORE YOU

CALL: MR. ZIMMERMAN
PH. (312) 332-3334

PH: (248) 606-8821
FACILITIES MANAGEMENT

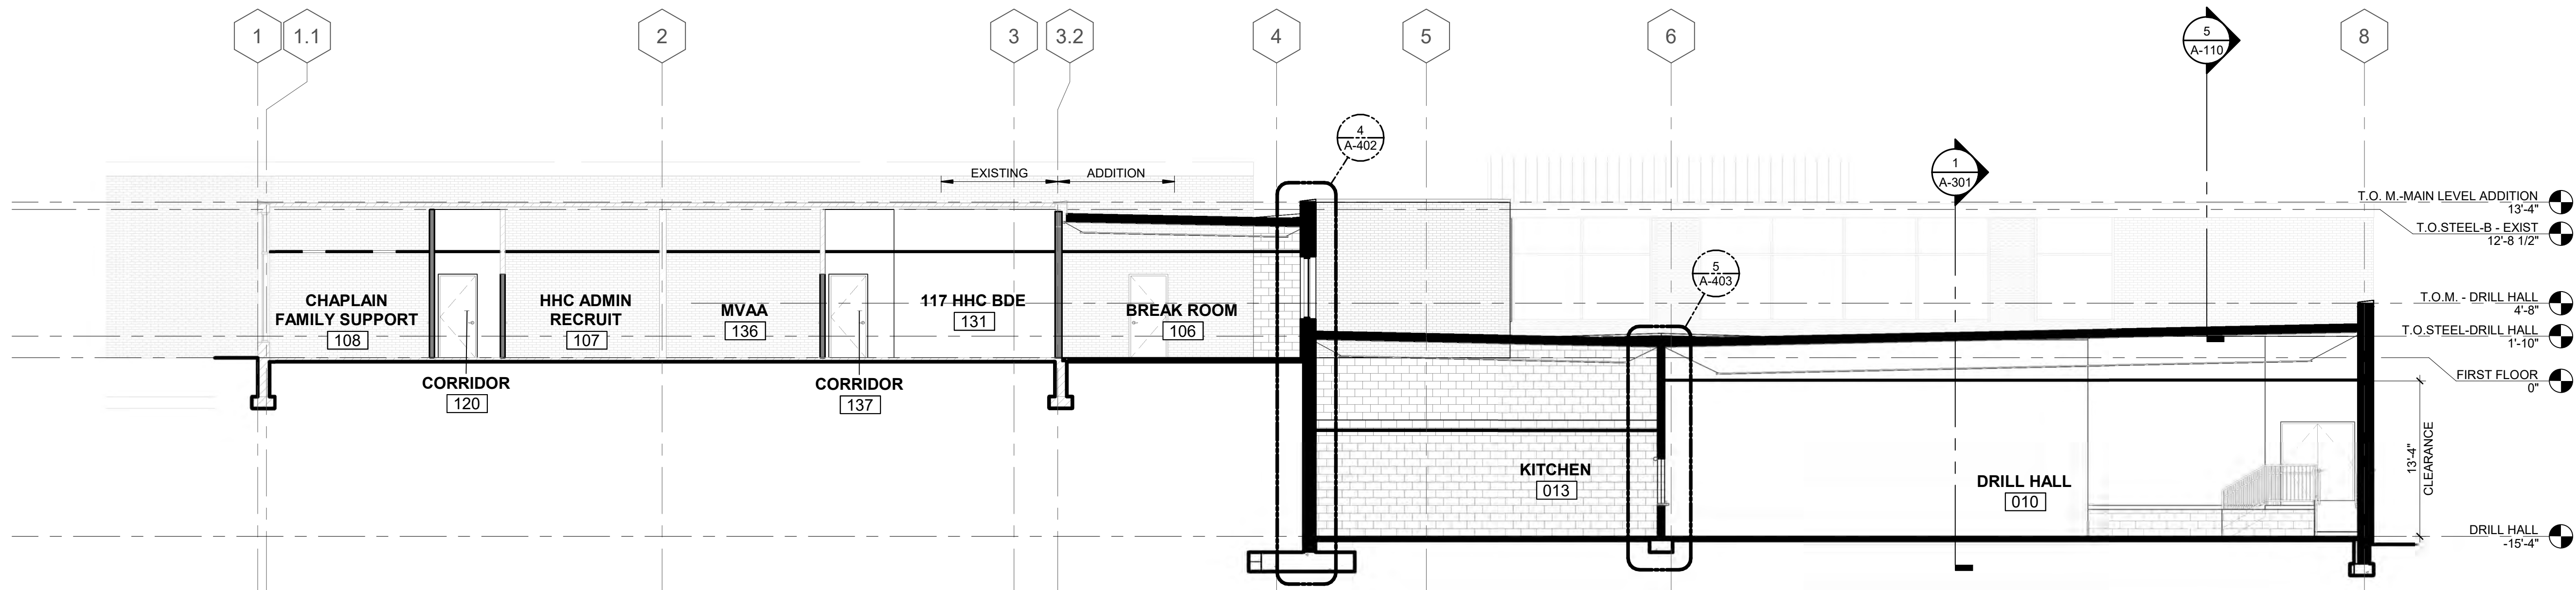

2 NORTH-SOUTH BUILDING SECTION
A-301 1/8" = 1'-0"

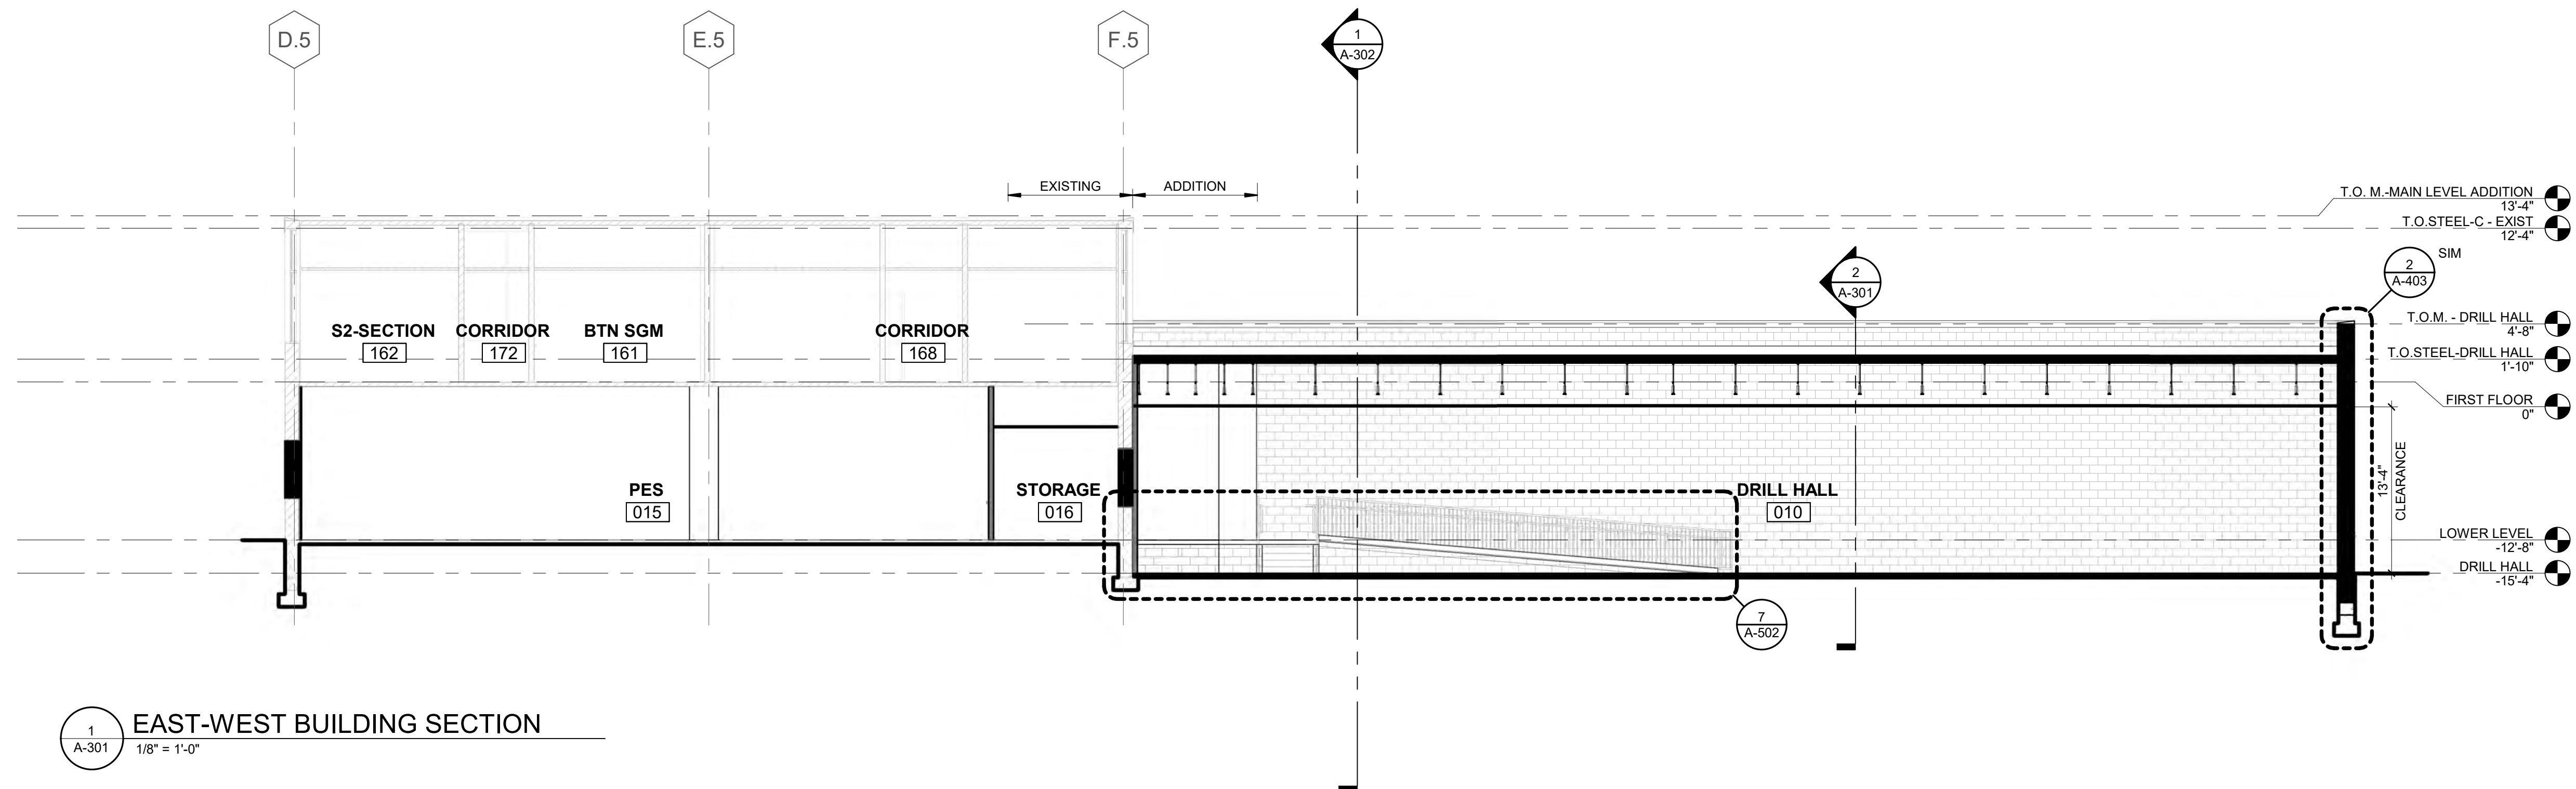

1 EAST-WEST BUILDING SECTION
A-301 1/8" = 1'-0"

SHEET	BUILDING SECTIONS	ISSUED FOR:	DATE	DESIGNED	NCHL
A-301	IDENTIFICATION NO:	PRELIMINARY	01/15/26	DRAWN	NCHL
		CONSTRUCTION		CHECKED	TM
		FINAL RECORD		APPROVED	RMR




Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF
SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED,
COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR
WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

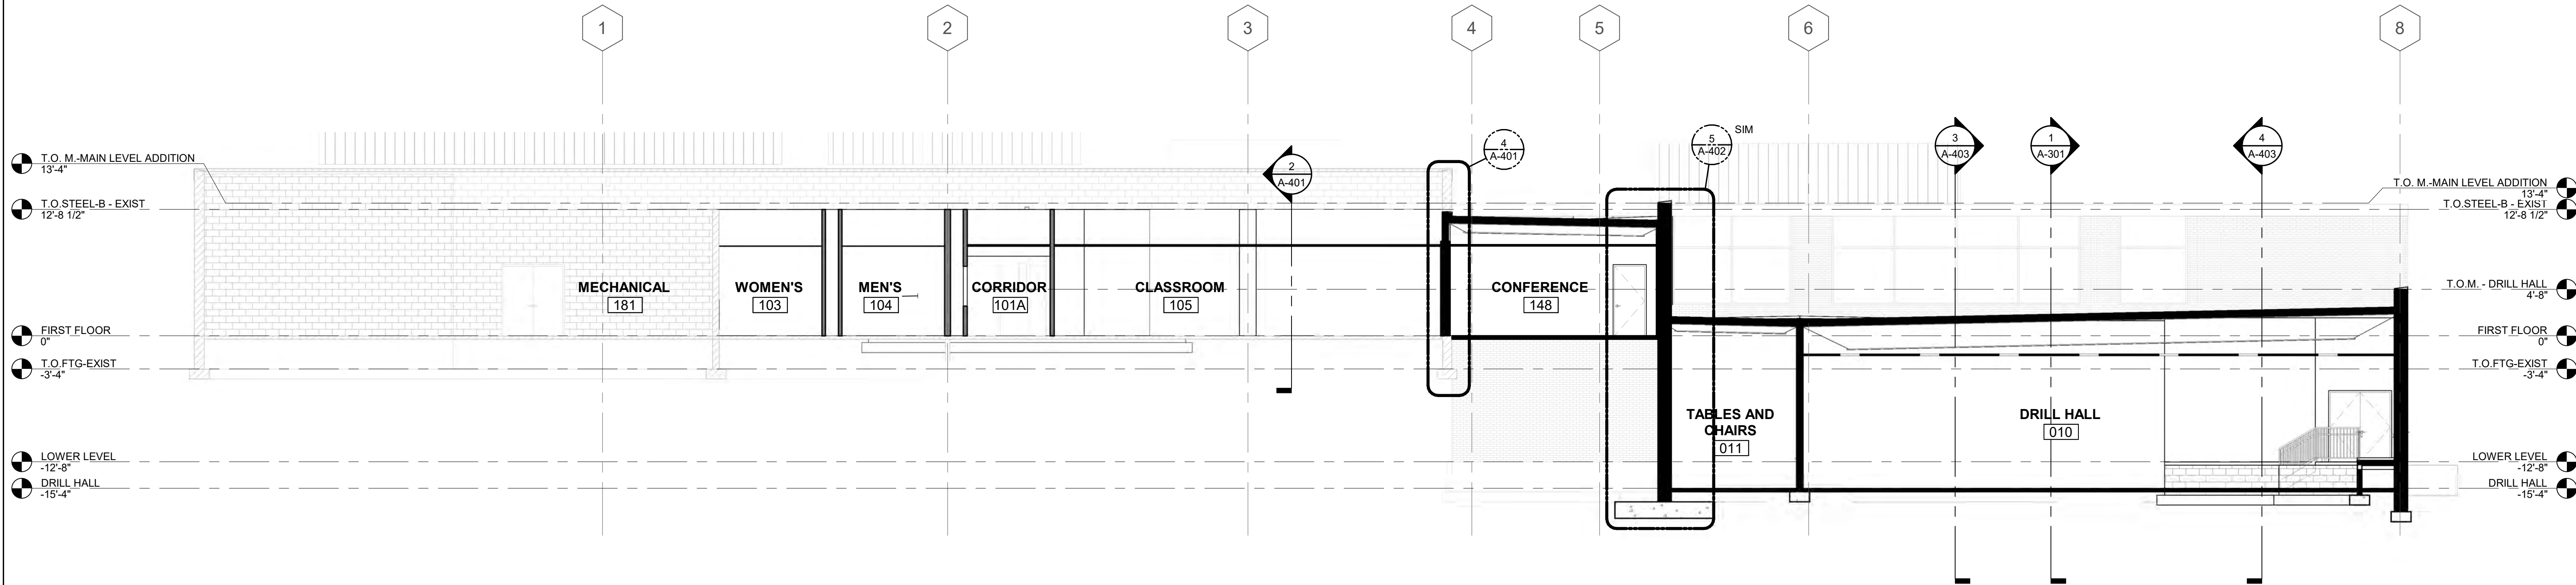

1 NORTH-SOUTH BUILDING SECTION - CONFERENCE ROOM
1/8" = 1'-0"

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF
SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED,
COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR
WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT


SHEET TITLE: BUILDING SECTIONS

IDENTIFICATION NO:	ISSUED FOR:	DATE	DESIGNED	HL
PROJECT NO: 25510.A	PRELIMINARY	01/15/26	DRAWN	H/LNC
DIVA: 262825007	CONSTRUCTION	☒	CHECKED	TM
FILE NO/INDEX CODE:	FINAL RECORD	☐	APPROVED	RMR


A-302

RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS


2700 W ARGYLE ST., JACKSON, MI

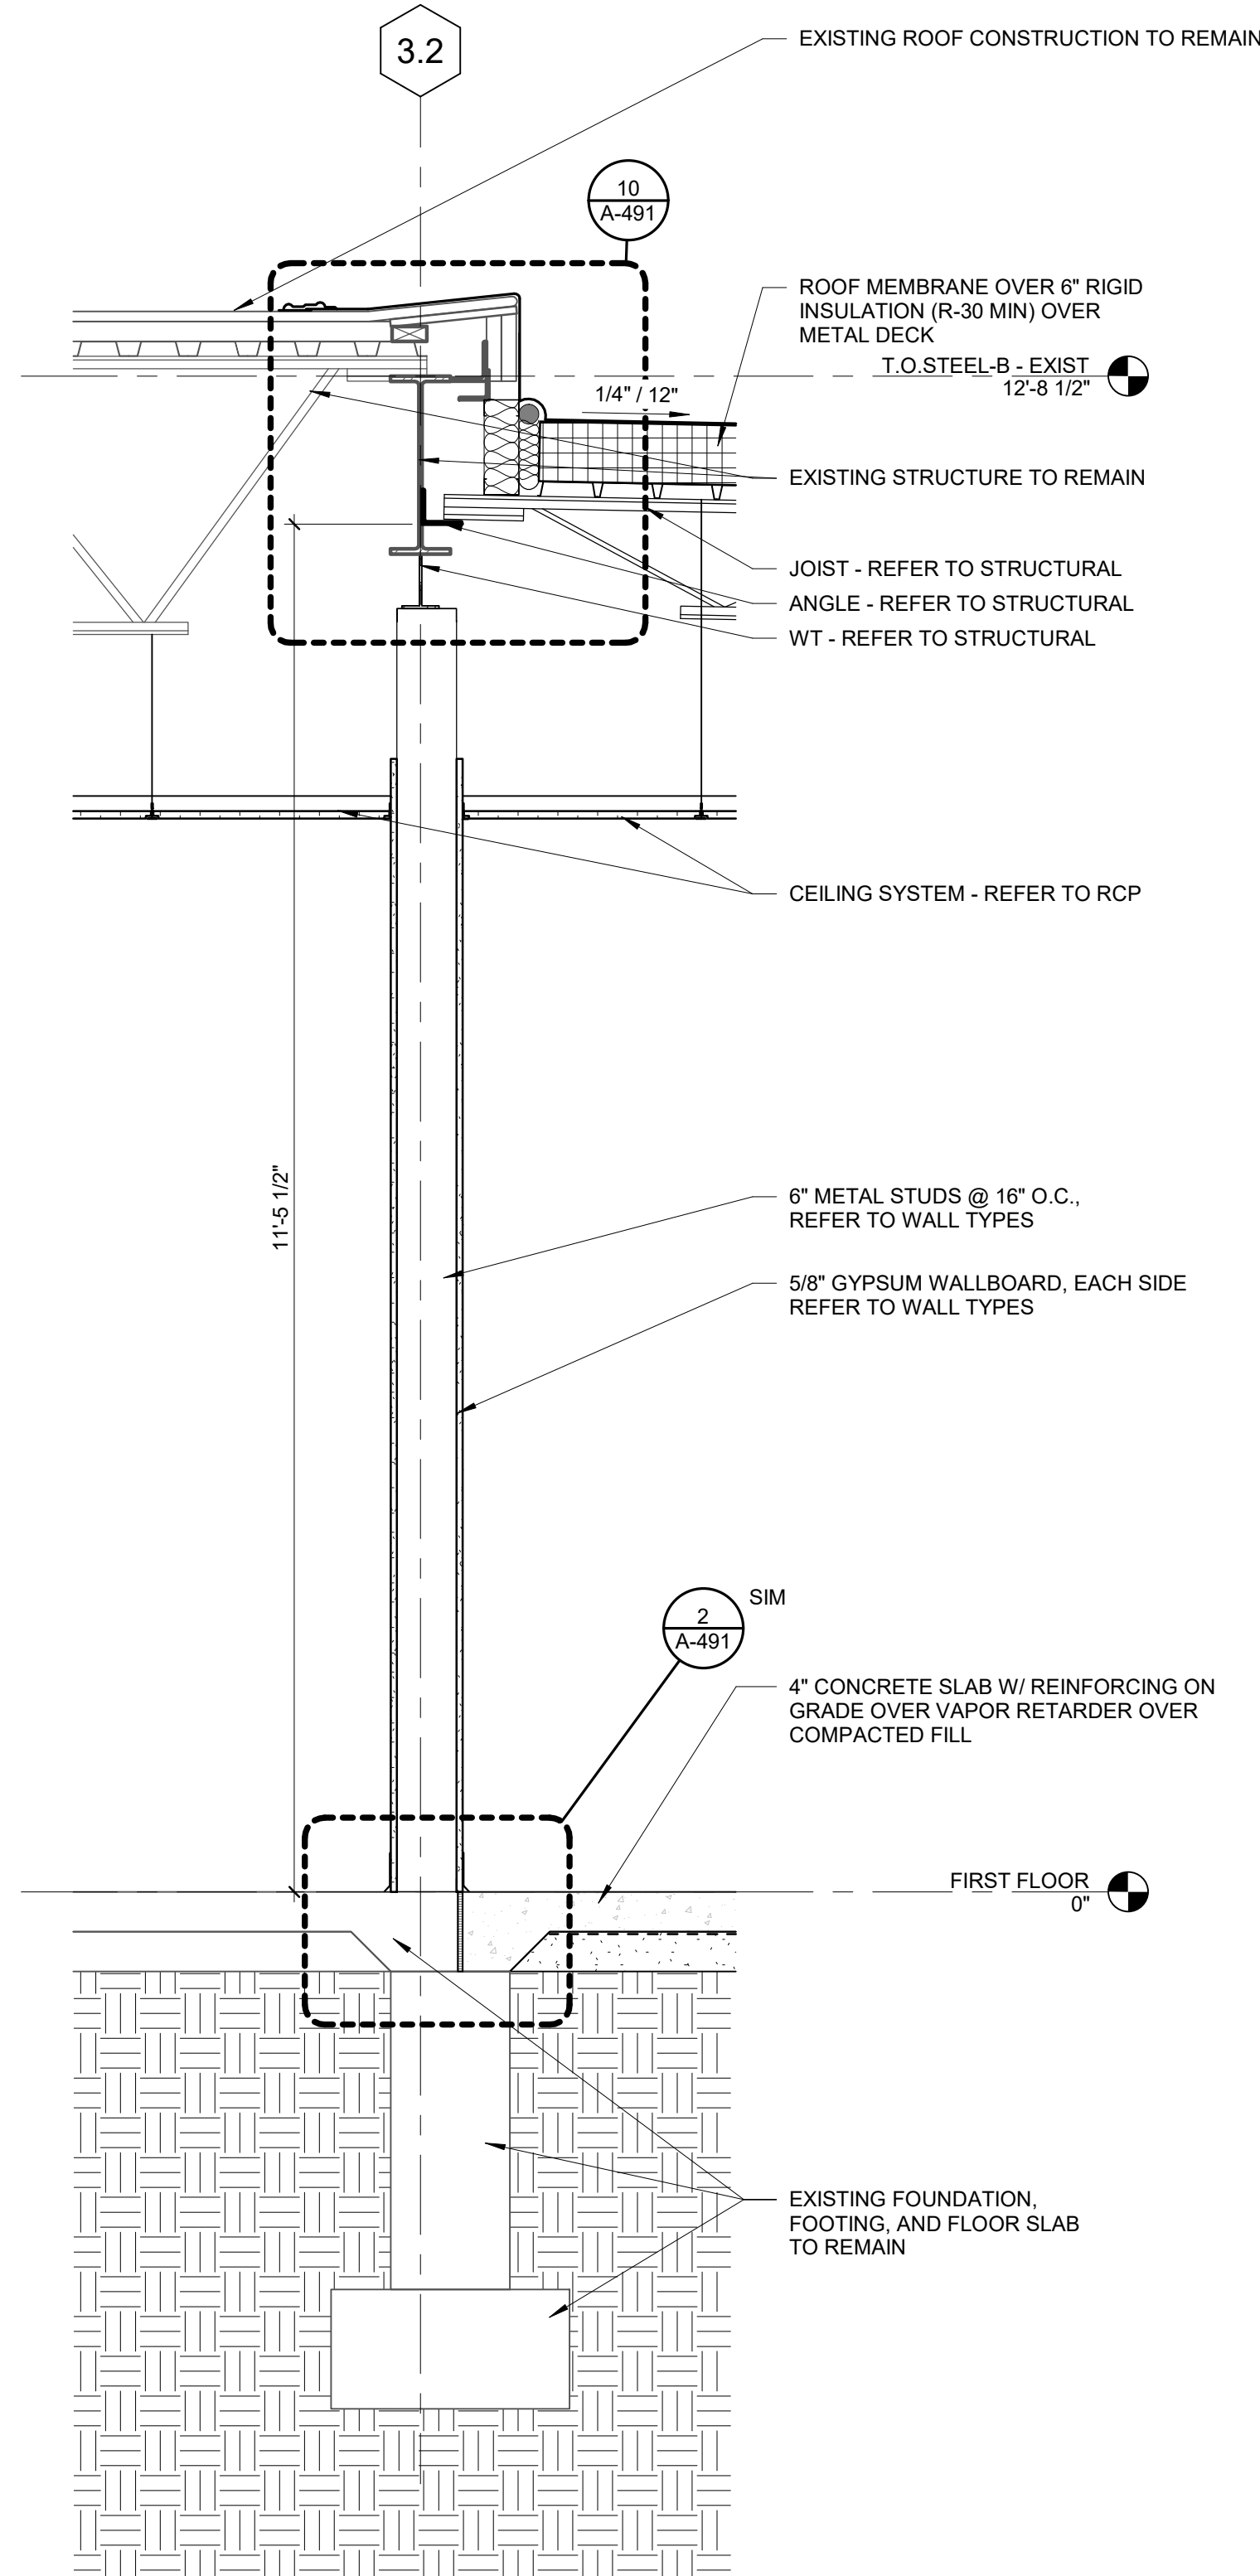


5 WALL SECTION
A-401 3/4" = 1'-0"

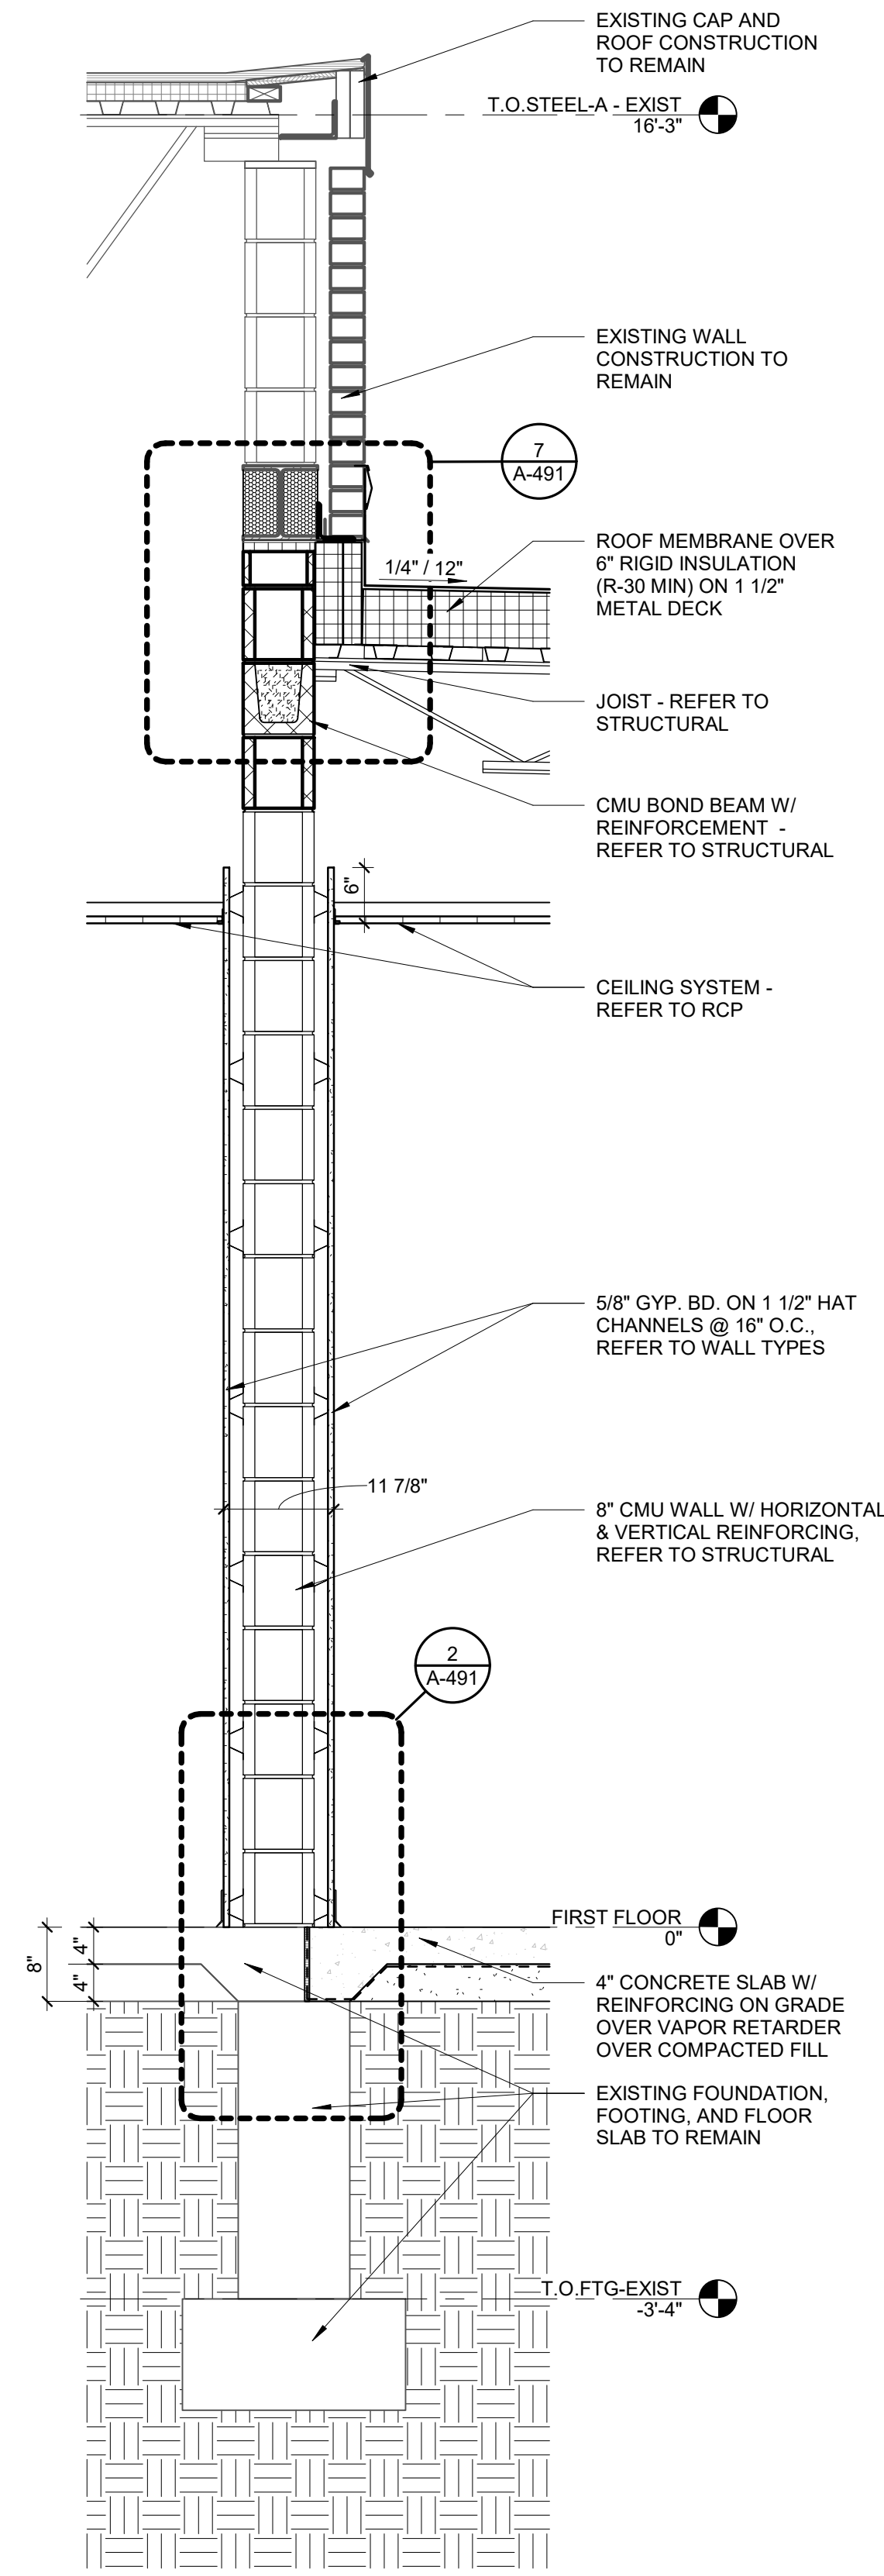


4 WALL SECTION
A-401 3/4" = 1'-0"

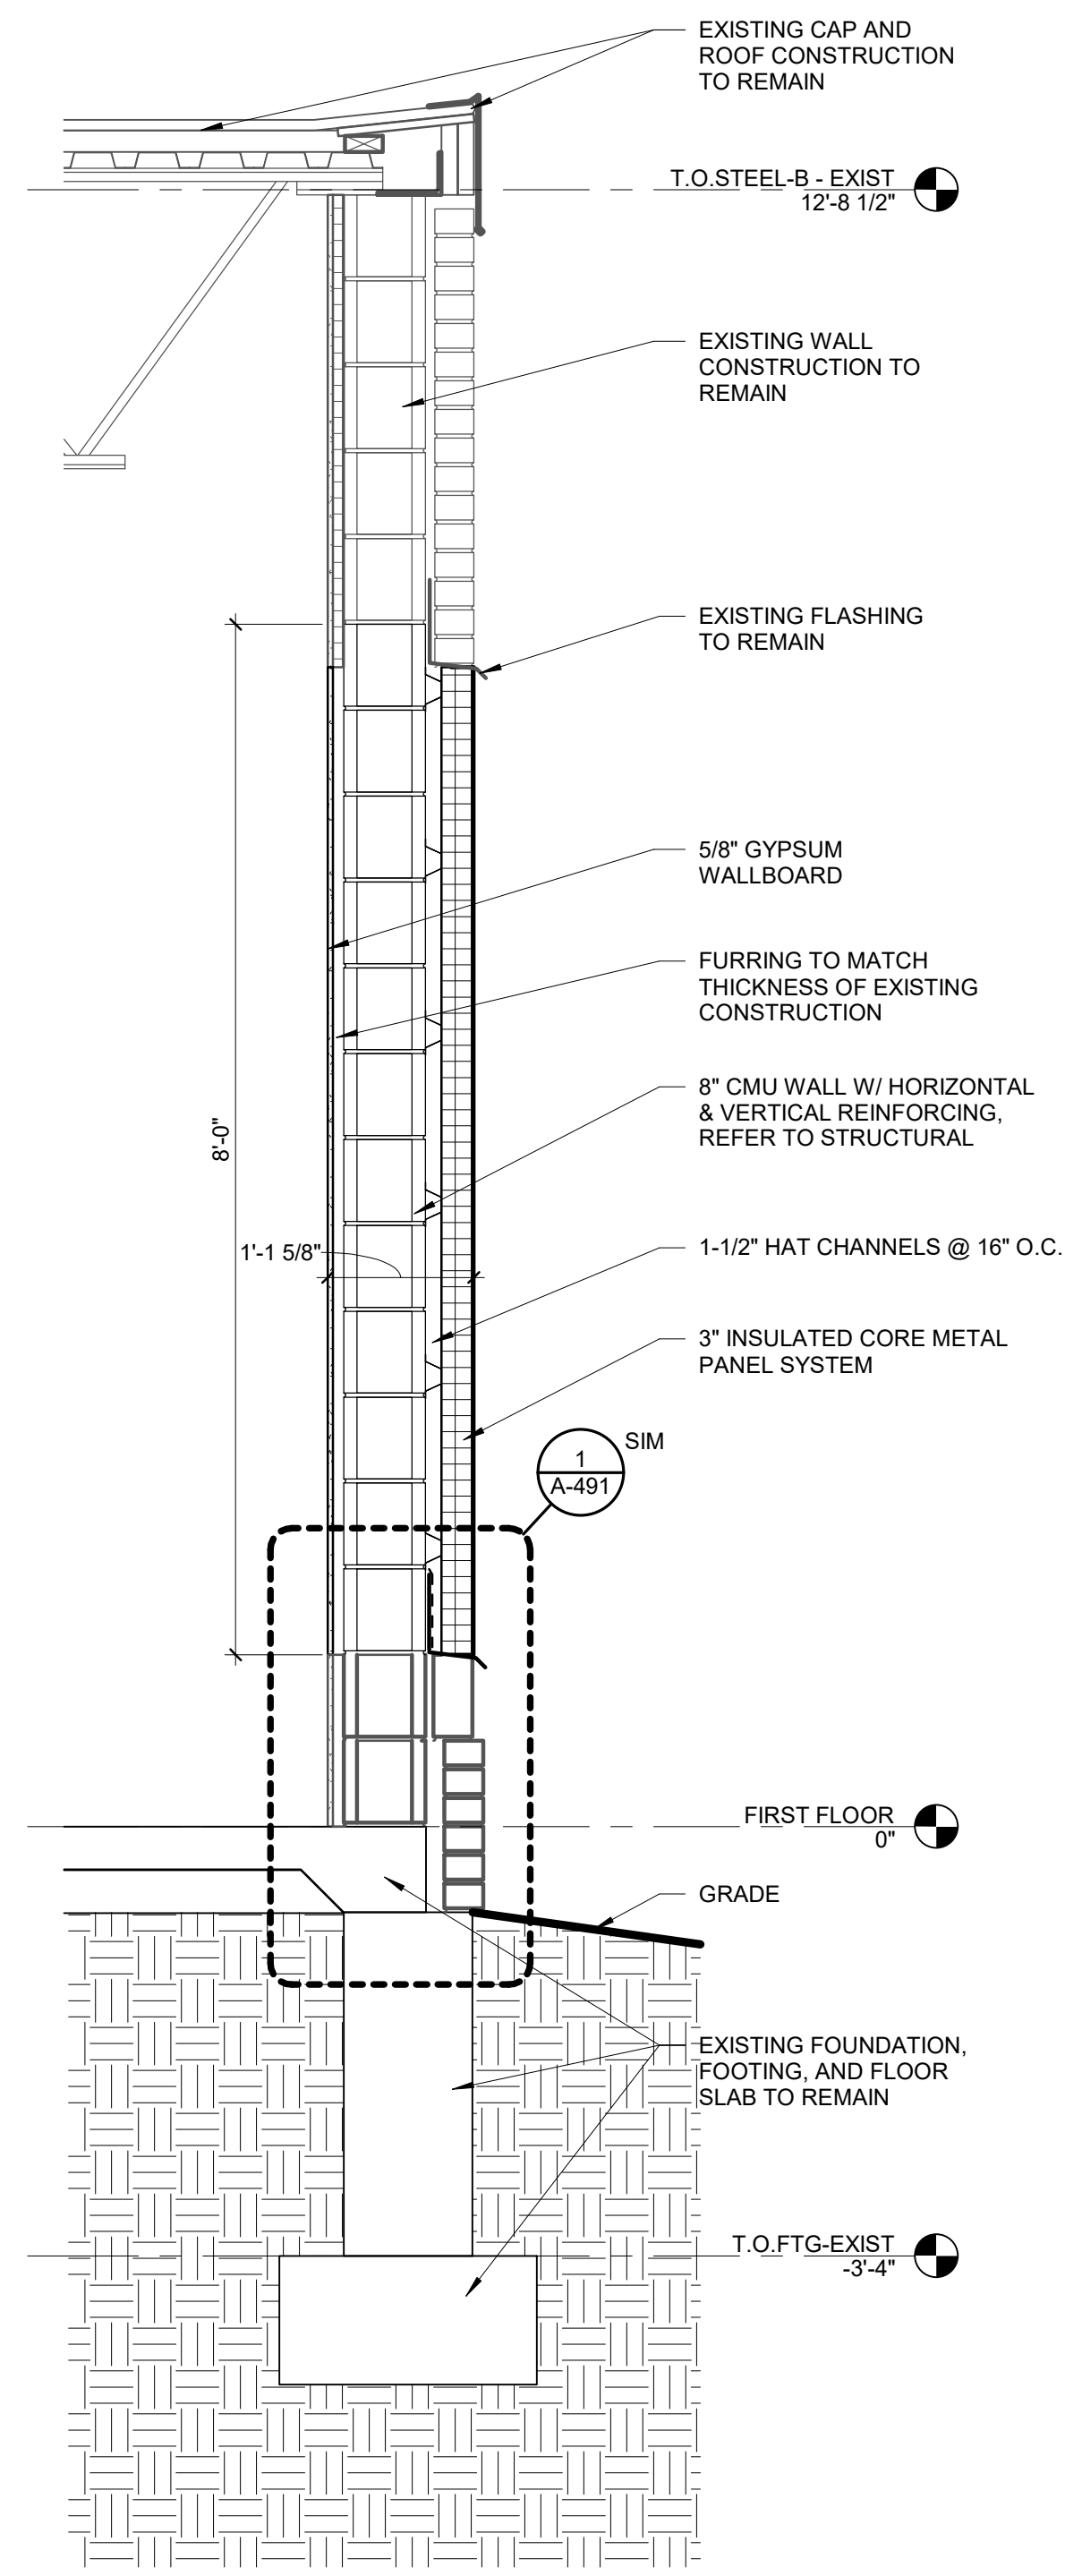

3 WALL SECTION
A-401 3/4" = 1'-0"

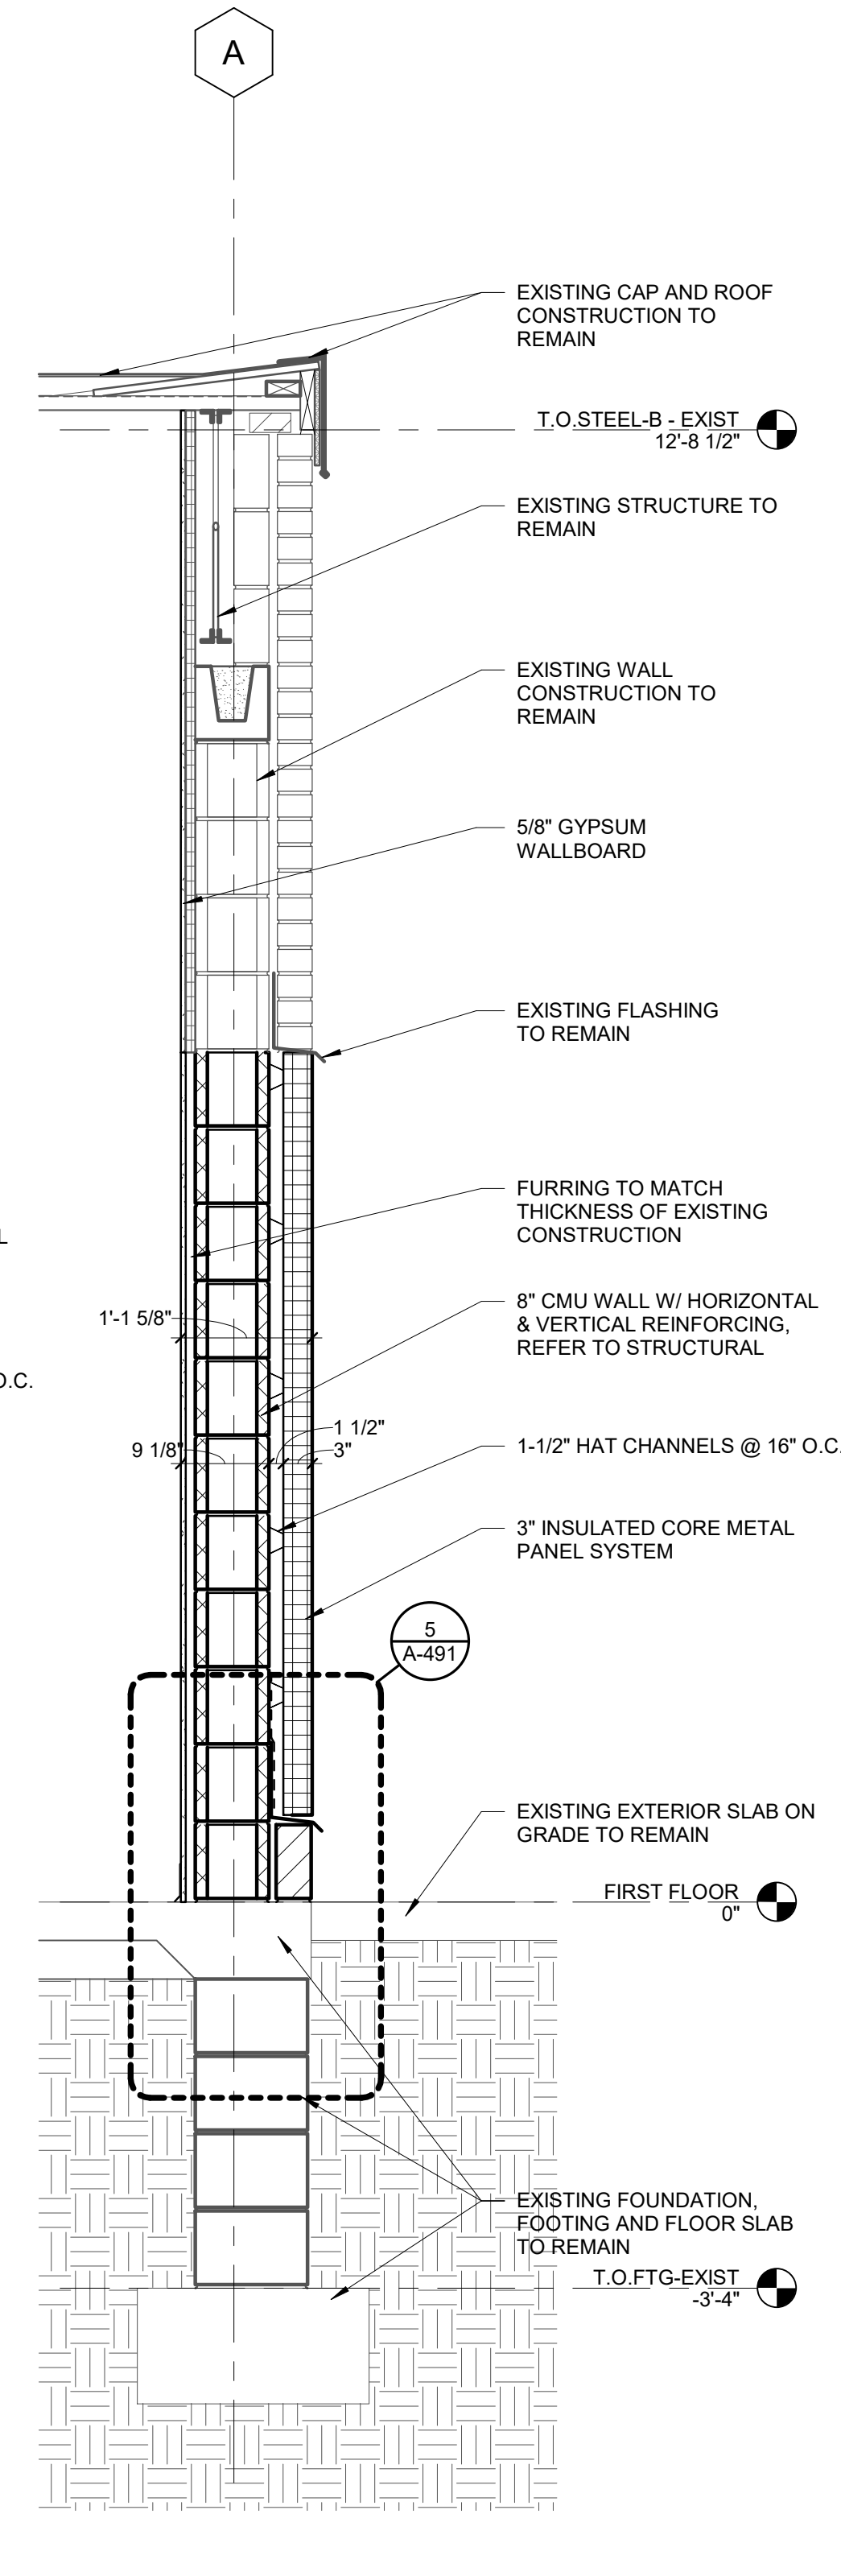

2 WALL SECTION
A-401 3/4" = 1'-0"

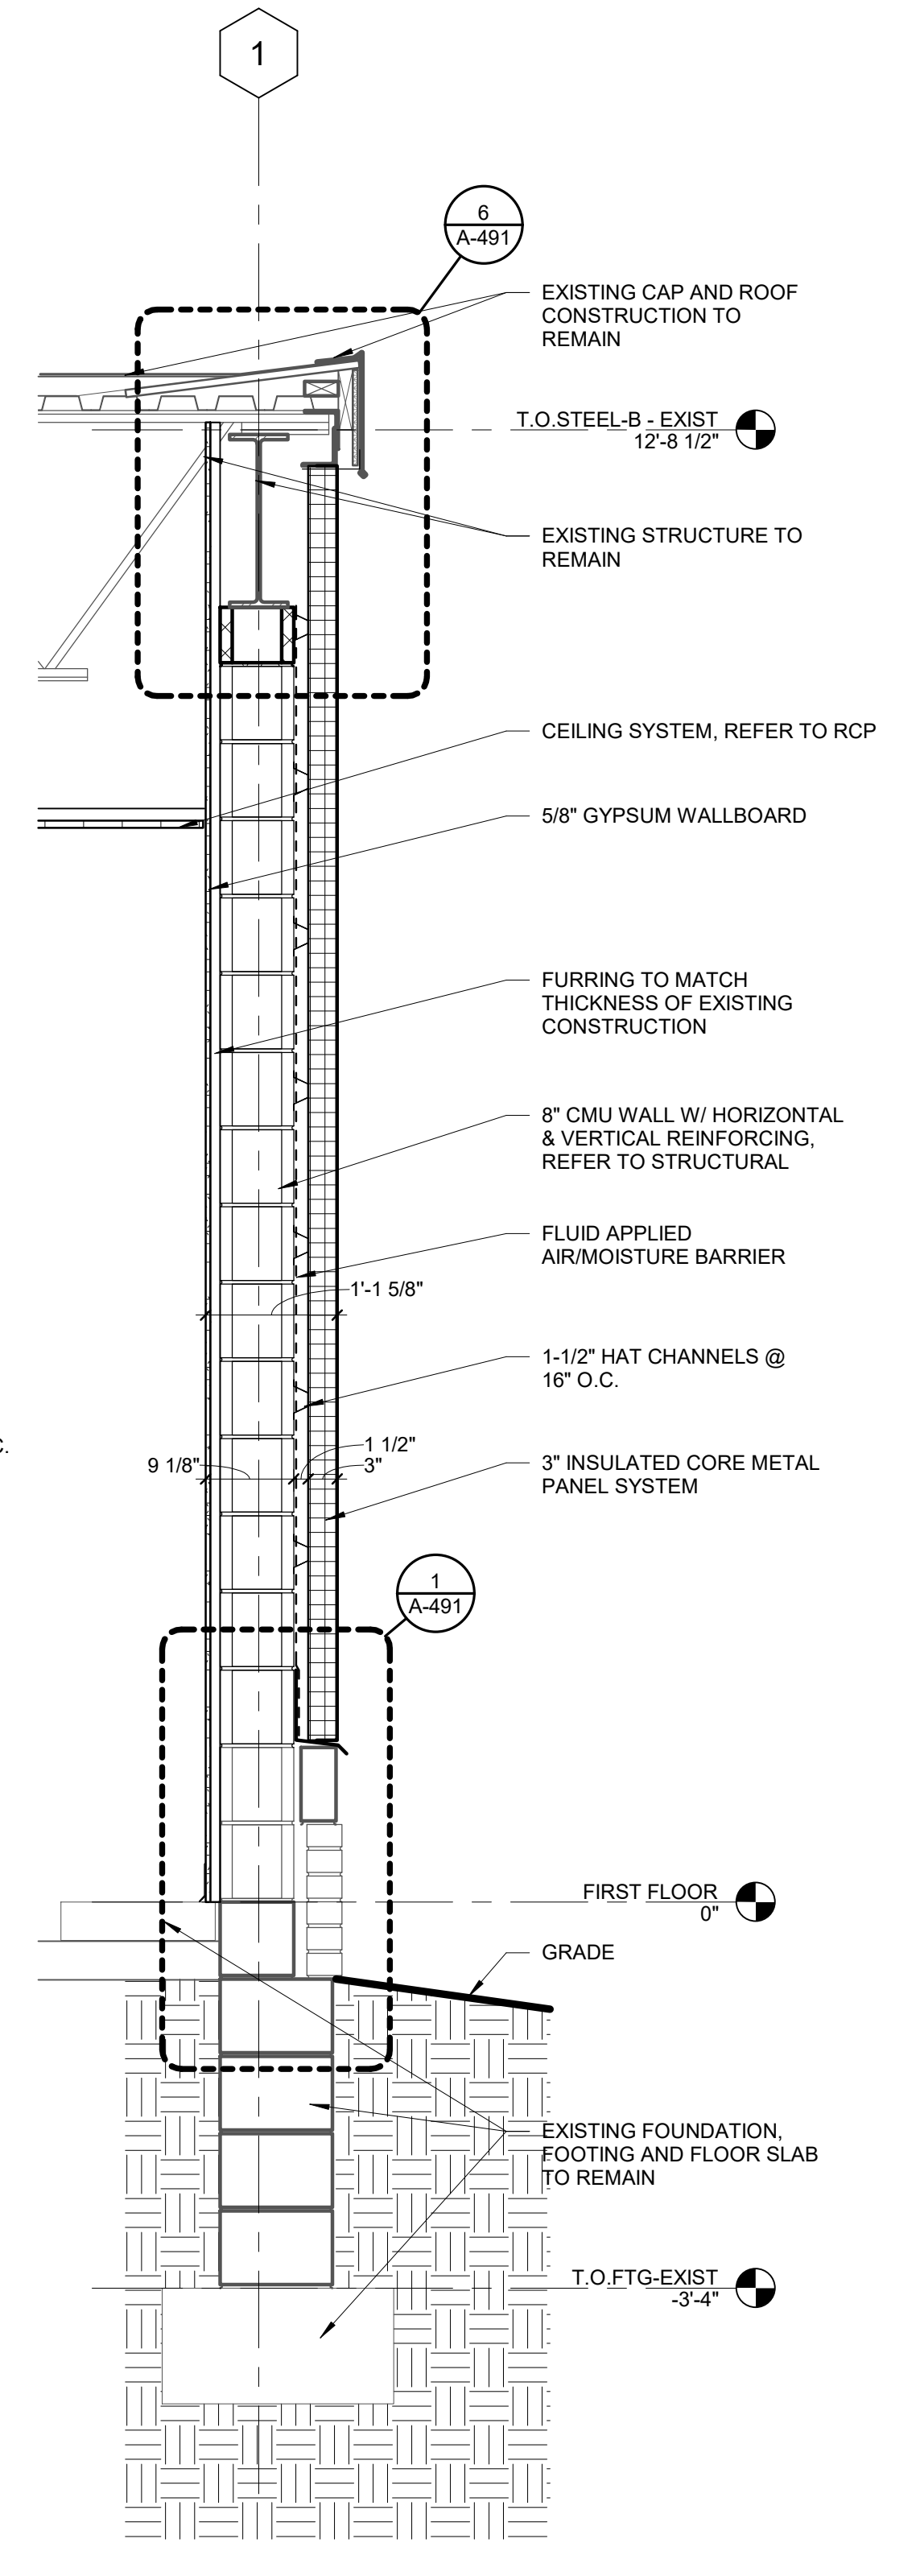

1 WALL SECTION
A-401 3/4" = 1'-0"








FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

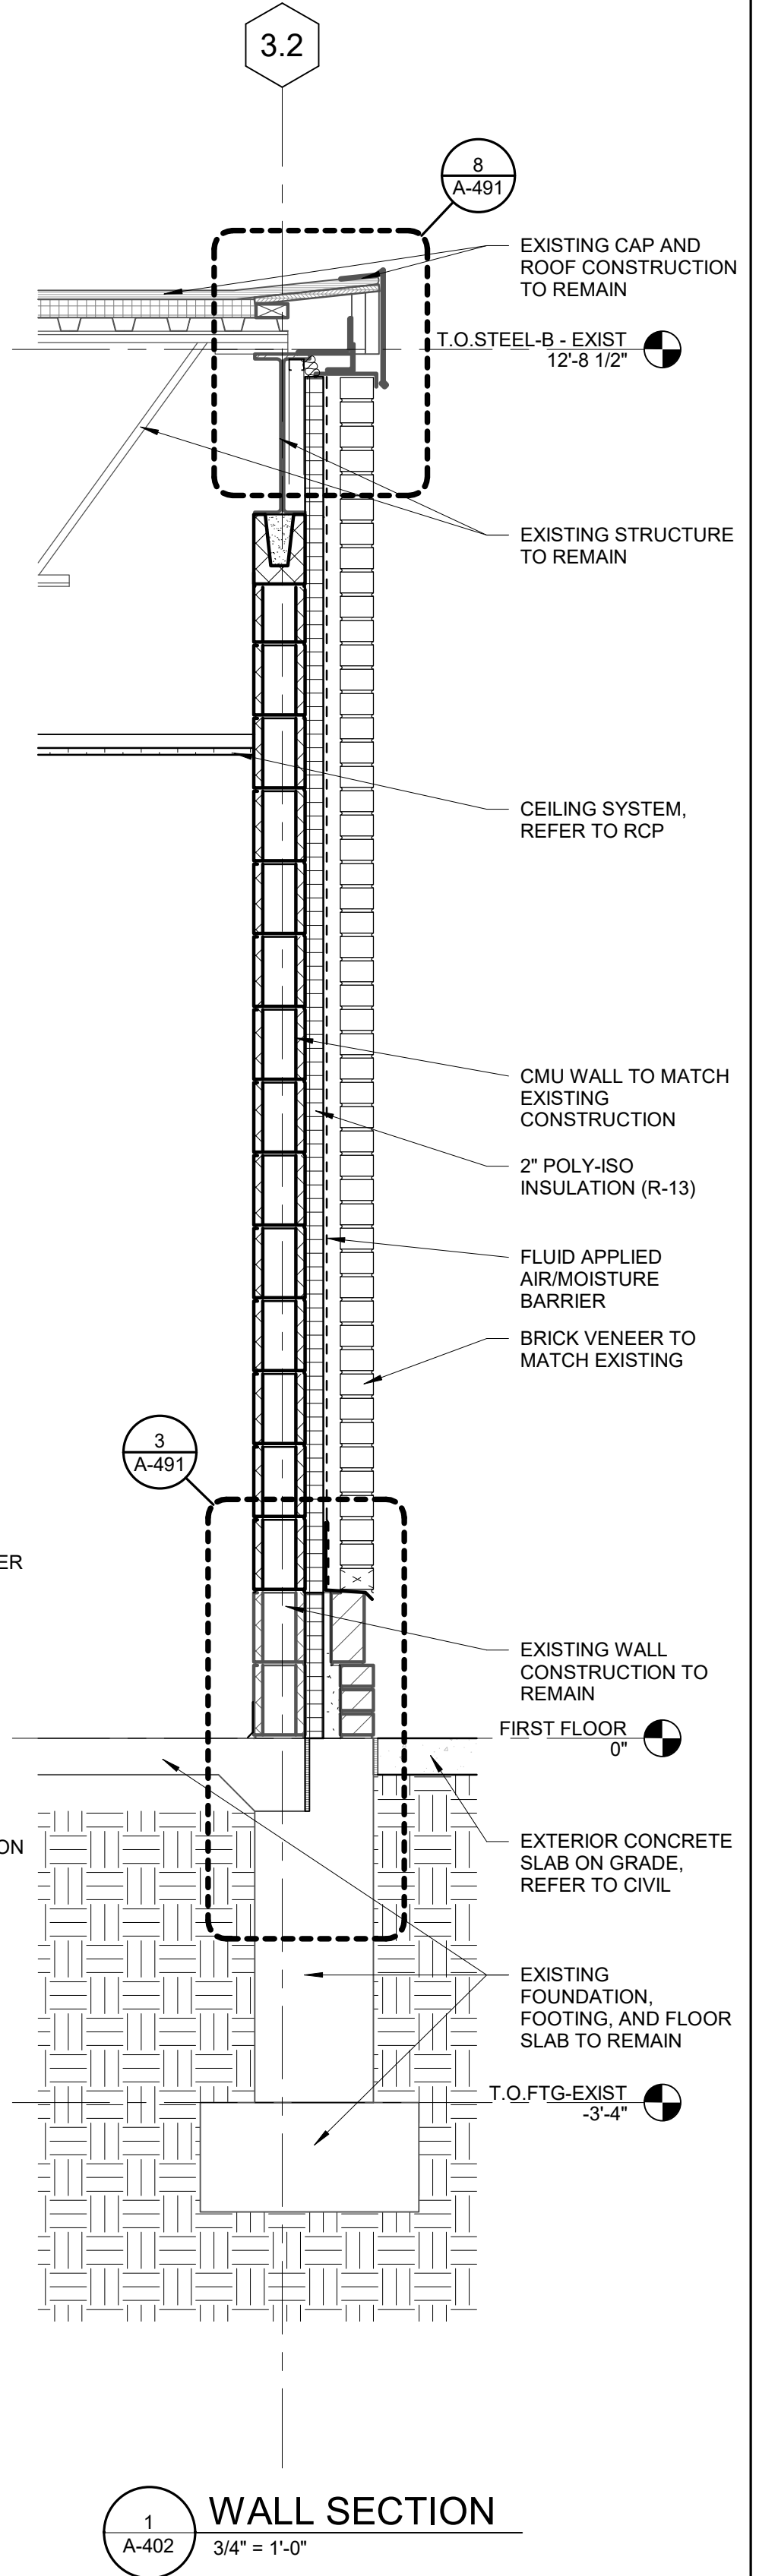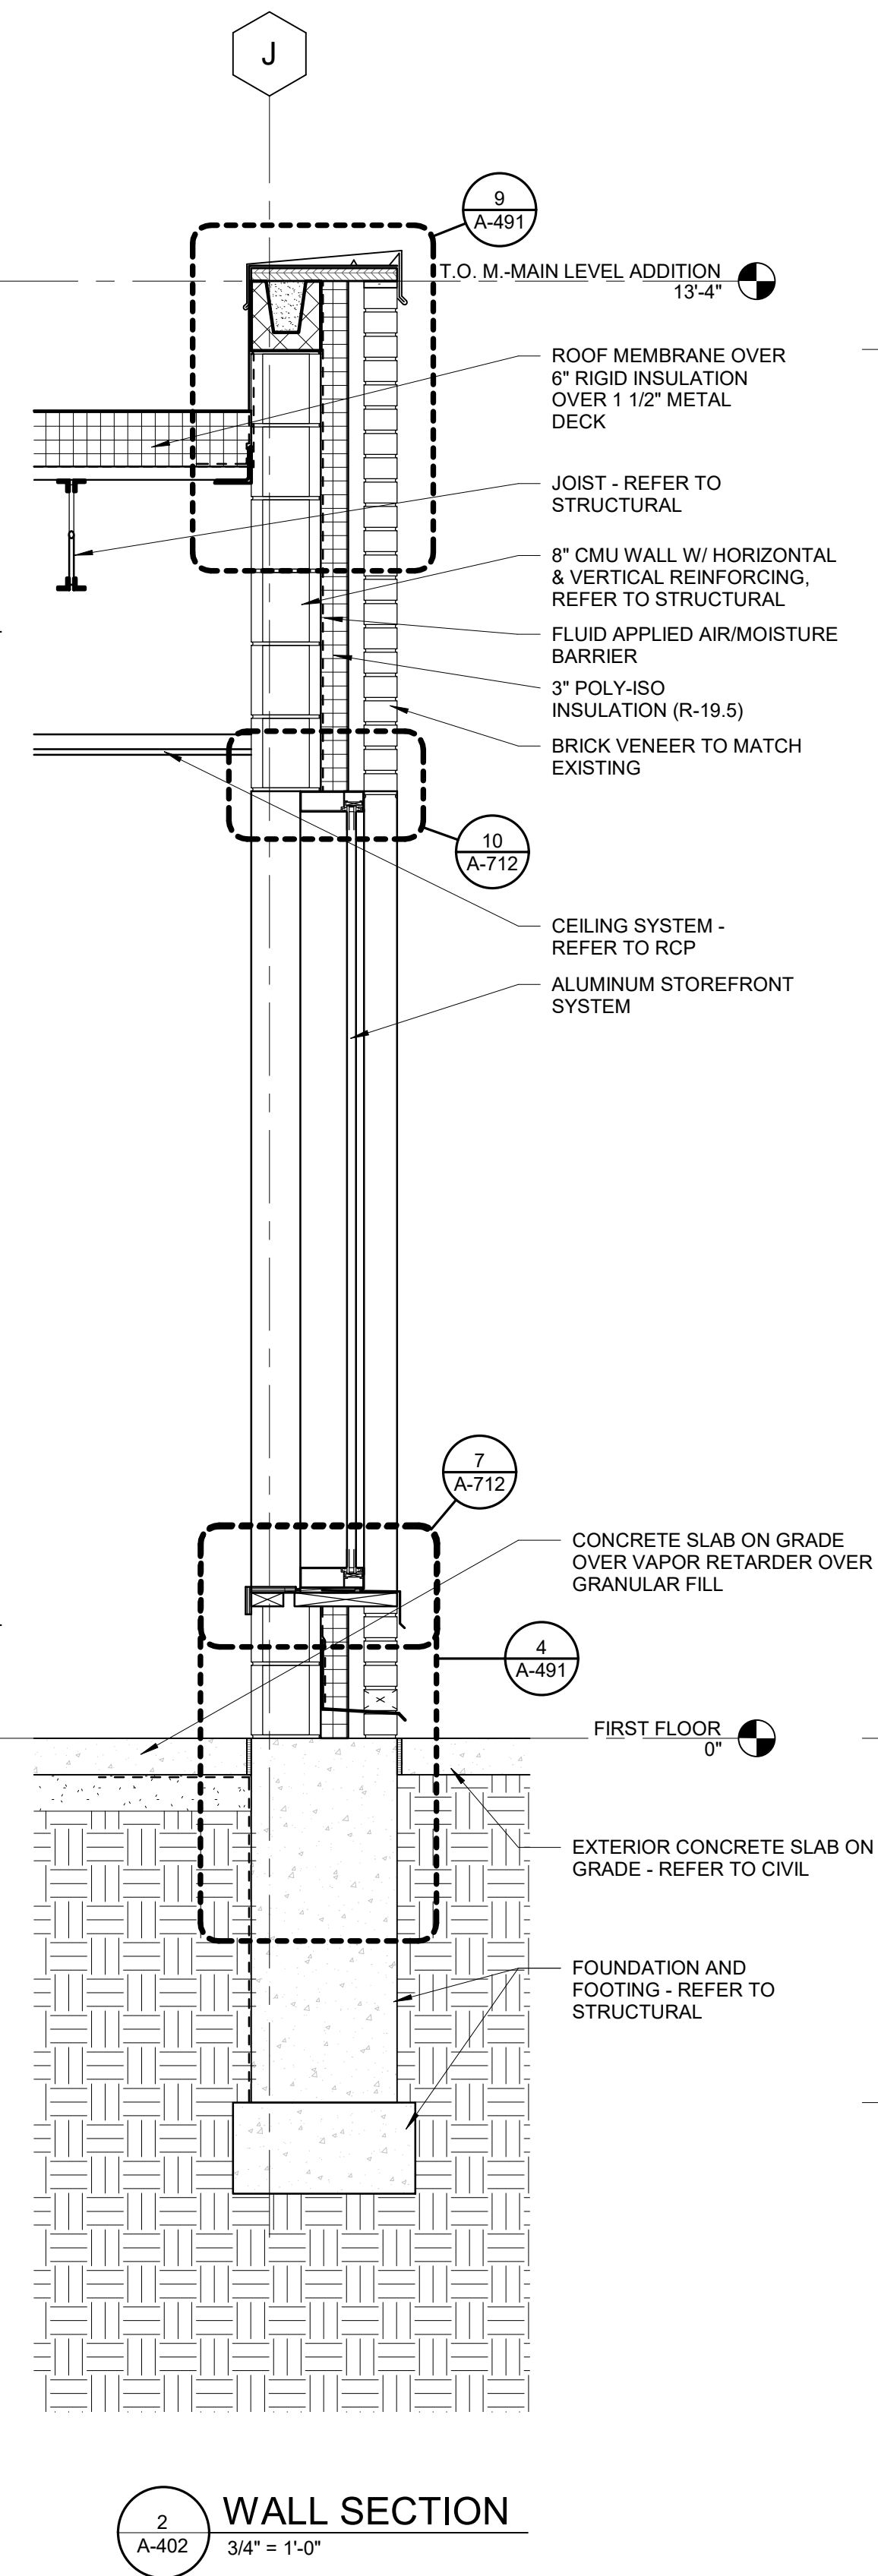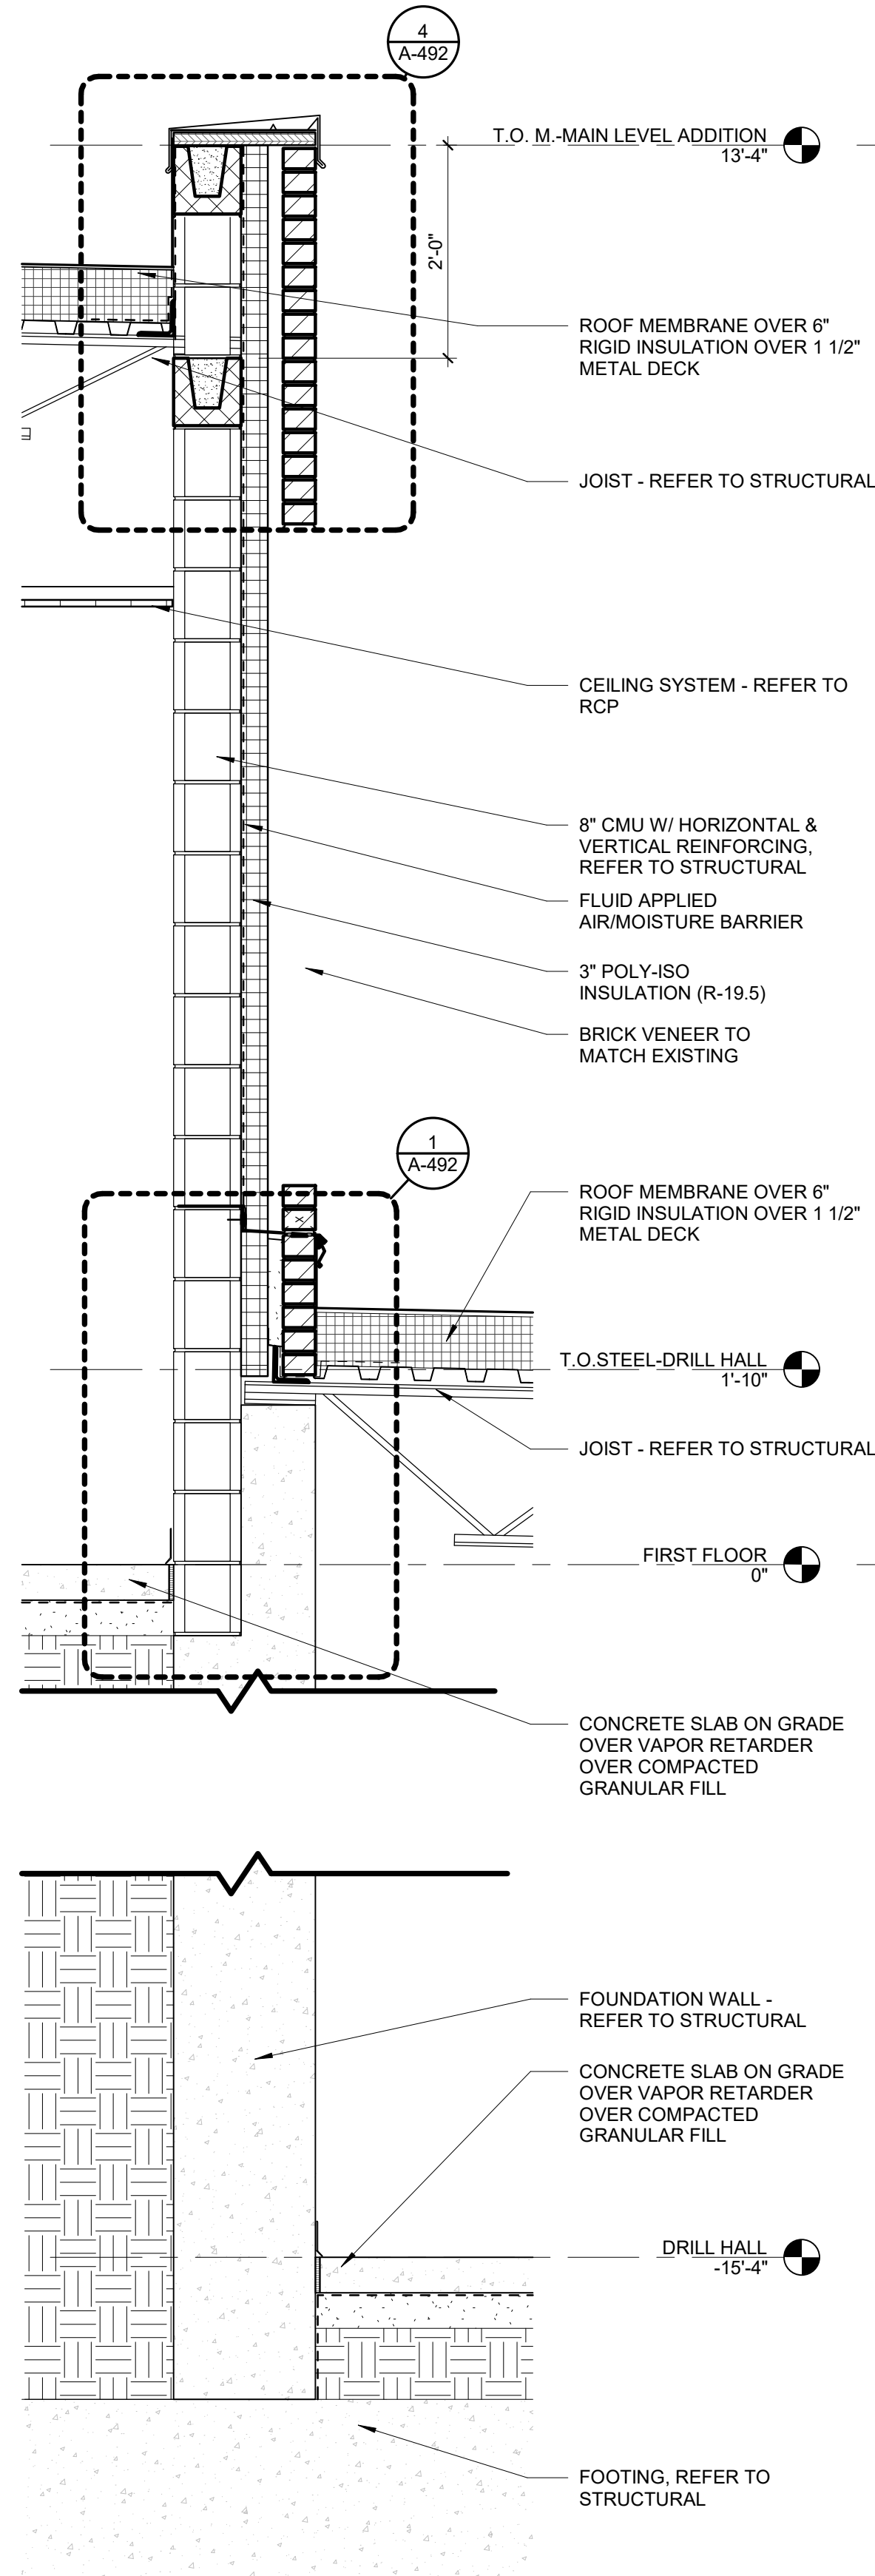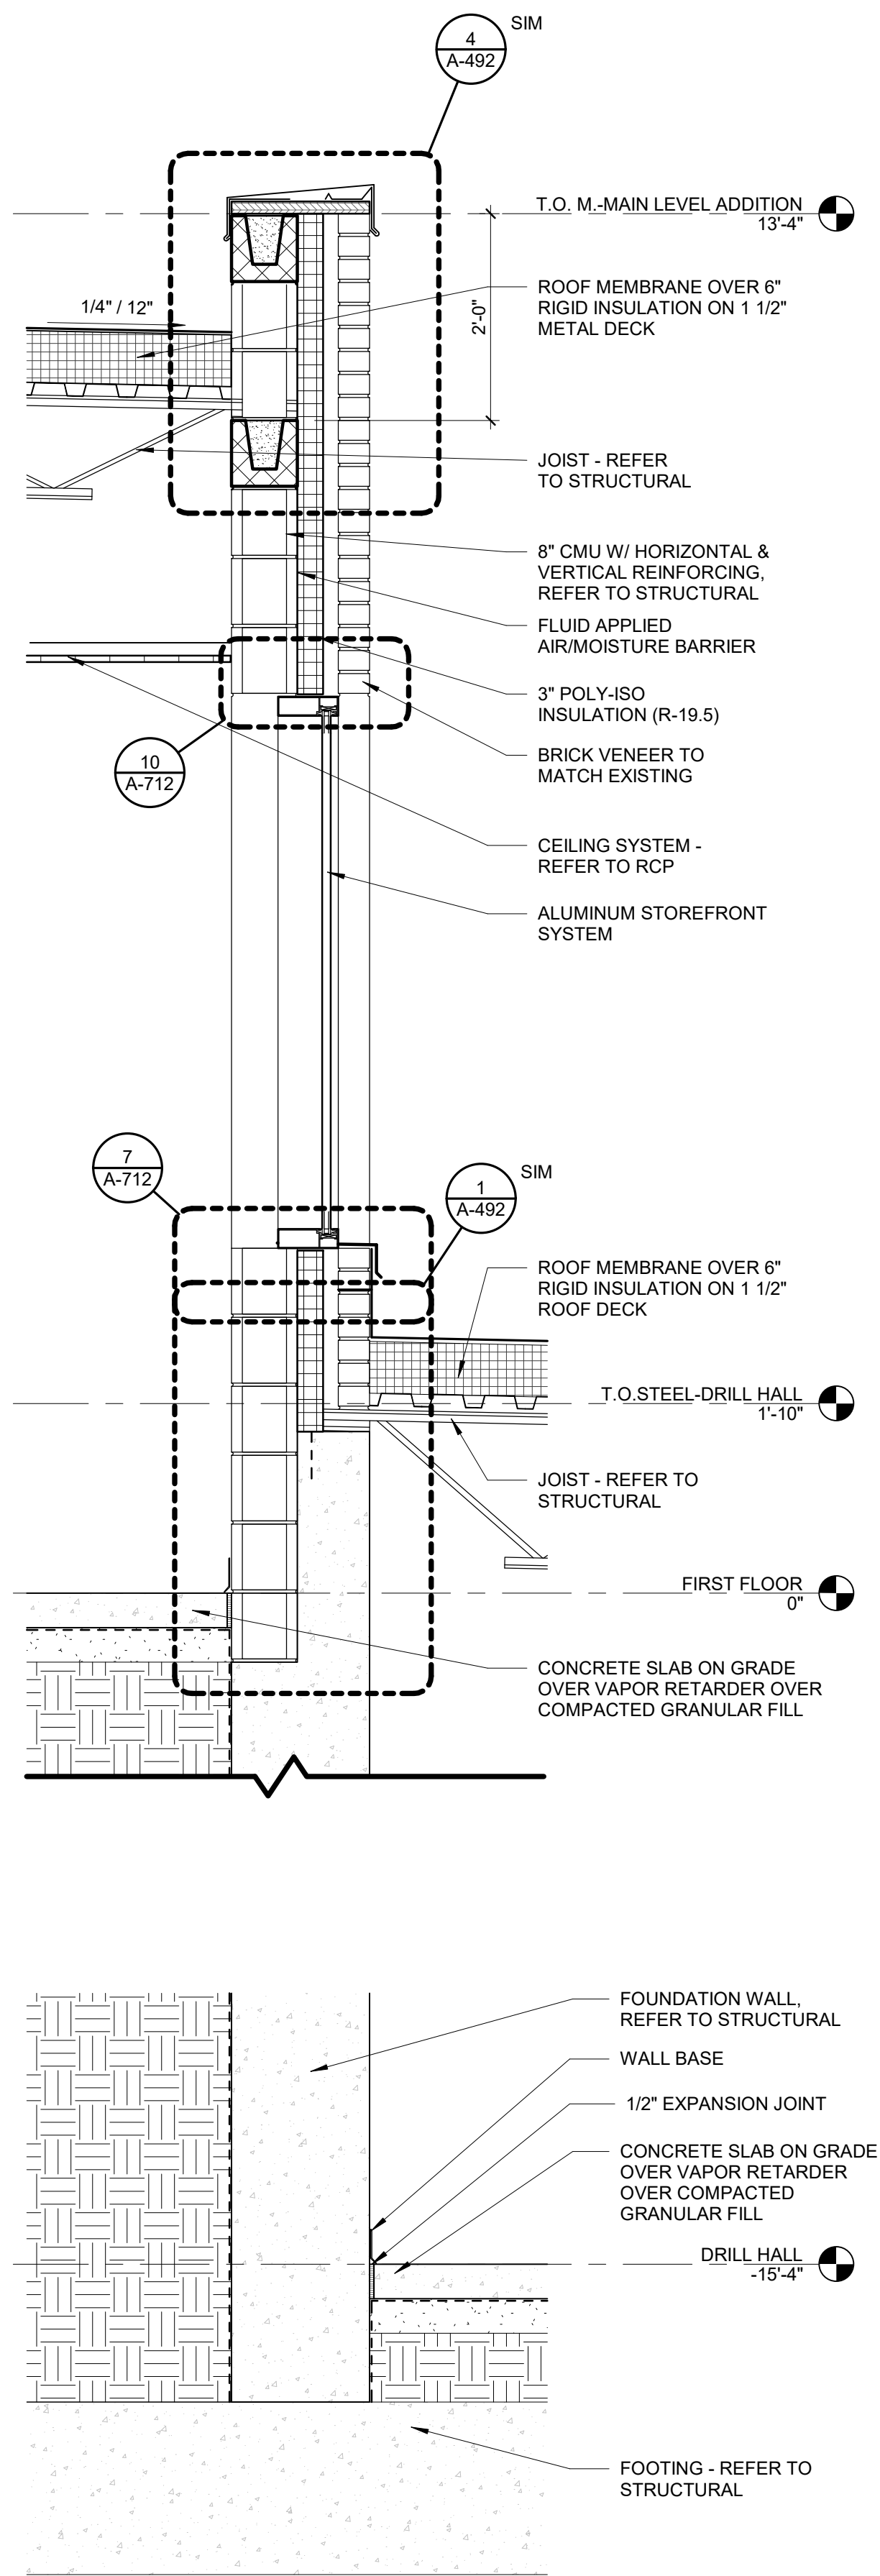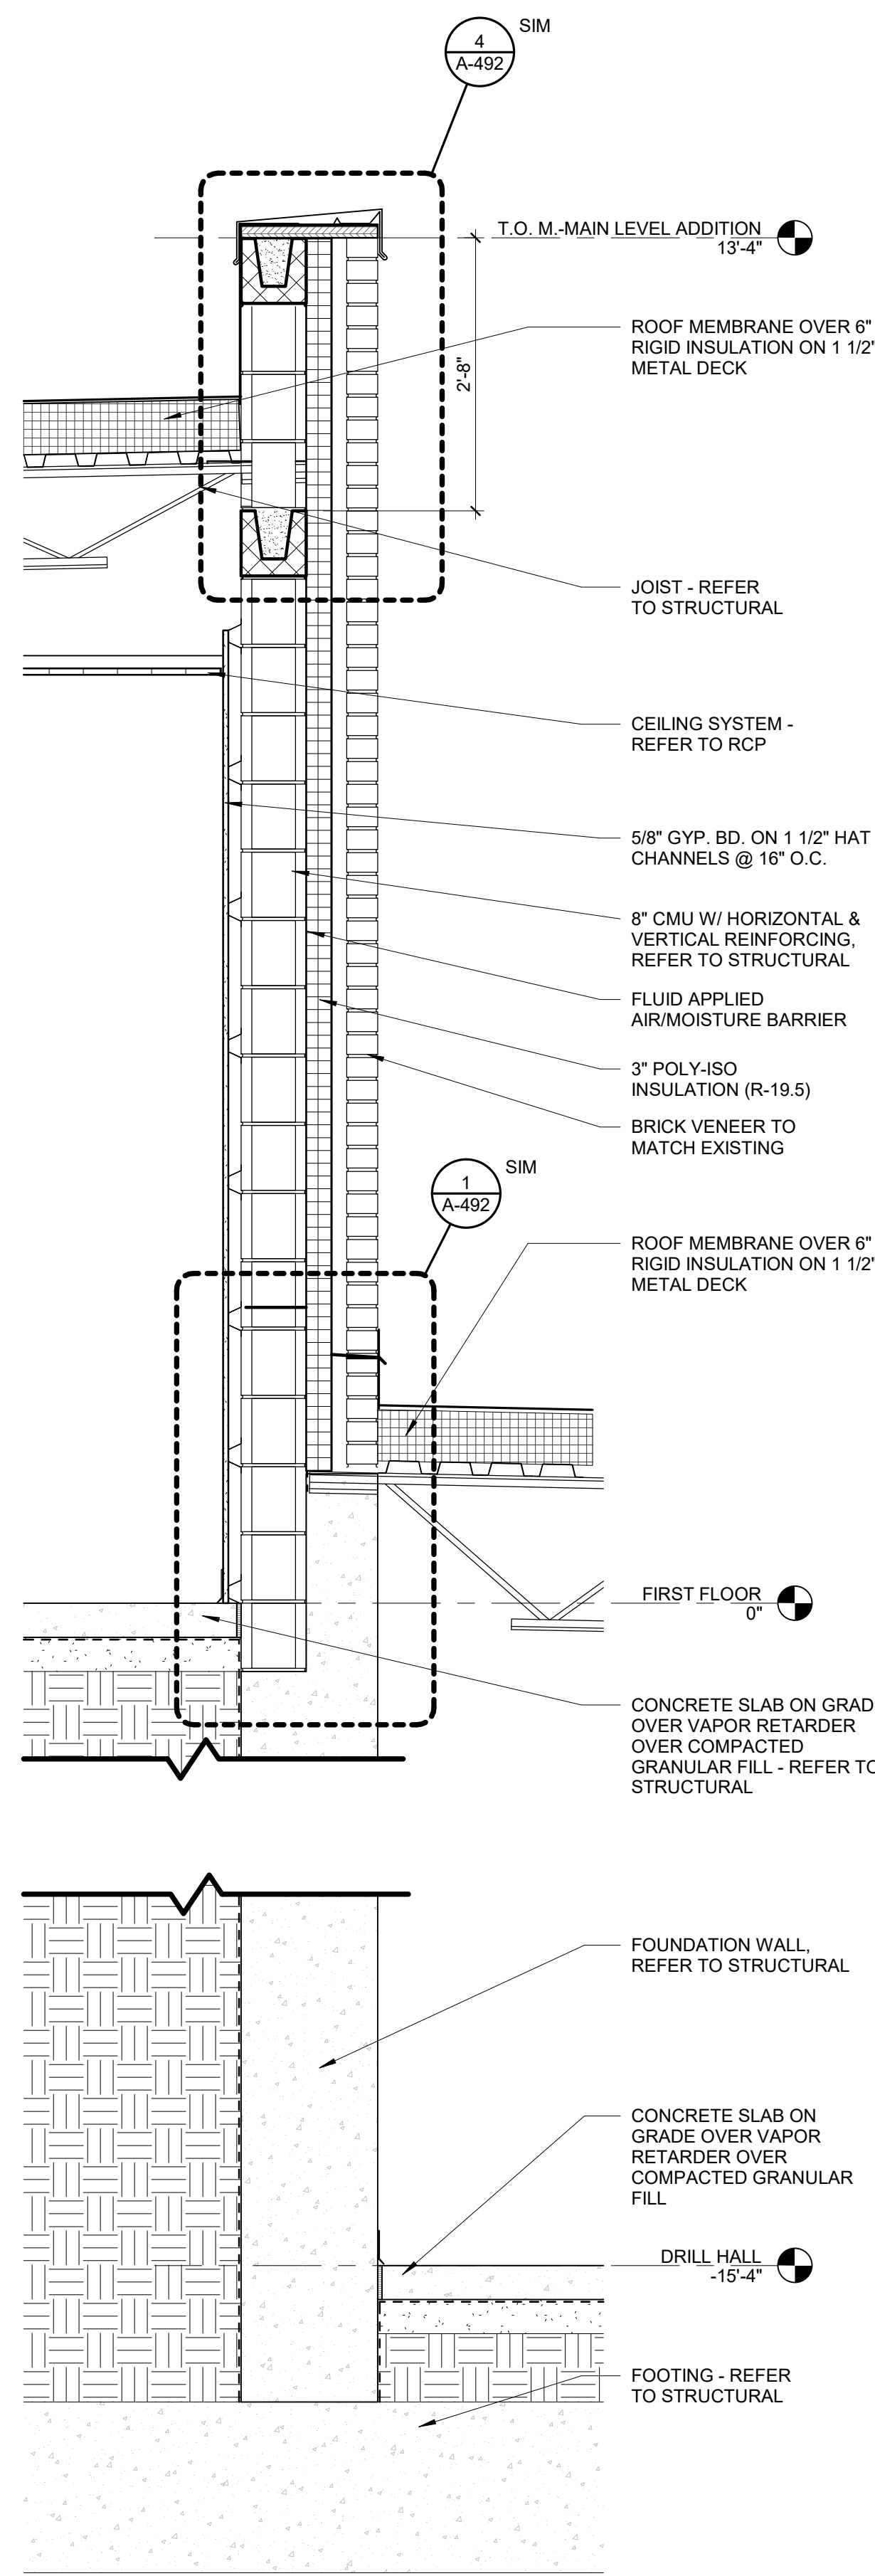

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS


MISSDIG811
FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

STATE OF MICHIGAN
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR

RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

SHEET TITLE	WALL SECTIONS	ISSUED FOR:	DATE	DESIGNED	HL
A-402	SHEET	PRELIMINARY	01/15/26	DRAWN	NCHL
		CONSTRUCTION		CHECKED	TM
		FINAL RECORD		APPROVED	RMR

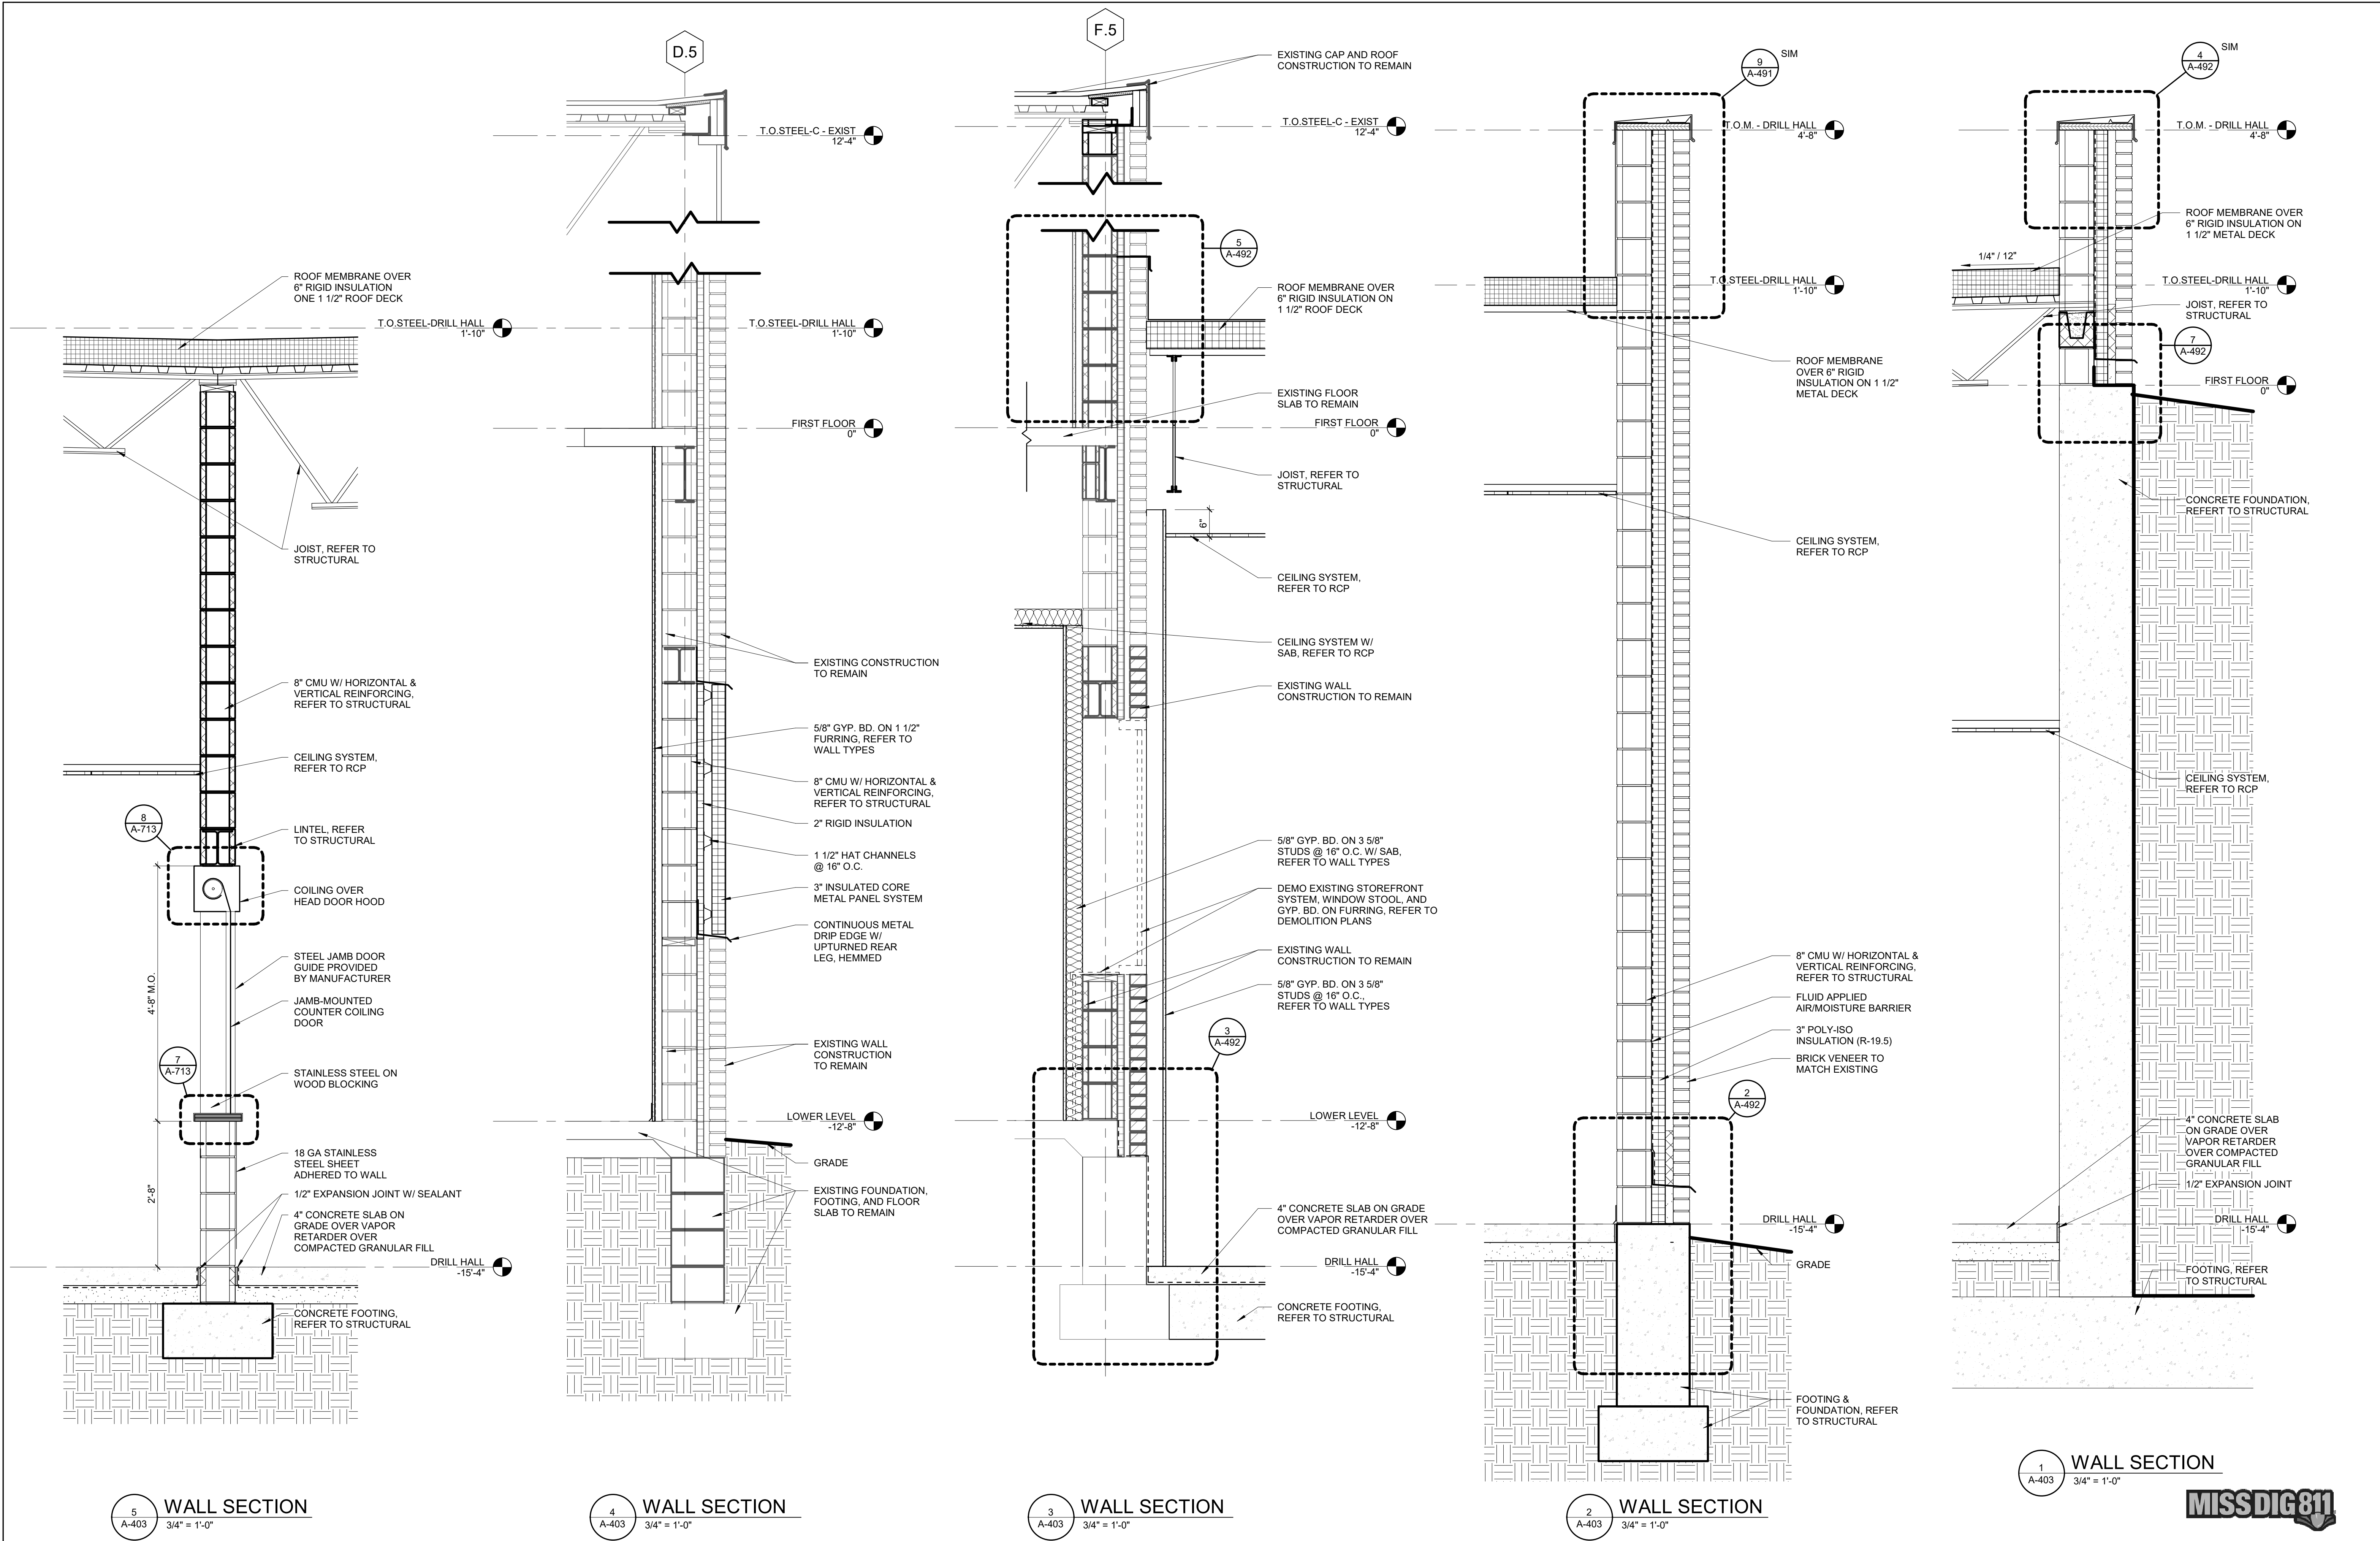

RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

DESIGNED	HL	DATE	ISSUED FOR:	IDENTIFICATION NO:	SHEET
DRAWN	NCHL	01/15/26	PRELIMINARY	PROJECT NO: 25510.A	A-403
CHECKED	TM		CONSTRUCTION	DIVA: 262285007	
APPROVED	RMR		FINAL RECORD	FILE NO/INDEX CODE:	
				51725039.CAK	



FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT




Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS


FOR ADDITIONAL/ SIMILAR
INFORMATION REFER TO

1
A-401


THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF
SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED,
COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR
WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

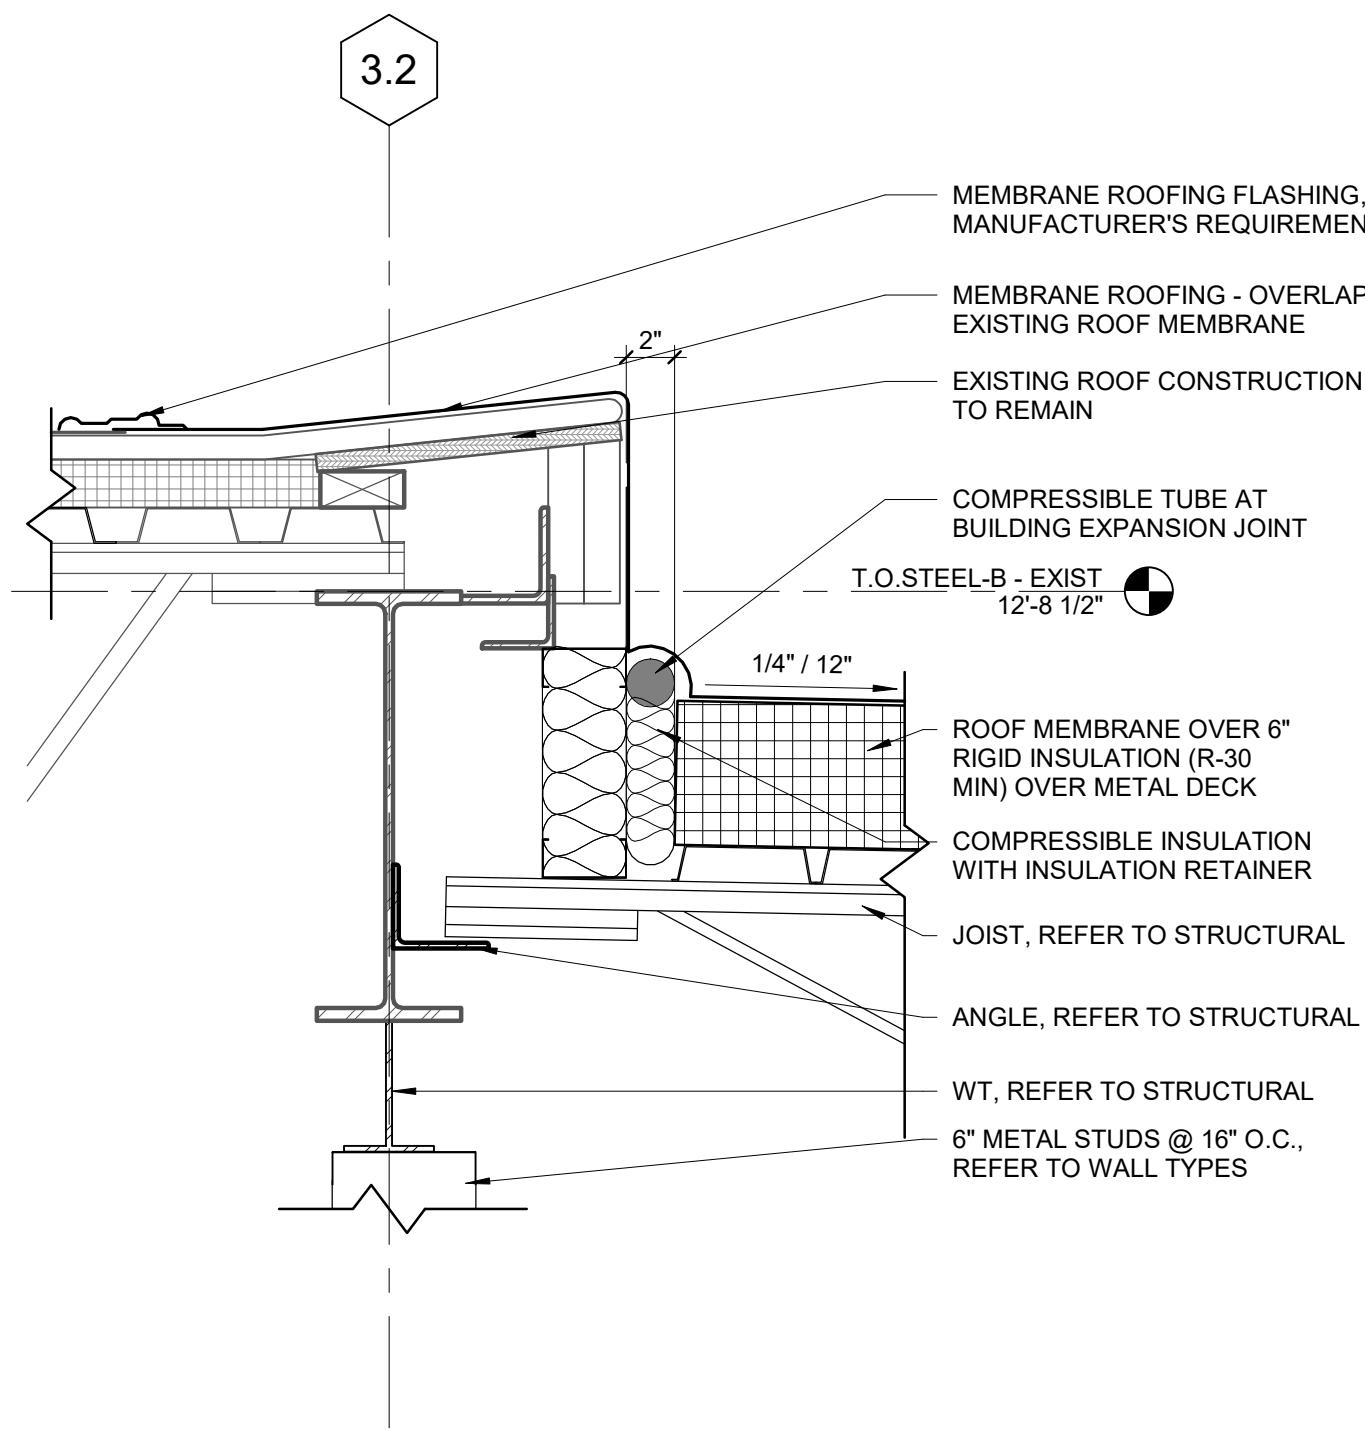


10
A-491
DETAIL @ EXPANSION JOINT
1 1/2" = 1'-0"

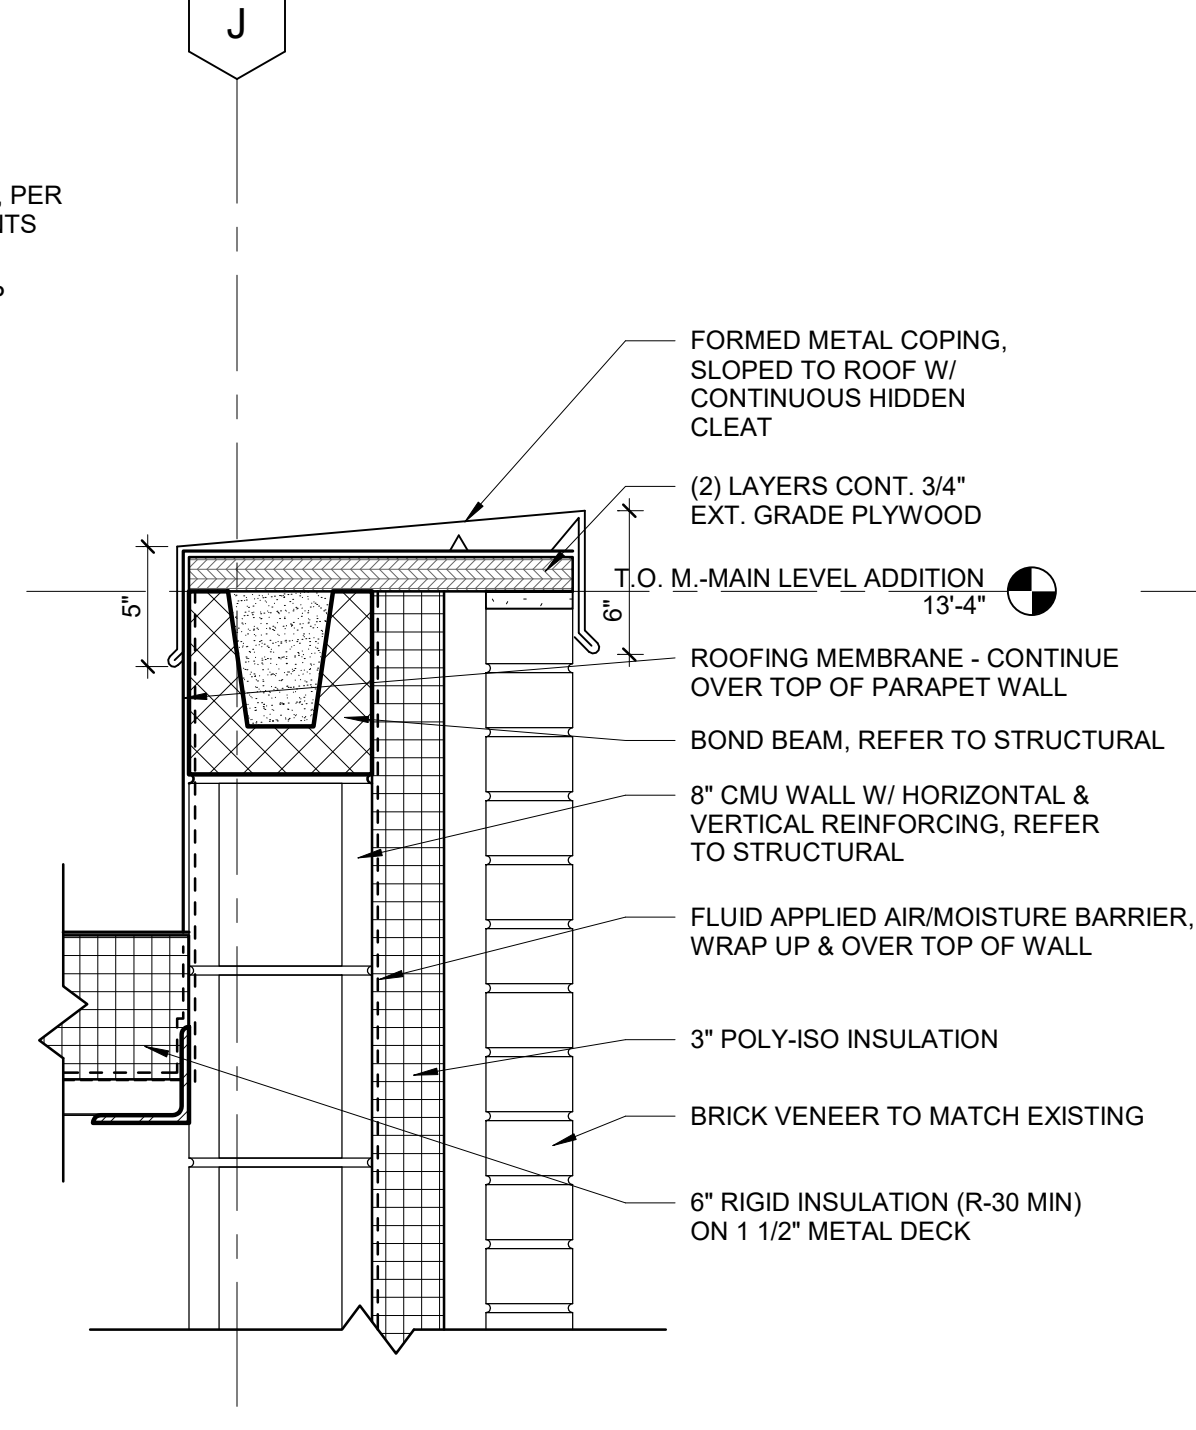


9
A-491
SECTION DETAIL
1 1/2" = 1'-0"

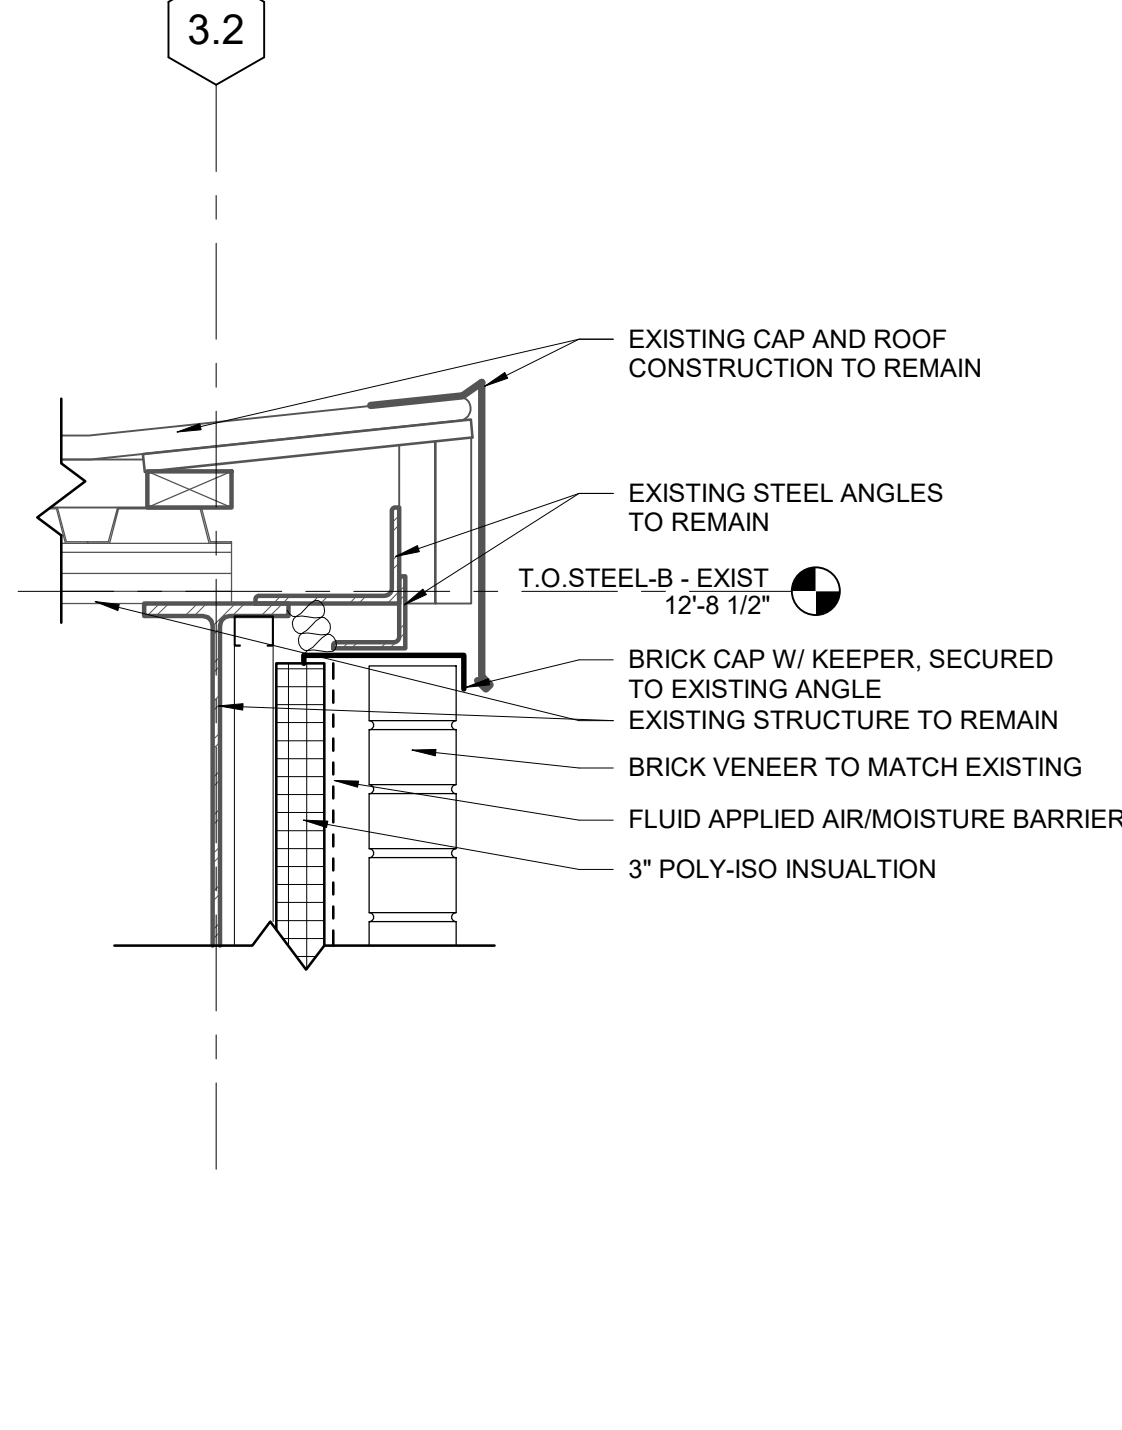


8
A-491
SECTION DETAIL
1 1/2" = 1'-0"

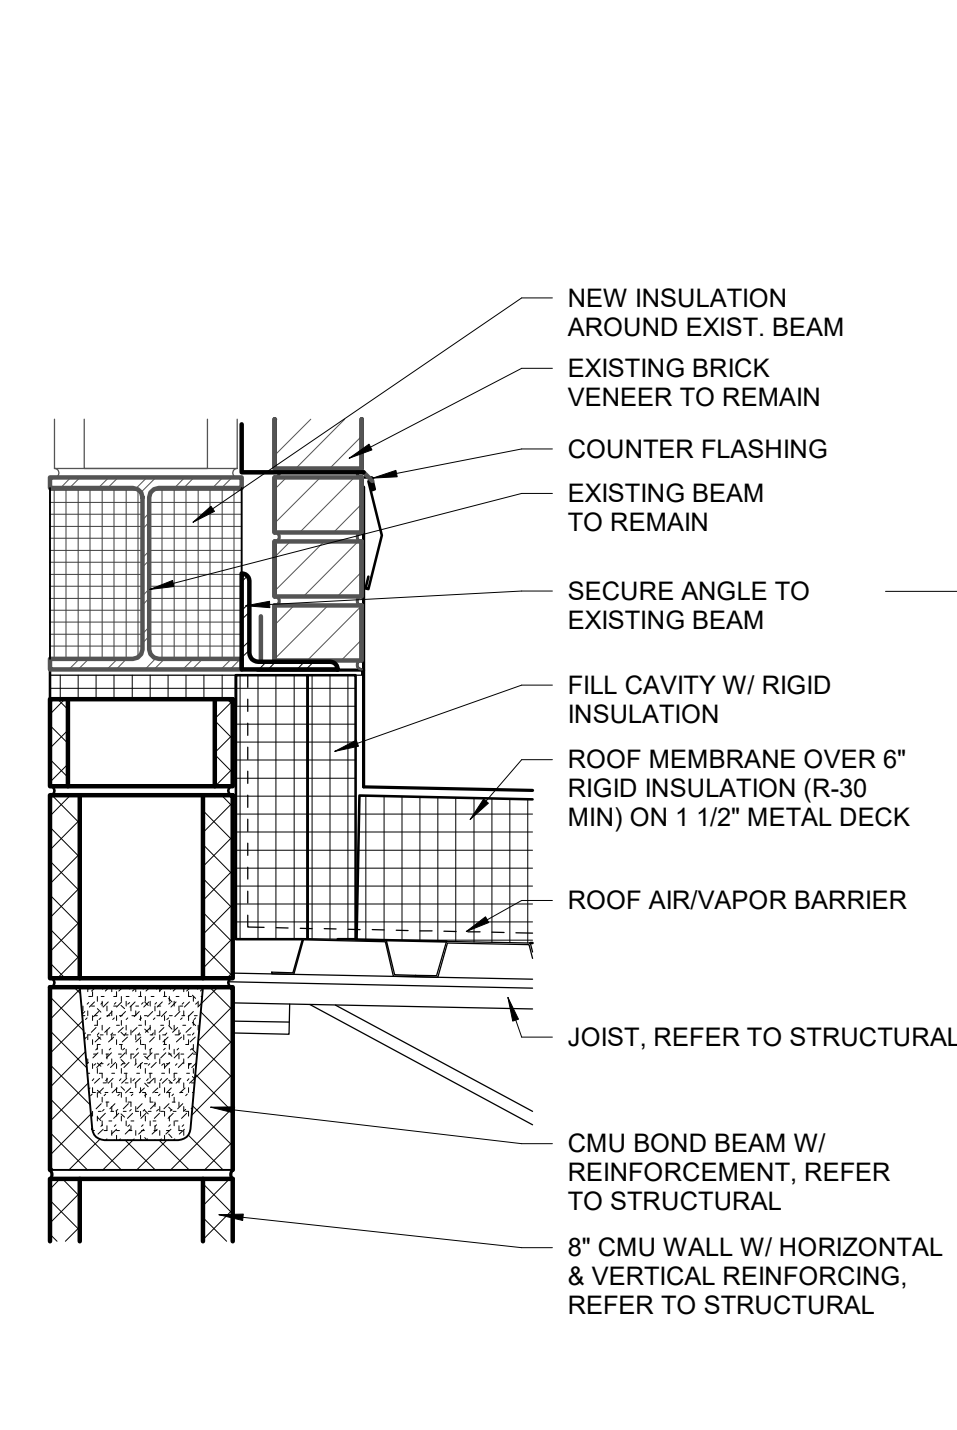


7
A-491
SECTION DETAIL
1 1/2" = 1'-0"

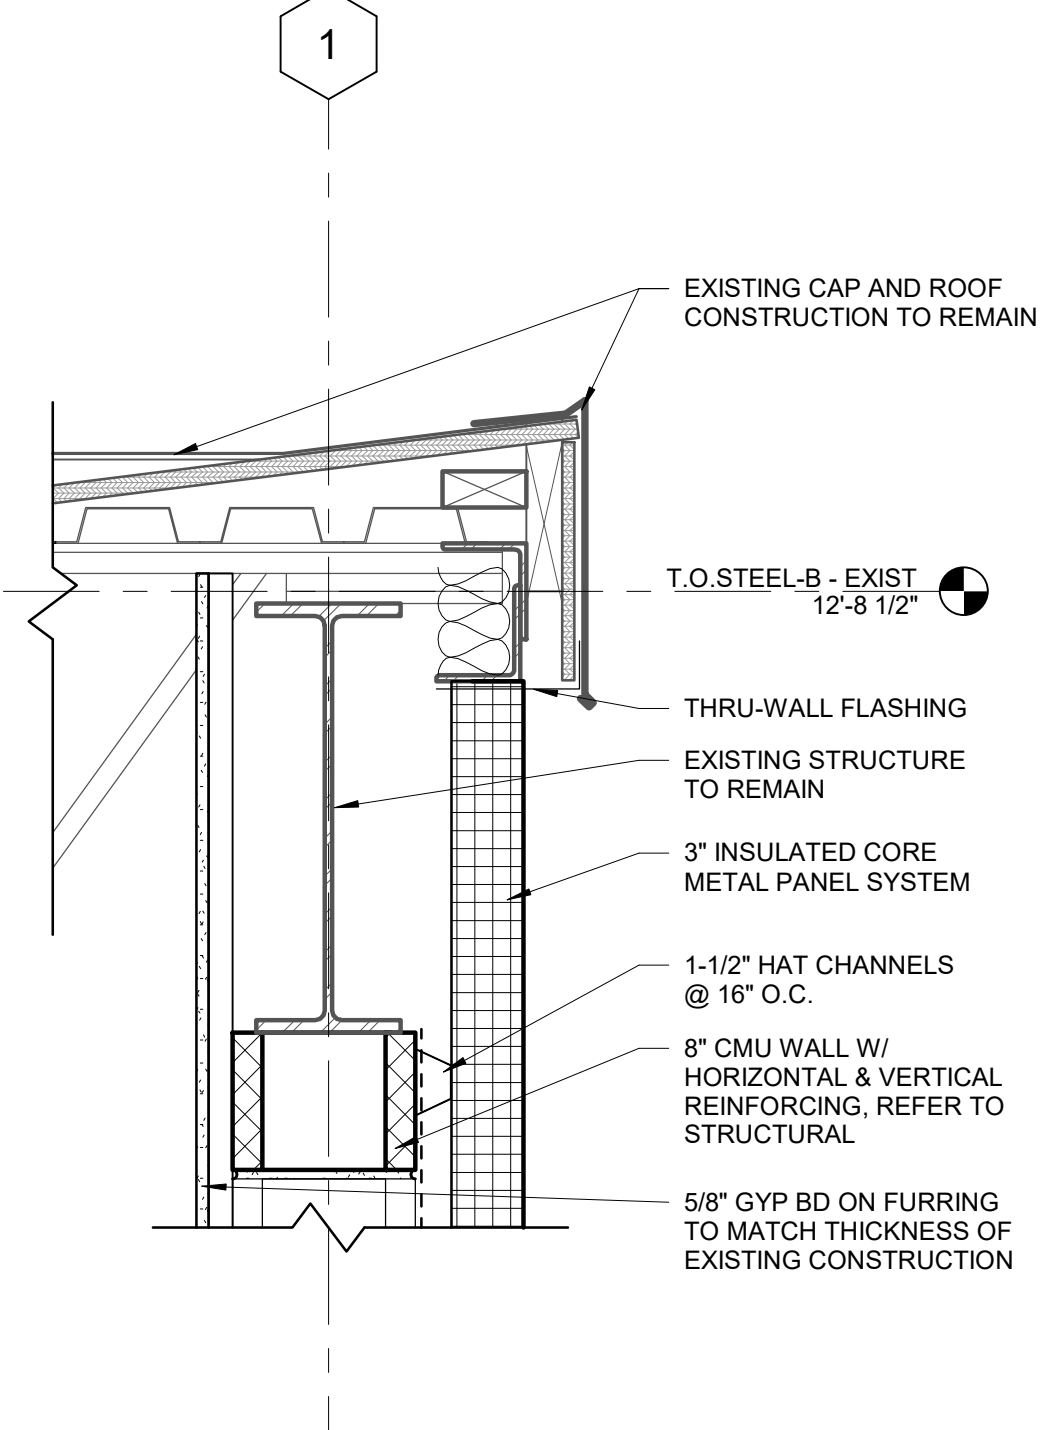


6
A-491
SECTION DETAIL
1 1/2" = 1'-0"

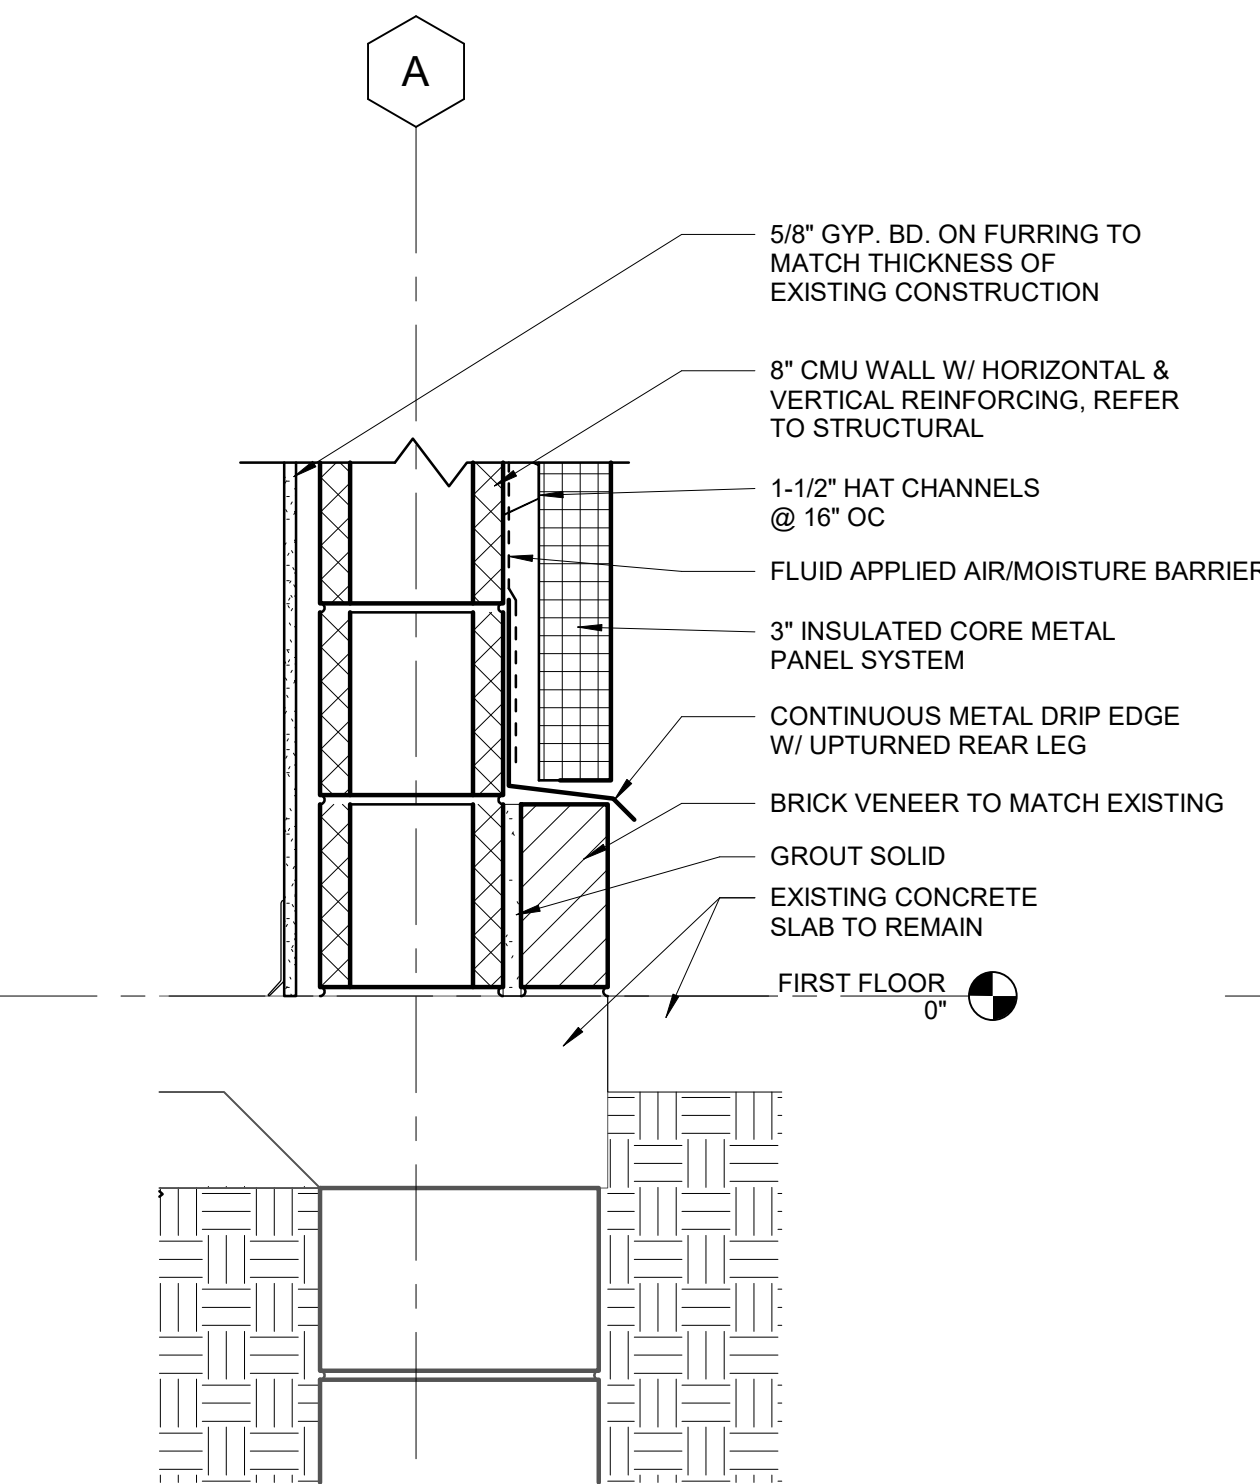


5
A-491
SECTION DETAIL
1 1/2" = 1'-0"

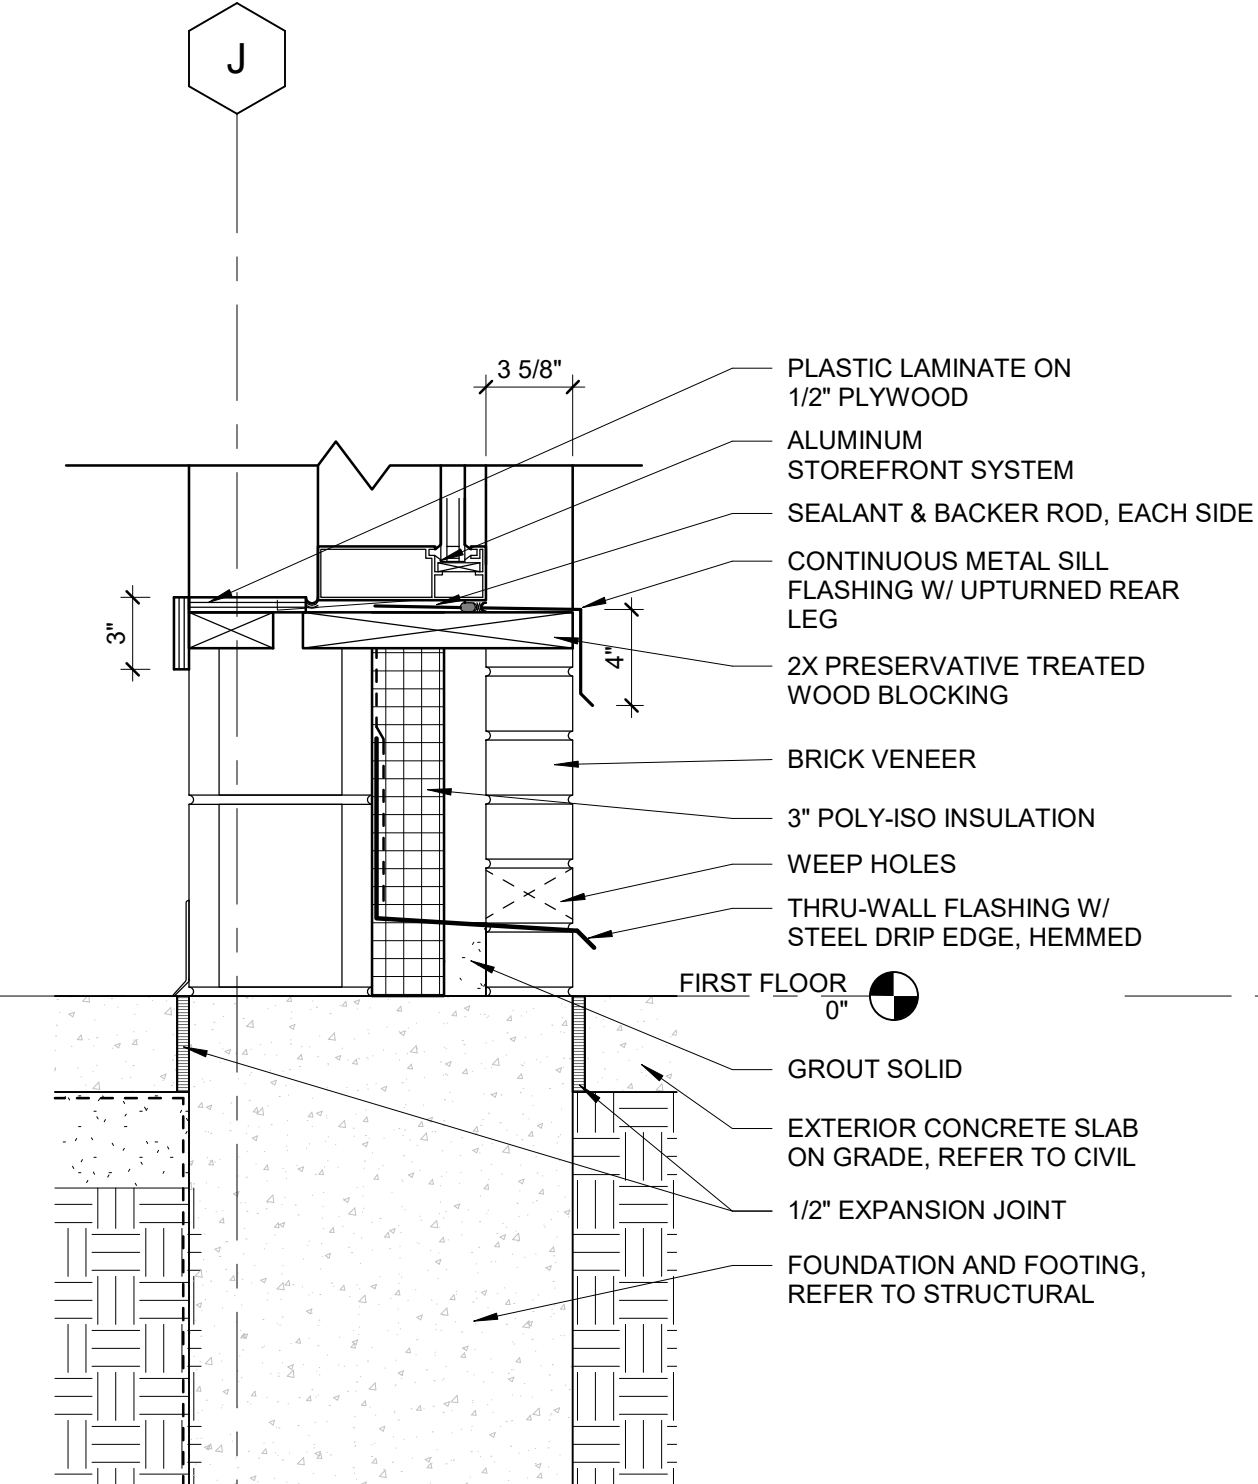


4
A-491
SECTION DETAIL
1 1/2" = 1'-0"

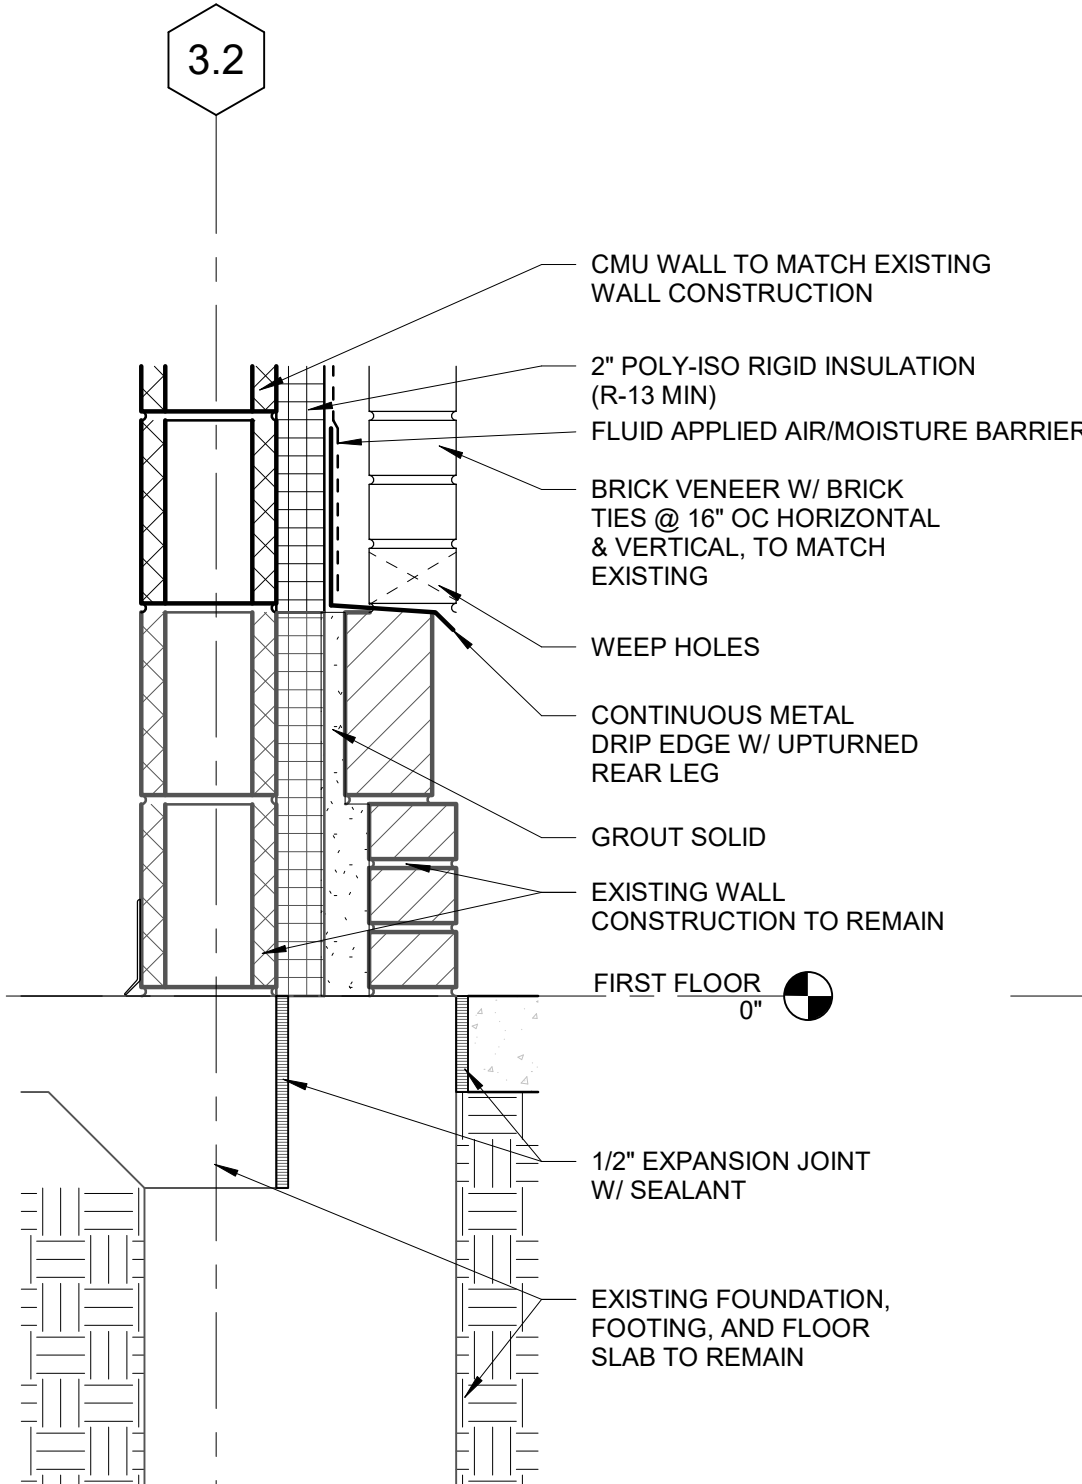

3
A-491
SECTION DETAIL
1 1/2" = 1'-0"

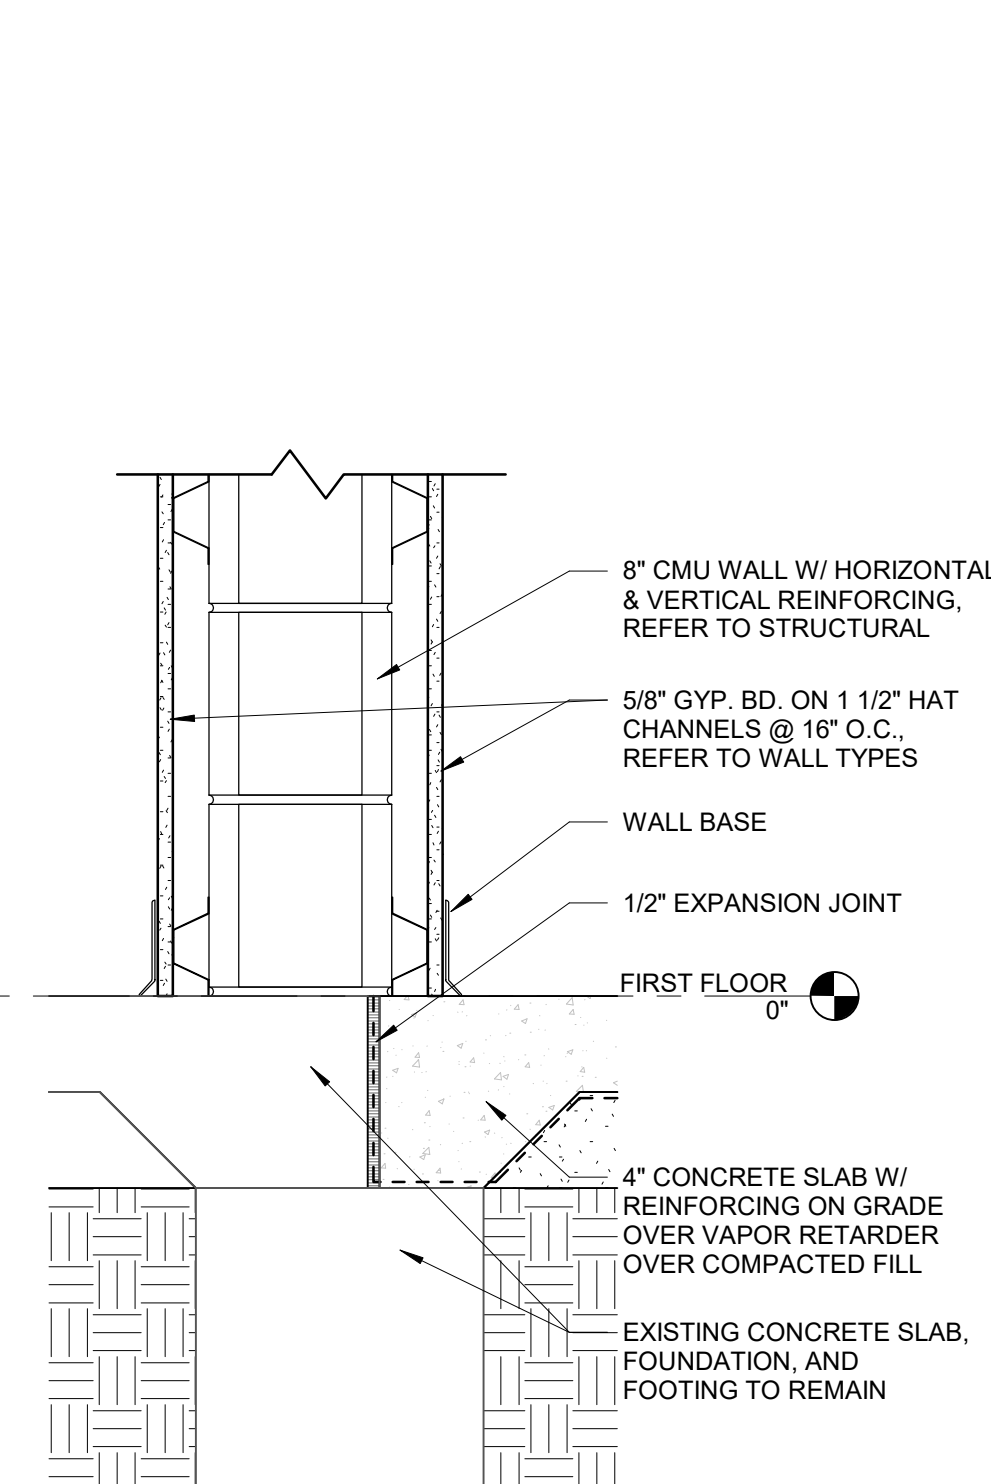

2
A-491
SECTION DETAIL
1 1/2" = 1'-0"

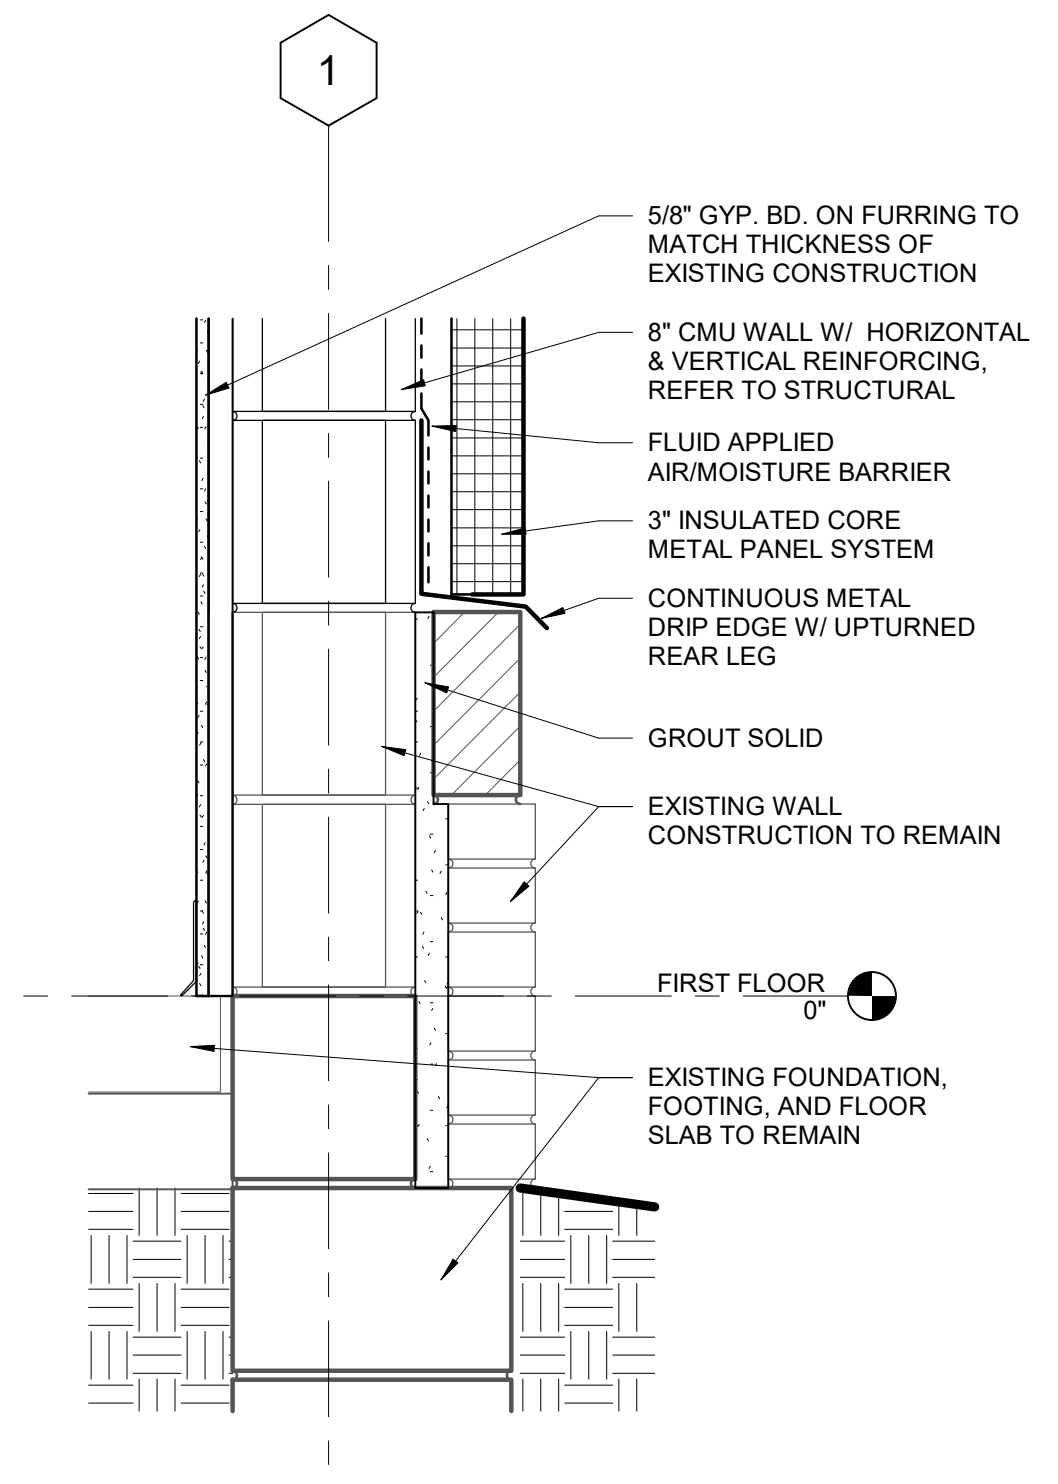

1
A-491
SECTION DETAIL
1 1/2" = 1'-0"




FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT




Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS


THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

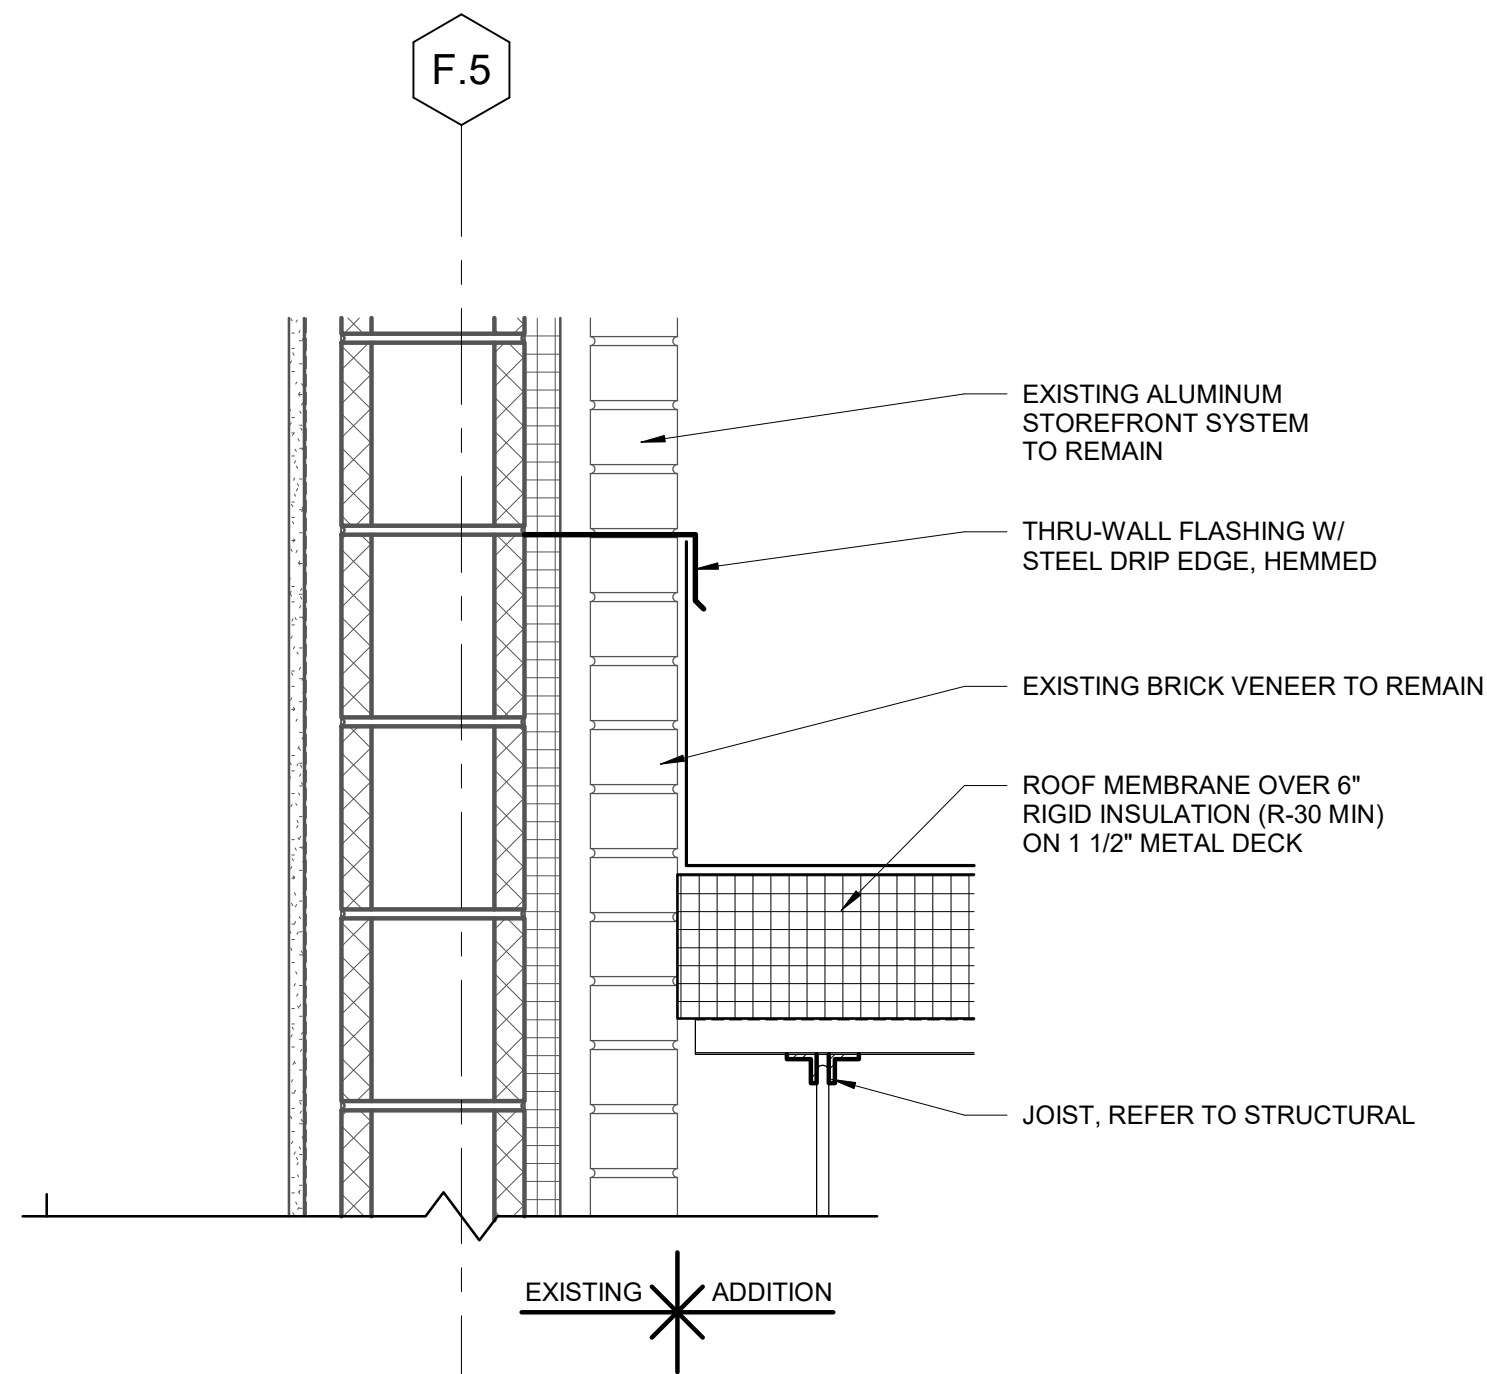


5
A-492
SECTION DETAIL
1 1/2" = 1'-0"

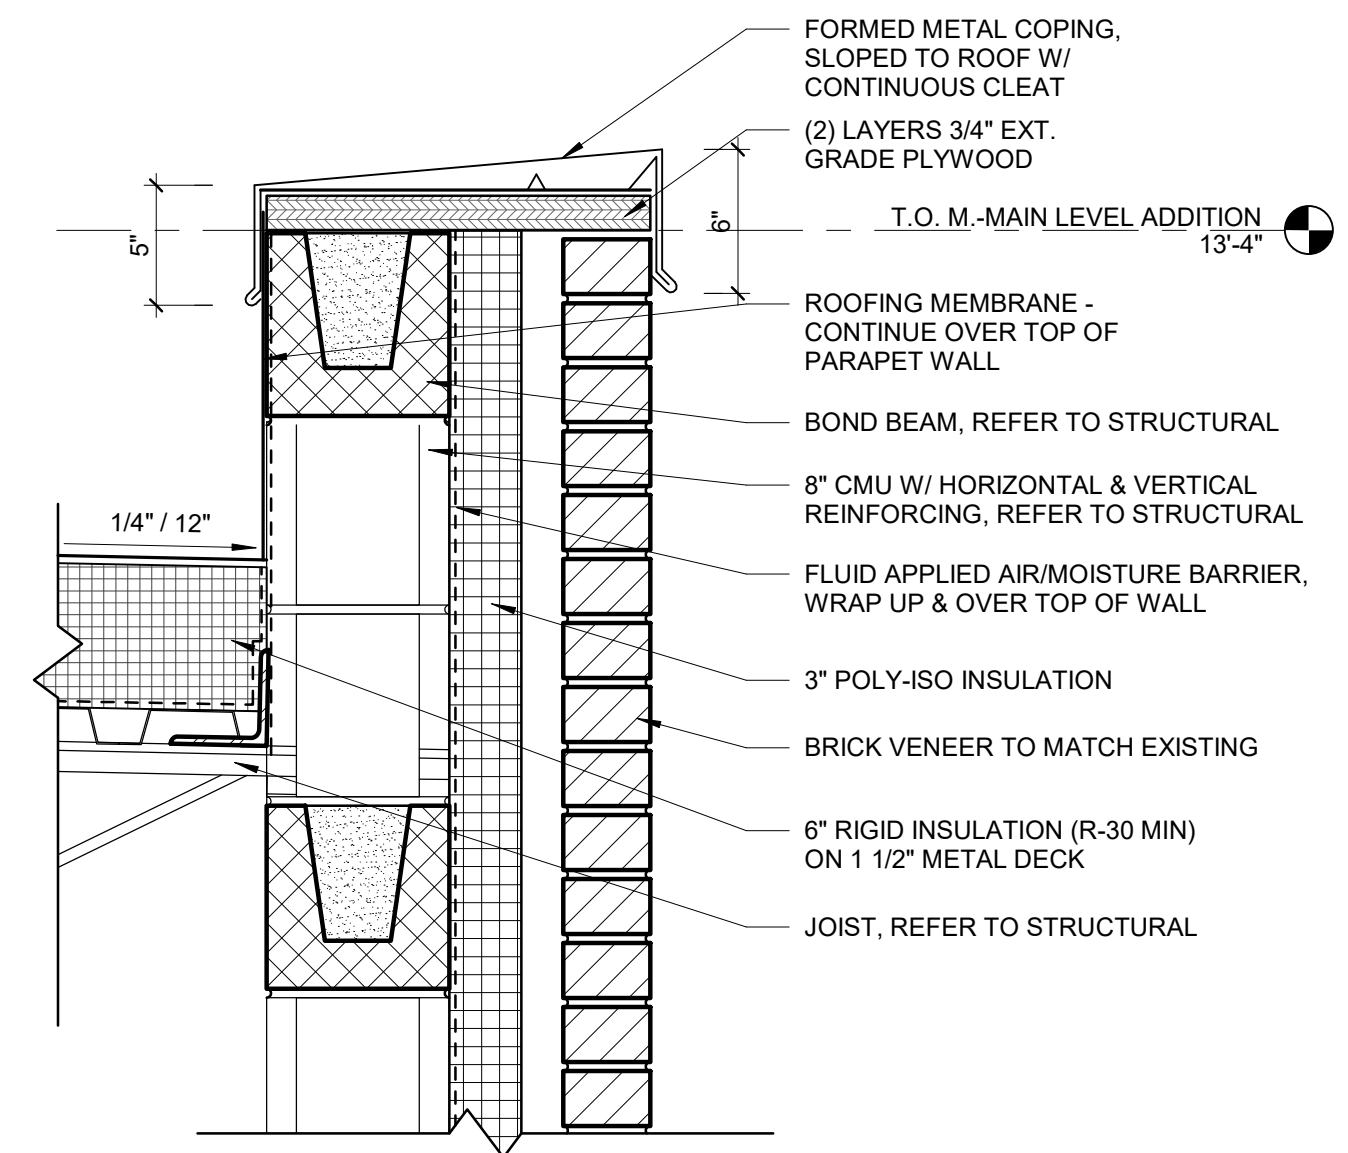


4
A-492
SECTION DETAIL
1 1/2" = 1'-0"

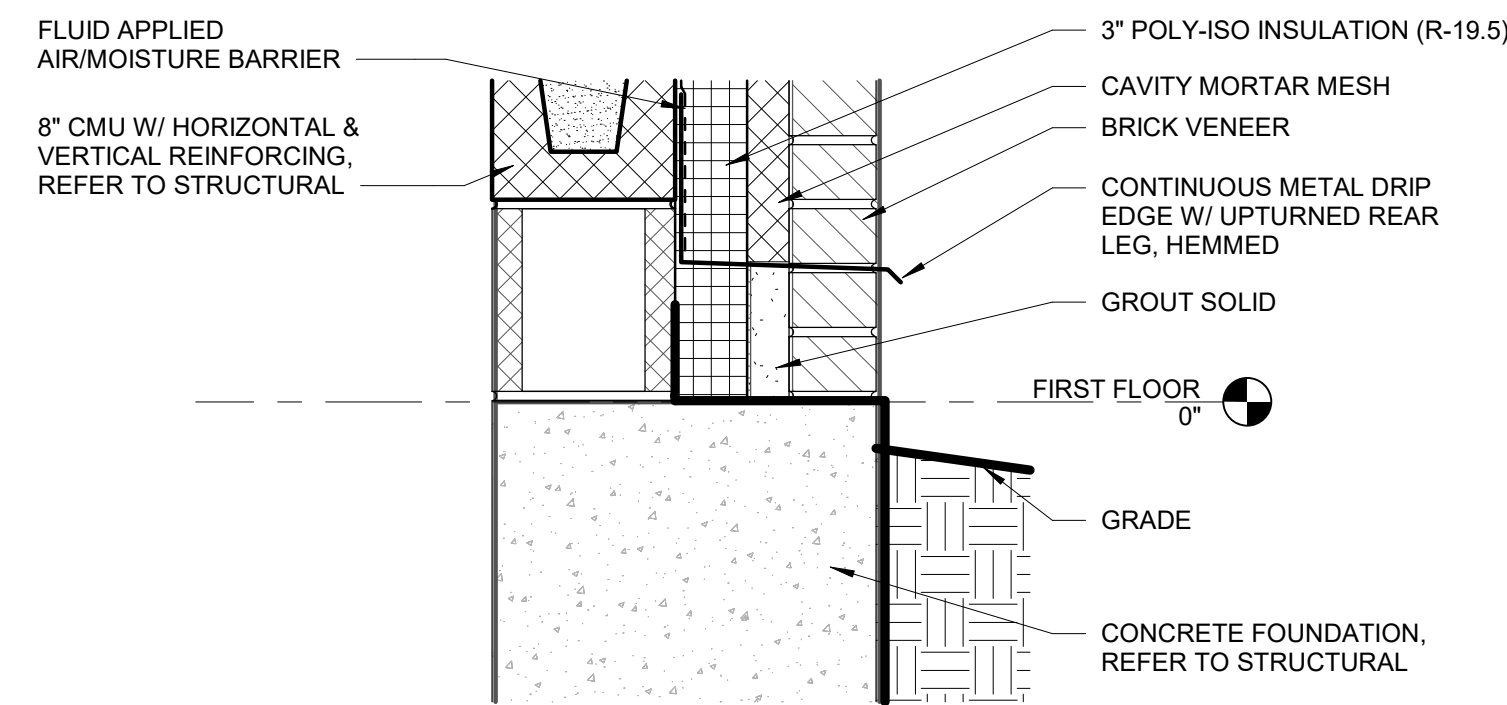


7
A-492
SECTION DETAIL
1 1/2" = 1'-0"

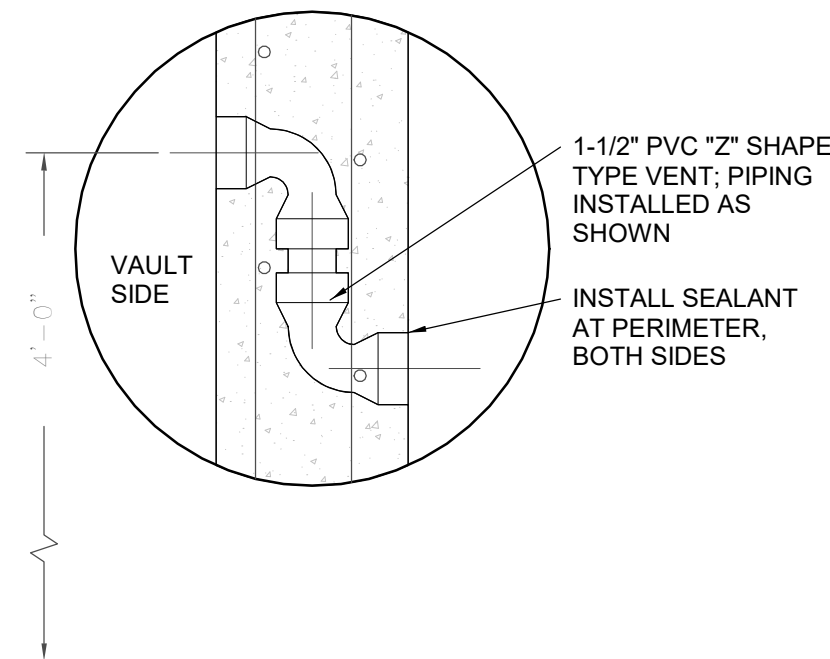


6
A-492
ZEE VENT DETAIL
1 1/2" = 1'-0"

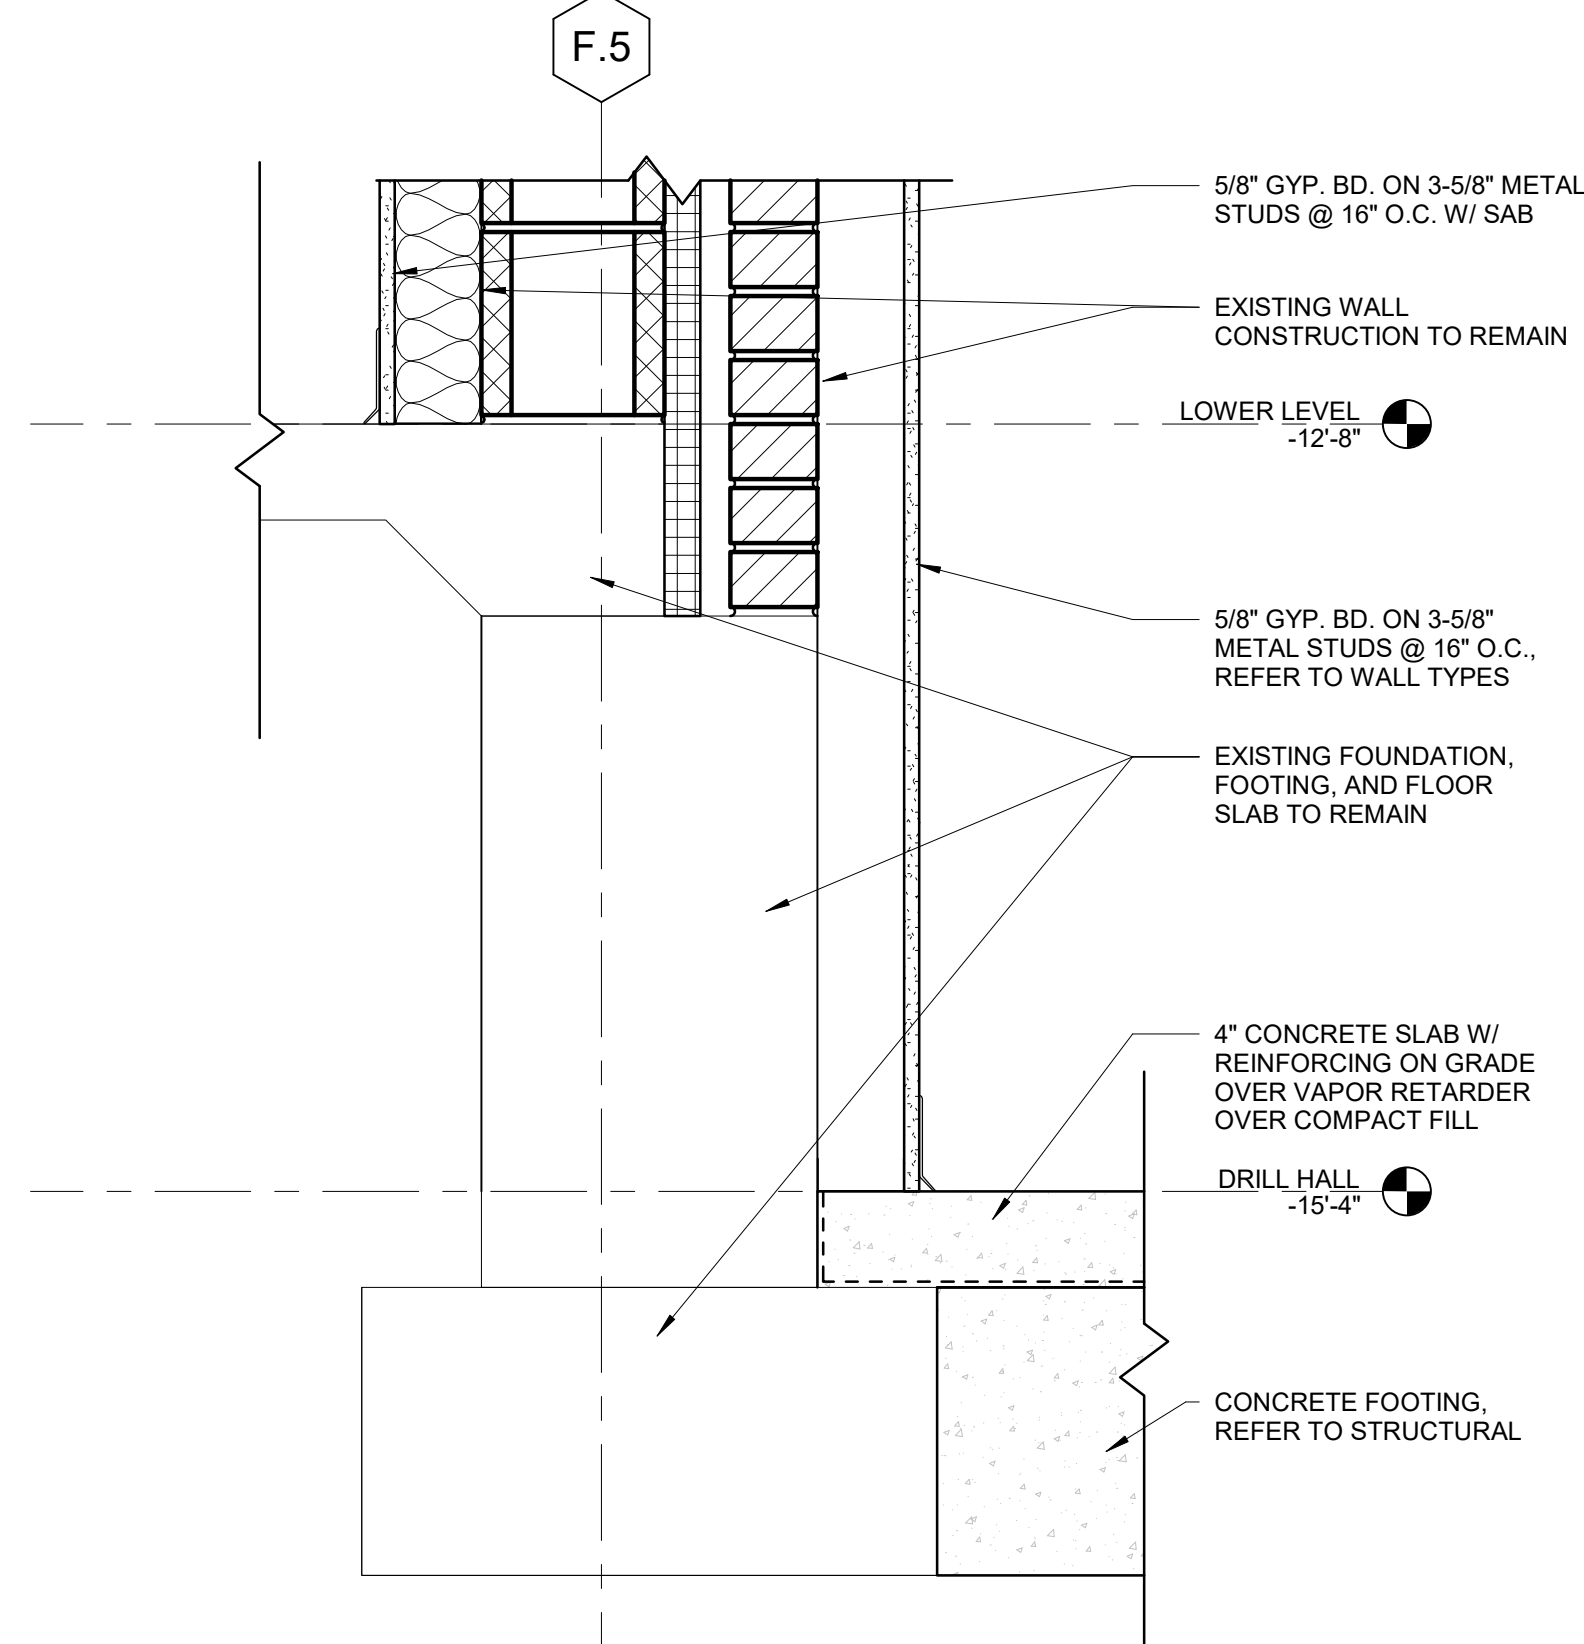

3
A-492
SECTION DETAIL
1 1/2" = 1'-0"

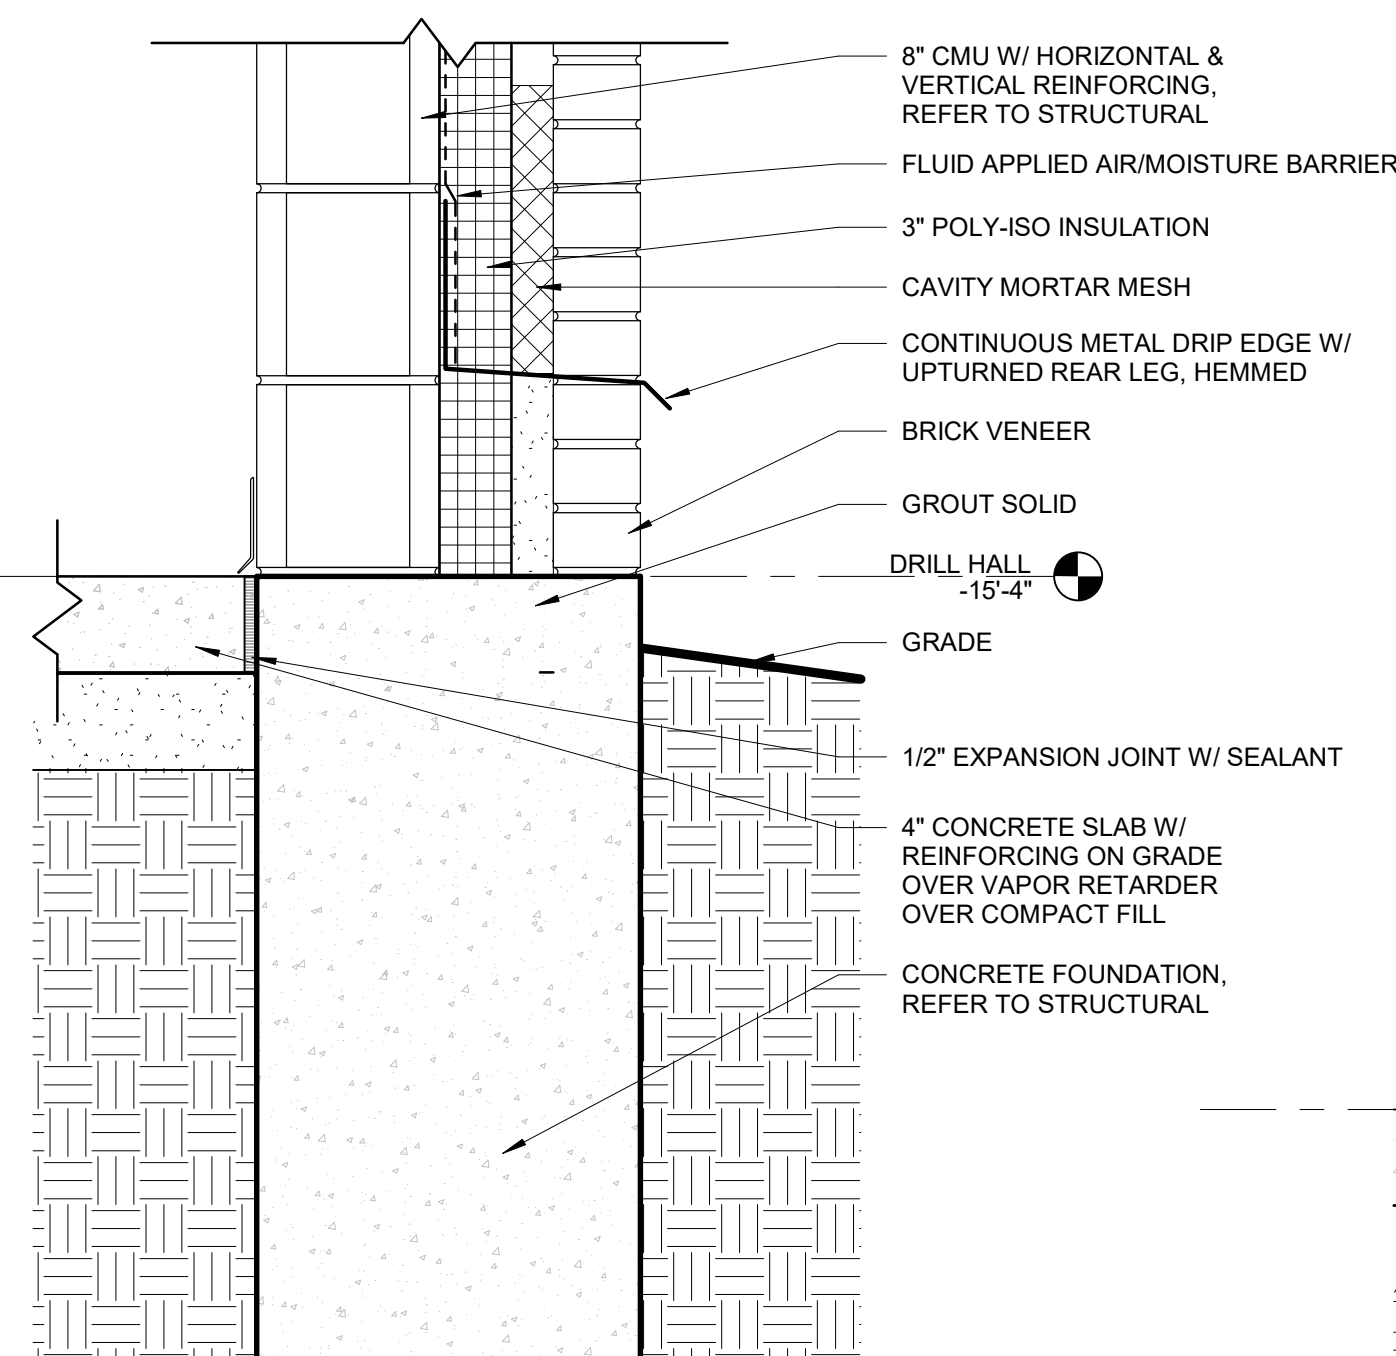

2
A-492
SECTION DETAIL
1 1/2" = 1'-0"

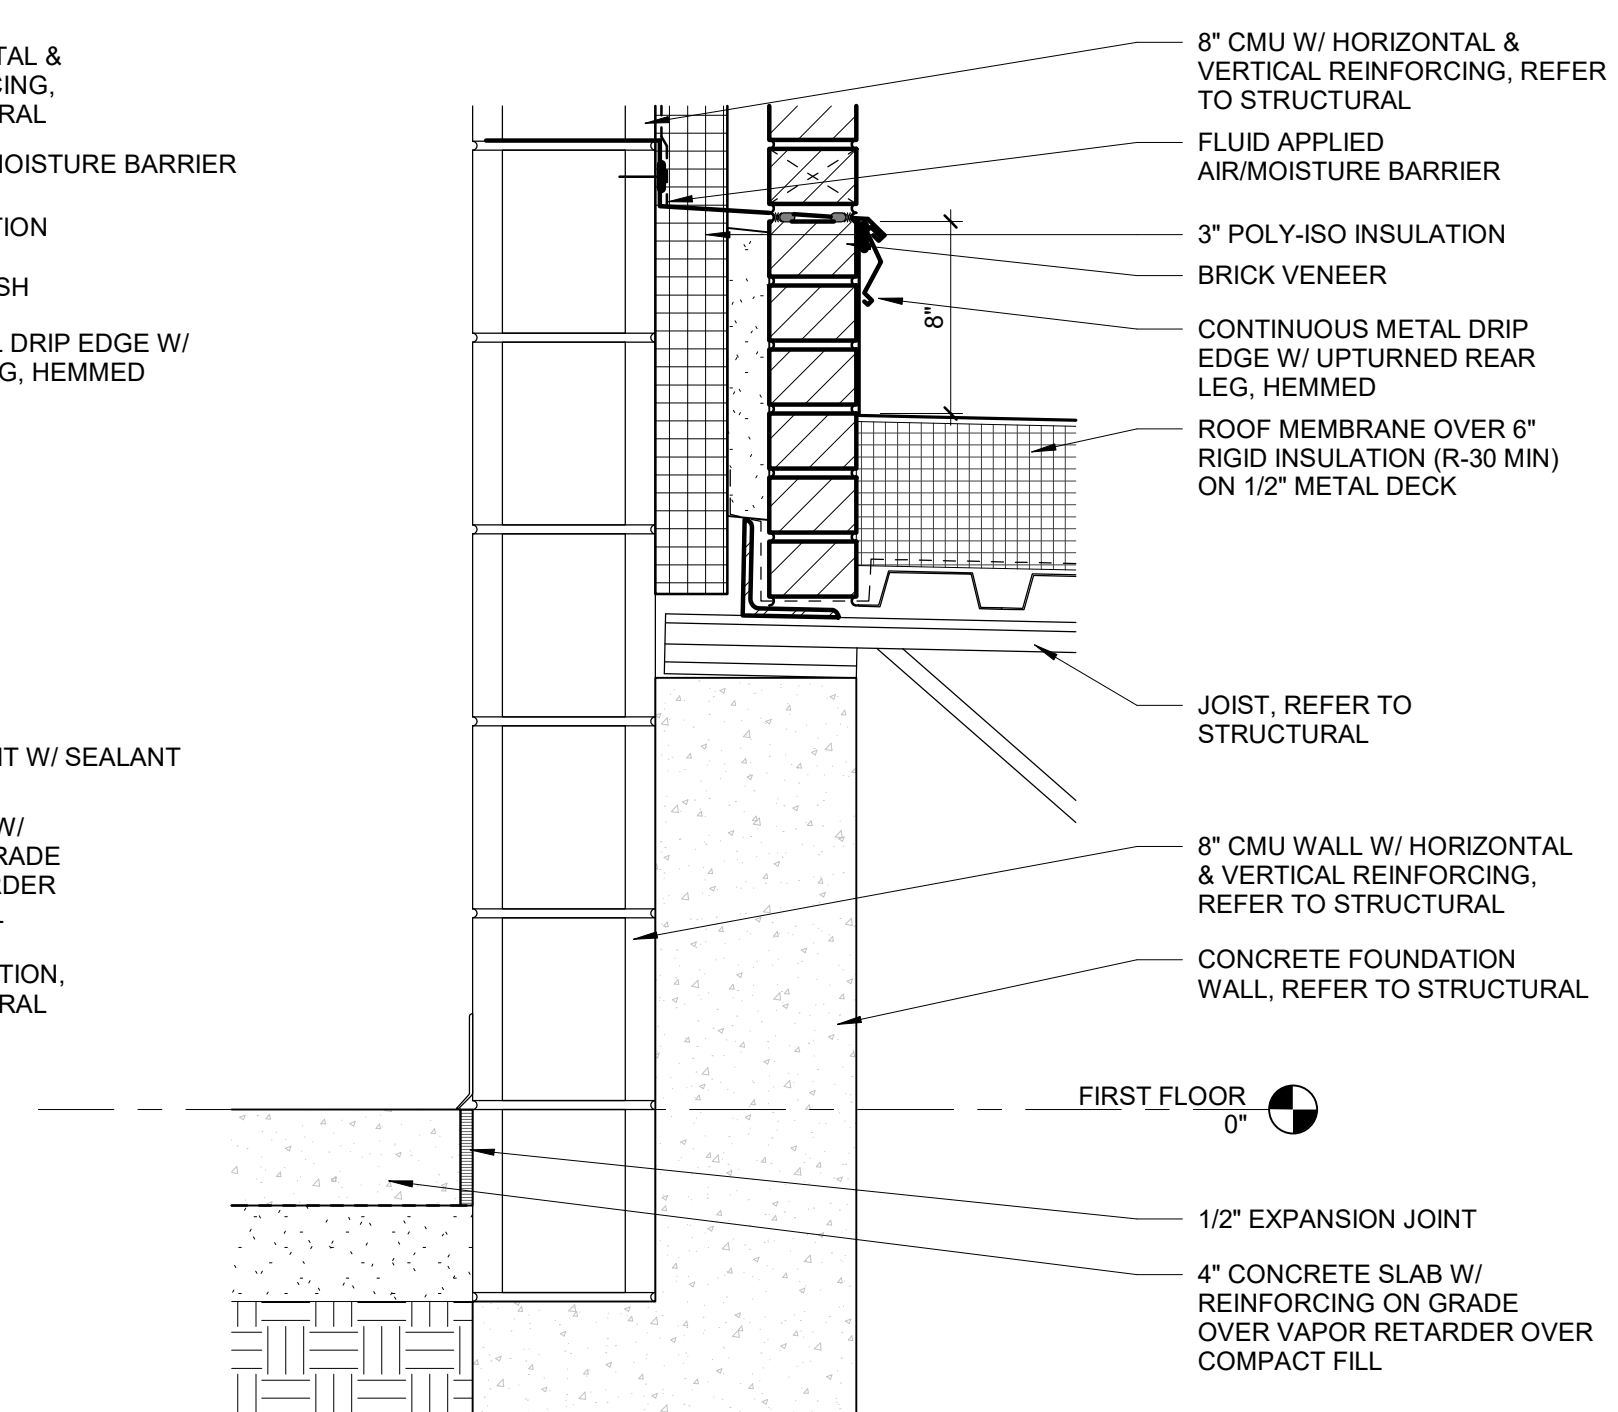

1
A-492
SECTION DETAIL
1 1/2" = 1'-0"



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS


MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT


THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

SHEET	SECTION DETAILS			DATE	ISSUED FOR:	DESIGNED	HL
	IDENTIFICATION NO:	PROJECT NO:	DIVISION				
A-492	25510.A	25510.A	25510.A	01/15/26	PRELIMINARY	DRAWN	HL
					CONSTRUCTION	CHECKED	TM
					FINAL RECORD	APPROVED	RMR

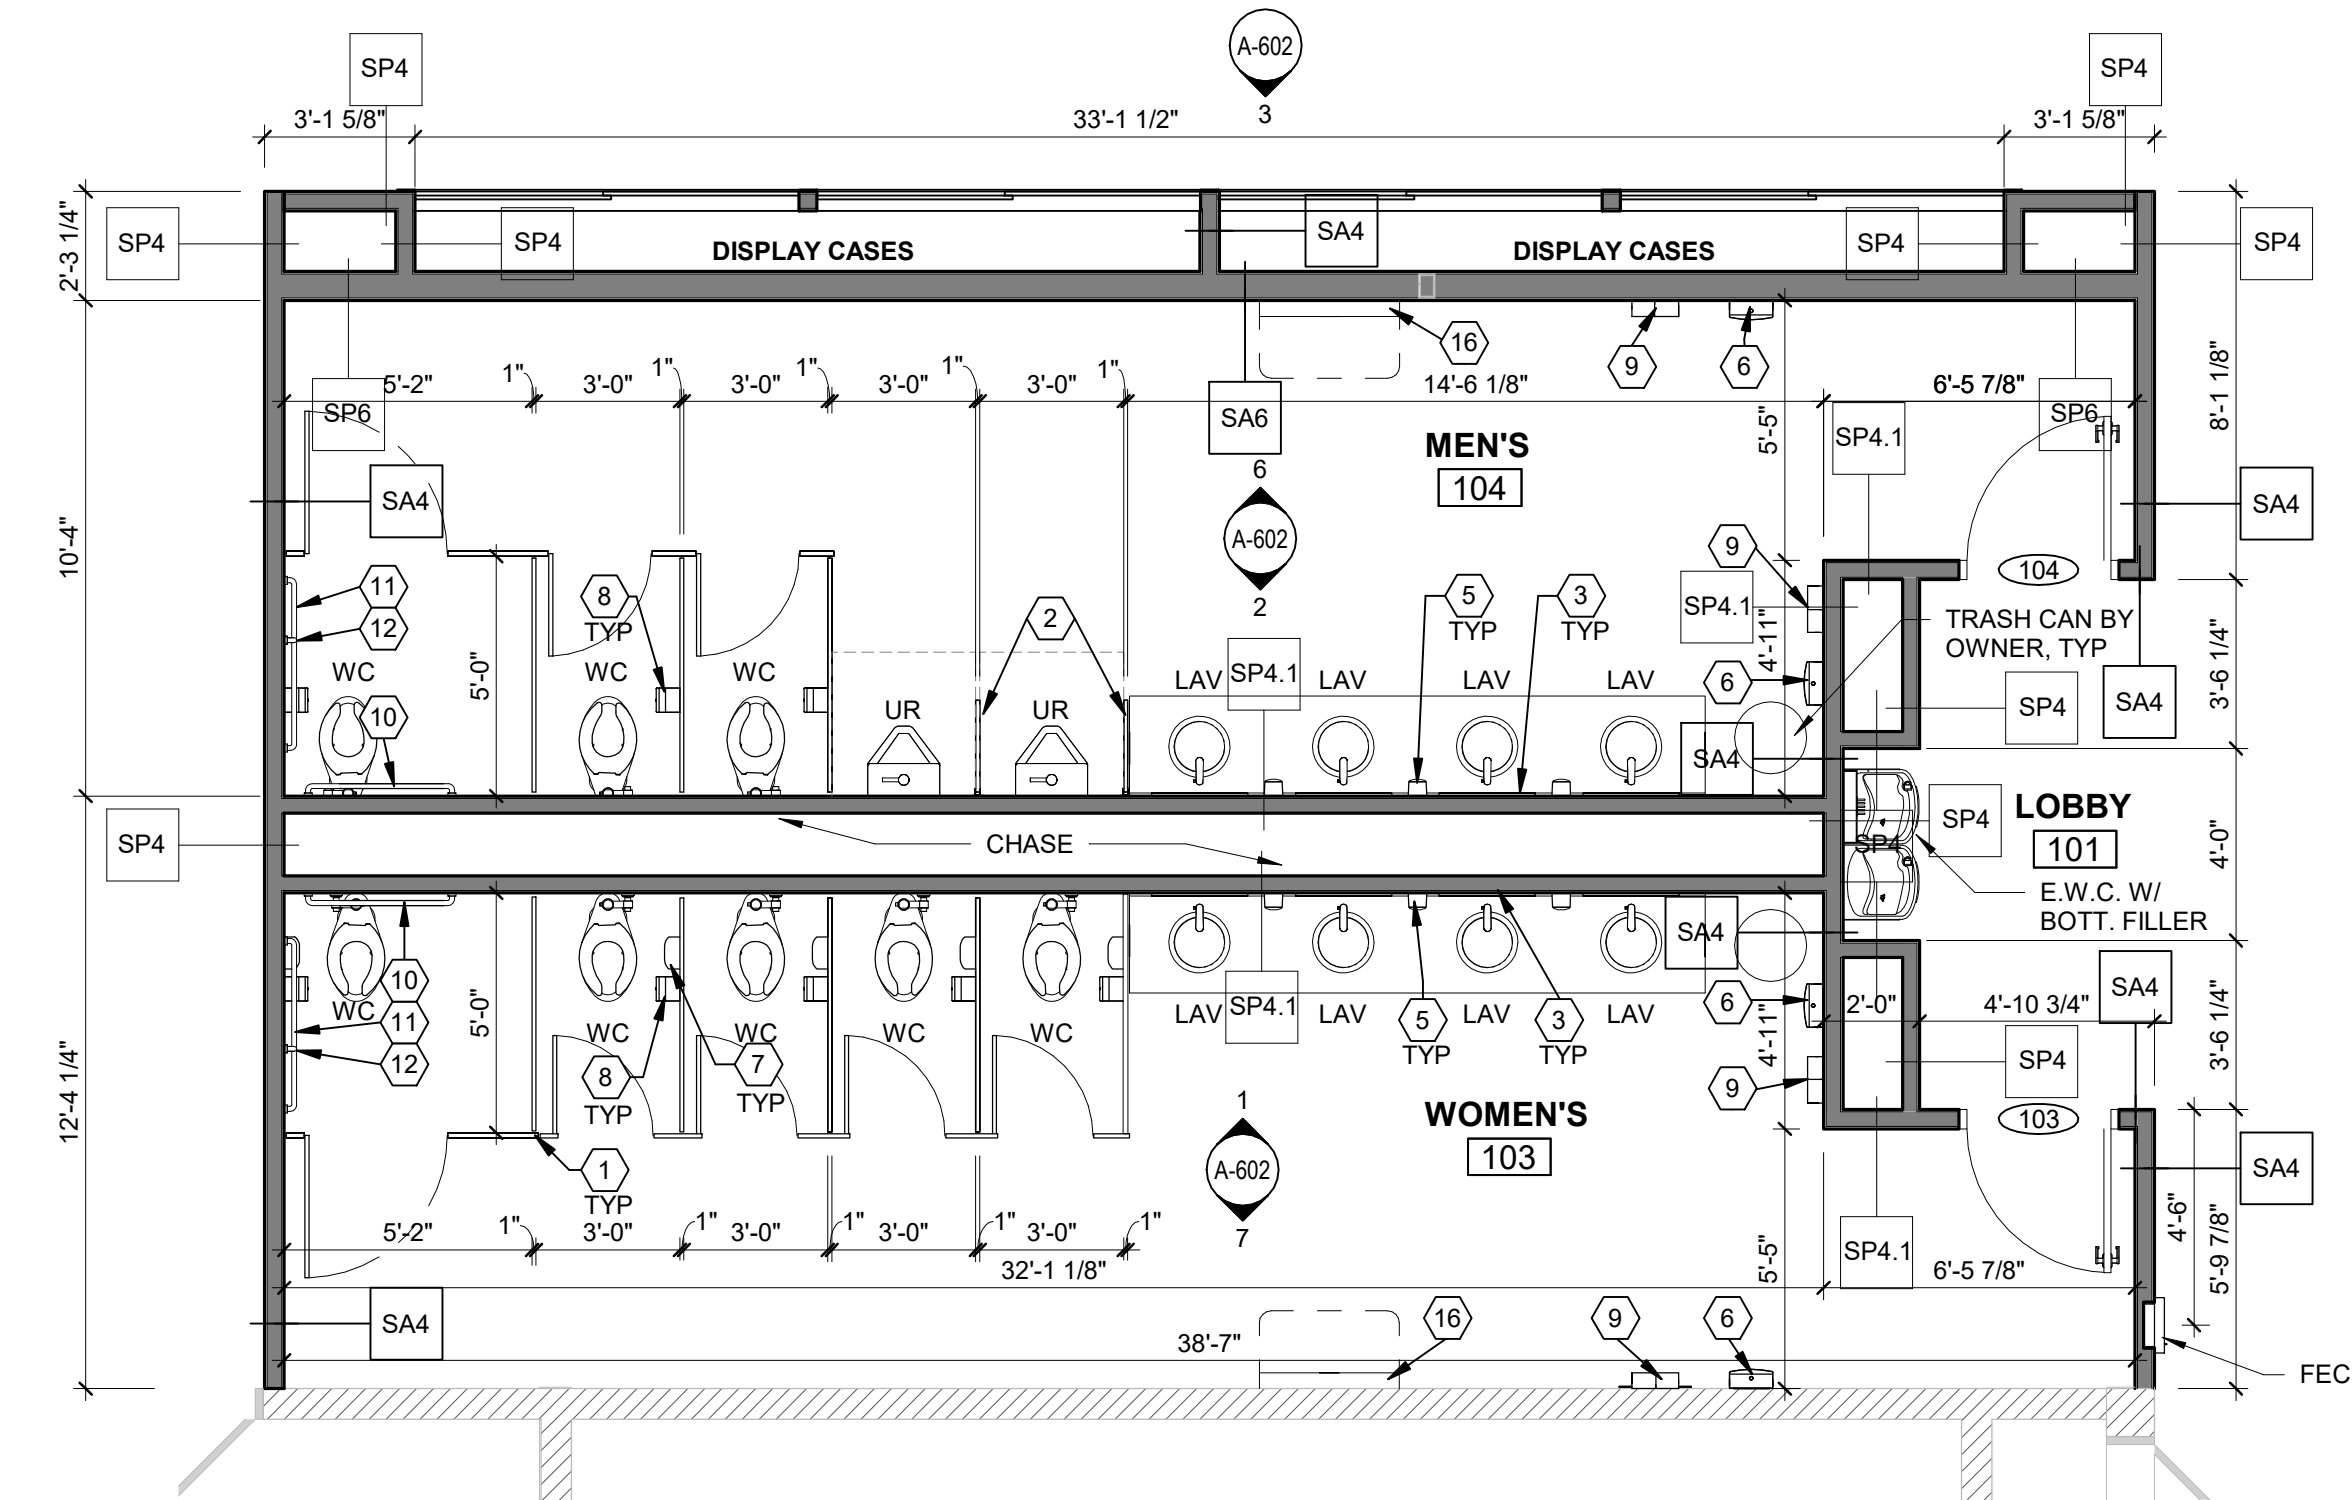


3
A-501
1/4" = 1'-0"

MAIN LEVEL FLOOR PLAN - ENLARGED TOILET ROOMS

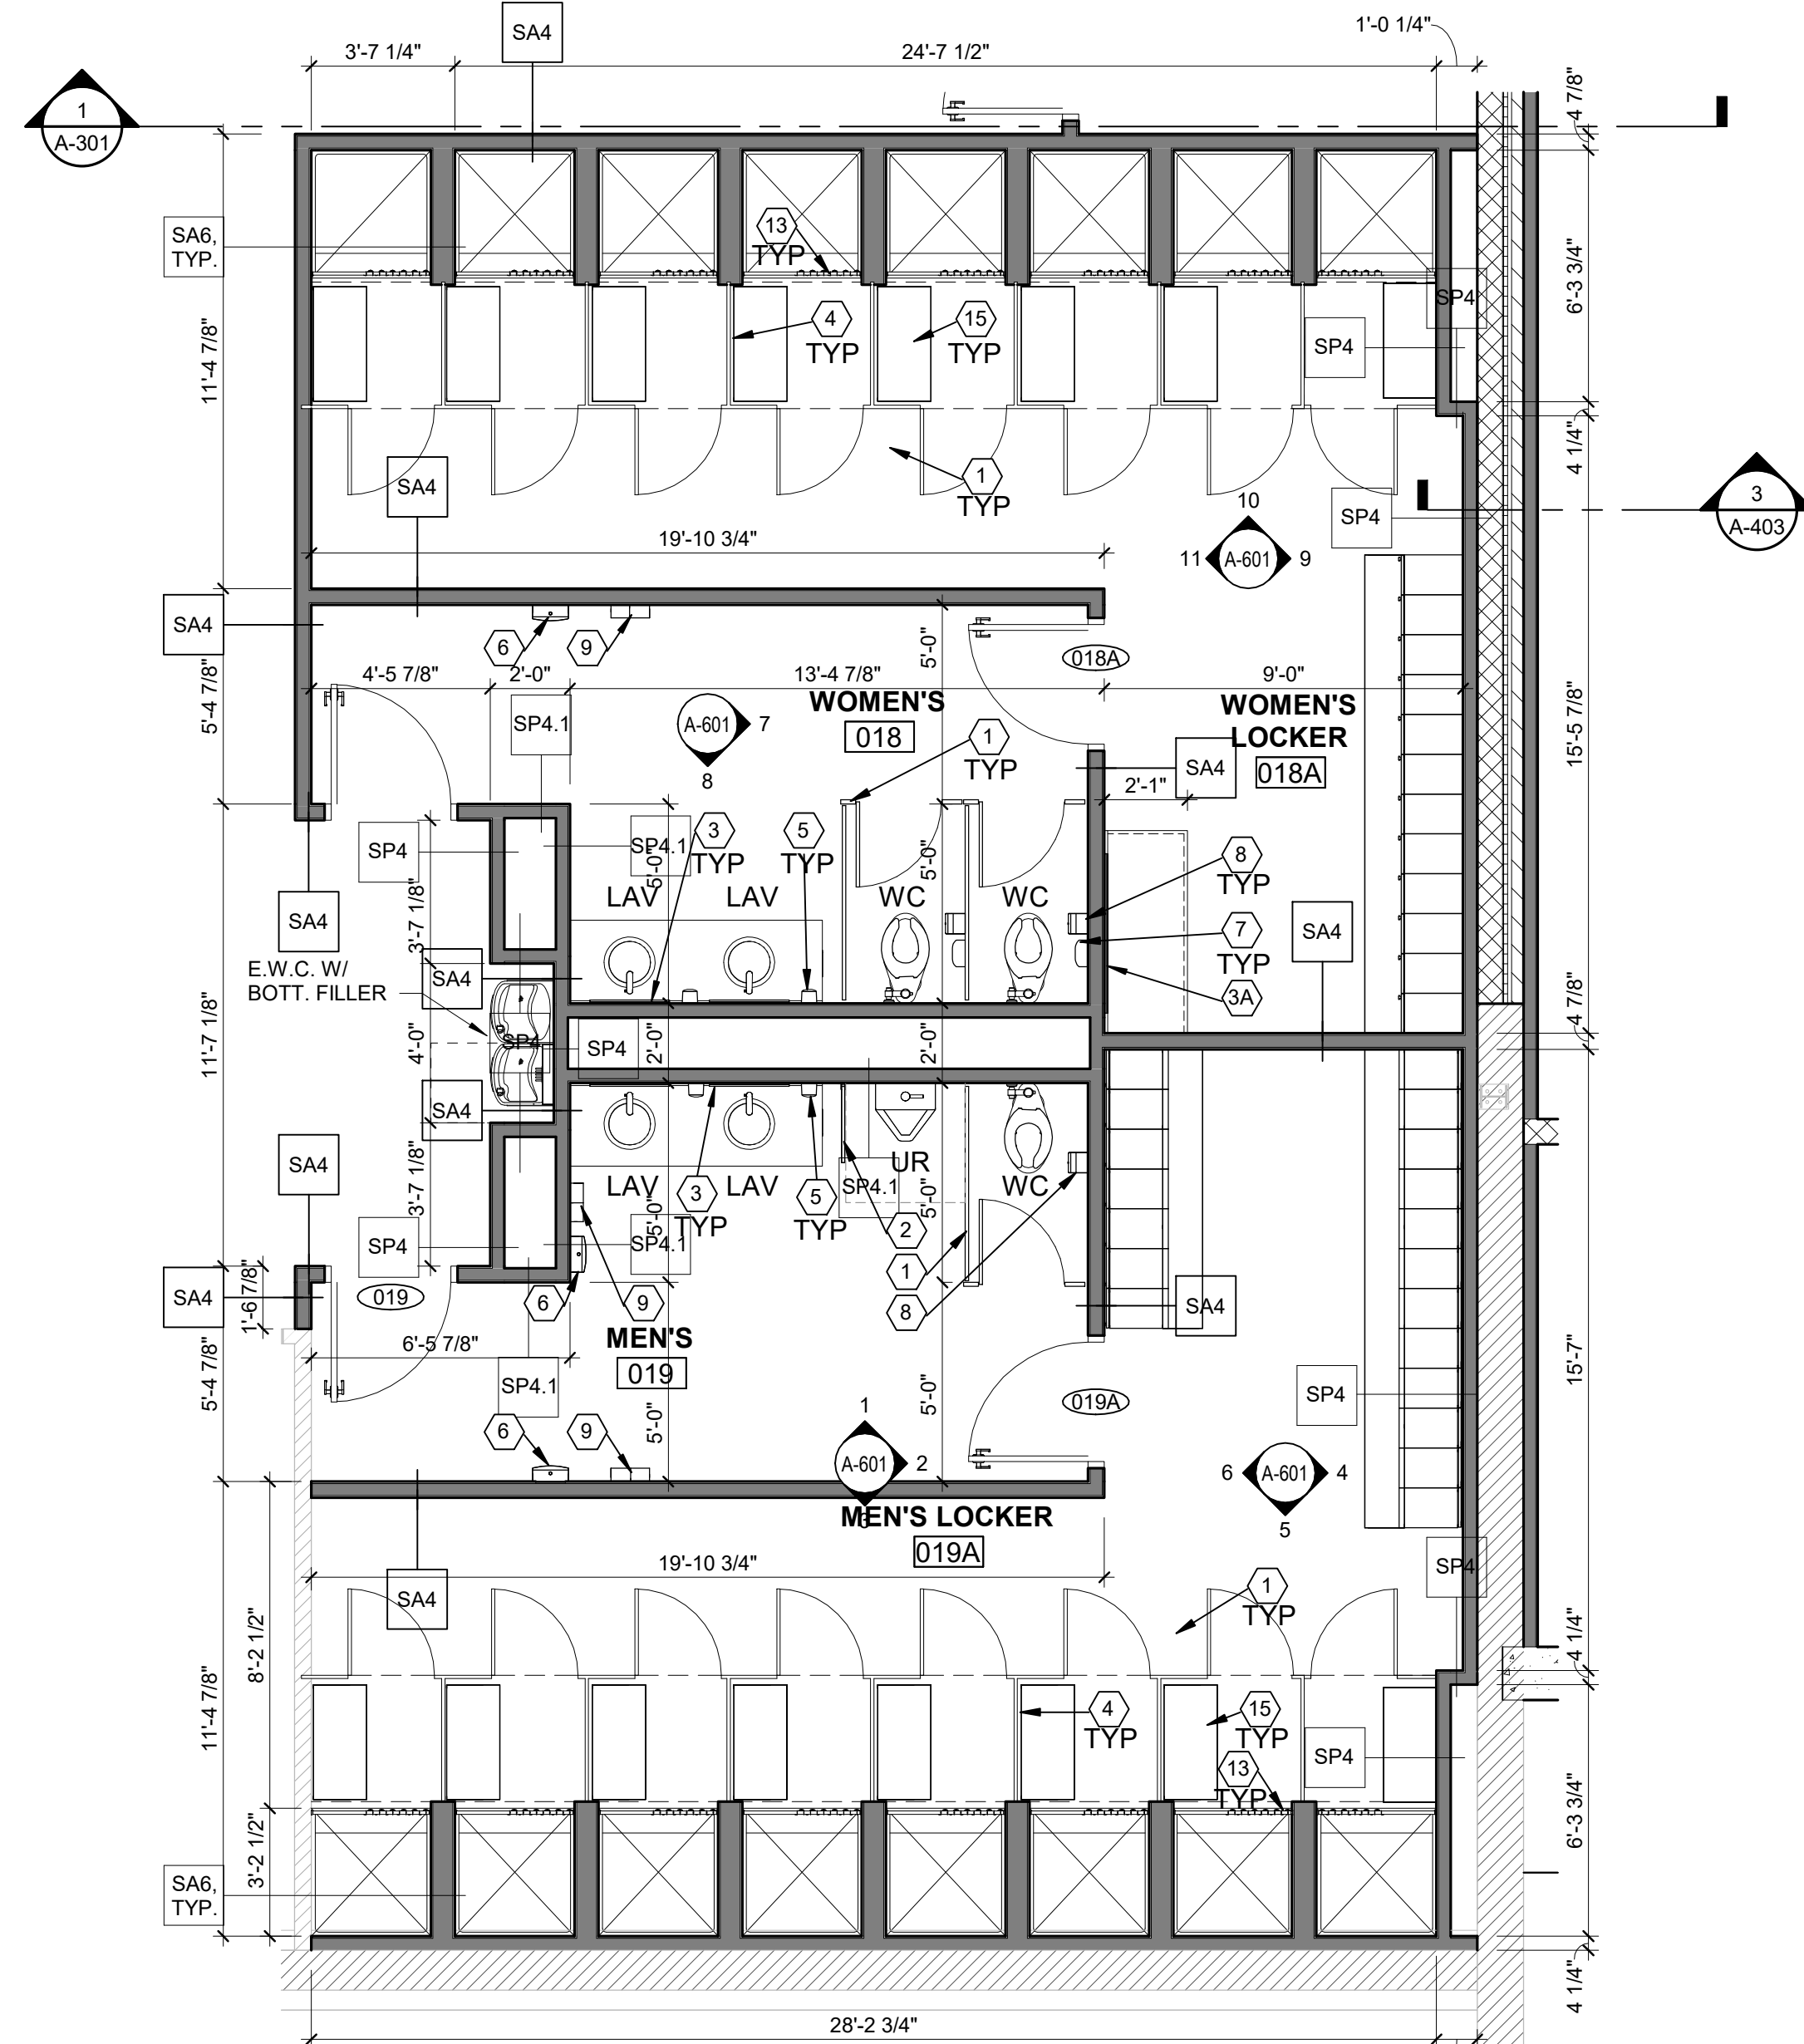

2
A-501
1/4" = 1'-0"

LOWER LEVEL FLOOR PLAN - ENLARGED TOILET ROOMS

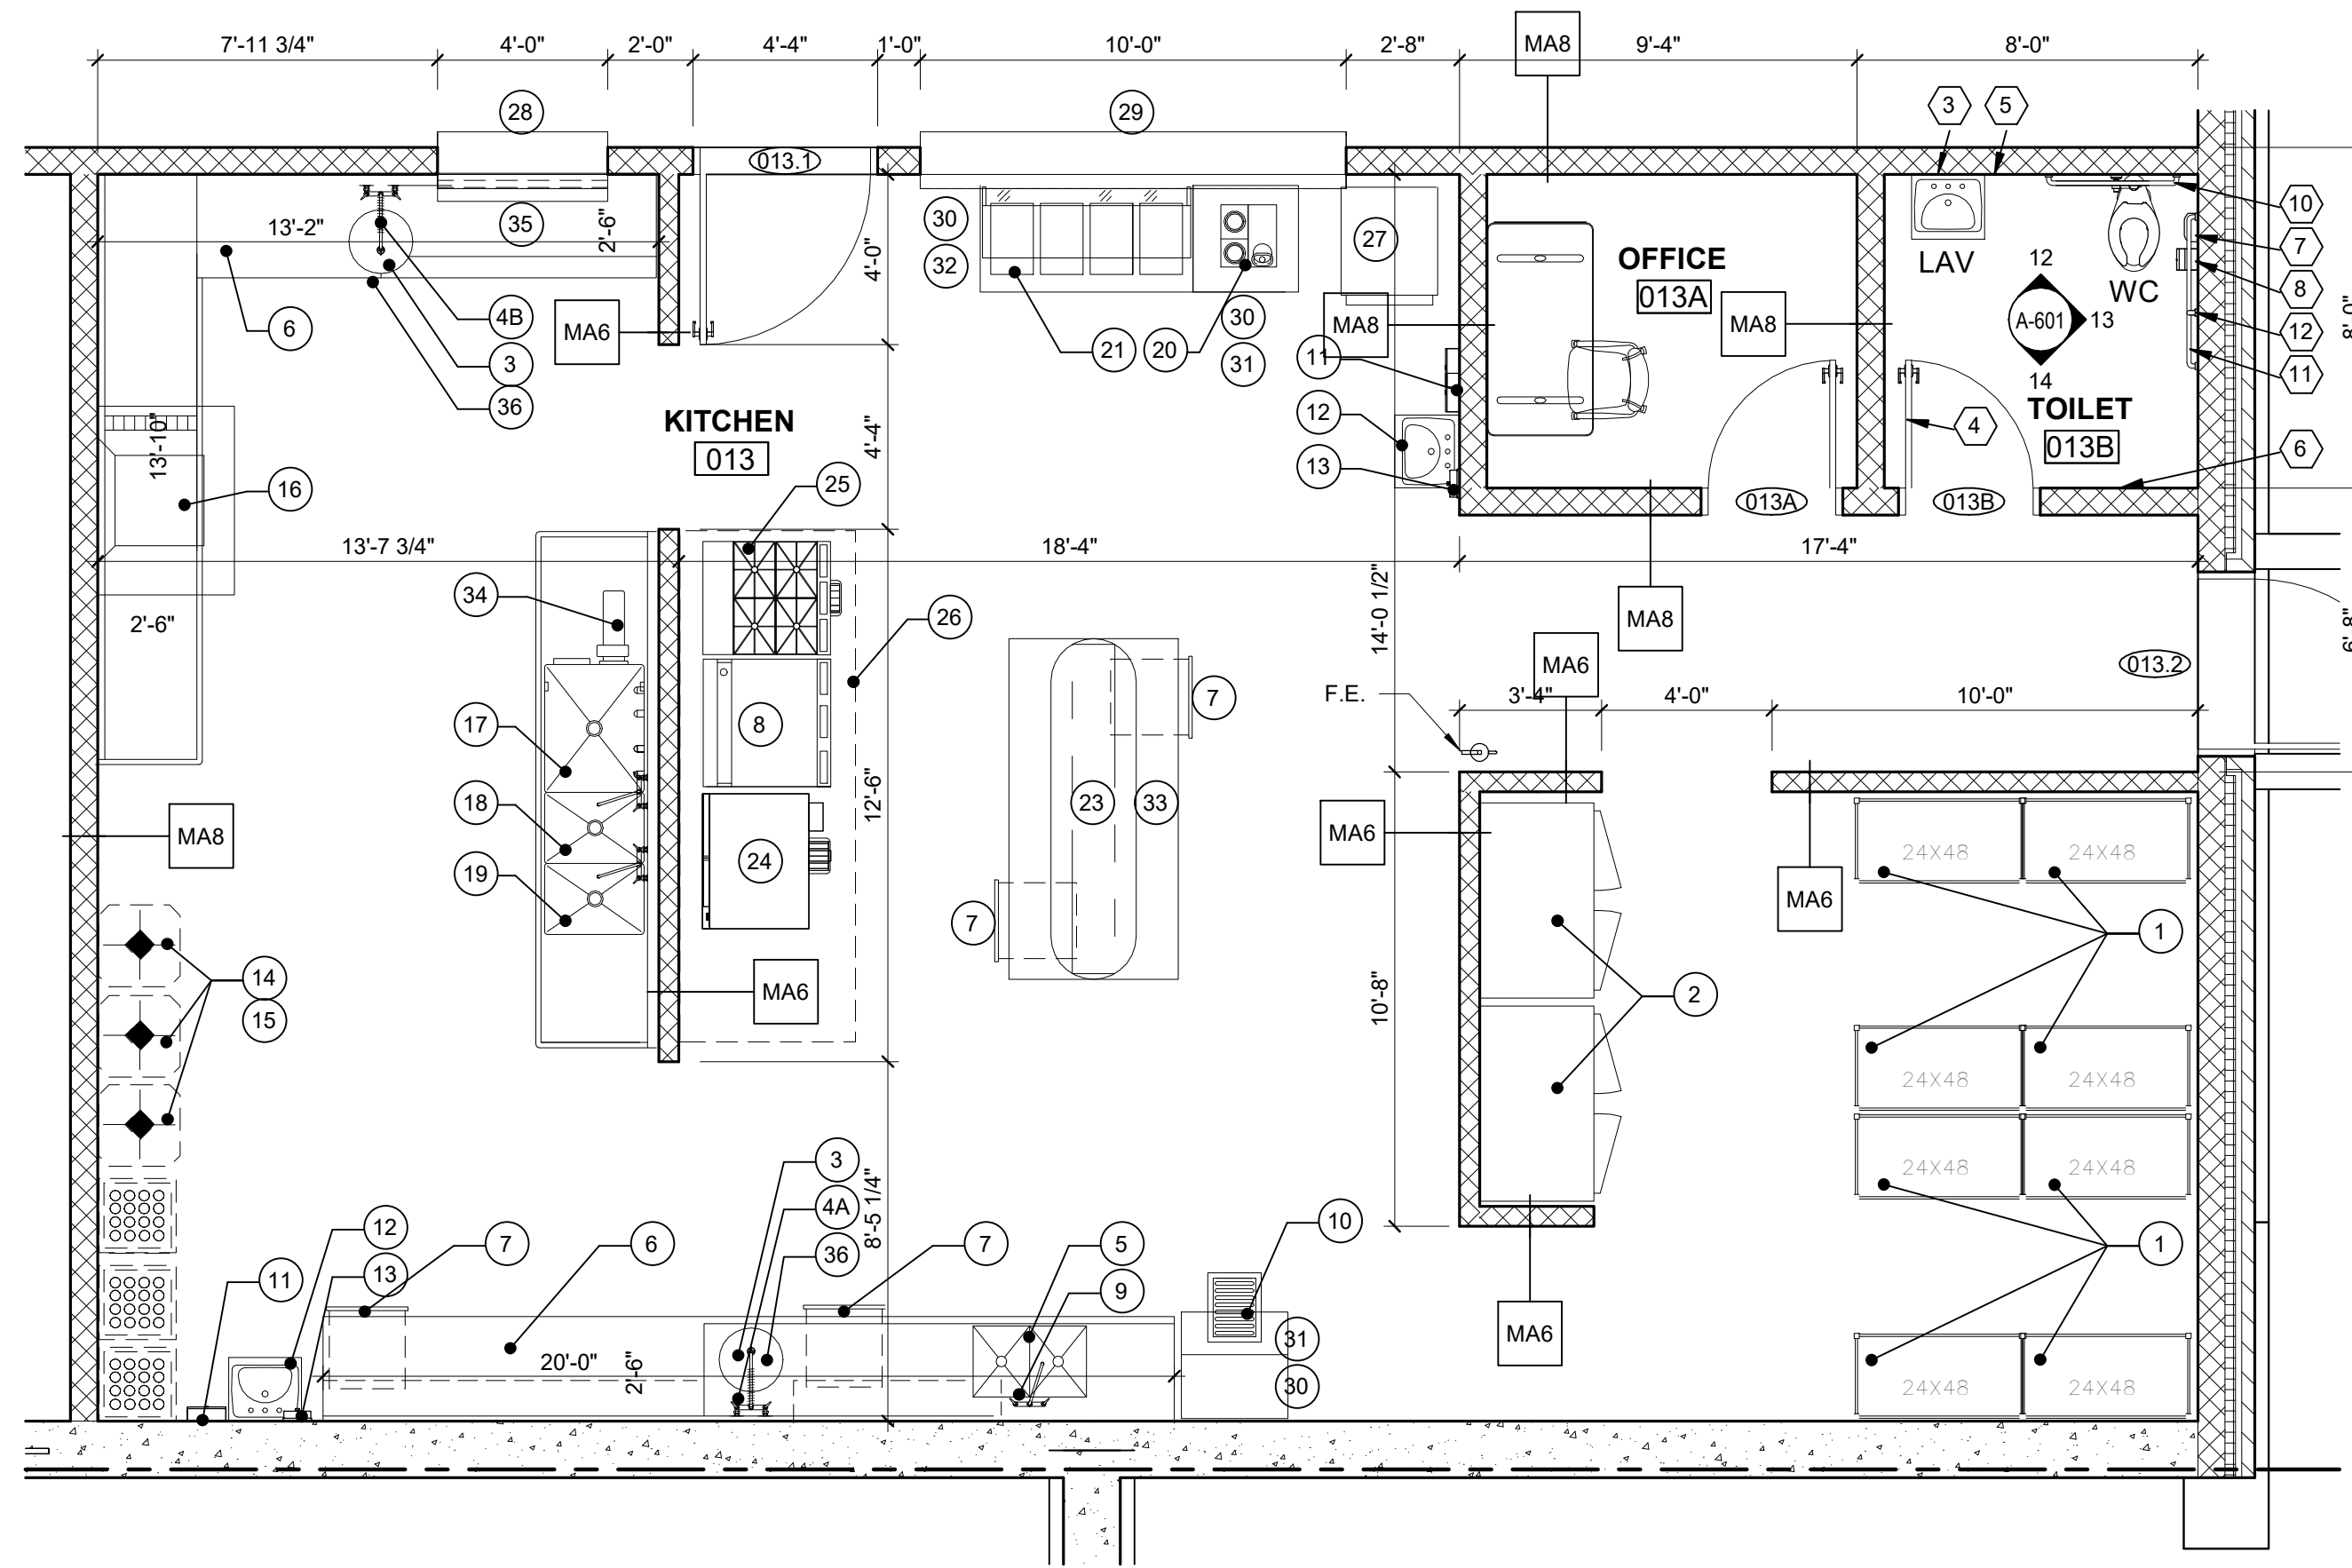

1
A-501
1/4" = 1'-0"








LOWER LEVEL FLOOR PLAN - ENLARGED KITCHEN

ITEM NUMBER	ITEM	MANUFACTURER	MODEL NUMBER	PROVIDED AND INSTALLED BY
1	STAINLESS STEEL RACK	LINE SUPPLY	2RVS	GENERAL CONTRACTOR
2	REFRIGERATOR	CONTINENTAL	2RVS	GENERAL CONTRACTOR
3	GARBAGE DISPOSAL	SALVADOR	5 HP	GENERAL CONTRACTOR
4A	FAUCET - WALL MOUNTED	CHICAGO FAUCETS	623-613-3000BGP	GENERAL CONTRACTOR
4B	FAUCET - WALL MOUNTED	CHICAGO FAUCETS	623-3000B	GENERAL CONTRACTOR
5	PREP SINK	COMMERCIAL STAINLESS	C2CSD	GENERAL CONTRACTOR
6	STAINLESS COUNTER - CUSTOM	EAGLE GROUP	CUSTOM	GENERAL CONTRACTOR
7	DRAWER	EAGLE GROUP	6204T	GENERAL CONTRACTOR
8	GRIDDLE TOP	VULCAN	36S-36GN	GENERAL CONTRACTOR
9	FAUCET	T&S	B-0230-4BS1	GENERAL CONTRACTOR
10	ICE MAKER	SCOTSMAN PRODIGY PLUS	C2630MA-32	GENERAL CONTRACTOR
11	TOWEL DISPENSER	BOBRICK	B-262	GENERAL CONTRACTOR
12	HAND SINK	GOJO	RMX-12	GENERAL CONTRACTOR
13	SOAP DISPENSER	GOJO	RMX-12	GENERAL CONTRACTOR
14	DISH CART	CAMBRO	CDR2020	GENERAL CONTRACTOR
15	DISH WASHING RACKS	CAMBRO	BR286	GENERAL CONTRACTOR
16	DISH WASHER	HOBART	AMT50A	GENERAL CONTRACTOR
17	LARGE WELL SINK	JUST	CUSTOM	GENERAL CONTRACTOR
18	SOAKING SINK	JUST	CUSTOM	GENERAL CONTRACTOR
19	RISING SINK	JUST	CUSTOM	GENERAL CONTRACTOR
20	COFFEE MAKER	BUNN	CWTF 42 TWIN	GENERAL CONTRACTOR
21	4 WELL WARMING STATION	RANDELL STAINLESS STEEL	HTD-4	GENERAL CONTRACTOR
22	NOT USED			
23	UTENSIL RACK	EAGLE GROUP	TM66PR	GENERAL CONTRACTOR
24	DOUBLE CONVECTION OVEN	VULCAN	SG44	GENERAL CONTRACTOR
25	COMMERCIAL GAS RANGE	VULCAN	36S-66N	GENERAL CONTRACTOR
26	EXHAUST HOOD	REFER TO MECHANICAL		GENERAL CONTRACTOR
27	FOOD WARMING CABINET	VULCAN	UPR6ES	GENERAL CONTRACTOR
28	4 WIRE ROLL UP DOOR	ALPINE	COUNTER SHUTTER	GENERAL CONTRACTOR
29	10 WIDE ROLL UP DOOR	ALPINE	COUNTER SHUTTER	GENERAL CONTRACTOR
30	WATER HOOKUP FOR EQUIPMENT	PENTAIR	EV032-01	GENERAL CONTRACTOR
31	WALL MOUNTED WATER FILTER			GENERAL CONTRACTOR
32	WALL MOUNTED SWIVEL POT FILLER	T&S	B-0600-36H	GENERAL CONTRACTOR
33	STAINLESS STEEL WORK TABLE	EAGLE GROUP	4886	GENERAL CONTRACTOR
34	HOT WATER BOOSTER	HAYCO	325-98	GENERAL CONTRACTOR
35	DISH RETURN TABLE & TROUGH	CUSTOM		GENERAL CONTRACTOR
36	CIRCULAR RINSING SINK	CUSTOM		GENERAL CONTRACTOR
37	MOBILE SALAD BAR	RANDELL	RAN14G IC-4	GENERAL CONTRACTOR
38	CAN OPENER	EDLUND	G-2CL	GENERAL CONTRACTOR

STUD INTERIOR WALL W/ GYP. BD (EXISTING TO REMAIN)	
STUD INTERIOR WALL W/ GYP. BD (W/ S.A.B.)	
STUD INTERIOR WALL FURRING W/ GYP. BD (ON MASONRY WALL)	
MASONRY WALL	
MASONRY VENEER OVER AIRSPACE AND CONTINUOUS INSULATION ON W/ WRB OVER MASONRY WALL	
CONCRETE WALL	
INSULATED METAL PANELS OVER AIRSPACE ON HAT CHANNELS OVER CMU WALL	

****NOTE: WALL LEGEND SHOWN FOR GRAPHICAL REFERENCE ONLY. REFER TO WALL TYPES AND SECTIONS FOR ADDITIONAL DETAILS AND INFORMATION.**

1	TOILET PARTITIONS, FULL HT. (PRIVATE)
2	URINAL PARTITION
3	2'W x 3'H MIRROR W/ S.S. FRAME
3A	4'W x 3'H MIRROR W/ S.S. FRAME
4	COAT HOOK
5	SOAP DISPENSER - SURFACE MOUNTED
6	PAPER TOWEL DISPENSER - SURFACE MOUNTED
7	SANITARY NAPKIN DISPOSAL - SURFACE MOUNTED
8	TOILET TISSUE DISPENSER - SURFACE MOUNTED
9	ELECTRIC HAND DRYER W/ S.S. WALL GUARD
10	36" GRAB BAR
11	42" GRAB BAR
12	18" VERTICAL GRAB BAR
13	SHOWER CURTAIN AND ROD
14	UTILITY SHELF AND MOP HOLDER
15	SHOWER BENCH
16	DIAPER CHANGING STATION

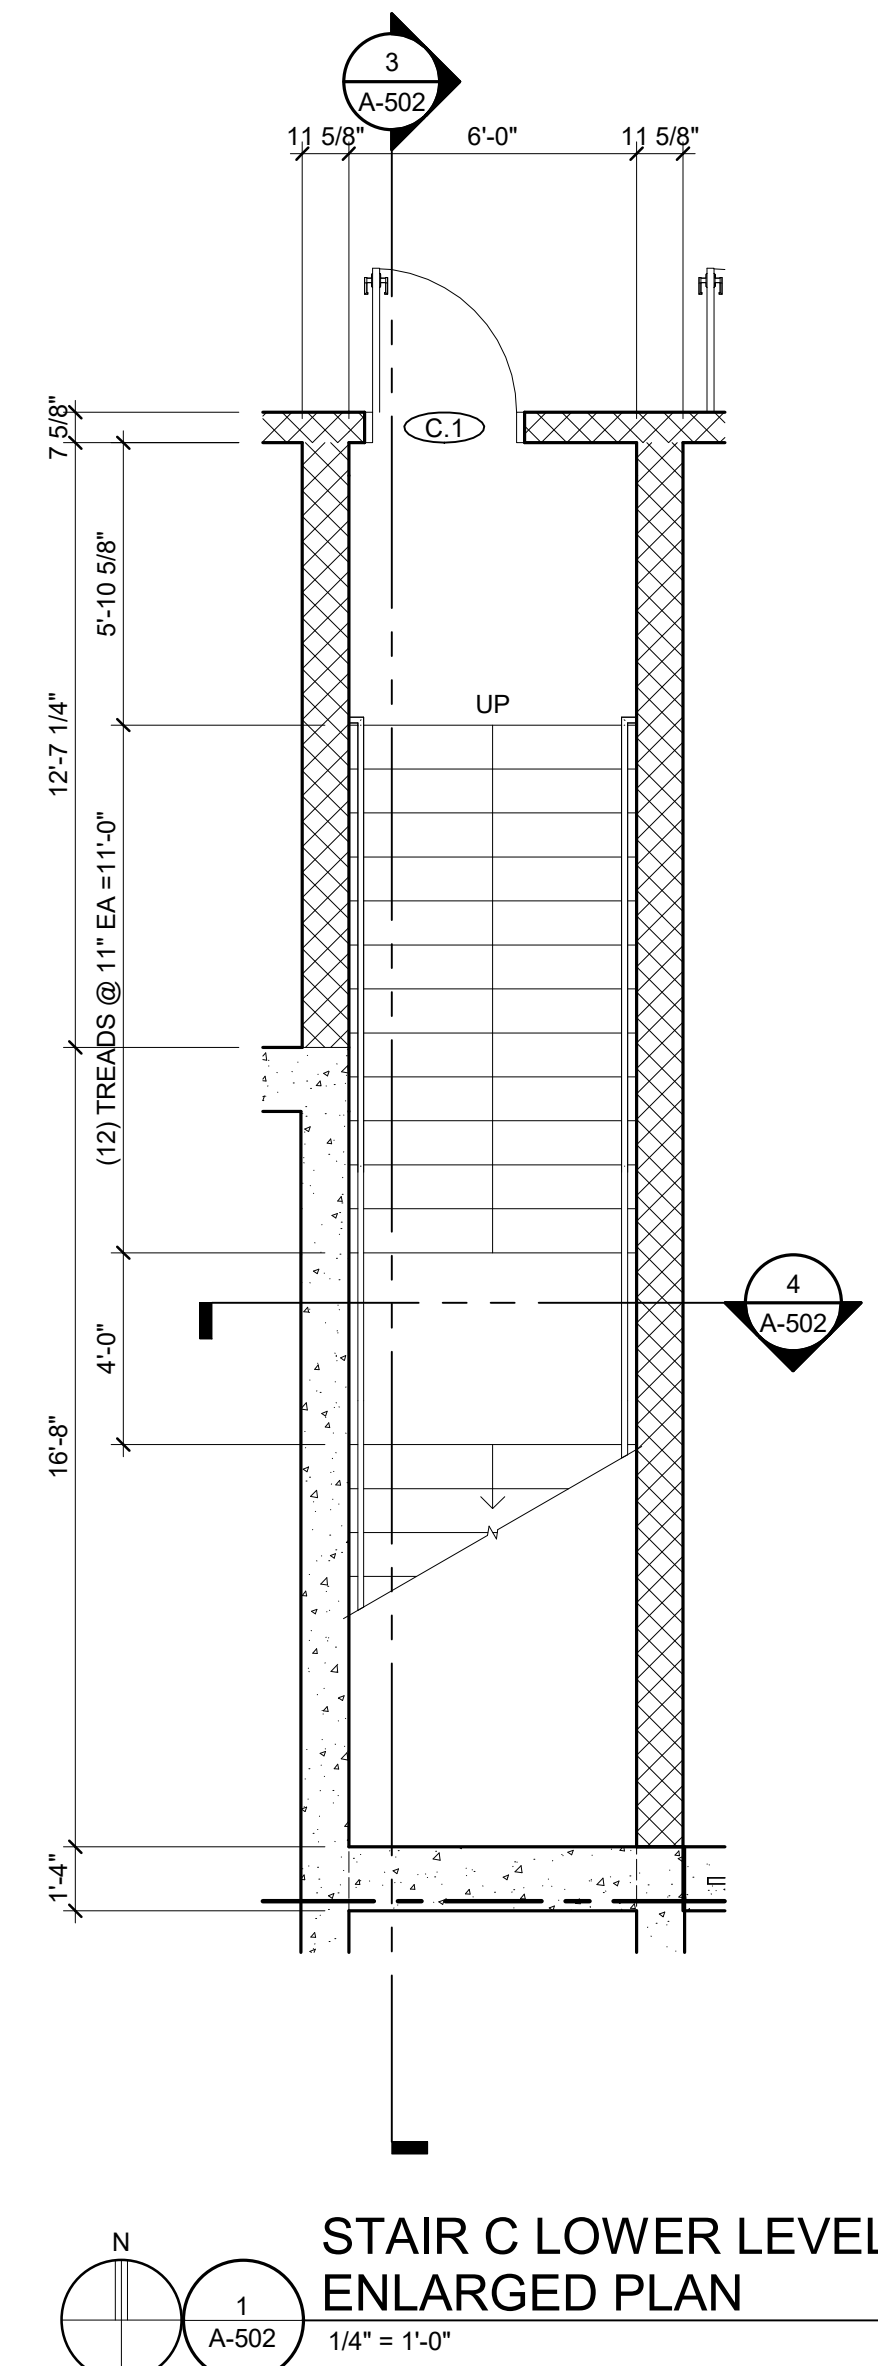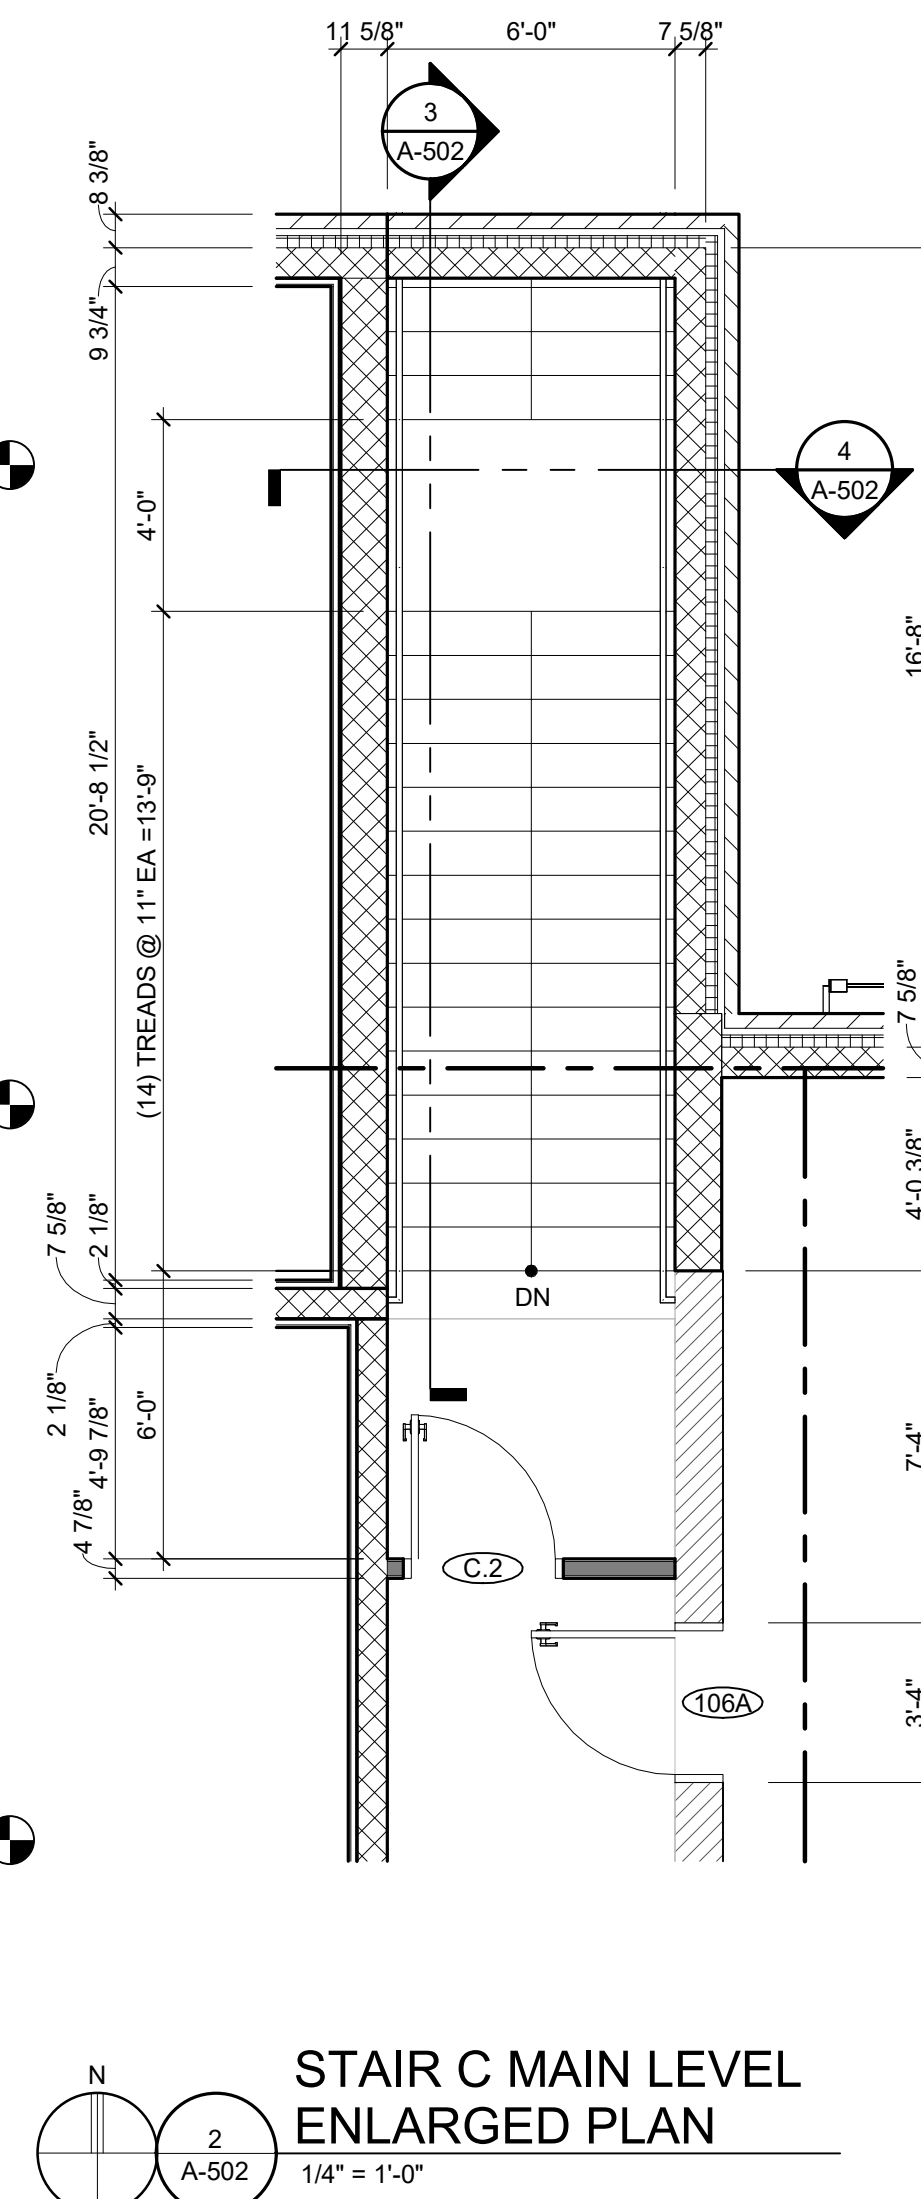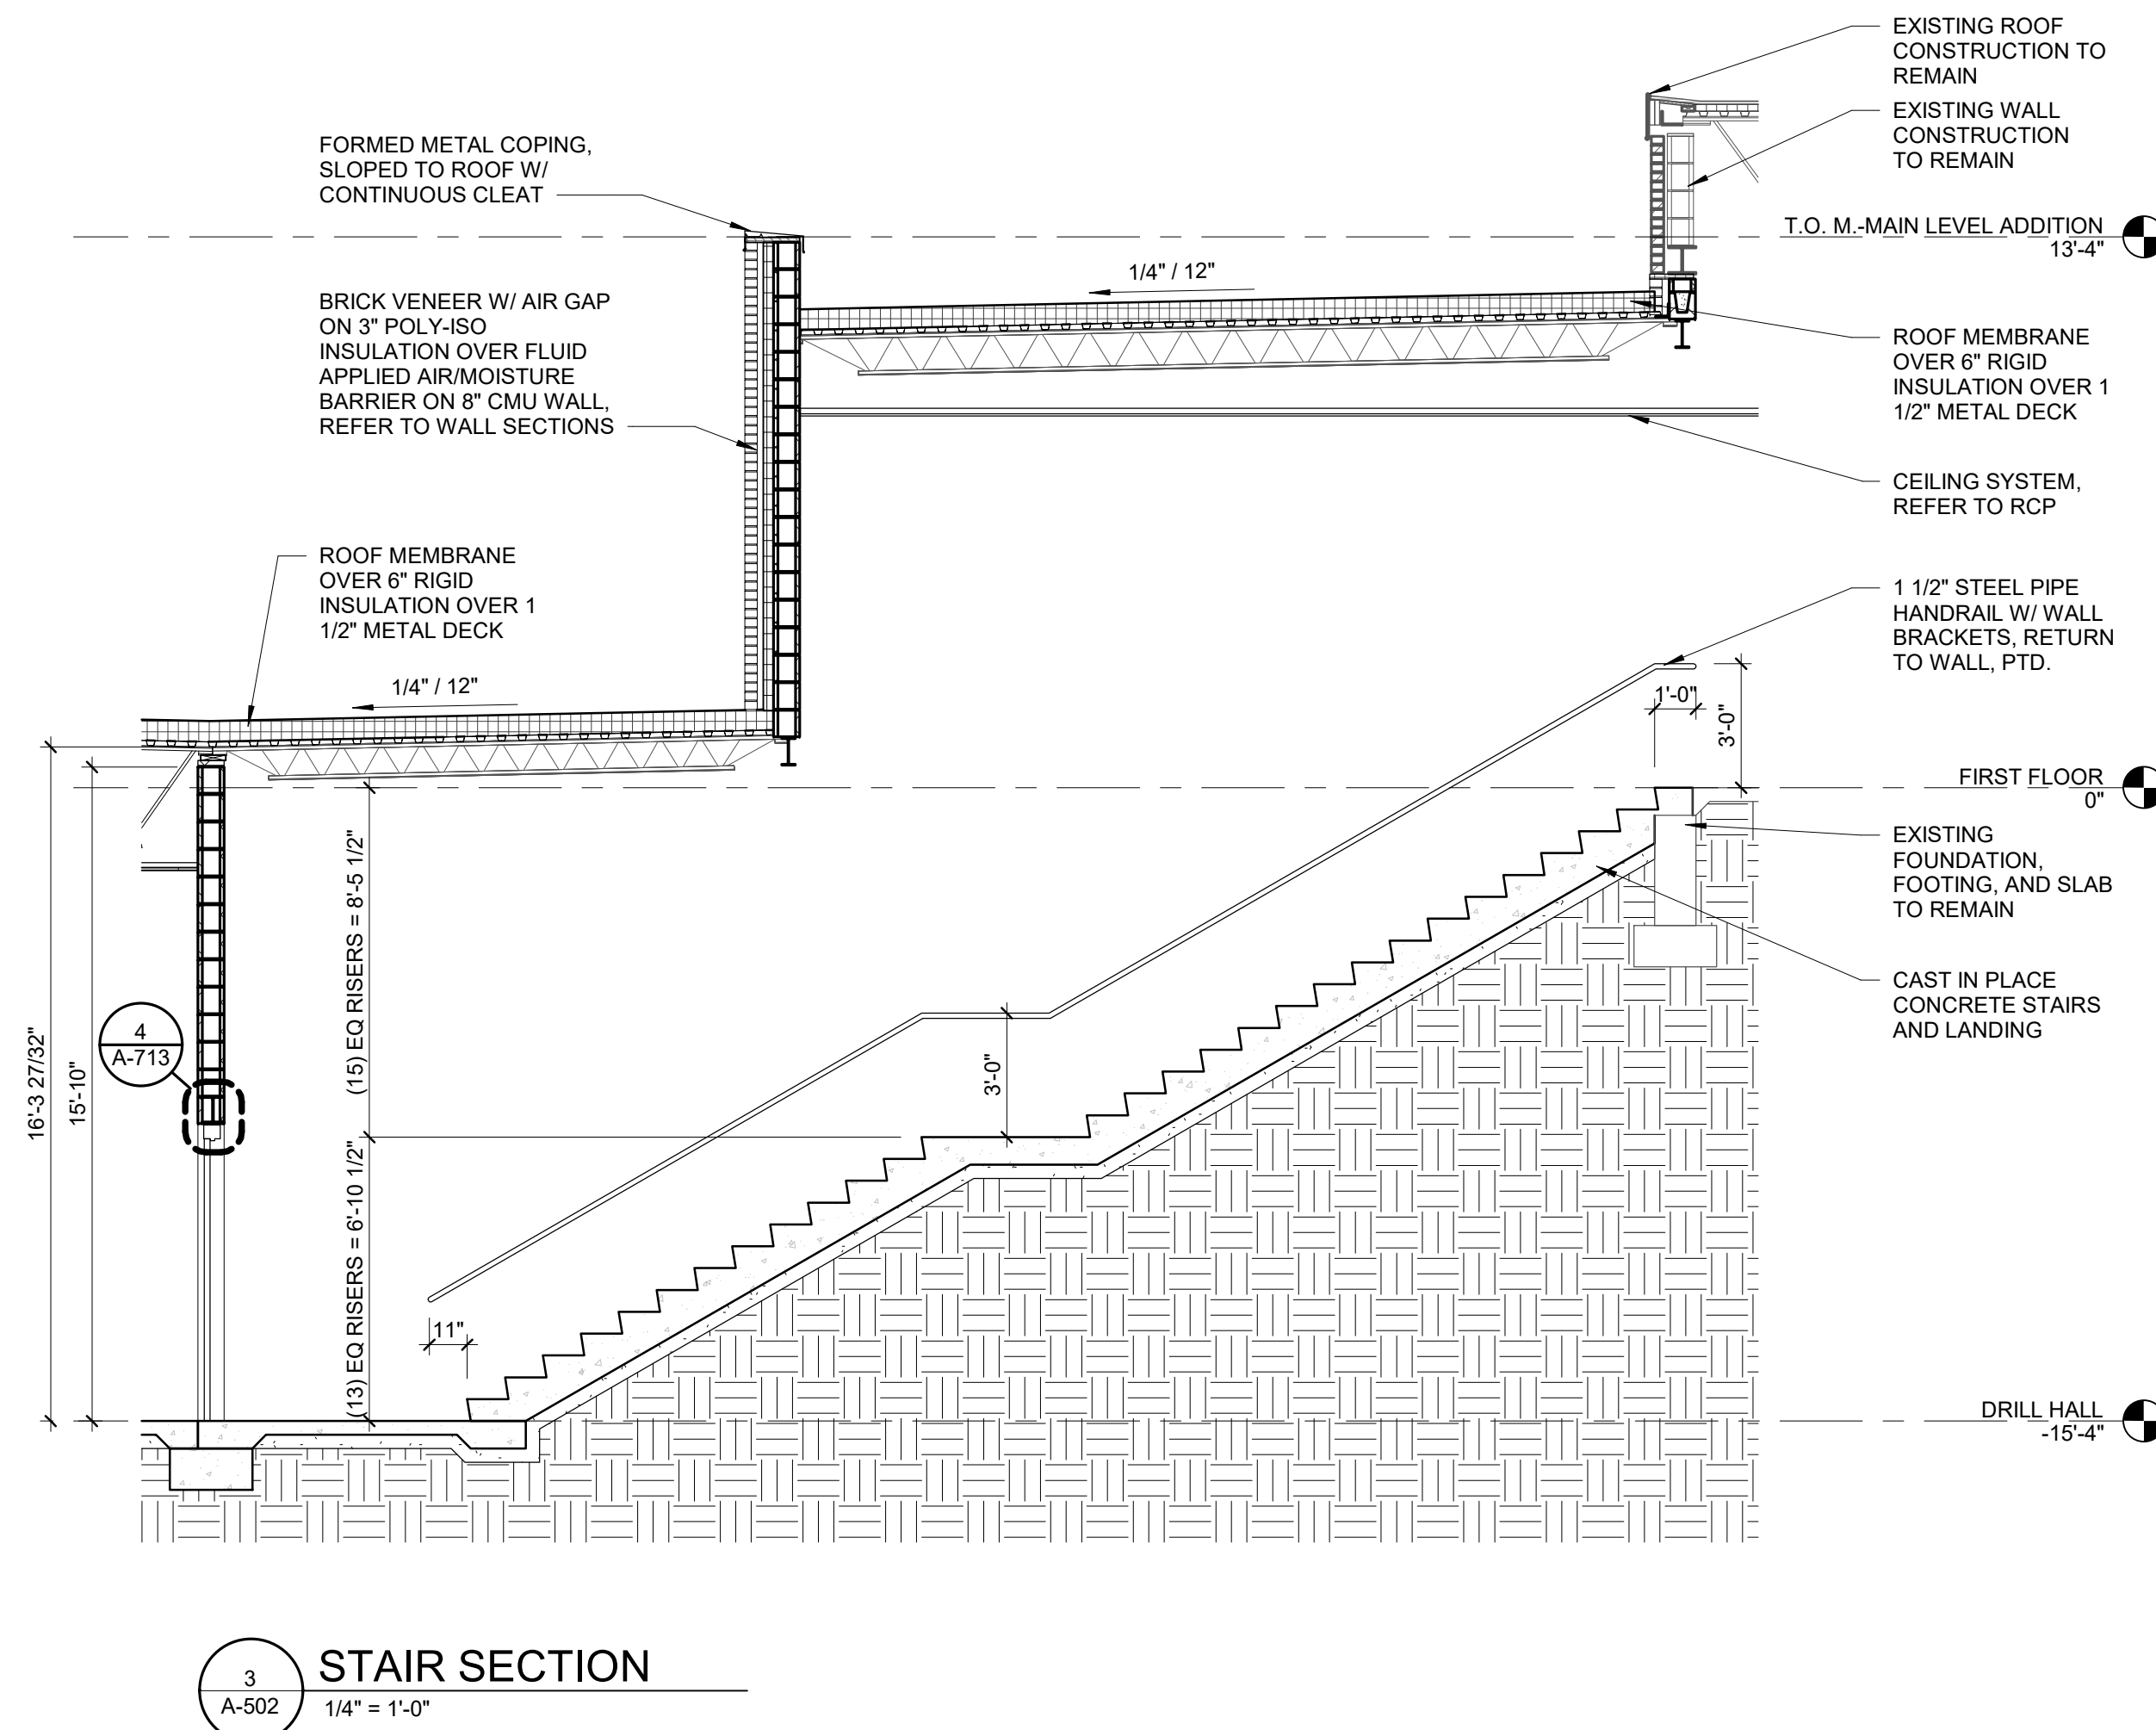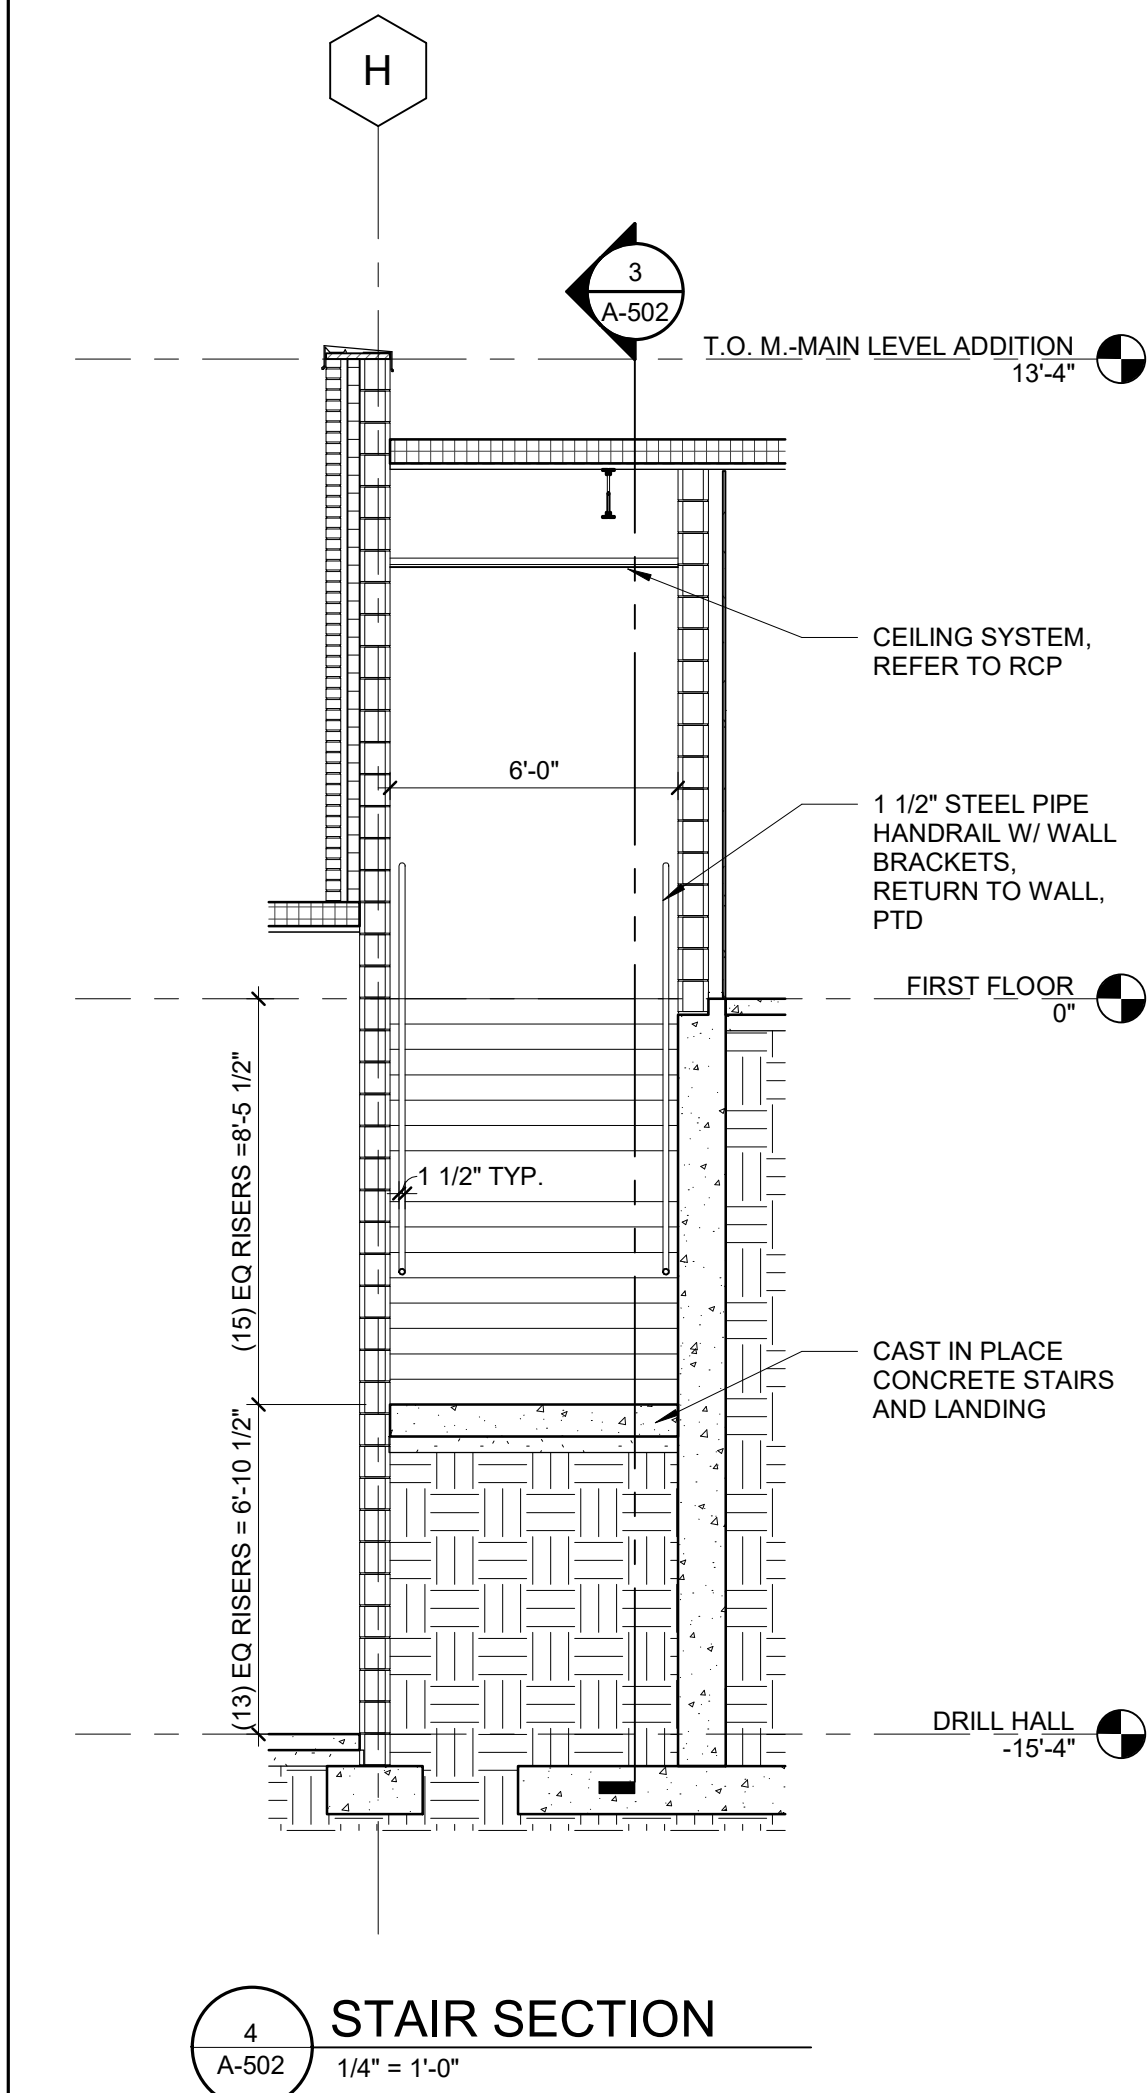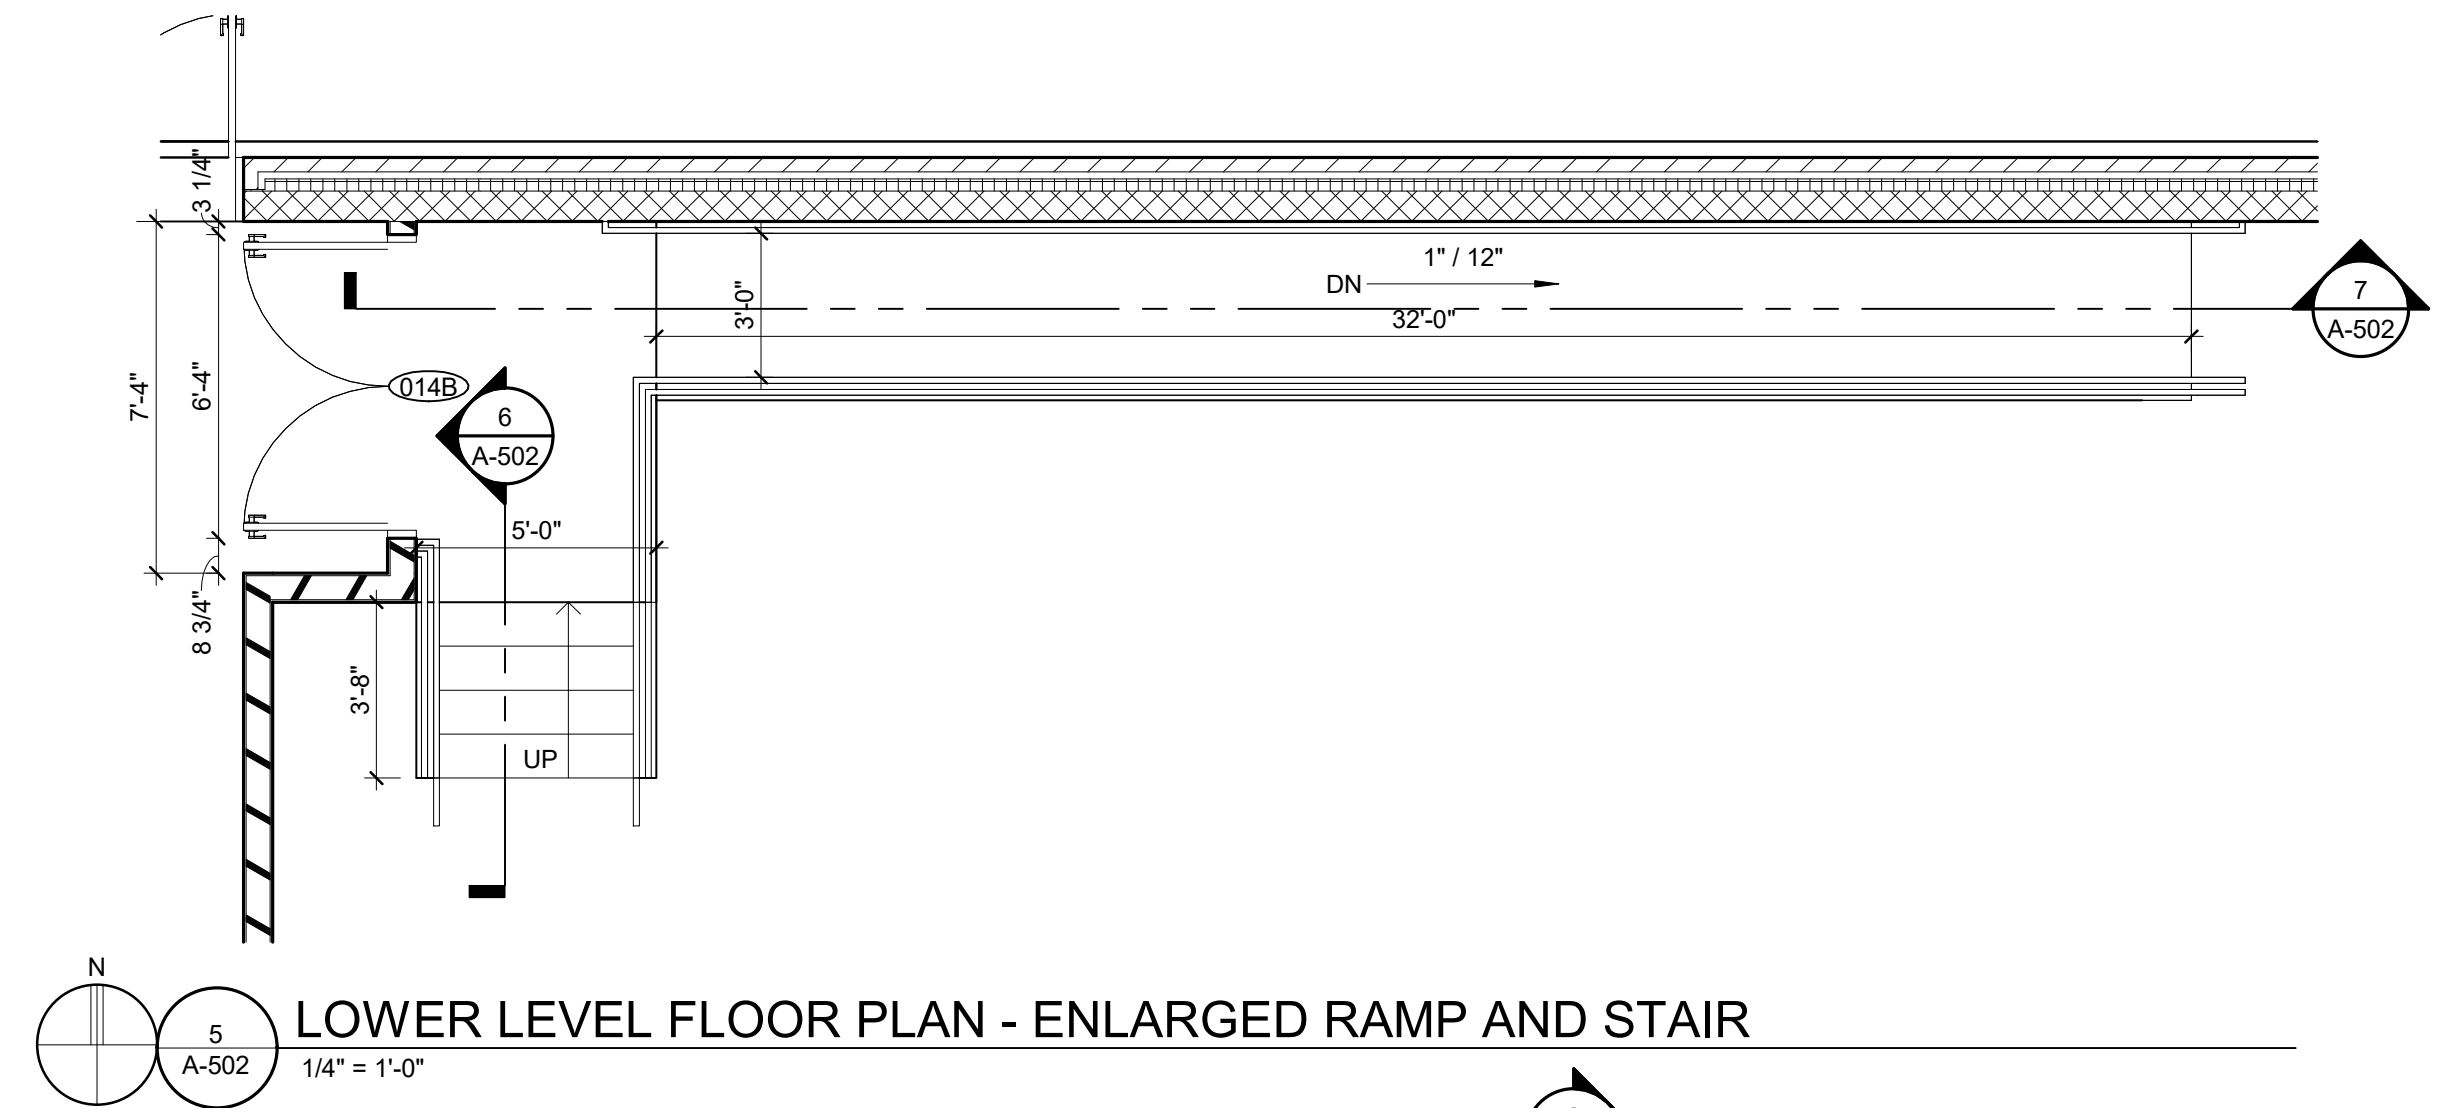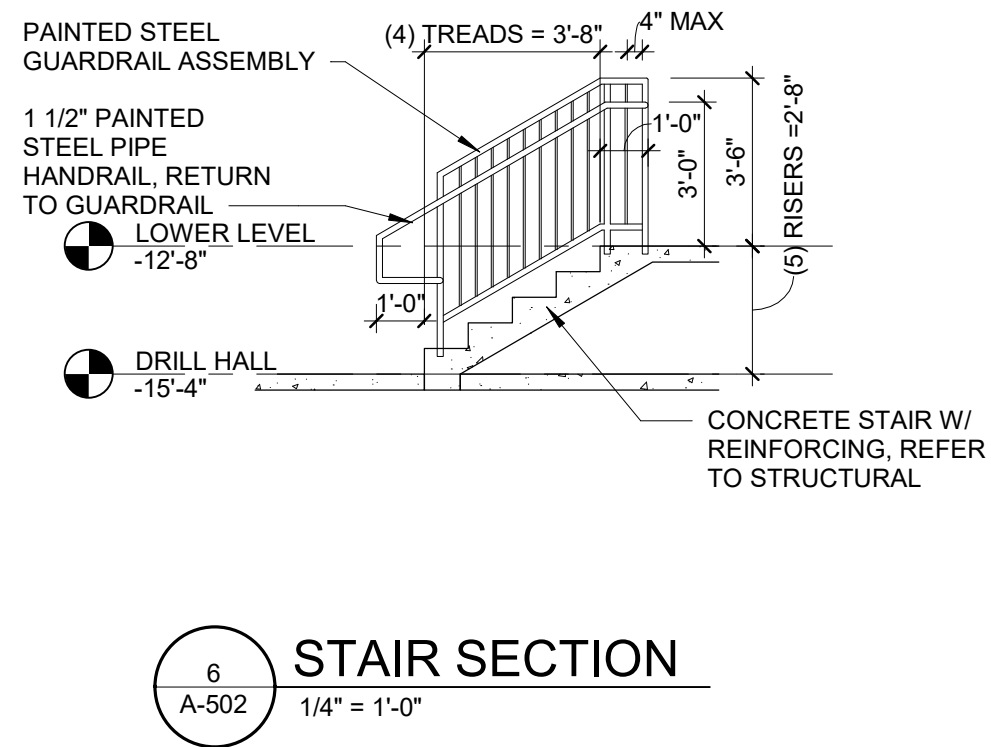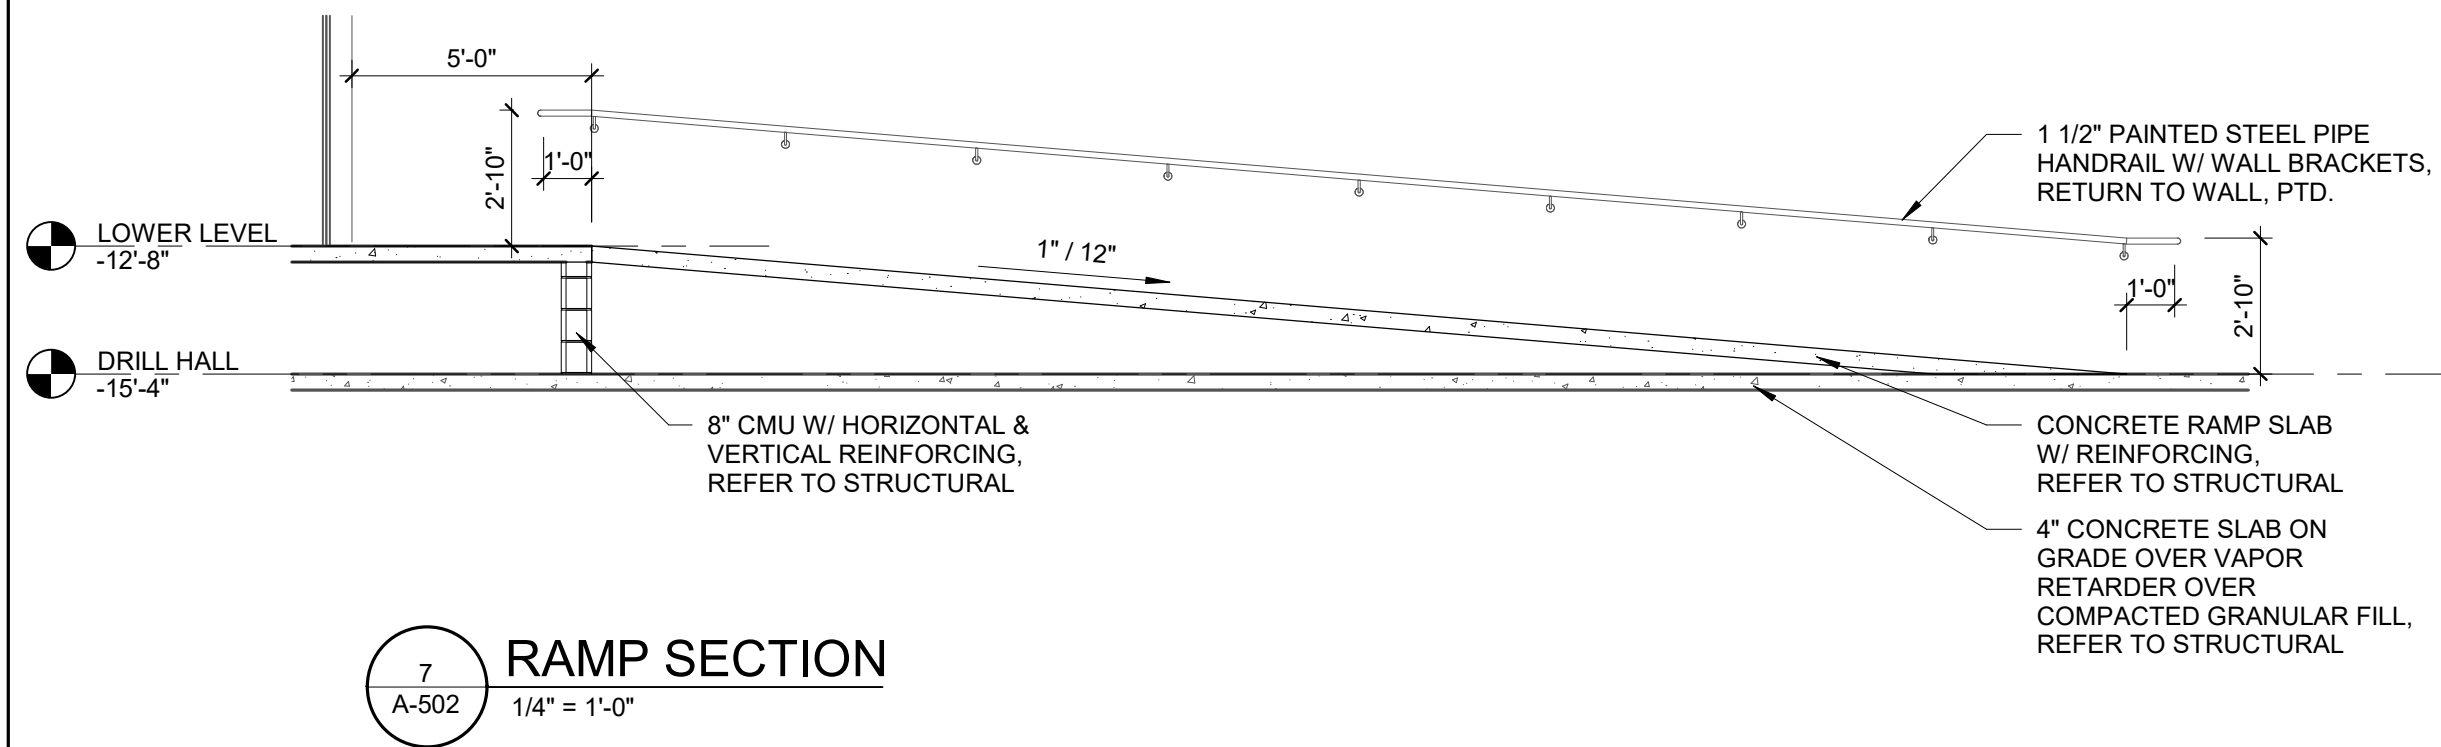

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025




Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS



FOR SITE OWNED UTILITIES



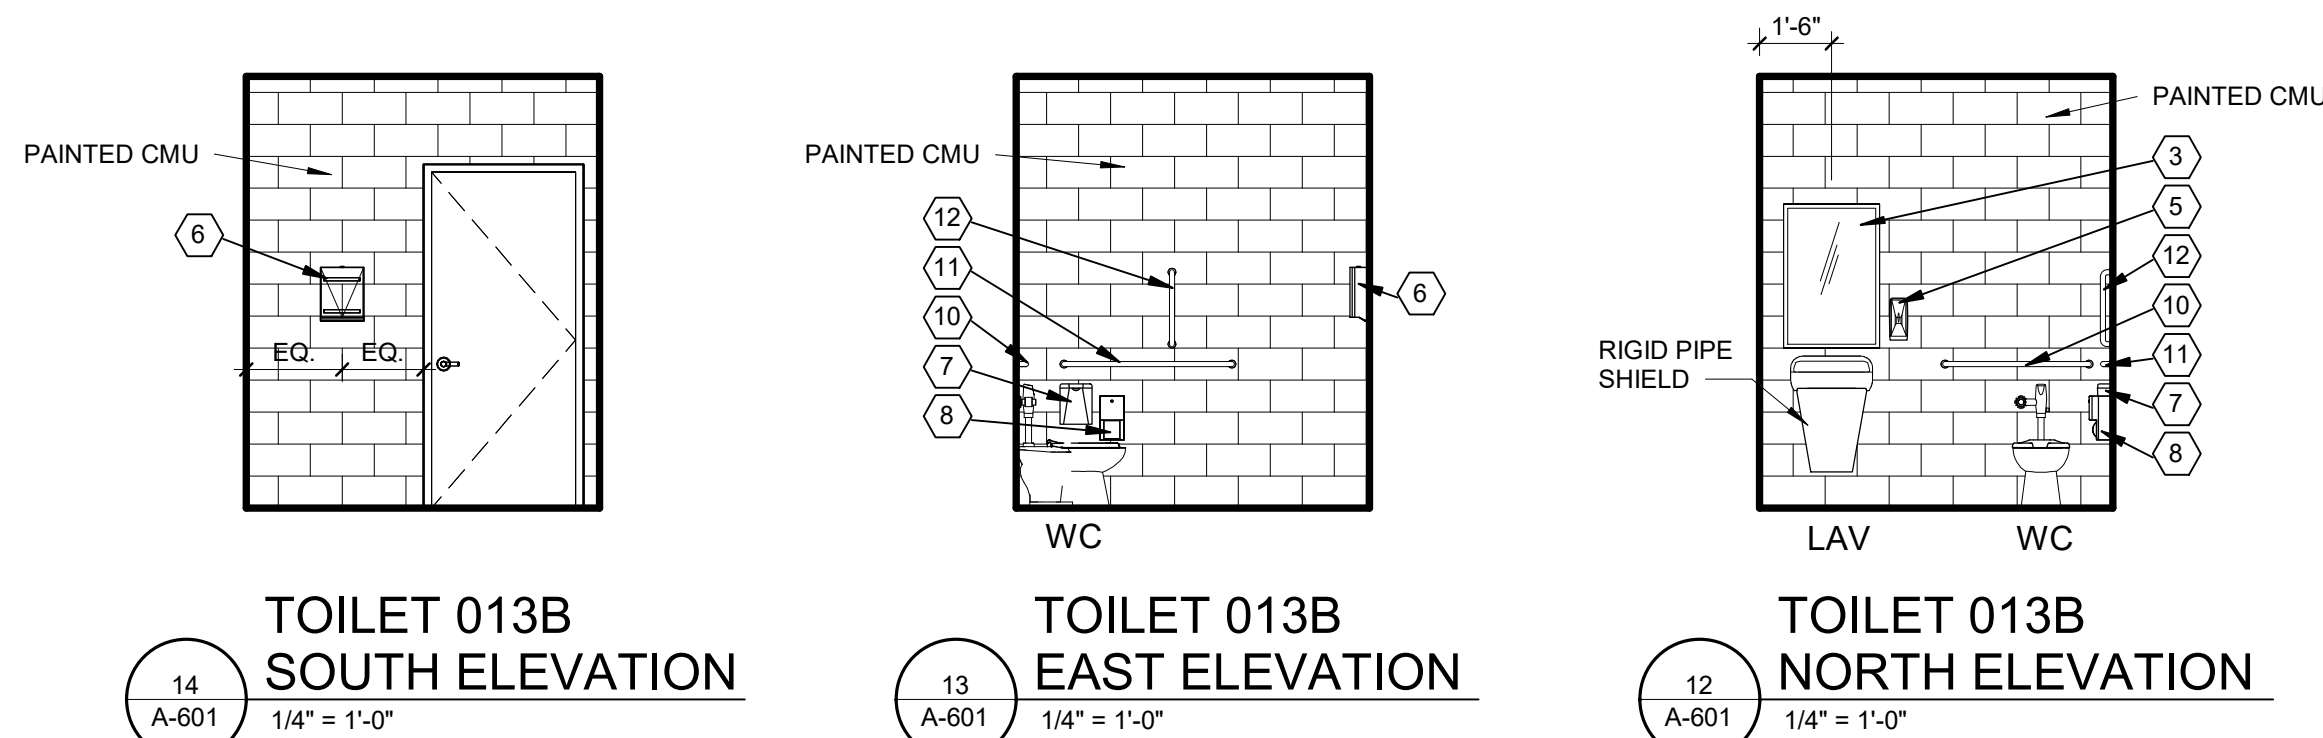

GENERAL INTERIOR NOTES












1. REFER TO SHEET CS-004 FOR STANDARD AND BARRIER FREE MOUNTING HEIGHTS.
2. PROVIDE AND INSTALL SOLID WOOD BLOCKING BEHIND ALL WALL MOUNTED EQUIPMENT, FIXTURES, AND ACCESSORIES TO ALLOW FOR SOLID MOUNTING. DO NOT USE SHEET METAL BLOCKING/BACKING.
3. PROVIDE AND INSTALL ADA-COMPLIANT UNDERSINK PIPE PROTECTION AT ALL EXPOSED WATER SUPPLY AND DRAIN PIPES UNDER LAVATORIES AND SINKS OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. THERE MUST BE NO SHARP OR ABRASIVE SURFACES UNDER LAVATORIES AND SINKS.
4. PROVIDE AND INSTALL TILE BACKER BOARD AT ALL CERAMIC TILE, U.N.O. (NOT REQUIRED WHERE DIRECT APPLIED TO C.M.U.)
5. INSTALL PARTITION MOUNTED ROBE HOOK PER MANUFACTURER STANDARDS - TYP ALL TOILET COMPARTMENTS.
6. REFER TO ROOM FINISH SCHEDULE FOR ADDITIONAL FINISH INFORMATION.
7. REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

GENERAL CASEWORK NOTES

1. SEE SHEET A-001 FOR STANDARD AND BARRIER FREE MOUNTING HEIGHTS AND DIMENSIONS.
2. PROVIDE AND INSTALL SOLID WOOD BLOCKING BEHIND ALL WALL MOUNTED EQUIPMENT, FIXTURES, AND ACCESSORIES TO ALLOW FOR SOLID MOUNTING. DO NOT USE SHEET METAL BLOCKING/BACKING.
3. FILLERS ARE REQUIRED TO CLOSE ALL CABINET TO CABINET OR CABINET TO WALL GAPS AND TO PROVIDE FOR CLEARANCES REQUIRED. WHEN FILLERS ARE REQUIRED AT BOTH ENDS OF CASEWORK, BOTH FILLERS MUST BE EQUAL WIDTH.
4. PROVIDE AND INSTALL FULL EXTENSION UNDERMOUNT DRAWER GUIDES FOR ALL DRAWERS.
5. ALL CASEWORK EXTERIOR EXPOSED OR SEMI-EXPOSED SURFACES TO BE PLASTIC LAMINATE ON PLYWOOD CORE. CASEWORK EDGES TO RECEIVE PLASTIC LAMINATE EDGING UNLESS NOTED OTHERWISE.
6. ALL CASEWORK INTERIOR EXPOSED SURFACES TO BE MELAMINE ON PLYWOOD CORE. DRAWER BOXES ARE TO BE 1/2" MELAMINE. BACKS OF CASEWORK DOORS TO BE PLASTIC LAMINATE TO MATCH EXTERIOR.
7. ALL CASEWORK CABINET DOORS TO HAVE CONCEALED HINGES.
8. PROVIDE AND INSTALL FINISHED END/SIDE PANEL ON ALL EXPOSED CABINET ENDS/SIDES.
9. PROVIDE AND INSTALL ADJUSTABLE SHELVES IN CABINETS AT THE FOLLOWING LOCATIONS UNLESS NOTED OTHERWISE ON INTERIOR ELEVATIONS:
 - a. BASE CABINET - 1 SHELF
 - b. FULL HEIGHT CABINET - 5 SHELVES, 1 FIXED
 - c. WALL CABINET - 1 SHELF AT 24" HIGH CABINET2 SHELVES AT CABINETS OVER 24" HIGH.
NOTE: SHELVES TO BE 3/4" THICK FOR SPANS UP TO 32" AND 1" FOR SPANS UP TO 36"
10. PROVIDE AND INSTALL WALL BRACKET SUPPORTS AT 36" O.C. MAX., U.N.O., TO SUPPORT COUNTERTOP AT CONTINUOUS KNEE SPACE UNLESS NOTED OTHERWISE. (VERIFY W/ BRACKET MANUFACTURER)
11. REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

ACCESSORY LEGEND

- 1 TOILET PARTITIONS, FULL HT. (PRIVATE)
- 2 URINAL PARTITION
- 3 2'W x 3'H MIRROR W/ S.S. FRAME
- 3A 4'W x 3'H MIRROR W/ S.S. FRAME
- 4 COAT HOOK
- 5 SOAP DISPENSER - SURFACE MOUNTED
- 6 PAPER TOWEL DISPENSER - SURFACE MOUNTED
- 7 SANITARY NAPKIN DISPOSAL- SURFACE MOUNTED
- 8 TOILET TISSUE DISPENSER - SURFACE MOUNTED
- 9 ELECTRIC HAND DRYER W/ S.S. WALL GUARD
- 10 36" GRAB BAR
- 11 42" GRAB BAR
- 12 18" VERTICAL GRAB BAR
- 13 SHOWER CURTAIN AND ROD
- 14 UTILITY SHELF AND MOP HOLDER
- 15 SHOWER BENCH
- 16 DIAPER CHANGING STATION

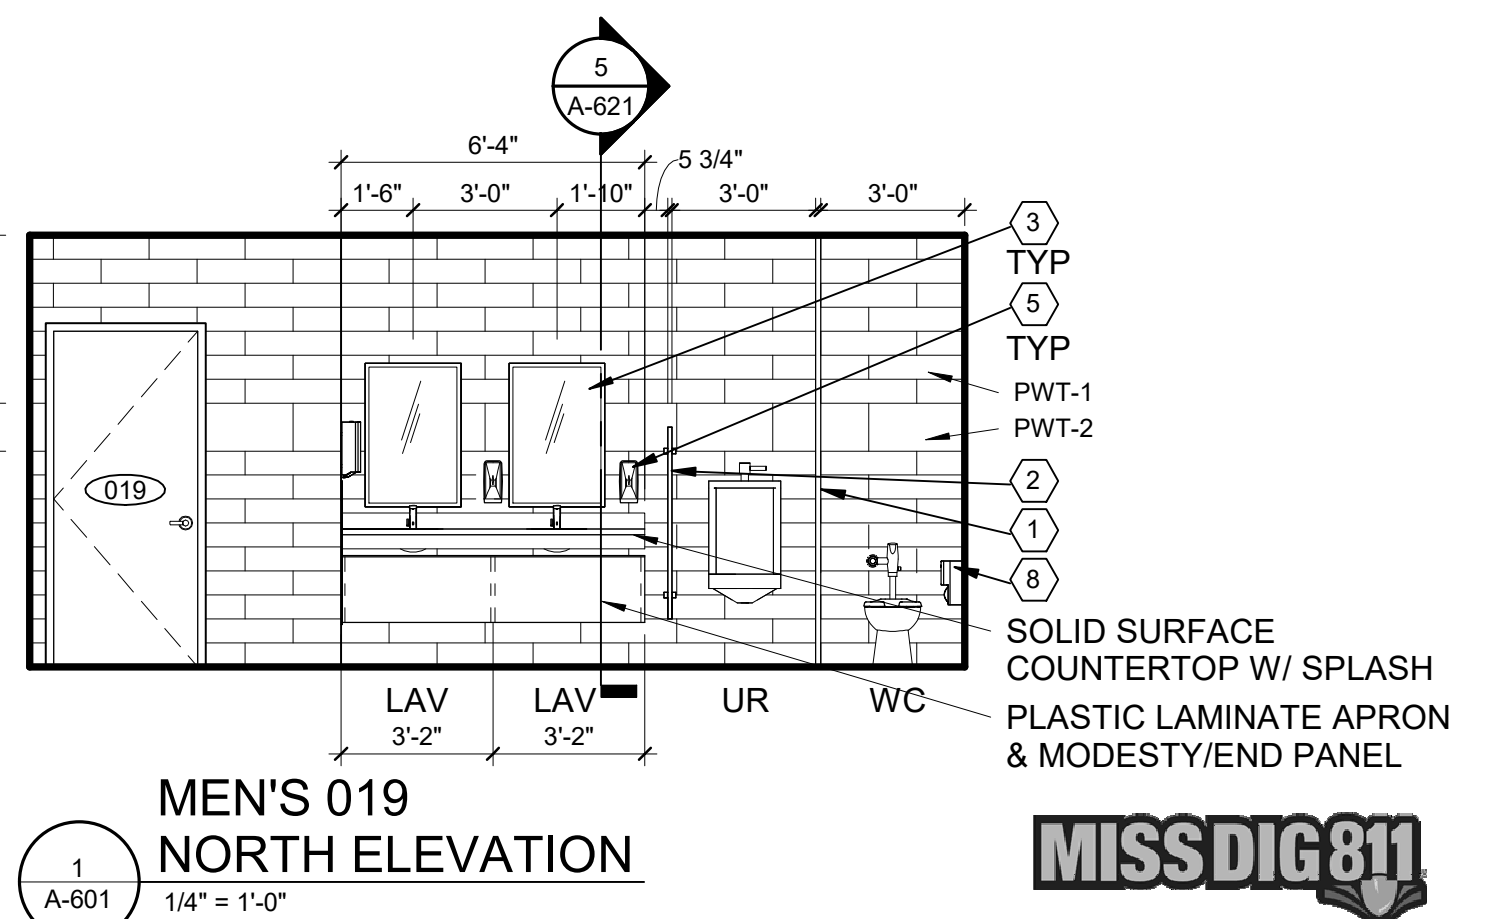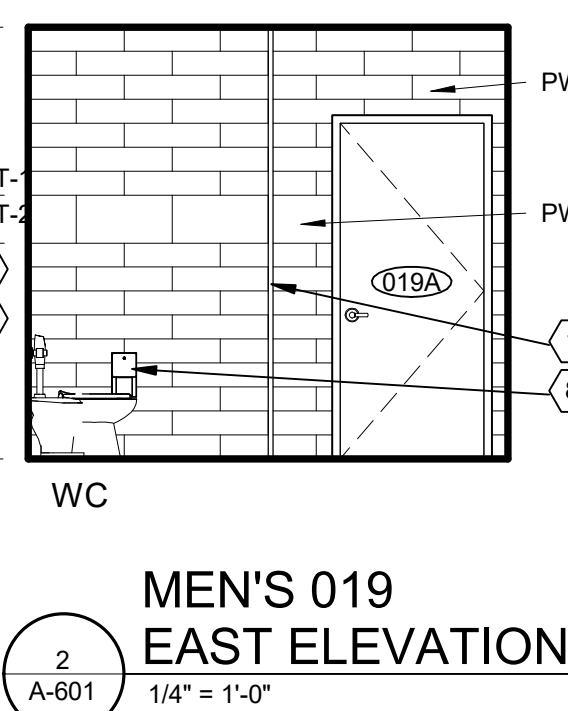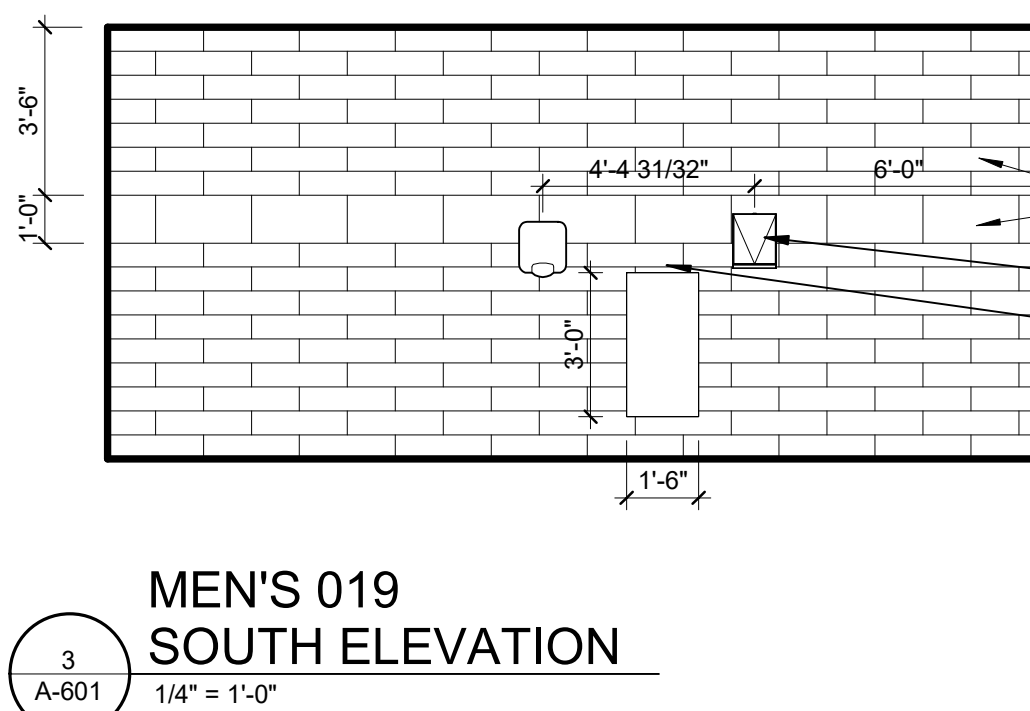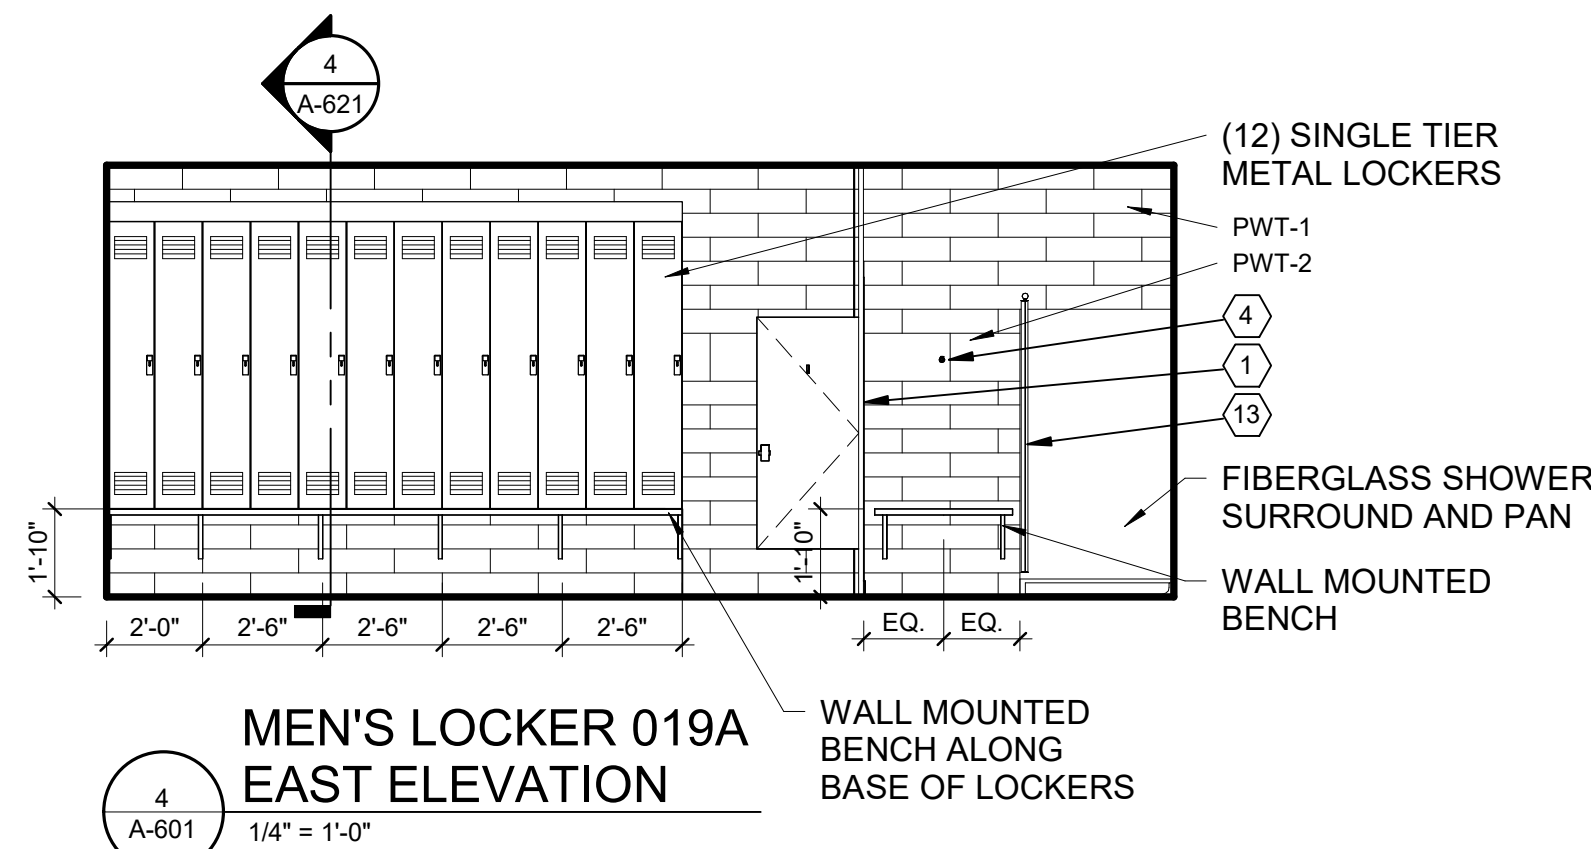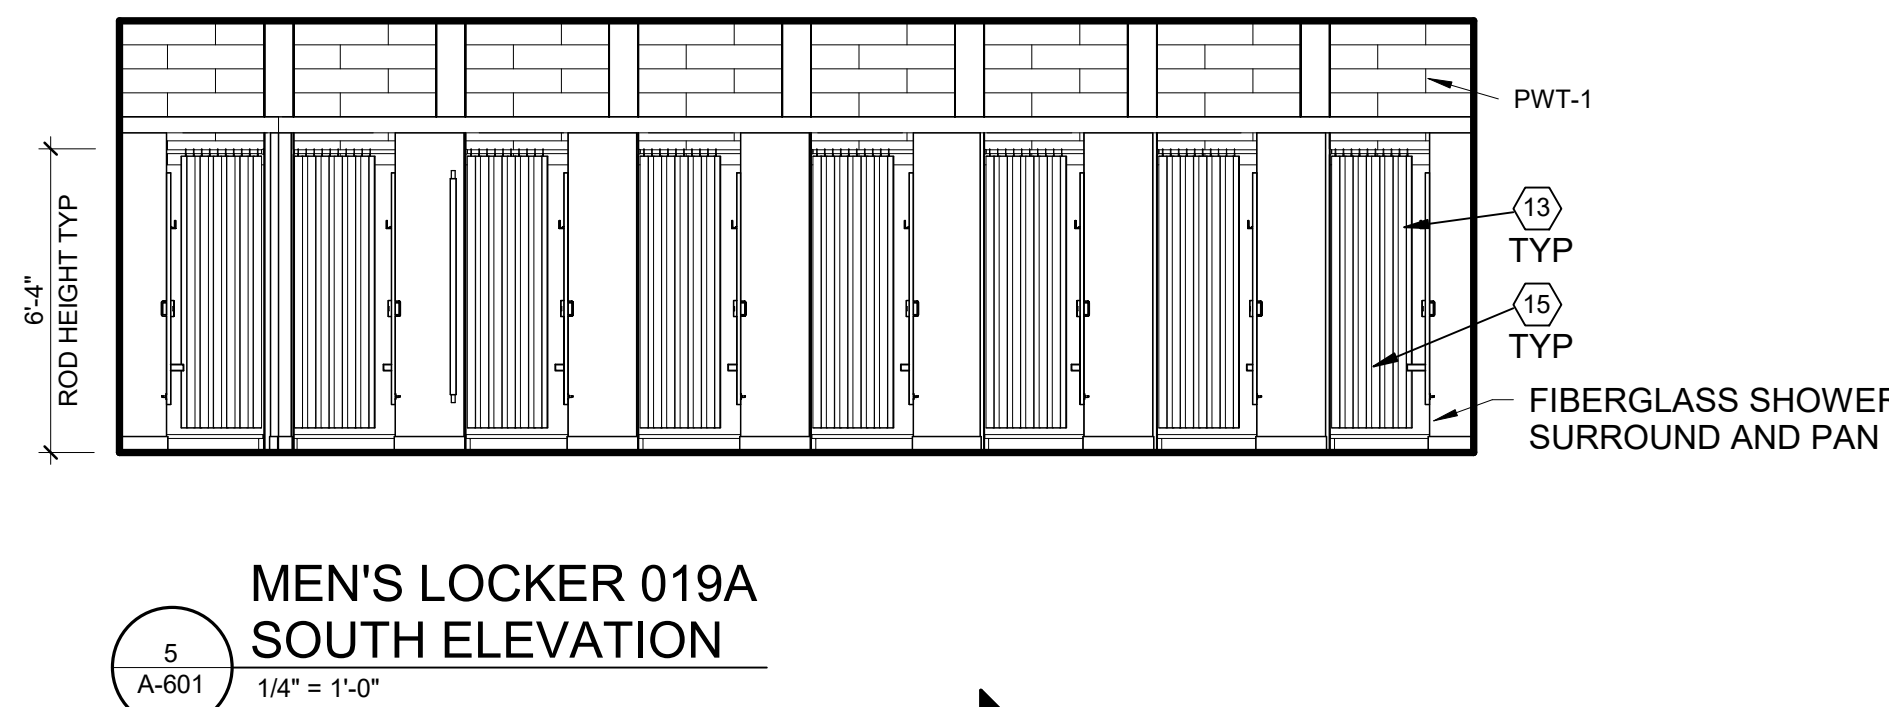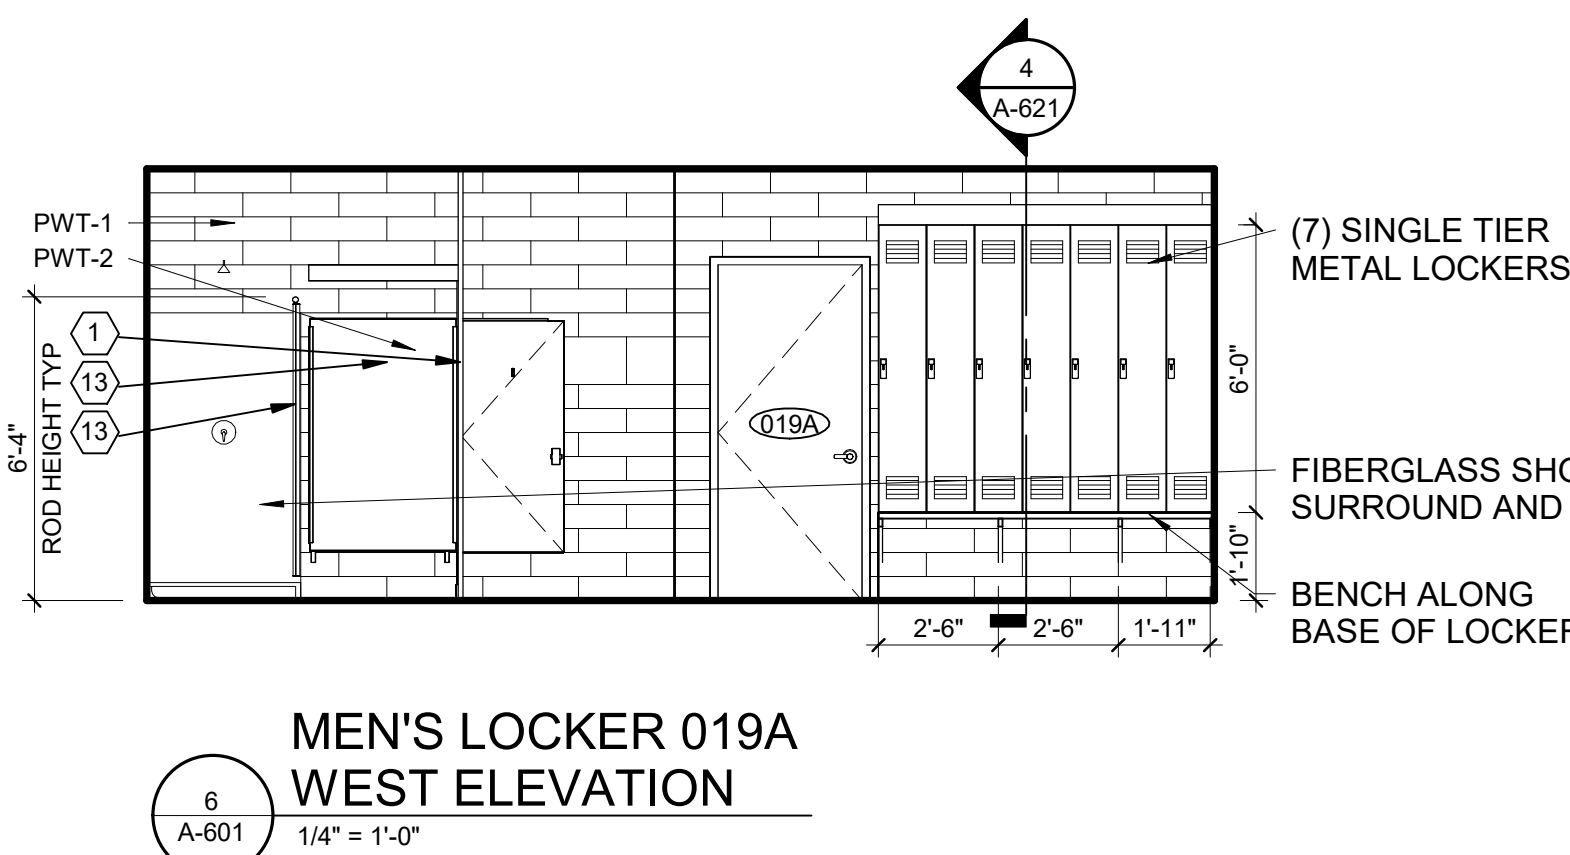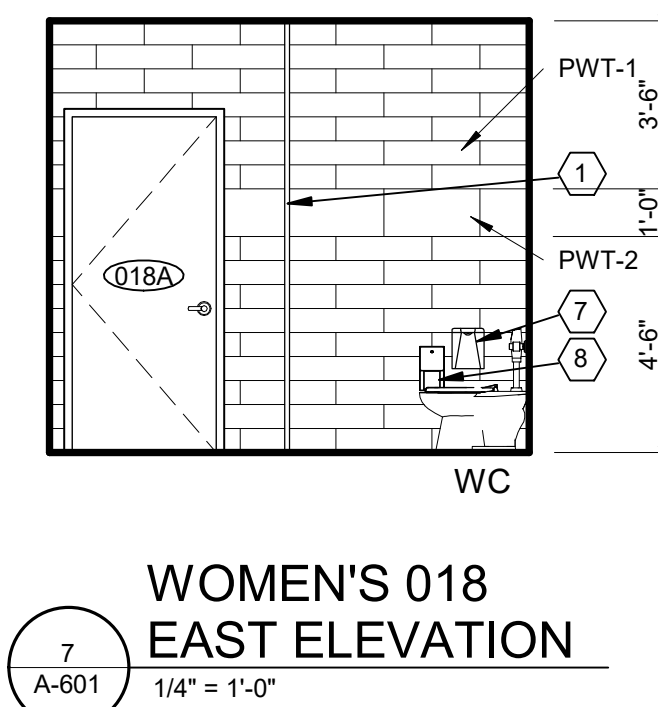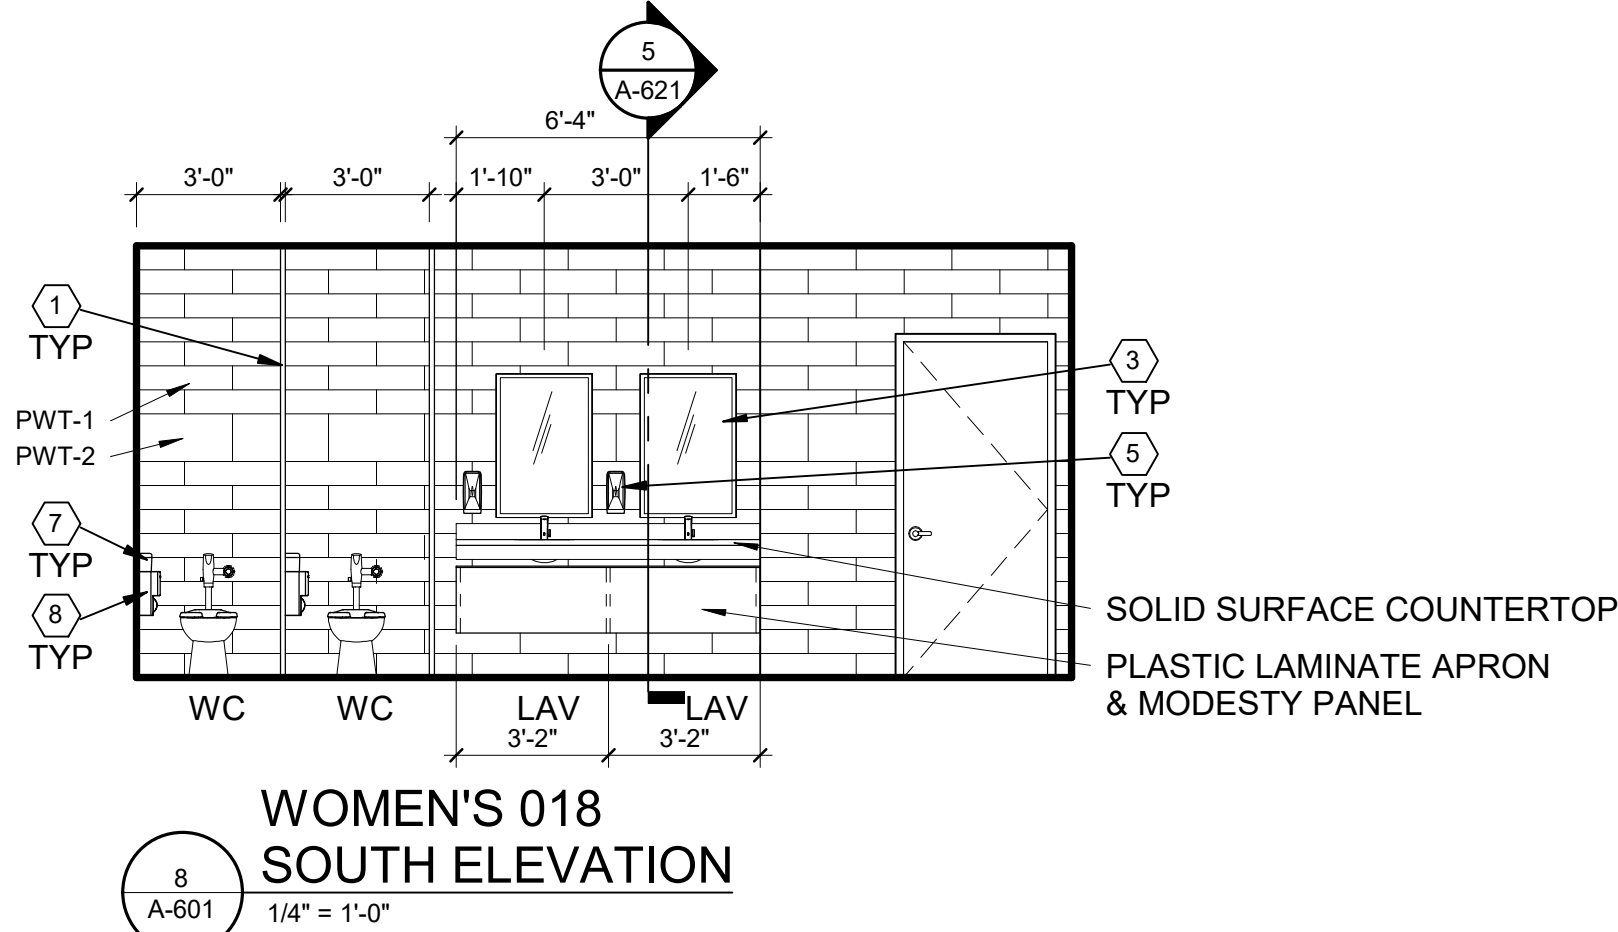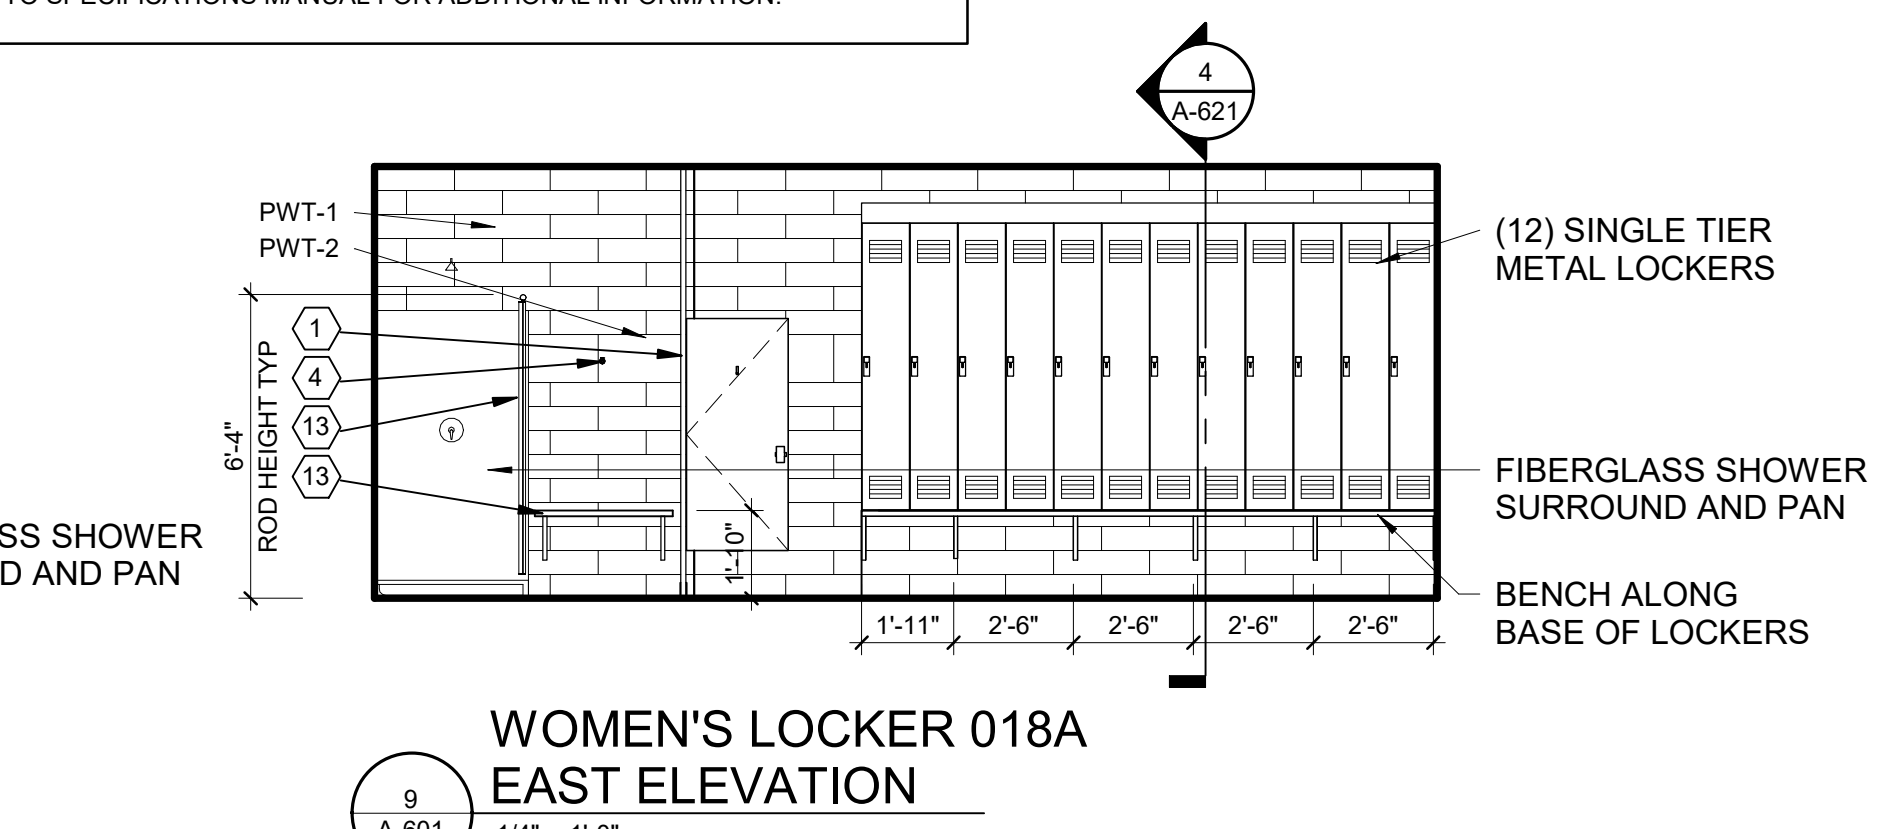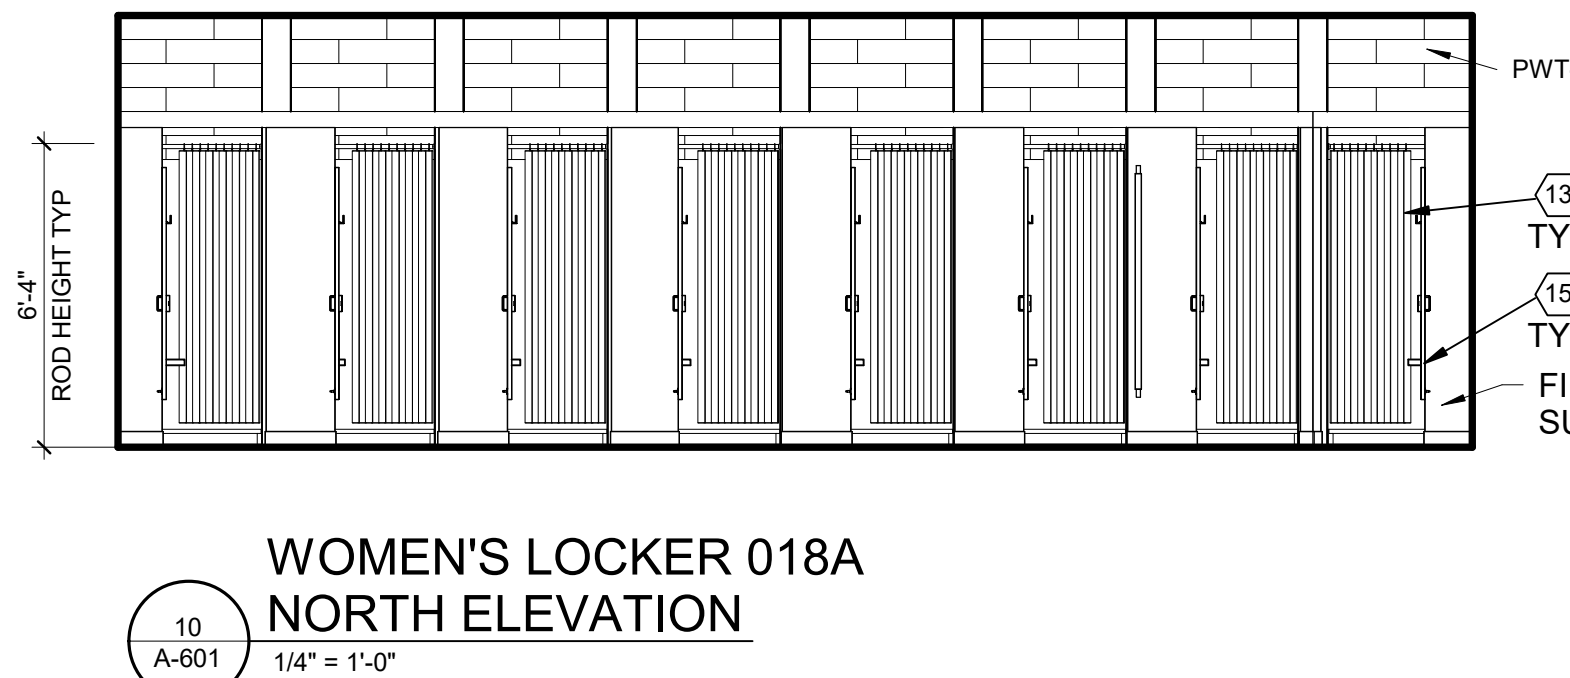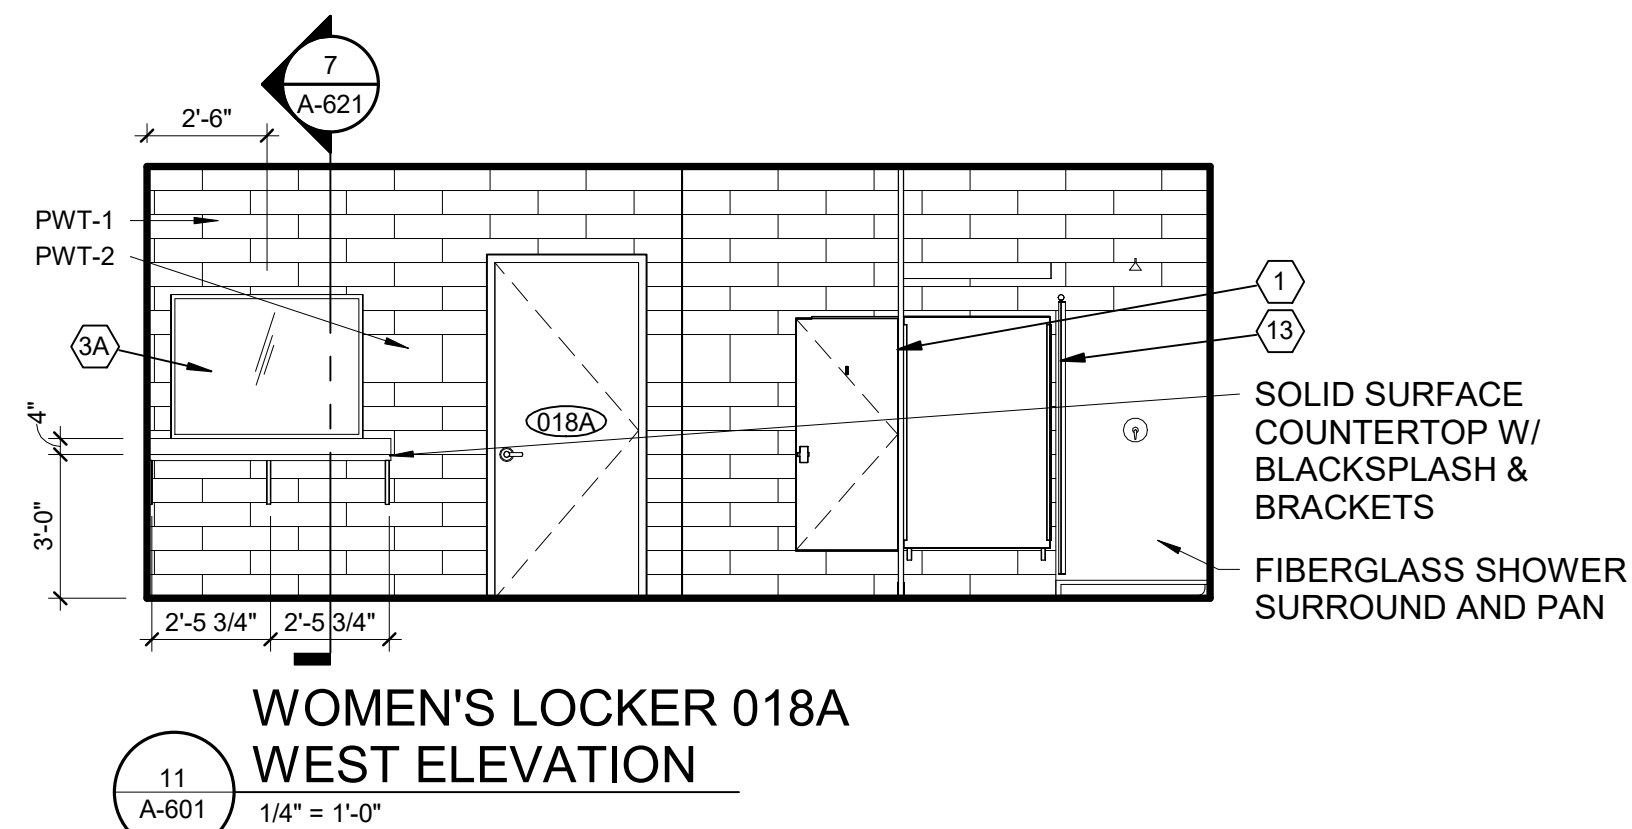

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025




Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS




FOR SITE OWNED UTILITIES




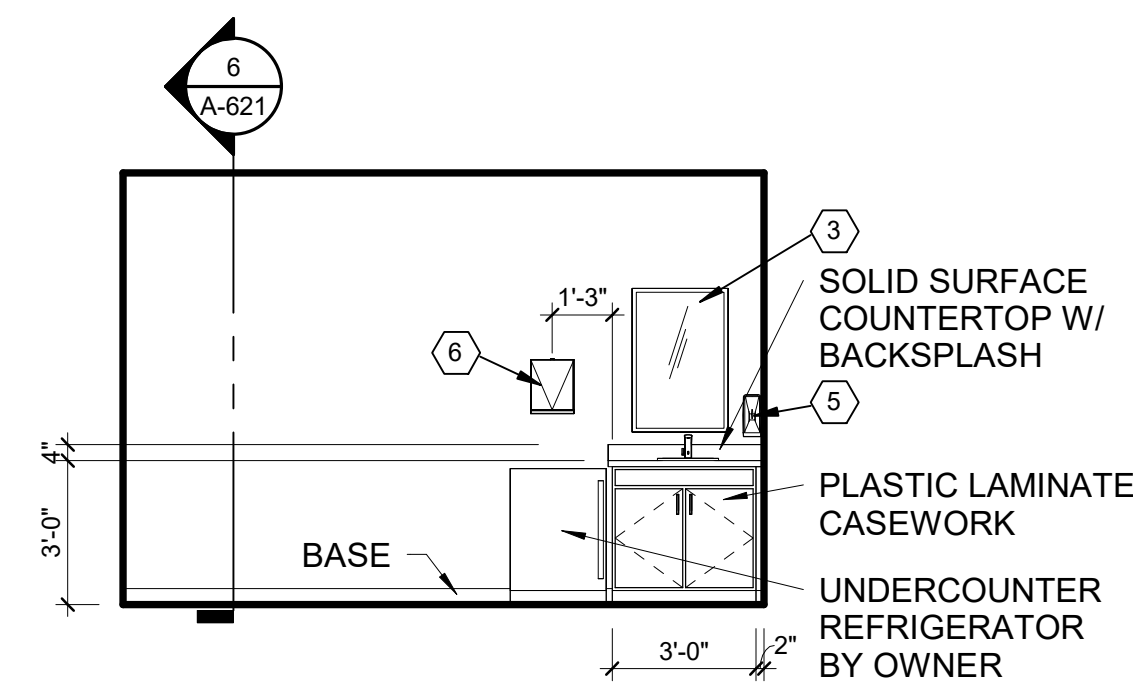


LACTATION 133
EAST ELEVATION
5
A-602
1/4" = 1'-0"

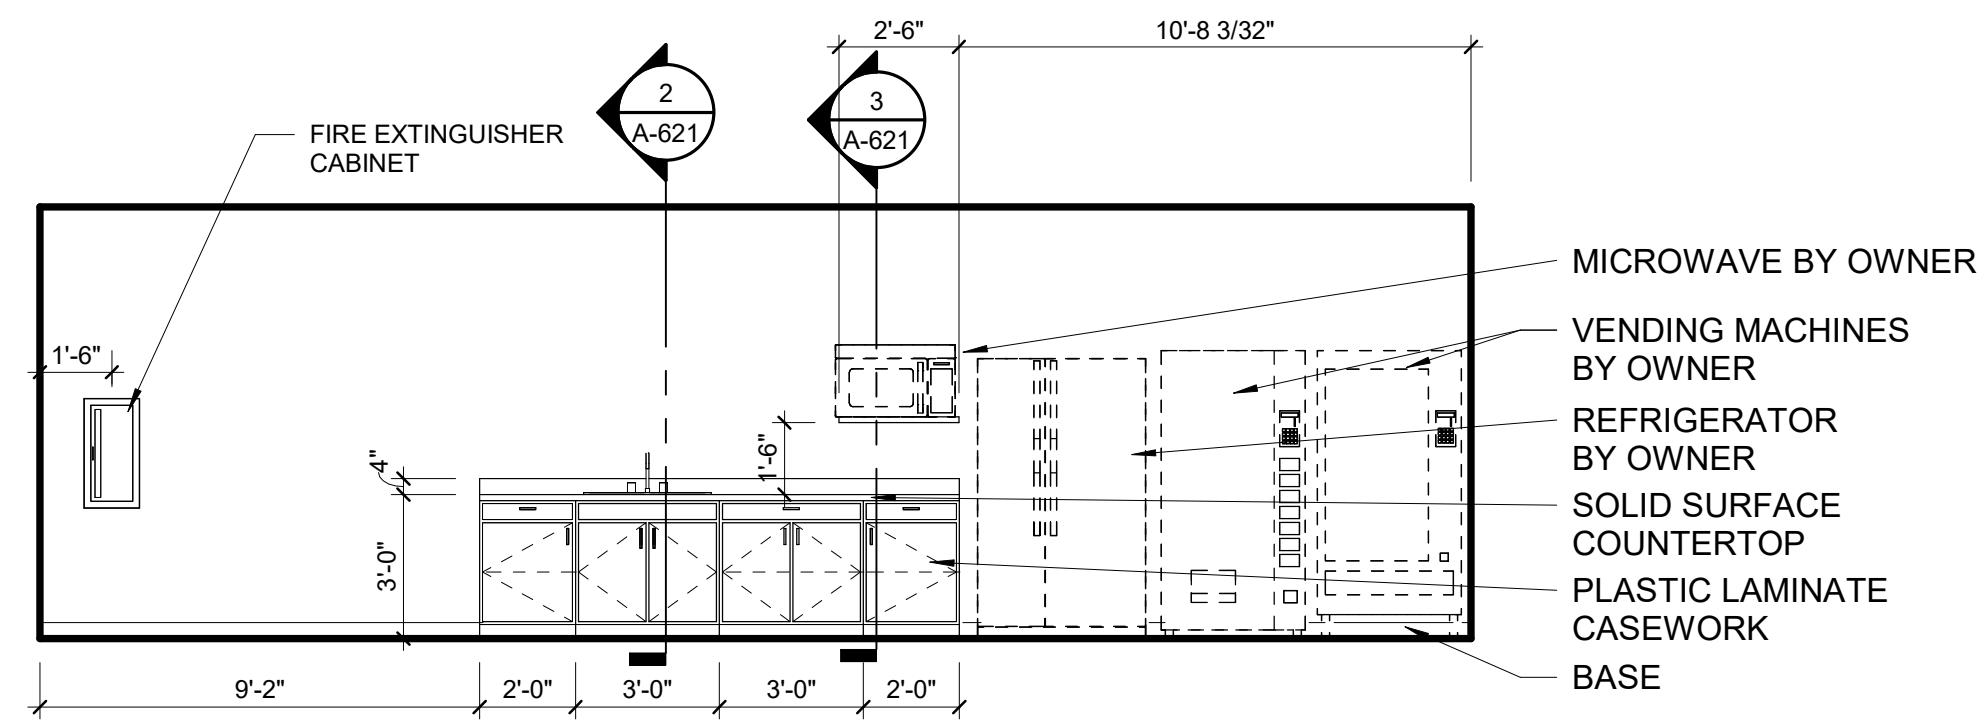


BREAK ROOM 106
SOUTH ELEVATION
4
A-602
1/4" = 1'-0"

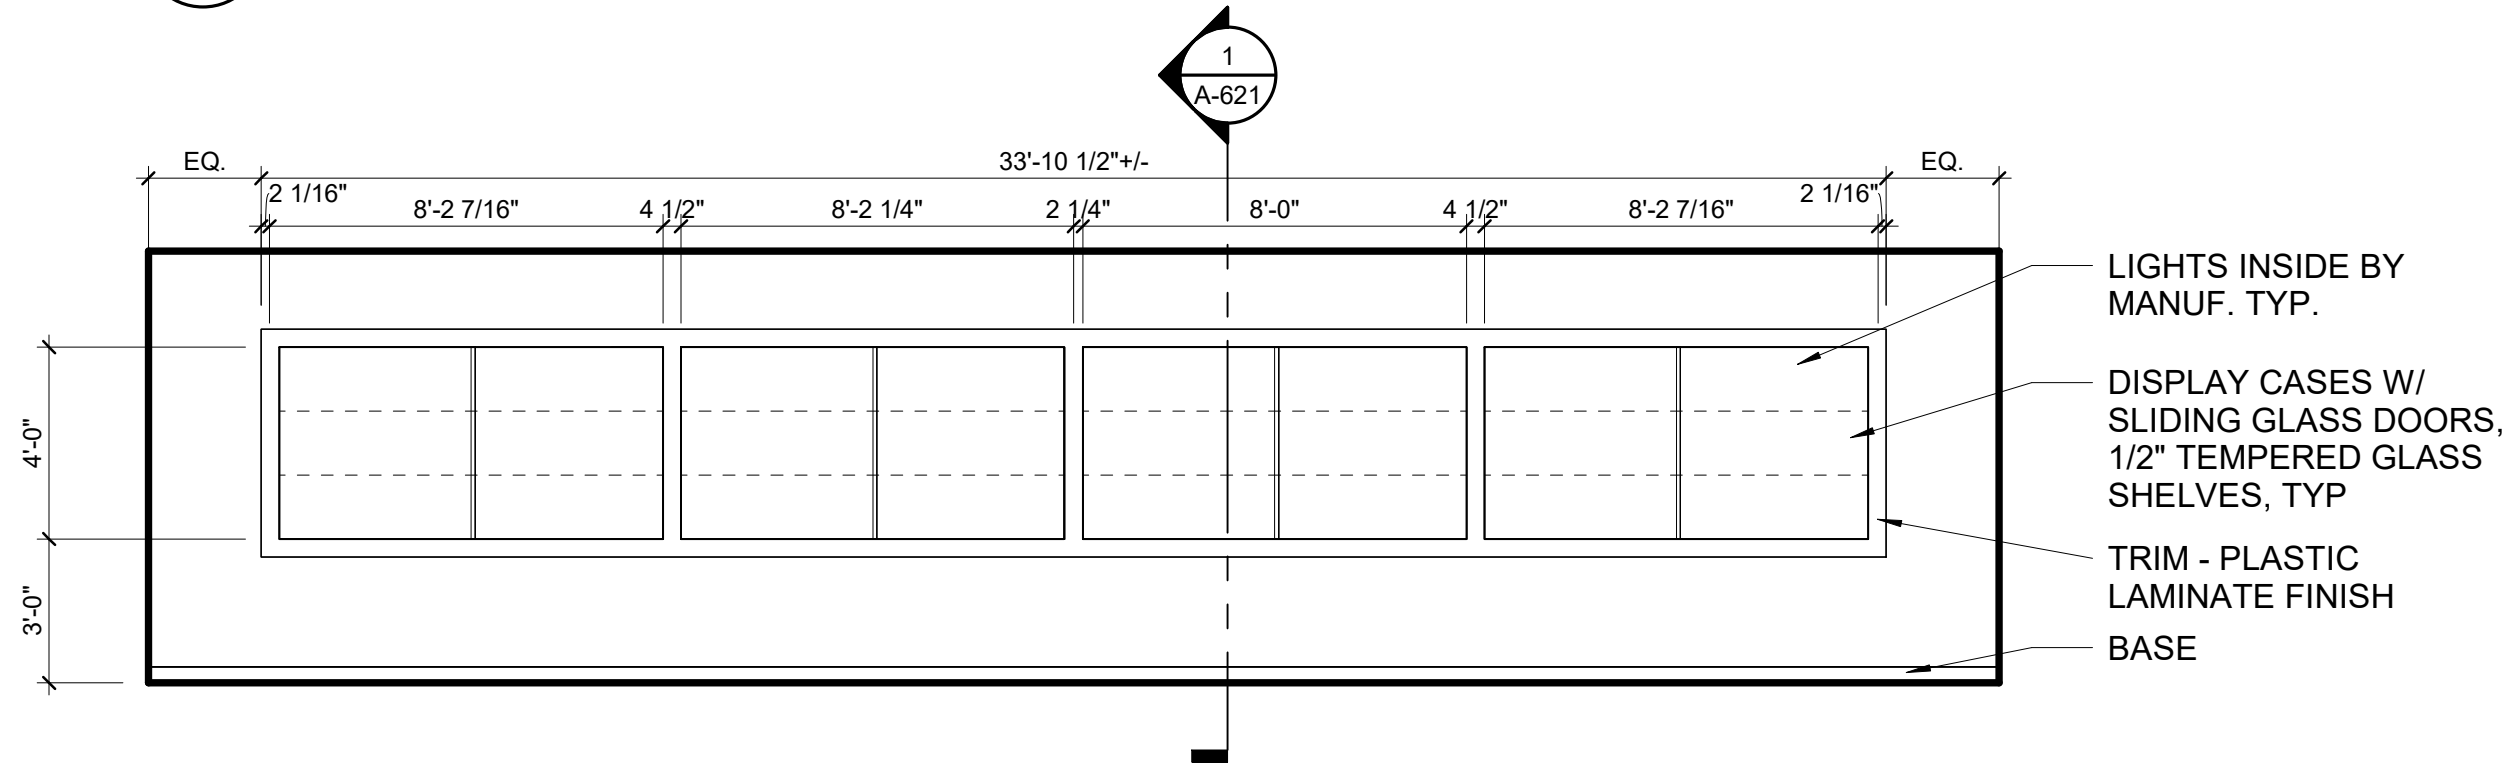

CORRIDOR 101A
DISPLAY CASE ELEVATION
3
A-602
1/4" = 1'-0"

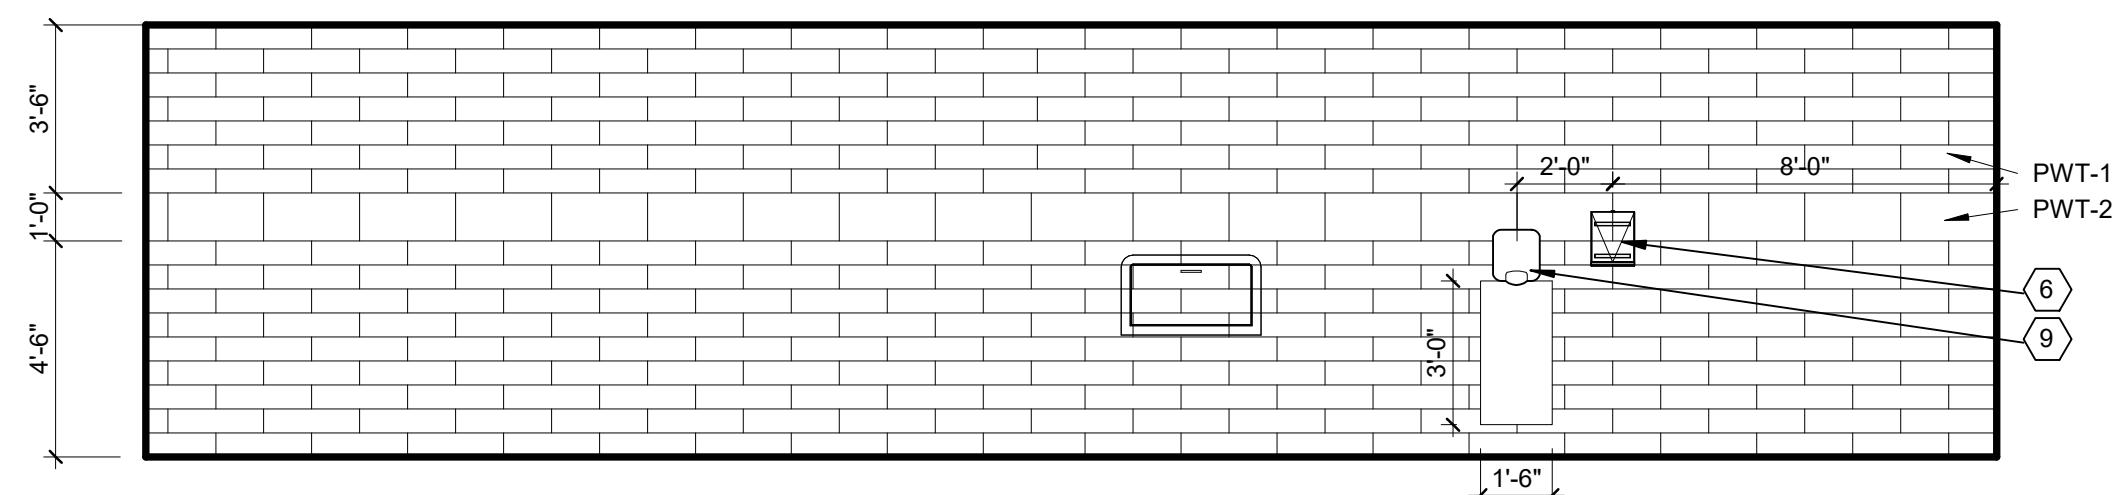

MEN'S 104
NORTH ELEVATION
6
A-602
1/4" = 1'-0"

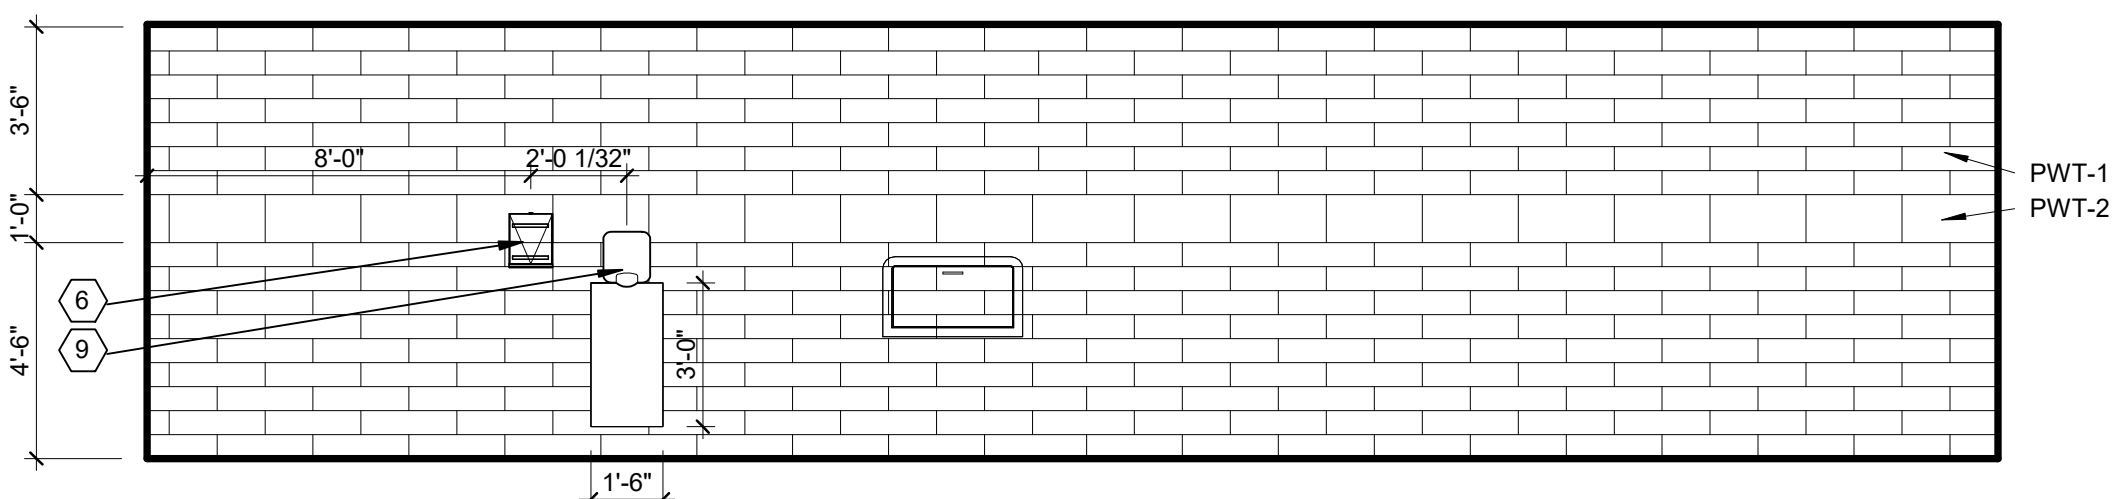

WOMEN'S 103
SOUTH ELEVATION
7
A-602
1/4" = 1'-0"

GENERAL INTERIOR NOTES


1. REFER TO SHEET CS-004 FOR STANDARD AND BARRIER FREE MOUNTING HEIGHTS.
2. PROVIDE AND INSTALL SOLID WOOD BLOCKING BEHIND ALL WALL MOUNTED EQUIPMENT, FIXTURES, AND ACCESSORIES TO ALLOW FOR SOLID MOUNTING. DO NOT USE SHEET METAL BLOCKING/BACKING.
3. PROVIDE AND INSTALL ADA-COMPLIANT UNDERSINK PIPE PROTECTION AT ALL EXPOSED WATER SUPPLY AND DRAIN PIPES UNDER LAVATORIES AND SINKS OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. THERE MUST BE NO SHARP OR ABRASIVE SURFACES UNDER LAVATORIES AND SINKS.
4. PROVIDE AND INSTALL TILE BACKER BOARD AT ALL CERAMIC TILE, U.N.O. (NOT REQUIRED WHERE DIRECT APPLIED TO C.M.U.)
5. INSTALL PARTITION MOUNTED ROBE HOOK PER MANUFACTURER STANDARDS - TYP ALL TOILET COMPARTMENTS.
6. REFER TO ROOM FINISH SCHEDULE FOR ADDITIONAL FINISH INFORMATION.
7. REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

ACCESSORY LEGEND


- 1 TOILET PARTITIONS, FULL HT. (PRIVATE)
- 2 URINAL PARTITION
- 3 2'W x 3'H MIRROR W/ S.S. FRAME
- 3A 4'W x 3'H MIRROR W/ S.S. FRAME
- 4 COAT HOOK
- 5 SOAP DISPENSER - SURFACE MOUNTED
- 6 PAPER TOWEL DISPENSER - SURFACE MOUNTED
- 7 SANITARY NAPKIN DISPOSAL- SURFACE MOUNTED
- 8 TOILET TISSUE DISPENSER - SURFACE MOUNTED
- 9 ELECTRIC HAND DRYER W/ S.S. WALL GUARD
- 10 36" GRAB BAR
- 11 42" GRAB BAR
- 12 18" VERTICAL GRAB BAR
- 13 SHOWER CURTAIN AND ROD
- 14 UTILITY SHELF AND MOP HOLDER
- 15 SHOWER BENCH
- 16 DIAPER CHANGING STATION

GENERAL CASEWORK NOTES

1. SEE SHEET A-001 FOR STANDARD AND BARRIER FREE MOUNTING HEIGHTS AND DIMENSIONS.
2. PROVIDE AND INSTALL SOLID WOOD BLOCKING BEHIND ALL WALL MOUNTED EQUIPMENT, FIXTURES, AND ACCESSORIES TO ALLOW FOR SOLID MOUNTING. DO NOT USE SHEET METAL BLOCKING/BACKING.
3. FILLERS ARE REQUIRED TO CLOSE ALL CABINET TO CABINET OR CABINET TO WALL GAPS AND TO PROVIDE FOR CLEARANCES REQUIRED. WHEN FILLERS ARE REQUIRED AT BOTH ENDS OF CASEWORK, BOTH FILLERS MUST BE EQUAL WIDTH.
4. PROVIDE AND INSTALL FULL EXTENSION UNDERMOUNT DRAWER GUIDES FOR ALL DRAWERS.
5. ALL CASEWORK EXTERIOR EXPOSED OR SEMI-EXPOSED SURFACES TO BE PLASTIC LAMINATE ON PLYWOOD CORE. CASEWORK EDGES TO RECEIVE PLASTIC LAMINATE EDGING UNLESS NOTED OTHERWISE.
6. ALL CASEWORK INTERIOR EXPOSED SURFACES TO BE MELAMINE ON PLYWOOD CORE. DRAWER BOXES ARE TO BE 1/2" MELAMINE. BACKS OF CASEWORK DOORS TO BE PLASTIC LAMINATE TO MATCH EXTERIOR.
7. ALL CASEWORK CABINET DOORS TO HAVE CONCEALED HINGES.
8. PROVIDE AND INSTALL FINISHED END/SIDE PANEL ON ALL EXPOSED CABINET ENDS/SIDES.
9. PROVIDE AND INSTALL ADJUSTABLE SHELVES IN CABINETS AT THE FOLLOWING LOCATIONS UNLESS NOTED OTHERWISE ON INTERIOR ELEVATIONS:
 - a. BASE CABINET - 1 SHELF
 - b. FULL HEIGHT CABINET - 5 SHELVES, 1 FIXED
 - c. WALL CABINET - 1 SHELF AT 24" HIGH CABINET2 SHELVES AT CABINETS OVER 24" HIGH.
NOTE: SHELVES TO BE 3/4" THICK FOR SPANS UP TO 32" AND 1" FOR SPANS UP TO 36"
10. PROVIDE AND INSTALL WALL BRACKET SUPPORTS AT 36" O.C. MAX., U.N.O., TO SUPPORT COUNTERTOP AT CONTINUOUS KNEE SPACE UNLESS NOTED OTHERWISE. (VERIFY W/ BRACKET MANUFACTURER)
11. REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

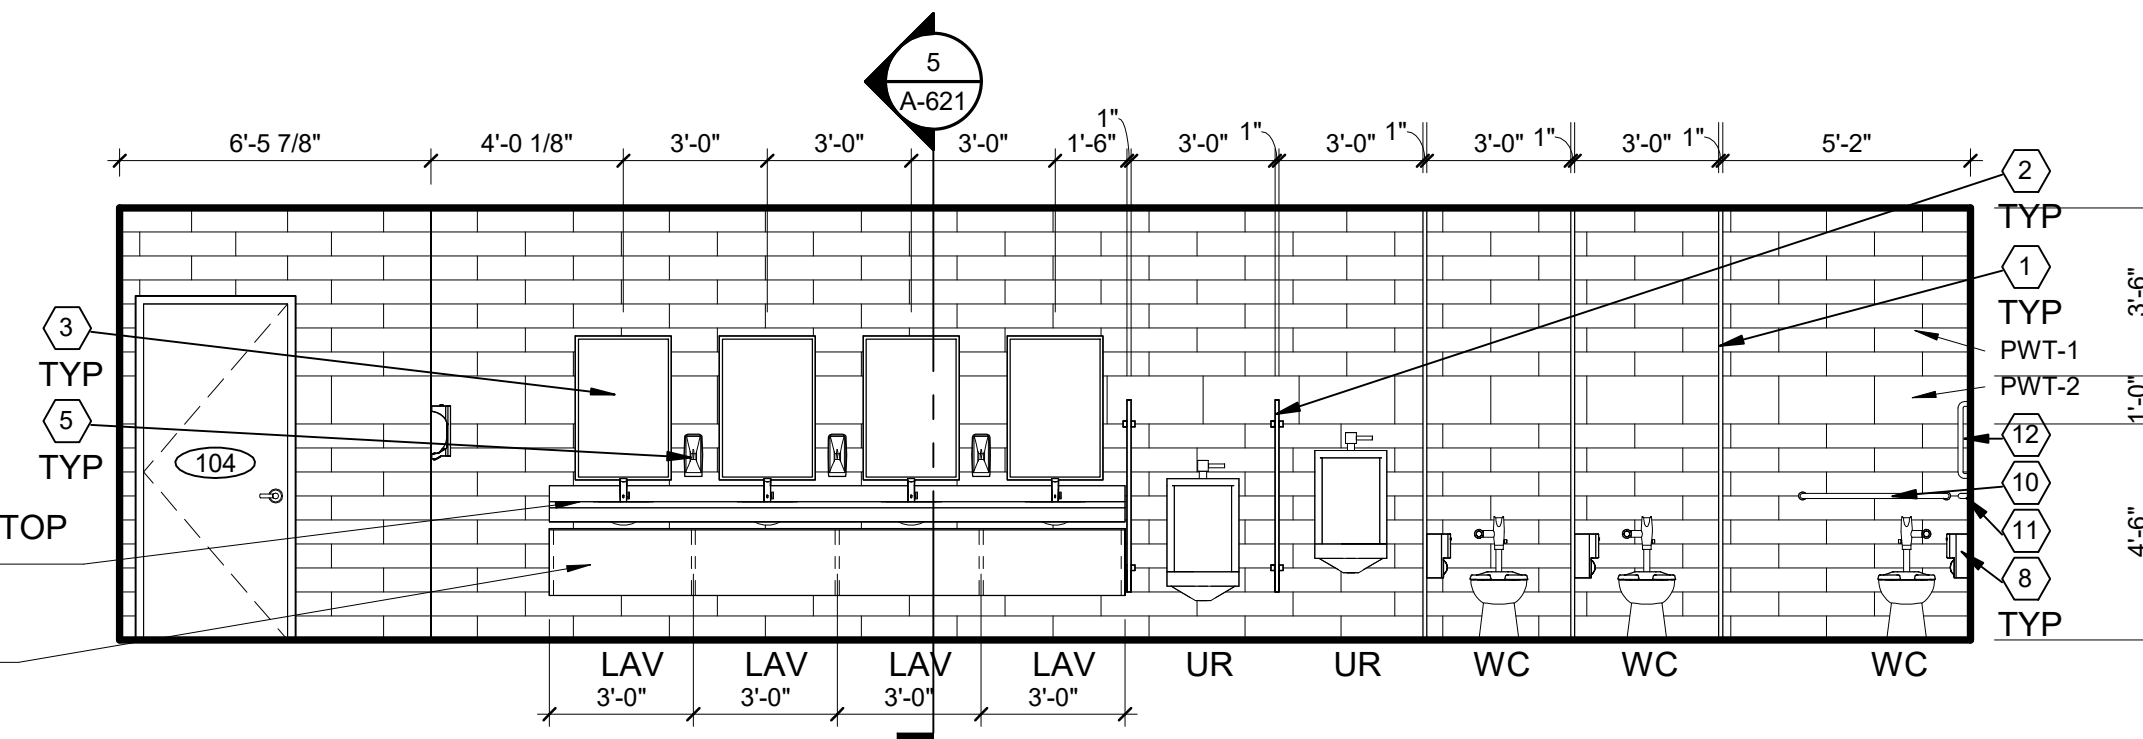

MEN'S 104
SOUTH ELEVATION
2
A-602
1/4" = 1'-0"

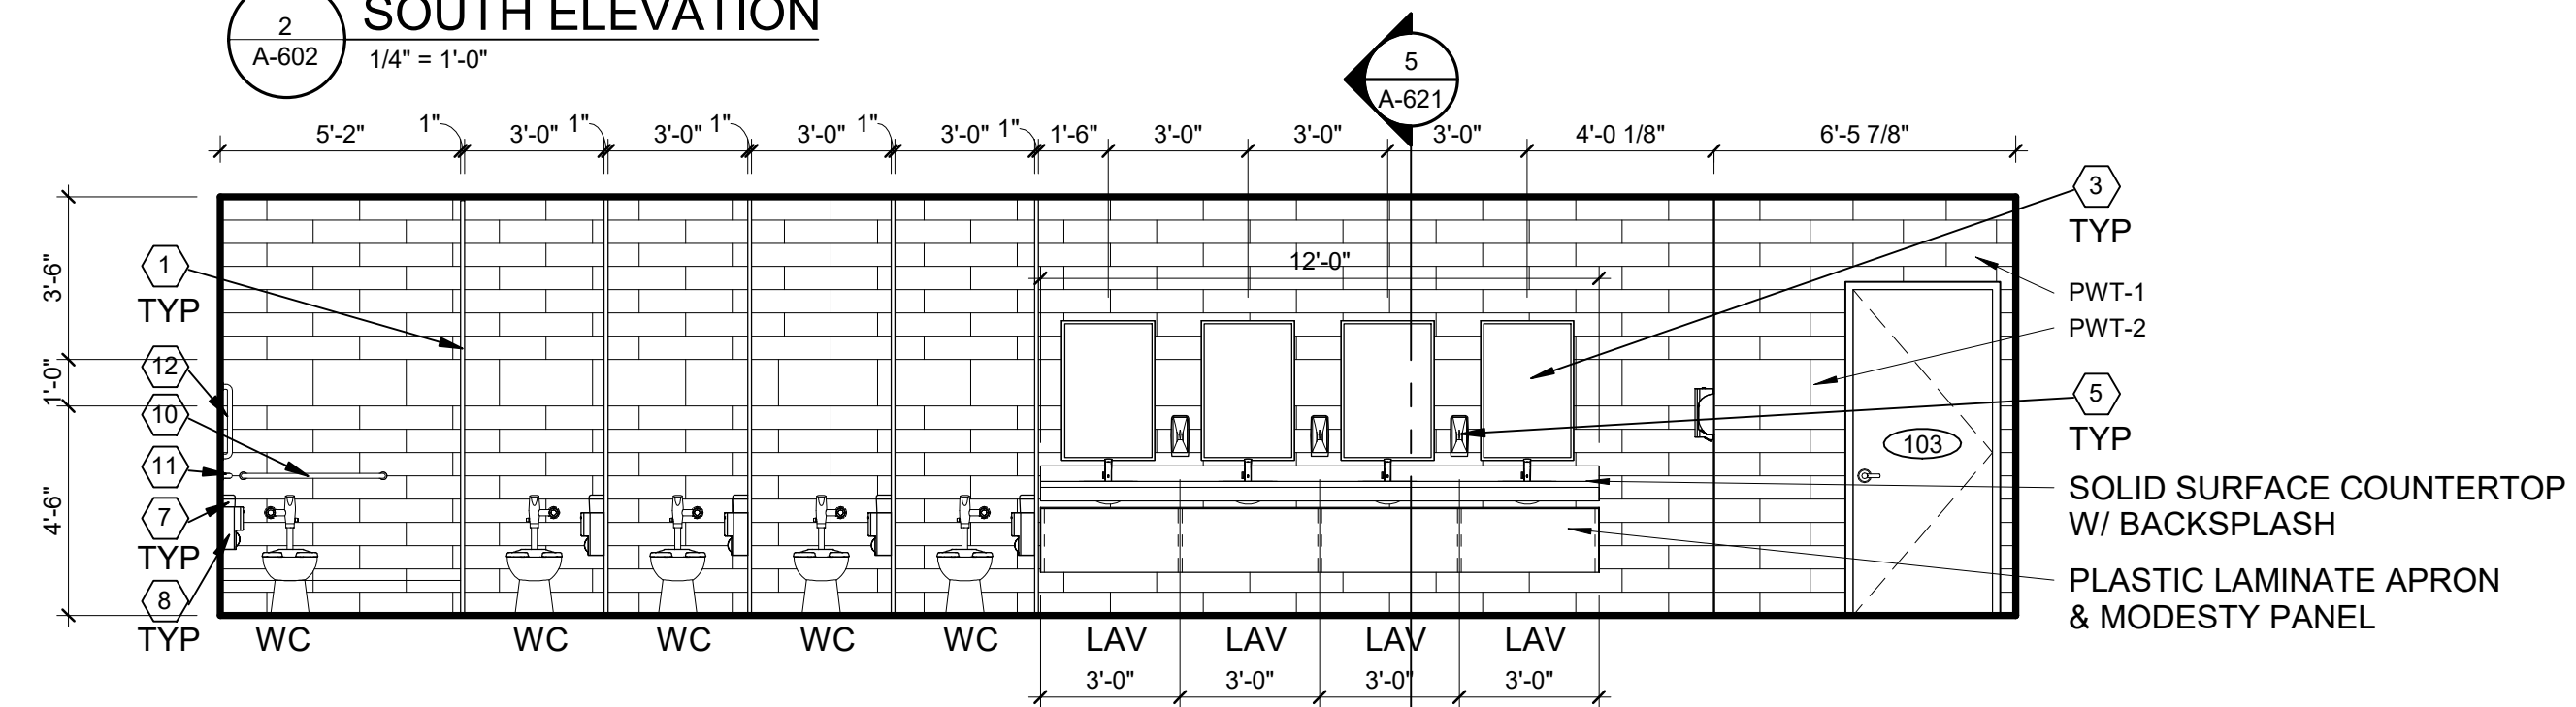

WOMEN'S 103
NORTH ELEVATION
1
A-602
1/4" = 1'-0"

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

SHEET TITLE: INTERIOR ELEVATIONS

SHEET IDENTIFICATION NO: PROJECT NO: 25510.A

DATE: 01/15/26

DESIGNED: HL

DRAWN: HL

CHECKED: TM

APPROVED: RMR

A-602

RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

STATE OF MICHIGAN
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR

SHEET TITLE	INTERIOR DETAILS/SECTIONS	ISSUED FOR:	DATE	DESIGNED	HL
A-621	IDENTIFICATION NO:	PROJECT NO: 25510.A	01/15/26	HL	HL
	PRELIMINARY	CONSTRUCTION	☒	CHECKED	TM
	FINAL RECORD	FILE NO/INDEX CODE:	517/25039.CAK	APPROVED	RMR





FOR SITE OWNED UTILITIES



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS


THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

1 DISPLAY CASE SECTION
1 1/2" = 1'-0"

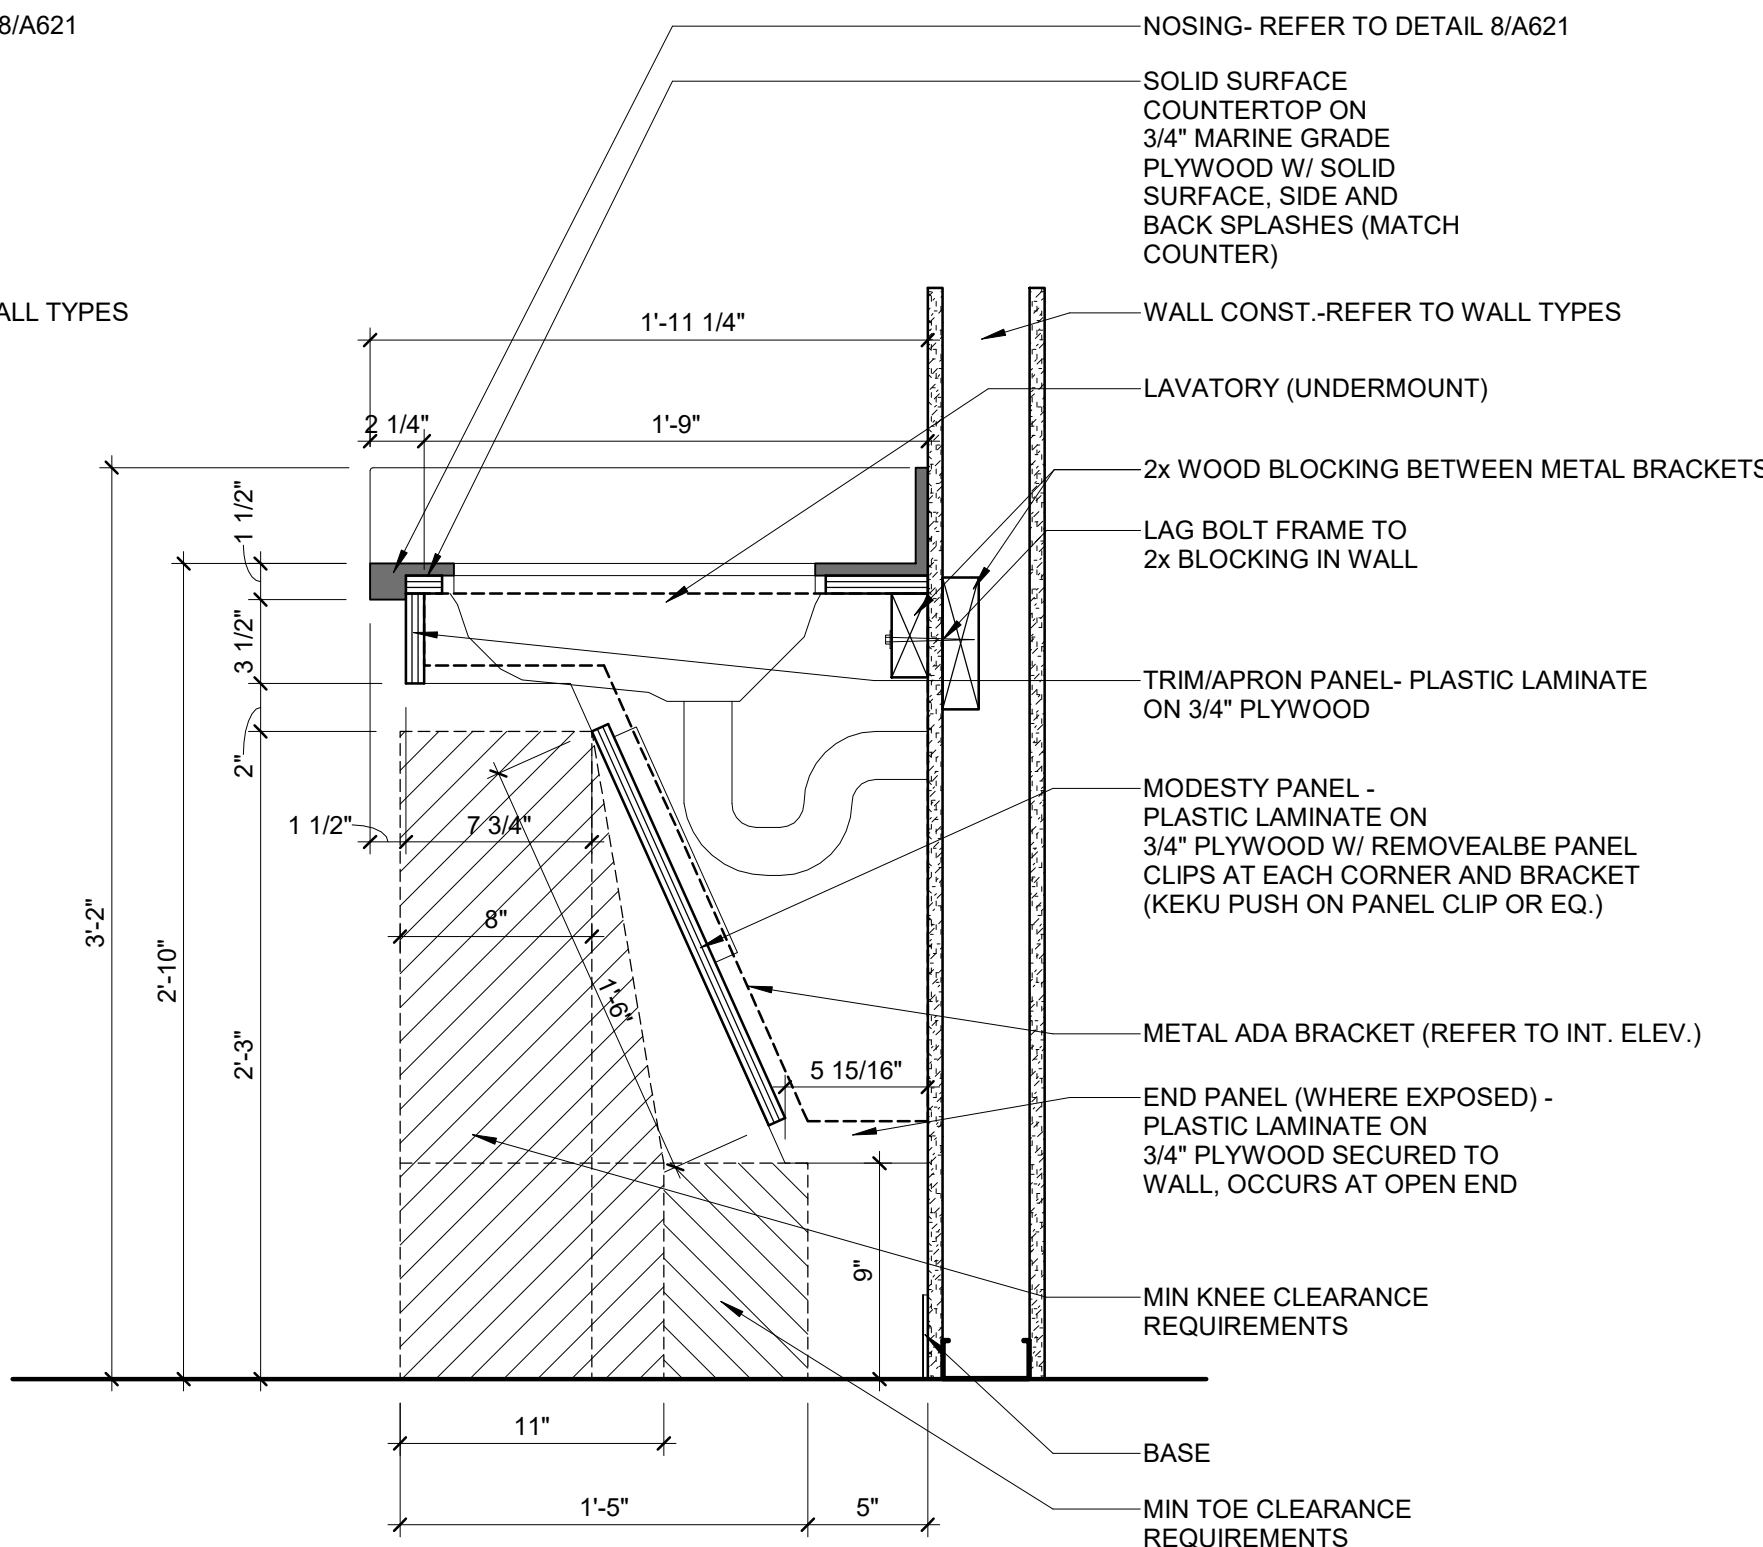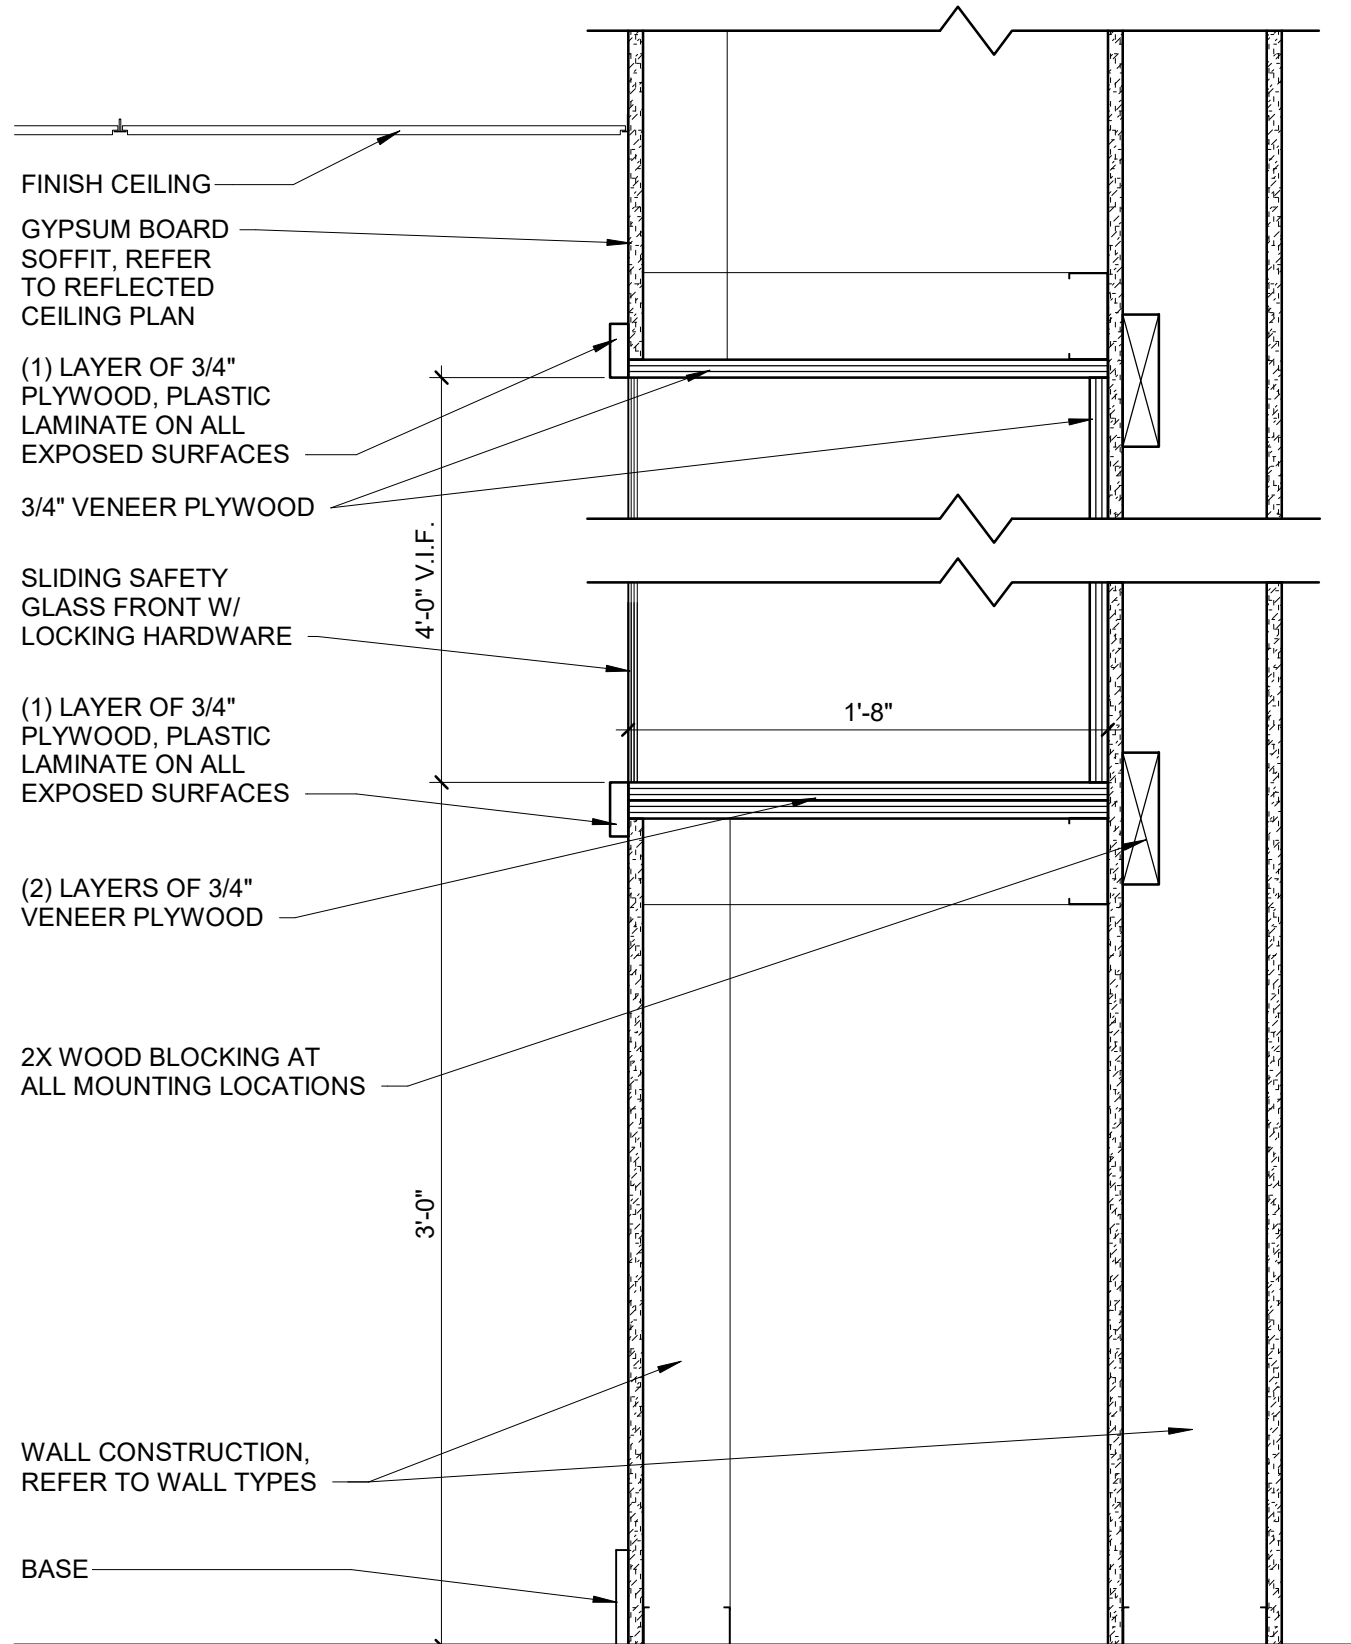


5 CASEWORK W/ SINK SECTION
1 1/2" = 1'-0"


2 CASEWORK W/ SINK SECTION
1 1/2" = 1'-0"

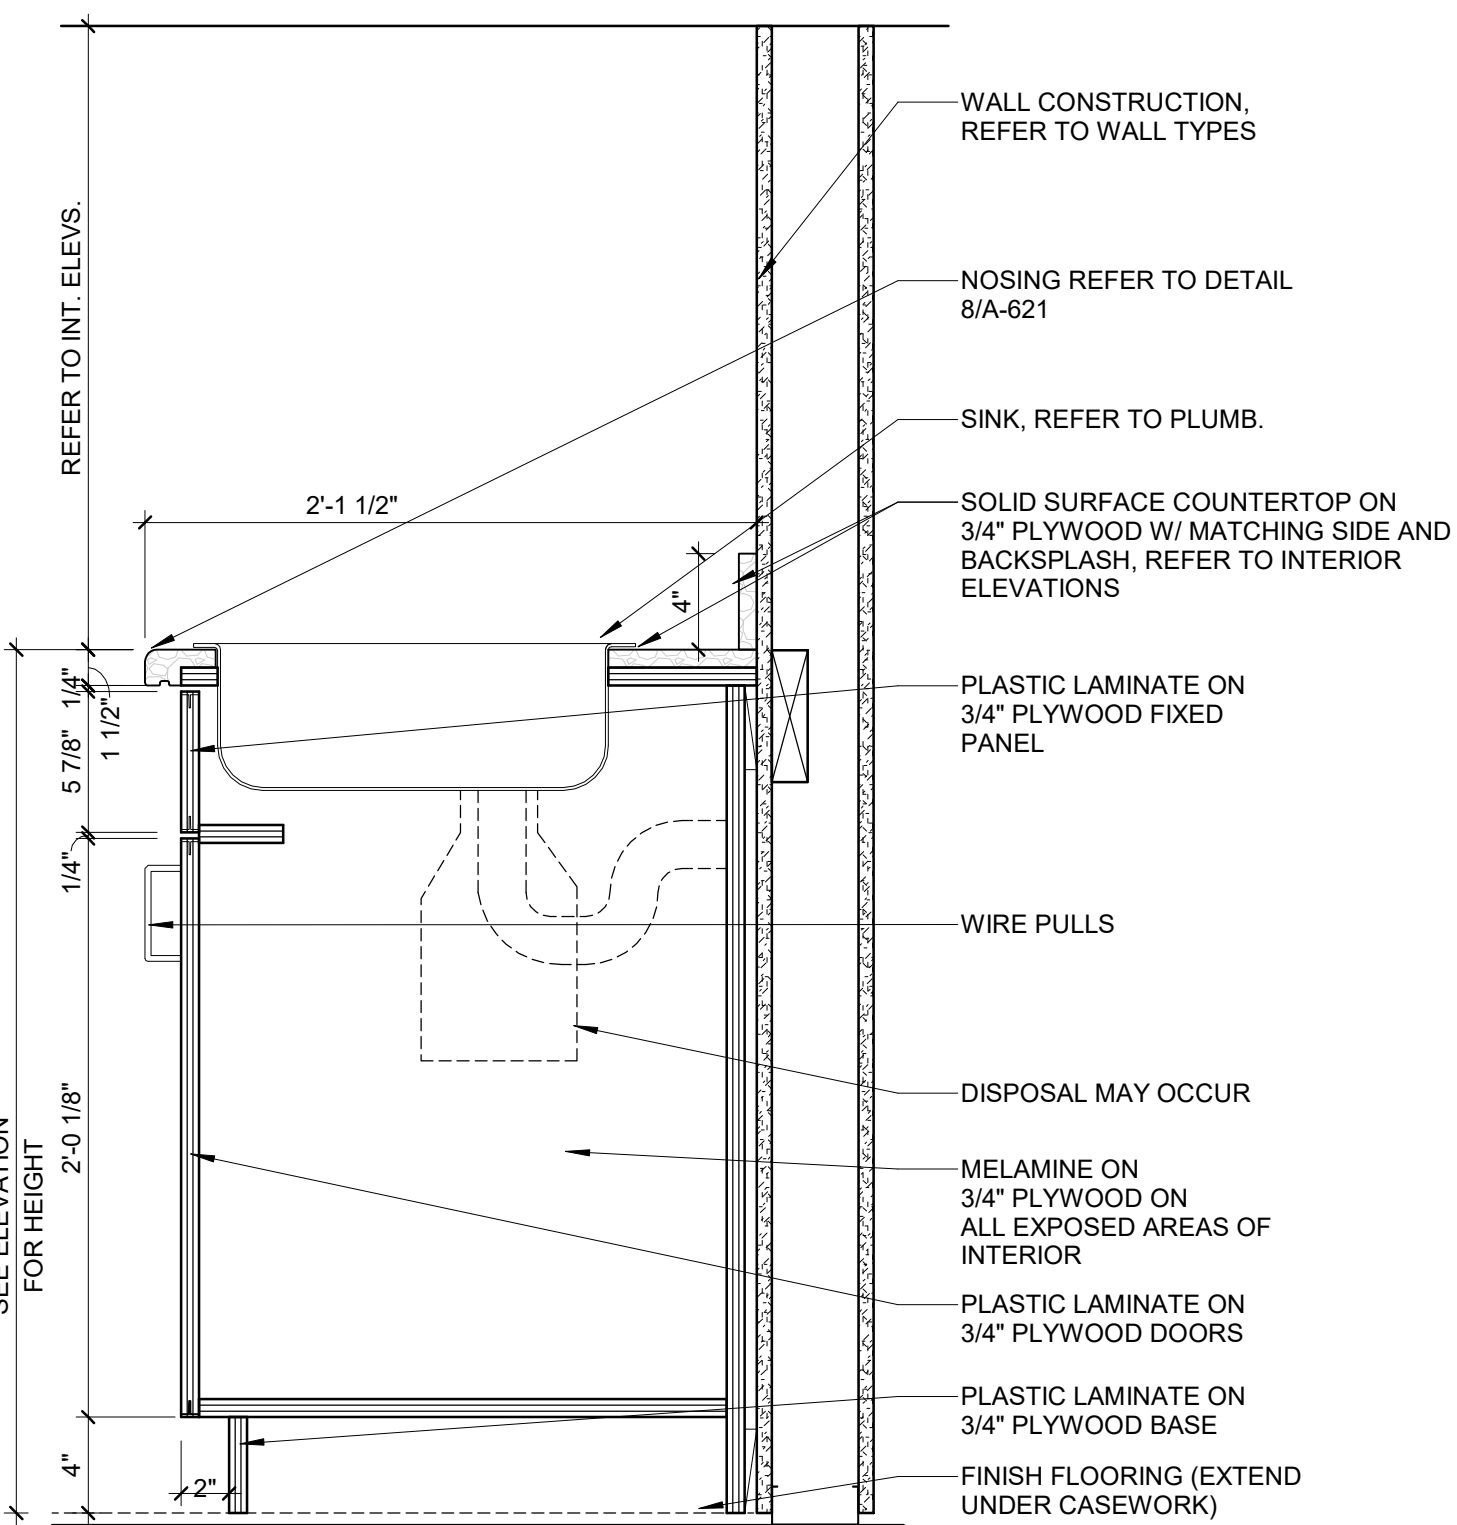


6 CASEWORK W/ SINK SECTION
1 1/2" = 1'-0"

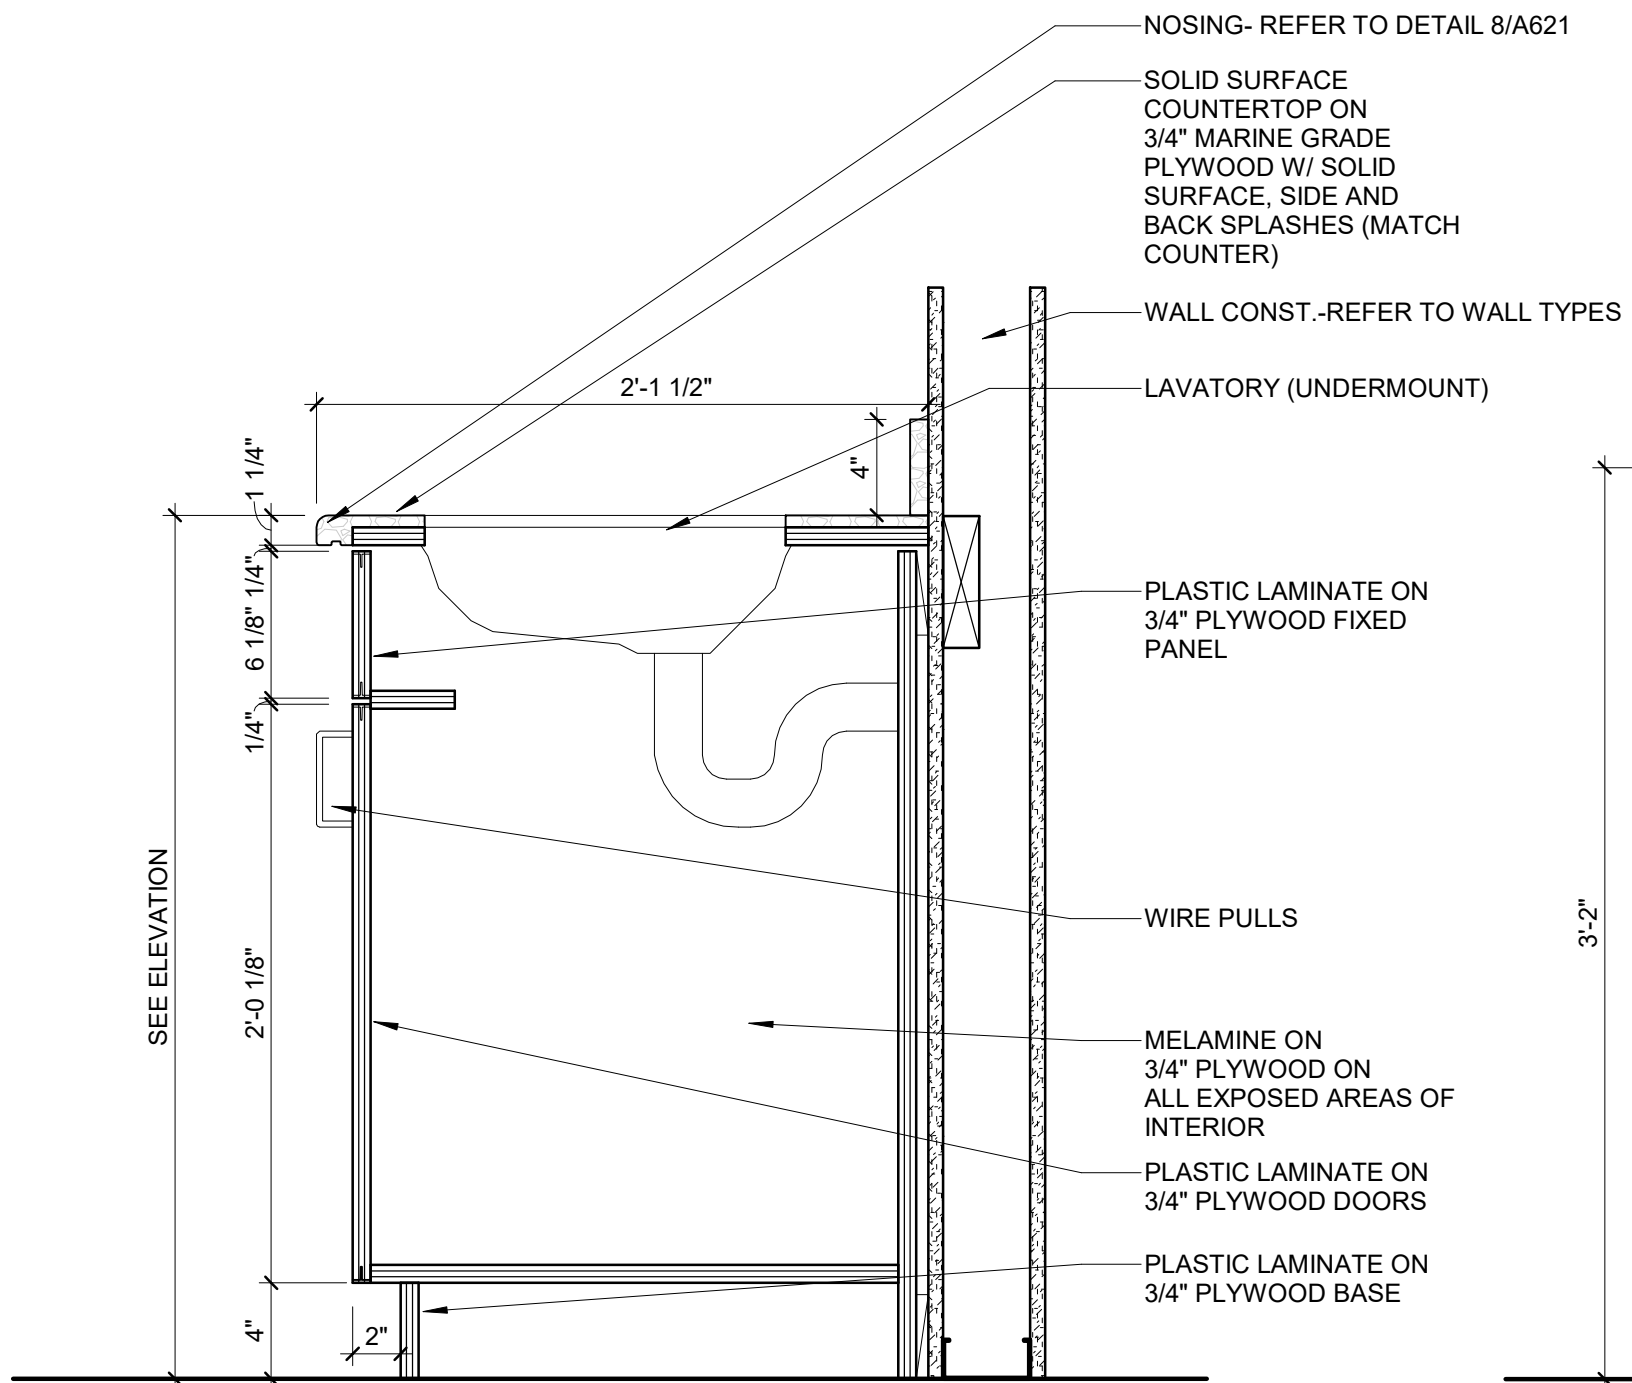


3 CASEWORK W/ SHELF SECTION
1 1/2" = 1'-0"

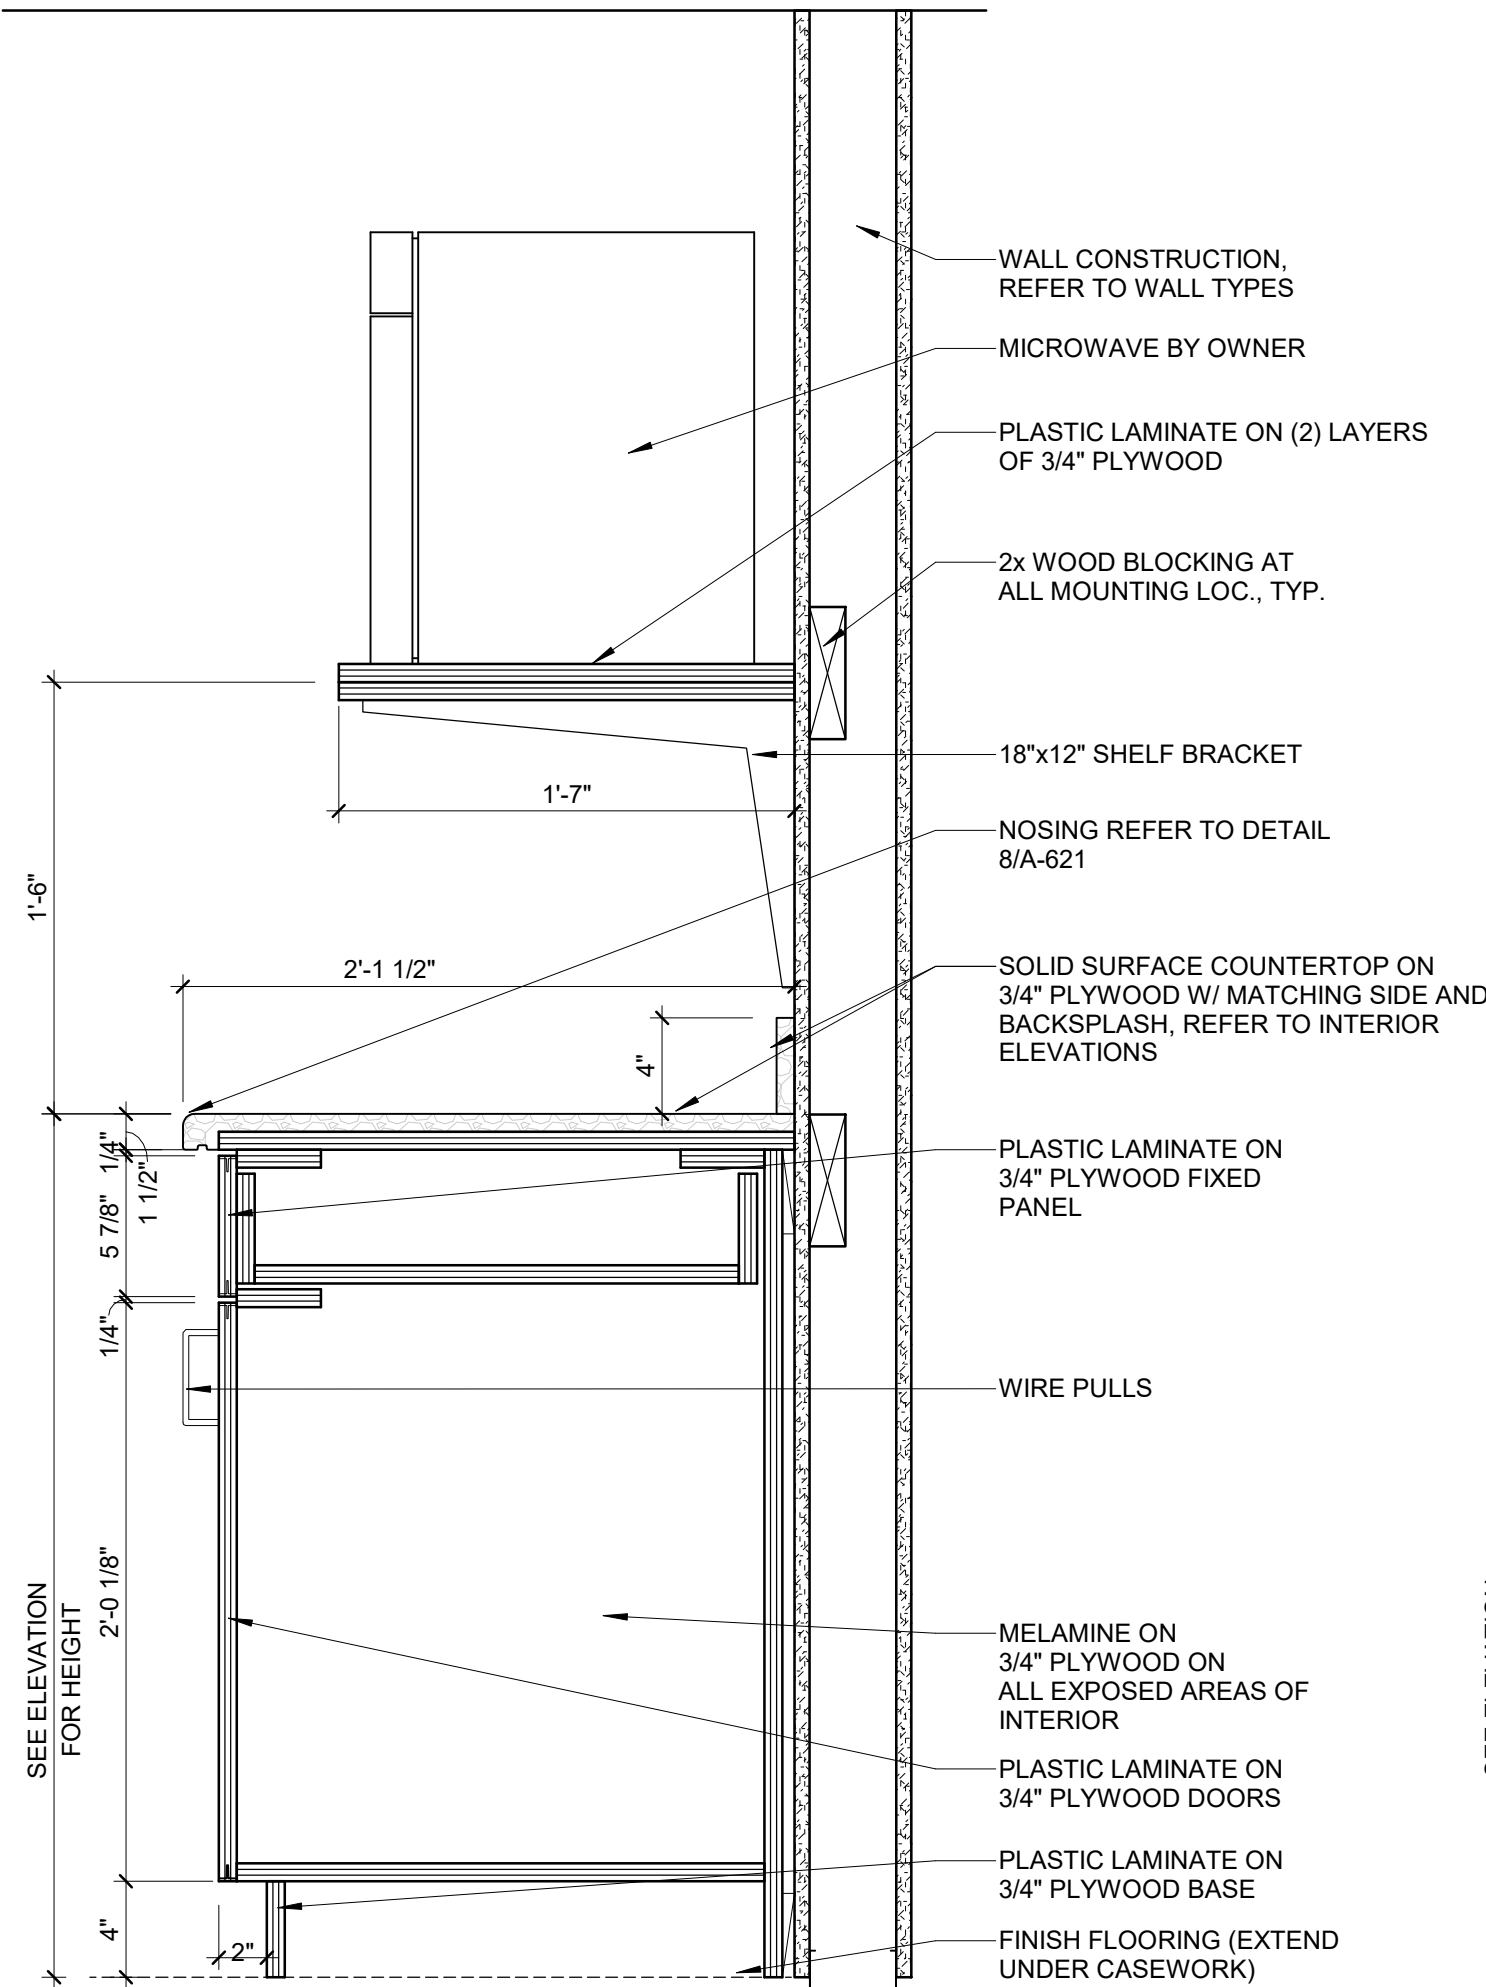


7 COUNTERTOP SECTION
1 1/2" = 1'-0"

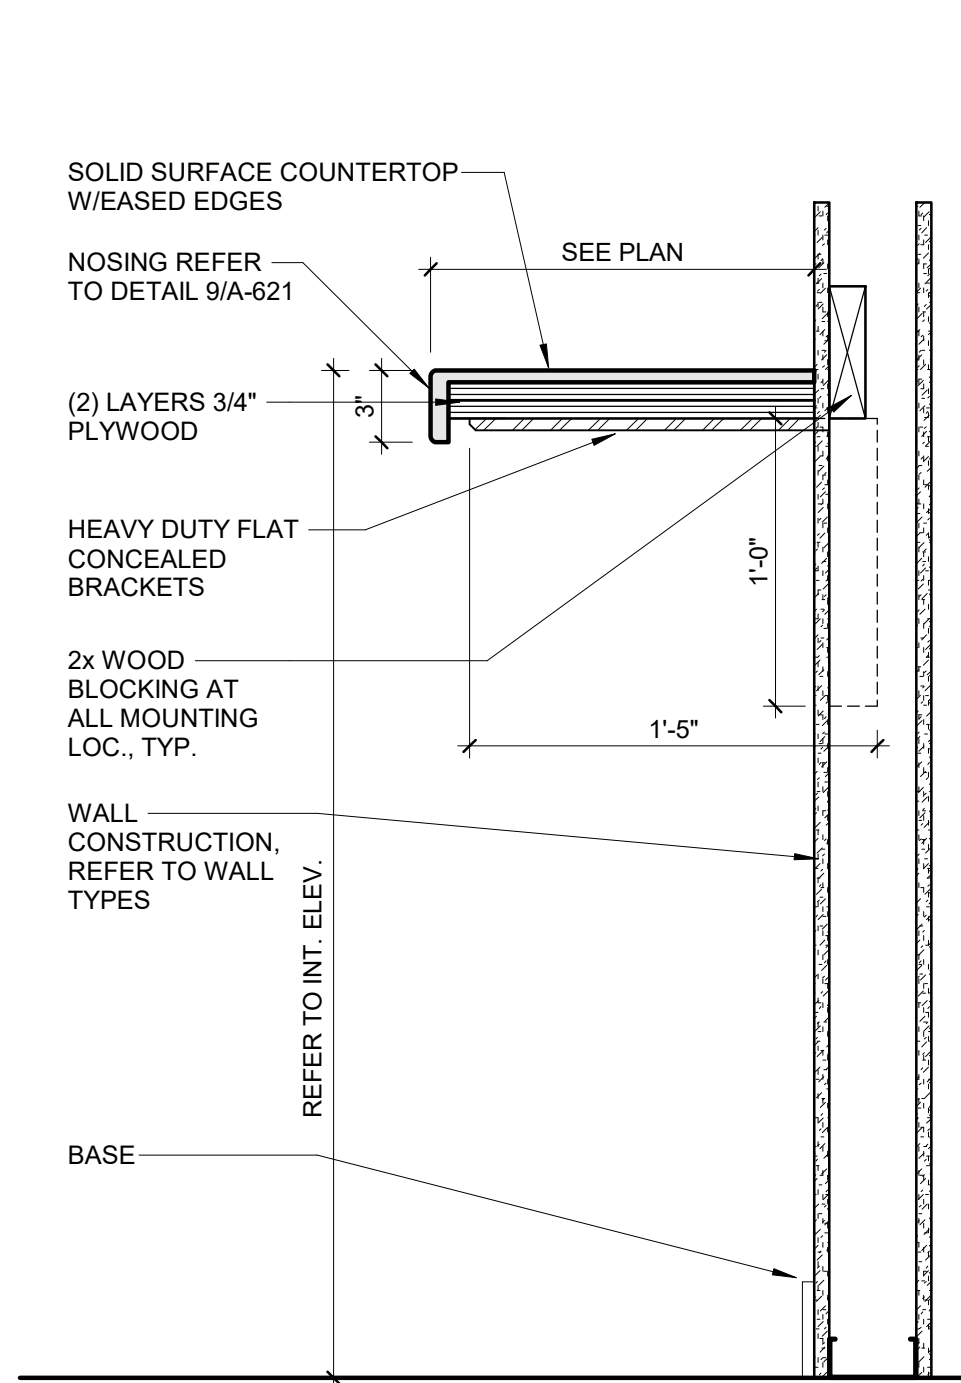


4 LOCKER SECTION
1 1/2" = 1'-0"

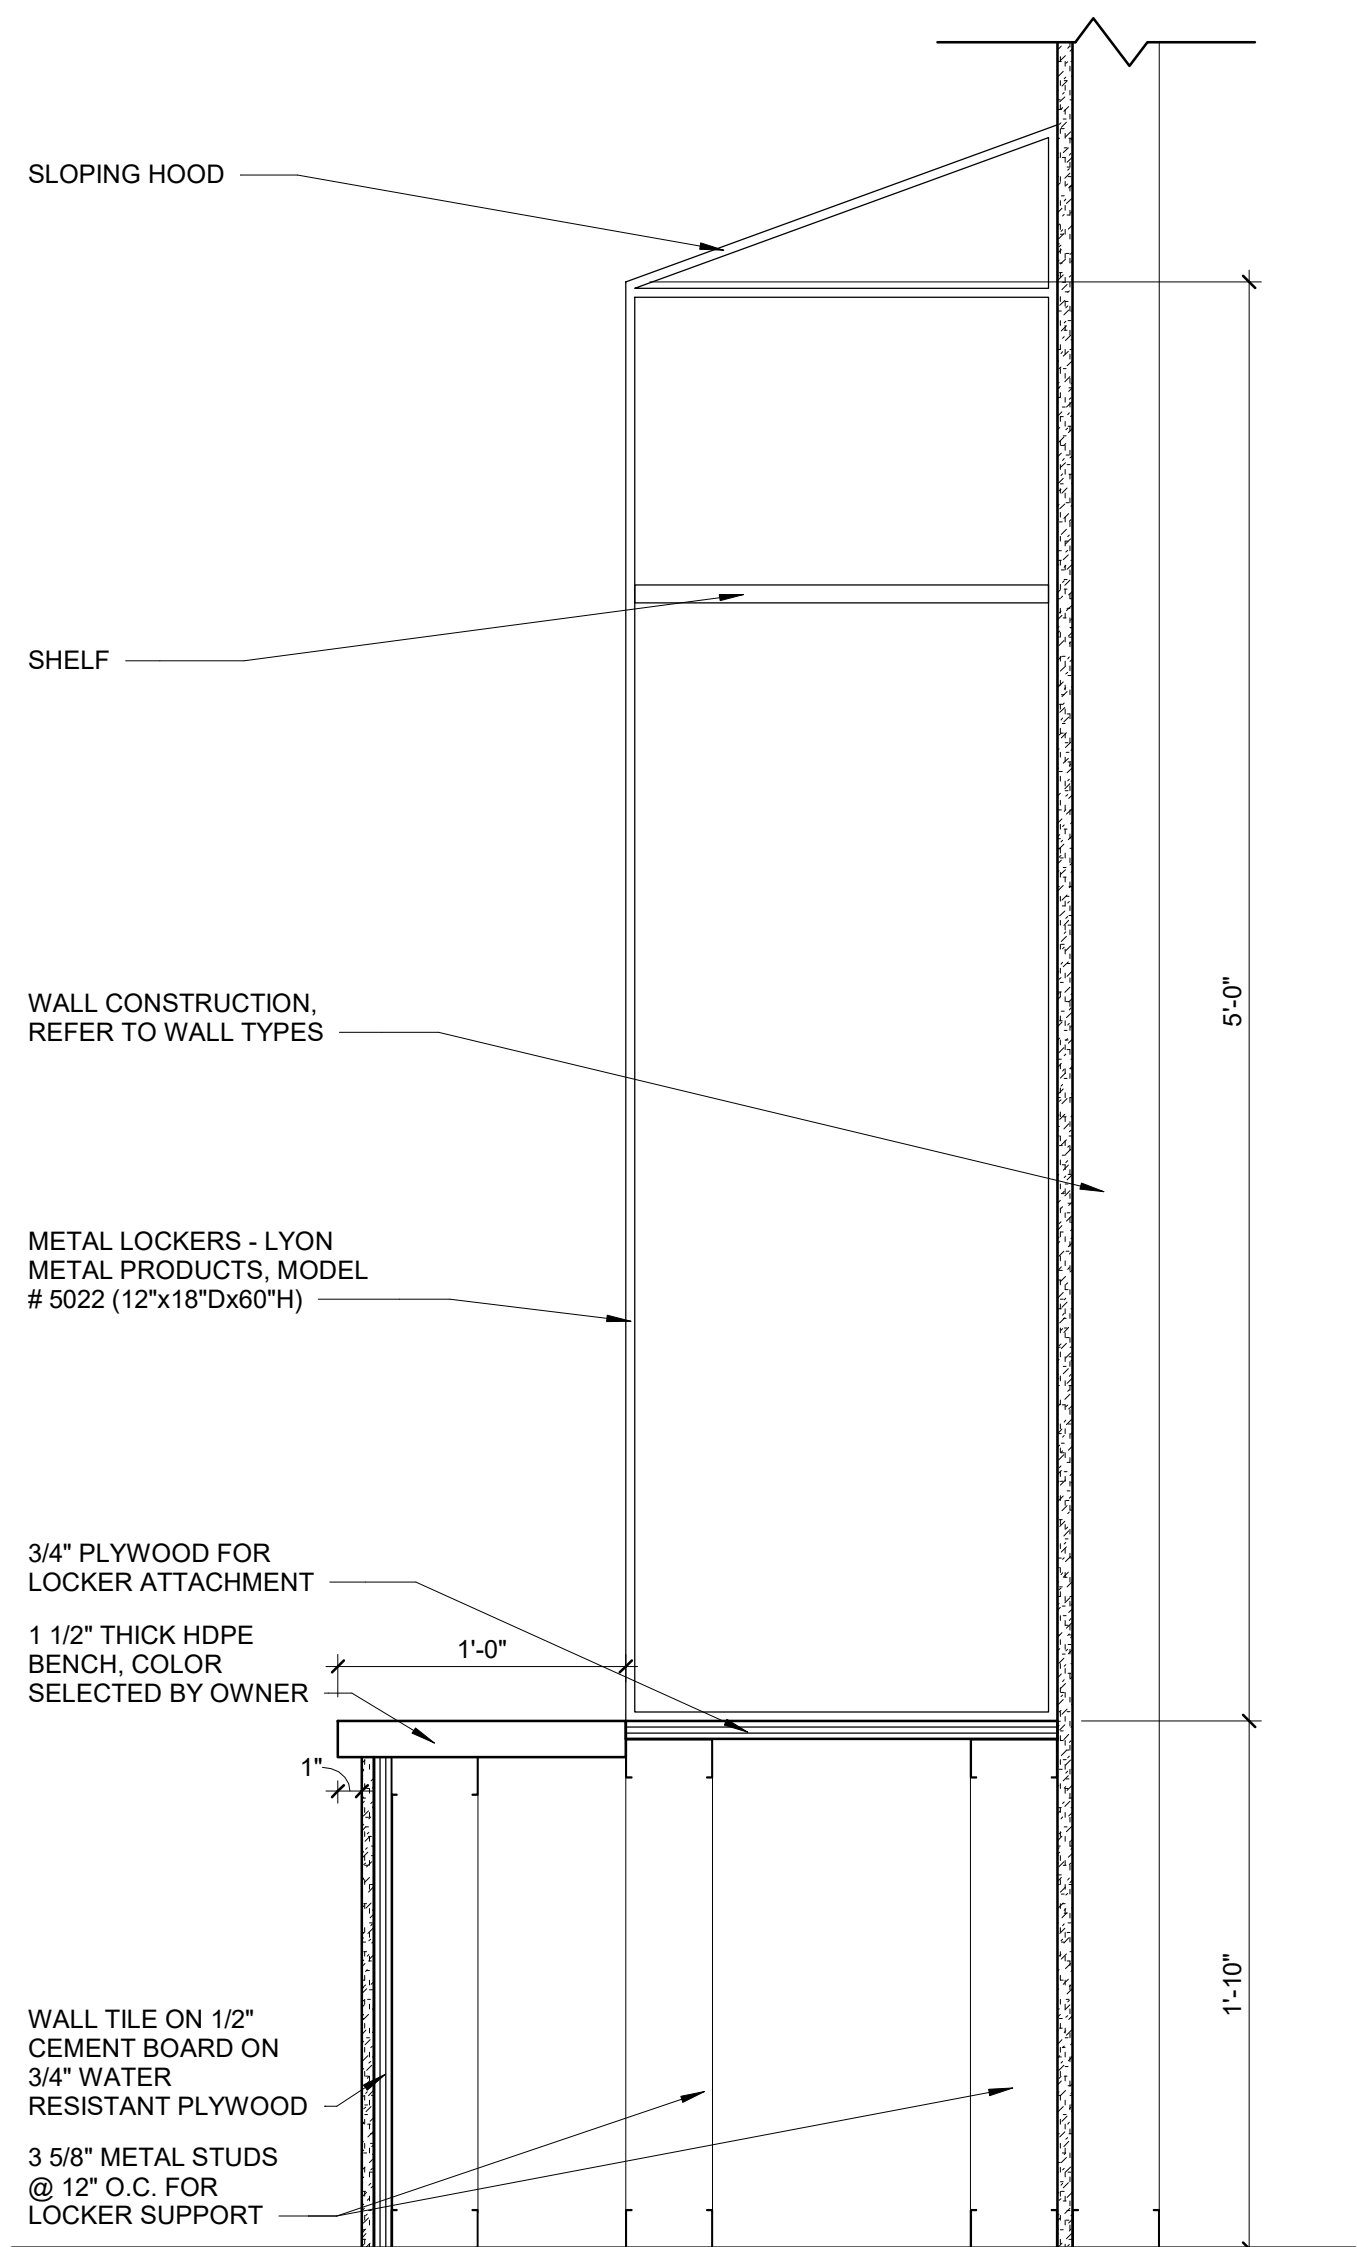


9 NOSING-SOLID SURFACE
3" = 1'-0"

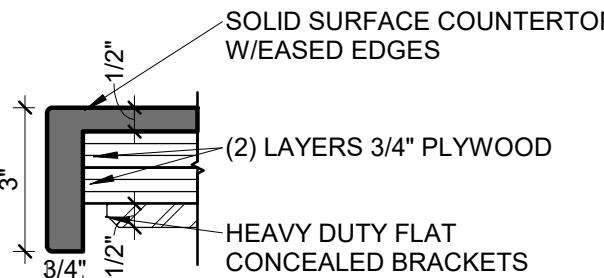


8 NOSING-SOLID SURFACE
3" = 1'-0"

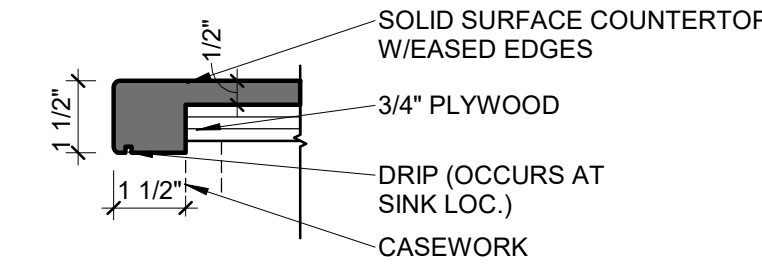


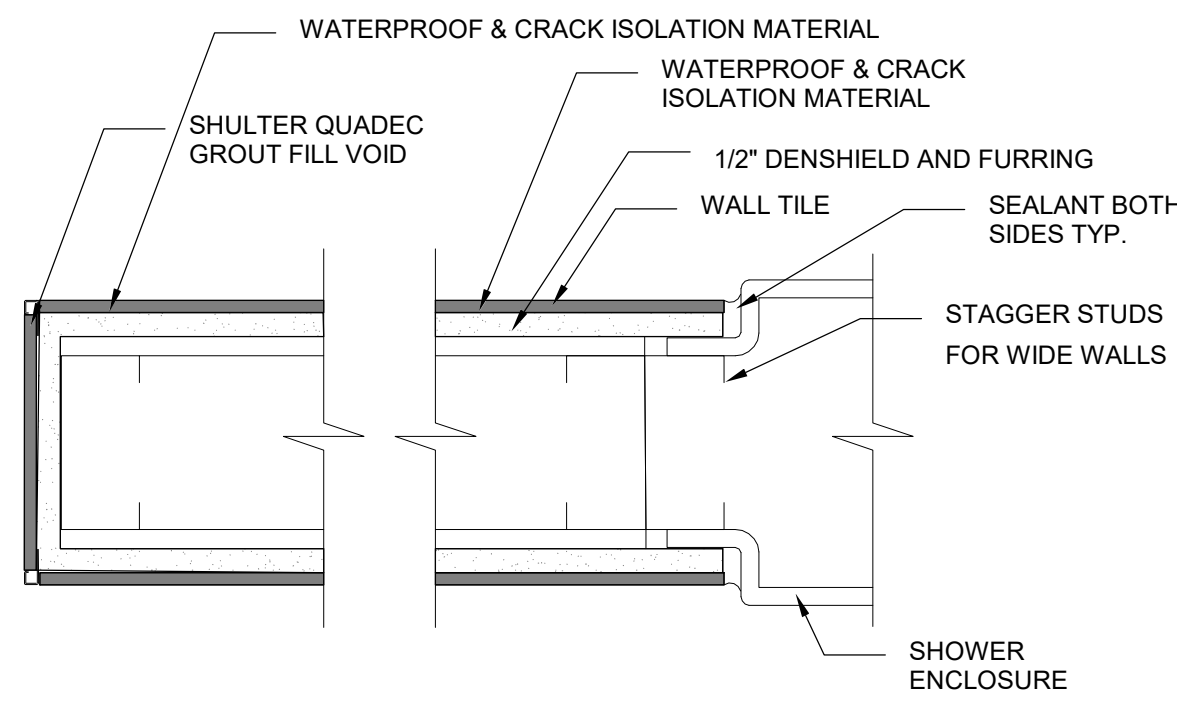


12
A-622
PLAN WALL CUT
3" = 1'-0"

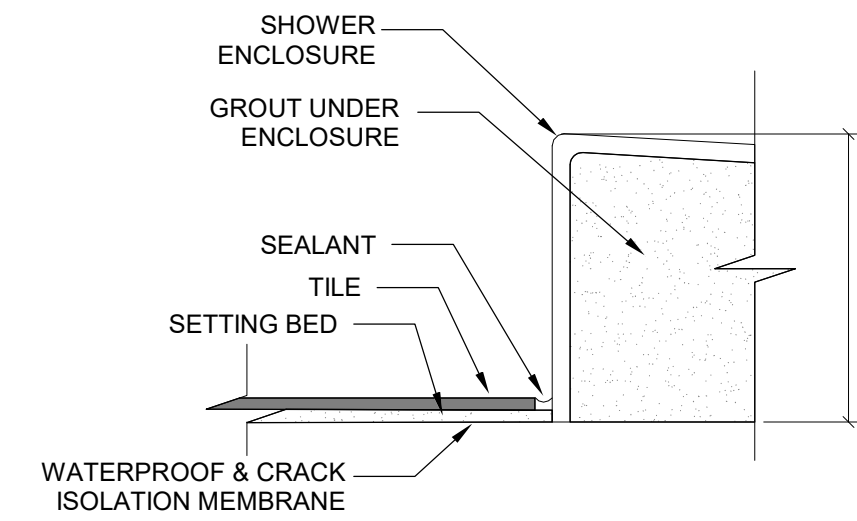


11
A-622
ENCLOSURE FLOOR SECTION
3" = 1'-0"

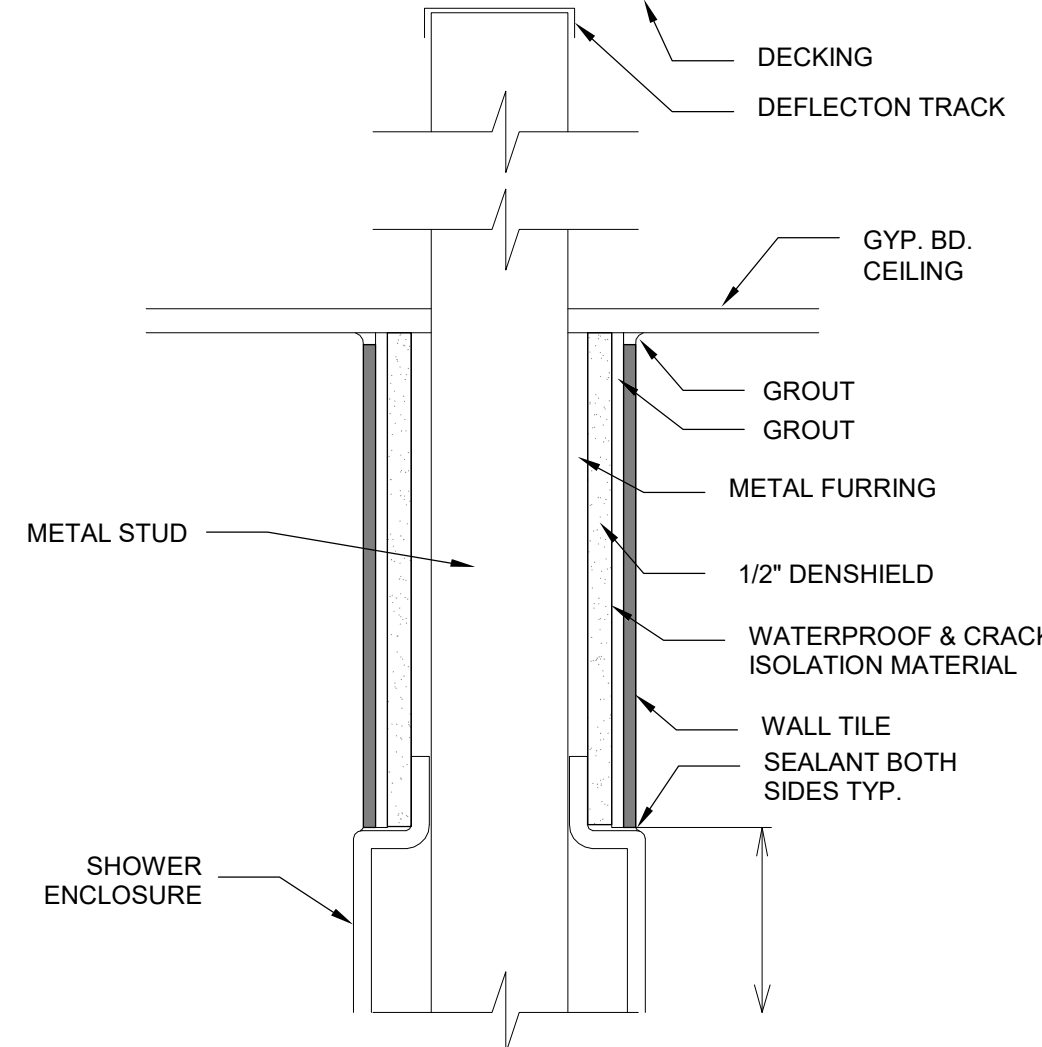


10
A-622
ENCLOSURE WALL SECTION
3" = 1'-0"

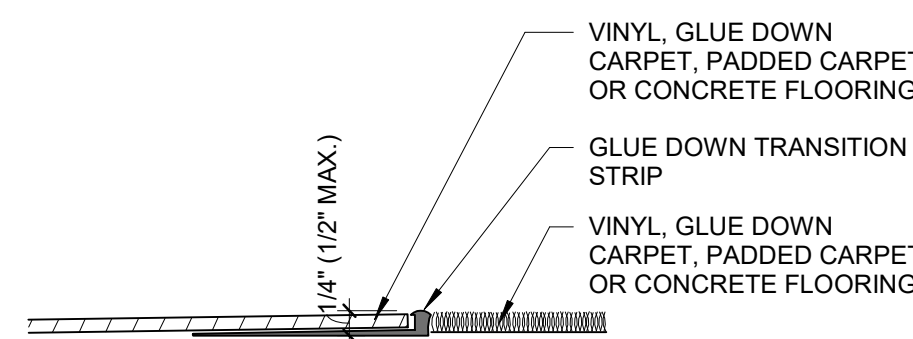


7
A-622
TRANSITION DETAIL
6" = 1'-0"

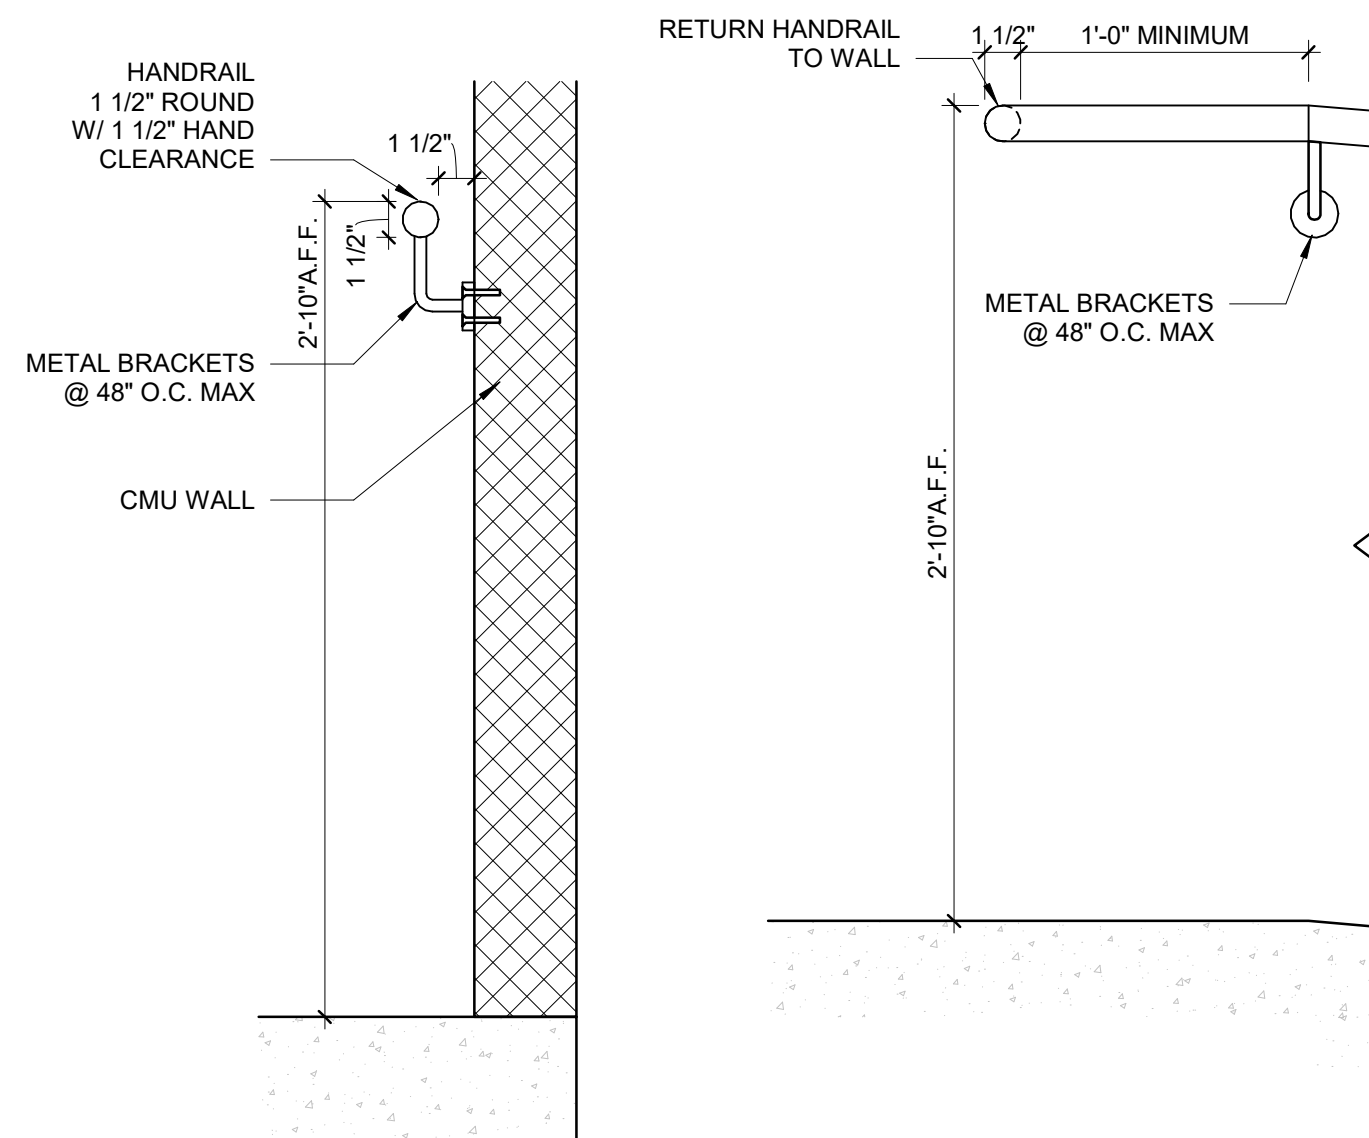


9
A-622
HANDRAIL DETAILS
1 1/2" = 1'-0"

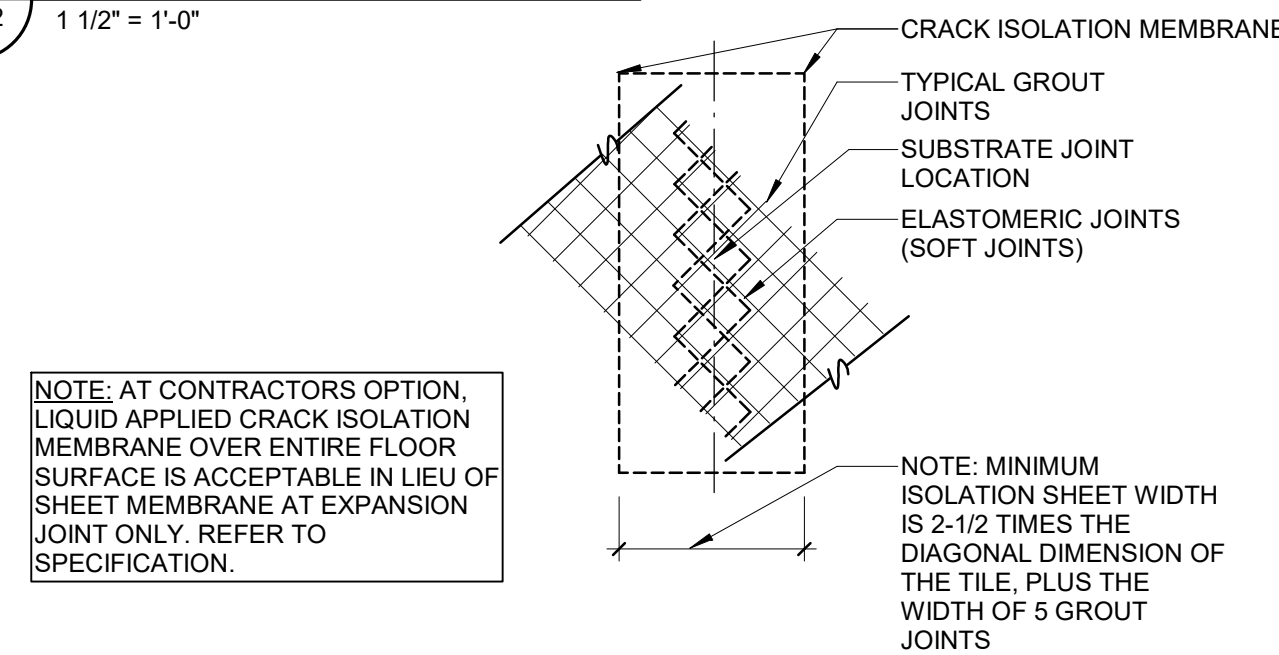


4
A-622
TILE EXPANSION DETAIL
6" = 1'-0"

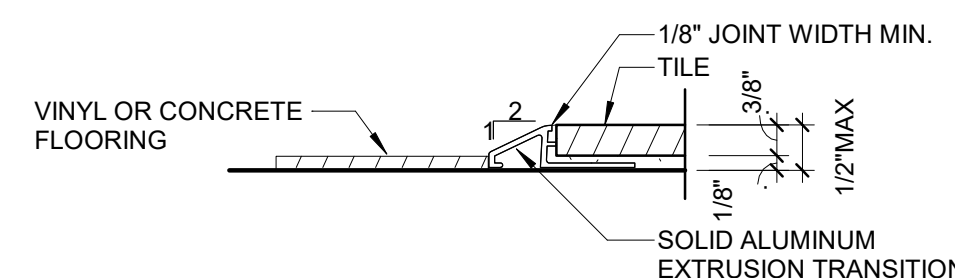


3
A-622
TILE/VINYL/CONC. TRANSITION
6" = 1'-0"

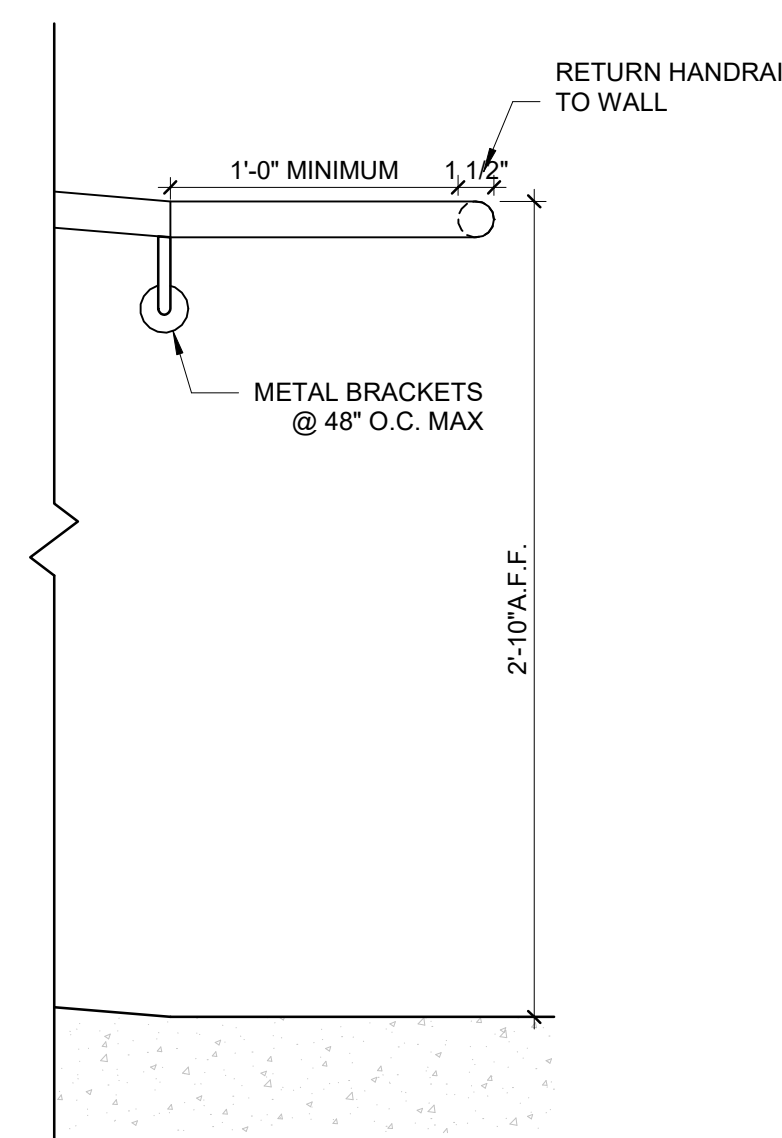


8
A-622
GUARDRAIL DETAILS
1 1/2" = 1'-0"

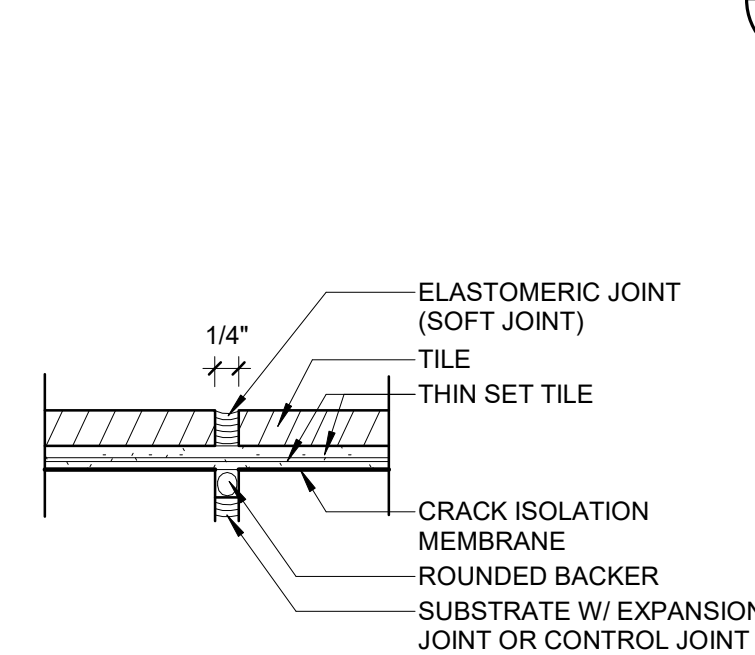


6
A-622
TILE EXPANSION DETAIL
6" = 1'-0"

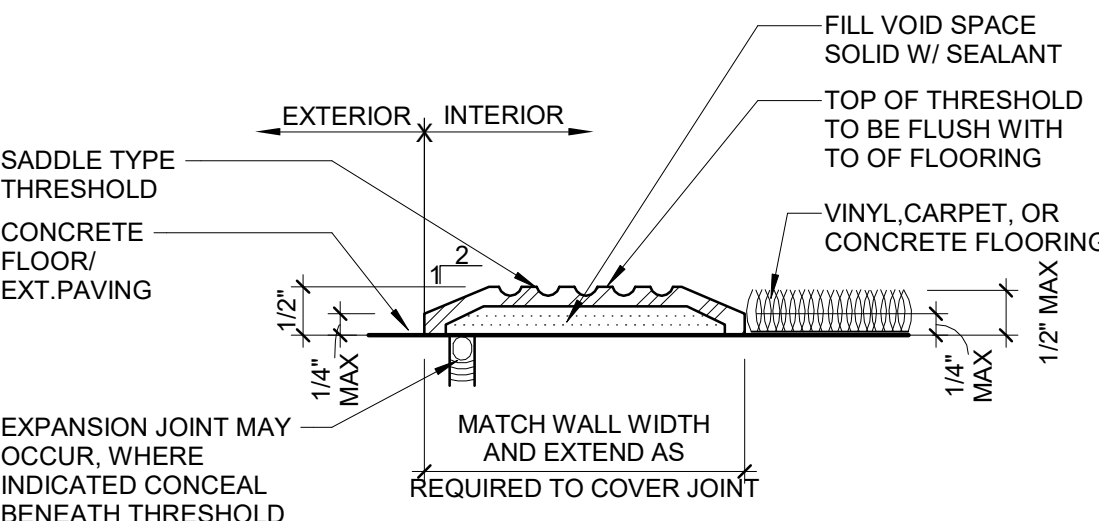

2
A-622
ALUM. THRESHOLD TRANSITION
6" = 1'-0"

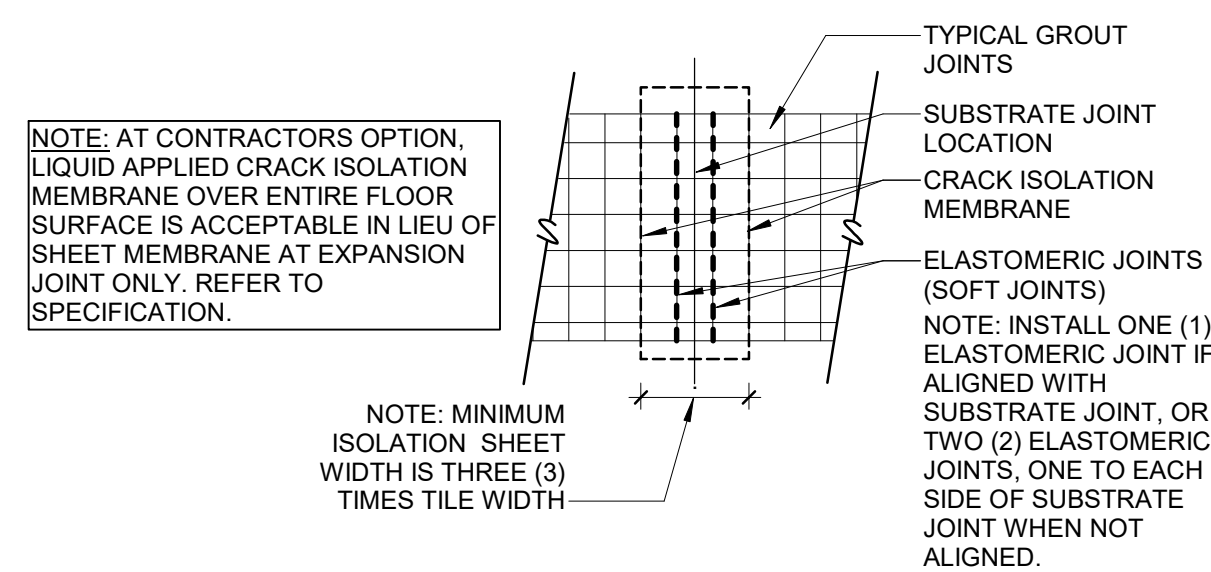

5
A-622
TILE EXPANSION DETAIL
6" = 1'-0"

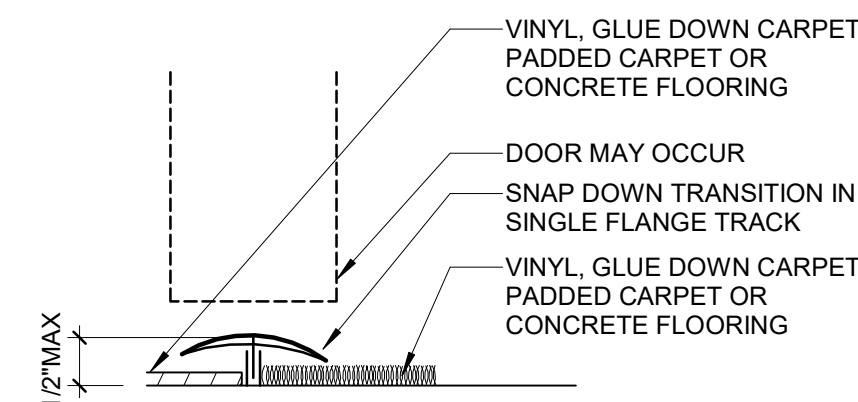

1
A-622
VINYL TRANSITION
6" = 1'-0"



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

MISSDIG811

FOR SITE OWNED UTILITIES


72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL MR. ZIMMERMAN
PH: (248) 606-8821

FACILITIES MANAGEMENT


THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

DESIGNED	HL	HL	TM	RMR
DRAWN			CHECKED	APPROVED
ISSUED FOR:	DATE	PRELIMINARY	CONSTRUCTION	FINAL RECORD
PROJECT NO: 25510.A	01/15/26	☐	☒	☐
DIVISION: 252285007				
FILE NO/INDEX CODE:				
51725039.CAK				


SHEET TITLE: INTERIOR DETAILS

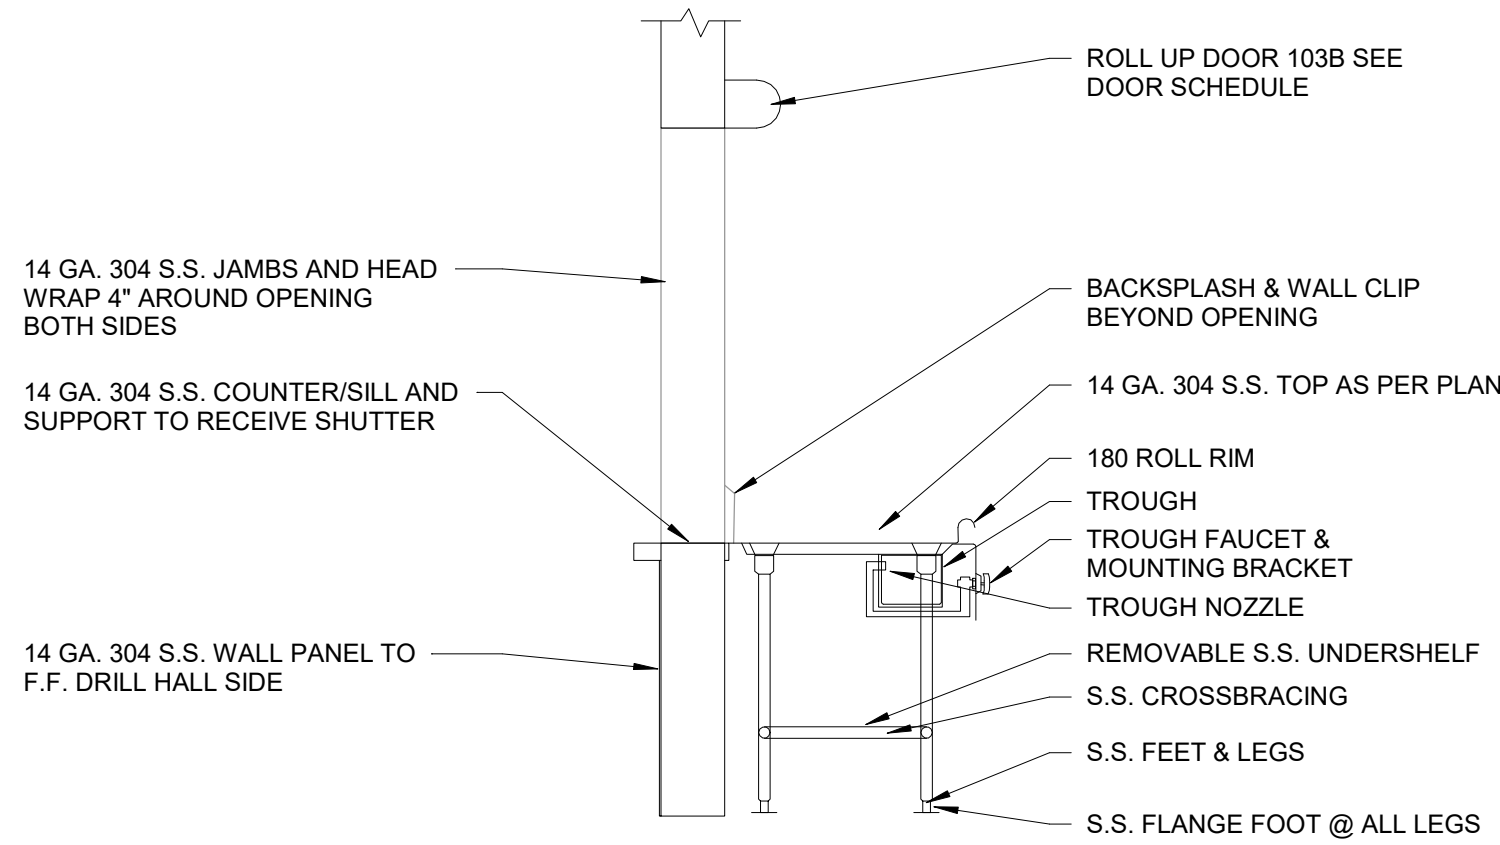

4 Dish Return Window Section
A-623 1/2" = 1'-0"

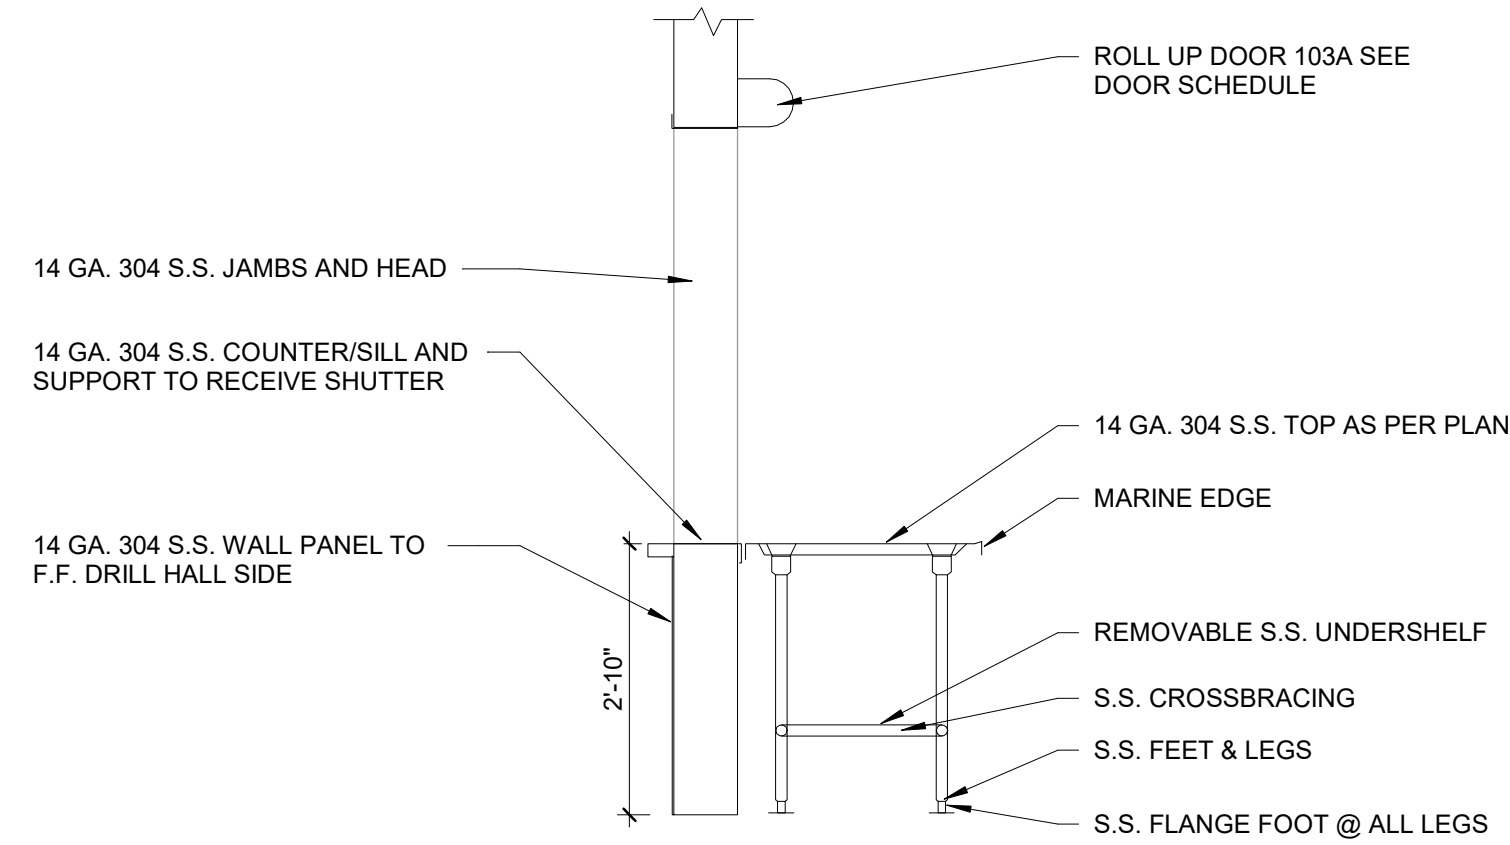


2 Food Service Window 103A at Coffee Pot Table
A-623 1/2" = 1'-0"

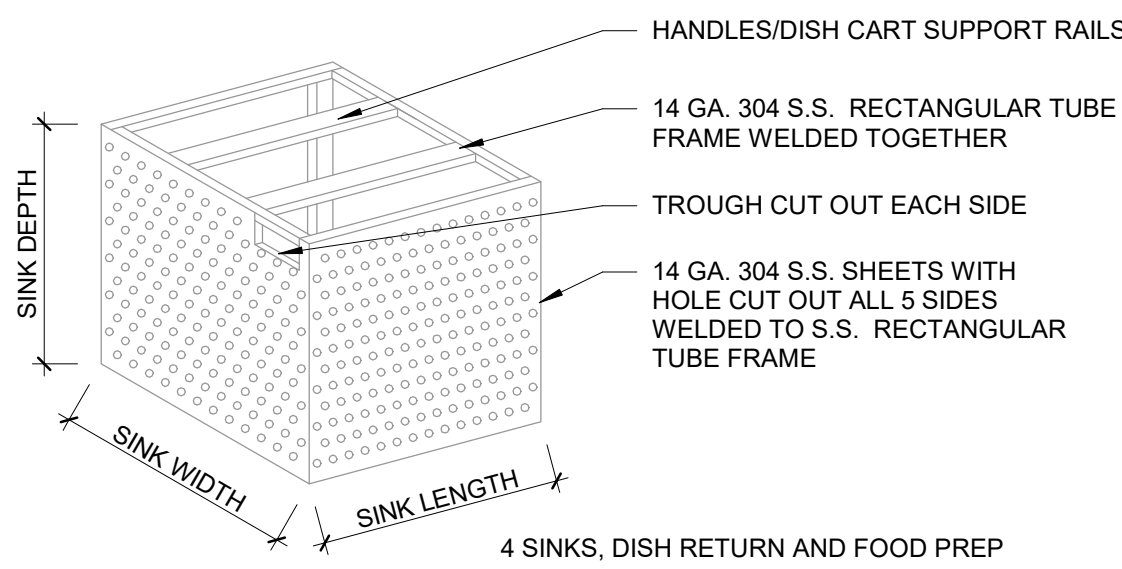


CUSTOM S.S. REMOVABLE DRAIN BASKET
SCALE : 1/2" = 1'-0"

6 Custom S.S. Removable Drain Basket
A-623 1/2" = 1'-0"

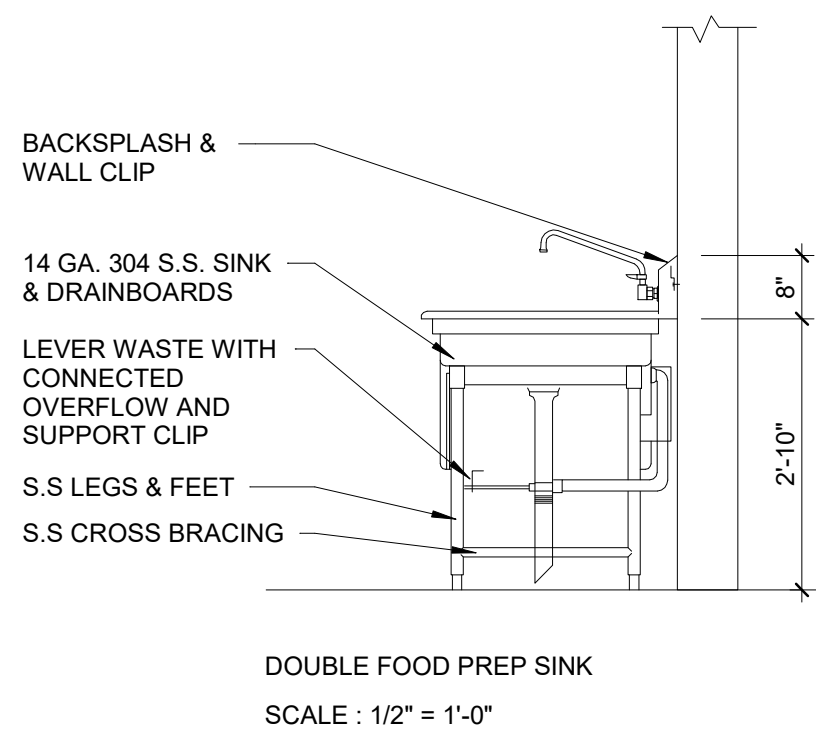


DOUBLE FOOD PREP SINK
SCALE : 1/2" = 1'-0"

5 Double Food Prep Sink
A-623 1/2" = 1'-0"

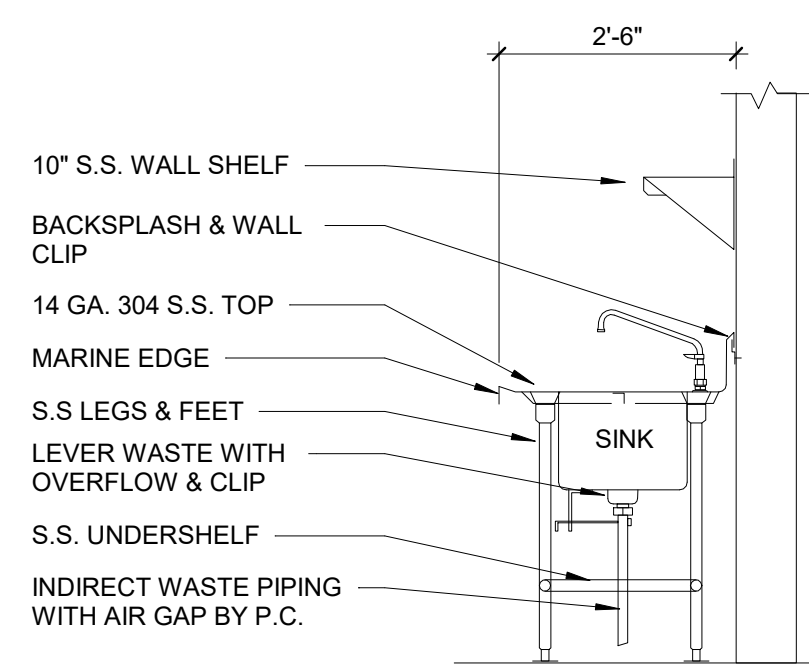

3 Typical Food Prep Table
A-623 1/2" = 1'-0"

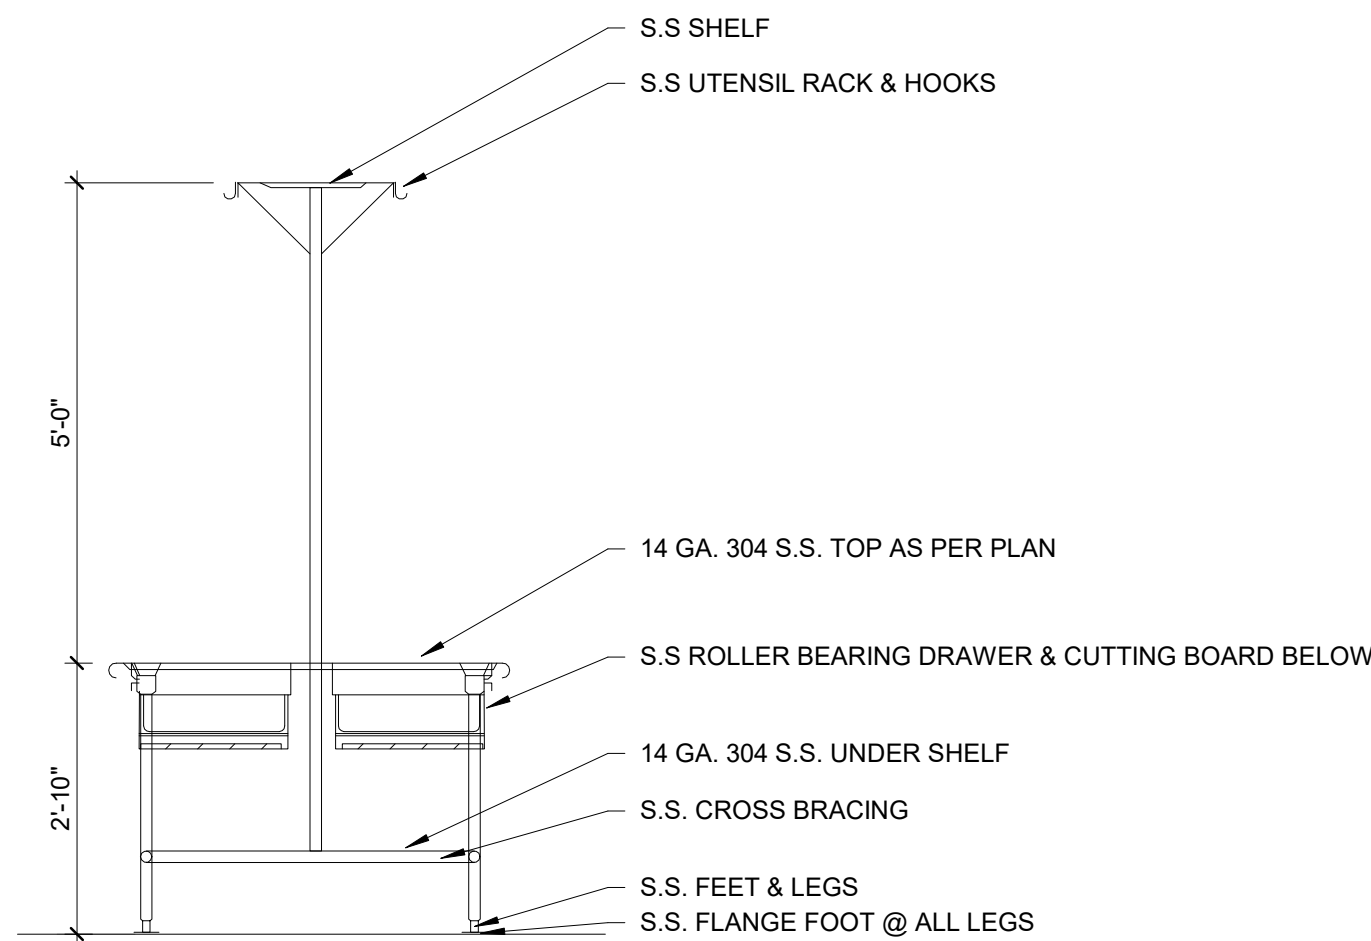

1 Typical Cooks Table
A-623 1/2" = 1'-0"



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS



FOR SITE OWNED UTILITIES



THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

ROOM FINISH SCHEDULE									
RM. NO.	RM. NM.	FLOOR	BASE	WALL				CEILING	REMARKS
				N	S	E	W		
	EXIST.								
010	DRILL HALL	PC	-	CMU-2	CMU-2	CMU-2	P	ACT-1	
011	TABLES AND CHAIRS	C	-	CMU-1	CMU-1	CMU-1	P	STRUC.	2,13
012	STORAGE	C	-	CMU-1	C-1	CMU-1	CMU-1/C-1	STRUC.	2,13
013	KITCHEN	QT	QT	CMU-2	CMU-2/C-2	CMU-2	CMU-2	GB-SS	5
013A	OFFICE	QT	QT	CMU-2	CMU-2	CMU-2	CMU-2	GB-SS	
013B	TOILET	PFT	PWT	CMU-2	CMU-2	CMU-2	CMU-2	GB-SS	
014	CORRIDOR	PC	VB	CMU-2	P	P	-	STRUC.	
015	PES	C	VB	P	P	P	P	STRUC.	2
016	STORAGE	C	VB	P	P	P	P	ACT-1	2
017	PHYSICAL TRAINING	RF	VB	P	P	P	P	STRUC.	
018	WOMEN'S	PFT	PWT	PWT	PWT	PWT	PWT	GB-SS	4,12
018A	WOMEN'S LOCKER	PFT	PWT	PWT	PWT	PWT	PWT	GB-SS	4,12
019	MEN'S	PFT	PWT	PWT	PWT	PWT	PWT	GB-SS	4,12
019A	MEN'S LOCKER	PFT	PWT	PWT	PWT	PWT	PWT	GB-SS	4,12
020	CORRIDOR	C	VB	P	P	P	P	ACT-1	2
021	MECH	-	-	-	-	-	-	EXIST.	
022	ELEV. MECH	-	-	-	-	-	-	EXIST.	
100	VEST.	-	-	-	-	-	-	EXIST.	
101	LOBBY	LVT	VB	P	-	-	P	ACT-2	
101A	CORRIDOR	LVT	VB	P	P	-	-	ACT-2	
102	COMM	CPT	VB	-	-	-	-	EXIST.	
103	WOMEN'S	PFT	PWT	PWT	PWT	PWT	PWT	GB-SS	4,12
104	MEN'S	PFT	PWT	PWT	PWT	PWT	PWT	GB-SS	4,12
105	CLASSROOM	CPT	VB	P	P	P	P	ACT-2	
106	BREAK ROOM	VCT	VB	CMU-2	P	CMU-2	CMU-2	ACT-1	8,9
107	HHC ADMIN RECRUIT	CPT	VB	P	P	P	-	ACT-1	
108	CHAPLAIN FAMILY SUPPORT	CPT	VB	P	-	P	-	ACT-1	
109	MED	CPT	VB	P	P	P	P	ACT-1	
110	S1	CPT	VB	P	-	-	P	ACT-1	
111	CONF.	CPT	VB	P	P	P	P	ACT-1	
112	HHC 1 SGT	CPT	VB	-	-	-	-	EXIST.	
113	S1 OIC	CPT	VB	-	-	-	-	EXIST.	
114	JAG	CPT	VB	-	-	-	-	EXIST.	
115	S6	CPT	VB	-	-	-	-	EXIST.	
117	SIPR	CPT	VB	-	-	-	-	EXIST.	
117A	SERVER	CPT	VB	P	-	-	P	ACT-1	
119	OFFICE	CPT	VB	-	-	-	-	EXIST.	
120	CORRIDOR	CPT	VB	P	P	-	P	ACT-1	
121	CORRIDOR	CPT	VB	-	-	P	p	ACT-1	
122	CONFERENCE	CPT	VB	P	-	P	-	ACT-1	
123	OPEN WORK SPACE	CPT	VB	-	P	-	-	ACT-1	
124	CSM	CPT	VB	P	-	-	P	ACT-1	
125	OIC	CPT	VB	-	-	-	-	EXIST.	
126	BDE CDR	CPT	VB	-	-	-	-	EXIST.	
127	TNG OFF	CPT	VB	-	-	-	-	EXIST.	
128	MDAY S3/DCOM	CPT	VB	-	-	-	-	EXIST.	
129	OPS SGM	CPT	VB	-	-	-	-	EXIST.	
130	S6	CPT	VB	P	-	P	-	ACT-1	
131	117 HHC BDE	CPT	VB	-	-	-	-	ACT-1	
132	S4 OIC	CPT	VB	-	-	-	-	EXIST.	
133	LACTATION	LVP	VB	P	P	P	P	ACT-1	
134	MED	CPT	VB	P	P	P	P	ACT-1	
135	JAN	C	VB	P	P	P	-	ACT-1	2,6
136	MVAA	CPT	VB	P	P	P	P	ACT-1	
137	CORRIDOR	CPT	VB	-	p	-	-	ACT-1	
138	DLC	CPT	VB	P	P	P	P	EXIST.	
139	STATE MAINTENANCE STORAGE	CPT	VB	-	-	-	-	EXIST.	
140	STATE MAINTENANCE OFFICE	CPT	VB	-	-	-	-	EXIST.	
141	CONFERENCE	CPT	VB	-	-	-	-	EXIST.	
142	HHB 1SG	-	-	-	-	-	-	EXIST.	
143	HHB CDR	-	-	-	-	-	-	EXIST.	
144	SIPR	-	-	-	-	-	-	EXIST.	
145	HHB READINESS	-	-	-	-	-	-	EXIST.	
146	MED	-	-	-	-	-	-	EXIST.	
147	MED READINESS	-	-	-	-	-	-	EXIST.	
148	CONFERENCE	CPT	VB	CMU-2	-	CMU-2	-	ACT-1	
149	MDAY	-	-	-	-	-	-	EXIST.	
150	S6-SECTION	-	-	-	-	-	-	EXIST.	
151	S6	-	-	-	-	-	-	EXIST.	
152	S3-SECTION	-	-	-	-	-	-	EXIST.	
153	S1	-	-	-	-	-	-	EXIST.	
154	S4-SECTION	-	-	-	-	-	-	EXIST.	
155	S3	-	-	-	-	-	-	EXIST.	
156	OIC	-	-	-	-	-	-	EXIST.	
157	S4	-	-	-	-	-	-	EXIST.	
158	OPS NCO	-	-	-	-	-	-	EXIST.	
159	BTN CMDR	-	-	-	-	-	-	EXIST.	
160	S1-SECTION	-	-	-	-	-	-	EXIST.	
161	BTN SGM	-	-	-	-	-	-	EXIST.	
162	S2-SECTION	-	-	-	-	-	-	EXIST.	
163	S1NCO	-	-	-	-	-	-	EXIST.	
164	CHAPLAIN	-	-	-	-	-	-	EXIST.	
165	S2	-	-	-	-	-	-	EXIST.	
166	WOMEN	-	-	-	-	-	-	EXIST.	
167	MDAY	-	-	-	-	-	-	EXIST.	
168	CORRIDOR	-	-	-	-	-	-	EXIST.	
169	MEN	-	-	-	-	-	-	EXIST.	
170	OPEN WORK SPACE	-	-	-	-	-	-	EXIST.	
171	STORAGE	-	-	-	-	-	-	EXIST.	
172	CORRIDOR	-	-	-	-	-	-	EXIST.	
173	SUPPLY	C	VB	-	P/C-1	P	-	STRUC.	2
173A	OFFICE	CPT	VB	P	P	P	P	ACT-1	
173B	VAULT	C	VB	C-1	C-1	C-1	C-1	STRUC.	2,13
174	CORRIDOR	PC	VB	-	-	-	P	ACT-1	
175	SUPPLY	C	VB	P/C-1	-	P	-	STRUC.	2
175A	OFFICE	CPT	VB	P	P	P	P	ACT-1	
175B	VAULT	C	VB	C-1	C-1	C-1	C-1	STRUC.	2,13
176	CORRIDOR	LVT	VB	-	-	-	-	ACT-1	
177	CORRIDOR	LVT	VB	-	-	PT	-	ACT-1	
178	CORRIDOR	LVT	VB	-	-	-	-	ACT-1	
179	MILITARY MAINTENANCE	-	-	-	-	-	-	EXIST.	
180	CORRIDOR	-	-	-	-	-	-	EXIST.	
181	MECHANICAL	-	-	-	-	-	-	EXIST.	
181A	ELECTRICAL	-	-	-	-	-	-	EXIST.	
A	STAIRS	-	-	-	-	-	-	EXIST.	
B	EXIST. STAIRS	-	-	-	-	-	-	EXIST.	
C	STAIRS	C	VB	CMU-2	PT	CMU-2	CMU-2	ACT-1	2

FINISH LEGEND

FLOORS
C CONCRETE - SEALED
PC POLISHED CONCRETE-SEALED (LEVEL C3)
CPT-1 CARPET TILE (SHAW AMPLIFY 64549, COLOR SELECTED BY DMVA)
PFT-1 PORCELAIN FLOOR TILE (FLORIM USA, STRATOS, CORDA, 12x12)
RF-1 RUBBER TILE FLOORING (JOHNSONITE, REPLAY, COLOR SELECTED BY DMVA)
LVP-1 LUXURY VINYL PLANK FLOORING (ID LATITUDE WOOD, MILLENIUM OAK, 6x48)
QT-1 QUARRY TILE (DAL TILE, QUARRY TILE, ARID GRAY, 6x6)

WALL BASE
VB-1 RESILIENT BASE (TARKETT BURNT UMBER 63)
PWT-1 PORCELAIN TILE (FLORIM USA, STRATOS, CORDA, 6x12 COVE)
QT-1 QUARRY TILE

GROUT
GRT-1 TEC POWER-GROUT (COLOR: TEC MOCHA 932)

WALLS
CMU-1 CONCRETE MASONRY UNITS (EXPOSED)
CMU-2 CONCRETE MASONRY UNITS (PAINTED)
C-1 CONCRETE (EXPOSED)
C-2 CONCRETE (PAINTED)
P-1 PAINT (MAIN COLOR)
P-2 PAINT (ACCENT #1)
PWT-1 PORCELAIN WALL TILE (FLORIM USA, STRATOS, AVORIO, 6x24)
PWT-2 PORCELAIN WALL TILE (FLORIM USA, STRATOS, CORDA, 12x24)

CEILING
ACT-1 ACOUSTICAL CEILING TILE (2x4)
ACT-2 ACOUSTICAL CEILING TILE (2x2)
STRUC STRUCTURE/FIRE RATED GYP. BD. (EXPOSED)
GB GYPSUM BOARD CEILING (PAINTED)
GB-SS SUSPENDED GYPSUM BOARD CEILING (PAINTED)
EXIST. EXISTING

ALL EXPOSED CEILINGS, STRUCTURE AND M.E.P. ITEMS TO RECEIVE DRYFALL PAINTED FINISH, COLOR T.B.D.

ROOM FINISH NOTES

- SEE REFLECTED CEILING PLAN, FLOOR PLAN AND SECTIONS FOR ADDITIONAL INFORMATION
- EXPOSED CONCRETE FLOOR WITH SEALER / DENSIFIER.
- EGGSHELL PAINT ON GYPSUM BOARD SOFFITS, NO PAINT ON ACOUSTIC TILE
- WHERE WALL TILE IS SPECIFIED PROVIDE OVER TILE BACKER BOARD U.N.O.
- FIBERGLASS REINFORCED PANELS W/ 1/2" P.T. PLYWOOD BACKER BOARD.
- FIBERGLASS REINFORCED PANELS EITHER SIDE OF MOP SINK, 8'-0" HIGH AND 4'-0" WIDE.
- WINDOW SHADES AT ALL EXTERIOR OPENINGS (EXCEPT DOORS)
- PLASTIC LAMINATE STOOLS AT ALL EXTERIOR OPENINGS, U.N.O.
- PROVIDE CEILING CAVITY ACCESS PANELS FOR ALL MEP ON ROOMS WITH GB-SS
- PAINT AND REPAIR DAMAGED EXISTING CONSTRUCTION TO MATCH EXISTING FINISHES, V.I.F.
- PRIMARY STEEL FRAME TO RECEIVE PRIME/PAINT FINISH, TYP., COLOR TO BE SELECTED BY OWNER
- REFER TO INTERIOR ELEVATIONS FOR TILE PATTERN.
- ALL EXPOSED CONCRETE WALLS SHALL BE PARGED AND PAINTED.



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS



FOR SITE OWNED UTILITIES




THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025




DOOR SCHEDULE																
DOOR NO.	ROOM NAME	DOOR						FRAME					HARDWARE SET	FIRE RATING (MIN.)	REMARKS	
		PAIR	WIDTH	HEIGHT	THICKNESS	MAT.	TYPE	TYPE	MAT.	HEAD	JAMB	SILL				
010A	DRILL HALL	Yes	3'-0"	7'-0"	1 3/4"	IHM	N	2	IHM	3/A-712	2/A-712	1/A-712	18		1	
010B	DRILL HALL	Yes	3'-0"	7'-0"	1 3/4"	IHM	N	2	IHM	3/A-712	2/A-712	1/A-712	18		1	
011	TABLES AND CHAIRS		4'-0"	7'-0"	1 3/4"	HM	F	2	HM	4/A-713	3/A-713	-	02			
012	STORAGE		3'-0"	7'-0"	1 3/4"	HM	F	2	HM	4/A-712	13/A-713	-	01			
013.1	KITCHEN		4'-0"	7'-0"	1 3/4"	HM	F	2	HM	4/A-712	13/A-713	-	22			
013.2	KITCHEN		4'-0"	7'-0"	1 3/4"	IHM	F	2	IHM	3/A-712	2/A-712	1/A-712	15			
013A	OFFICE		3'-0"	7'-0"	1 3/4"	HM	F	2	HM	4/A-713	3/A-713	-	08			
013B	TOILET		3'-0"	7'-0"	1 3/4"	HM	F	2	HM	4/A-713	3/A-713	-	09			
014A	CORRIDOR	Yes	3'-0"	7'-0"	1 3/4"	IHM	N	2	IHM	3/A-712	2/A-712	1/A-712	19		1	
014B	CORRIDOR	Yes	3'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	07	60	1, 6	
016	STORAGE		3'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	01			
017	PHYSICAL TRAINING		3'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	08			
018	WOMEN'S		3'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	14			
018A	WOMEN'S LOCKER		3'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	14			
019	MEN'S		3'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	14			
019A	MEN'S LOCKER		3'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	14			
021	MECH		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	01			
022	ELEV. MECH		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	01			
100.A	VEST.		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	16		6	
100.B	LOBBY		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	17			
102	COMM		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	20			
103	LOBBY		3'-0"	7'-0"	1 3/4"	SCW	F	1	HM	6/A-713	5/A-713	-	14			
104	LOBBY		3'-0"	7'-0"	1 3/4"	SCW	F	1	HM	6/A-713	5/A-713	-	14			
105A	CLASSROOM		3'-0"	7'-0"	1 3/4"	SCW	N	1	HM	6/A-713	5/A-713	-	12			
105B	CLASSROOM		3'-0"	7'-0"	1 3/4"	SCW	N	1	HM	6/A-713	5/A-713	-	12			
106A	BREAK ROOM		3'-0"	7'-0"	1 3/4"	SCW	N	2	HM	2/A-713	1/A-713	-	10			
106B	BREAK ROOM		3'-0"	7'-0"	1 3/4"	ALUM	SF	4	ALUM	6/A-712	5/A-712	4/A-712	03			
107	HHC ADMIN RECRUIT		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
108	CHAPLAIN FAMILY SUPPORT		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
109	MED		3'-0"	7'-0"	1 3/4"	RELOC	RELOC	EX	EX	6/A-713	5/A-713	-	08		2, 3	
110	S1		3'-0"	7'-0"	1 3/4"	RELOC	RELOC	EX	EX	6/A-713	5/A-713	-	10		2, 3	
111A	CONF.		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	10		2	
111B	CONF.		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	10		2	
112	HHC 1 SGT		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
113	S1 OIC		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
114	JAG		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
115	S6		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
117A	SERVER		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	11		2	
117B	SIPR		3'-0"	7'-0"	1 3/4"	SCW	F	2	HM	2/A-713	1/A-713	-	10			
119	OFFICE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
120	CORRIDOR		3'-0"	7'-0"	1 3/4"	SCW	F	1	HM	6/A-713	5/A-713	-	04			
122	CONFERENCE		3'-0"	7'-0"	1 3/4"	SCW	N	1	HM	6/A-713	5/A-713	-	10	-		
123A	OPEN WORK SPACE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	15			
123B	OPEN WORK SPACE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	15			
124	CSM		3'-0"	7'-0"	1 3/4"	RELOC	RELOC	EX	EX	6/A-713	5/A-713	-	08		2, 3	
125	OIC		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
126	BDE CDR		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
127	TNG OFF		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
128	MDAY S3/DCOM		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
129	OPS SGM		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
130	S6		3'-0"	7'-0"	1 3/4"	RELOC	RELOC	EX	EX	6/A-713	5/A-713	-	08		2, 3	
132	S4 OIC		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
133	LACTATION		3'-0"	7'-0"	1 3/4"	SCW	F	1	HM	6/A-713	5/A-713	-	09			
134	MED		3'-0"	7'-0"	1 3/4"	RELOC	RELOC	EX	EX	6/A-713	5/A-713	-	08		2, 3	
135	JAN		3'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	01			
136	MVA		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
137	CORRIDOR		3'-0"	7'-0"	1 3/4"	SCW	F	1	HM	6/A-713	5/A-713	-	04			
138	OLC		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	10		2	
139	STATE MAINTENANCE STORAGE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	01		2	
140	STATE MAINTENANCE OFFICE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	08		2	
141A	CONFERENCE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	10			
141B	CONFERENCE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	10			
141C	CONFERENCE		3'-0"	8'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	23			
141D	CONFERENCE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	10			
142	HHB 1SG		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
143	HHB CDR		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
144	SIPR		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			


DOOR SCHEDULE																
DOOR NO.	ROOM NAME	DOOR							FRAME			HARDWARE SET	FIRE RATING (MIN.)	REMARKS		
		PAIR	WIDTH	HEIGHT	THICKNESS	MAT.	TYPE	TYPE	MAT.	HEAD	JAMB				SILL	
145	HHB READINESS		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
146	CORRIDOR		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
147	MED READINESS		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
148	CONFERENCE		3'-0"	7'-0"	1 3/4"	SCW	F	2	HM	2/A-713	1/A-713	-	10			
149	MDAY		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
150	CORRIDOR		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
151	S6		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
152	CORRIDOR		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
153	S1		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
154	CORRIDOR		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
155	S3		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
156	OIC		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
157	S4		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
158	OPS NCO		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
159	BTN CMDR		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
160	S1-SECTION		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
161	BTN SGM		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
162	S1NCO		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
163	S2-SECTION		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
164	CHAPLAIN		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
165	S2		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
167	MDAY		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
168	CORRIDOR		3'-0"	7'-0"	1 3/4"	SCW	F	1	HM	6/A-713	5/A-713	-	04			
172	CORRIDOR		3'-0"	7'-0"	1 3/4"	SCW	F	1	HM	6/A-713	5/A-713	-	04			
173	SUPPLY		4'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	01	45		
173.01	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
173.02	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
173.03	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
173.04	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
173.05	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
173.06	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
173A	OFFICE		3'-0"	7'-0"	1 3/4"	RELOC	RELOC	EX	EX	6/A-713	5/A-713	-	08		2, 3	
173B	VAULT		4'-0"	6'-8"	4"	AD	STEEL	3	STEEL	-	-	-	-		4	
175	SUPPLY		4'-0"	7'-0"	1 3/4"	HM	F	1	HM	6/A-713	5/A-713	-	01	45		
175.01	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
175.02	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
175.03	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
175.04	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
175.05	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
175.06	SUPPLY		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
175A	OFFICE		3'-0"	7'-0"	1 3/4"	RELOC	RELOC	EX	EX	6/A-713	5/A-713	-	08		2, 3	
175B	VAULT		4'-0"	6'-8"	4"	AD	STEEL	3	STEEL	-	-	-	-		4	
179.01	MILITARY MAINTENANCE		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
179.02	MILITARY MAINTENANCE		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
179.03	MILITARY MAINTENANCE		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
179.04	MILITARY MAINTENANCE		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
179.05	MILITARY MAINTENANCE		4'-0"	6'-10"	1 5/8"	-	-	-	-	-	-	-	13		5	
179A	MILITARY MAINTENANCE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	15			
179B	MILITARY MAINTENANCE		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	01			
180A	CORRIDOR	Yes	3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	23			
180B	CORRIDOR	Yes	3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	25			
180C	MECHANICAL	Yes	3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	24			
180D	CORRIDOR		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	21			
180E	CORRIDOR		6'-0"	7'-0"	2"	EX	EX	EX	EX	-	-	-	-		6	
181A	ELECTRICAL	Yes	3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	23			
A.1	STAIRS		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	15			
A.2	STAIRS		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	05	60		
A.3	STAIRS		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	05			
A.4	STAIRS		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-			
B.1	EXIST. STAIRS	Yes	3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	07	60		
B.2	EXIST. STAIRS		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	05			
B.3	EXIST. STAIRS	Yes	3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	07			
B.4	EXIST. STAIRS		3'-0"	7'-0"	1 3/4"	EX	EX	EX	EX	-	-	-	-	60		
C.1	STAIRS		3'-0"	7'-0"	1 3/4"	HM	F	2	HM	4/A-713	3/A-713	-	06			
C.2			3'-0"	7'-0"	1 3/4"	HM	F	1	HM	-	-	-	05			

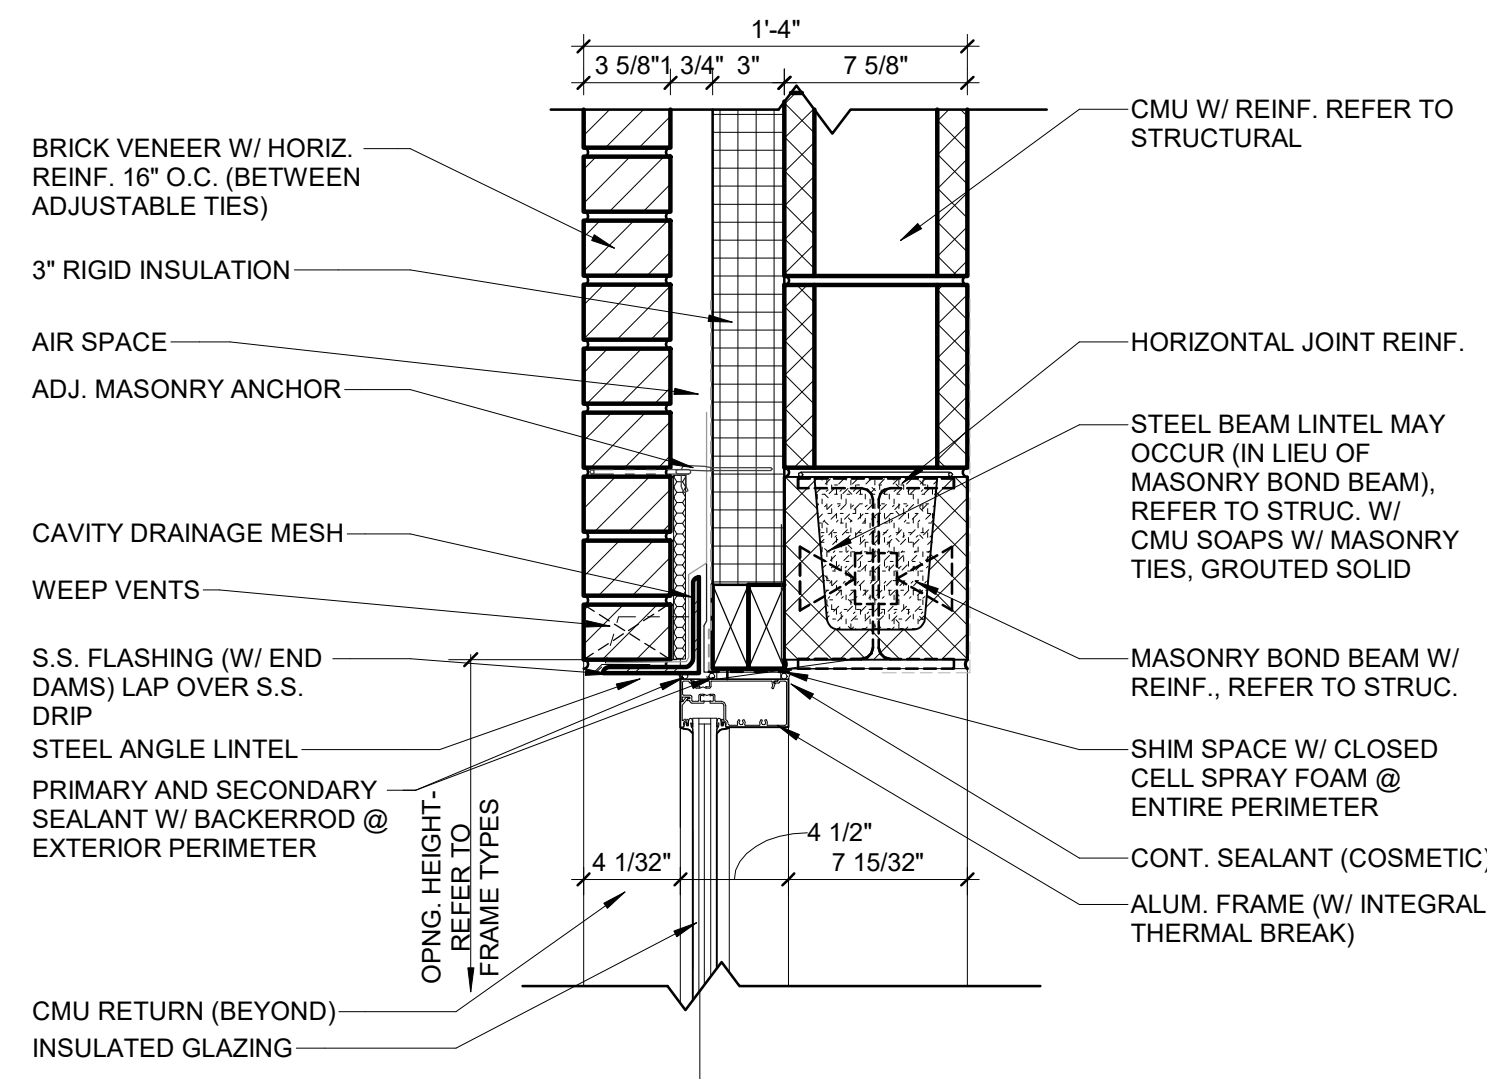


10
A-712
ALUM. HEAD
1 1/2" = 1'-0"

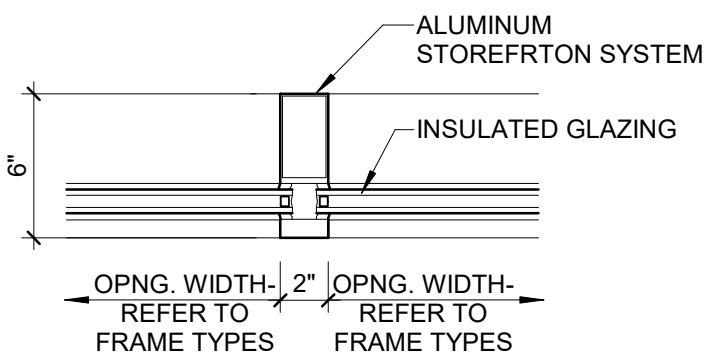


9
A-712
ALUM. VERTICAL MULLION
1 1/2" = 1'-0"

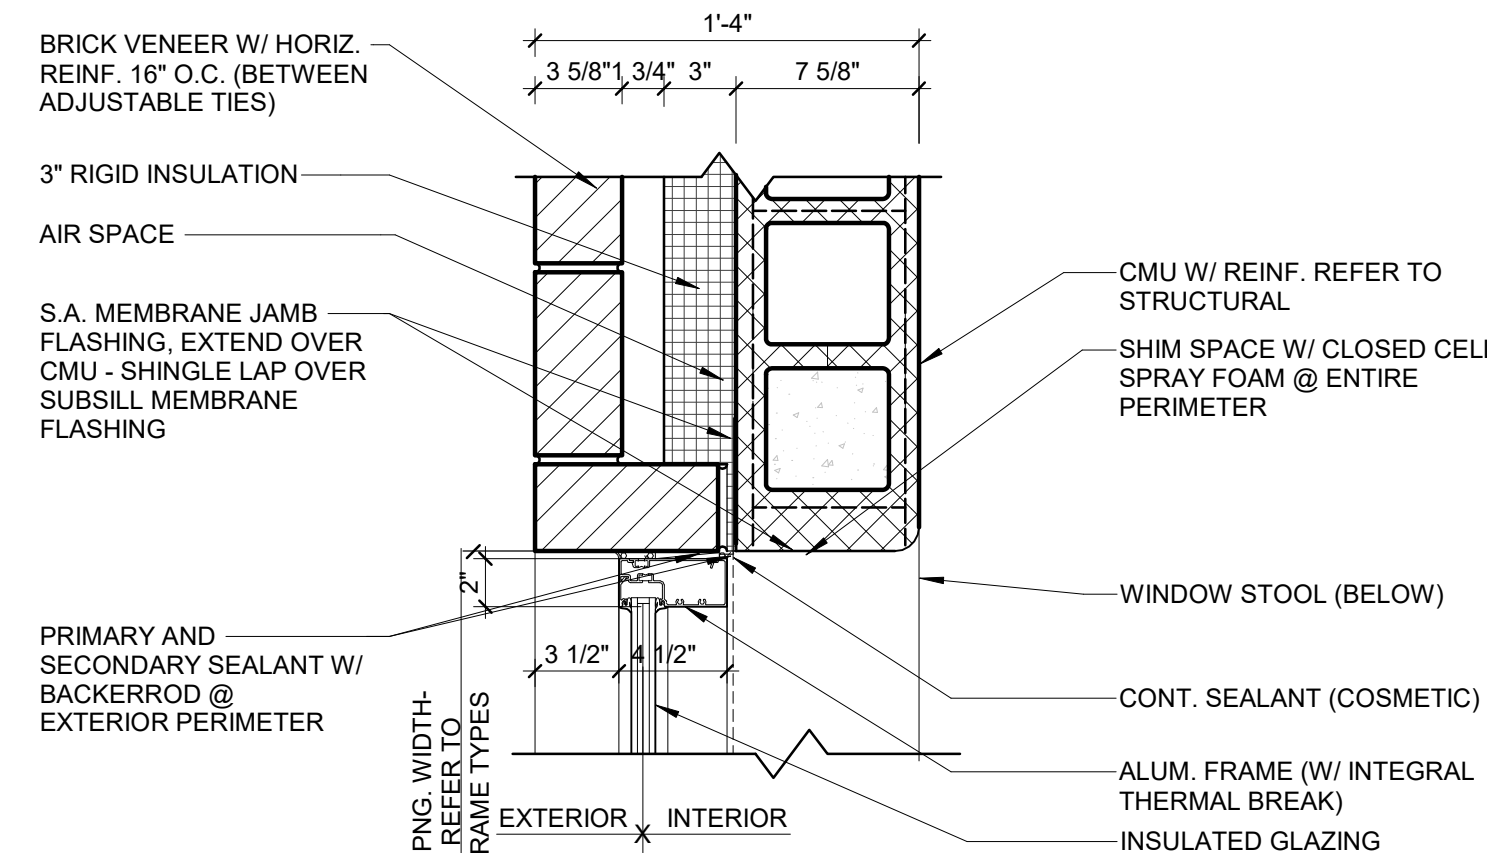


8
A-712
ALUM. JAMB
1 1/2" = 1'-0"

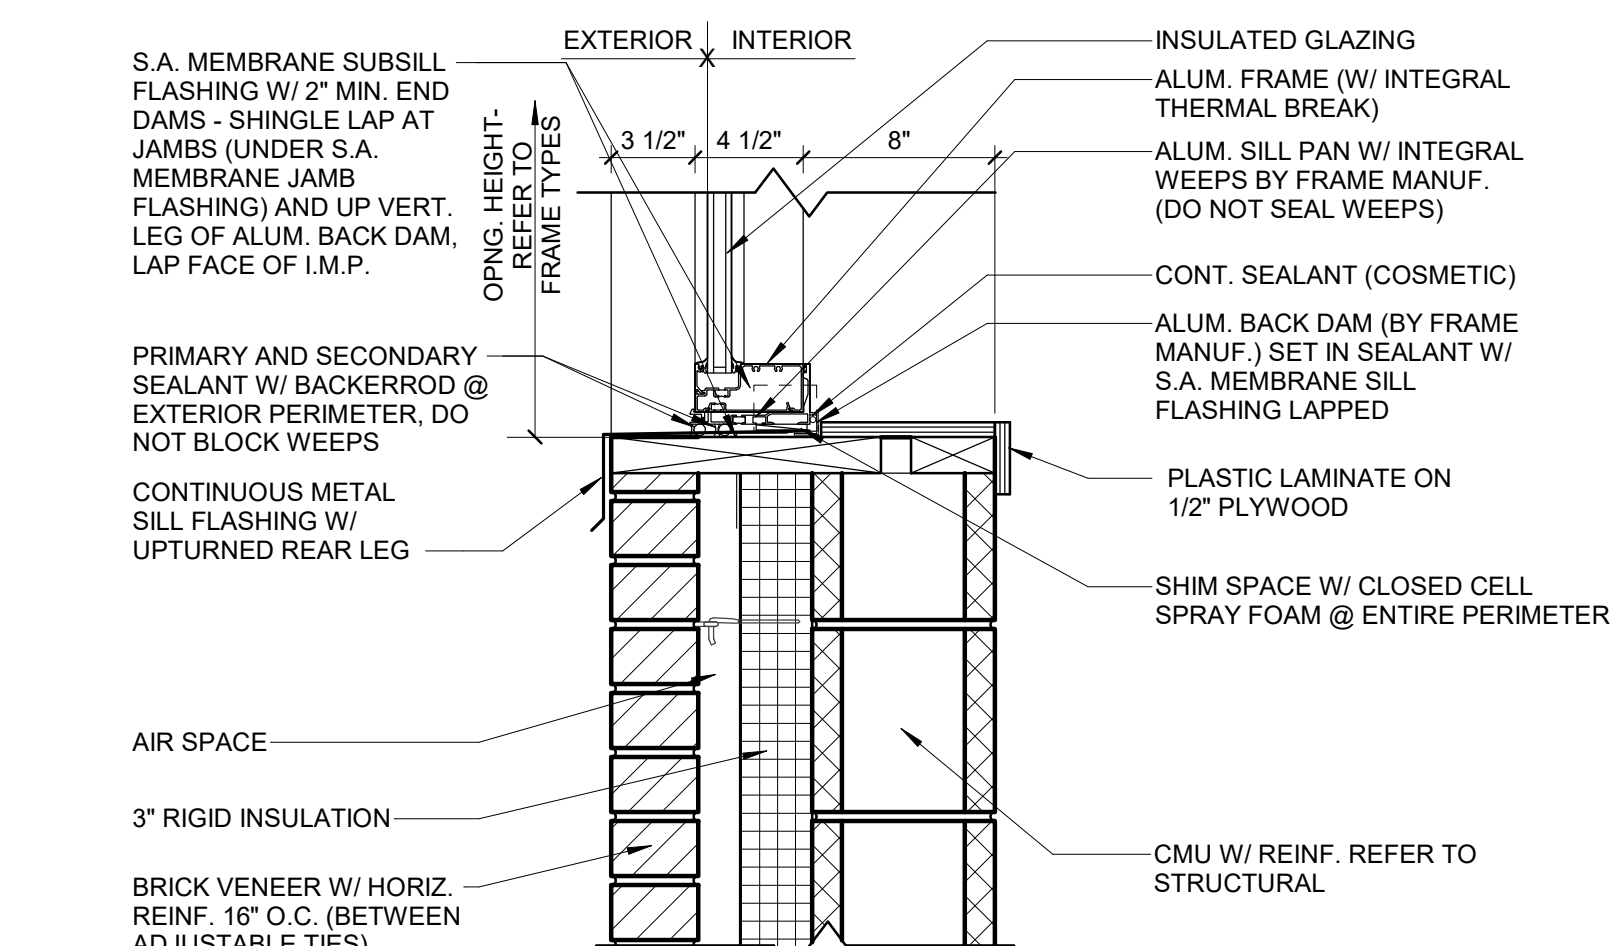


7
A-712
ALUM. SILL
1 1/2" = 1'-0"

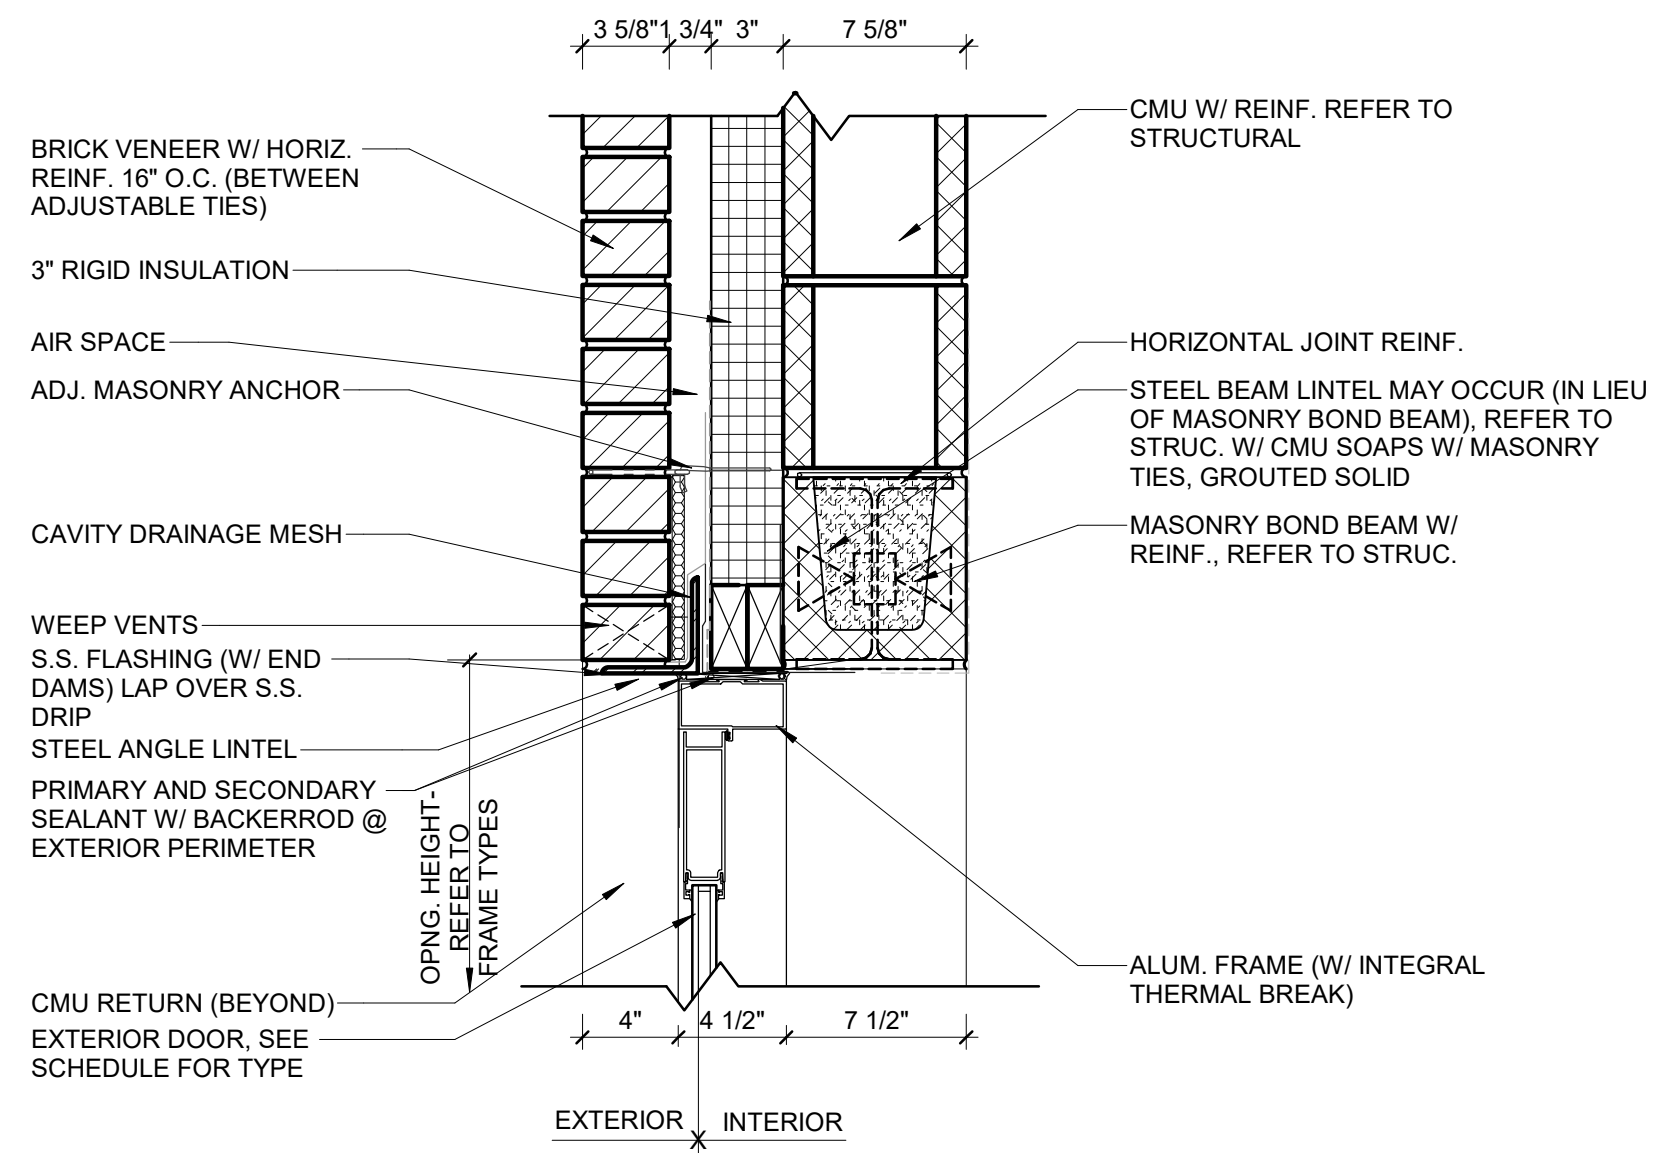


6
A-712
ALUM. HEAD
1 1/2" = 1'-0"

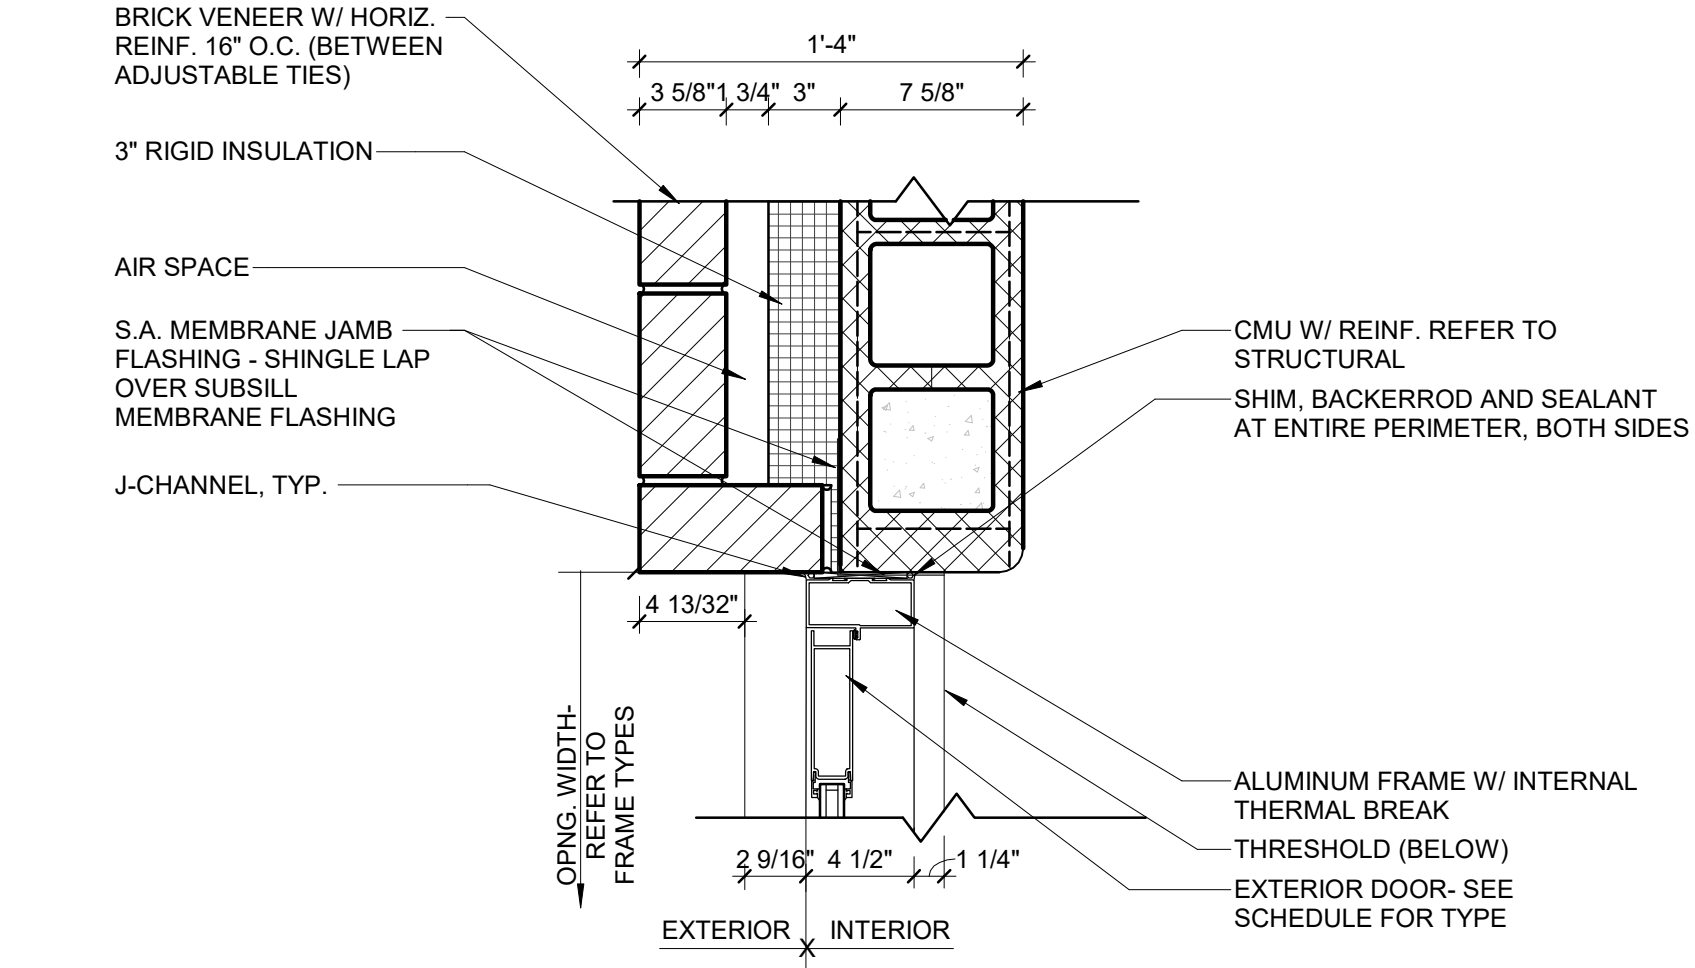


5
A-712
ALUM JAMB
1 1/2" = 1'-0"

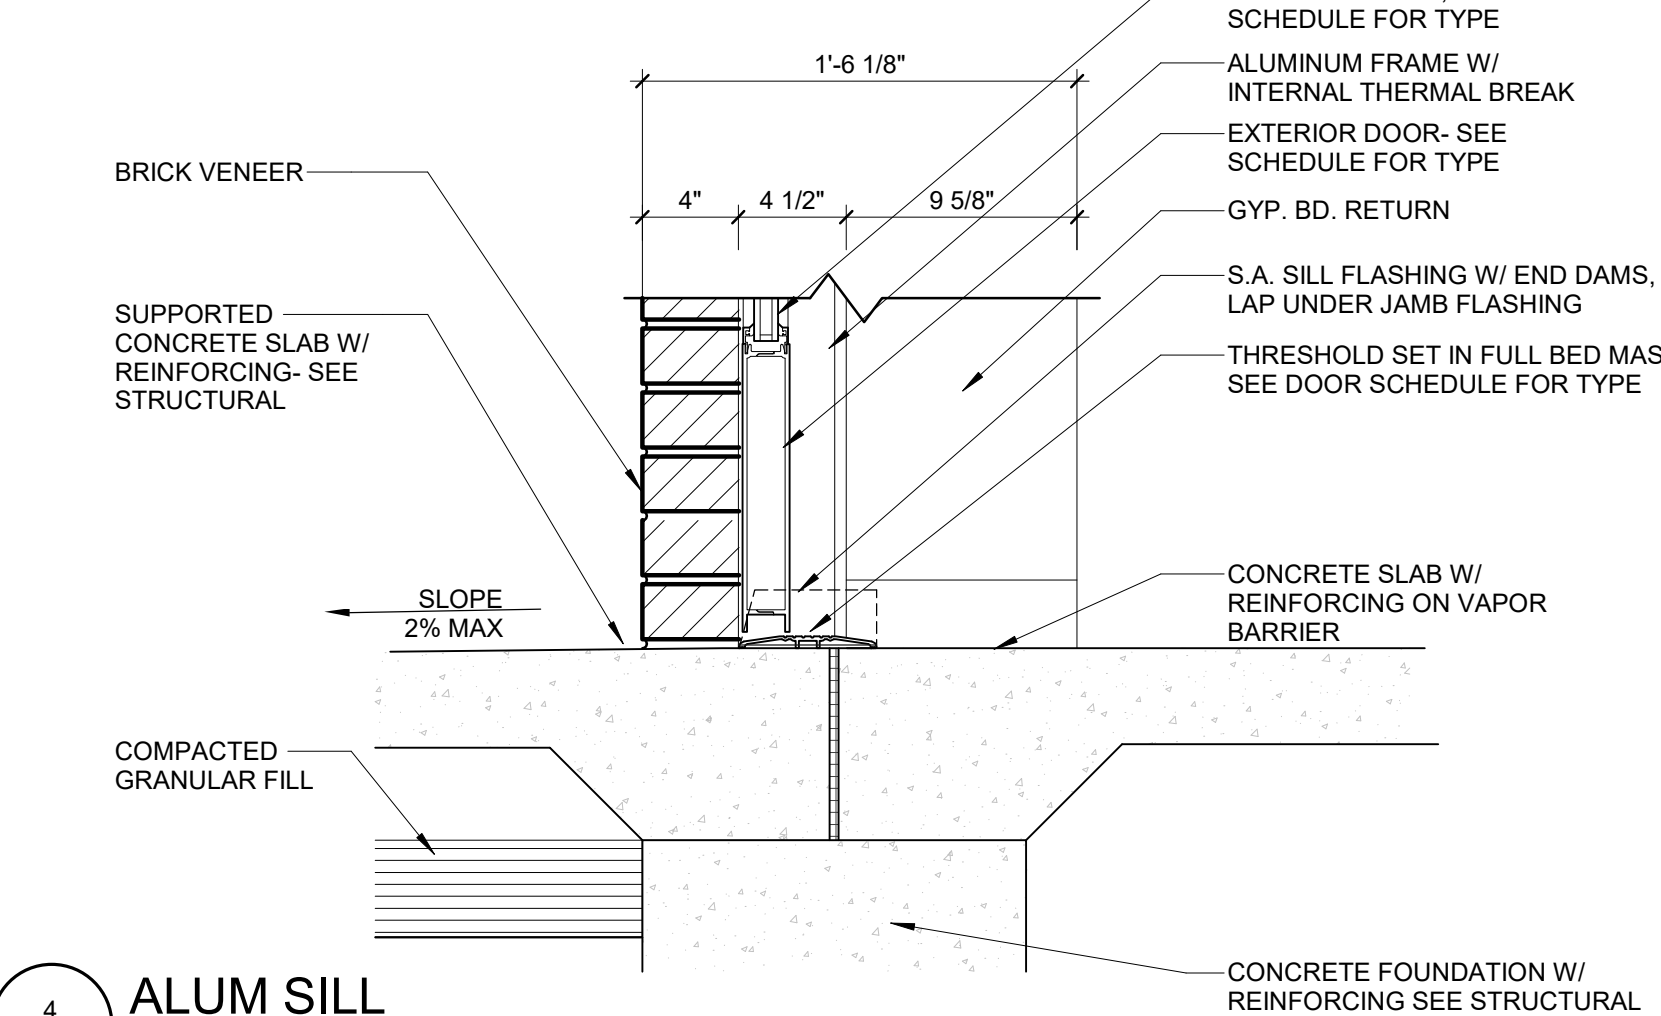


4
A-712
ALUM SILL
1 1/2" = 1'-0"

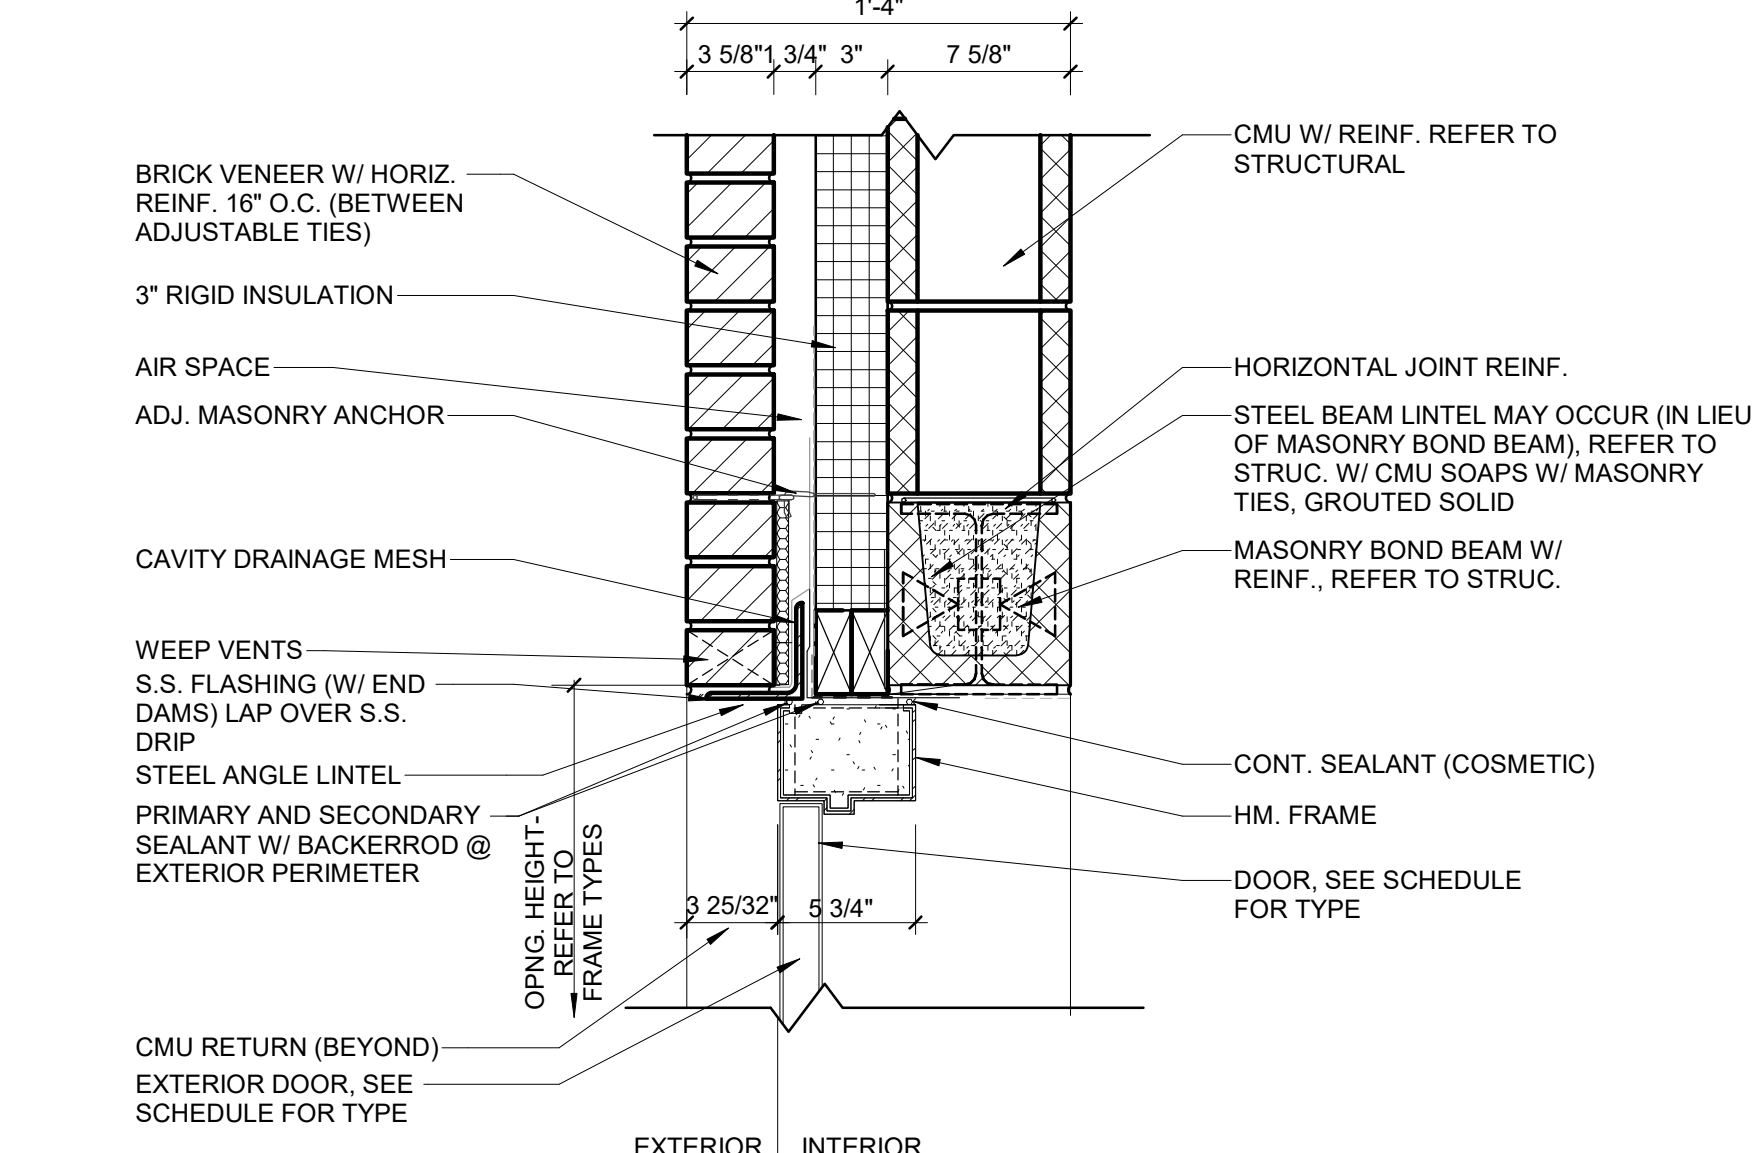


3
A-712
HM. HEAD
1 1/2" = 1'-0"

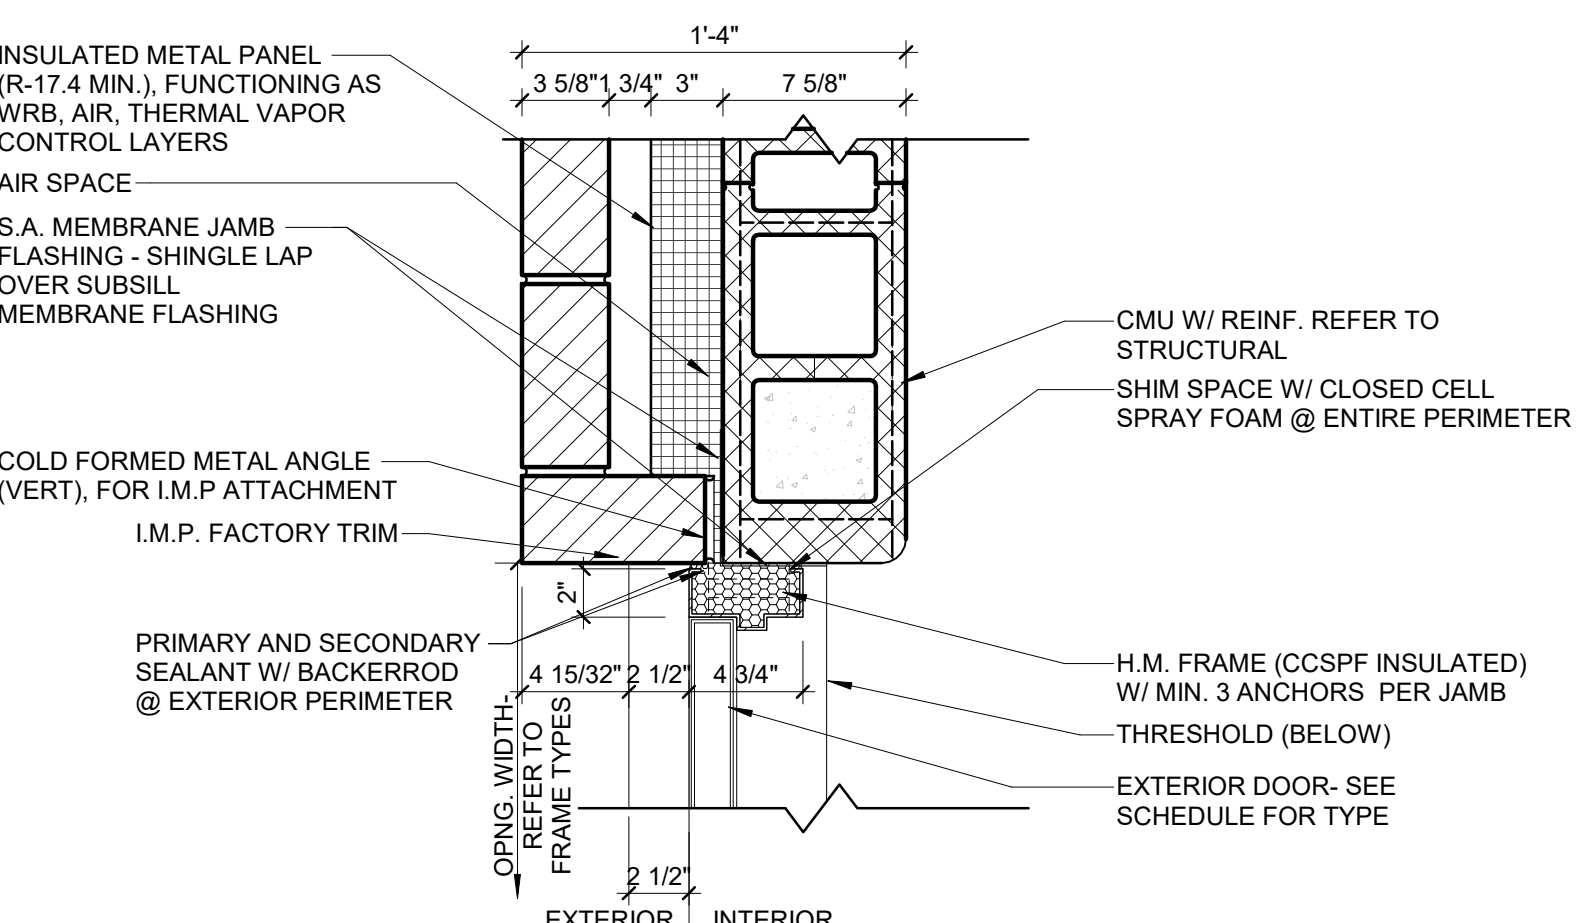


2
A-712
HM JAMB
1 1/2" = 1'-0"

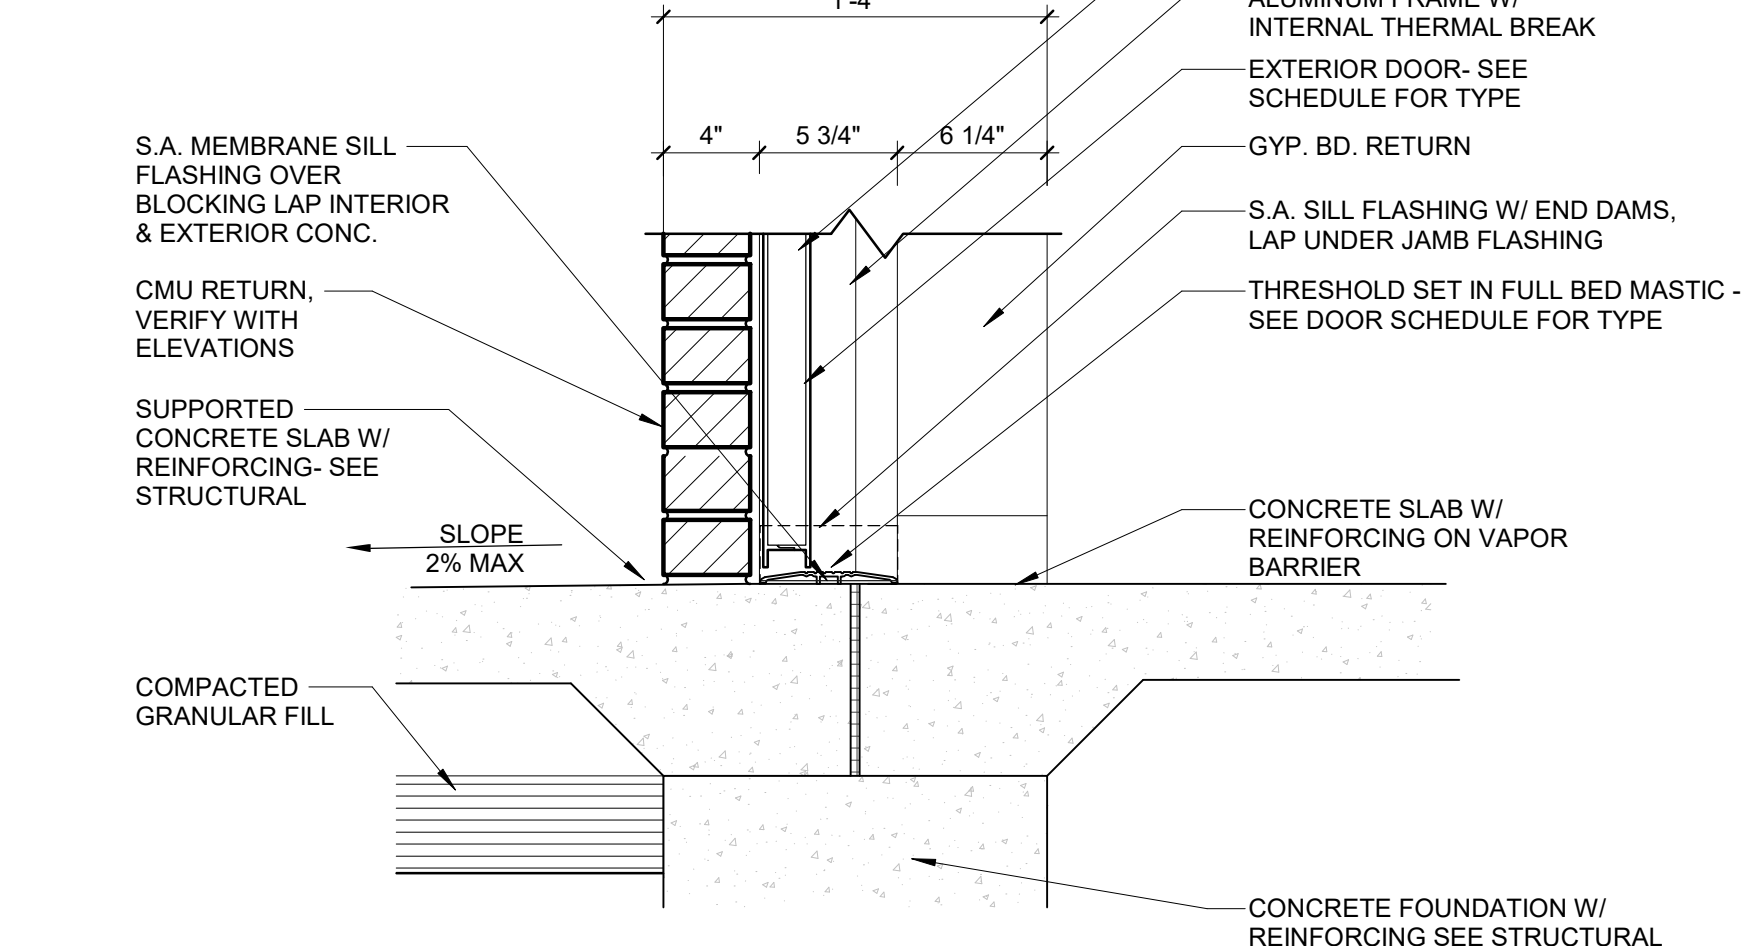


1
A-712
HM SILL
1 1/2" = 1'-0"

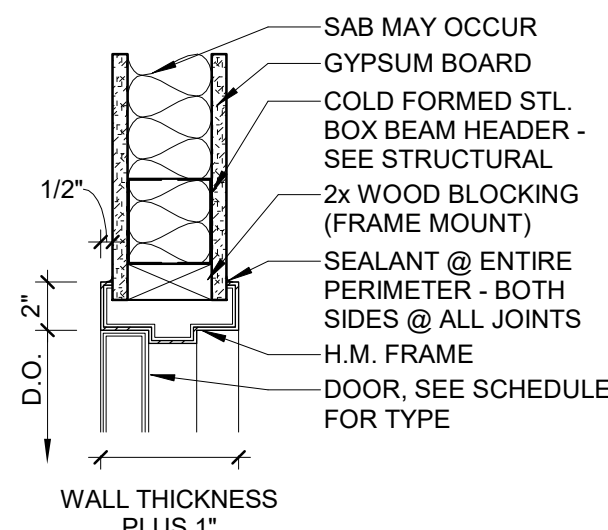


10
A-713
HM HEAD
1 1/2" = 1'-0"

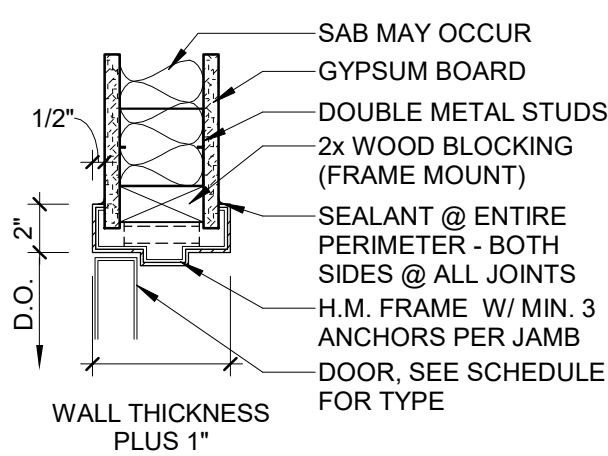


9
A-713
HM JAMB
1 1/2" = 1'-0"

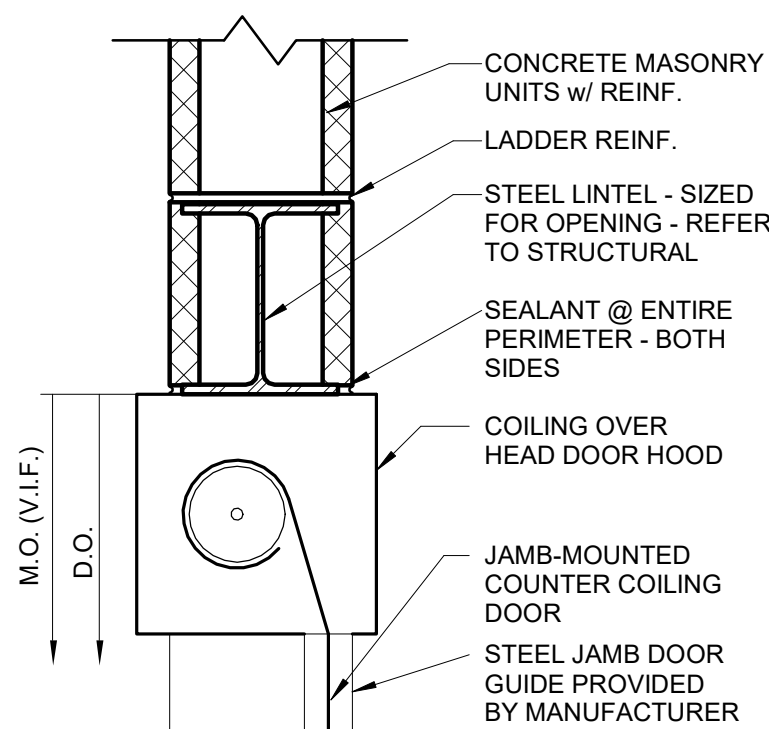


8
A-713
COILING DOOR HEAD
1 1/2" = 1'-0"

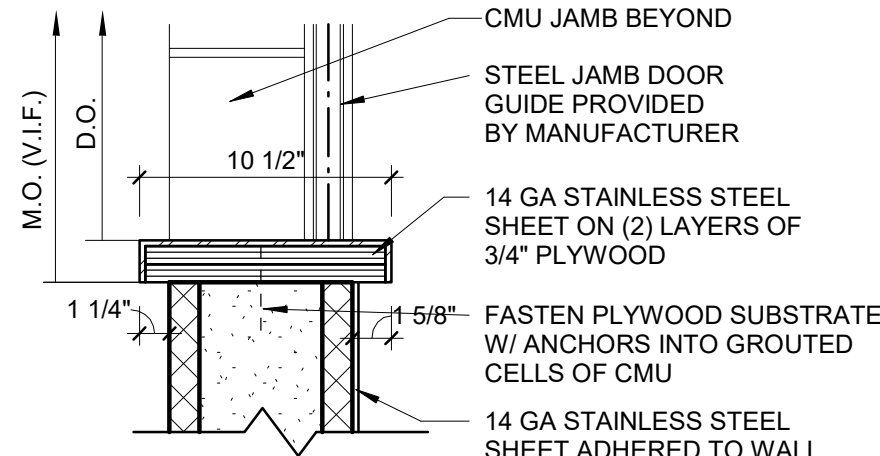


7
A-713
COILING DOOR SILL
1 1/2" = 1'-0"

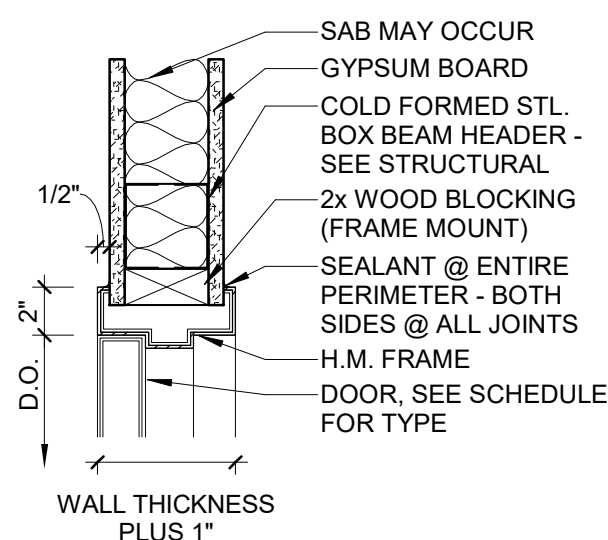


6
A-713
HM HEAD
1 1/2" = 1'-0"

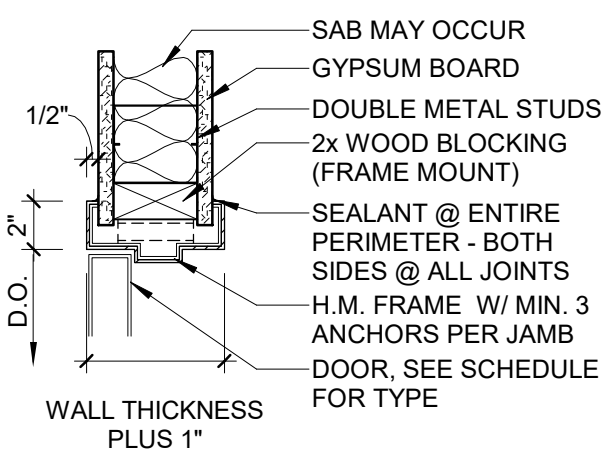


5
A-713
HM JAMB
1 1/2" = 1'-0"

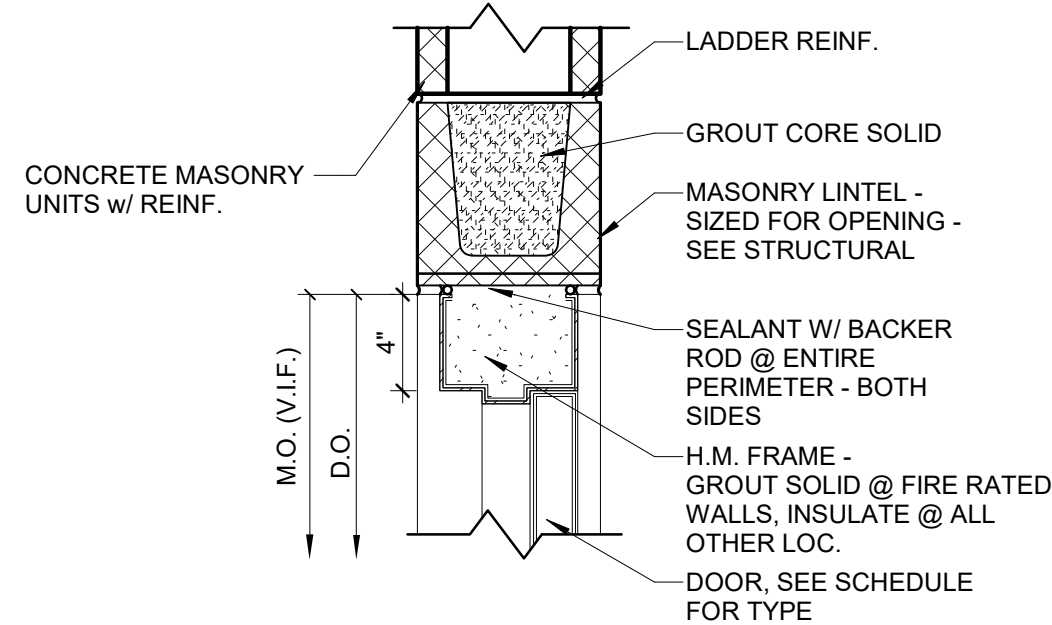


4
A-713
HM HEAD
1 1/2" = 1'-0"

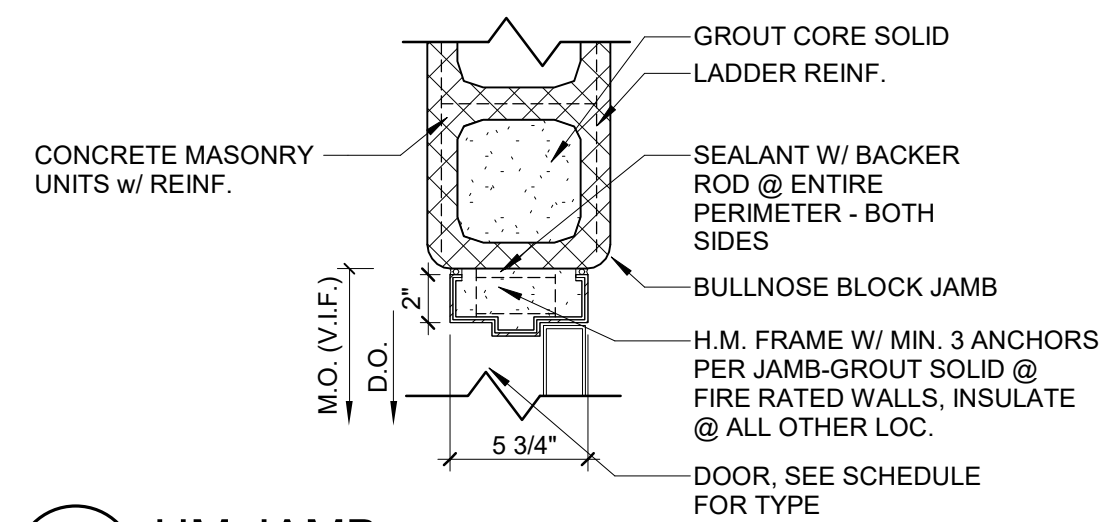

3
A-713
HM JAMB
1 1/2" = 1'-0"

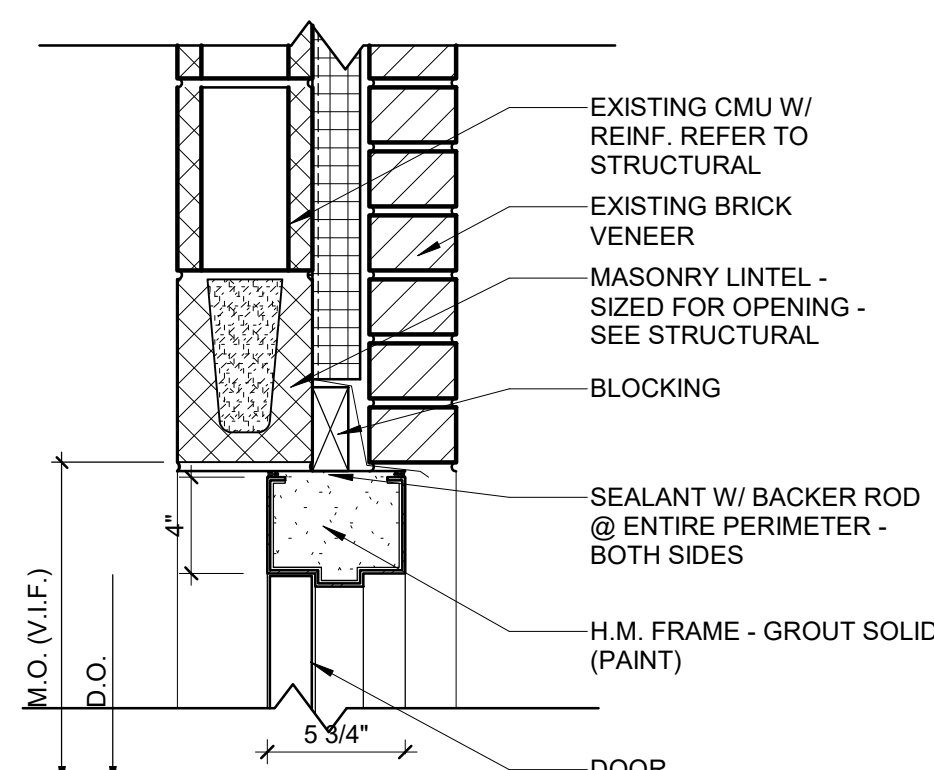

2
A-713
HM HEAD
1 1/2" = 1'-0"

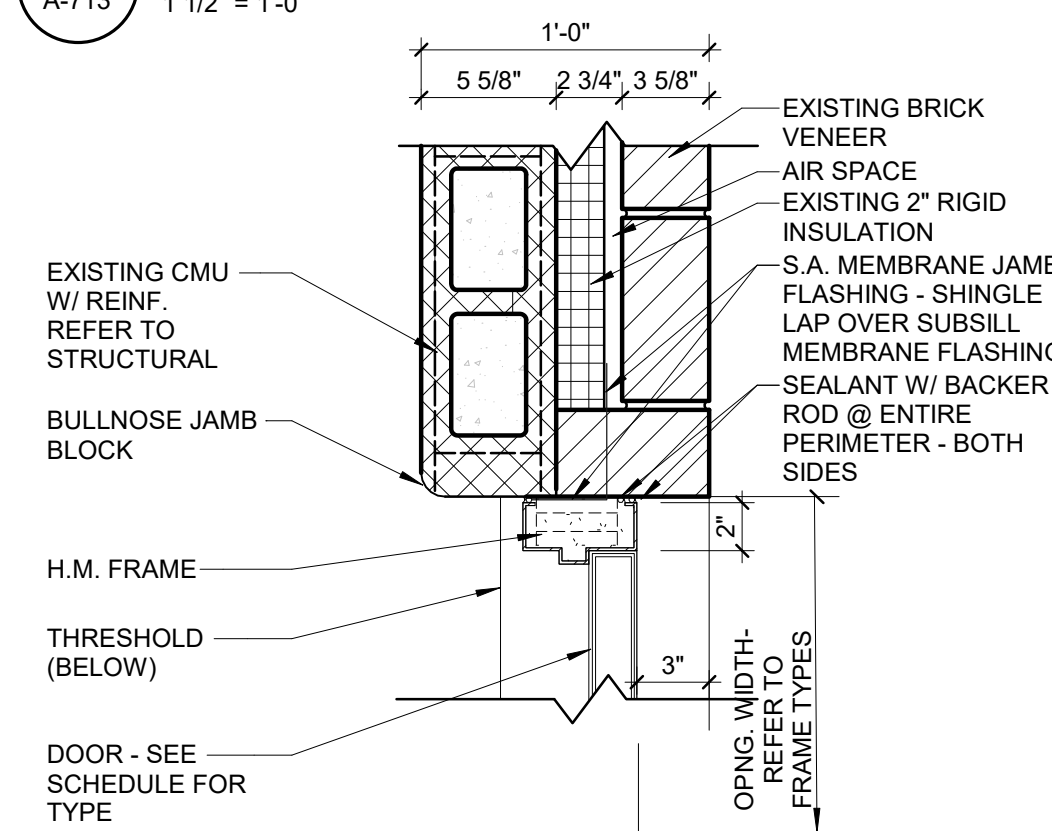

1
A-713
HM JAMB
1 1/2" = 1'-0"

PARTITION AND RATED ASSEMBLY NOTES

- WALLS ARE DISTINGUISHED ON FLOOR PLANS BY SYMBOL DESIGNATION, GRAPHIC DESIGNATION OR A COMBINATION OF BOTH DESIGNATIONS.
- THERE ARE TWO TYPES OF SYMBOL DESIGNATIONS, ONE FOR WALLS NOT REQUIRING SOUND ATTENUATION AND ANOTHER FOR WALLS WHICH REQUIRE SOUND ATTENUATIONS. REFER TO PARTITION MATRICES FOR SOUND ATTENUATION BLANKET (SAB) MINIMUM THICKNESS FOR STC INDICATED.

XX# SYMBOL DESIGNATION
(NO SOUND ATTENUATION
BATTS)

XX# SYMBOL DESIGNATION
(WITH SOUND ATTENUATION
BATTS)


- THE SYMBOL DESIGNATION HAS THREE CHARACTERS:
 - FIRST CHARACTER IS A LETTER INDICATING THE STRUCTURAL BACKUP SYSTEM.
 - SECOND CHARACTER IS A LETTER INDICATING THE PARTITION TYPE.
 - THIRD CHARACTER IS A NUMERIC INDICATING THE STRUCTURE WIDTH.

REFER TO LEGEND BELOW.

STRUCTURAL BACKUP	NUMERIC CHARACTER	METAL STUD WIDTH	WOOD STUD WIDTH	CMU WIDTH	CONCRETE WIDTH
W= WOOD STUD	1	1 5/8"	1 1/2"		
S= COLD FORMED	2	2 1/2"	2 1/2"		
STEEL STUD	3	3 5/8"	3 1/2"		
M= C.M.U.	4	4"		3 5/8"	
C= CONCRETE	5	6"	5 1/2"	5 5/8"	
	6	8"	7 1/4"	7 5/8"	8"
	7	10"	9 1/4"	9 5/8"	10"
	8			11 5/8"	12"

- WHERE PARTITION WALL TYPES ARE INDICATED, THE PARTITION SYSTEM IS CONTINUOUS UNTIL THE PARTITION CHANGES DIRECTION OR A DIFFERENT PARTITION SYSTEM IS INDICATED.
 - ALL INTERIOR STUD FRAMING/ C.M.U. TO EXTEND TO UNDERSIDE OF ROOF DECK, U.N.O.
 - "LINE OF STRUCTURE/ ROOF DECK" INDICATED FOR EACH PARTITION IS DIAGRAMMATIC ONLY AND DOES NOT INDICATE EXACT CONSTRUCTION CONDITIONS OR GEOMETRY.
 - FULLY CONSTRUCT ALL FIRE RESISTANCE RATED ASSEMBLIES PRIOR TO CONSTRUCTION OF ADJACENT NON RATED CONSTRUCTION.
 - APPROPRIATE FRAMING AND GYPSUM BOARD SHALL BE INSTALLED TO OFFSET AROUND STRUCTURAL MEMBERS OR OTHER OBSTRUCTIONS SUCH AS PIPING OR DUCTWORK TO MAINTAIN THE FIRE RESISTANCE RATING.
 - GYPSUM BOARD TO TERMINATE 1/2" BELOW LINE OF STRUCTURE AND BE SEALED AS FOLLOWS.
 - FIRE RESISTANCE RATED WALLS SHALL BE INSTALLED WITH LISTED FIRE RATED SEALANT UNLESS NOTED OTHERWISE.
 - SMOKE RESISTANCE RATED WALLS SHALL BE INSTALLED WITH LISTED SEALANT TO "LIMIT THE PASSAGE OF SMOKE" UNLESS NOTED OTHERWISE.
 - NON-FIRE RESISTANCE RATED WALLS SHALL BE INSTALLED WITH ACOUSTICAL SEALANT U.N.O., AT THE TOP AND BOTTOM STUDS/ TRACKS.
 - INSULATION AT HEAD CONDITIONS AT FLOOR/ROOF DECK
 - FIRE RESISTANCE RATED WALLS SHALL USE MINERAL WOOL INSULATION.
 - NON-FIRE RESISTANCE RATED WALLS REQUIRING SOUND ATTENUATION SHALL USE SOUND ATTENUATION BLANKETS (SAB).
 - FOR WALLS INDICATED TO RECEIVE SOUND ATTENUATION BATTS, EXTEND SOUND ATTENUATION BATTS TO FULL HEIGHT OF PARTITION UNLESS NOTED OTHERWISE. FLOOR STUD/ TRACKS TO BE SET IN A CONTINUOUS BED OF ACOUSTICAL SEALANT.
 - FIRE WALLS, FIRE BARRIERS, FIRE PARTITIONS AND SMOKE BARRIERS SHALL EXTEND AND SEAL TO THE INSIDE FACE OF THE EXTERIOR WALL AND ROOF/ FLOOR SHEATHING OR DECK, INCLUDING EXTENSIONS THROUGH SOFFITS AND CONCEALED SPACES.
 - ALL PENETRATIONS INTO AND/OR THROUGH A FIRE RATED ASSEMBLY MUST BE PROTECTED WITH A LISTED FIRE-STOP OR MEMBRANE PENETRATION SYSTEM. THE GENERAL CONTRACTOR WILL SUBMIT ALL FIRE-STOP ASSEMBLIES, TO INCLUDE TYPE OF PENETRATION, ASSEMBLY AND INSTALLATION DETAILS, TO THE ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION
 - PROVIDE AND INSTALL LISTED FIRE RATED AND/OR SMOKE DAMPERS AT MECHANICAL PENETRATIONS OF FIRE RESISTANCE RATED ASSEMBLIES PER THE 2015 MMC, U.N.O.
- ALL FIRE RESISTANCE RATED WALLS TO USE TYPE 'X'
 - ALL FIRE RESISTANCE RATED CEILINGS TO USE TYPE 'C'
 - WHERE MOISTURE RESISTANT GYPSUM BOARD OCCURS ON FIRE RATED ASSEMBLIES, USE COMBINATION FIRE RESISTANCE RATED/ MOLD AND MOISTURE RESISTANCE RATED GYPSUM BOARD FOR THE APPROPRIATE APPLICATION (I.E. TYPE 'X' OR 'C') AT OCCUPIED AREAS OR AT GYP. BD. SCHEDULED TO RECEIVE FINISHES, GYP. BD. SHALL RECEIVE LVL. 4 FINISH, ALL OTHER AREAS TO RECEIVE LVL. 2 FINISH.
 - ALL CURVED SURFACES EXPOSED TO VIEW TO RECEIVE LEVEL 5 FINISH.
- CONTINUE WALL FINISH MATERIAL TO MINIMUM 4" ABOVE SUSPENDED CEILINGS, U.N.O. WHERE NO CEILINGS IS INDICATED CONTINUE FINISH TO UNDERSIDE OF ROOF DECK, U.N.O.
 - ALL WALLS SCHEDULED TO RECEIVE SOUND ATTENUATION TO SHALL HAVE GYP. BD. AND INSULATION EXTENDED TO UNDERSIDE OF ROOF DECK.
 - ALL WALLS WHERE SOUND ATTENUATION IS NOT SCHEDULED ARE PERMITTED TO HAVE GYP. BD. TERMINATE 4" MIN. ABOVE THE FINISH CEILING, U.N.O.
- OFFSET ELECTRICAL BOXES AND OTHER PENETRATIONS MINIMUM 2'-0", TYP., ON OPPOSITE SIDES OF THE WALL.
 - AT ALL FIRE RESISTANCE RATED CONSTRUCTION, RECESSED FIXTURES SHALL BE INSTALLED SUCH THAT THE REQUIRED FIRE RESISTANCE WILL NOT BE REDUCED PER MBC SECTION 713.3.2, I.E. FIRE RESISTANCE RATED NICHE, HOUSING, ETC.
 - REFER TO STRUCTURAL DRAWINGS FOR COORDINATION OF ALL SHEAR WALL LOCATIONS, CONTRACTOR TO CONFIRM ADDITIONAL BLOCKING AND/OR FASTENING REQUIREMENTS WITH STRUCTURAL DRAWINGS.
 - "METAL STUDS" INDICATED ON THIS SHEET FOR INTERIOR PARTITIONS REFER TO THOSE SPECIFIED IN SECTION 09 22 16 / NON-STRUCTURAL METAL FRAMING. REFER TO SPECIFICATIONS FOR ADDITIONAL CRITERIA SUCH AS STUD SPACING, MINIMUM GAUGE OF METAL AND PERMISSIBLE DEFLECTION LIMITS.
 - WALL TYPES ARE TITLED TO GENERALLY DESCRIBE AN ASSEMBLY'S FIRE-RESISTIVE "CAPABILITY". IN SOME CASES, ARCHITECT MAY HAVE EMPLOYED A GIVEN WALL TYPE FOR ITS SOUND CONTROL OR OTHER PROPERTIES. THUS IT IS POSSIBLE THAT WALL TYPES CHOSEN MAY PROVIDE GREATER FIRE RESISTIVE CAPABILITY THAN ACTUALLY REQUIRED BY BUILDING CODE. UTILIZE WALL TYPES INDICATED BY FLOOR PLAN CALL-OUTS.
 - CONTACT ARCHITECT WHERE WALLS/PARTITIONS LACK A WALL TYPE CALL-OUT.
 - "STC" REFERS TO SOUND TRANSMISSION CLASS. A RATING SYSTEM THAT DESCRIBES THE ABILITY OF AN ASSEMBLY TO REDUCE THE TRANSMISSION OF SOUND. CONFIGURE SOUND-RATED WALL ASSEMBLIES ACCORDING TO THE MINIMUM REQUIREMENTS STIPULATED IN THE STC TESTS LISTED.
 - "SAB" REFERS TO SOUND ATTENUATION BATTS SPECIFIED IN SECTION 07 21 00/ 09 29 00 WHERE SAB'S ARE INDICATED, THEY SHALL EXTEND CONTINUOUSLY FROM FLOOR TO STRUCTURE ABOVE, U.N.O. SAB'S SHALL BE OF MATERIAL AS SPECIFIED IN WALL TYPES AND SPECIFICATIONS. NO SUBSTITUTIONS WITHOUT ARCHITECT APPROVAL.
 - HEAD-OF-WALL FIRESTOPPING AND SEALING OF THRU-WALL PENETRATIONS: REFER TO SECTION 07 84 00 / FIRESTOPPING.
 - ACOUSTICAL SEALANTS: SPECIFIED IN SECTION 07 92 00/ 09 29 00.
 - FIRE RESISTANCE RATING SIGNAGE: REFER TO SIGNAGE AND CONTROL NOTES, SHEET CS-003.
 - STANDARD AND BARRIER FREE MOUNTING HEIGHTS: REFER TO SHEET CS-003 FOR COORDINATION OF BLOCKING HEIGHTS.


TYPICAL CONTROL JOINT

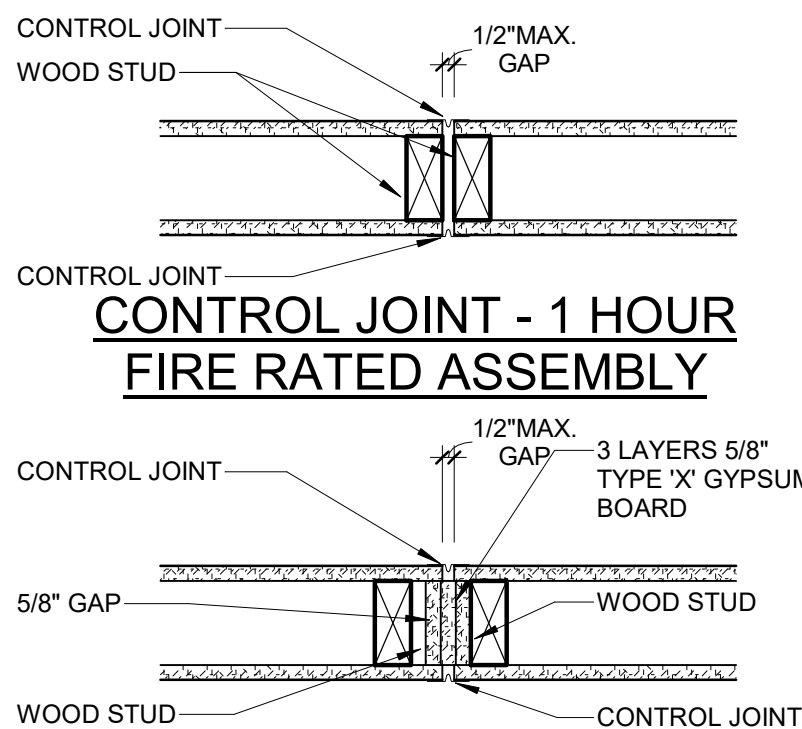

CONTROL JOINT - 1 HOUR FIRE RATED ASSEMBLY

CONTROL JOINTS IN GYPSUM BOARD MUST BE INSTALLED WHERE ANY OF THE FOLLOWING CONDITIONS OCCUR AS SPECIFIED IN AN GA-216 "APPLICATION AND FINISHING OF GYPSUM PANEL PRODUCTS" OR GA-234 "CONTROL JOINTS FOR FIRE-RESISTANCE RATED SYSTEMS" BY THE GYPSUM ASSOCIATION:

- A CONTROL JOINT MUST BE INSTALLED WHERE A PARTITION WALL OR CEILING TRAVERSES A CONSTRUCTION JOINT (EXPANSION, SEISMIC, OR BUILDING CONTROL ELEMENT) IN THE BASE BUILDING STRUCTURE.
- CONTROL JOINTS MUST BE INSTALLED WHERE A WALL OR PARTITION RUNS IN AN UNINTERRUPTED STRAIGHT PLANE EXCEEDING 30 LINEAR FEET.
- CONTROL JOINTS IN INTERIOR CEILINGS WITH PERIMETER RELIEF MUST BE INSTALLED SO THAT LINEAR DIMENSIONS BETWEEN CONTROL JOINTS DO NOT EXCEED 50 FEET.
- CONTROL JOINTS IN INTERIOR CEILINGS WITHOUT PERIMETER RELIEF MUST BE INSTALLED SO THAT LINEAR DIMENSIONS BETWEEN CONTROL JOINTS DO NOT EXCEED 30 FEET.
- CONTROL JOINTS IN EXTERIOR CEILINGS AND SOFFITS MUST BE INSTALLED SO THAT LINEAR DIMENSIONS BETWEEN CONTROL JOINTS DO NOT EXCEED 30 FEET.
- A CONTROL JOINT OR INTERMEDIATE BLOCKING MUST BE INSTALLED WHERE CEILING FRAMING MEMBERS CHANGE DIRECTION.
- CONTROL JOINT LOCATIONS ARE INDICATED ON THE INTERIOR ELEVATIONS AND/OR REFLECTED CEILING PLANS. IF A SITUATION ARISES WHERE IT IS UNKNOWN WHETHER A CONTROL JOINT IS REQUIRED, PLEASE CONTACT THE ARCHITECT.

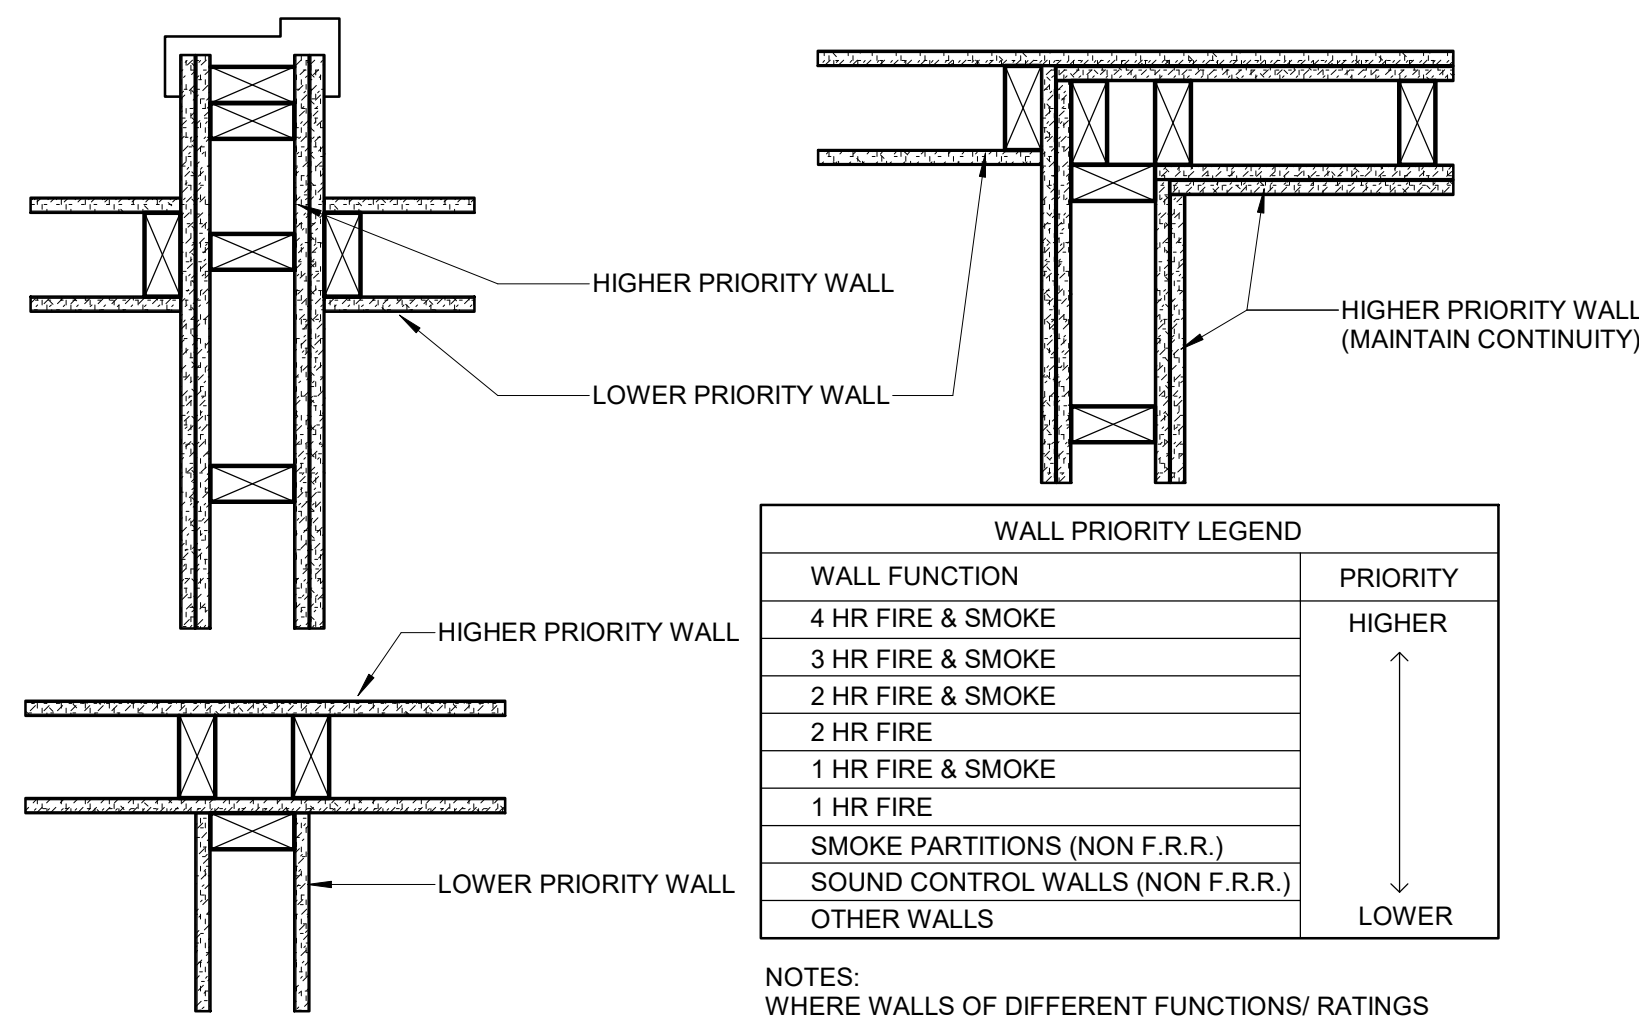


WALL PRIORITY LEGEND	
WALL FUNCTION	PRIORITY
4 HR FIRE & SMOKE	HIGHER
3 HR FIRE & SMOKE	
2 HR FIRE & SMOKE	
2 HR FIRE	
1 HR FIRE & SMOKE	LOWER
1 HR FIRE	
SMOKE PARTITIONS (NON F.R.R.)	
SOUND CONTROL WALLS (NON F.R.R.)	
OTHER WALLS	

NOTES:
WHERE WALLS OF DIFFERENT FUNCTIONS/ RATINGS INTERSECT: WALLS OF HIGHER PRIORITY SHALL BE CONTINUOUS.

LOWER PRIORITY WALLS SHALL "ABUT" AND BE "SEALED TO" HIGHER PRIORITY WALLS, BUT SHALL NOT INTERRUPT CONTINUITY OF THE HIGHER PRIORITY WALL.

WALL PRIORITY LEGEND

1 1/2" = 1'-0"

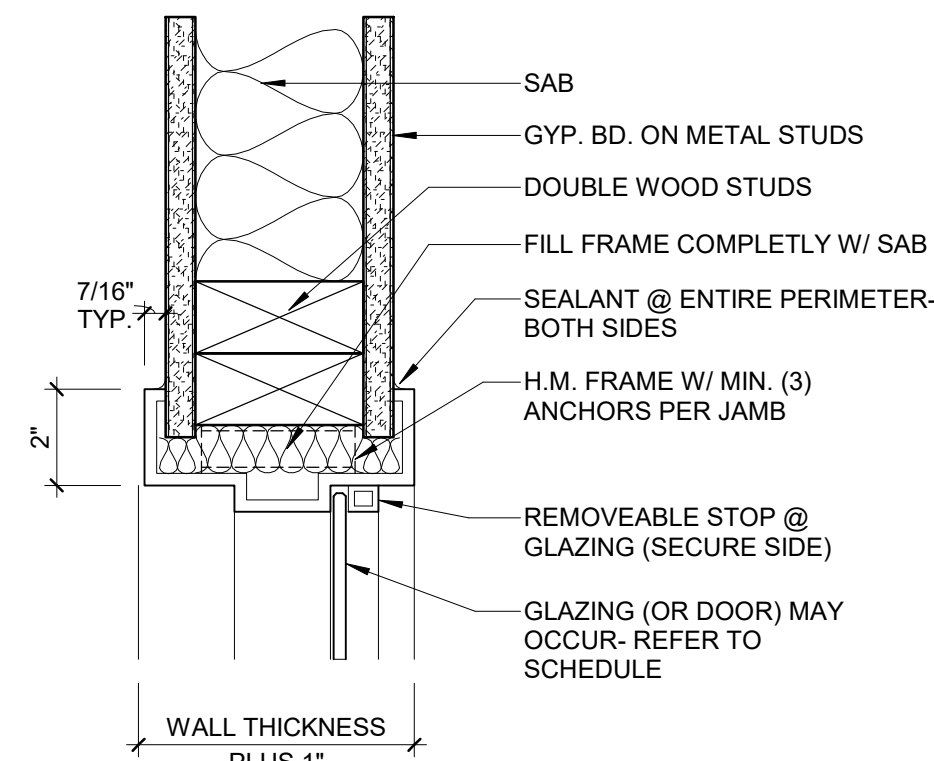

DOOR JAMB (SIM. AT HEAD)- STUD WALLS SOUND CONTROL (FIRE RATED/NON-FIRE RATED)

3" = 1'-0"

BACKING/BLOCKING SCHEDULE/NOTES.

- PROVIDE BACKING/BLOCKING IN GYB PARTITIONS FOR ALL WALL-HUNG ITEMS. DO NOT USE SHEET METAL BLOCKING/BACKING.

- PROVIDE AND INSTALL 3/4" F.R.T. PLYWOOD BACKING @ ALL ELECTRICAL, AND LOW VOLTAGE WALL MOUNTED PANELS/ RACKS, TYP.

- THESE ANCHORING DETAILS ARE SHOWN AS TYPICAL AND ARE NOT INTENDED TO BE ALL INCLUSIVE. PROVIDE WOOD OR STEEL BACKING IN PARTITIONS FOR WALL HUNG ITEMS, SUCH AS WALL CABINETS, BATHROOM ACCESS, SHELVING, DOOR HOLD-OPENS, & STOPS, ETC., INCLUDING NIC, BY OWNER, BY OWNER FUTURE, & RELOCATE EXISTING ITEMS.

- USE THE FOLLOWING ASSUMED LOADS TO DETERMINE BLKG & FASTENER REQUIREMENTS UNLESS GREATER LOADS ARE KNOWN.
 - S DISP, PTC, TPH, MIRRORS, COAT HOOKS, BPG, TOWEL BAR & RING, MOP HOLDER, ASH URN, ETC-USE 100lbs MOP HOLDER, ASH URN ETC - USE 100 LB.
 - HANDRAIL, BUMPER RAILS - USE 200 LB CONCENTRATED LOAD.
 - GRAB BARS - USE 250 LB CONCENTRATED LOAD.
 - WALL CABINETS - USE WEIGHT OF CABINET PLUS 100LB PER FOOT OF SHELF.
 - COUNTERTOPS- USE WEIGHT OF COUNTER TOP PLUS 55 LB PER FOOT OF COUNTER.
 - 12" ADJ SHELVES - USE 40 LB PER BRKT
 - 18" ADJ SHELVES - USE 55 LB PER BRKT
 - 24" ADJ SHELVES - USE 83 LB PER BRKT

LOADING TABLE NOTES:

- SEE TABLE 1 BELOW FOR SIZE OF WOOD BLKG, QUANTITY AND SIZE OF SCREWS FOR CONNECTION TO EACH STUD.


- SEE TABLE 2 OR 3 BELOW FOR QUANTITY AND SIZE OF SCREWS FOR CONNECTION OF WALL HUNG ITEMS, IF NOT ALREADY PROVIDED BY MFR OF WALL HUNG ITEM.

TABLE 1				
MAXIMUM ALLOWABLE LOAD-IN POUNDS				
WOOD SCREW	LENGTH OF WALL HUNG ITEM			
QUAN.	SIZE	1'-4" OR LESS	2'-8" OR LESS-9" OR MORE	
2x4 WOOD BLOCKING				
2	#6	160	320	480
2	#8	240	480	700
2	#10	320	640	700
2x6 WOOD BLOCKING				
3	#6	240	480	700
3	#8	360	700	700
3	#10	480	700	700


LOADS BASED ON GROUP II WOOD SPECIES & SCREWS EMBEDDED IN WOOD A MIN OF 7 TIMES THE SCREW DIA WITH SCREWS INSERTED IN SIDE GRAIN ON ONE SIDE & SIDE GRAIN ON OPPOSITE END.

TABLE 2				
MAXIMUM ALLOWABLE LOAD-IN POUNDS				
SCREW SIZE	QUANTITY OF SCREWS			
	2	3	4	5
#6	150	225	300	375
#8	212	318	424	530
#10	286	429	572	700
#12	370	555	700	700


LOADS BASED ON GROUP II WOOD SPECIES & SCREWS EMBEDDED IN WOOD A MIN OF 7 TIMES THE SCREW DIA WITH SCREWS INSERTED IN SIDE GRAIN.

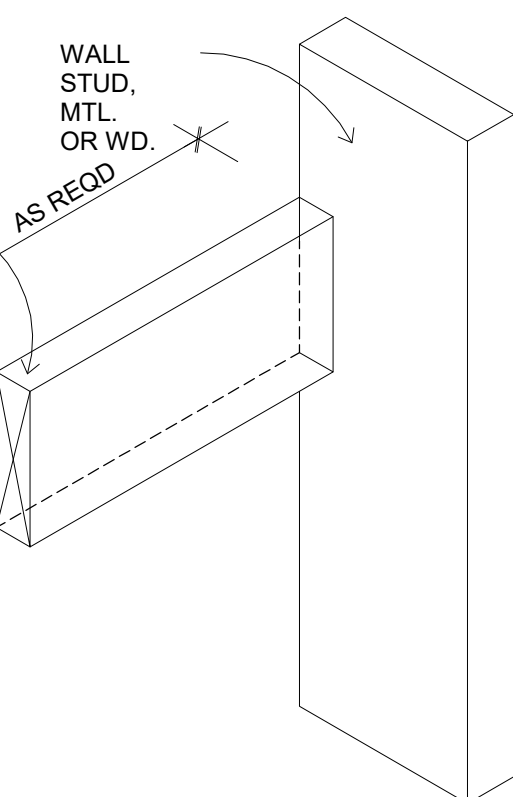

ISOMETRIC DETAIL

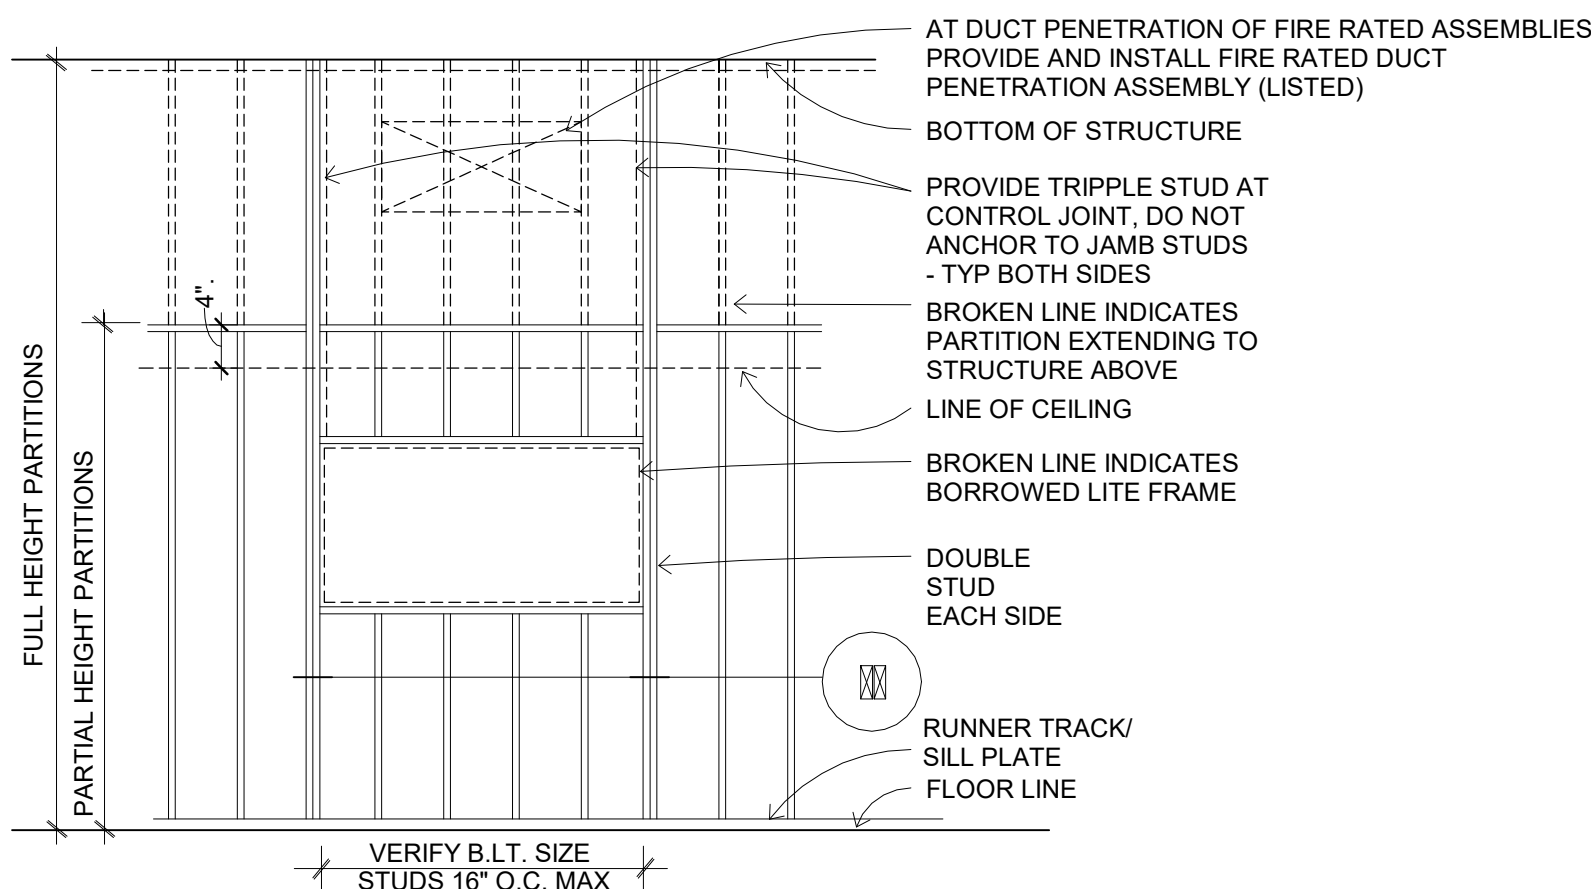

WINDOW/BORROWED LIGHT OPENING TYPICAL FRAMING ELEVATION

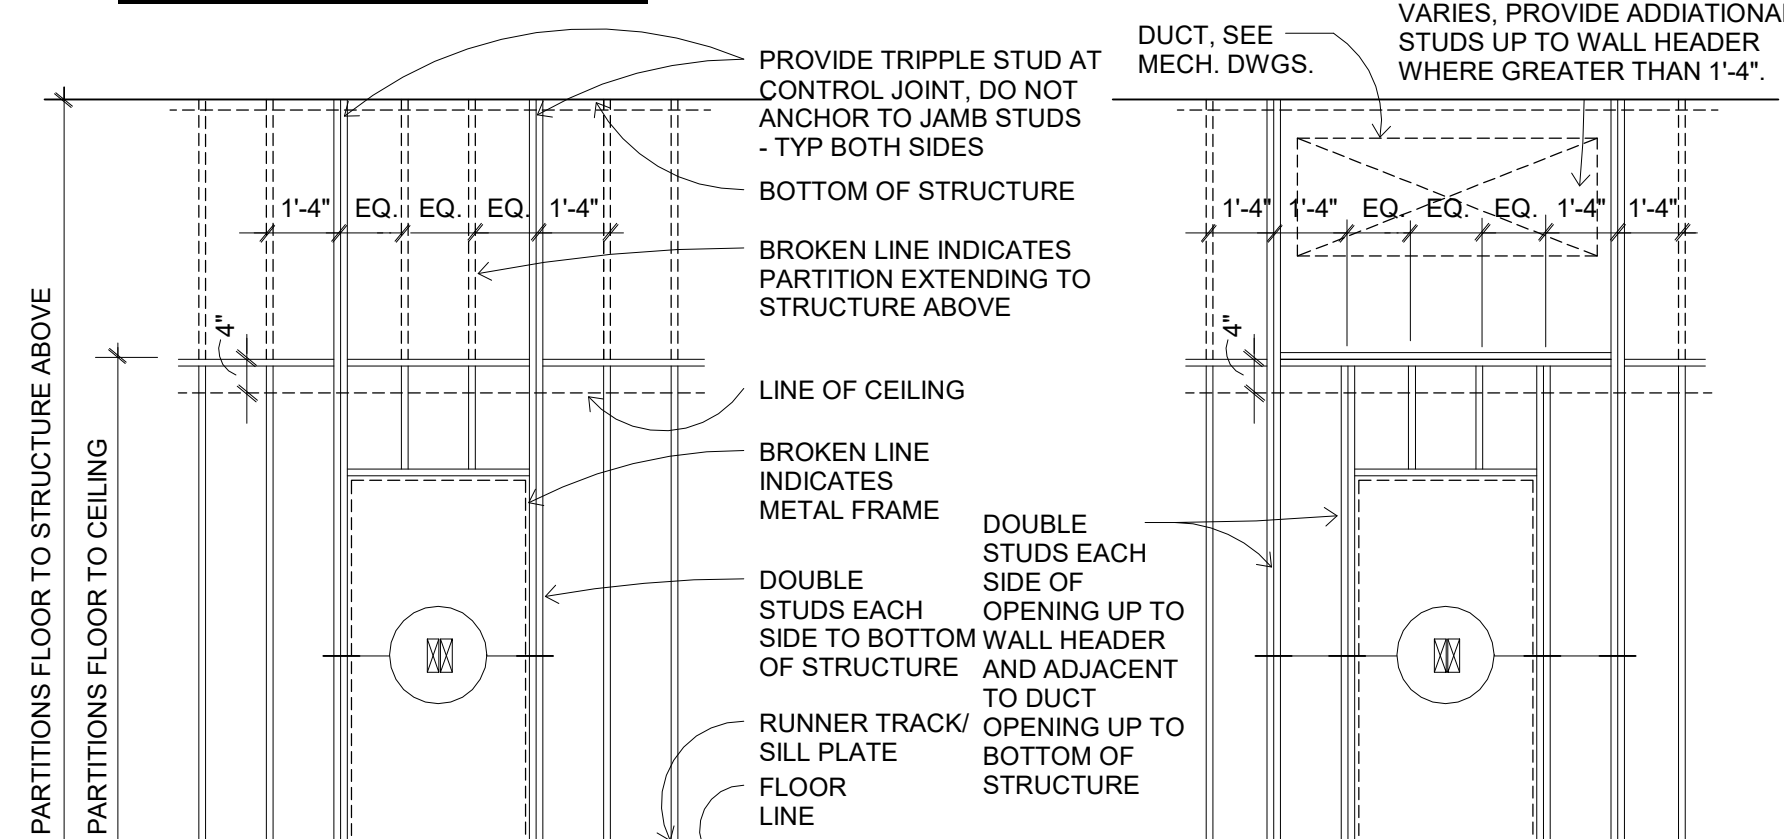

DOOR OPENING TYPICAL FRAMING ELEVATION

DOOR OPENING TYPICAL FRAMING ELEVATION WITH DUCT ABOVE. WINDOW SIMILAR.

BLOCKING AND BACKING REQUIREMENTS

1 1/2" = 1'-0"

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED, COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS



FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
OFFICE OF BUSINESS SERVICES
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR




RENOVATE ARMORY, JACKSON (WEST) ARMORY

DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

SHEET TITLE: WALL TYPES AND ASSEMBLIES


HL	NC	TM	RMR
DESIGNED	CHECKED	APPROVED	
DATE	DATE	DATE	DATE
01/15/26	01/15/26	01/15/26	01/15/26
ISSUED FOR:	PRELIMINARY	CONSTRUCTION	FINAL RECORD
PROJECT NO: 25510.A	PROJECT NO: 25510.A	PROJECT NO: 25510.A	PROJECT NO: 25510.A
DWVA: 252285007	DWVA: 252285007	DWVA: 252285007	DWVA: 252285007
FILE NO INDEX CODE:	FILE NO INDEX CODE:	FILE NO INDEX CODE:	FILE NO INDEX CODE:
51725039.CAK	51725039.CAK	51725039.CAK	51725039.CAK

A-721

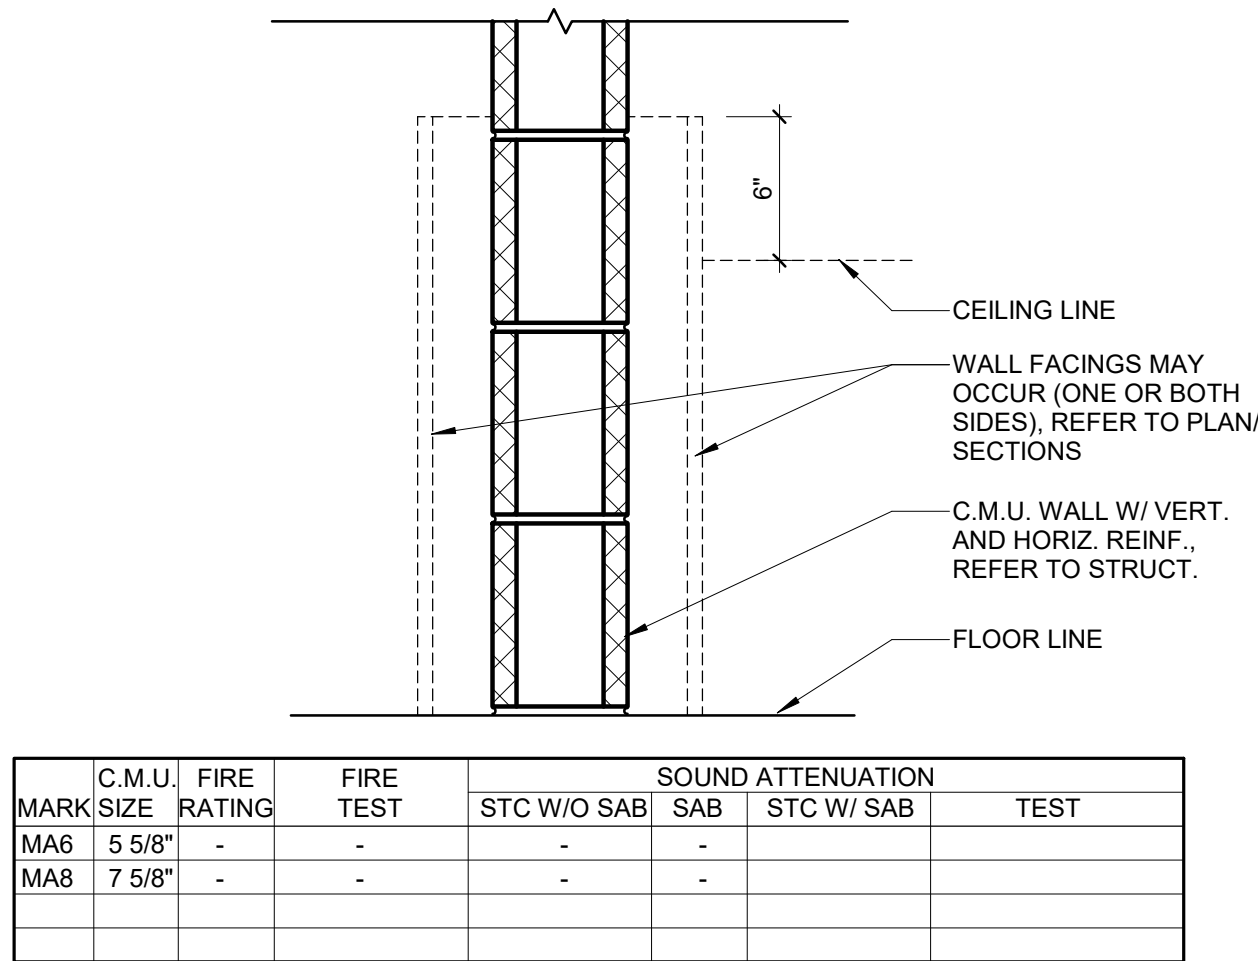


*WALL ASSEMBLIES SHALL EXTEND TO UNDERSIDE OF ROOF DECK UNLESS NOTED OTHERWISE.


MA CONCRETE MASONRY WALL
1 1/2" = 1'-0"

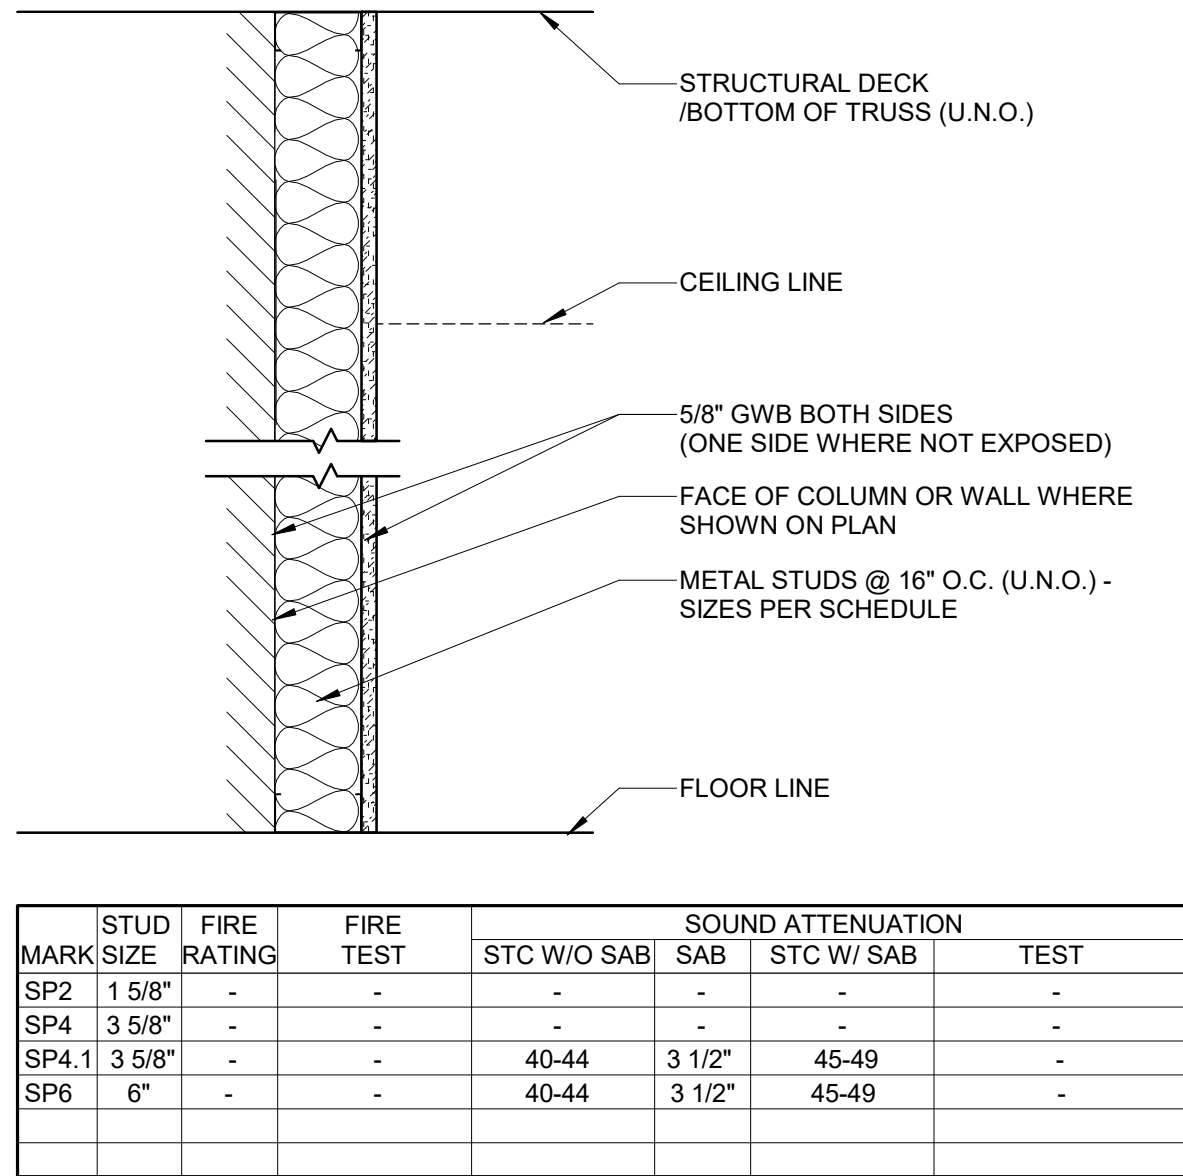


SP STUD FURRING TO STRUCTURE
1 1/2" = 1'-0"

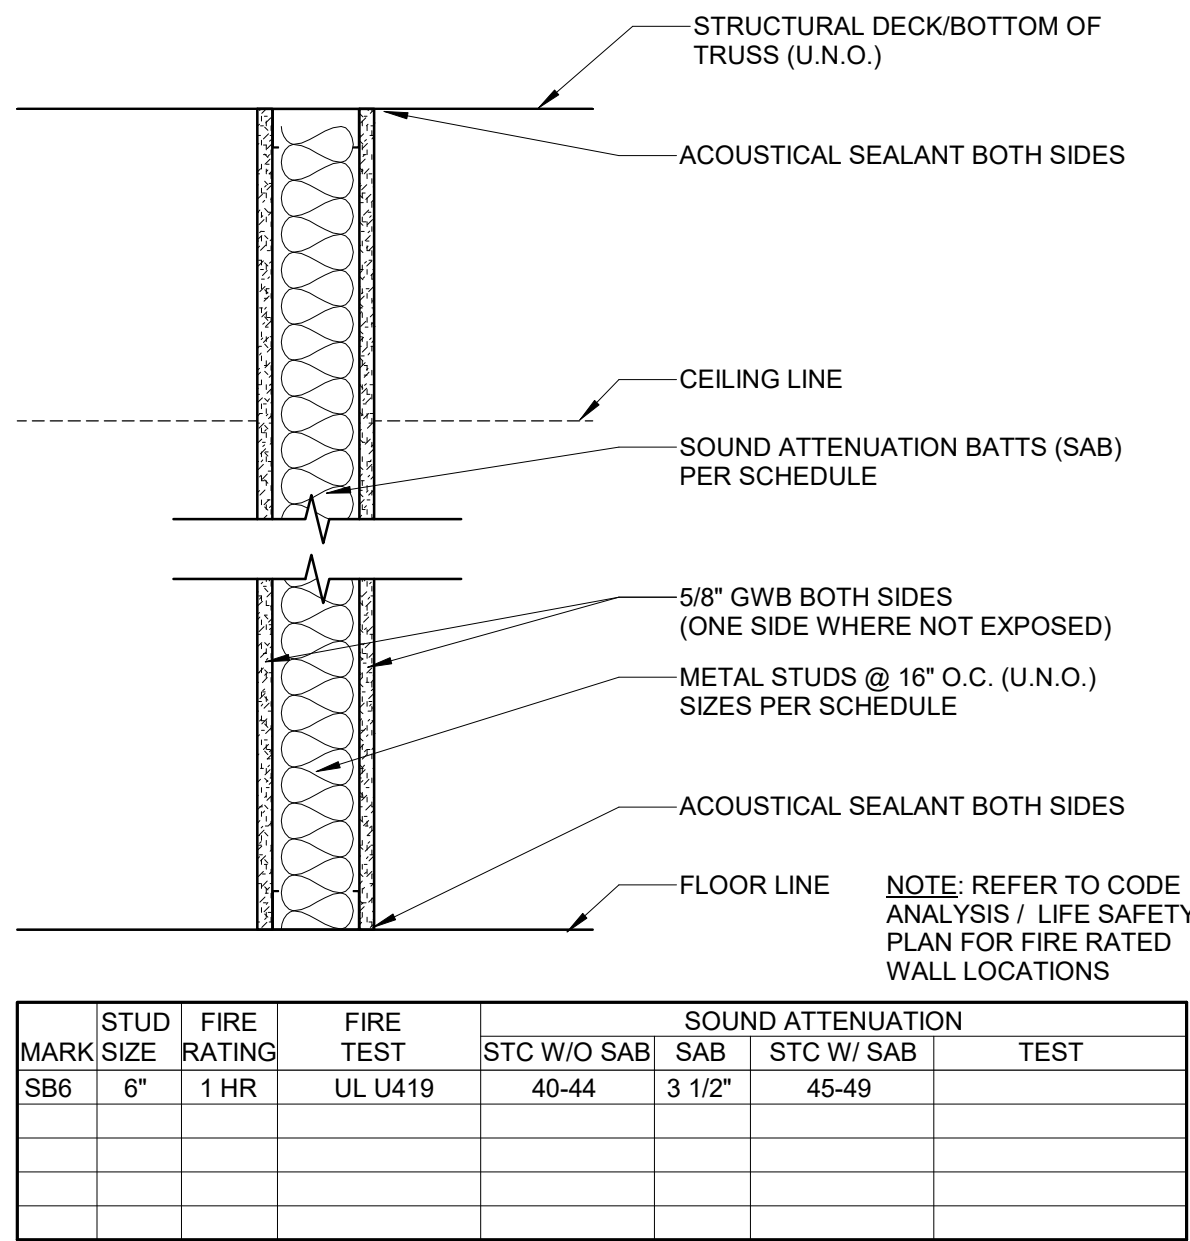


SB 1-HR FIRE RATED WALL
1 1/2" = 1'-0"

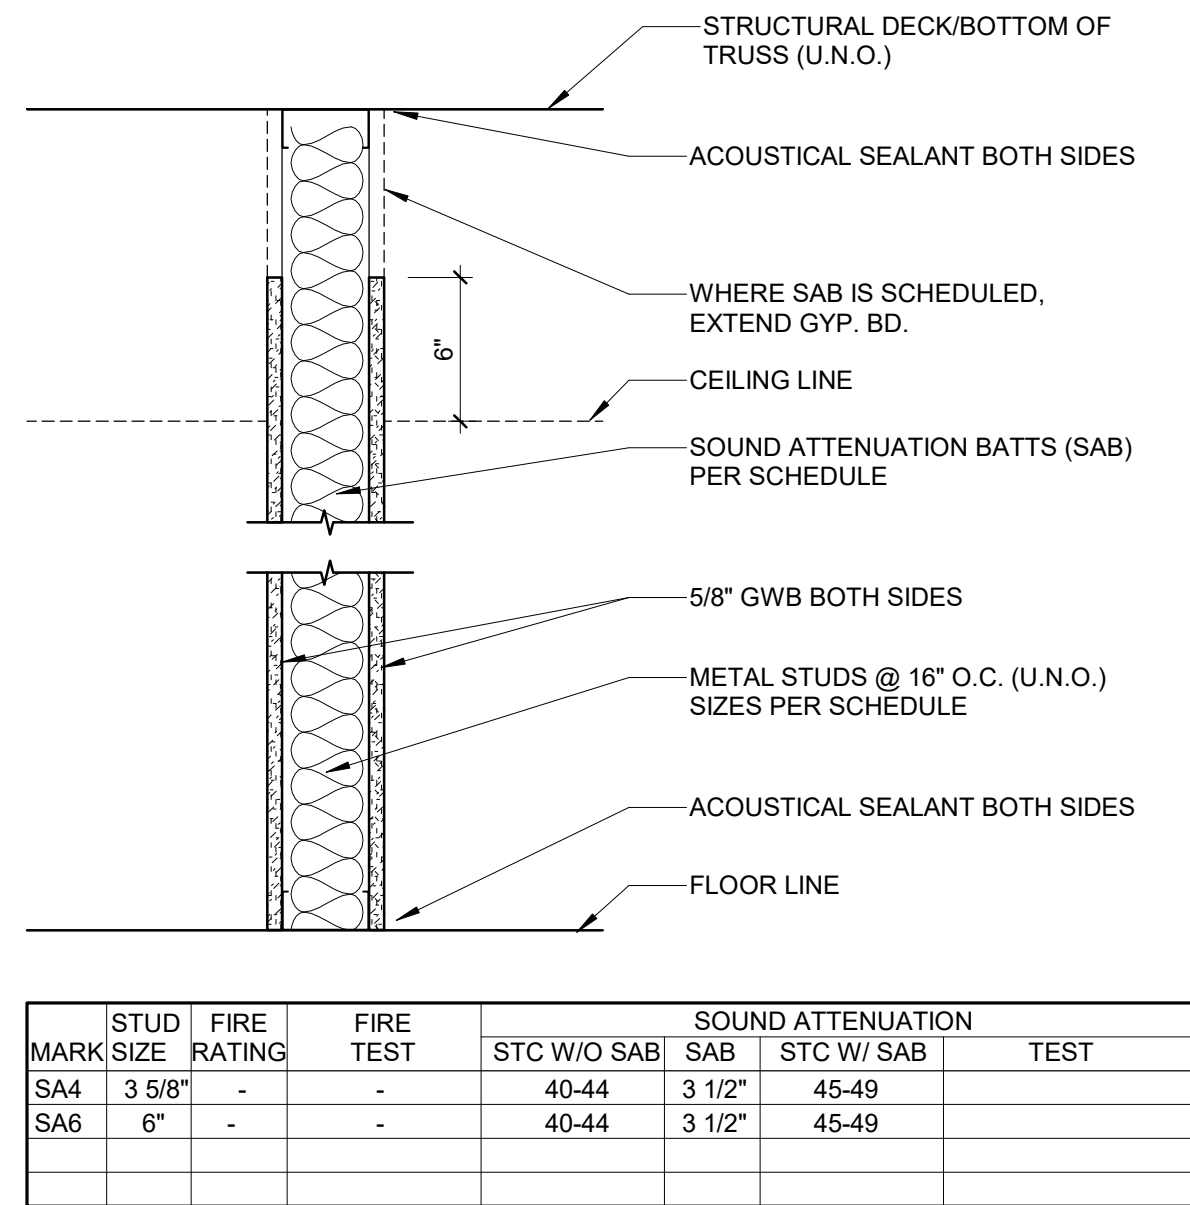


SA NON-FIRE RATED WALL
1 1/2" = 1'-0"

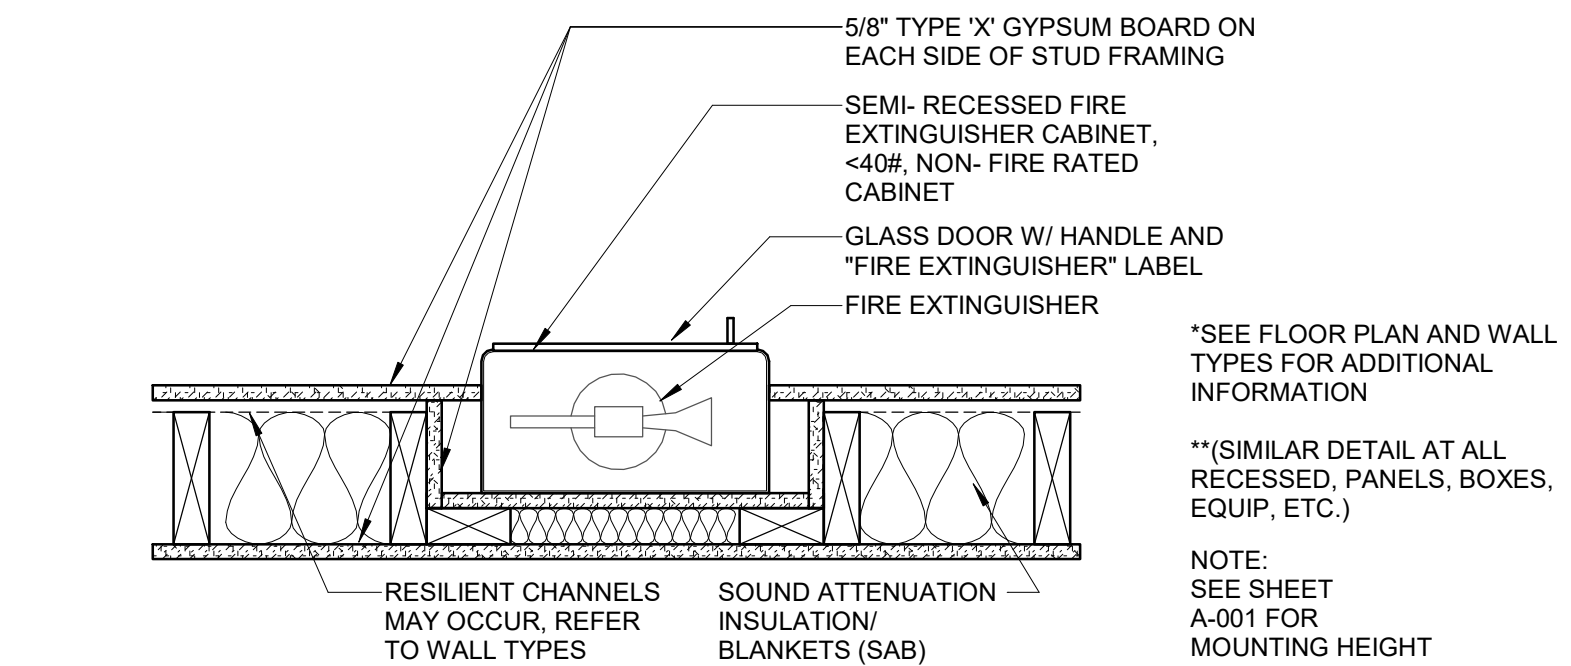


2 FIRE EXTINGUISHER CABINET DETAIL
1 1/2" = 1'-0"

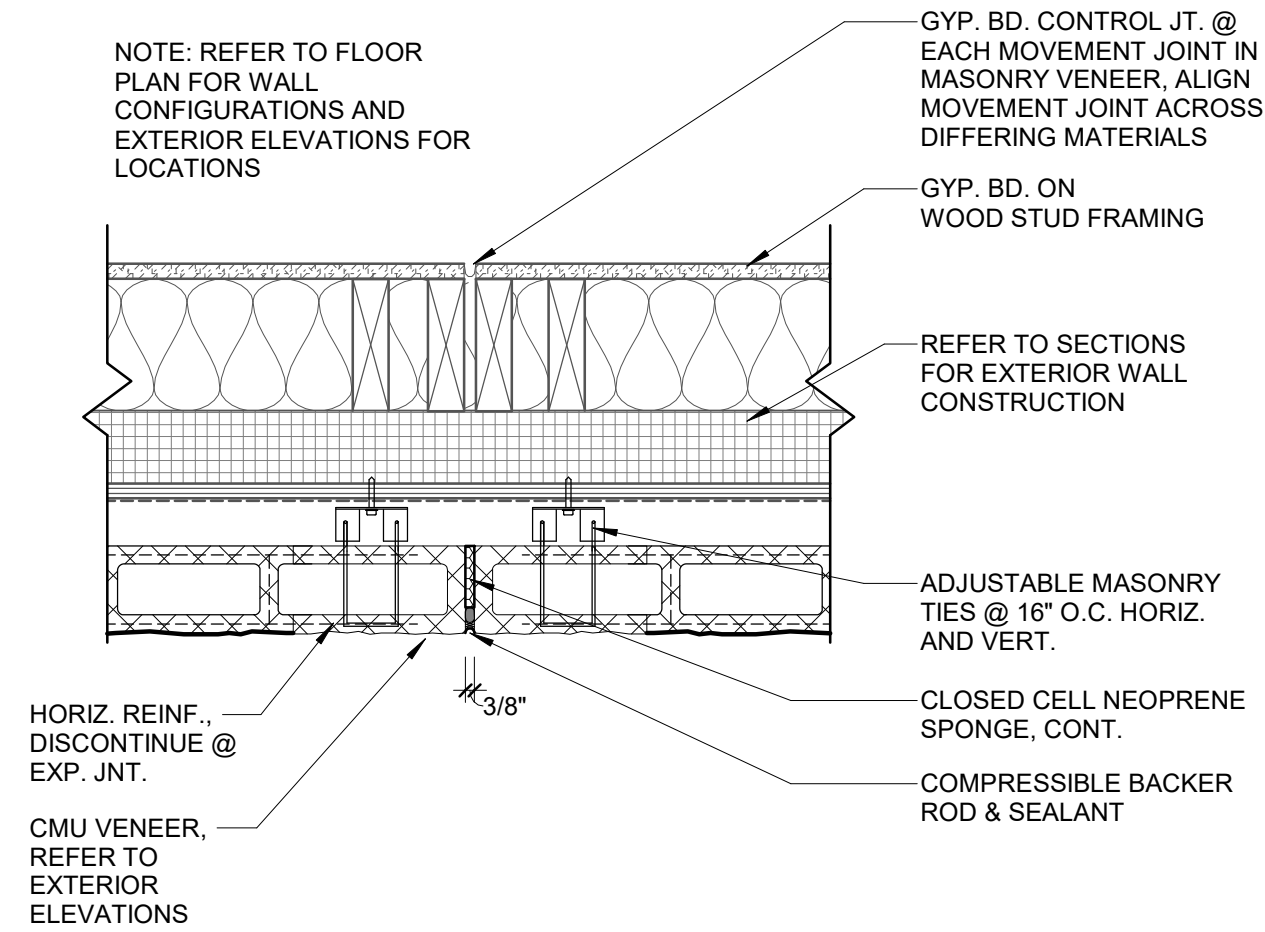

1 CMU CONTROL JOINT
1 1/2" = 1'-0"

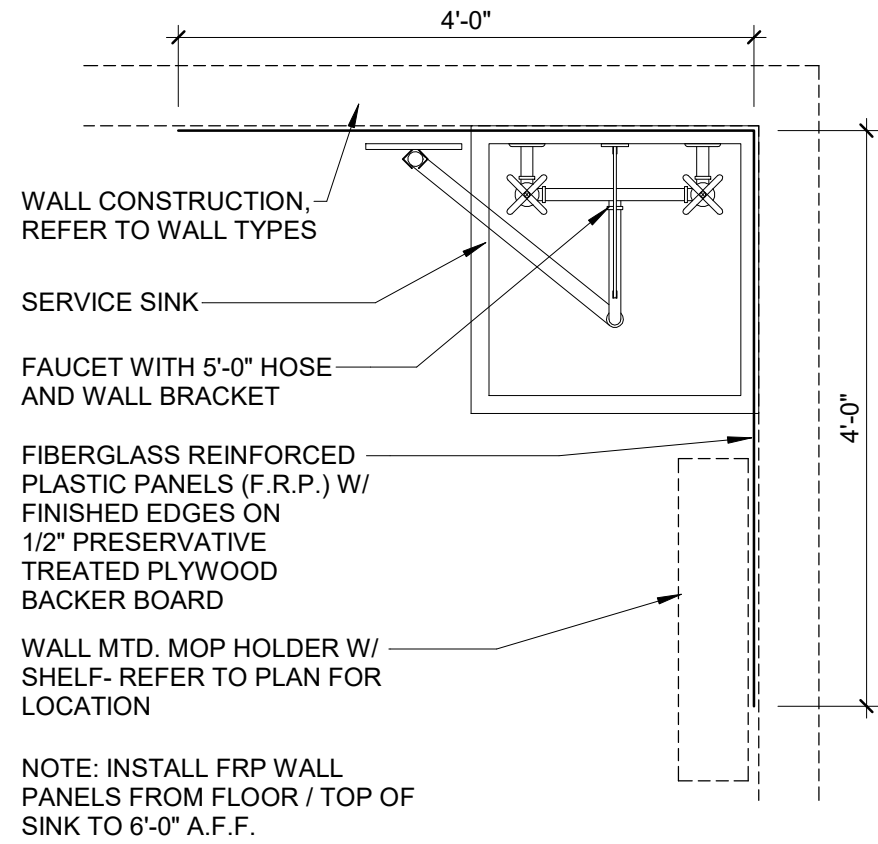

3 JANITOR SINK DETAIL
3/4" = 1'-0"

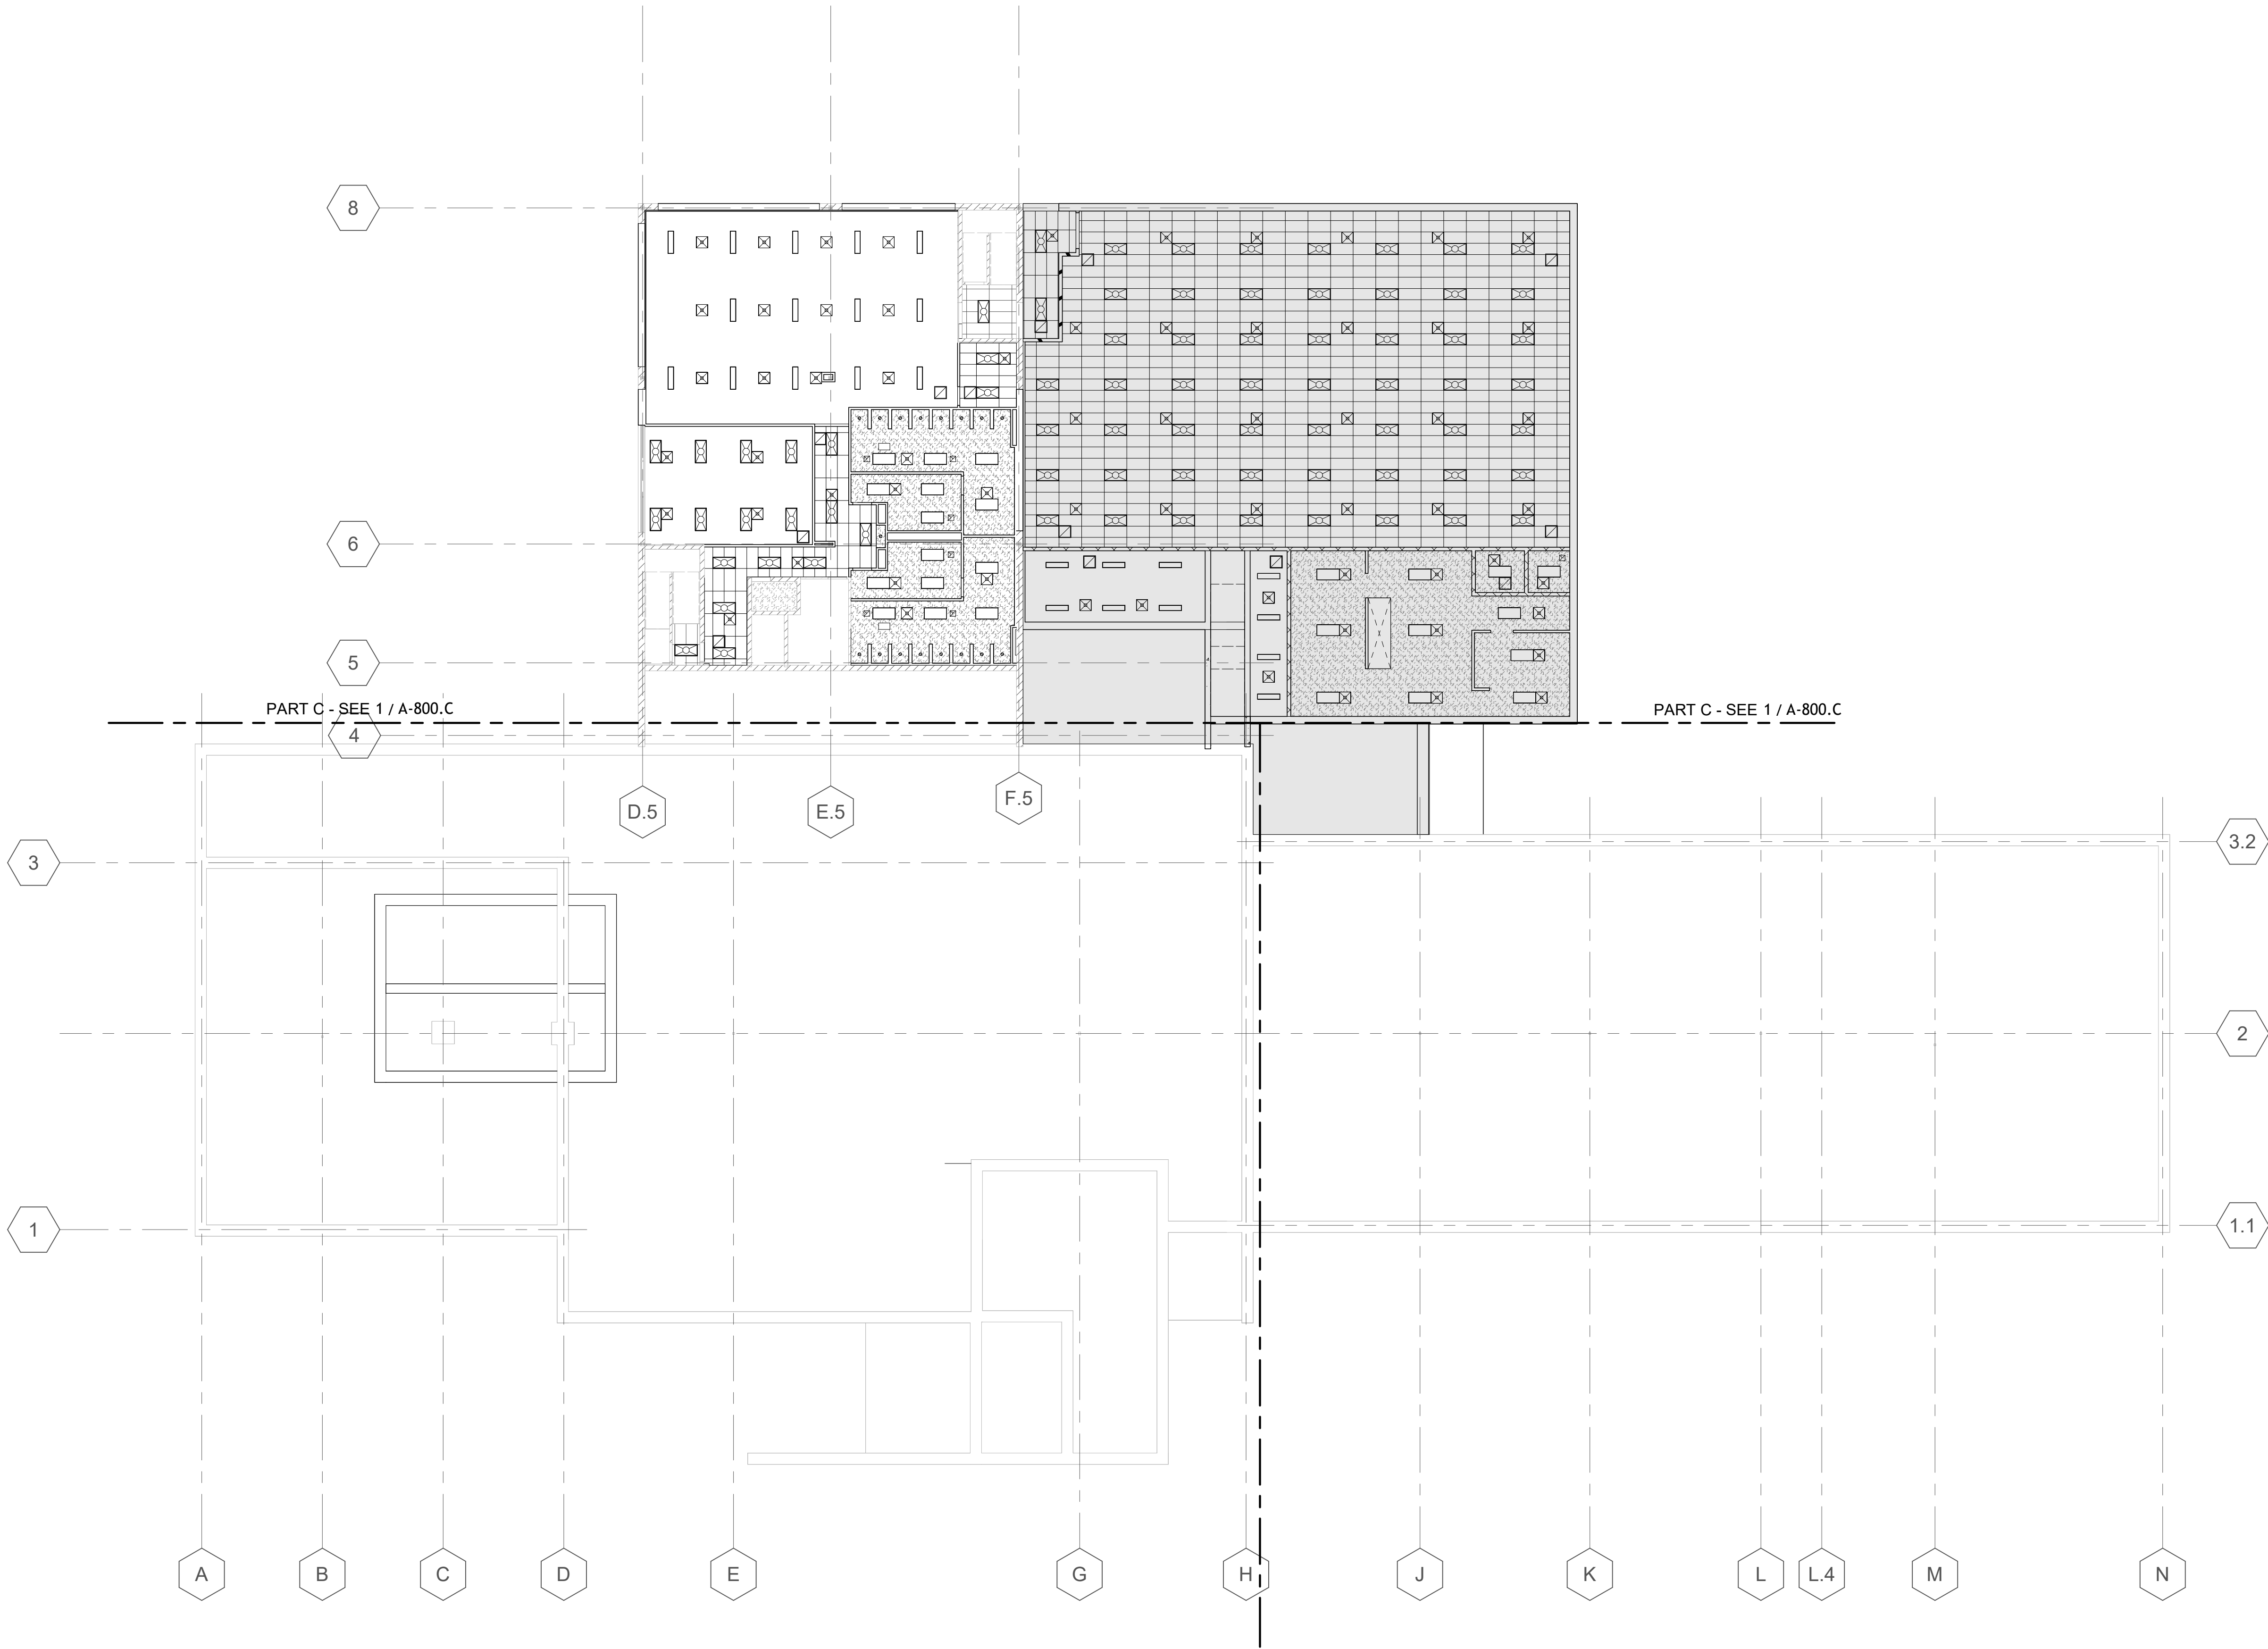

1
A-800
1/16" = 1'-0"


LOWER LEVEL REFLECTED CEILING PLAN

CEILING SCHEDULE

MARK	DESCRIPTION	REMARKS
ACT-1	2' X 4' ACOUSTIC SUSPENDED CEILING - TYPE 1	STANDARD METAL GRID
ACT-2	2' X 2' ACOUSTIC SUSPENDED CEILING - TYPE 2	STANDARD METAL GRID
GB	GYPSUM BOARD ON METAL FRAMING	
GB-SS	GYPSUM BOARD ON METAL SUSPENSION SYSTEM	
STRUC	EXPOSED METAL DECK (PAINTED)	
EXIST	EXISTING CEILING TO REMAIN	

REFLECTED CEILING PLAN
SYMBOLS LEGEND

SYMBOL	DESCRIPTION
	2'-0"x2'-0" LAY-IN CEILING SYSTEM
	2'-0"x4'-0" LAY-IN CEILING SYSTEM
	2' X 2' LAY-IN LIGHT FIXTURE (ACT)
	2' X 2' LAY-IN LIGHT FIXTURE (GWB)
	2' X 4' LAY-IN LIGHT FIXTURE (ACT)
	2' X 4' LAY-IN LIGHT FIXTURE (GWB)
	RECESSED LIGHT FIXTURE (CIRCULAR)
	WALL MOUNTED LIGHT FIXTURE (WALL PACK)
	EXIT SIGN LIGHT FIXTURE (CLG MTD, DIRECTIONAL)
	SUPPLY AIR DIFFUSER
	RETURN AIR/EXHAUST DIFFUSER
	PAINTED DRYWALL (GB-SS) (USE MOISTURE RESIST. GYP. BD. IN TOILET RM'S / LOCKER ROOMS)
	FINISHED CEILING MATERIAL/ ELEVATION

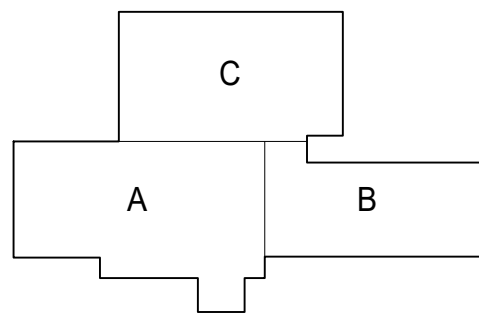

FOR SITE OWNED UTILITIES



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF
SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED,
COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR
WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES MANAGEMENT
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, P.A., DIRECTOR




RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS

2700 W ARGYLE ST., JACKSON, MI

SHEET TITLE: OVERALL LOWER LEVEL REFLECTED CEILING PLAN

DESIGNED	DATE	ISSUED FOR:	DATE
NCHL	01/15/26	PRELIMINARY	01/15/26
DRAWN		CONSTRUCTION	
CHECKED		FINAL RECORD	
APPROVED			

A-800

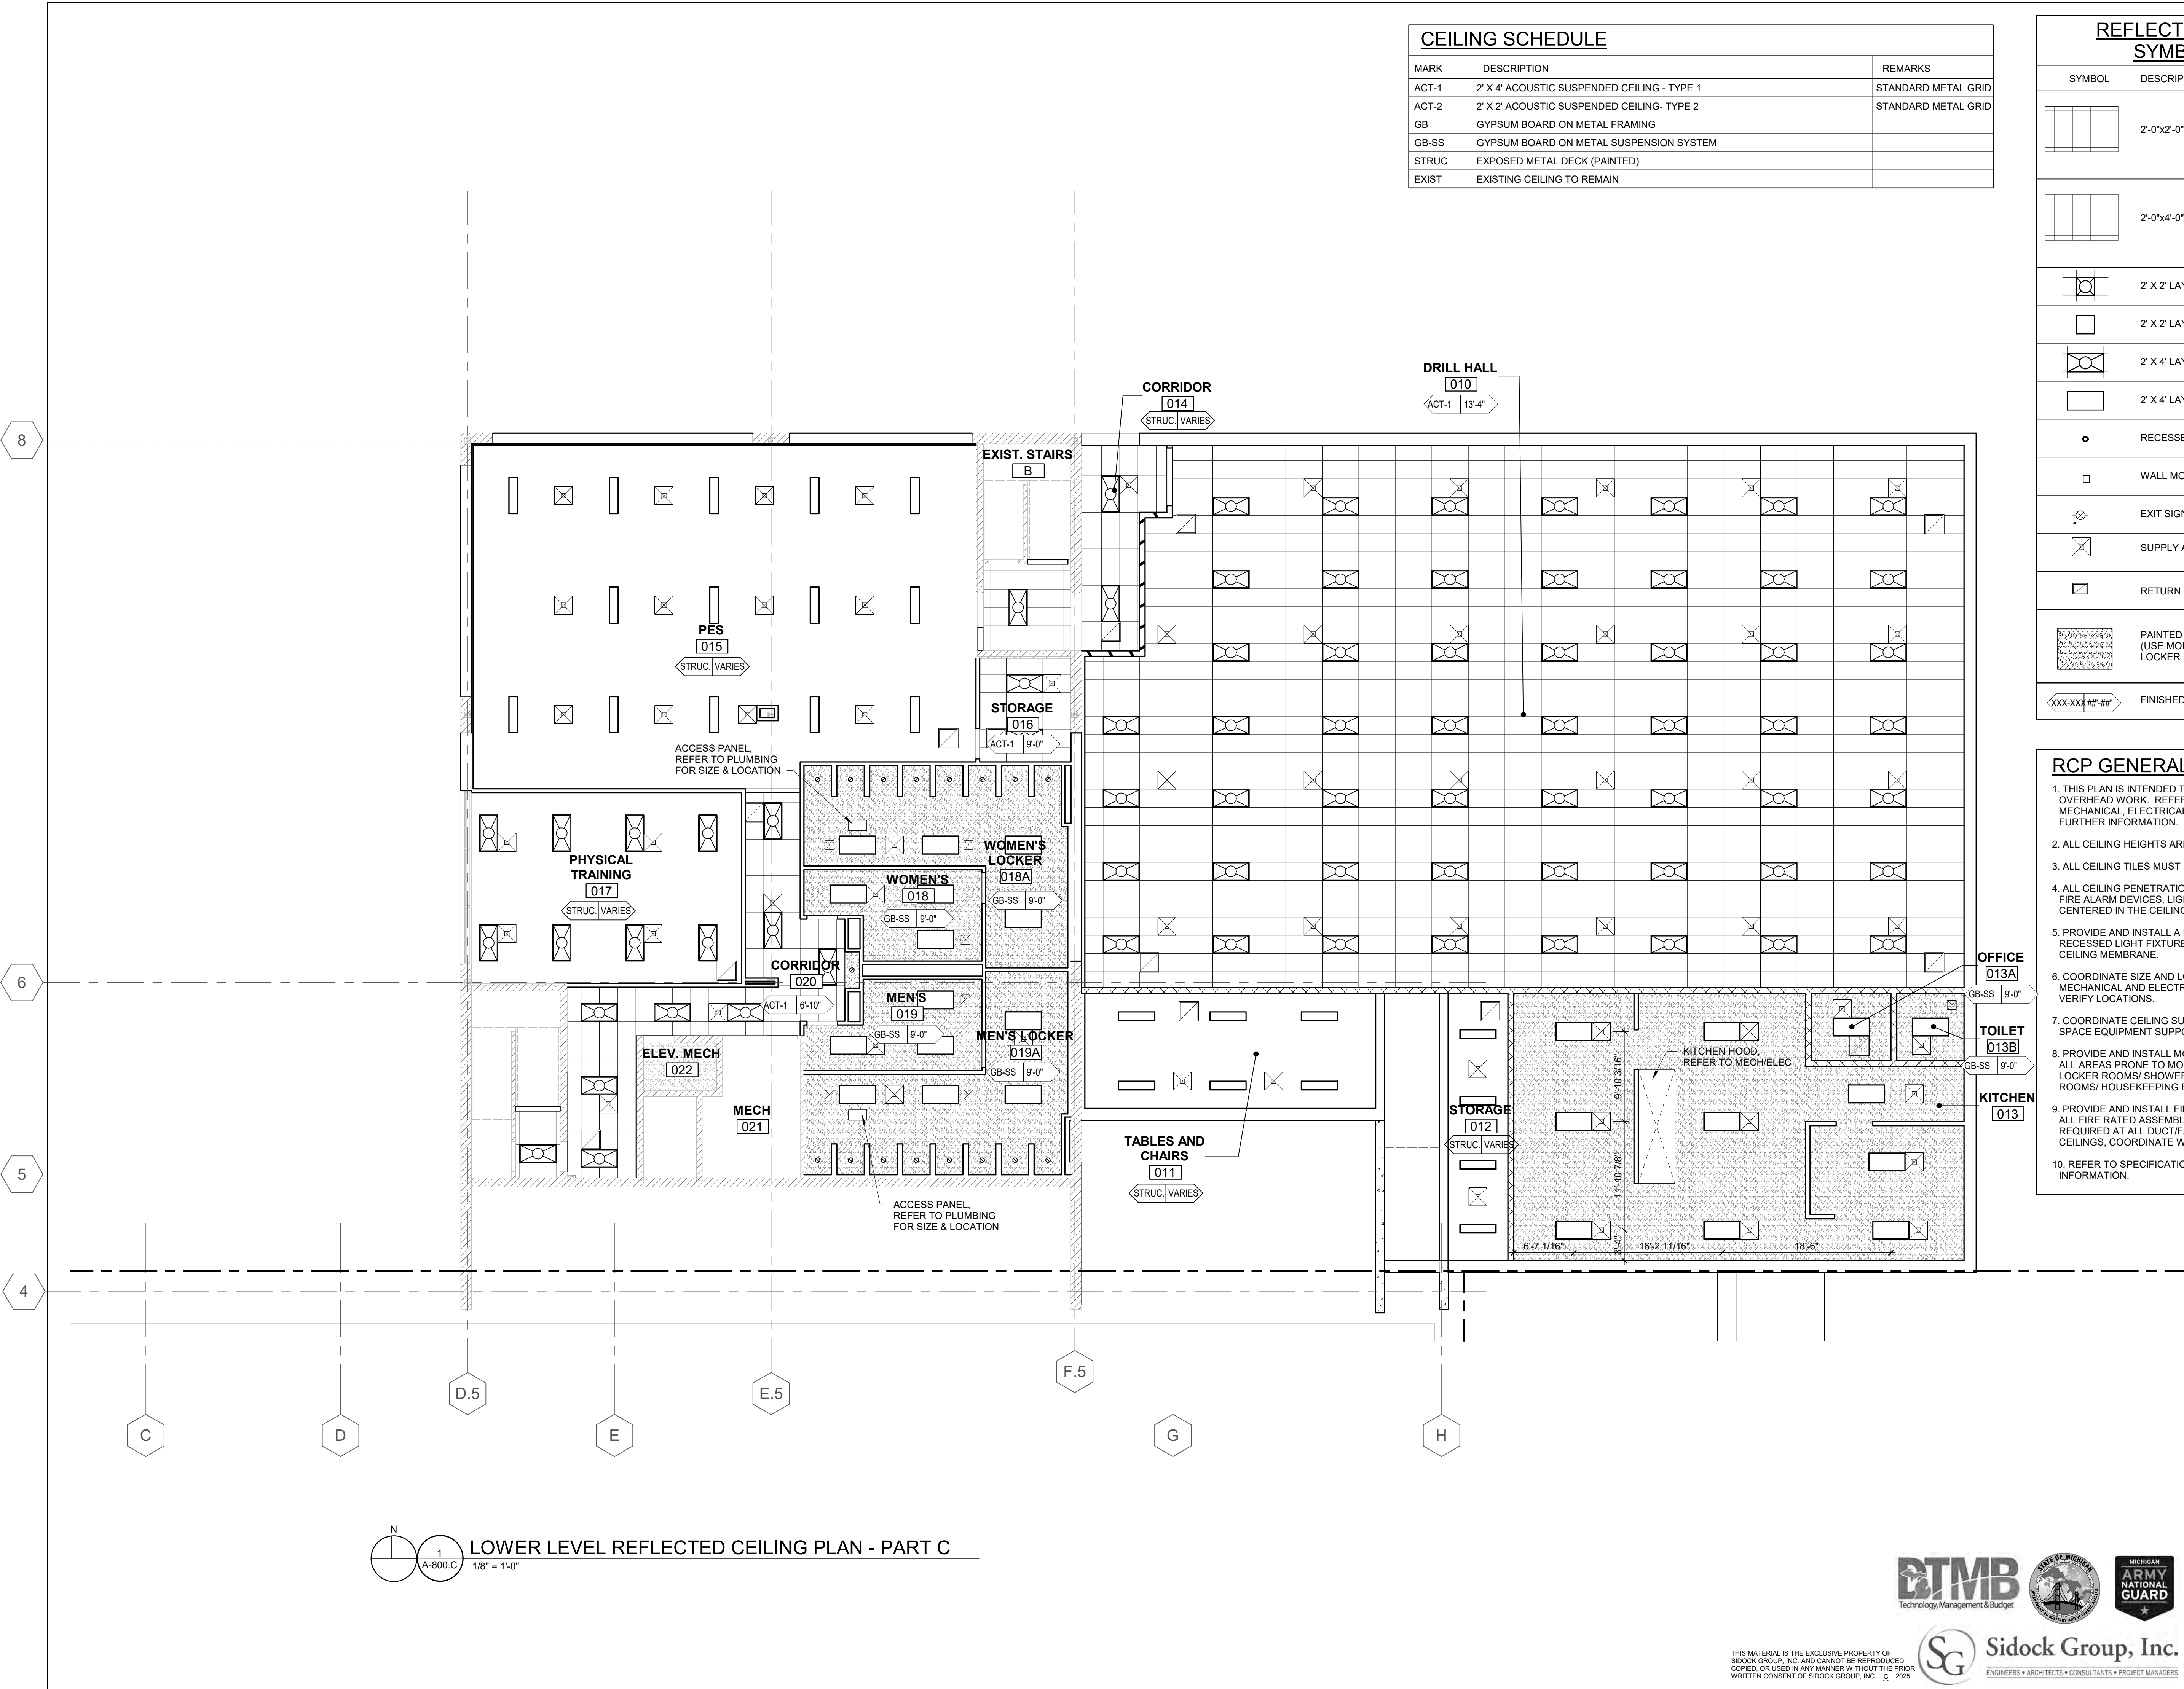


CEILING SCHEDULE		
MARK	DESCRIPTION	REMARKS
ACT-1	2' X 4' ACOUSTIC SUSPENDED CEILING - TYPE 1	STANDARD METAL GRID
ACT-2	2' X 2' ACOUSTIC SUSPENDED CEILING - TYPE 2	STANDARD METAL GRID
GB	GYPSUM BOARD ON METAL FRAMING	
GB-SS	GYPSUM BOARD ON METAL SUSPENSION SYSTEM	
STRUC	EXPOSED METAL DECK (PAINTED)	
EXIST	EXISTING CEILING TO REMAIN	

REFLECTED CEILING PLAN SYMBOLS LEGEND	
SYMBOL	DESCRIPTION
	2'-0"x2'-0" LAY-IN CEILING SYSTEM
	2'-0"x4'-0" LAY-IN CEILING SYSTEM
	2' X 2' LAY-IN LIGHT FIXTURE (ACT)
	2' X 2' LAY-IN LIGHT FIXTURE (GWB)
	2' X 4' LAY-IN LIGHT FIXTURE (ACT)
	2' X 4' LAY-IN LIGHT FIXTURE (GWB)
	RECESSED LIGHT FIXTURE (CIRCULAR)
	WALL MOUNTED LIGHT FIXTURE (WALL PACK)
	EXIT SIGN LIGHT FIXTURE (CLG MTD. DIRECTIONAL)
	SUPPLY AIR DIFFUSER
	RETURN AIR/EXHAUST DIFFUSER
	PAINTED DRYWALL (GB-SS) (USE MOISTURE RESIST. GYP. BD. IN TOILET RM'S./ LOCKER ROOMS)
	FINISHED CEILING MATERIAL/ ELEVATION

- RCP GENERAL NOTES:**
- THIS PLAN IS INTENDED TO SHOW GENERAL COORDINATION OF OVERHEAD WORK. REFER TO STRUCTURAL, PLUMBING, MECHANICAL, ELECTRICAL & LOW VOLTAGE DRAWINGS FOR FURTHER INFORMATION.
 - ALL CEILING HEIGHTS ARE FINISH DIMENSIONS.
 - ALL CEILING TILES MUST BE CENTERED IN ROOM.
 - ALL CEILING PENETRATIONS INCLUDING FIRE PROTECTION HEADS, FIRE ALARM DEVICES, LIGHT FIXTURES, SPEAKERS, ETC. MUST BE CENTERED IN THE CEILING TILE.
 - PROVIDE AND INSTALL A FIRE RATED ENCLOSURE ABOVE ALL RECESSED LIGHT FIXTURES WHICH PENETRATE A FIRE RATED CEILING MEMBRANE.
 - COORDINATE SIZE AND LOCATION OF ALL ACCESS PANELS WITH MECHANICAL AND ELECTRICAL DRAWINGS. ARCHITECT TO FIELD VERIFY LOCATIONS.
 - COORDINATE CEILING SUSPENSION SYSTEM WITH OTHER CEILING SPACE EQUIPMENT SUPPORTING DEVICES.
 - PROVIDE AND INSTALL MOISTURE RESISTANT GYPSUM BOARD AT ALL AREAS PRONE TO MOISTURE, I.E. PUBLIC TOILET ROOMS, LOCKER ROOMS/ SHOWER ROOMS, MECHANICAL ROOMS, JANITOR ROOMS/ HOUSEKEEPING ROOMS, ETC., U.N.O.
 - PROVIDE AND INSTALL FIRE DAMPERS AT DUCT PENETRATIONS OF ALL FIRE RATED ASSEMBLIES. CEILING RADIATION DAMPERS ARE REQUIRED AT ALL DUCT/FAN PENETRATIONS OF THE FIRE RATED CEILINGS. COORDINATE WITH MECHANICAL DRAWINGS.
 - REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

1
A-800.C
1/8" = 1'-0"

LOWER LEVEL REFLECTED CEILING PLAN - PART C

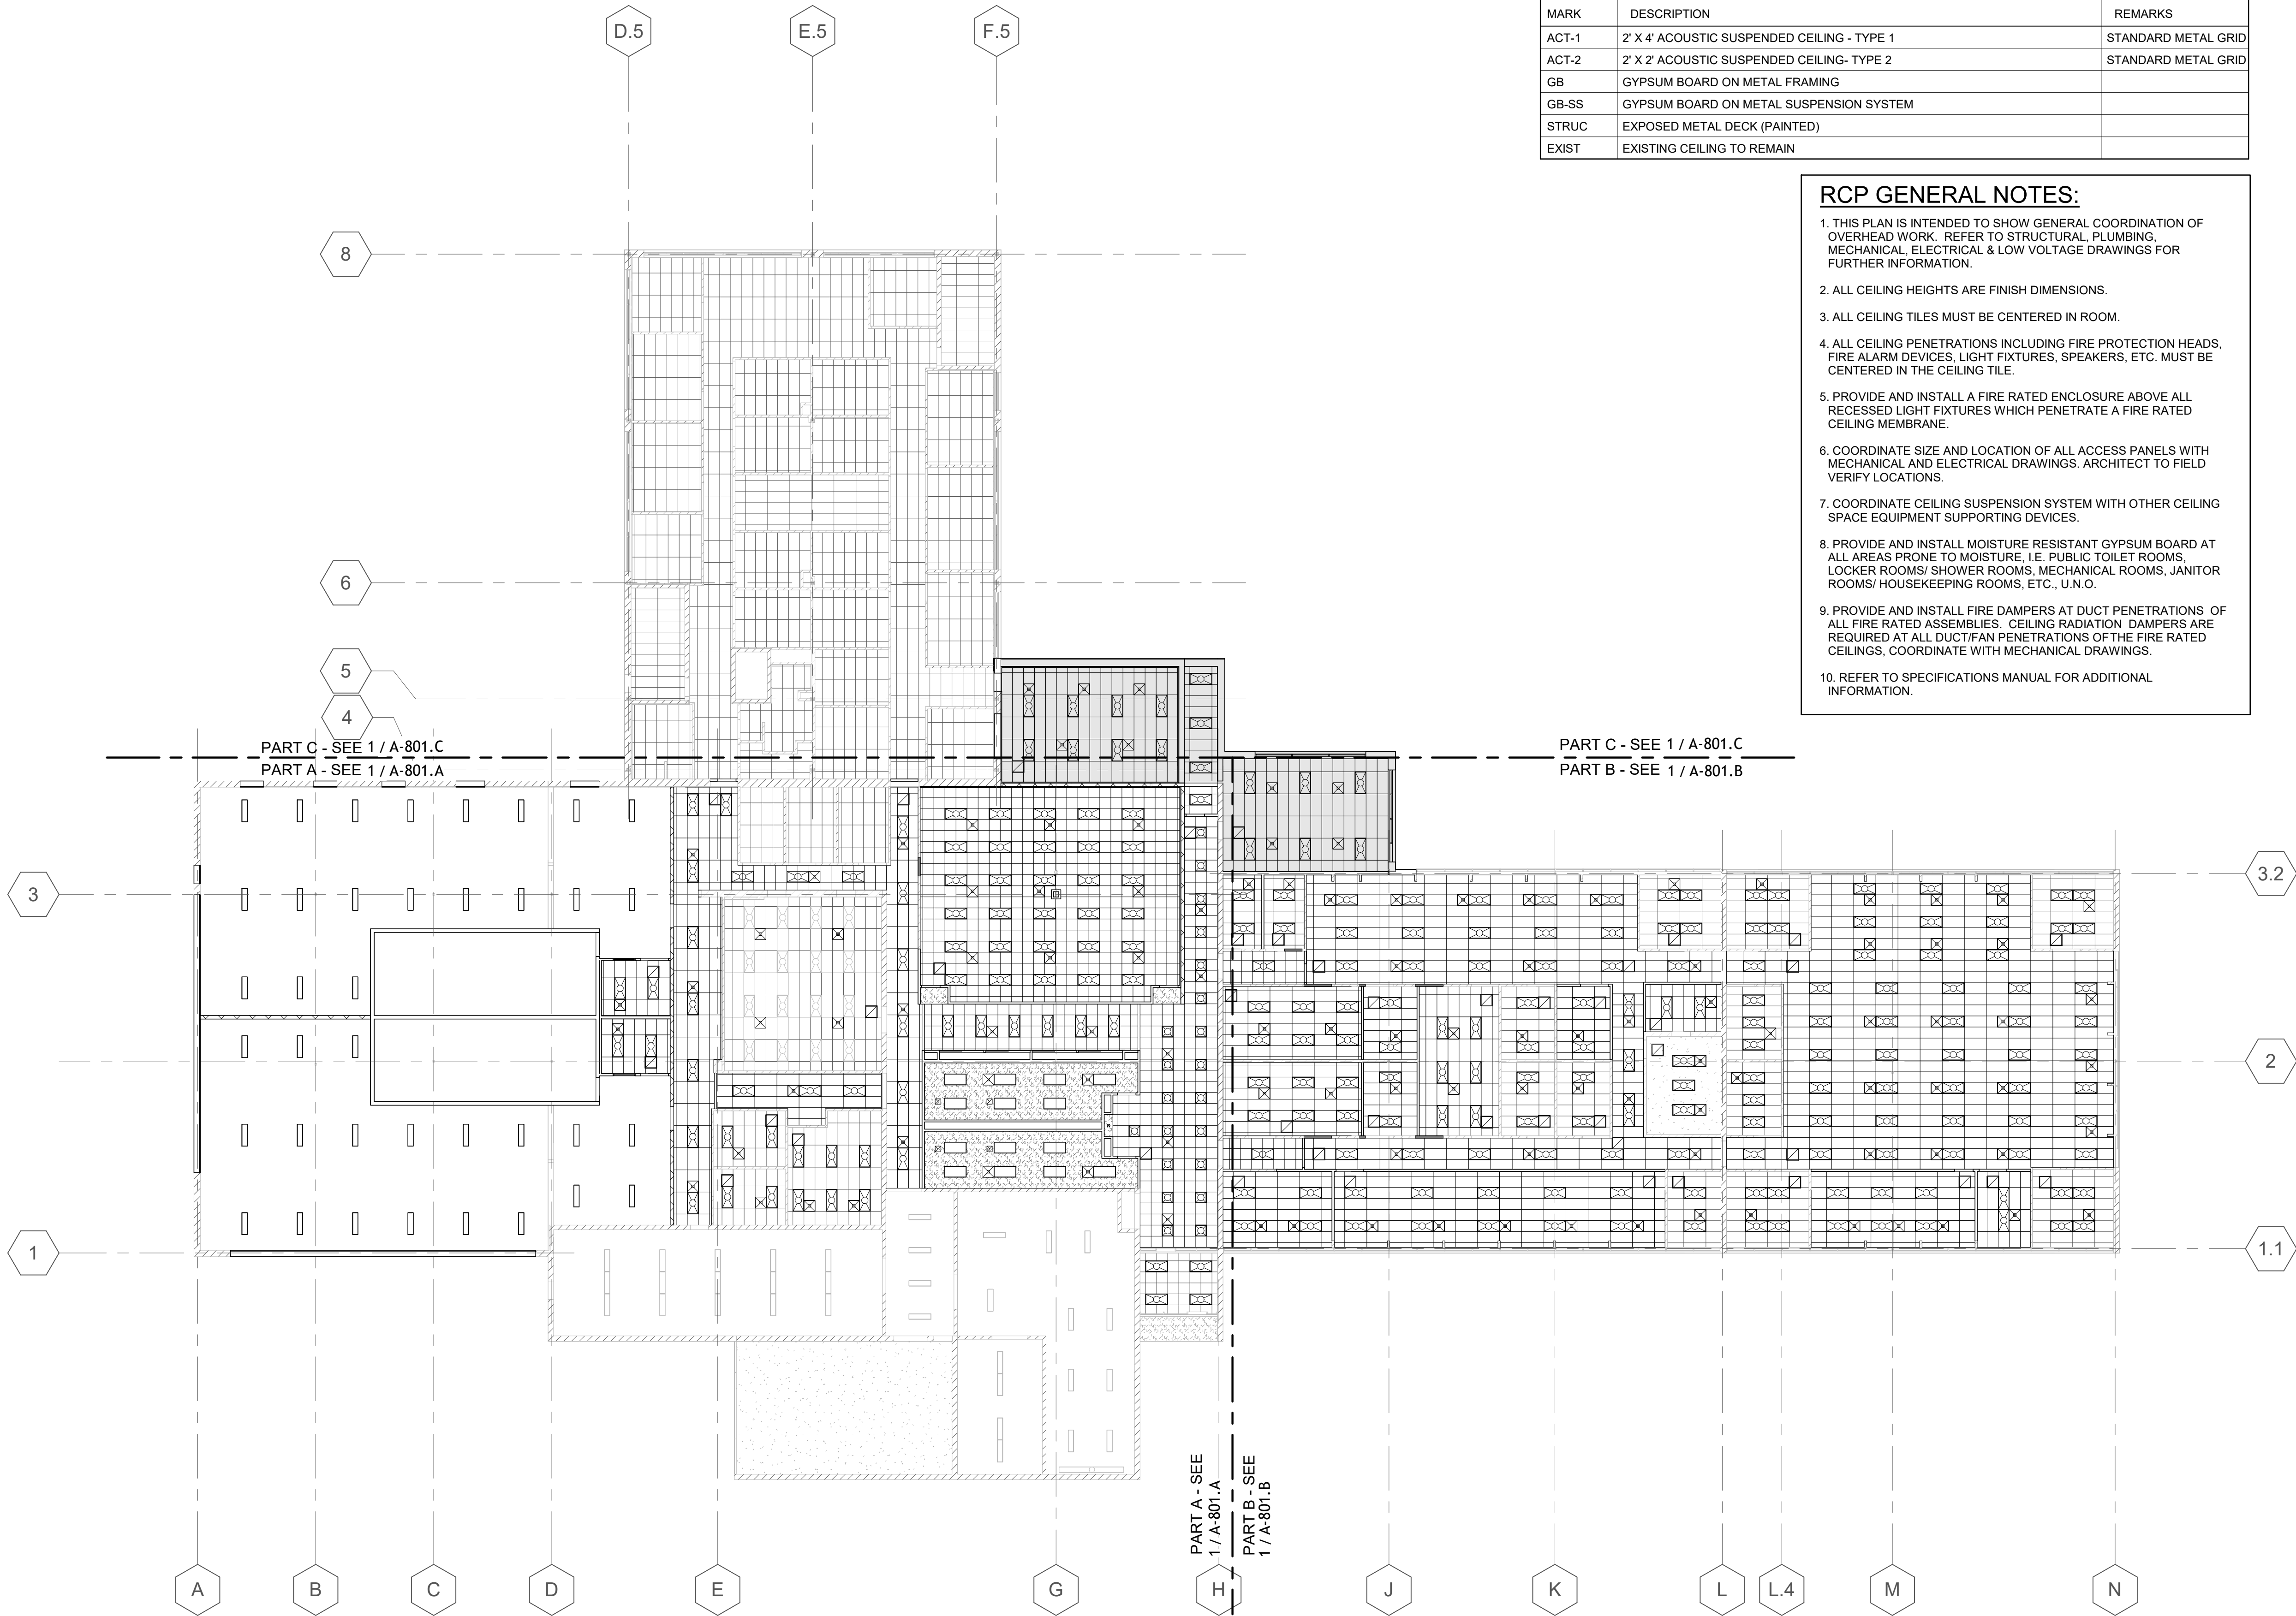






CEILING SCHEDULE

MARK	DESCRIPTION	REMARKS
ACT-1	2' X 4' ACOUSTIC SUSPENDED CEILING - TYPE 1	STANDARD METAL GRID
ACT-2	2' X 2' ACOUSTIC SUSPENDED CEILING- TYPE 2	STANDARD METAL GRID
GB	GYPSUM BOARD ON METAL FRAMING	
GB-SS	GYPSUM BOARD ON METAL SUSPENSION SYSTEM	
STRUC	EXPOSED METAL DECK (PAINTED)	
EXIST	EXISTING CEILING TO REMAIN	


RCP GENERAL NOTES:

1. THIS PLAN IS INTENDED TO SHOW GENERAL COORDINATION OF OVERHEAD WORK. REFER TO STRUCTURAL, PLUMBING, MECHANICAL, ELECTRICAL & LOW VOLTAGE DRAWINGS FOR FURTHER INFORMATION.
2. ALL CEILING HEIGHTS ARE FINISH DIMENSIONS.
3. ALL CEILING TILES MUST BE CENTERED IN ROOM.
4. ALL CEILING PENETRATIONS INCLUDING FIRE PROTECTION HEADS, FIRE ALARM DEVICES, LIGHT FIXTURES, SPEAKERS, ETC. MUST BE CENTERED IN THE CEILING TILE.
5. PROVIDE AND INSTALL A FIRE RATED ENCLOSURE ABOVE ALL RECESSED LIGHT FIXTURES WHICH PENETRATE A FIRE RATED CEILING MEMBRANE.
6. COORDINATE SIZE AND LOCATION OF ALL ACCESS PANELS WITH MECHANICAL AND ELECTRICAL DRAWINGS. ARCHITECT TO FIELD VERIFY LOCATIONS.
7. COORDINATE CEILING SUSPENSION SYSTEM WITH OTHER CEILING SPACE EQUIPMENT SUPPORTING DEVICES.
8. PROVIDE AND INSTALL MOISTURE RESISTANT GYPSUM BOARD AT ALL AREAS PRONE TO MOISTURE, I.E. PUBLIC TOILET ROOMS, LOCKER ROOMS/ SHOWER ROOMS, MECHANICAL ROOMS, JANITOR ROOMS/ HOUSEKEEPING ROOMS, ETC., U.N.O.
9. PROVIDE AND INSTALL FIRE DAMPERS AT DUCT PENETRATIONS OF ALL FIRE RATED ASSEMBLIES. CEILING RADIATION DAMPERS ARE REQUIRED AT ALL DUCT/FAN PENETRATIONS OF THE FIRE RATED CEILINGS. COORDINATE WITH MECHANICAL DRAWINGS.
10. REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

REFLECTED CEILING PLAN SYMBOLS LEGEND

SYMBOL	DESCRIPTION
	2'-0"x2'-0" LAY-IN CEILING SYSTEM
	2'-0"x4'-0" LAY-IN CEILING SYSTEM
	2' X 2' LAY-IN LIGHT FIXTURE (ACT)
	2' X 2' LAY-IN LIGHT FIXTURE (GWB)
	2' X 4' LAY-IN LIGHT FIXTURE (ACT)
	2' X 4' LAY-IN LIGHT FIXTURE (GWB)
	RECESSED LIGHT FIXTURE (CIRCULAR)
	WALL MOUNTED LIGHT FIXTURE (WALL PACK)
	EXIT SIGN LIGHT FIXTURE (CLG MTD, DIRECTIONAL)
	SUPPLY AIR DIFFUSER
	RETURN AIR/EXHAUST DIFFUSER
	PAINTED DRYWALL (GB-SS) (USE MOISTURE RESIST. GYP. BD. IN TOILET RM'S/ LOCKER ROOMS)
	FINISHED CEILING MATERIAL/ ELEVATION

1
A-801
1/16" = 1'-0"

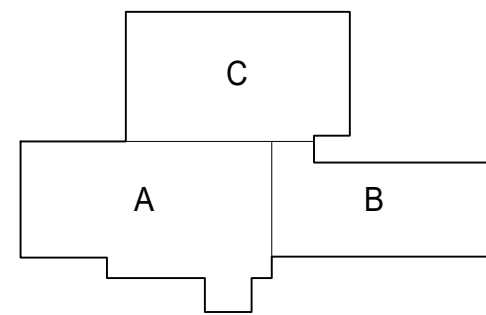

MISSDIG811

FOR SITE OWNED UTILITIES

72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIG
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF
SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED,
COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR
WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

CEILING SCHEDULE

MARK	DESCRIPTION	REMARKS
ACT-1	2' X 4' ACOUSTIC SUSPENDED CEILING - TYPE 1	STANDARD METAL GRID
ACT-2	2' X 2' ACOUSTIC SUSPENDED CEILING - TYPE 2	STANDARD METAL GRID
GB	GYPSUM BOARD ON METAL FRAMING	
GB-SS	GYPSUM BOARD ON METAL SUSPENSION SYSTEM	
STRUC	EXPOSED METAL DECK (PAINTED)	
EXIST	EXISTING CEILING TO REMAIN	

REFLECTED CEILING PLAN
SYMBOLS LEGEND


SYMBOL	DESCRIPTION
	2'-0"x2'-0" LAY-IN CEILING SYSTEM
	2'-0"x4'-0" LAY-IN CEILING SYSTEM
	2' X 2' LAY-IN LIGHT FIXTURE (ACT)
	2' X 2' LAY-IN LIGHT FIXTURE (GWB)
	2' X 4' LAY-IN LIGHT FIXTURE (ACT)
	2' X 4' LAY-IN LIGHT FIXTURE (GWB)
	RECESSED LIGHT FIXTURE (CIRCULAR)
	WALL MOUNTED LIGHT FIXTURE (WALL PACK)
	EXIT SIGN LIGHT FIXTURE (CLG MTD, DIRECTIONAL)
	SUPPLY AIR DIFFUSER
	RETURN AIR/EXHAUST DIFFUSER
	PAINTED DRYWALL (GB-SS) (USE MOISTURE RESIST. GYP. BD. IN TOILET RMs./ LOCKER ROOMS)
	FINISHED CEILING MATERIAL/ ELEVATION

RCP GENERAL NOTES:

- THIS PLAN IS INTENDED TO SHOW GENERAL COORDINATION OF OVERHEAD WORK. REFER TO STRUCTURAL, PLUMBING, MECHANICAL, ELECTRICAL & LOW VOLTAGE DRAWINGS FOR FURTHER INFORMATION.
- ALL CEILING HEIGHTS ARE FINISH DIMENSIONS.
- ALL CEILING TILES MUST BE CENTERED IN ROOM.
- ALL CEILING PENETRATIONS INCLUDING FIRE PROTECTION HEADS, FIRE ALARM DEVICES, LIGHT FIXTURES, SPEAKERS, ETC. MUST BE CENTERED IN THE CEILING TILE.
- PROVIDE AND INSTALL A FIRE RATED ENCLOSURE ABOVE ALL RECESSED LIGHT FIXTURES WHICH PENETRATE A FIRE RATED CEILING MEMBRANE.
- COORDINATE SIZE AND LOCATION OF ALL ACCESS PANELS WITH MECHANICAL AND ELECTRICAL DRAWINGS. ARCHITECT TO FIELD VERIFY LOCATIONS.
- COORDINATE CEILING SUSPENSION SYSTEM WITH OTHER CEILING SPACE EQUIPMENT SUPPORTING DEVICES.
- PROVIDE AND INSTALL MOISTURE RESISTANT GYPSUM BOARD AT ALL AREAS PRONE TO MOISTURE, I.E. PUBLIC TOILET ROOMS, LOCKER ROOMS/ SHOWER ROOMS, MECHANICAL ROOMS, JANITOR ROOMS/ HOUSEKEEPING ROOMS, ETC., U.N.O.
- PROVIDE AND INSTALL FIRE DAMPERS AT DUCT PENETRATIONS OF ALL FIRE RATED ASSEMBLIES. CEILING RADIATION DAMPERS ARE REQUIRED AT ALL DUCT/FAN PENETRATIONS OF THE FIRE RATED CEILINGS, COORDINATE WITH MECHANICAL DRAWINGS.
- REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.



MAIN LEVEL REFLECTED CEILING PLAN - PART A

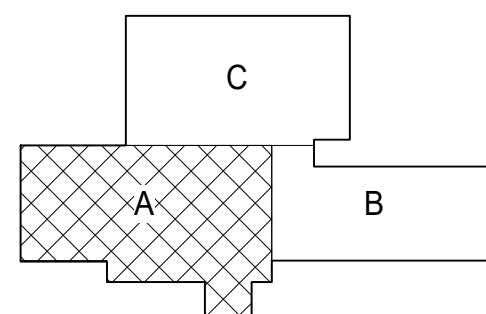

MISSDIG811

FOR SITE OWNED UTILITIES


72 HOURS
(3 WORKING DAYS)

BEFORE YOU DIG

CALL MR. ZIMMERMAN
PH: (248) 606-8821

FACILITIES MANAGEMENT

Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERSTHIS MATERIAL IS THE EXCLUSIVE PROPERTY OF
SIDOCK GROUP, INC. AND CANNOT BE REPRODUCED,
COPIED, OR USED IN ANY MANNER WITHOUT THE PRIOR
WRITTEN CONSENT OF SIDOCK GROUP, INC. © 2025

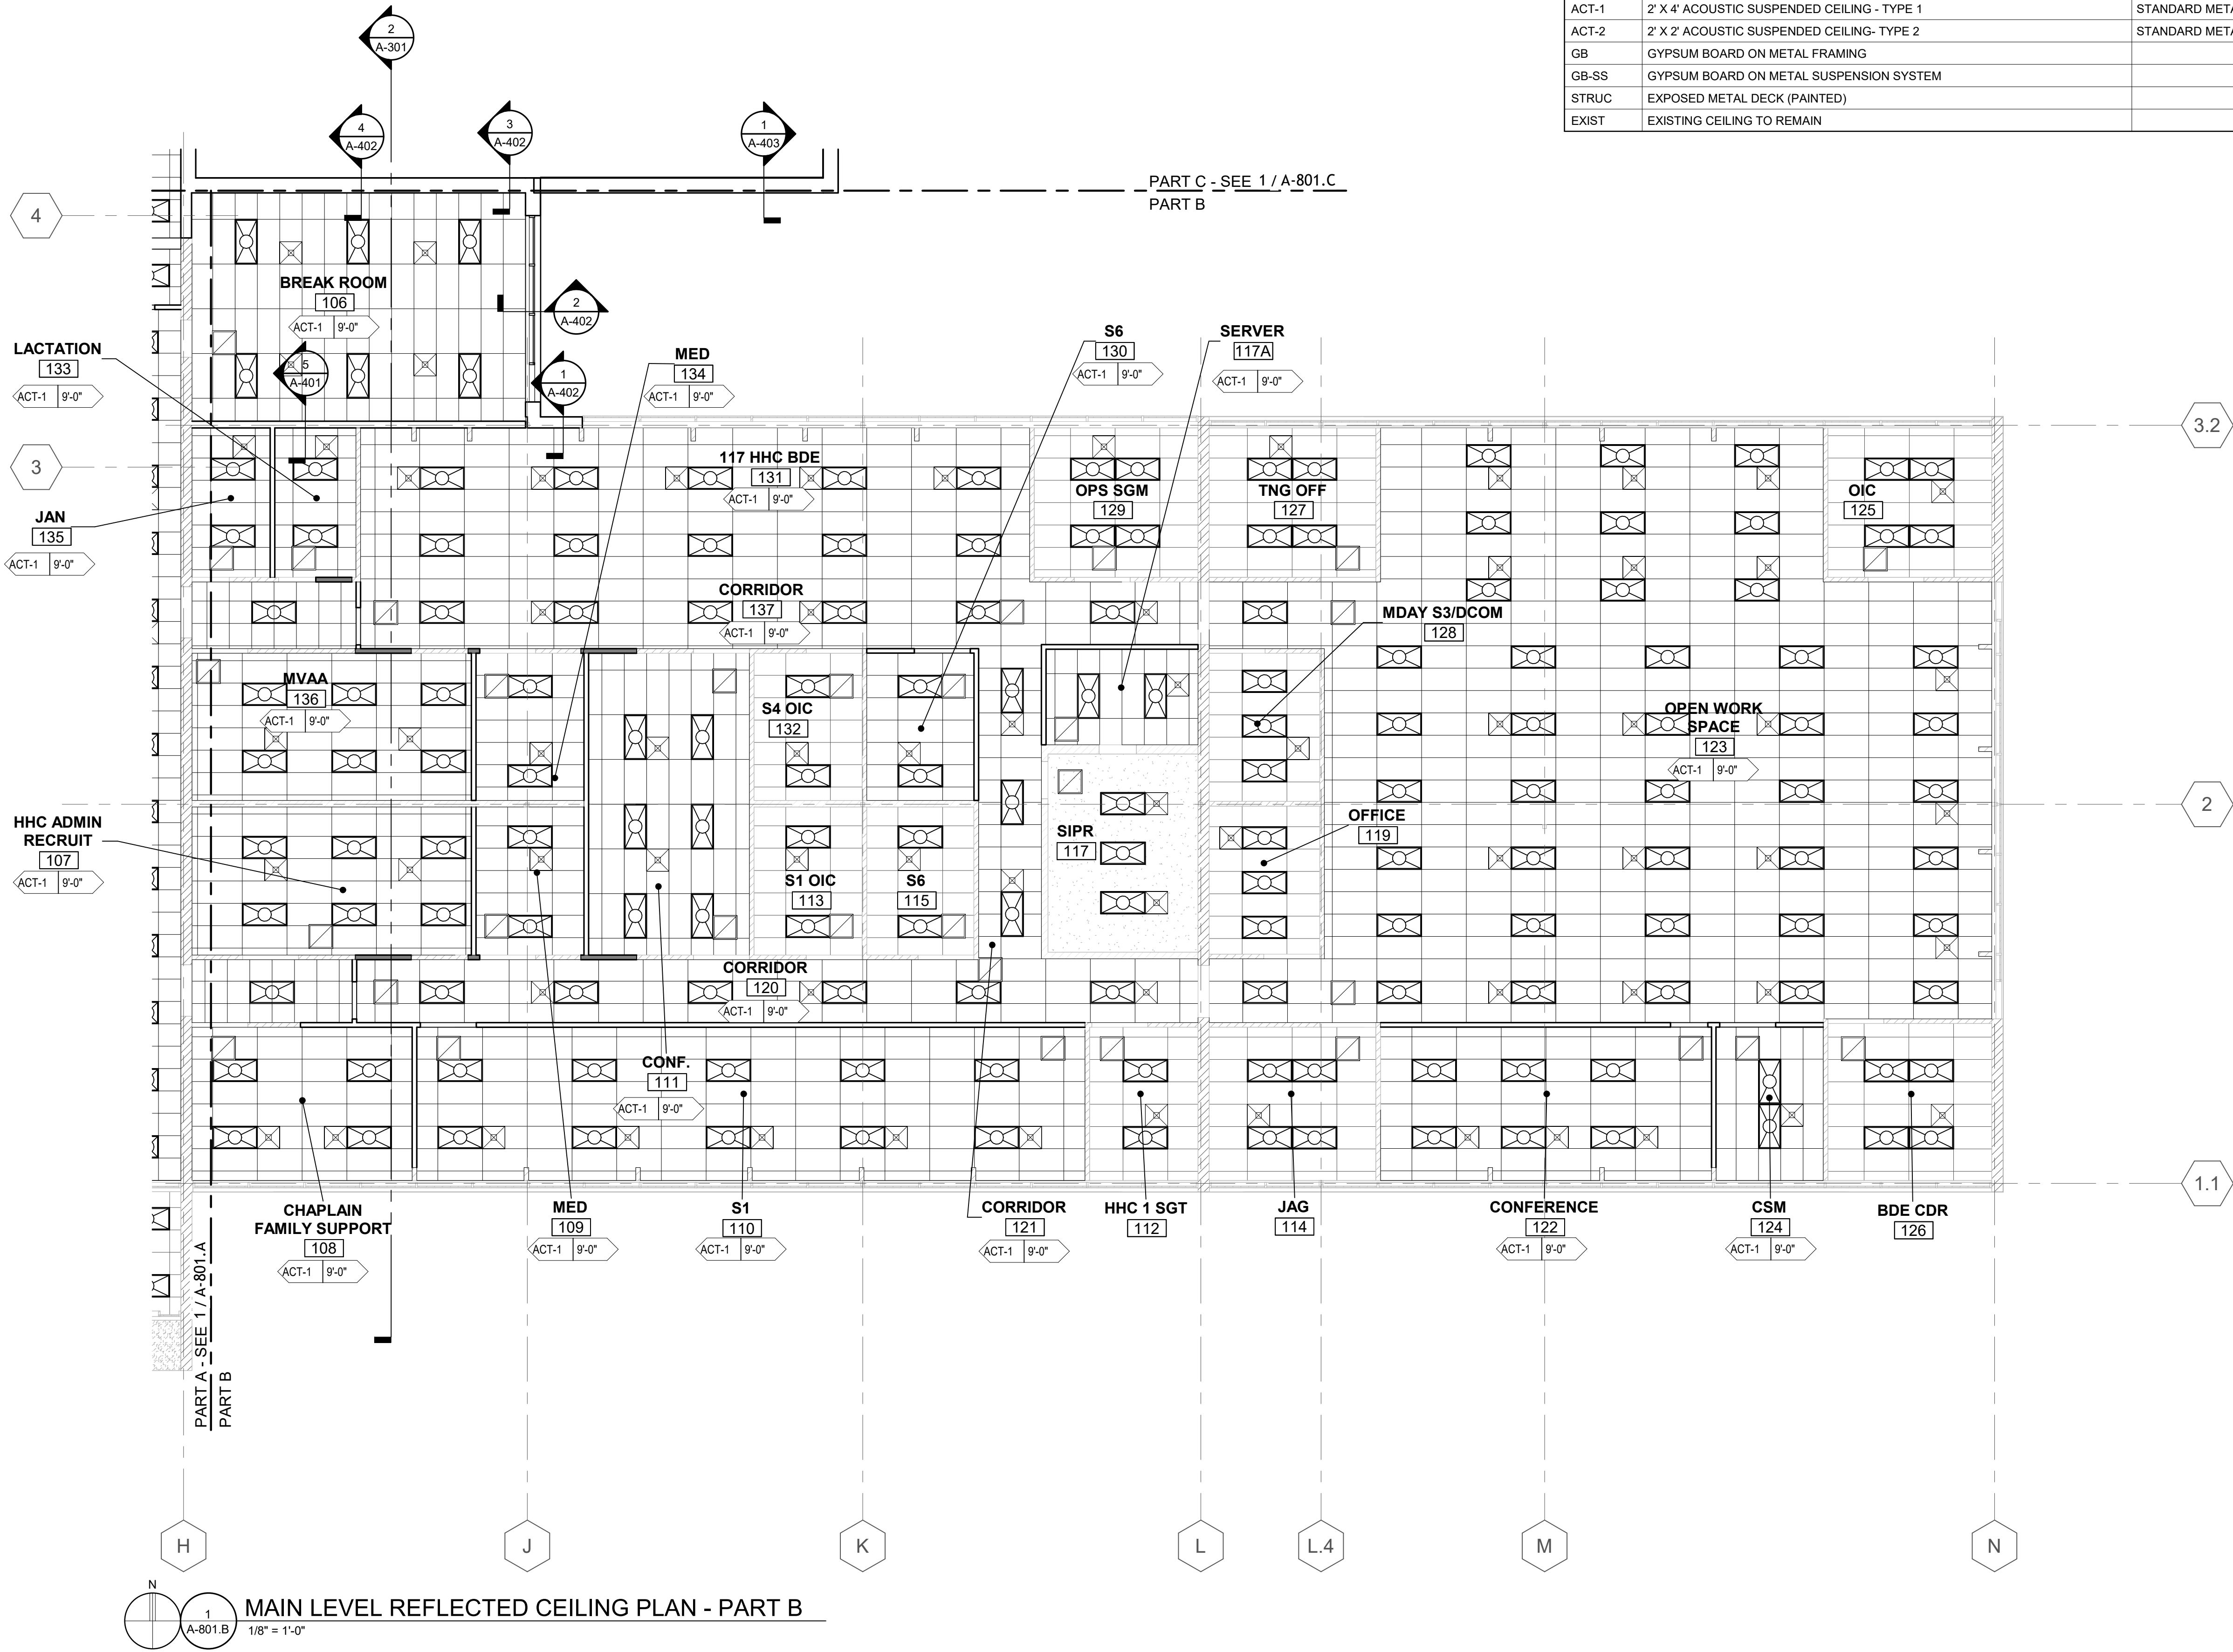

CEILING SCHEDULE

MARK	DESCRIPTION	REMARKS
ACT-1	2' X 4' ACOUSTIC SUSPENDED CEILING - TYPE 1	STANDARD METAL GRID
ACT-2	2' X 2' ACOUSTIC SUSPENDED CEILING - TYPE 2	STANDARD METAL GRID
GB	GYPSUM BOARD ON METAL FRAMING	
GB-SS	GYPSUM BOARD ON METAL SUSPENSION SYSTEM	
STRUC	EXPOSED METAL DECK (PAINTED)	
EXIST	EXISTING CEILING TO REMAIN	

REFLECTED CEILING PLAN SYMBOLS LEGEND


SYMBOL	DESCRIPTION
	2'-0"x2'-0" LAY-IN CEILING SYSTEM
	2'-0"x4'-0" LAY-IN CEILING SYSTEM
	2' X 2' LAY-IN LIGHT FIXTURE (ACT)
	2' X 2' LAY-IN LIGHT FIXTURE (GWB)
	2' X 4' LAY-IN LIGHT FIXTURE (ACT)
	2' X 4' LAY-IN LIGHT FIXTURE (GWB)
	RECESSED LIGHT FIXTURE (CIRCULAR)
	WALL MOUNTED LIGHT FIXTURE (WALL PACK)
	EXIT SIGN LIGHT FIXTURE (CLG MTD. DIRECTIONAL)
	SUPPLY AIR DIFFUSER
	RETURN AIR/EXHAUST DIFFUSER
	PAINTED DRYWALL (GB-SS) (USE MOISTURE RESIST. GYP. BD. IN TOILET RMs./ LOCKER ROOMS)
	FINISHED CEILING MATERIAL/ ELEVATION

RCP GENERAL NOTES:

- THIS PLAN IS INTENDED TO SHOW GENERAL COORDINATION OF OVERHEAD WORK. REFER TO STRUCTURAL, PLUMBING, MECHANICAL, ELECTRICAL & LOW VOLTAGE DRAWINGS FOR FURTHER INFORMATION.
- ALL CEILING HEIGHTS ARE FINISH DIMENSIONS.
- ALL CEILING TILES MUST BE CENTERED IN ROOM.
- ALL CEILING PENETRATIONS INCLUDING FIRE PROTECTION HEADS, FIRE ALARM DEVICES, LIGHT FIXTURES, SPEAKERS, ETC. MUST BE CENTERED IN THE CEILING TILE.
- PROVIDE AND INSTALL A FIRE RATED ENCLOSURE ABOVE ALL RECESSED LIGHT FIXTURES WHICH PENETRATE A FIRE RATED CEILING MEMBRANE.
- COORDINATE SIZE AND LOCATION OF ALL ACCESS PANELS WITH MECHANICAL AND ELECTRICAL DRAWINGS. ARCHITECT TO FIELD VERIFY LOCATIONS.
- COORDINATE CEILING SUSPENSION SYSTEM WITH OTHER CEILING SPACE EQUIPMENT SUPPORTING DEVICES.
- PROVIDE AND INSTALL MOISTURE RESISTANT GYPSUM BOARD AT ALL AREAS PRONE TO MOISTURE, I.E. PUBLIC TOILET ROOMS, LOCKER ROOMS/ SHOWER ROOMS, MECHANICAL ROOMS, JANITOR ROOMS/ HOUSEKEEPING ROOMS, ETC., U.N.O.
- PROVIDE AND INSTALL FIRE DAMPERS AT DUCT PENETRATIONS OF ALL FIRE RATED ASSEMBLIES. CEILING RADIATION DAMPERS ARE REQUIRED AT ALL DUCT/FAN PENETRATIONS OF THE FIRE RATED CEILINGS. COORDINATE WITH MECHANICAL DRAWINGS.
- REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

MAIN LEVEL REFLECTED CEILING PLAN - PART B

1/8" = 1'-0"

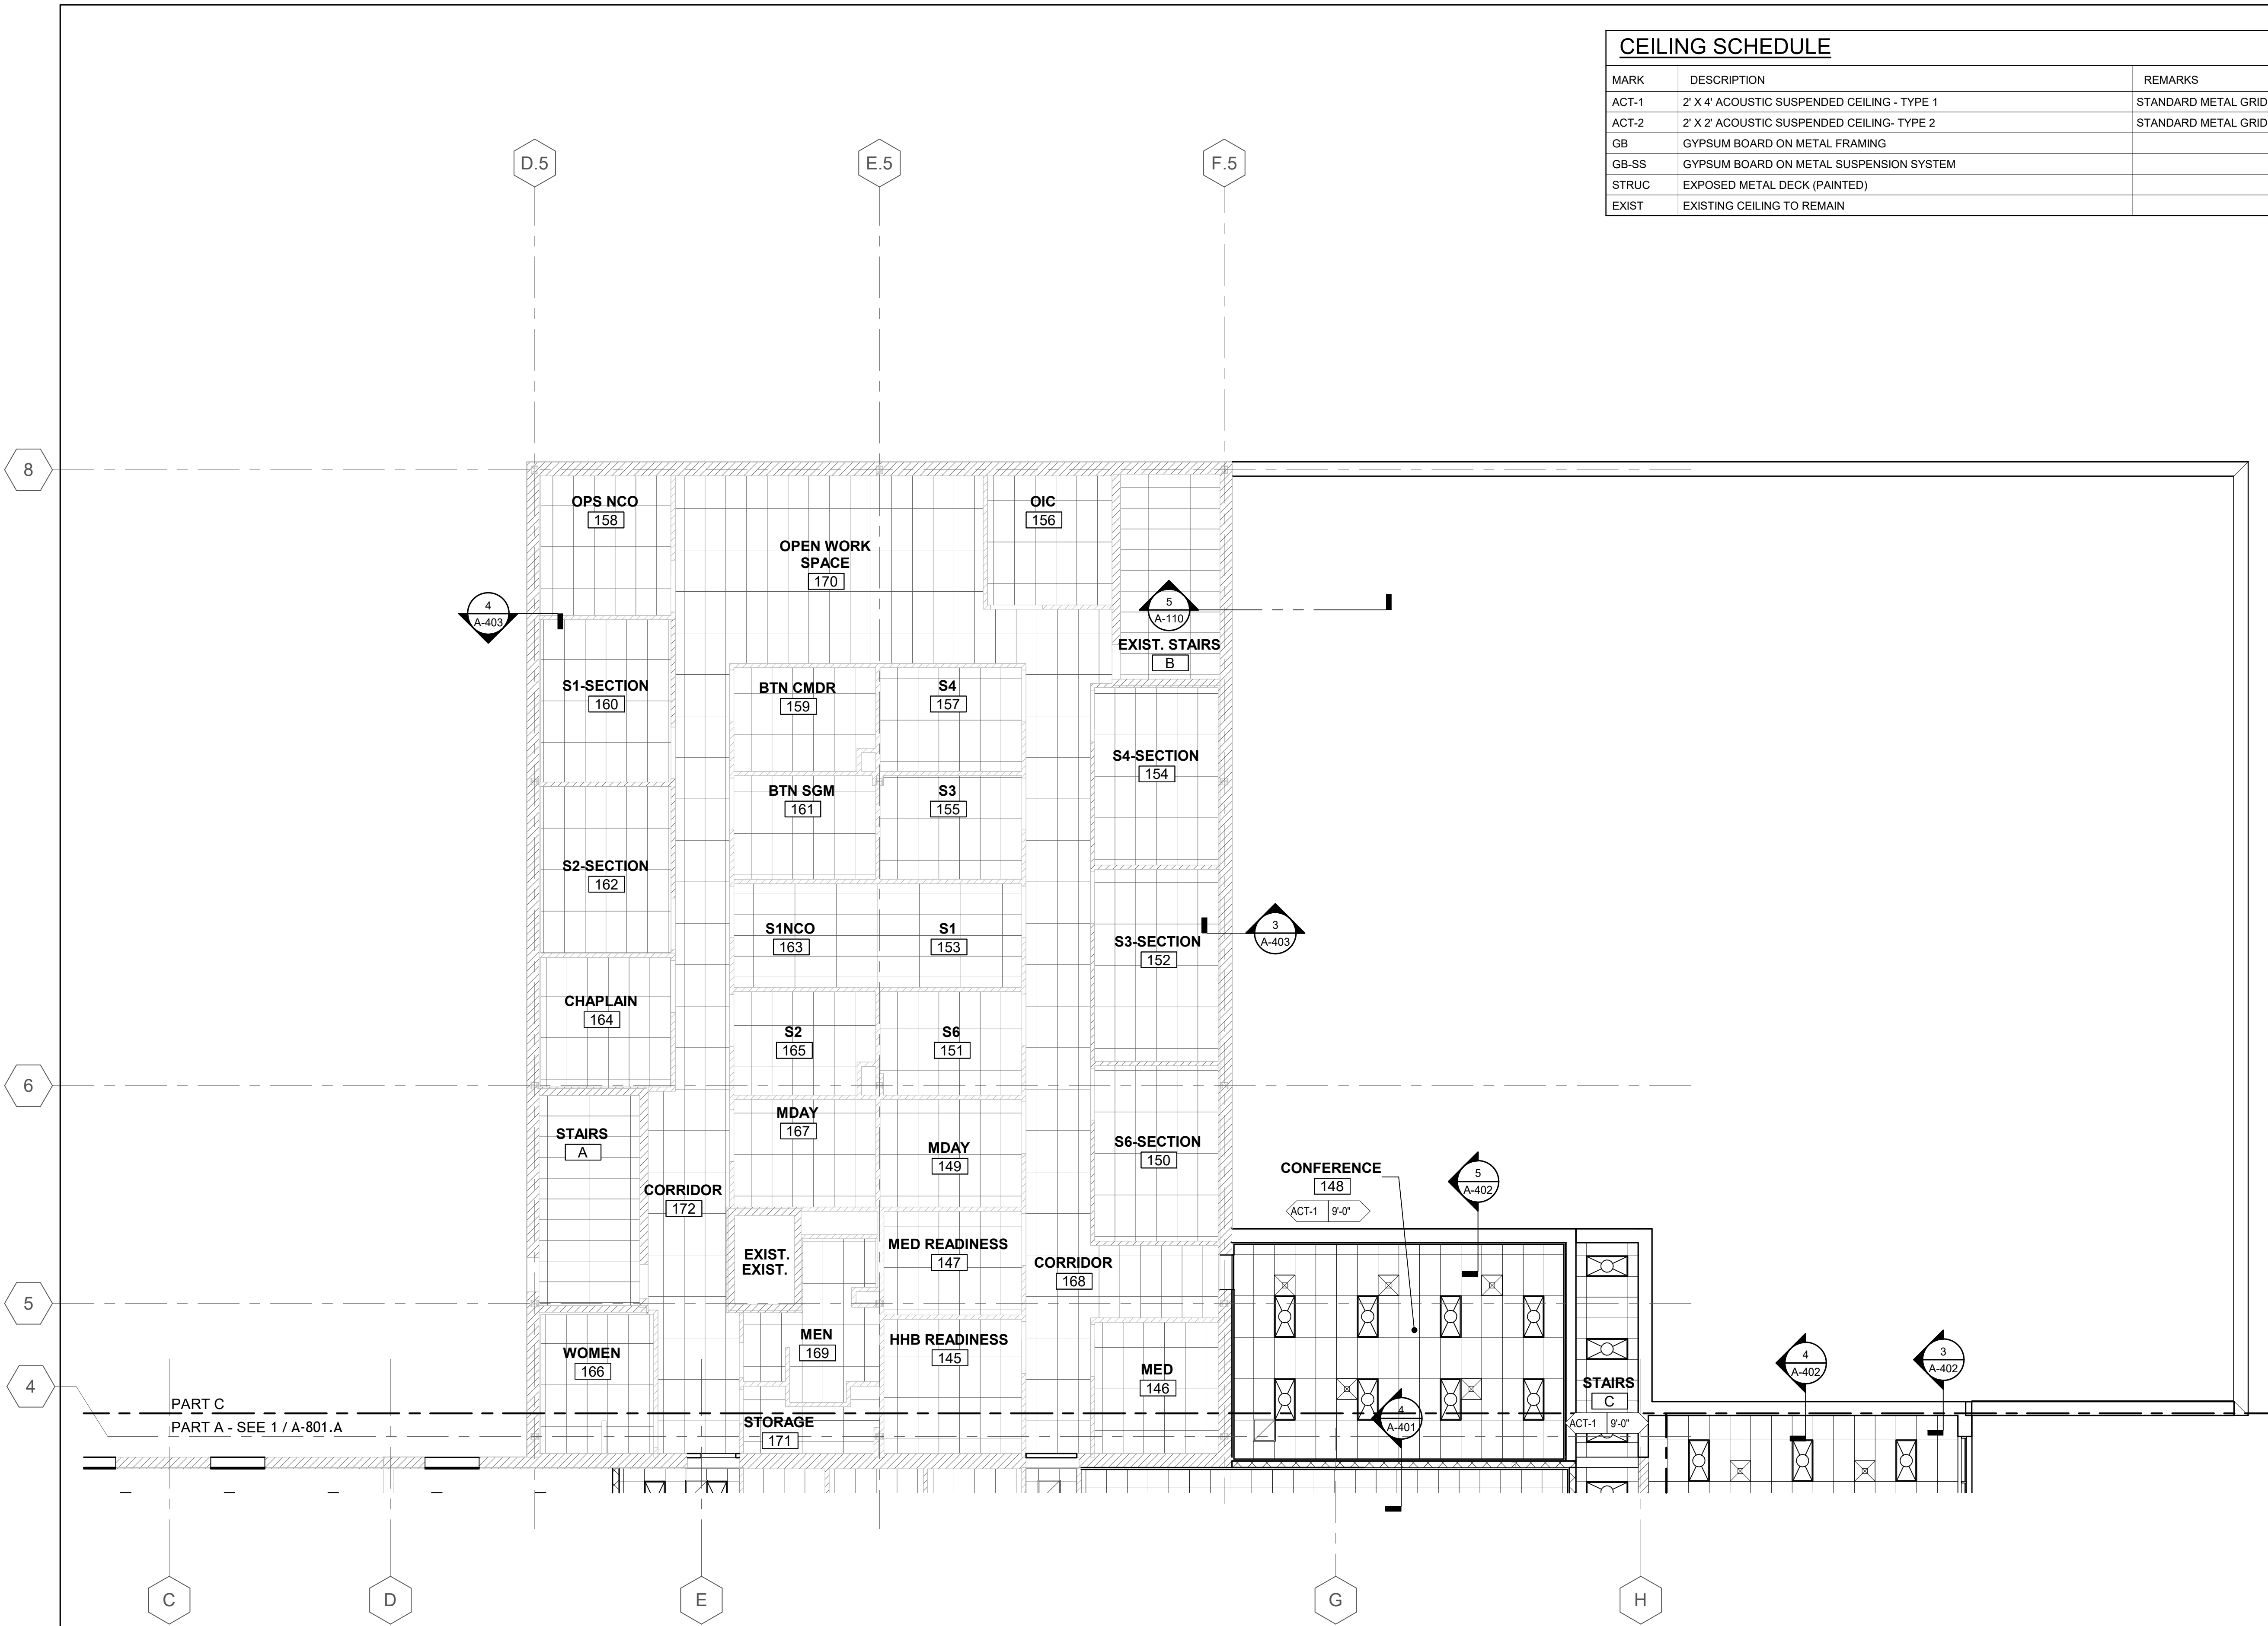

CEILING SCHEDULE

MARK	DESCRIPTION	REMARKS
ACT-1	2' X 4' ACOUSTIC SUSPENDED CEILING - TYPE 1	STANDARD METAL GRID
ACT-2	2' X 2' ACOUSTIC SUSPENDED CEILING- TYPE 2	STANDARD METAL GRID
GB	GYPSUM BOARD ON METAL FRAMING	
GB-SS	GYPSUM BOARD ON METAL SUSPENSION SYSTEM	
STRUC	EXPOSED METAL DECK (PAINTED)	
EXIST	EXISTING CEILING TO REMAIN	

REFLECTED CEILING PLAN SYMBOLS LEGEND

SYMBOL	DESCRIPTION
	2'-0"x2'-0" LAY-IN CEILING SYSTEM
	2'-0"x4'-0" LAY-IN CEILING SYSTEM
	2' X 2' LAY-IN LIGHT FIXTURE (ACT)
	2' X 2' LAY-IN LIGHT FIXTURE (GWB)
	2' X 4' LAY-IN LIGHT FIXTURE (ACT)
	2' X 4' LAY-IN LIGHT FIXTURE (GWB)
	RECESSED LIGHT FIXTURE (CIRCULAR)
	WALL MOUNTED LIGHT FIXTURE (WALL PACK)
	EXIT SIGN LIGHT FIXTURE (CLG MTD. DIRECTIONAL)
	SUPPLY AIR DIFFUSER
	RETURN AIR/EXHAUST DIFFUSER
	PAINTED DRYWALL (GB-SS) (USE MOISTURE RESIST. GYP. BD. IN TOILET RMs./ LOCKER ROOMS)
	FINISHED CEILING MATERIAL/ ELEVATION

RCP GENERAL NOTES:

- THIS PLAN IS INTENDED TO SHOW GENERAL COORDINATION OF OVERHEAD WORK. REFER TO STRUCTURAL, PLUMBING, MECHANICAL, ELECTRICAL & LOW VOLTAGE DRAWINGS FOR FURTHER INFORMATION.
- ALL CEILING HEIGHTS ARE FINISH DIMENSIONS.
- ALL CEILING TILES MUST BE CENTERED IN ROOM.
- ALL CEILING PENETRATIONS INCLUDING FIRE PROTECTION HEADS, FIRE ALARM DEVICES, LIGHT FIXTURES, SPEAKERS, ETC. MUST BE CENTERED IN THE CEILING TILE.
- PROVIDE AND INSTALL A FIRE RATED ENCLOSURE ABOVE ALL RECESSED LIGHT FIXTURES WHICH PENETRATE A FIRE RATED CEILING MEMBRANE.
- COORDINATE SIZE AND LOCATION OF ALL ACCESS PANELS WITH MECHANICAL AND ELECTRICAL DRAWINGS. ARCHITECT TO FIELD VERIFY LOCATIONS.
- COORDINATE CEILING SUSPENSION SYSTEM WITH OTHER CEILING SPACE EQUIPMENT SUPPORTING DEVICES.
- PROVIDE AND INSTALL MOISTURE RESISTANT GYPSUM BOARD AT ALL AREAS PRONE TO MOISTURE, I.E. PUBLIC TOILET ROOMS, LOCKER ROOMS/ SHOWER ROOMS, MECHANICAL ROOMS, JANITOR ROOMS/ HOUSEKEEPING ROOMS, ETC., U.N.O.
- PROVIDE AND INSTALL FIRE DAMPERS AT DUCT PENETRATIONS OF ALL FIRE RATED ASSEMBLIES. CEILING RADIATION DAMPERS ARE REQUIRED AT ALL DUCT/FAN PENETRATIONS OF THE FIRE RATED CEILINGS, COORDINATE WITH MECHANICAL DRAWINGS.
- REFER TO SPECIFICATIONS MANUAL FOR ADDITIONAL INFORMATION.

1
A-801.C
1/8" = 1'-0"

MAIN LEVEL REFLECTED CEILING PLAN - PART C



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS

MISSDIG811

FOR SITE OWNED UTILITIES



STATE OF MICHIGAN
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, P.A., DIRECTOR



RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI



SHEET TITLE: MAIN LEVEL REFLECTED CEILING PLAN - PART C

DESIGNED	HL
DRAWN	HLNC
CHECKED	TM
APPROVED	RMR

ISSUED FOR:	DATE
PRELIMINARY	01/15/26
CONSTRUCTION	☒
FINAL RECORD	☐

IDENTIFICATION NO:
PROJECT NO: 25510.A
DWG: 25225007
FILE NO/INDEX CODE:
51725039.CAK

A-801.C

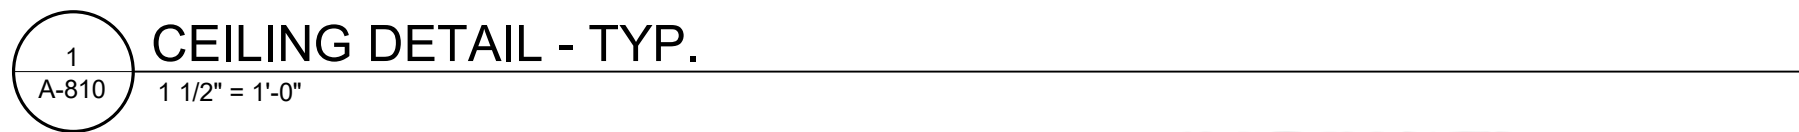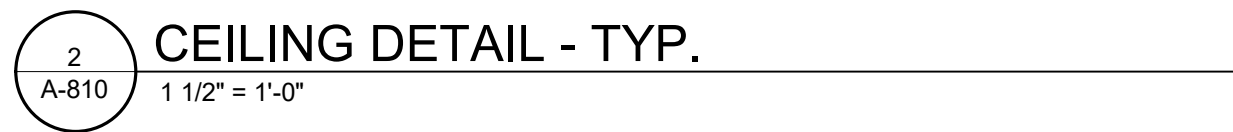

DTMB
Technology, Management & Budget



Sidock Group, Inc.
ENGINEERS • ARCHITECTS • CONSULTANTS • PROJECT MANAGERS



FOR SITE OWNED UTILITIES



72 HOURS
(3 WORKING DAYS)
BEFORE YOU DIE
CALL: MR. ZIMMERMAN
PH: (248) 606-8821
FACILITIES MANAGEMENT

SHEET TITLE: CEILING DETAILS

IDENTIFICATION NO:
PROJECT NO: 25510.A
DMVA: 2622825007
FILE NO./INDEX CODE:
511/25039.CAK

A-810
SHEET

RENOVATE ARMORY, JACKSON (WEST) ARMORY
DEPARTMENT OF MILITARY AND VETERANS AFFAIRS
2700 W ARGYLE ST., JACKSON, MI

STATE OF MICHIGAN
DEPARTMENT OF TECHNOLOGY, MANAGEMENT, AND BUDGET
FACILITIES AND BUSINESS SERVICES ADMINISTRATION
DESIGN AND CONSTRUCTION DIVISION
ADAM P. LARCH, R.A., DIRECTOR